




Coire Glas Grid Connecton Project Figure 12.1 - Viewpoint 1: A87 at Invergarry (West) OS reference: Ground level: Direction of view: 229407 E 801079 N Camera: 56.7 m AOD Lens: 270° Camera he 2647.8 m Date and to

Camera height: Date and time:

Sony ILCE-7RM3 Horizontal field of view: 50mm (Sony DT50mm f/1.2)) Principal distance: 1.5m AGL 08/03/2022 11:41

90° (cylindrical projection) 522 mm

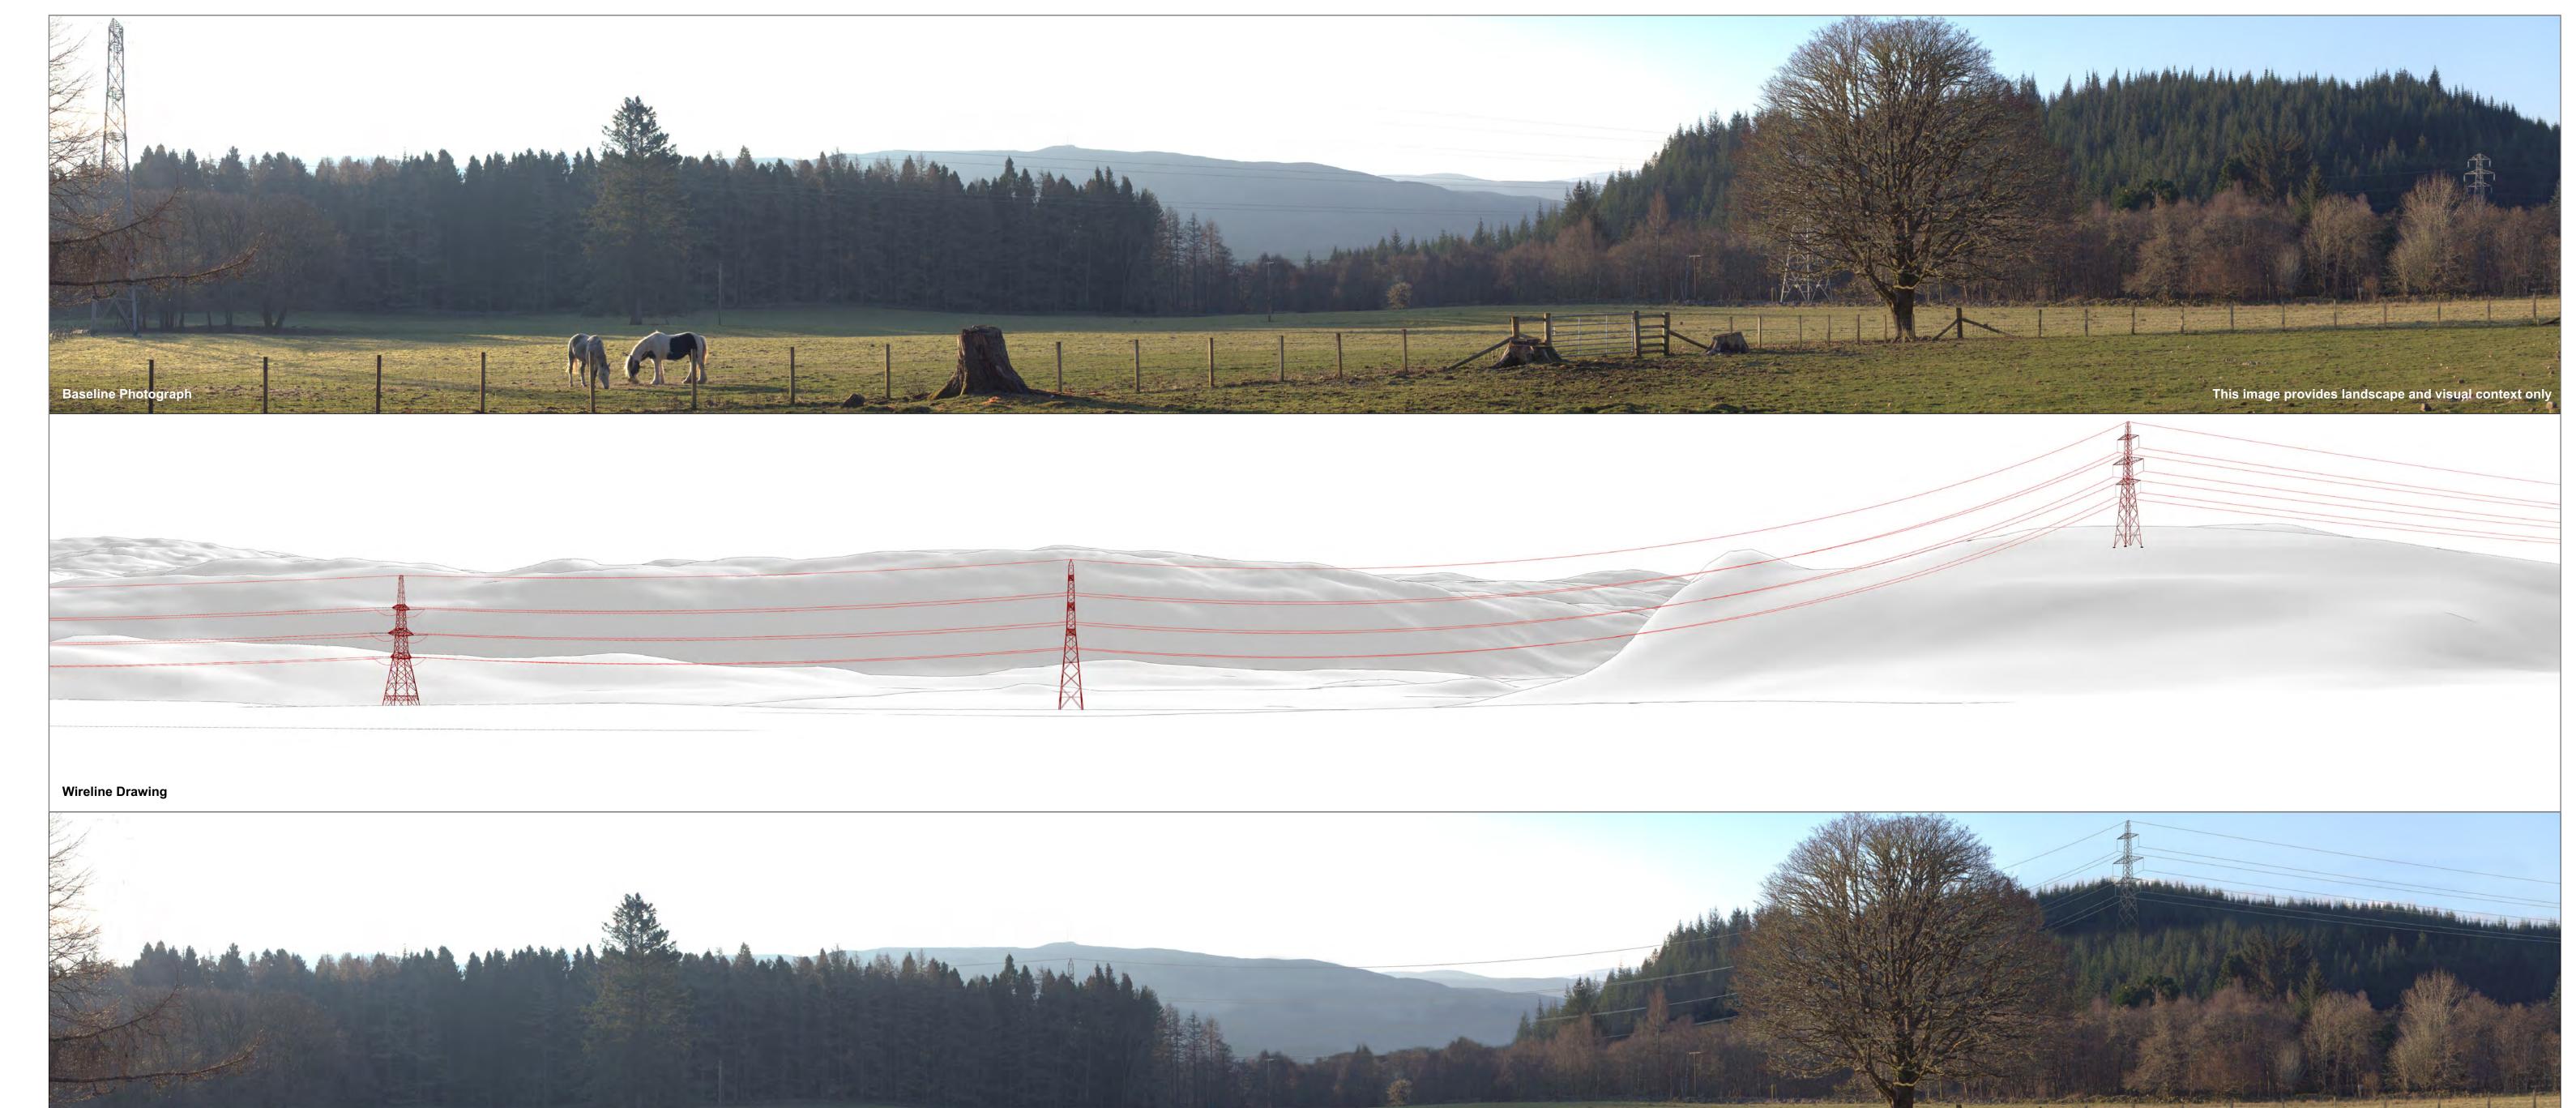

Coire Glas Grid Connecton Project Figure 13.1 - Viewpoint 2: Auchterawe Road (at Torr Dhuin) The existing 132 kV Fort Augustus to Fort William overhead line has been removed from the photomontage as it is anticipated that this overhead line will be decommissioned and dismantled once the new 400 kV overhead line is installed for the Coire Glas Grid

OS reference:

Ground level:

Direction of vie

Direction of view: Nearest tower:

234865 E 807668 N Camera: 63.9 m AOD Lens: 514.7 m

Camera height: Date and time:

Sony ILCE-7RM3 Horizontal field of view: 50mm (Sony DT50mm f/1.2)) Principal distance: 1.5m AGL 08/03/2022 08:06

90° (cylindrical projection) 522 mm

Note: A pitch angle of +2° has been applied to the wireline and photographs on this figure.