




Baseline Photograph

This image provides landscape and visual context only

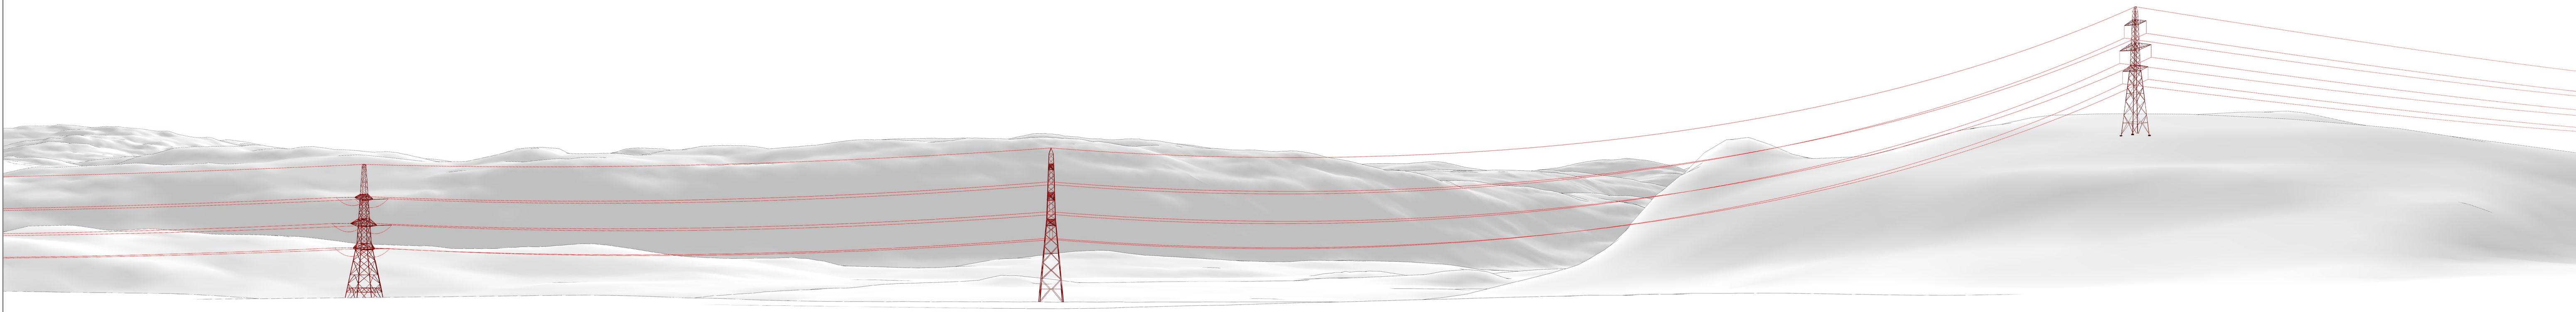

Wireline Drawing



Photomontage

Coire Glas Grid Connecton Project  
 Figure 13.1 - Viewpoint 2: Auchterawe Road (at Torr Dhuin)

The existing 132 kV Fort Augustus to Fort William overhead line has been removed from the photomontage as it is anticipated that this overhead line will be decommissioned and dismantled once the new 400 kV overhead line is installed for the Coire Glas Grid Connection

Note: A pitch angle of +2° has been applied to the wireline and photographs on this figure.

OS reference: 234865 E 807668 N  
 Ground level: 63.9 m AOD  
 Direction of view: 166°  
 Nearest tower: 514.7 m

Camera: Sony ILCE-7RM3  
 Lens: 50mm (Sony DT50mm f/1.2)  
 Camera height: 1.5m AGL  
 Date and time: 08/03/2022 08:06

Horizontal field of view: 90° (cylindrical projection)  
 Principal distance: 522 mm

