


Wireline Drawing

Coire Glas Grid Connecton Project
 Figure 11.5.1 - Cultural Heritage Viewpoint 3: Auchterawe Road (at Torr Dhuin)

The tie-in leads into the Fort Augustus Substation are not illustrated in this wireline
 Note: A pitch angle of +2° has been applied to the wireline and photograph on this figure.

OS reference:	234865 E 807668 N	Camera:	Sony ILCE-7RM3	Horizontal field of view:	90° (cylindrical projection)
Ground level:	63.9 m AOD	Lens:	50mm (Sony DT50mm f/1.2))	Principal distance:	522 mm
Direction of view:	97°	Camera height:	1.5m AGL		
Nearest tower:	513.9 m	Date and time:	08/03/2022 08:06		

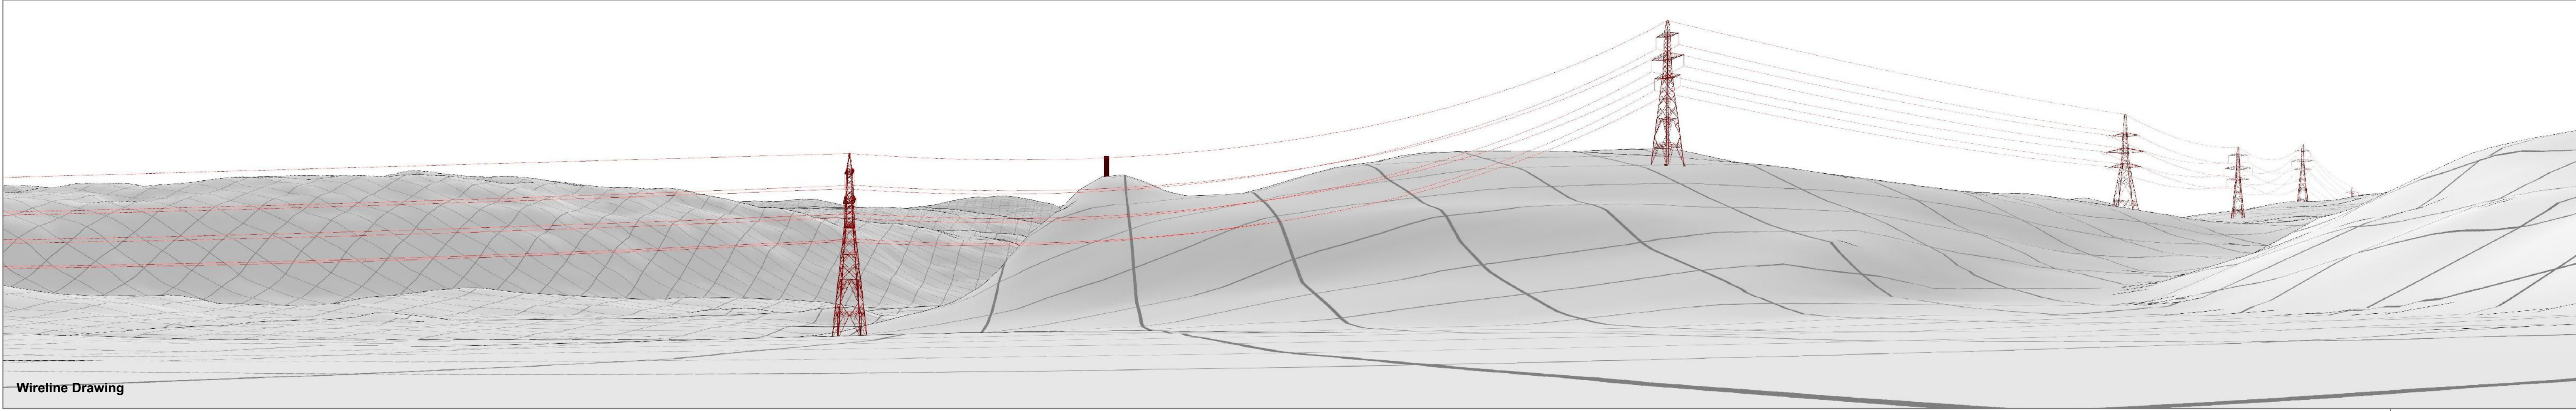

Coire Glas Grid Connecton Project
 Figure 11.5.2 - Cultural Heritage Viewpoint 3: Auchterawe Road (at Torr Dhuin)


Note: A pitch angle of +3° has been applied to the wireline and photograph on this figure.

OS reference:	234865 E 807668 N	Camera:	Sony ILCE-7RM3	Horizontal field of view:	90° (cylindrical projection)
Ground level:	63.9 m AOD	Lens:	50mm (Sony DT50mm f/1.2)	Principal distance:	522 mm
Direction of view:	187°	Camera height:	1.5m AGL		
Nearest tower:	513.9 m	Date and time:	08/03/2022 08:06		



Baseline Photograph

This image provides landscape and visual context only

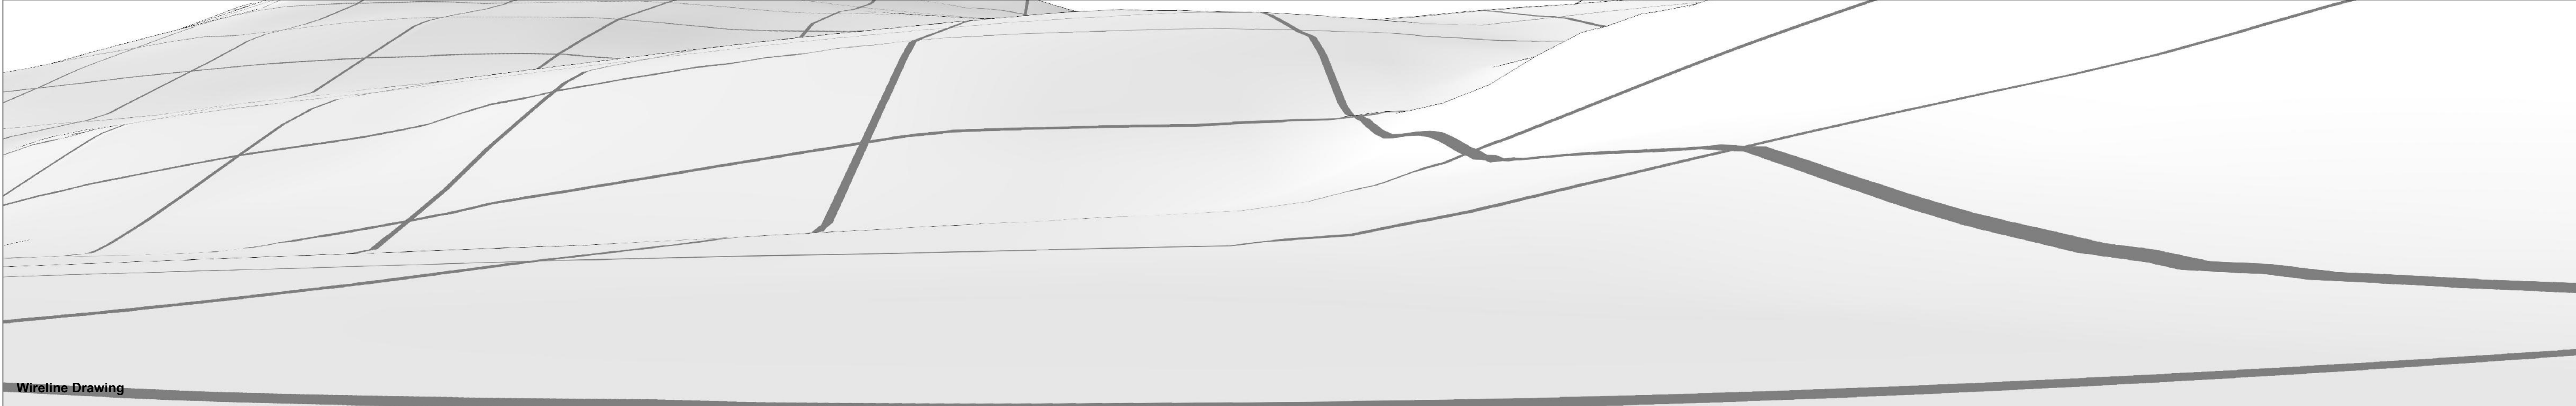

Wireline Drawing

Coire Glas Grid Connecton Project
 Figure 11.5.3 - Cultural Heritage Viewpoint 3: Auchterawe Road (at Torr Dhuin)

Note: A pitch angle of +2° has been applied to the wireline and photograph on this figure.	OS reference: 234865 E 807668 N	Camera: Sony ILCE-7RM3	Horizontal field of view: 90° (cylindrical projection)
Ground level: 63.9 m AOD	Direction of view: 277°	Lens: 50mm (Sony DT50mm f/1.2)	Principal distance: 522 mm
Nearest tower: 513.9 m		Camera height: 1.5m AGL	
		Date and time: 08/03/2022 08:06	


Drawing No. - 121012-D-EIA-11.5.3-1.0.0 Date - 28.03.2023





Baseline Photograph

This image provides landscape and visual context only

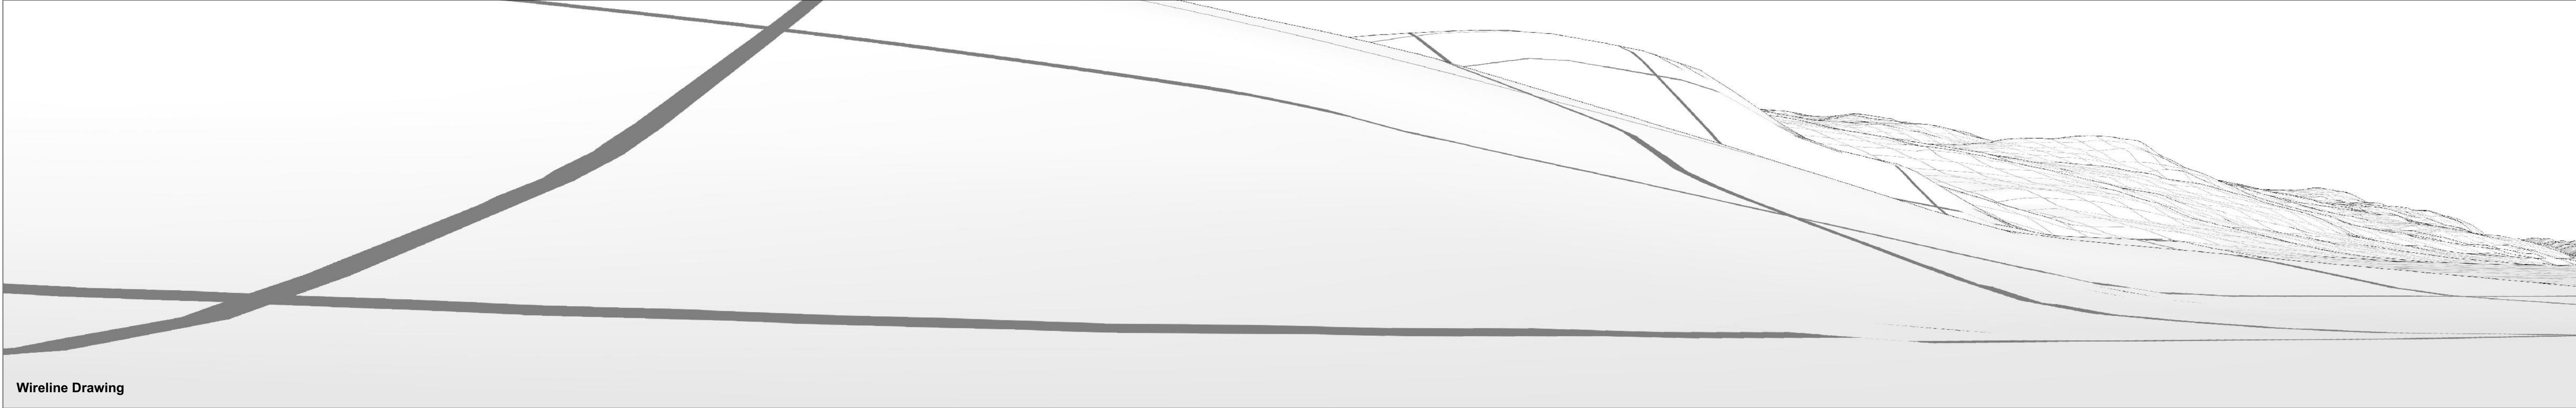

Wireline Drawing

Coire Glas Grid Connecton Project
 Figure 11.5.4 - Cultural Heritage Viewpoint 3: Auchterawe Road (at Torr Dhuin)


Note: A pitch angle of +2° has been applied to the wireline and photograph on this figure.

OS reference: 234865 E 807668 N
 Ground level: 63.9 m AOD
 Direction of view: 07°
 Nearest tower: 513.9 m

Camera: Sony ILCE-7RM3
 Lens: 50mm (Sony DT50mm f/1.2)
 Camera height: 1.5m AGL
 Date and time: 08/03/2022 08:06

Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm



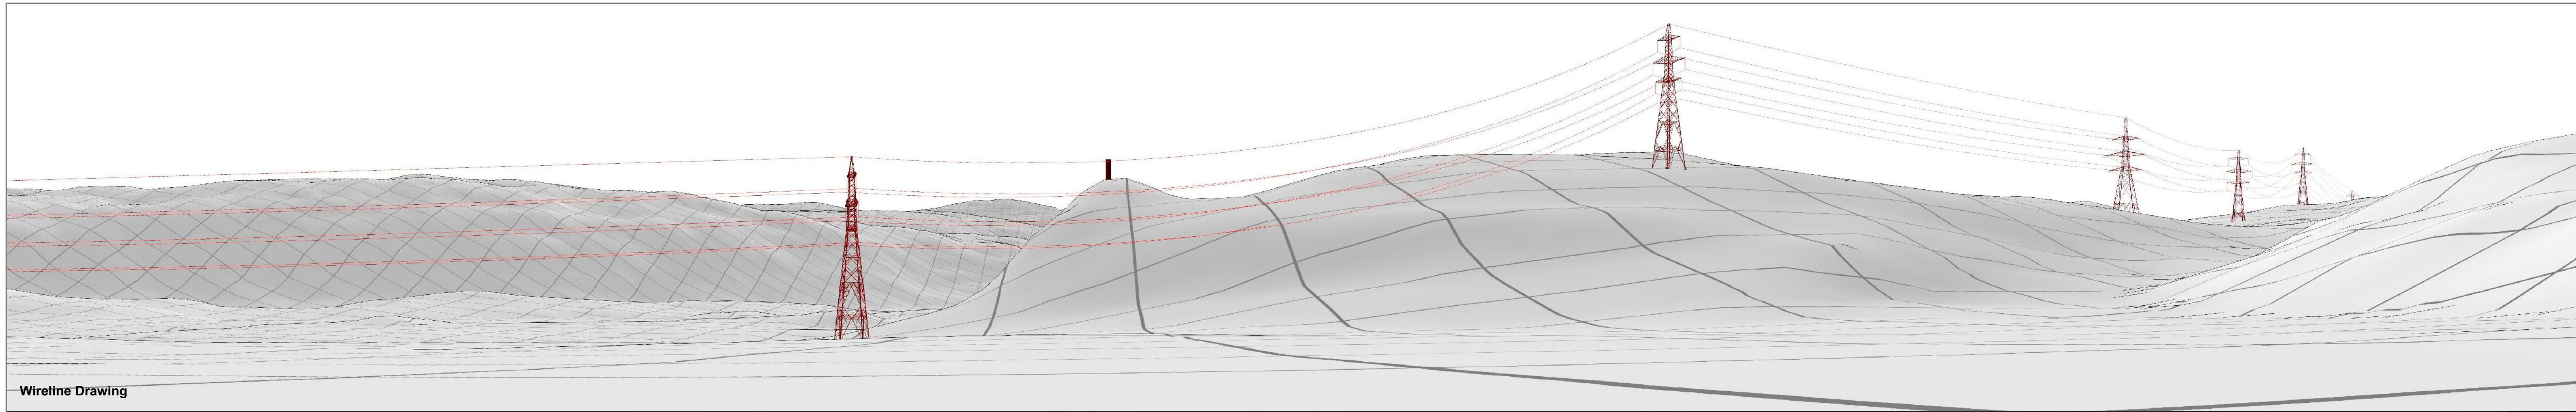

Wireline Drawing



Photomontage

Coire Glas Grid Connecton Project
 Figure 11.5.5 - Cultural Heritage Viewpoint 3: Auchterawe Road (at Torr Dhuin) - Photomontage

The existing 132 kV Fort Augustus to Fort William overhead line has been removed from the photomontage as it is anticipated that this overhead line will be decommissioned and dismantled once the new 400 kV overhead line is installed for the Coire Glas Grid Connection

Note: A pitch angle of +3° has been applied to the wireline and photographs on this figure.

OS reference: 234865 E 807668 N
 Ground level: 63.9 m AOD
 Direction of view: 187°
 Nearest tower: 513.9 m

Camera: Sony ILCE-7RM3
 Lens: 50mm (Sony DT50mm f/1.2)
 Camera height: 1.5m AGL
 Date and time: 08/03/2022 08:06

Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm

Drawing No. - 121012-D-EIA-11.5.5-1.0.0 Date - 28.03.2023