



TRANSMISSION

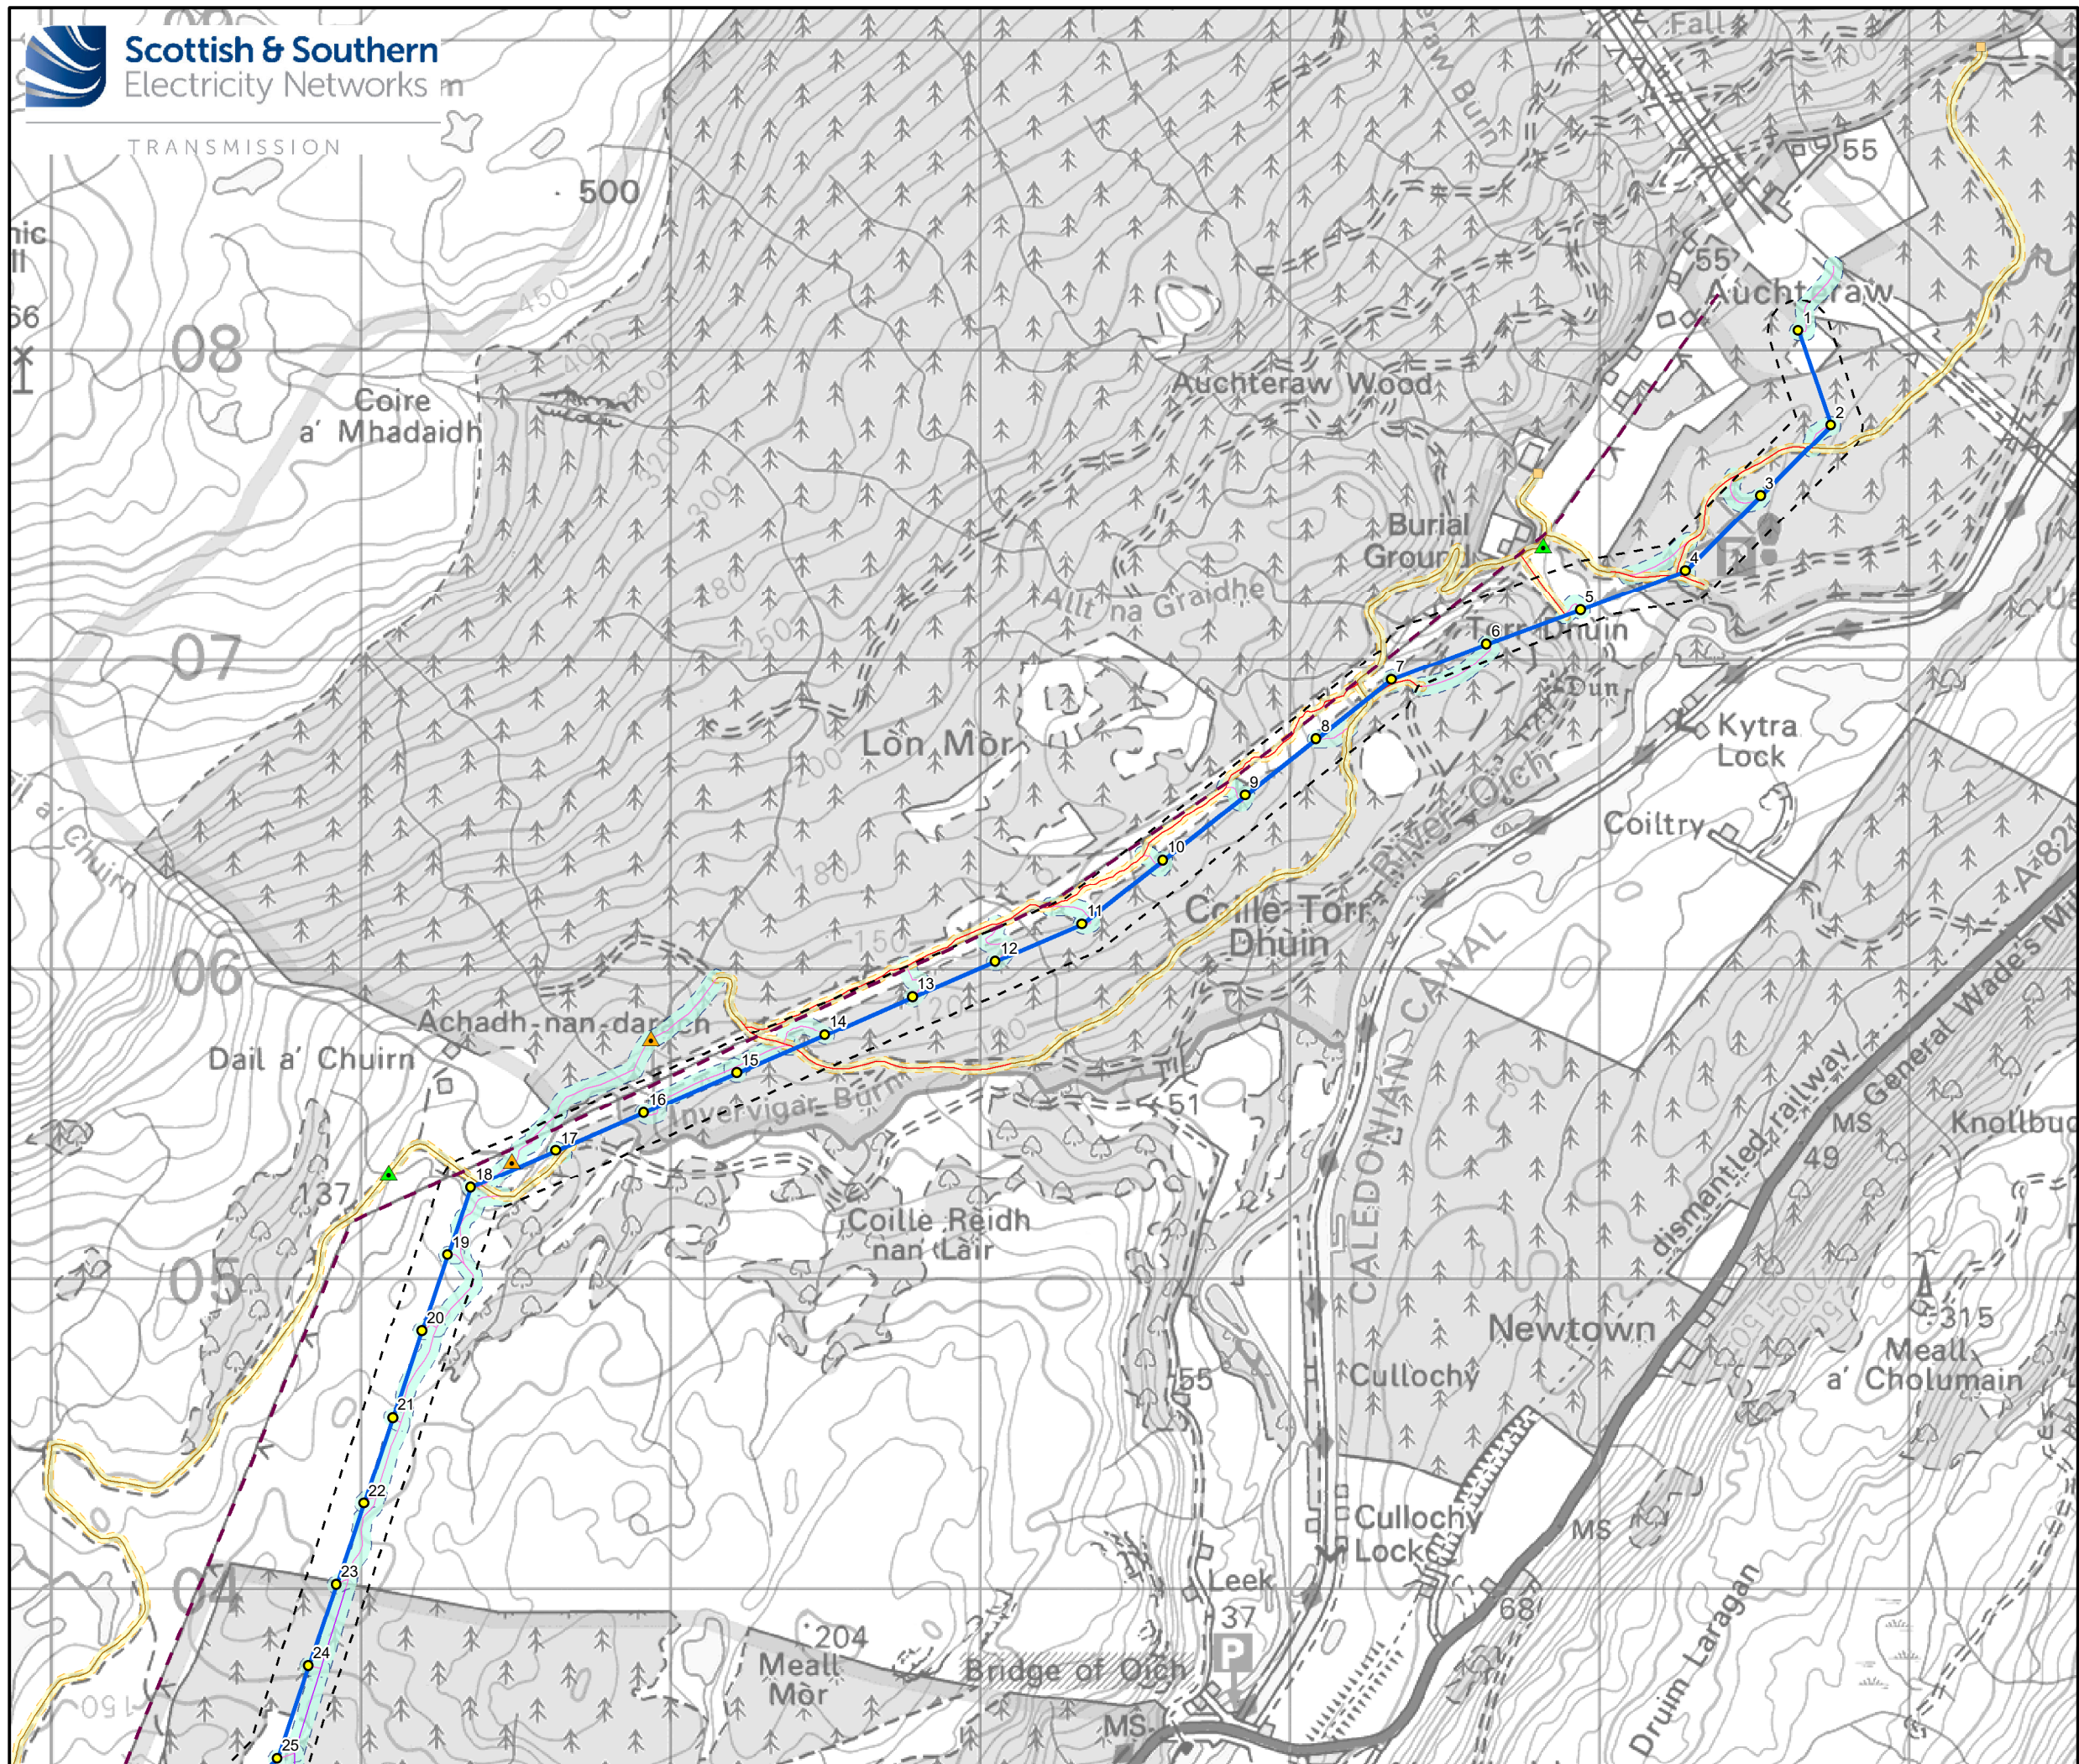

- Legend**
- Proposed OHL Alignment (Steel Lattice Towers)
 - Proposed Steel Lattice Tower
- Limits of Deviation (LOD)**
- OHL Alignment LOD
 - Existing Access Track LOD
 - New Access Track LOD
- Existing 132 KV Fort Augustus to Fort William OHL**
- to be dismantled
- Access Tracks**
- Existing Track (No Upgrades Required)
 - Existing Track (to be Upgraded)
 - New Track (Temporary)
 - New Track to be Retained (Construction Method to be Decided)



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2023 all rights reserved.
Ordnance Survey Licence number EL273236.

Project: Coire Glas Grid Connection Project – 400 kV OHL EIA Report

Title: Figure 3.1c - The Proposed Development (North)

Drawn by: KM Date: 31/03/2023

Drawing: 121012-EIA-D3.1c-1.0.0