


TRANSMISSION

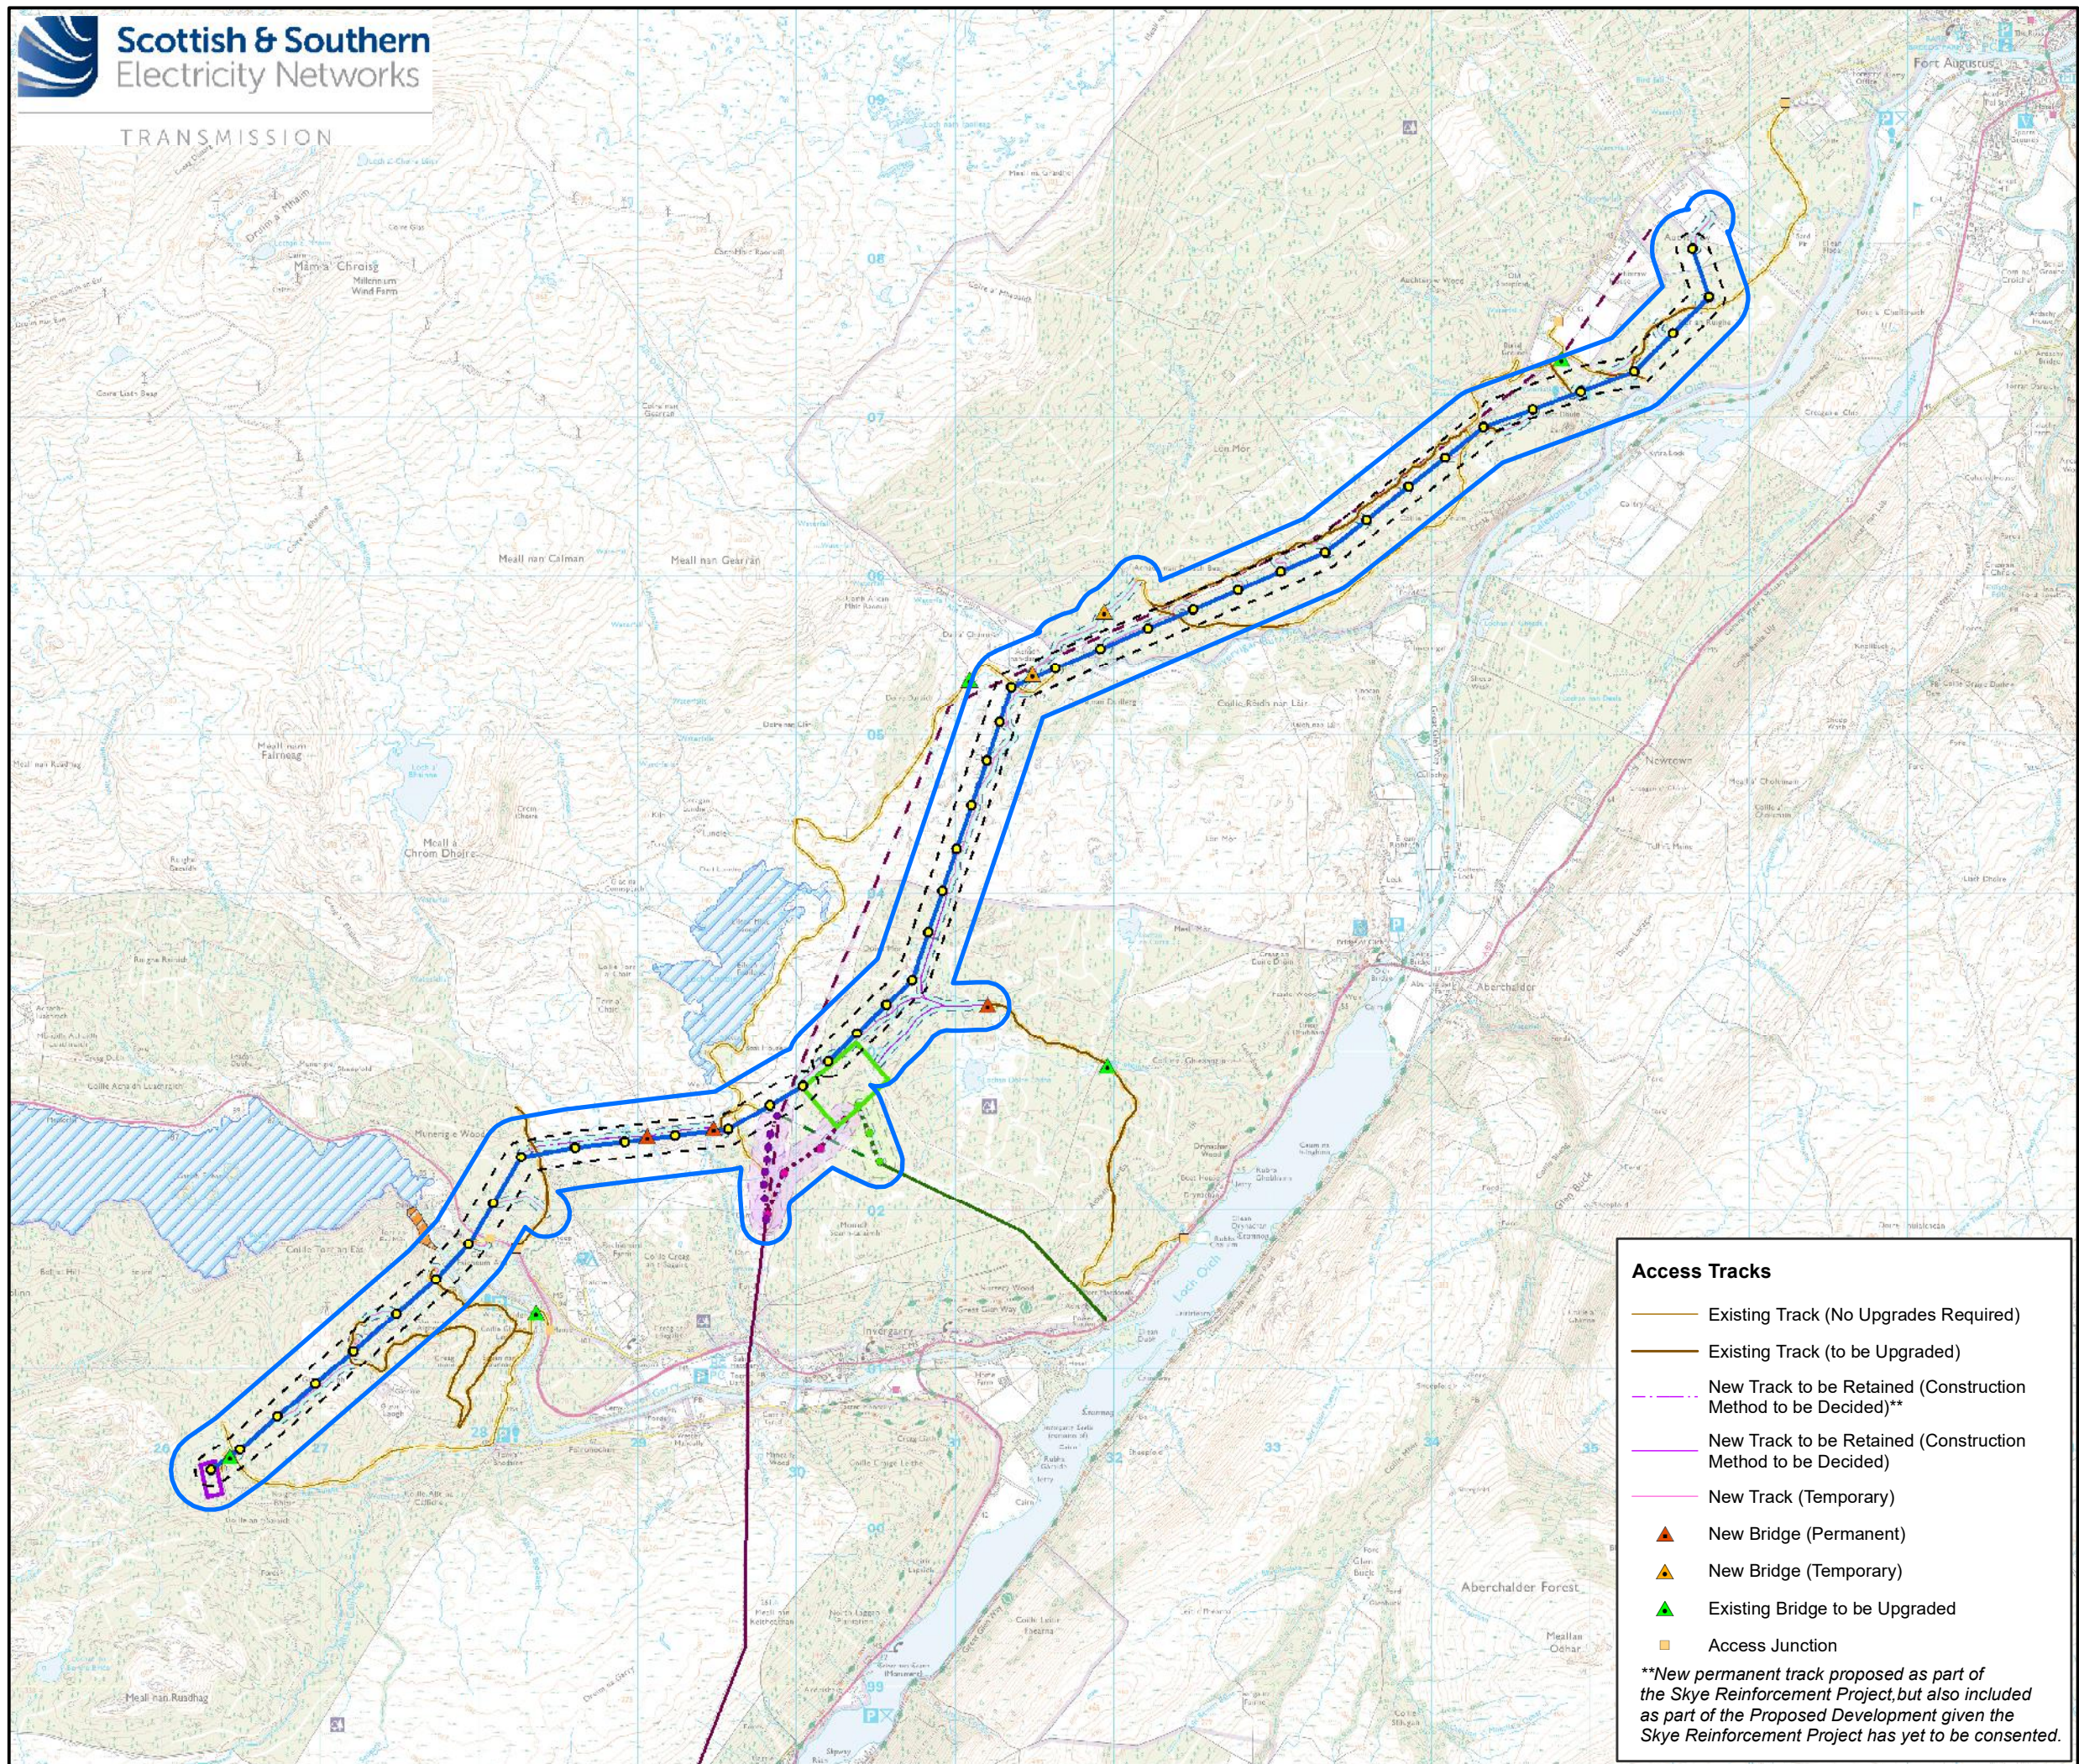

### Legend

- Proposed OHL Alignment (Steel Lattice Towers)
- Proposed Steel Lattice Tower
- Proposed Coire Glas Switching Station Platform\*
- Proposed Loch Lundie Substation Platform\*

### Limit of Deviations (LOD)

- OHL Alignment LOD
- Existing Access Track
- New Access Track
- Invergarry Tee OHL Diversion LOD
- Fort Augustus to Fort William OHL Diversion LOD

### Existing 132 KV Invergarry Tee OHL (Steel Lattice Towers)

- new permanent Trident Steel Pole location
- to be retained
- - - to be diverted into the proposed Loch Lundie Substation
- - - to be dismantled

### Existing 132 KV Fort Augustus to Fort William OHL (Steel Lattice Towers)

- temporary Trident Wood Pole locations
- - - temporary OHL diversion
- new permanent Steel Lattice Tower location
- to be retained
- - - to be diverted into the proposed Loch Lundie Substation
- - - to be dismantled

### Sites of Nature Conservation


- Study Area
- Garry Falls SSSI
- South Laggan Fen SSSI
- West Inverness-shire Lochs SPA, SSSI

### Access Tracks

- Existing Track (No Upgrades Required)
- Existing Track (to be Upgraded)
- - - New Track to be Retained (Construction Method to be Decided)\*\*
- - - New Track to be Retained (Construction Method to be Decided)
- - - New Track (Temporary)
- ▲ New Bridge (Permanent)
- ▲ New Bridge (Temporary)
- ▲ Existing Bridge to be Upgraded
- Access Junction

**\*\*New permanent track proposed as part of the Skye Reinforcement Project, but also included as part of the Proposed Development given the Skye Reinforcement Project has yet to be consented.**

\*Associated works subject to separate consent under the Town and County Planning (Scotland) Act 1997. Footprints show indicative locations only.



Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2023 all rights reserved. Ordnance Survey Licence number EL273236.


Project: Coire Glas Grid Connection Project – 400 kV OHL EIA Report

Title: Figure 8.1a - Sites of Nature Conservation Statutory Designations

Drawn by: HC Date: 29/03/2023

Drawing:

**TRANSMISSION**

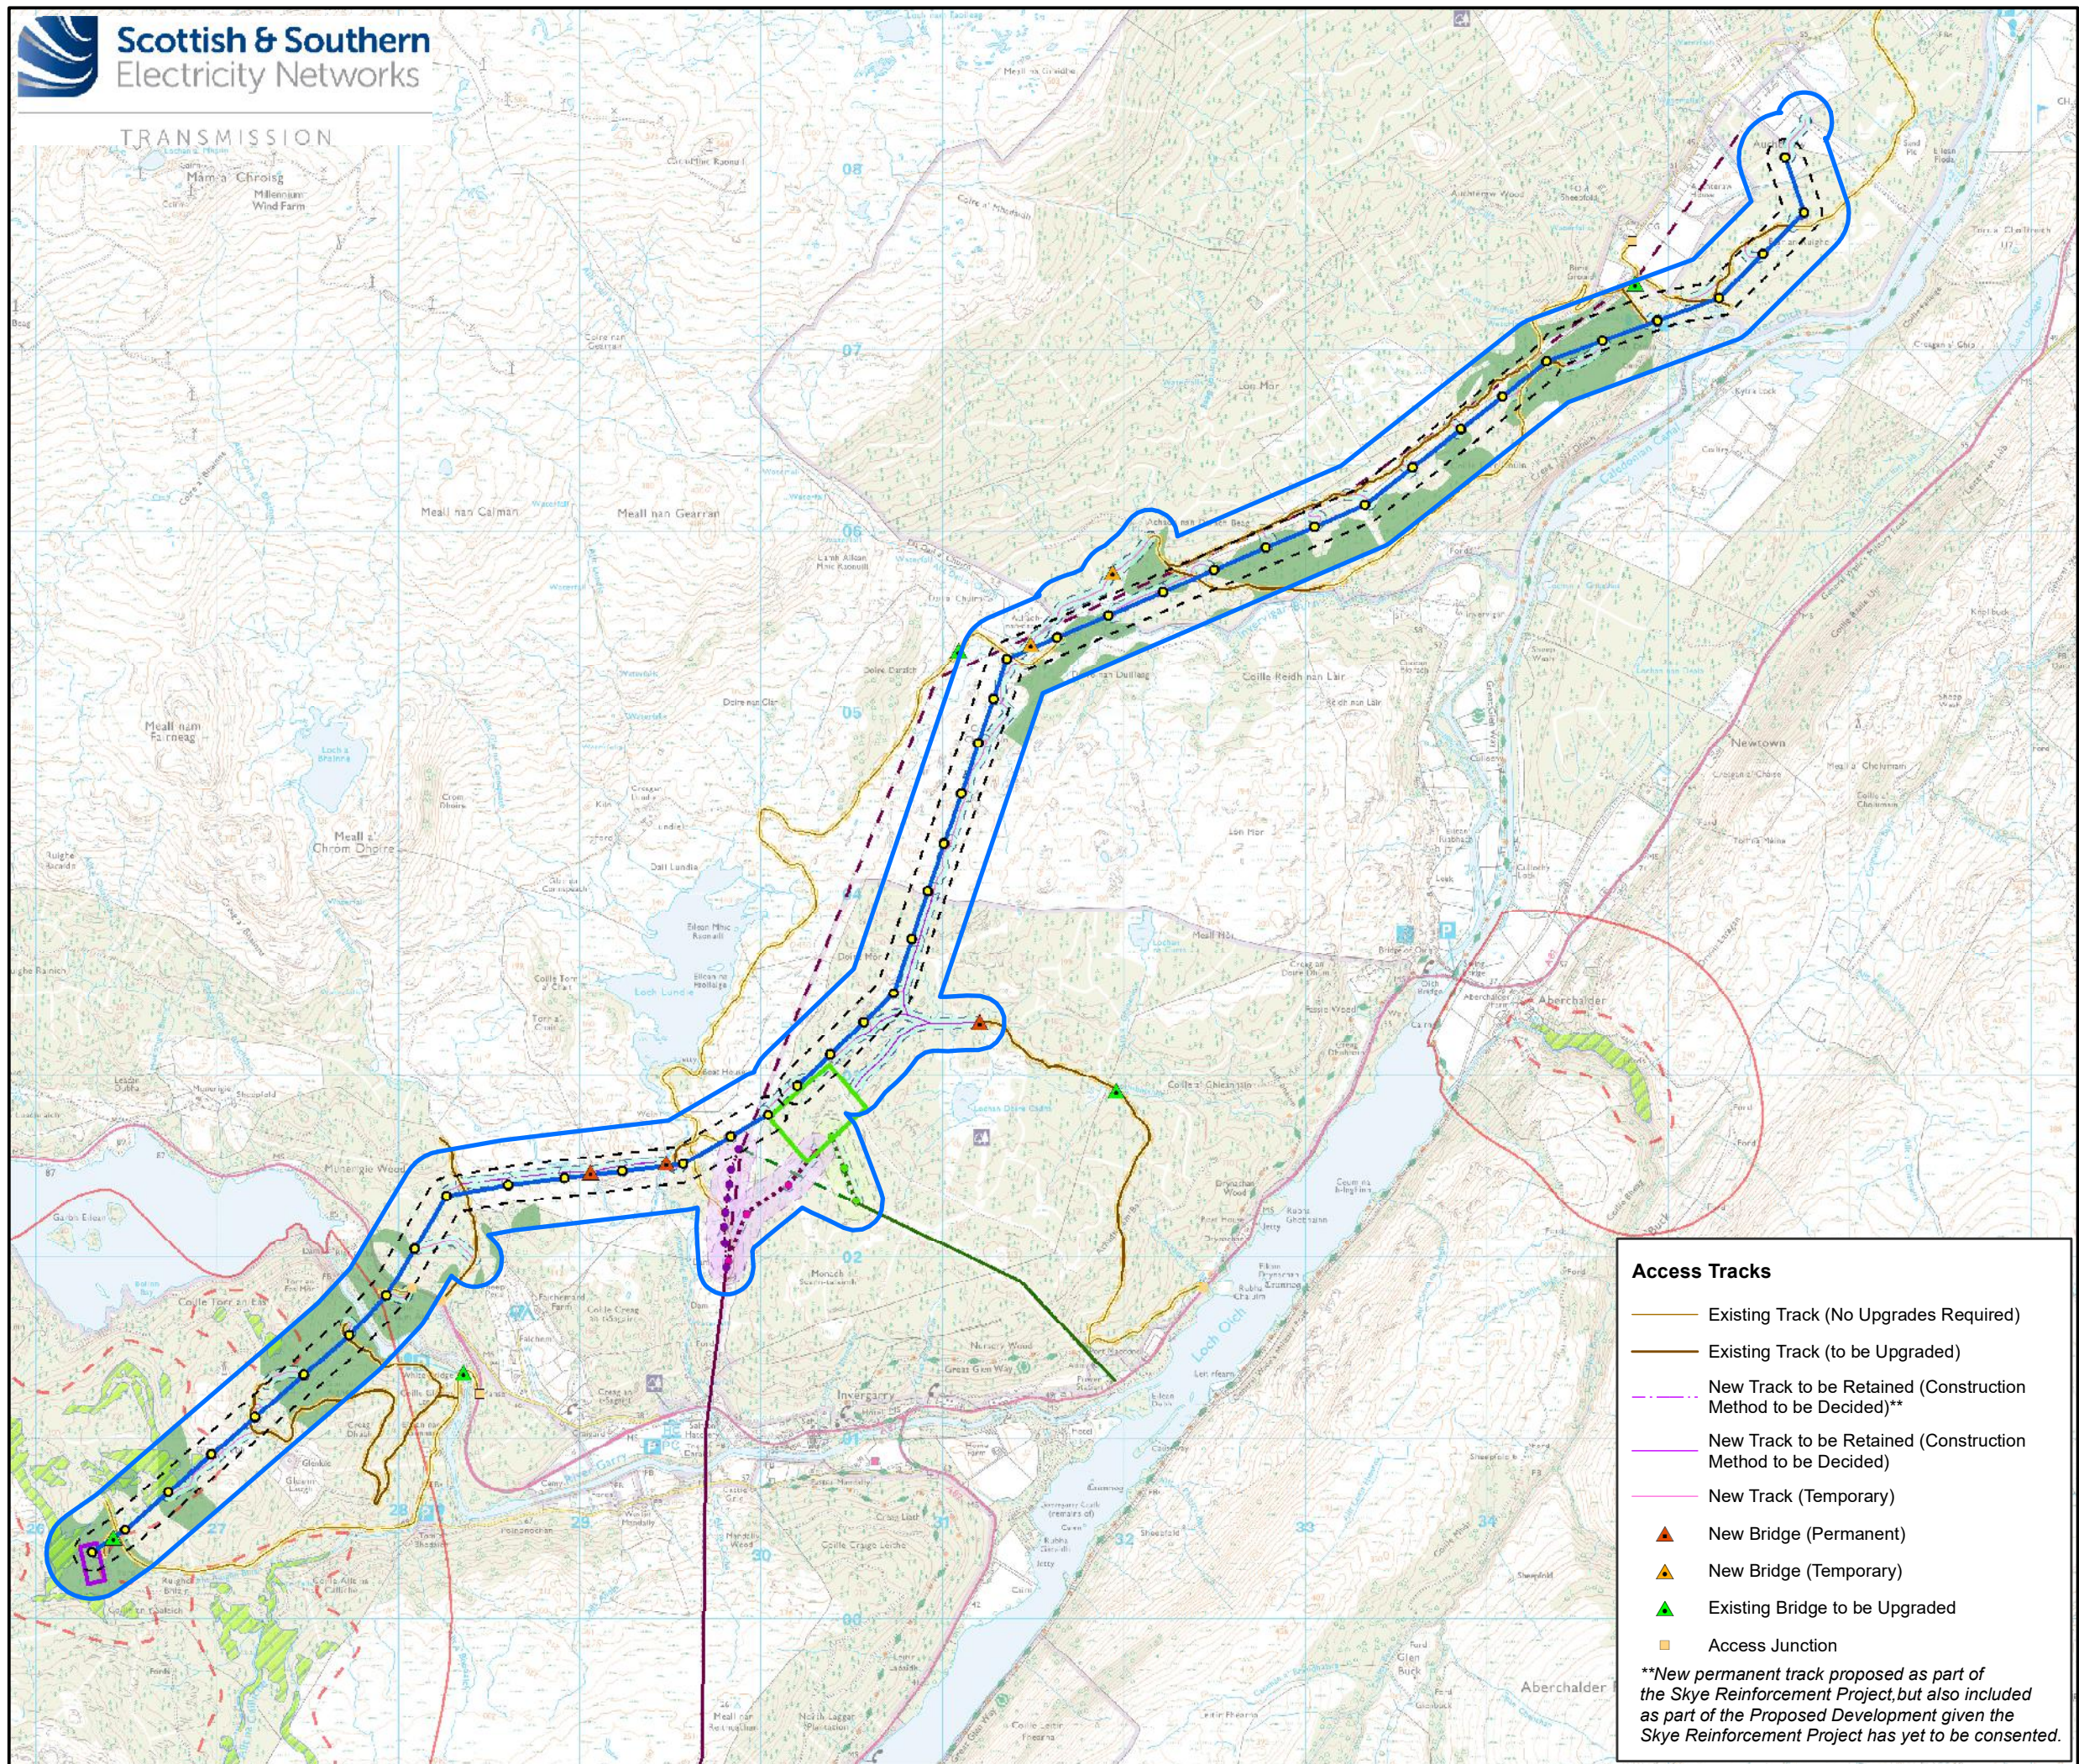

**Legend**

- Proposed OHL Alignment (Steel Lattice Towers)
- Proposed Steel Lattice Tower
- Proposed Coire Glas Switching Station Platform\*
- Proposed Loch Lundie Substation Platform\*

**Limit of Deviations (LOD)**

- OHL Alignment LOD
- Existing Access Track
- New Access Track
- Invergarry Tee OHL Diversion LOD
- Fort Augustus to Fort William OHL Diversion LOD

**Existing 132 KV Invergarry Tee OHL (Steel Lattice Towers)**

- new permanent Trident Steel Pole location
- to be retained
- - - to be diverted into the proposed Loch Lundie Substation
- - - to be dismantled

**Existing 132 KV Fort Augustus to Fort William OHL (Steel Lattice Towers)**

- temporary Trident Wood Pole locations
- - - temporary OHL diversion
- new permanent Steel Lattice Tower location
- to be retained
- - - to be diverted into the proposed Loch Lundie Substation
- - - to be dismantled

**Sites of Nature Conservation**


- Study Area
- Ancient Woodland Inventory (AWI)
- Caledonian Pinewood Inventory (CPI)
- Pinewood Buffer Zone
- Pinewood Regeneration Zone

**Access Tracks**

- Existing Track (No Upgrades Required)
- Existing Track (to be Upgraded)
- - - New Track to be Retained (Construction Method to be Decided)\*\*
- - - New Track to be Retained (Construction Method to be Decided)
- New Track (Temporary)
- ▲ New Bridge (Permanent)
- ▲ New Bridge (Temporary)
- ▲ Existing Bridge to be Upgraded
- Access Junction

**\*\*New permanent track proposed as part of the Skye Reinforcement Project, but also included as part of the Proposed Development given the Skye Reinforcement Project has yet to be consented.**

\*Associated works subject to separate consent under the Town and County Planning (Scotland) Act 1997. Footprints show indicative locations only.



Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2023 all rights reserved. Ordnance Survey Licence number EL273236.

Project: Coire Glas Grid Connection Project – 400 kV OHL EIA Report

Title: Figure 8.1b - Sites of Nature Conservation Non-statutory Designations

Drawn by: HC Date: 29/03/2023

Drawing: