


Date Saved: 07/10/2020
Document Path: \\uk.wspgroup.com\central\data\Projects\70065799 - LT193 Dunoon to Whistlefield\05 Models and Drawings\MXD\LT193_DW_70065799_0018 - Figure 7.1 - Preferred Route.mxd

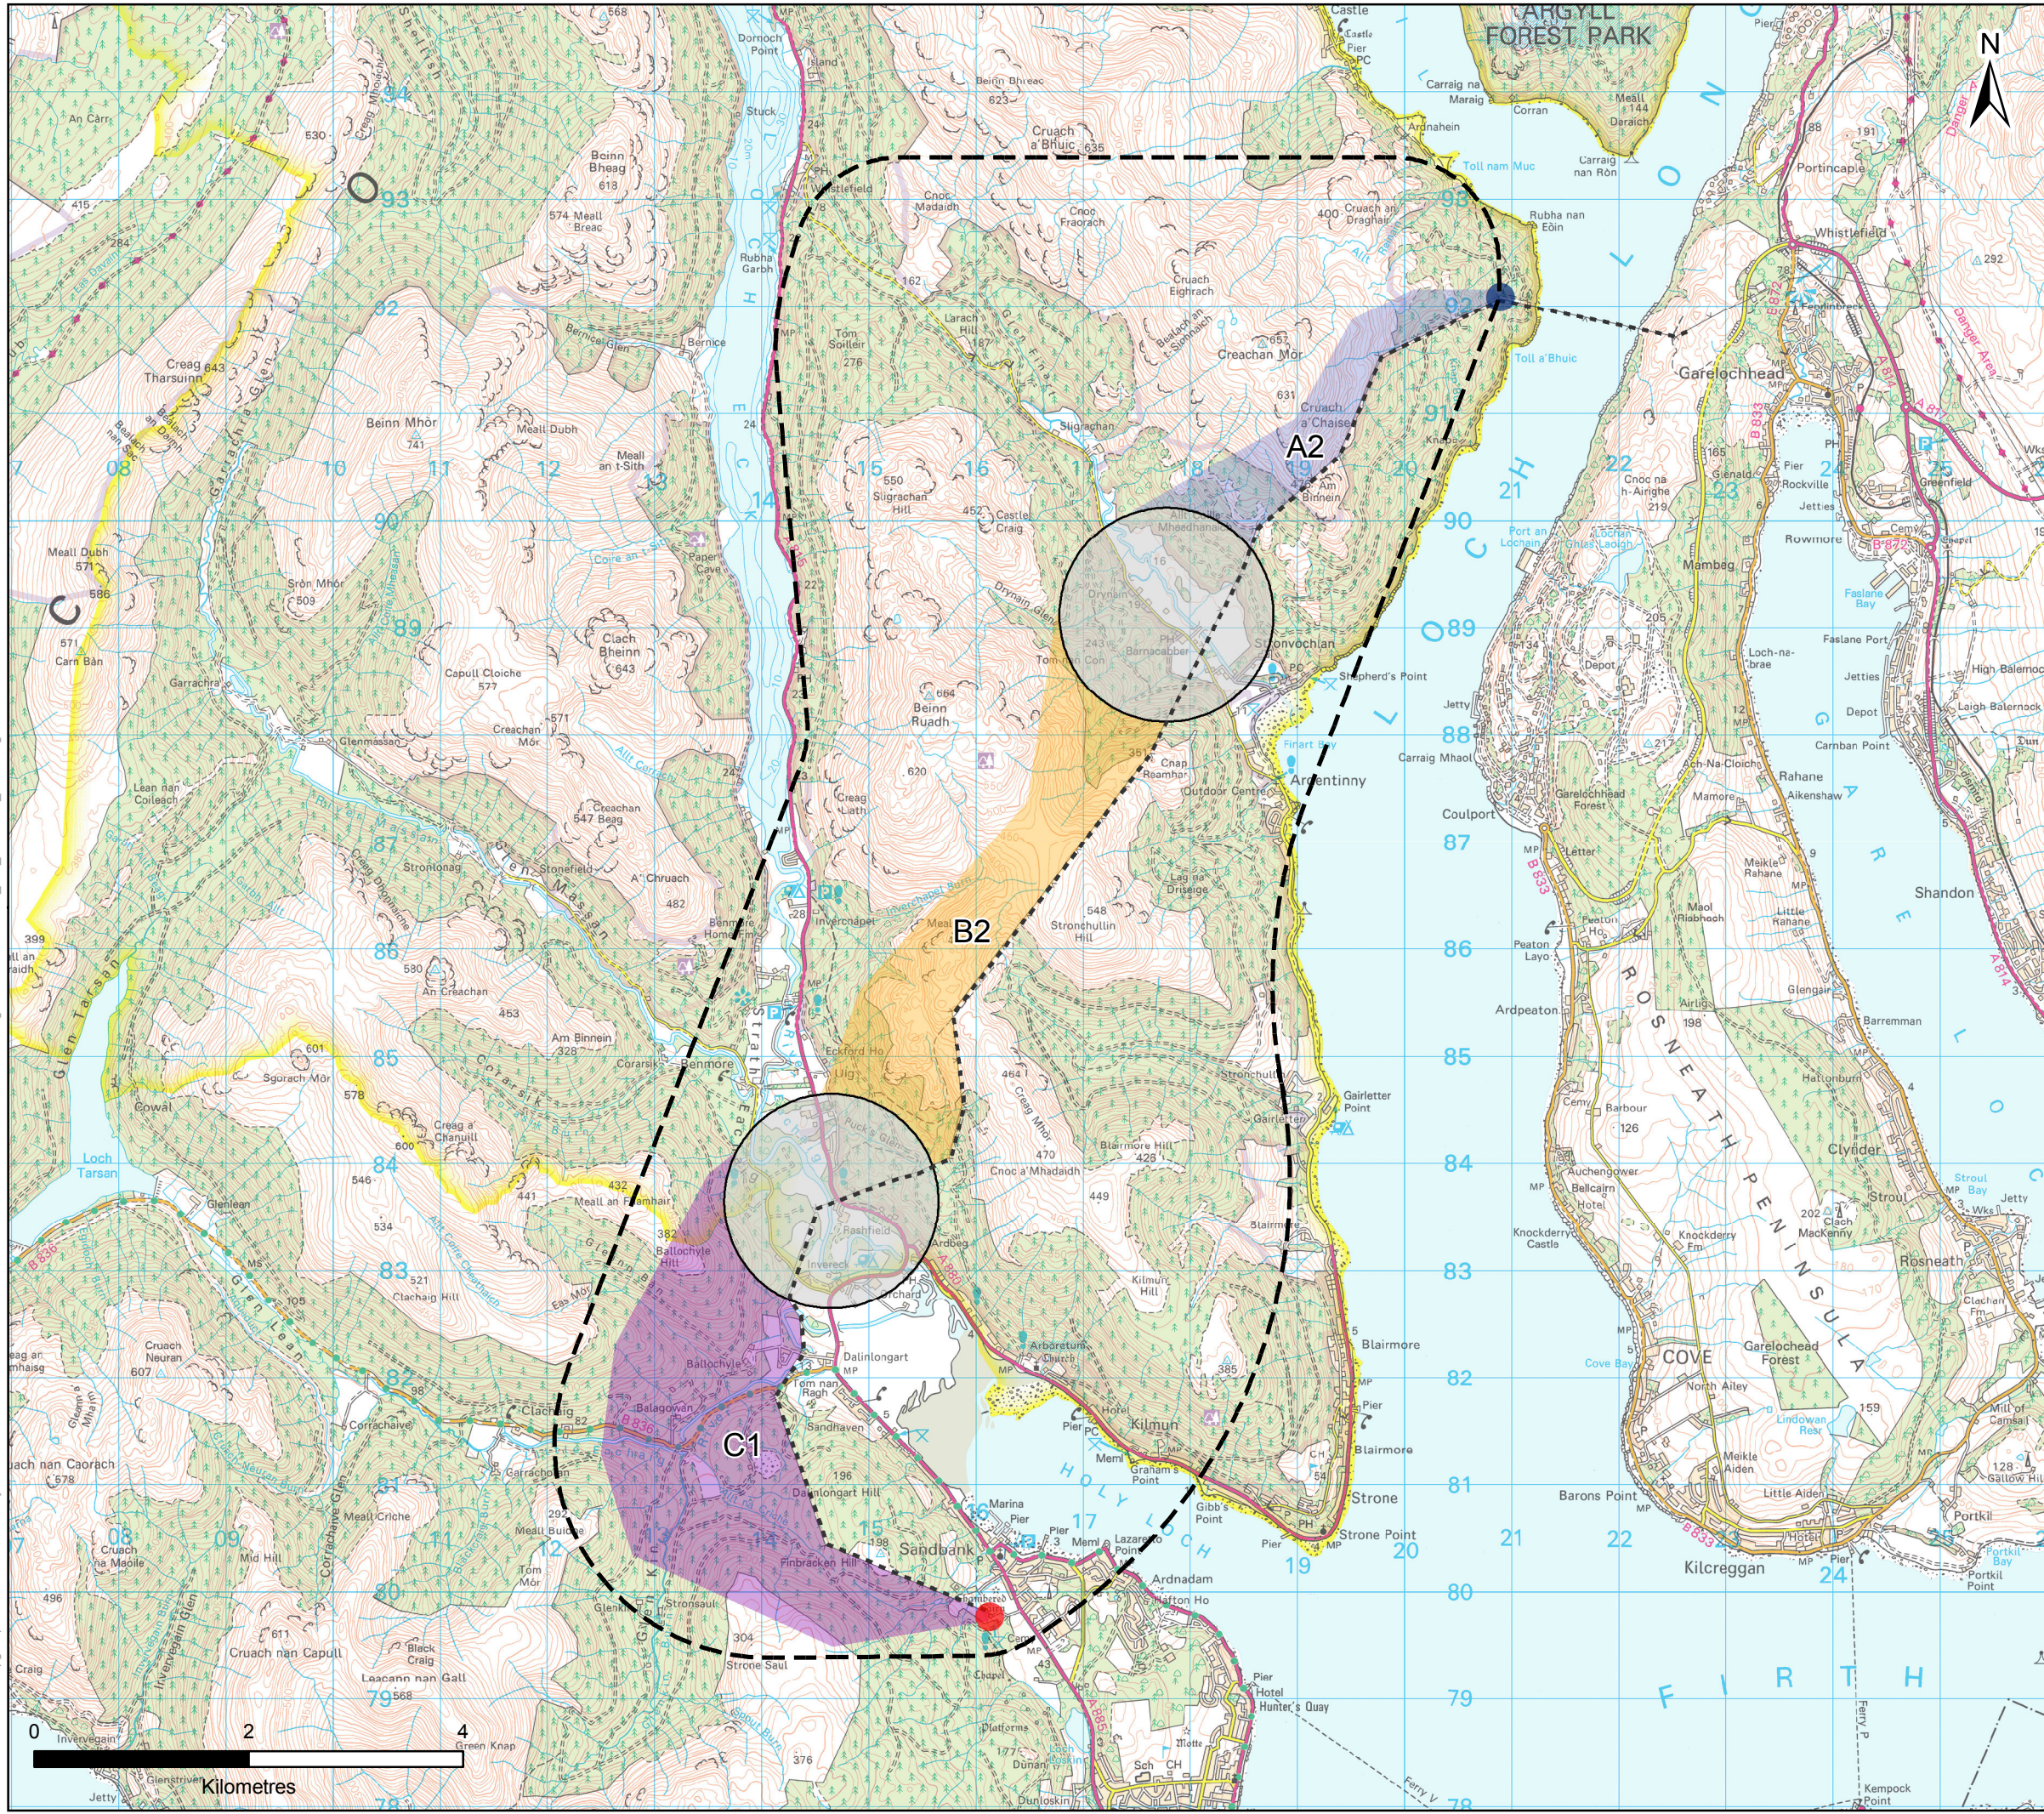

Key

- Corridor
- Existing Dunoon Substation
- Tower 15 on Whistlefield - Dunoon 132kV OHL

Preferred Route

- A2
- B2
- C1
- Node
- Existing OHL

Client:

Scottish & Southern Electricity Networks

Project:

LT193 Dunoon to Whistlefield 132kV OHL Rebuild

Title:

Figure 3.1 Preferred Route

Date:	07 October 2020	Scale:	60,000 @ A3
Drawn:	MS	Checked:	CE
		Approved:	JB