

Beauly – Aigas/Deanie 132kV OHL Works Core Non-Load Engineering Justification Paper



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper**1 Executive Summary**

Our paper A Risk Based Approach to Asset Management¹ sets out our approach to network risk and how we subsequently identify assets that require intervention to limit the rise of risk over the RIIO-T2 period.

This paper identifies the need for intervention on the 132kV tower lines between Beauly and Aigas, and Beauly and Deanie. The primary driver for the scheme is the asset condition.

Following a process of optioneering and detailed analysis, as set out in this paper, the proposed scope of works is:

- Replacement of phase conductors, earth wire and fixtures and fittings

This scheme will cost £19.0m to deliver the following outputs and benefits during the RIIO T2 period:

- A long-term monetised risk benefit of R£26.0m,
- A reduction of total network risk calculated as R£132.4k,
- Improved operational flexibility and resilience in line with our goal of 100% network reliability for homes and businesses.

The Beauly-Aigas-Deanie 132kV OHL Refurbishment scheme is not flagged as eligible for early or late competition due to it being under Ofgem's £50m and £100m thresholds respectively.

¹A Risk Based Approach to Asset Management



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

Name of Scheme/Programme	Beauly – Aigas/Deanie 132kV OHL Works	
Primary Investment Driver	Asset Health (Non-Load)	
Scheme reference/ mechanism or category	RIIO T1: SN-00172 RIIO T2: SHNLT205	
Output references/type	RIIO T1: NLR-0017 RIIO T2: NLRT2SH205	
Cost	£19.0m	
Delivery Year	RIIO T2	
Reporting Table	C0.7 Non-Load Master Data	
Outputs included in RIIO T1 Business Plan	No	
Spend profile	T1	T2
	£2.1m	£19.0m

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper**2 Introduction**

This Engineering Justification Paper sets out our plans to undertake condition-related work during the RIIO-T2 period (April 2021 to March 2026). The planned work is on the 132kV overhead line BDN/BDS as shown on the map on the next page.

The Engineering Justification Paper is structured as follows:

Section 3: Need

This section provides an explanation of the need for the planned works. It provides evidence of the primary and, where applicable, secondary drivers for undertaking the planned works. Where appropriate it provides background information and/or process outputs that generate or support the need.

Section 4: Optioneering

This section presents all the options considered to address the need that is described in Section 3. Each option considered here is either discounted at this Optioneering stage with supporting reasoning provided or is taken forward for detailed analysis in Section 5.

Section 5: Detailed Analysis

This section considers in more detail each of the options taken forward from the Optioneering section. Where appropriate the results of Cost Benefit Analysis are discussed and together with supporting objective and engineering judgement contribute toward the identification of a selected option. The section continues by setting out the costs for the selected option.

Section 6: Conclusion

This section provides summary detail of the selected option. It sets out the scope and outputs, costs and timing of investment and where applicable other key supporting information.

Section 7: Price Control Deliverables and Ring Fencing


This section provides a view of whether the proposed scheme should be ring-fenced or subject to other funding mechanisms.

Section 8: Outputs included in RIIO-T1 Business Plan

This section identifies if some or all the outputs were included in the RIIO-T1 Business Plan and provides explanation and justification as to why such outputs are planned to be undertaken in the RIIO-T2 period.

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

Figure 1 – Geographical Representation Beauly/Deanie

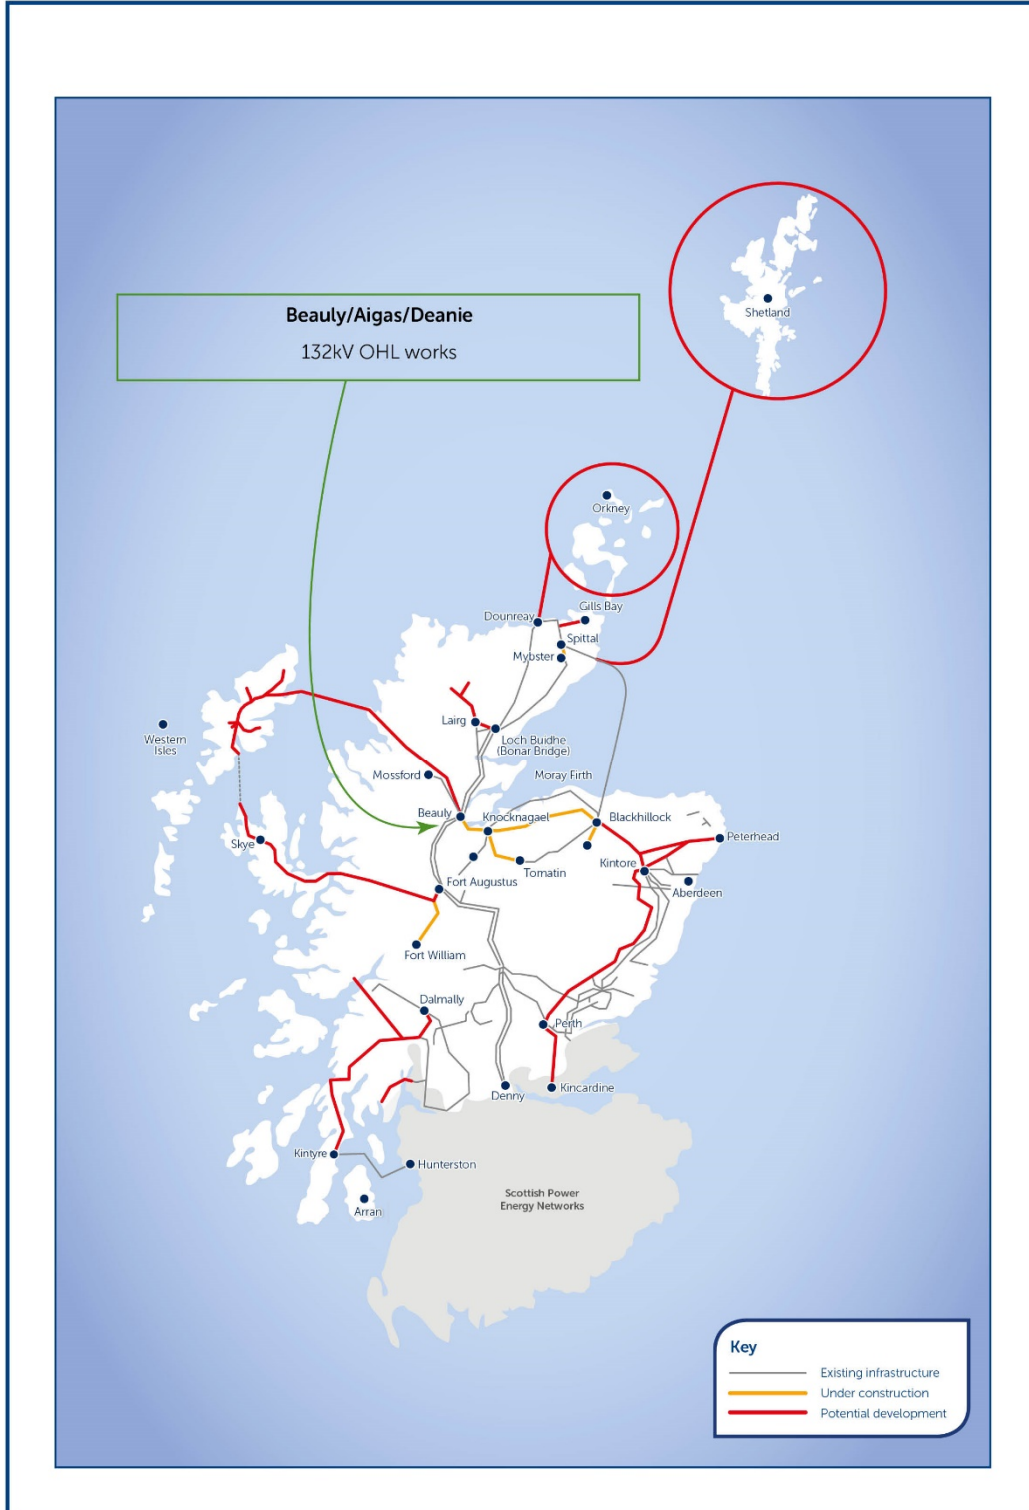

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

3 Need

This section provides an explanation of the need for the planned works. It provides evidence of the primary and, where applicable, secondary drivers for undertaking the planned works. Where appropriate it provides background information and/or process outputs that generate or support the need.

3.1 Background

The existing Beauly - Deanie (BDS/BDN) OHL circuit, constructed in 1960, is a 132kV circuit comprising 85 PL16 double circuit steel lattice towers with a total length of 23km. There is currently a double 132kV transmission circuit between Beauly and Aigas (BDS/BDN). In contrast, between Aigas and Deanie (BDN) one side is operated at 132kV providing a single transmission circuit, whereas the other side is operated at 33kV providing a distribution circuit for SHEPD. The circuit is strung with single Lynx ACSR phase conductors and has a Horse ACSR earthwire providing earthing protection on the entire length of the circuit.

The circuits are radial connections to four hydro generation sites connecting to Beauly substation. The substation at Beauly and the four hydro connection substations are also subject to upgrade works proposals for the RIIO T2 period.

The circuit is protected by a single distance main protection device at the Beauly end of the circuit for both BDS/BDN, with intertrips over PLC to the Culligran/Deanie and intertrips over pilot wire to Kilmorack and Aigas sites. Neither circuit has DAR. Appendix A shows the system configuration.

3.2 Asset Need

The need for intervention on the BDN/BDS circuits is based on current asset performance and available condition assessments and is detailed in the Asset Condition Report².

By the end of T2 these circuits will be 66 years old, having aged beyond their design life of 40 years and beyond the 54-year industry mean asset service life. At this time the following items are of such a condition that intervention is required on the following items:

- Steel members on 17 towers require replacement
- Step bolts at all angle and tension towers require replacement
- 60% of earth wire fittings require replacement
- 28% of conductor fittings require replacement

² Beauly Kilmorack Aigas Culligran Deanie 132kV OHL Asset Condition Report [T2BP-ACR-0009]



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

- 2 foundations require upgrading
- All towers require painting
- Earth wire and phase conductors need to be replaced

3.3 Growth Need

There is 97MW of transmission generation connected to this circuit and no Grid Supply Points serving SHEPD demand. There are no requirements to increase the circuit capacity as there is no new development interest or requests to increase capacity at existing generation sites.

Highly Confidential

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

4 Optioneering

This section presents all the options considered to address the need that is described in Section 3. Each option considered here is either discounted at this Optioneering stage with supporting reasoning provided or is taken forward for detailed analysis in Section 5.

The final 8km of the route between Culligran and Deanie Substation is situated within several environmental protection areas. This part of the route is in the 'Glen Affric to Strathconon' Special Protection Area (SPA). This area has been designated a SPA due to it being a breeding zone for Golden Eagles. This section is also within the 'Strathglass Complex' Special Area of Conservation (SAC). This has been designated a SAC due to it being a habitat for many protected species of flora and fauna. Finally, this section is also in the 'Glen Strathfarrar' Site of Specific Scientific Interest (SSSI). This area was designated a SSSI due to the presence of breeding birds, dragonflies, lichen, native pinewood and vascular plants.

At the end of the RIIO-T2 period the conductors and insulators will be 26 years past the end of their design life and the fittings will be 41 years past their design life. Due to poor condition intervention is required to replace these between April 2021 and March 2026.

Table 1 – Options Considered

Option	Option Detail	Cost (£m)	Taken forward to CBA?
1	Full refurbishment of existing circuit, reconductoring with UPAS AAAC conductor.	19.0	Yes
2	Rebuild the line with a new trident line.	-	No
3	Rebuild the line with new technology composite poles	-	No

Option 1

This option proposes phase and earthwire assembly replacement including insulators, dampers, shackles and U-Bolts. The earthwire will be replaced with an OPGW equivalent and the phase conductors with a UPAS AAAC conductor. All towers will be painted, and concrete muffs repaired as recommended in the Asset Condition Report².

Conductor assessment has taken a Lynx ACSR standard replacement as Upas AAAC. The replacement of ACSR Conductors with AAAC is standard industry practice, as ACSR conductors are gradually being phased out by suppliers and are unlikely to be standard products in the years to come.



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

The Upas AAAC conductor has been selected for the Lynx ACSR replacement as it has been used widely on the UK Network and meets the electrical and mechanical requirements of the OHL. As the UPAS conductor is stronger than the Lynx conductor, the resulting works on the scheme will include tower and foundation strengthening as well as clearance infringements mitigation to ensure that minimum statutory clearances are met. Alternative, smaller, AAAC conductors were assessed which would achieve the required electrical rating, however were ruled out as the mechanic loading would exceed the limits specified by the suppliers.

This option will re-utilise the existing asset and route. This option will however require a large amount of foundation upgrades and steelwork strengthening as a result of the increased strengthening requirements for the use of the UPAS conductors. There are 30 towers between Culligran and Deanie which are in a SSSI SPA or SAC. Scottish National Heritage are likely to object to any large scale works in this area and minimal environmental impact must be targeted.

PROGRESSED TO DETAILED ANALYSIS

Option 2

This option proposes rebuilding the circuits with two single circuit wood pole lines. The existing circuit is a double circuit tower with a 33kV asset on the opposite tower crossarms from towers 48 to 1. This would therefore impact the distribution 33kV circuit. Replacing the tower line with trident provides a solution with minimum outage requirements. The trident circuits would require an underslung fibre to be installed on the structures to maintain adequate protection communications. While this option is technically acceptable, a new route between Culligran and Deanie would require consent within the environmental designations as it is not possible to avoid them. The environmental impact of constructing a new trident line through these areas as well either removing the tower line or this being retained by SHEPD results in a solution that is unlikely to achieve consent.

NOT PROGRESSED TO DETAILED ANALYSIS

Option 3

This option proposes rebuilding the circuit with composite poles, an innovative solution deployed during RIIO T1. The benefit of the composite pole compared to the wood pole solution is the longer span lengths which can be achieved. The longer span lengths, therefore reduced structure numbers may be advantageous to the consenting process. Like Option 3, the re-build would also impact the 33kV circuit which would also need to seek consent for a parallel route through the designated areas and for the same reason has not been further progressed.

NOT PROGRESSED TO DETAILED ANALYSIS

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

5 Detailed Analysis

This section considers in more detail each of the options taken forward from the Optioneering section. Where appropriate the results of Cost Benefit Analysis are discussed and together with supporting objective and engineering judgement contribute toward the identification of a selected option. The section continues by setting out the costs for the selected option.

5.1 Cost Benefit Analysis

Only one option has been identified as technically compliant and deliverable therefore Cost Benefit Analysis has not been undertaken for this scheme.

5.2 Project Sensitivity

As outlined in our core RIIO-T2 business plan document, "A Network for Net Zero", we believe we have a critical role to play in delivering Net Zero ambitions in both the UK and Scotland. Therefore, our plan has been carefully designed with the flexibility to deliver pathways to Net Zero. Our policy paper "A Risk-Based Approach to Asset Management" outlines our approach to monitoring and assessing the condition of our assets to maintain the reliable and resilient network that is expected by our stakeholders. Where asset condition deteriorates, we undertake a programme of cost-effective, risk-based interventions to maintain the longevity and performance of the transmission network. Each of our non-load related projects for T2 is underpinned by Asset Condition Reports which clearly outline that the works are necessary and driven by reliability.

Table 2: Sensitivity Analysis table

Sensitivity	Test and impact observed – switching inputs
Asset Performance / deterioration rates	Switching deterioration assumption: The asset performance / deterioration rates can only improve or deteriorate. As the need for this project is driven by an asset condition report (as outlined in Section 3), the asset condition will not improve in the intervening period. The second option is for the asset performance to deteriorate and therefore the need remains, and the project would be considered for advancement within available outages.
Ongoing efficiency assumptions	Switching efficiency assumption: increased or decreased. Test would have no impact on (feasible) option selection, only one option was

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

	taken forward to detailed analysis and therefore there is no impact on the preferred solution.
Demand variations	No significant demand forecast
Energy scenarios	Sensitivity considered in Section 3 (Need) already. As this is a non-load project and the need is driven by the asset condition, the work would be required regardless of any changes to the energy scenario.
Asset utilisation	Our policy paper “A Risk-Based Approach to Asset Management” outlines our approach to monitoring and assessing the condition of our assets to maintain the reliable and resilient network that is expected by our stakeholders. Where asset condition deteriorates, we undertake a programme of cost-effective, risk-based interventions to maintain the longevity and performance of the transmission network. Each of our non-load related projects for T2 is underpinned by Asset Condition Reports which clearly outline that the works are necessary and driven for reliability.
Timing / delivery	We have considered timing of investments as part of our CBAs.
Consenting / stakeholders	Where applicable we have considered consenting and stakeholder engagement as part of section 5 (Detailed Analysis) and the impact which this has had on the selection of the preferred solution.
Public policy / Government legislation	We have considered the impact of public policy, government legislation and regulations as part of the need (Section 3), optioneering (Section 4) and detailed analysis (Section 5) and the impacts this has on the selection of the preferred solution. For example, the projects have considered the impact of the UK Governments’ Net Zero emission by 2050 target, SQSS and ESQCR.

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

5.3 Proposed Solution

The scope of the proposed solution encompasses the full refurbishment of the 132kV circuits BDN and BDS. The project will be energized within the RIIO T2 period. The table below details the outputs which captures the upgraded assets driven by condition

Table 3 – Outputs from the preferred option

Plant	Size of new plant	Replacement for
132kV double circuit tower line refurbishment	26km Upas AAAC phase conductor	26km Lynx ACSR phase conductor
	23km OPGW	23km Horse earth wire
	Fixtures and fittings	Fixtures and fittings

The works also require the upgrade of 25 foundations driven by the increased loadings from the use of the UPAS conductor. There are 7 panel extensions to be installed to achieve ground clearances. The full refurbishment option also delivers fibre communications from end to end of the circuit providing adequate protection communications. The Beauly 132kV substation and the four connecting hydro sites (Aigas, Kilmorack, Culligran and Deanie) are also subject to proposed upgrades during the RIIO T2 period. The timing of this project and the substations it interfaces with will be coordinated such that the fibre is in place ahead of the substation commissioning.

5.4 Competition

The Beauly – Aigas/Deanie 132kV OHL Works is not flagged as eligible for early or late competition due it being under Ofgem’s £50m and £100m thresholds respectively.

5.5 Risk Benefit


A Risk Benefit Analysis has been carried out in order to compare “no intervention” against the selected “with intervention” option. Please note that while monetised risk is denoted as a financial figure, it is important to note that it is not “real” money and does not correspond to the cost that SHE Transmission would incur if an asset was to fail and these values are thus identified with R£ prefix (for more details please refer to A Risk Based Approach to Asset Management¹).

The long-term risk monetised benefit which would be realised through the completion of this project is R£26.0m. The long-term benefit is derived by consideration of the risk of the asset experiencing a catastrophic failure weighted by the probability that the asset will survive for the Options and “no intervention” scenarios. The long-term benefit is an aggregation of the risk of all assets being considered within the option. The risk of each Option is then compared with

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

the “no intervention” scenario. The “no intervention” scenario assumes that when the asset experiences a catastrophic failure the asset is replaced.

Figure 2: Long Term Benefit of Proposed Intervention – Full circuit refurbishment with UPAS AAAC

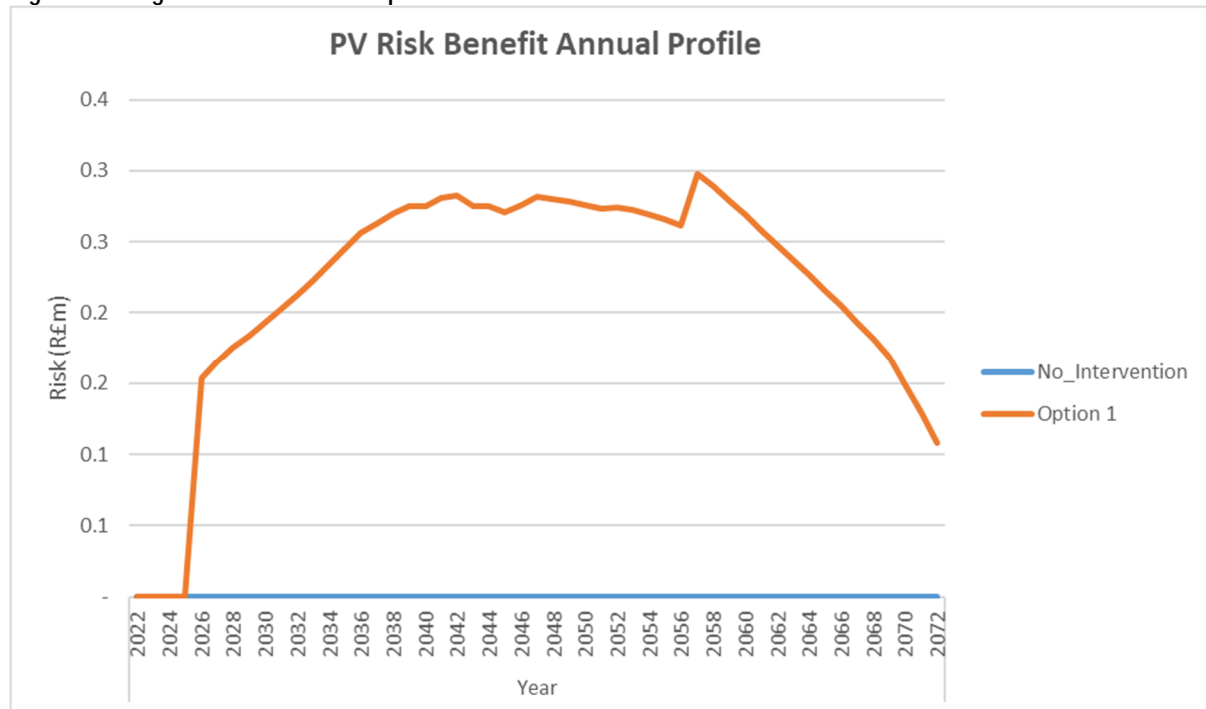

In addition to assessing the long-term risk benefit, a monetised risk benefit has also been determined. The monetised risk benefit which would be realised through the completion of this project is R£132.4k.

5.6 Carbon Modelling

We are committed to managing resources over the whole asset lifecycle – i.e. including the manufacturing of assets, construction, operations and decommissioning activities – to reduce our greenhouse gas emissions in line with climate science and become a climate resilient business. It is our aspiration that the carbon lifecycle cost of investment options plays a key role within our project development (between gates 1 and 2) and is considered in the selection of a preferred solution. We have therefore developed an internal carbon pricing model that estimates a carbon cost for each option considered in our CBA through deriving values for:

1. Embodied carbon, which relates to the carbon emissions associated with the manufacturing and production of the materials use in production of the lead assets (transformer, reactors, underground cables and Overhead lines. Overhead line is made up of tower/wood pole/composite pole, conductor and fittings) procured and installed as part of the project.

Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

2. The carbon emissions associated with the main stages of the project lifecycle (construction, operations and decommissioning).

It is our vision to embed carbon considerations within our strategic optioneering and project development processes, which will require us to determine a way of flagging high carbon options within our CBA outputs. We will continue to develop our thinking in this space, which will involve our model being validated by a third party, so the results included in this EJP are indicative and subject to change.

The results of analysis for this project, are captured in the carbon footprint results table.

Table 4 – Carbon Calculation Summary

	Project Information	Baseline
Project info	Project Name/number	0
	Construction Start Year	2026
	Construction End Year	2028
Cost estimate £GBP	Embodied carbon	£ 417,107
	Construction	£ 233,851
	Operations	£ 1,337
	Decommissioning	£ 107,063
	Total Project Carbon Cost Estimate	£ 759,358
Carbon footprint tCO₂e	Embodied carbon	5,569
	Construction	3,076
	Operations	6
	Decommissioning	308
	Total Project Carbon (tCO₂e)	8,959
Project Carbon Footprint by Emission Category	Total Scope 1 (tCO ₂ e)	6
	Total Scope 2 (tCO ₂ e)	-
	Total Scope 3 (tCO ₂ e)	8,953
SF₆ Emissions	Total SF ₆ Emissions 3 (tCO ₂ e)	-

5.7 Cost Estimate

The cost of the preferred option for works on the circuits BDN and BDS have been developed using rates from existing substation framework contracts and benchmarks from delivered RIIO-T1 projects. The total cost for delivering the scope of works for the proposed solution is £19.0m.



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

6 Conclusion

This paper identifies the need for intervention on the 132kV double circuit tower line from Beauly to Aigas, Kilmorack, Culligran and Deanie. The primary driver for the scheme is asset condition.

The proposal is the full refurbishment of the tower line as follows:

- Replacement of phase conductors, earth wire and fixtures and fittings

This scheme will cost £19.0m to deliver the following outputs and benefits during the RIIO T2 period:

- A long-term monetised risk benefit of R£26.0m,
- A reduction of total network risk calculated as R£132.4k,
- Improved operational flexibility and resilience in line with our goal to aim for 100% network reliability for homes and businesses.

The Beauly – Aigas/Deanie scheme is not flagged as eligible for early or late competition as the scheme is under Ofgem's £50m and £100m thresholds respectively.

Highly Confidential



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

7 Price Control Deliverables and Ring Fencing

As set out in our Regulatory Framework paper (Section 1.12 and Appendix 3) we support a key principle from Citizens Advice – one that guarantees delivery of outcomes equivalent to the funding received - to ensure that RIIO-T2 really delivers for consumers.

For our core non-load projects this means that we commit to delivering our overarching NARMS target. If we do not deliver the NARMS target, or a materially equivalent target, then we should be subject to a penalty. Equally, if we over-deliver against our target and can justify that the over-delivery is in the consumers interests and could not have been reasonably factored into our business plan at the time of target setting then we should be made cost neutral for this work.

Core non-load projects should not be ring fenced. This is to allow for substitution of projects in order to meet that NARMS target. We need flexibility to respond to up to date asset data information or external influences on our network during the price control; this information might drive us to substitute one project for another in order to ensure a reliable and resilient network. Ring fencing projects may result in sub-optimal decisions, having adverse consequences for the health of our network, which will ultimately be reflected in the NARMS target.

Highly Confidential



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

8 Outputs included in RIIO T1 Business Plan

Although this scheme was originally included in our baseline for delivery during the RIIO-T1 period, changes in asset condition and prioritisation across our portfolio means that our asset program is under continual review.

The deferral was the result of condition information on other circuits which raised their priority and order of delivery in T1. At the time of the deferral costs of £2.1m had been incurred on design and material purchase.

Our decision to defer this scheme means that we were able to substitute and deliver other schemes to meet our required absolute output target in line with our license obligation. An assessment will be undertaken at the end of the RIIO-T1 period to validate our performance against our license target and associated Rewards and Penalties guidelines.

Under the methods of scheme identification used for the RIIO T2 business plan Beauly/Deanie has been proposed for intervention based on condition.

Highly Confidential



Beauly-Aigas/Deanie 132kV OHL Engineering Justification Paper

Appendix A

CONTENT DELETED

Highly Confidential