




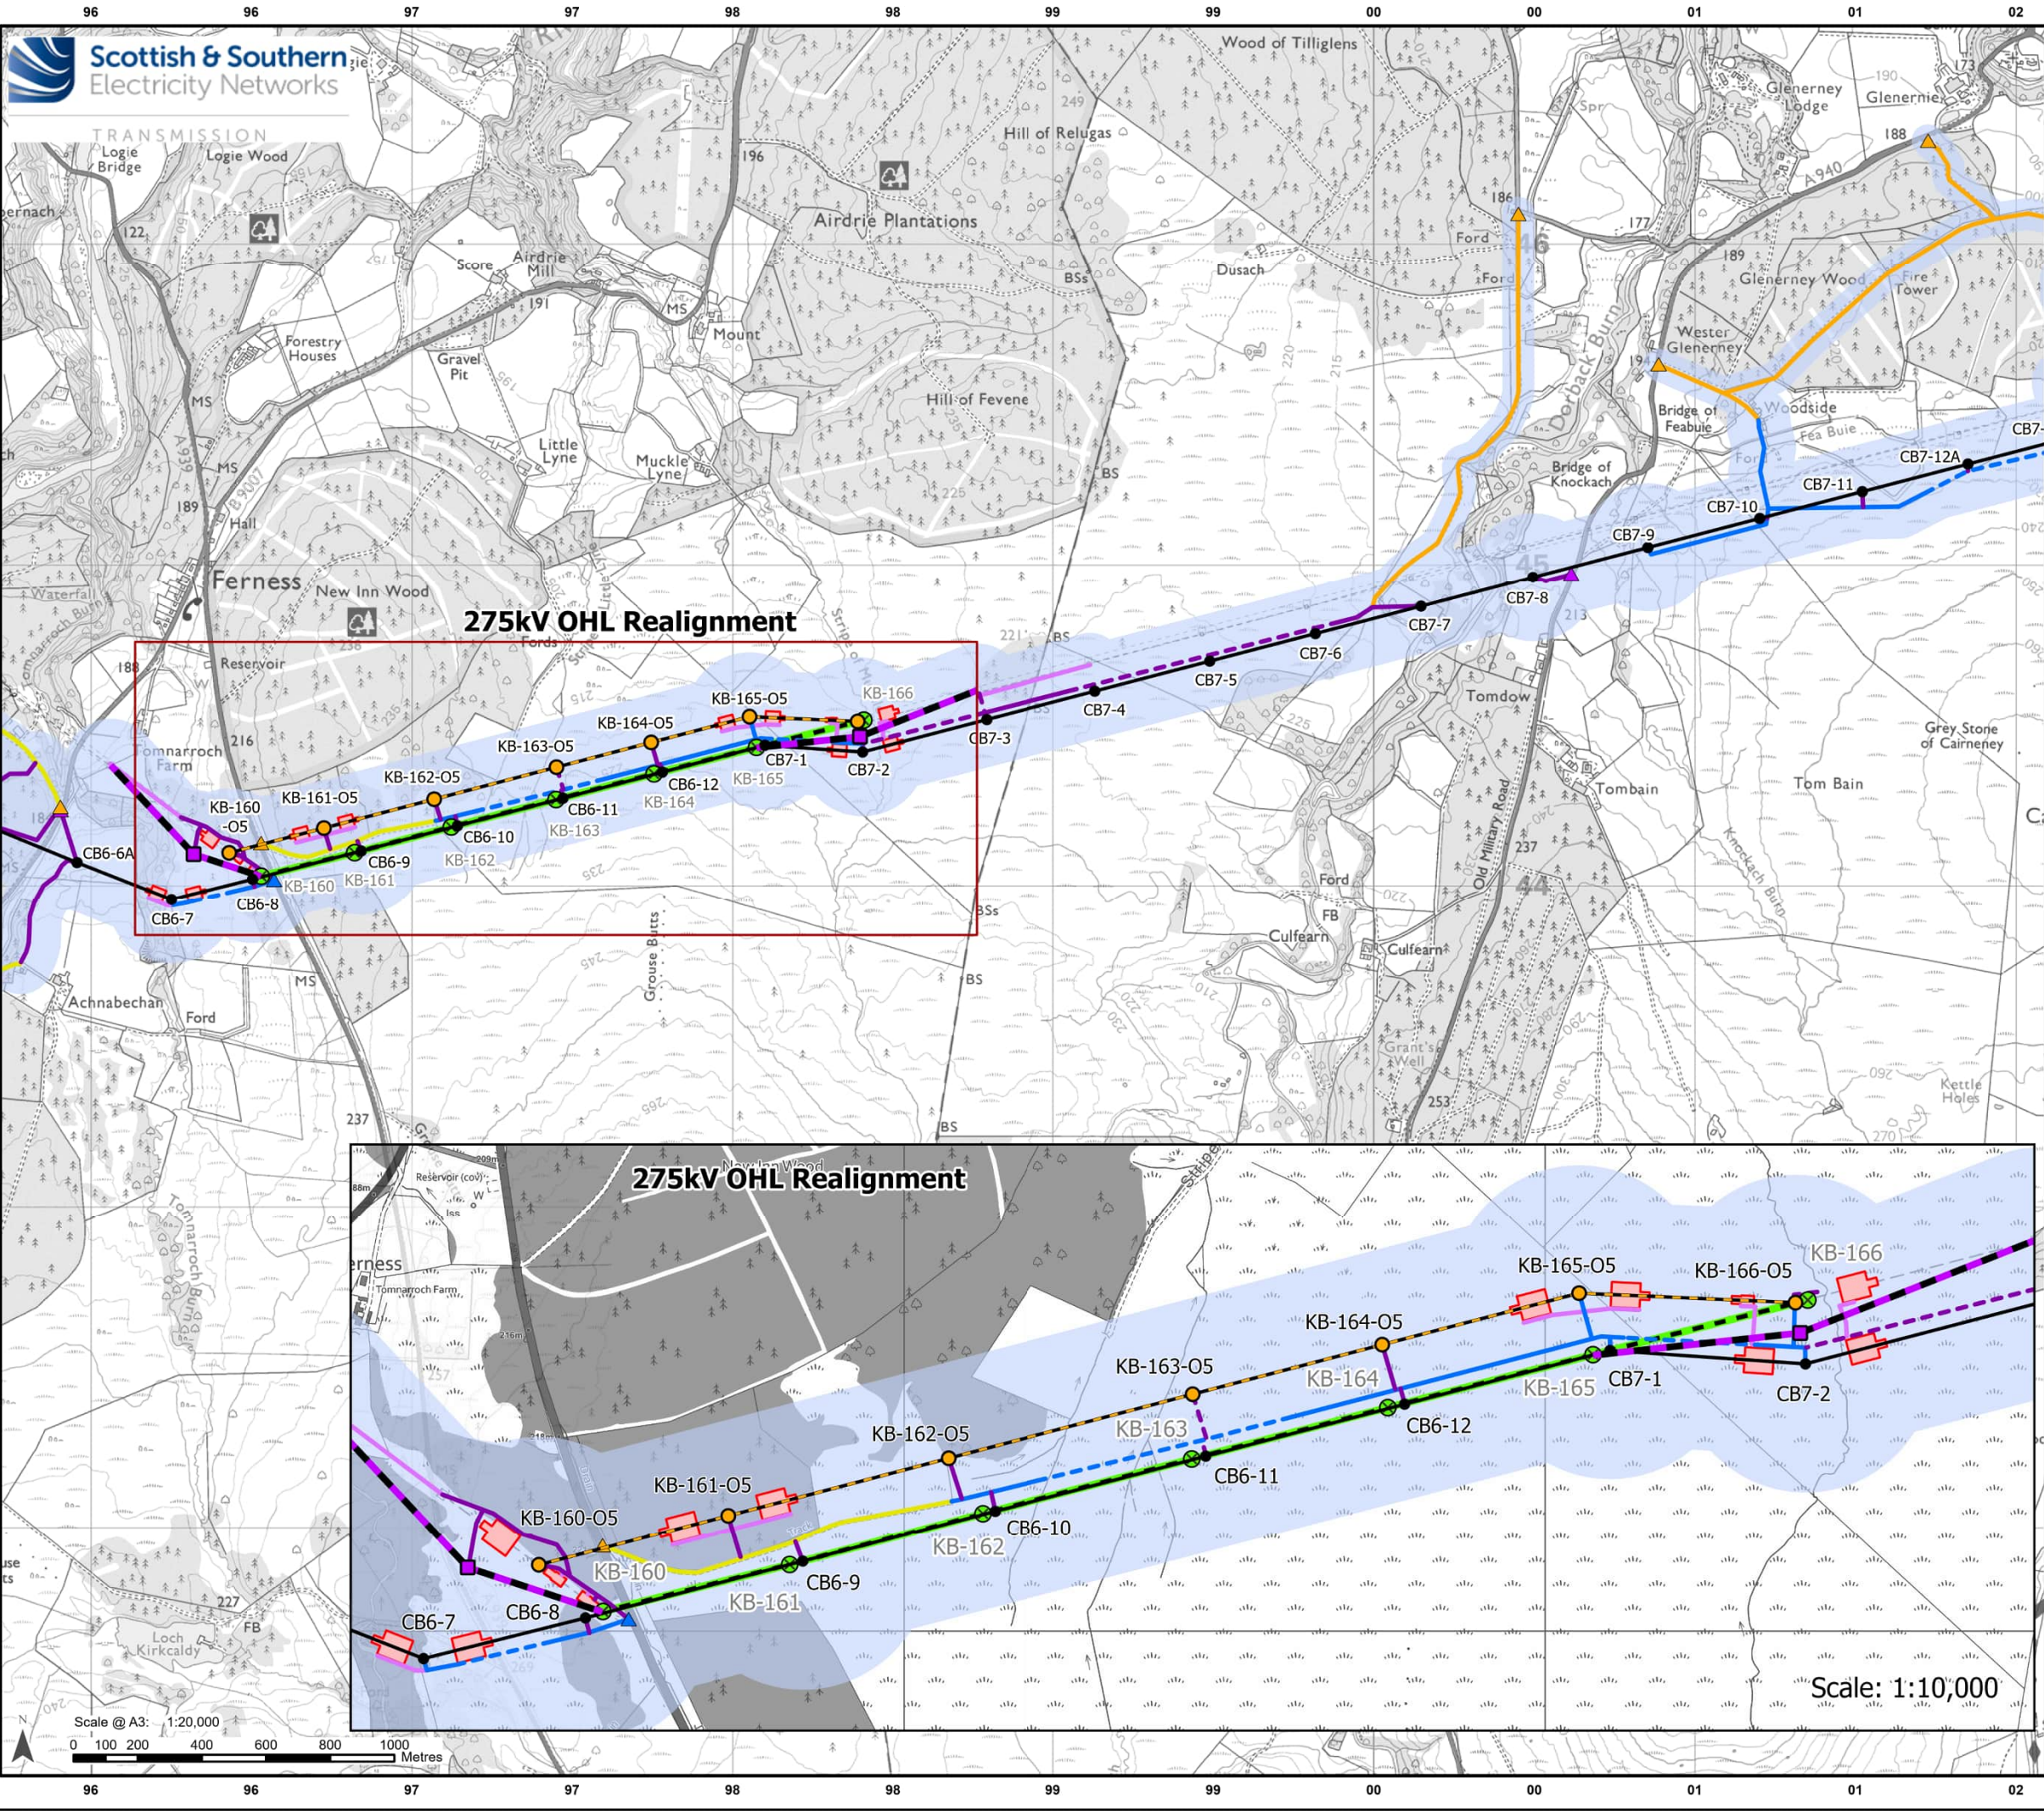


- Legend**
- Existing Tower
 - Existing OHL
 - Development for which Section 37 Consent is Sought
 - Proposed OHL Alignment - 400 kV
 - Temporary OHL Diversion
 - Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
 - Proposed Tower - 400 kV (with tower number)
 - Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
 - Proposed Tower - Temporary
 - Limit of Deviation - Proposed Development
 - Ancillary Development
 - Tower to be Removed
 - OHL to be Removed
 - Proposed Conductor Pulling Area (EPZ)
 - Existing Access – Upgrade – Good / Fair Condition
 - Existing Access – Upgrade – Poor Condition
 - Proposed Access – ATV or Temporary Trackway
 - Proposed Access – Permanent
 - Proposed Access – Permanent Floated
 - Proposed Access – Temporary
 - Proposed Access – Temporary Floated
 - Proposed Bellmouth - Permanent
 - Proposed Bellmouth - Temporary
 - Proposed Bellmouth - Upgrade

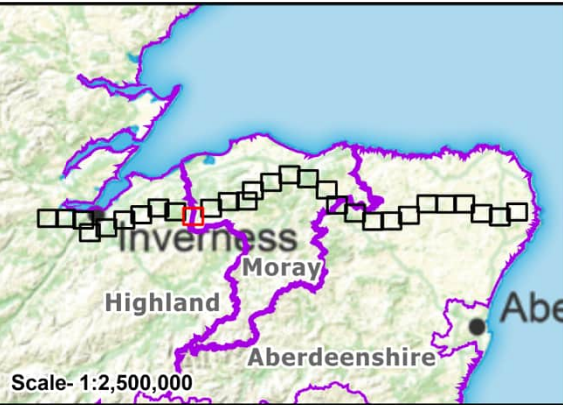

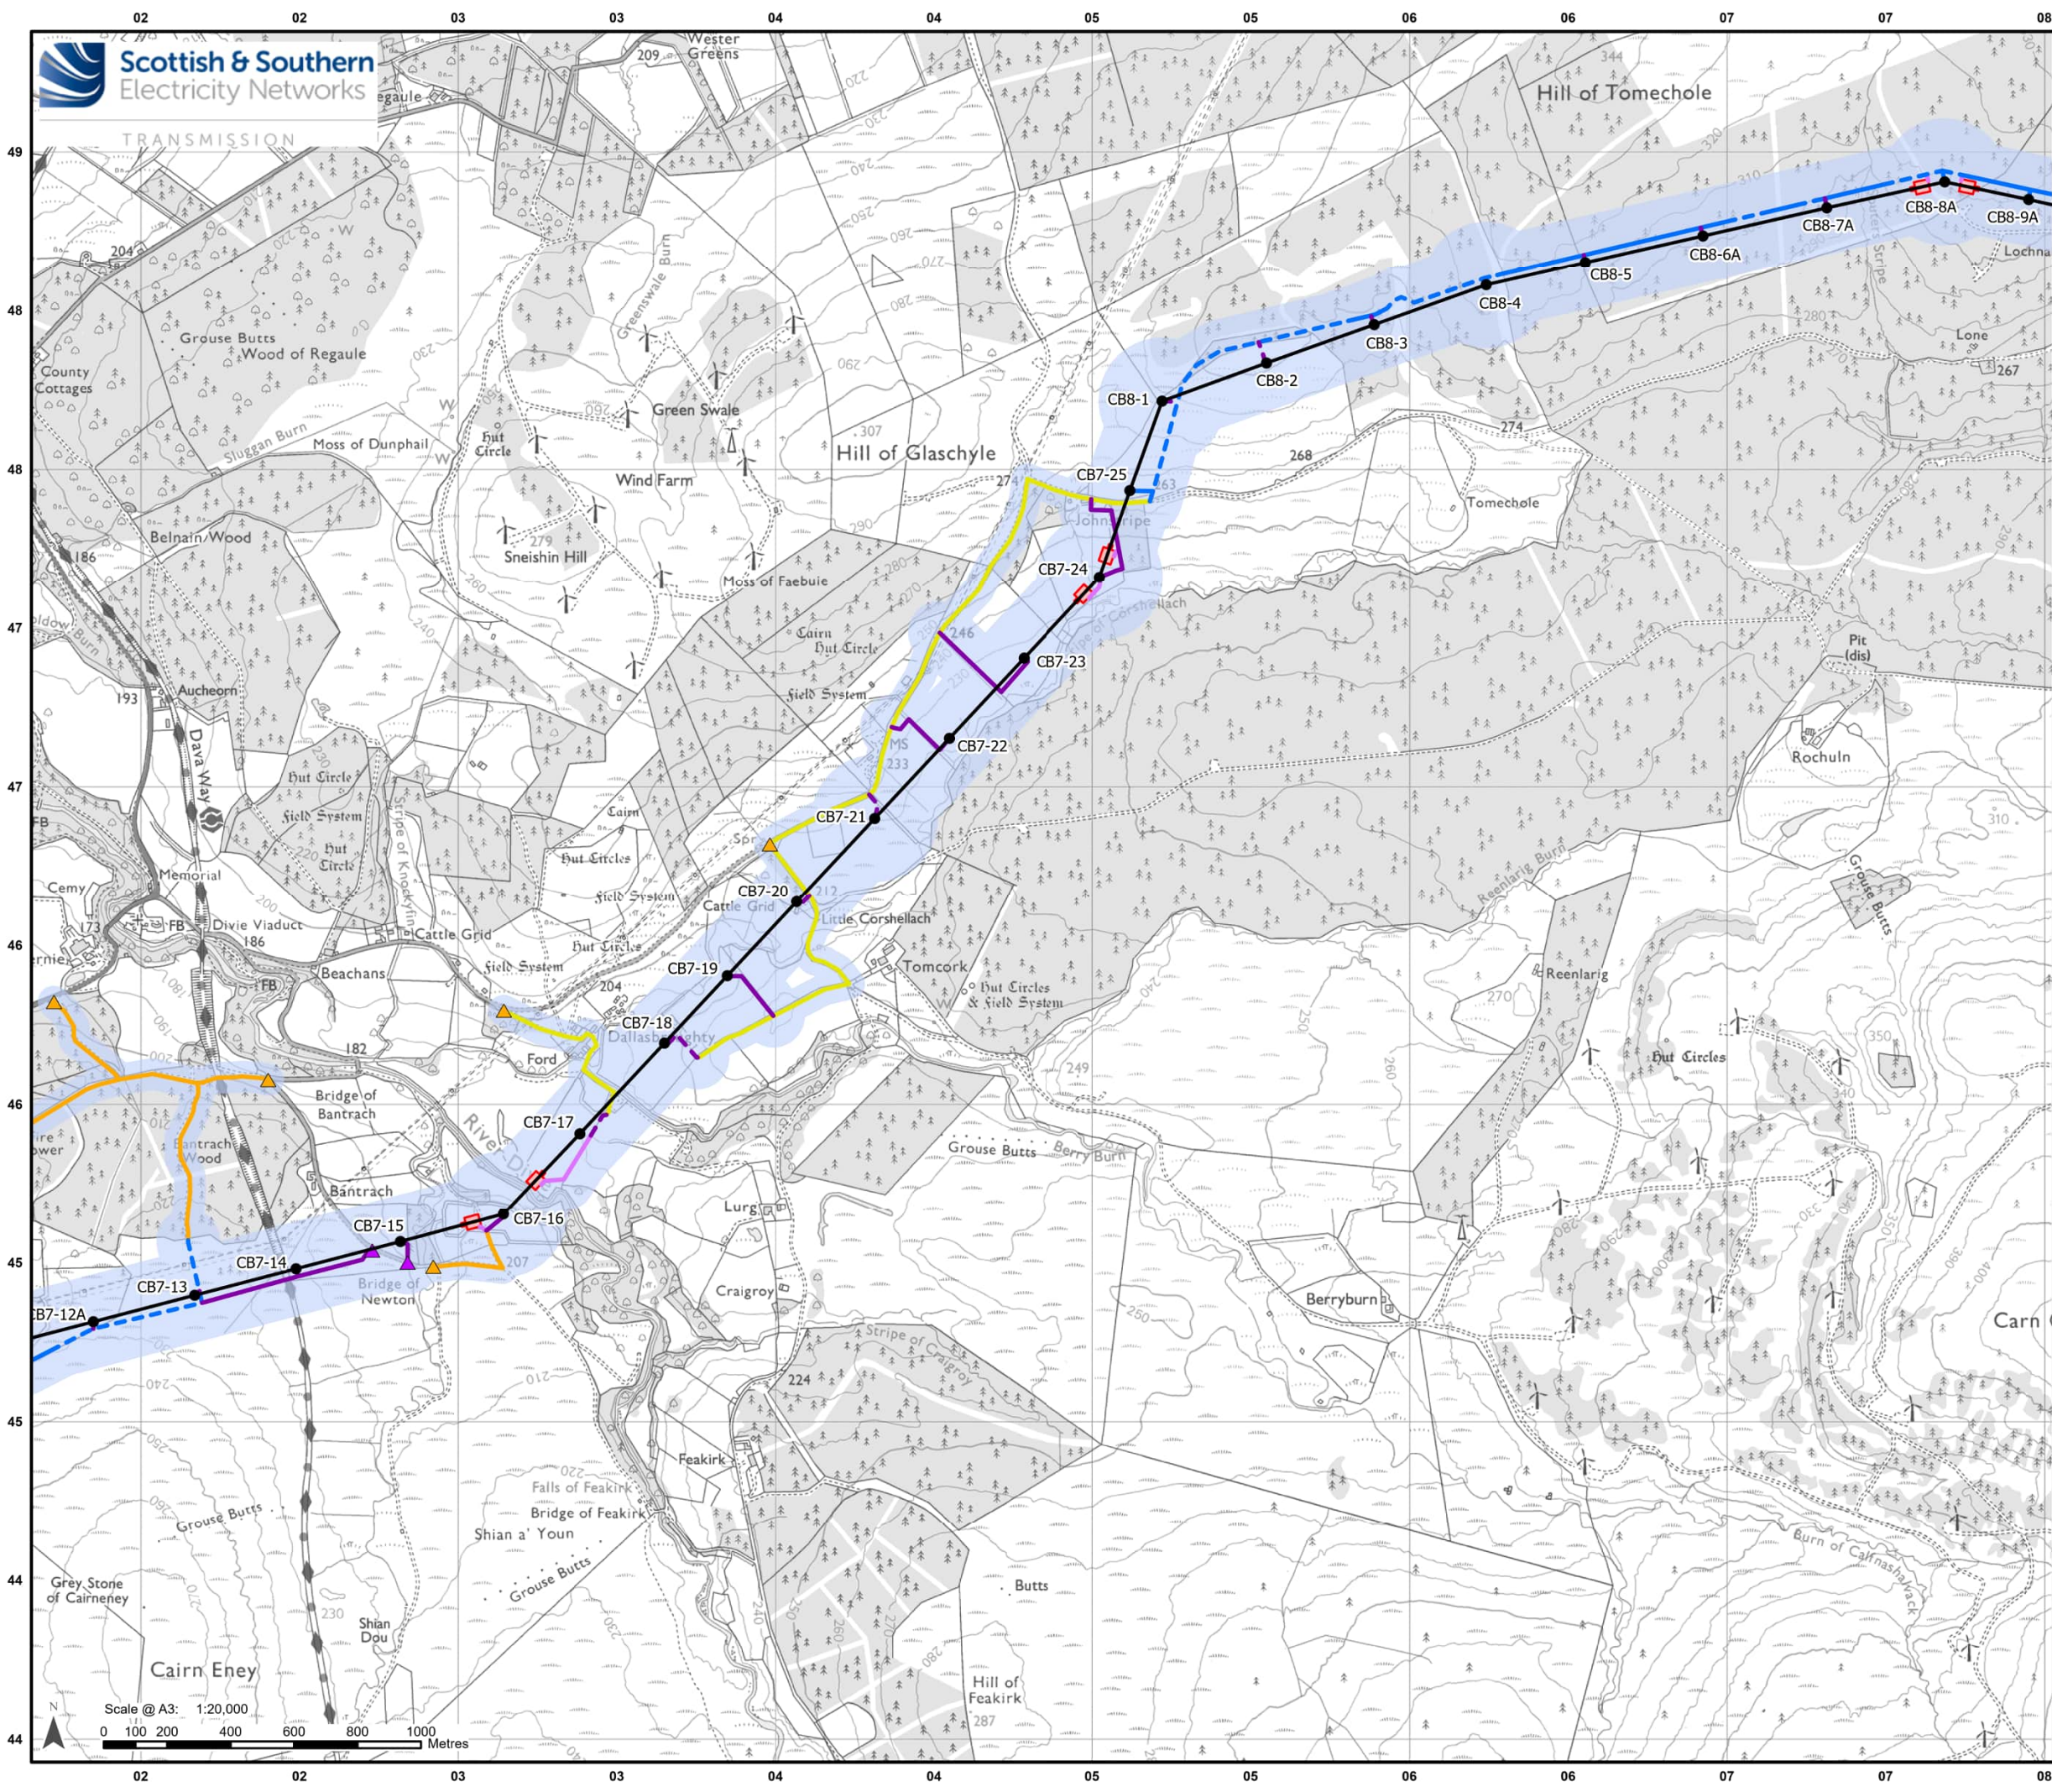

Legend

- Existing Tower
- Existing OHL
- Development for which Section 37 Consent is Sought**
 - Proposed OHL Alignment - 400 kV
 - Proposed Tower - 400 kV (with tower number)
 - Limit of Deviation - Proposed Development
- Ancillary Development**
 - Proposed Conductor Pulling Area (EPZ)
 - Existing Access – Upgrade – Good / Fair Condition
 - Existing Access – Upgrade – Poor Condition
 - Proposed Access – ATV or Temporary Trackway
 - Proposed Access – Permanent
 - Proposed Access – Permanent Floated
 - Proposed Access – Temporary
 - Proposed Access – Temporary Floated
 - Proposed Bellmouth - Temporary
 - Proposed Bellmouth - Upgrade

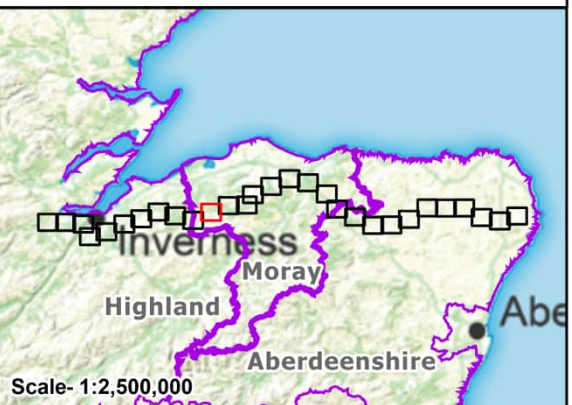


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 11 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187

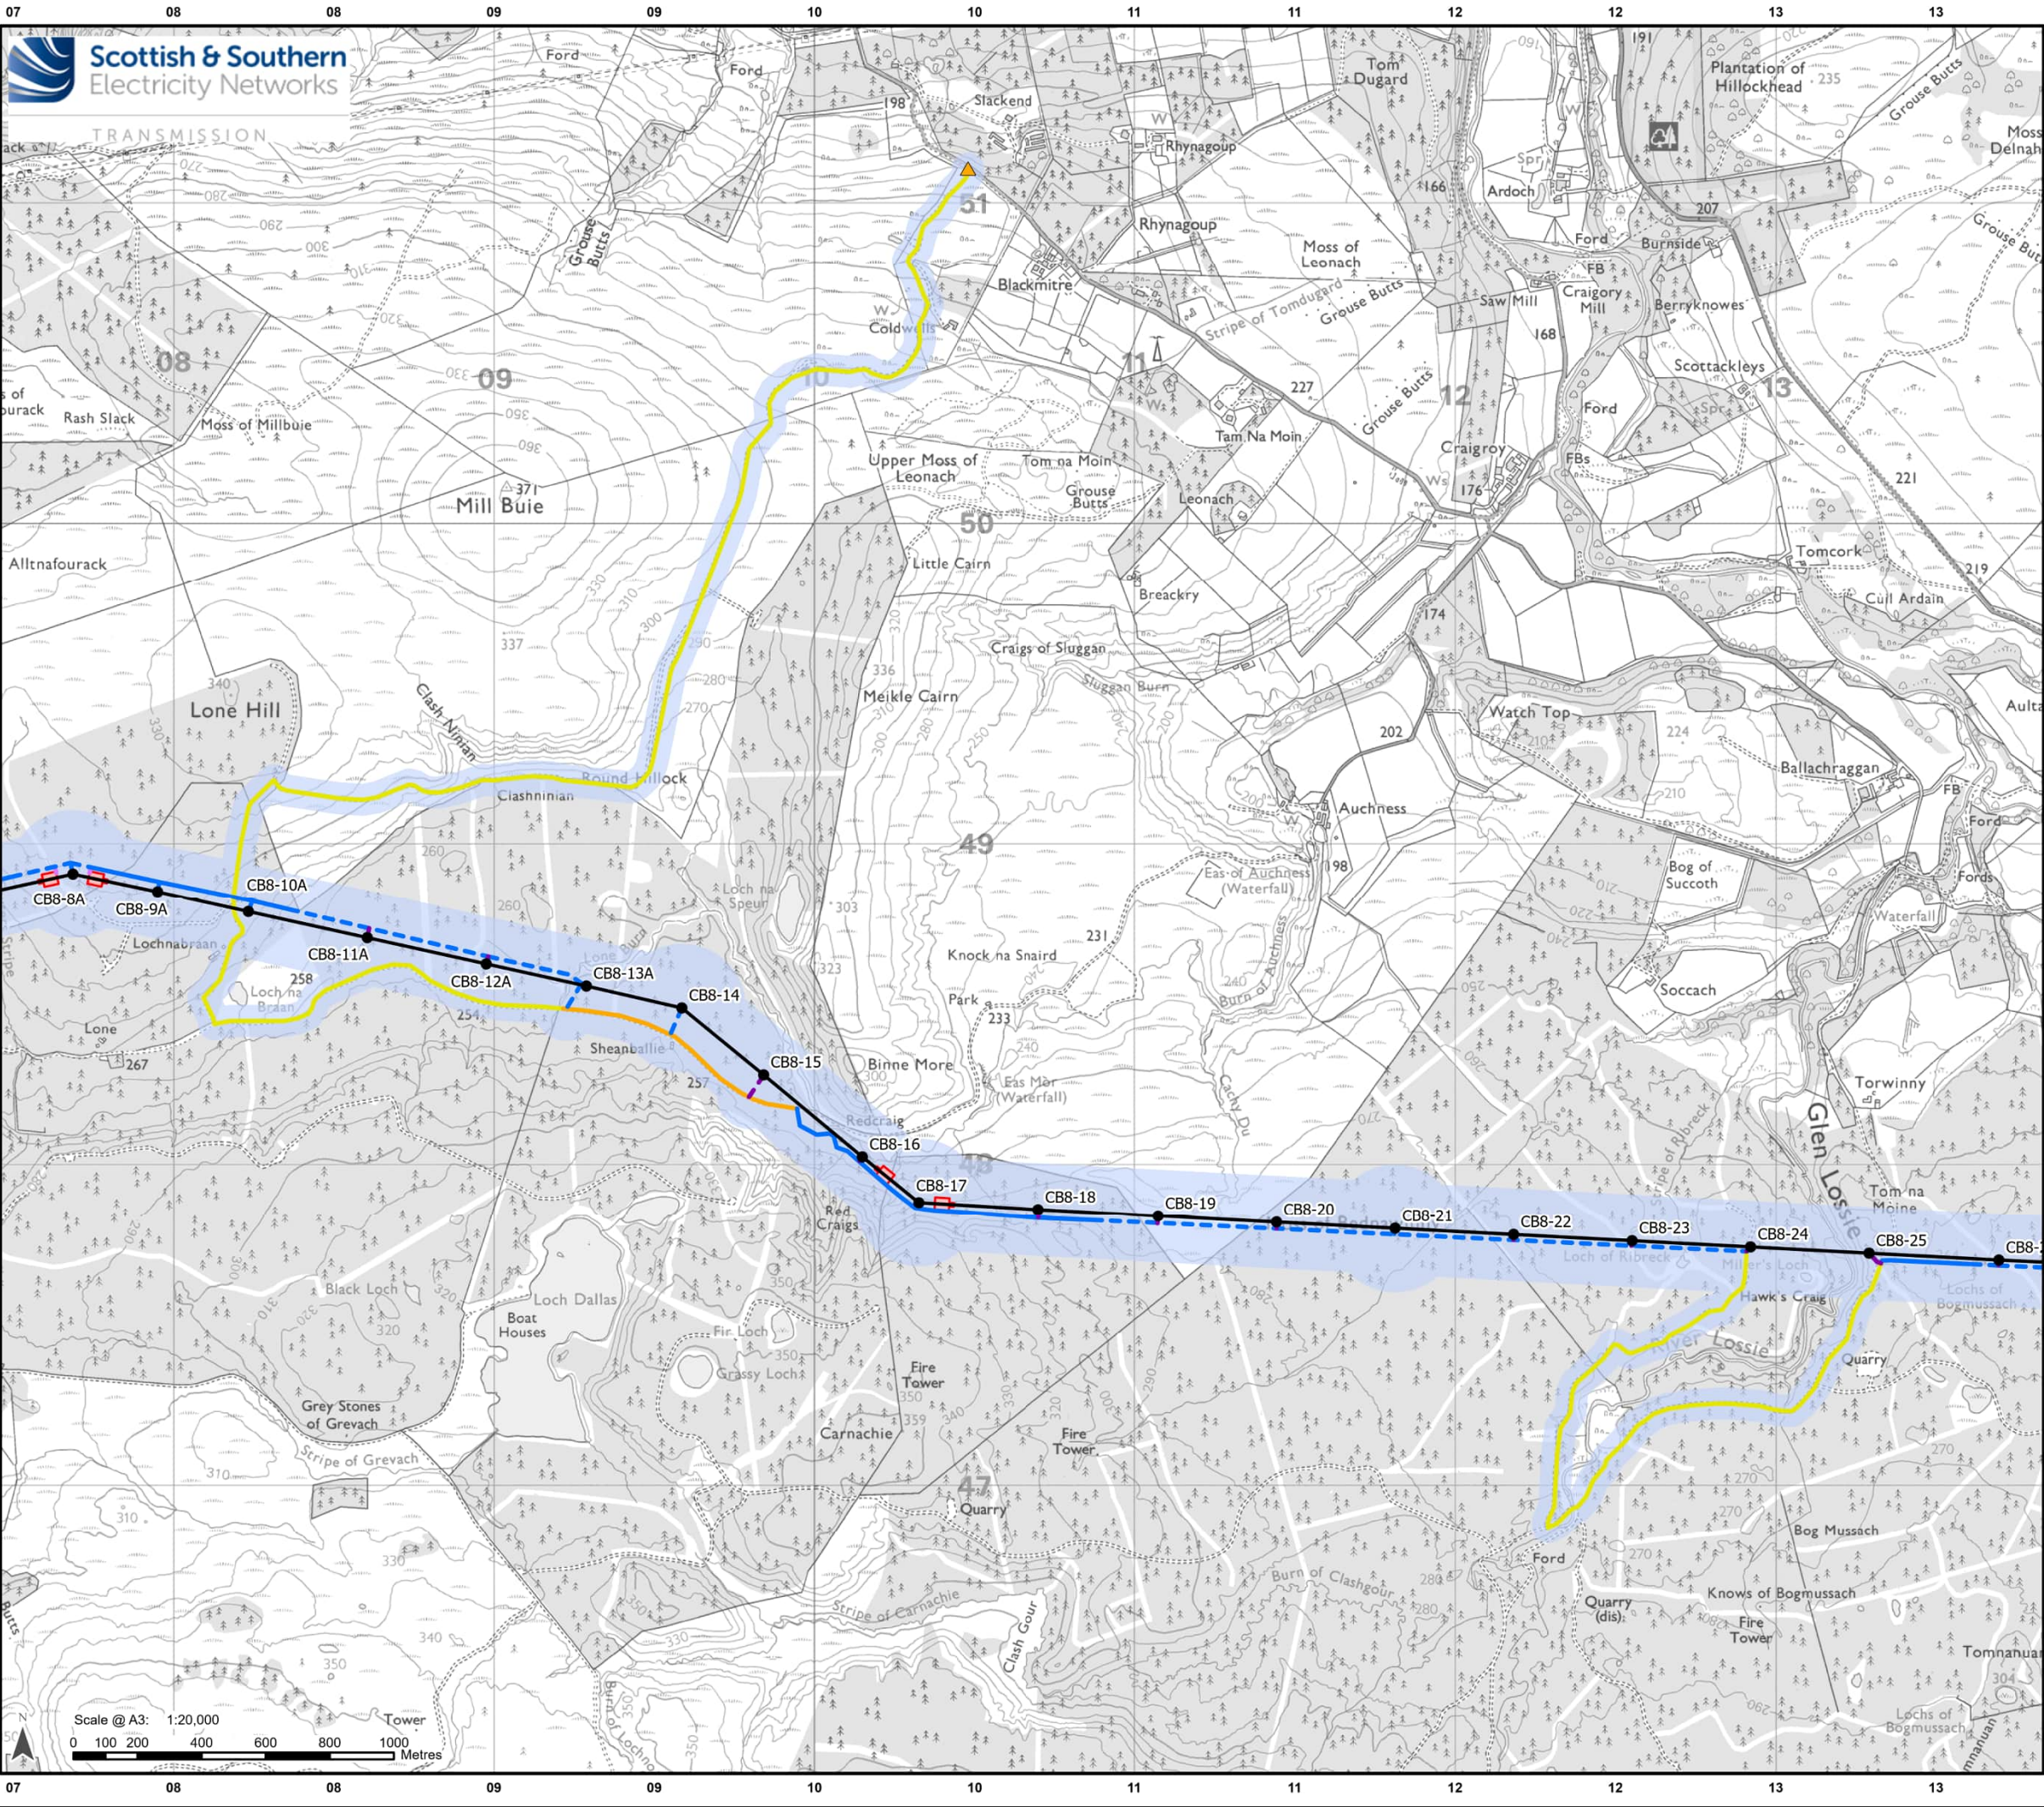

Legend

- Existing Tower
- Existing OHL

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation - Proposed Development

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Upgrade

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 12 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187



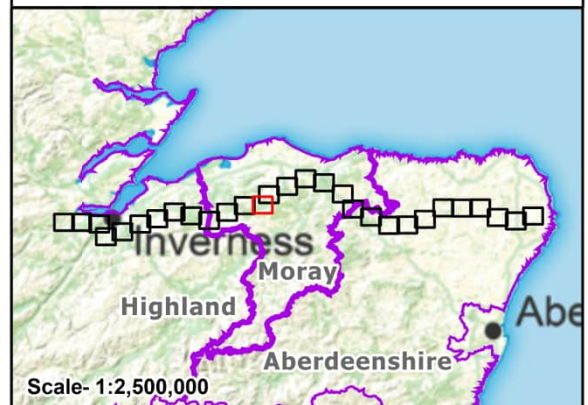


Figure 2 - Site Layout
Page 13 of 29

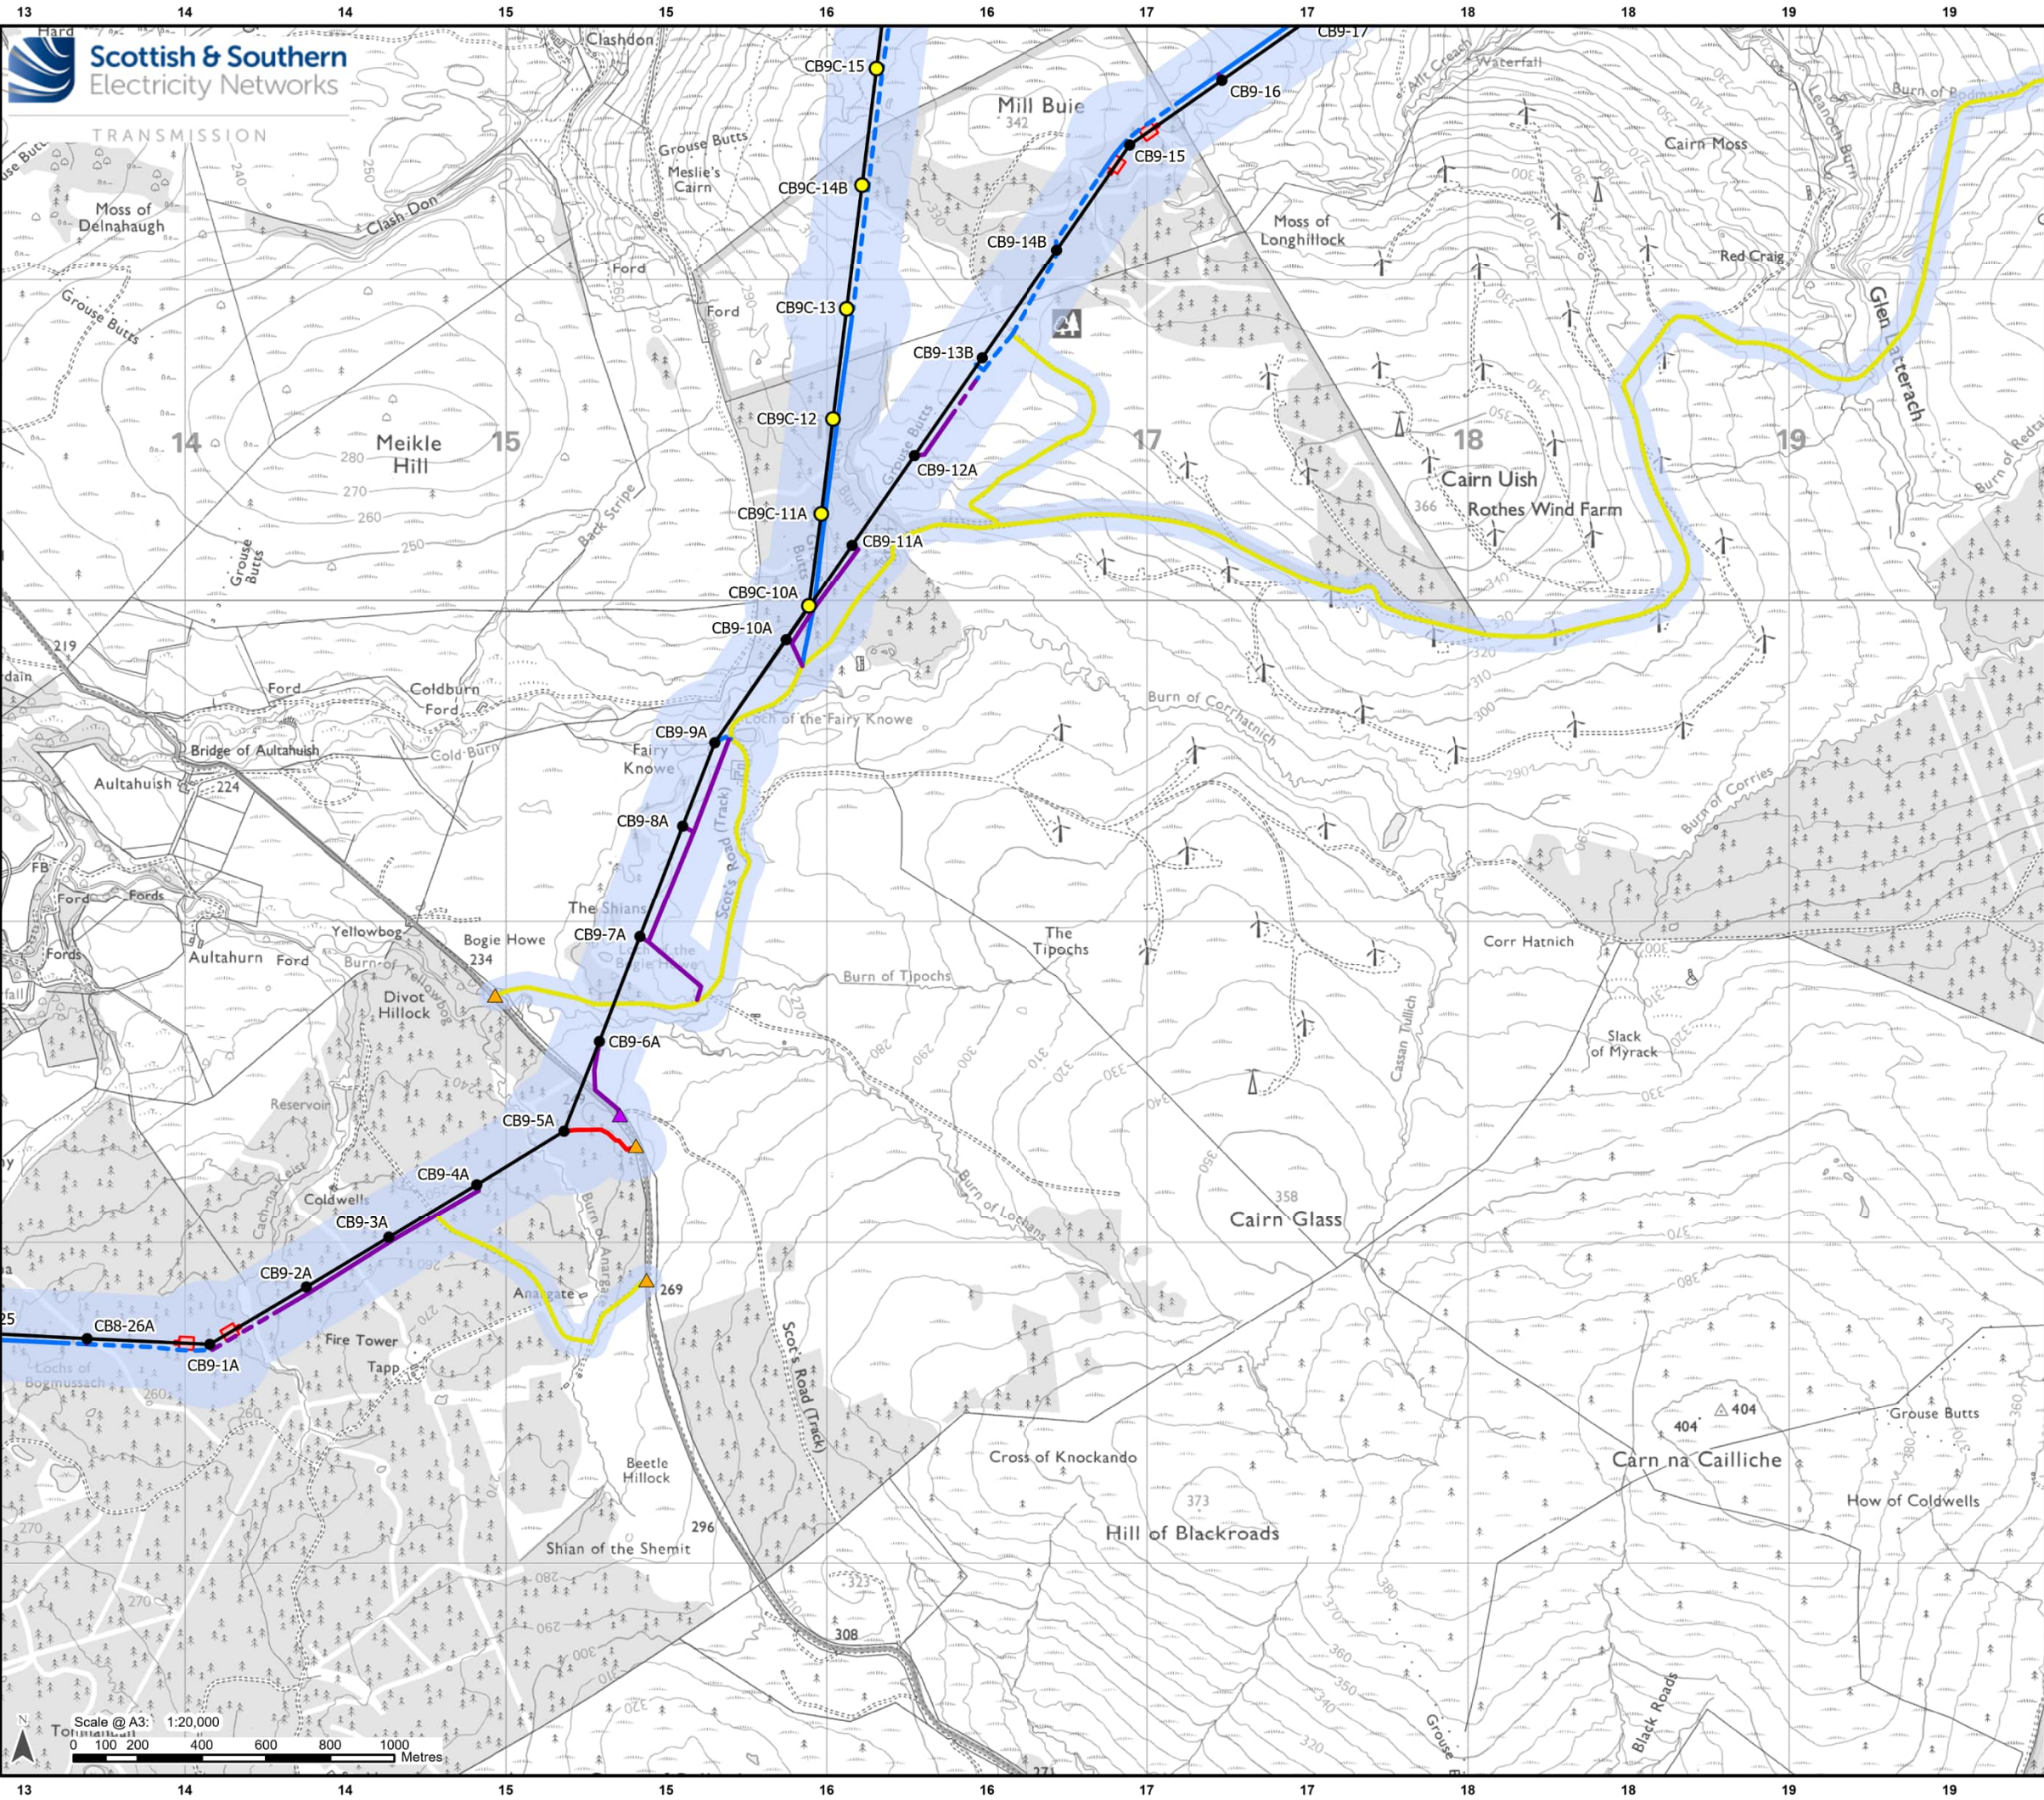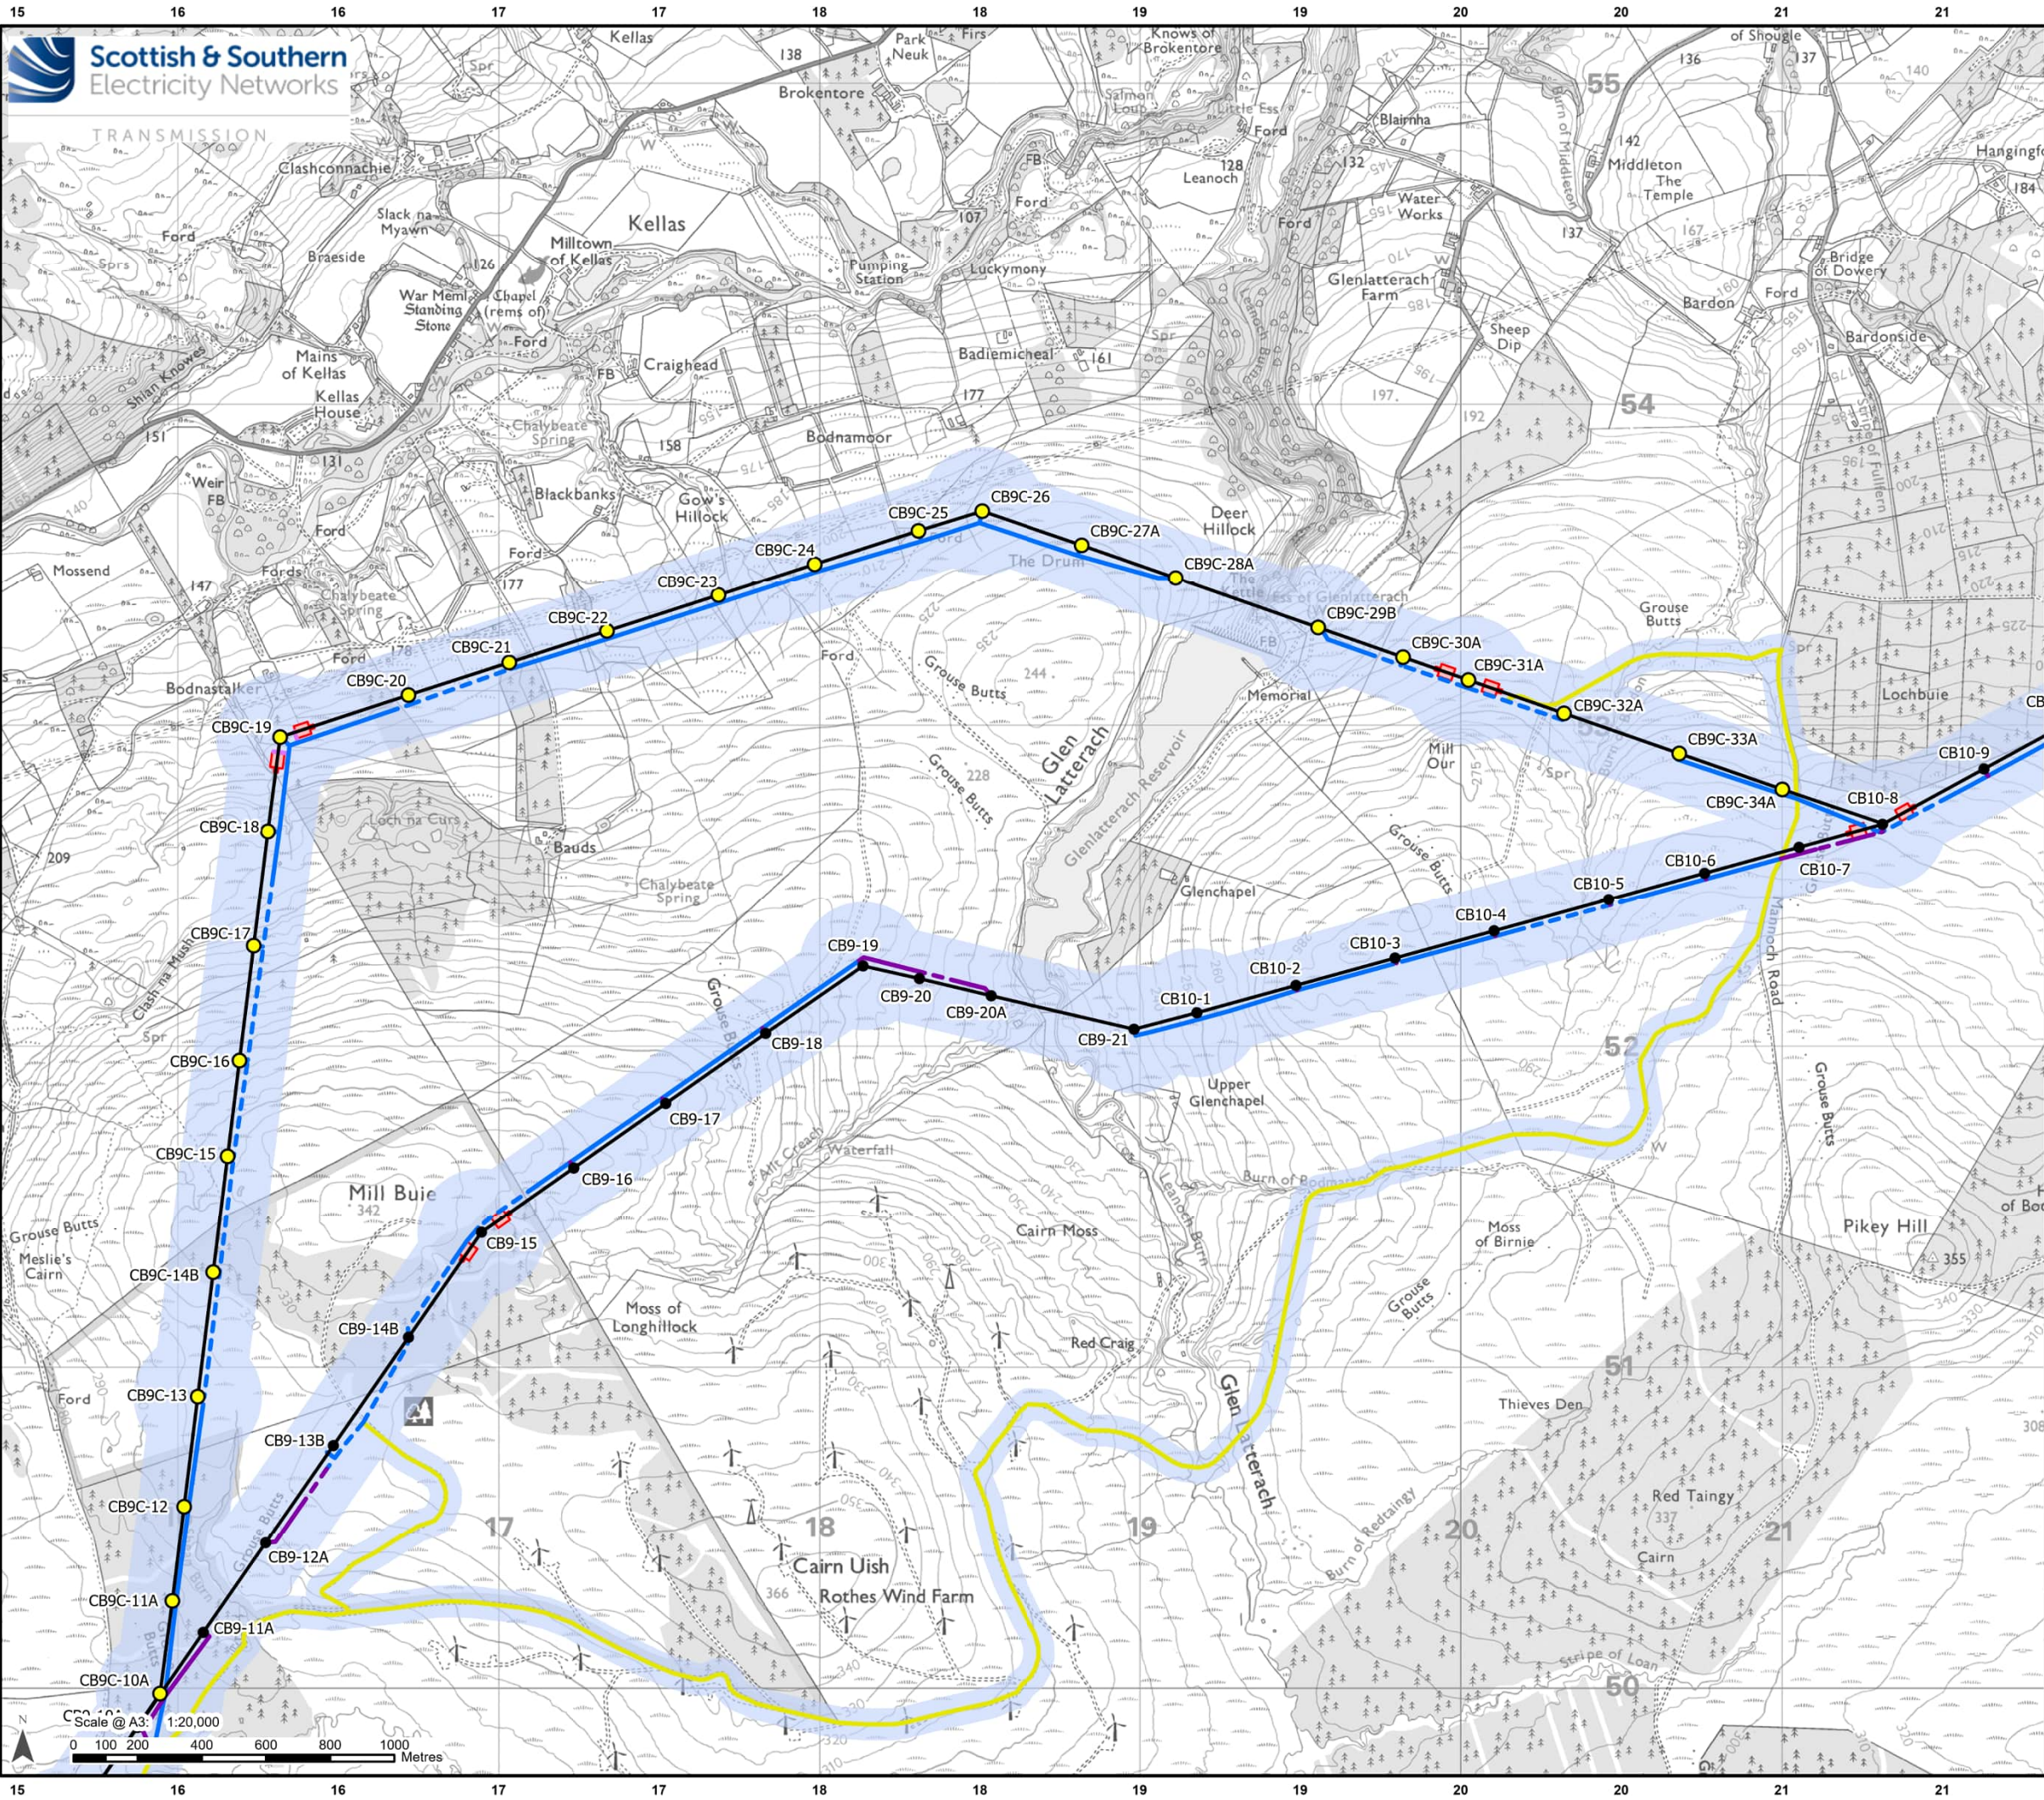


Legend

- Existing Tower
- Existing OHL
- Development for which Section 37 Consent is Sought
 - Proposed OHL Alignment - 400 kV
 - Proposed Tower - 400 kV (with tower number)
 - Proposed Tower - Kellas Alternative Alignment
 - Limit of Deviation - Proposed Development

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

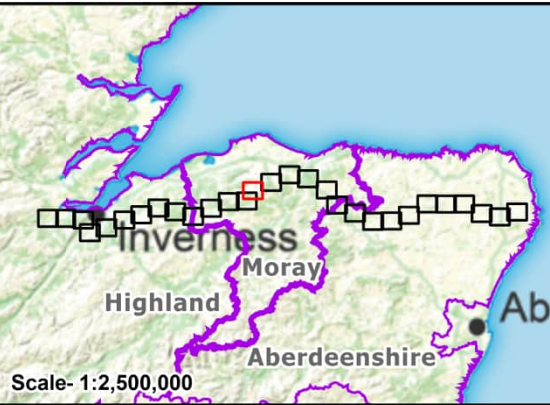


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 14 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187

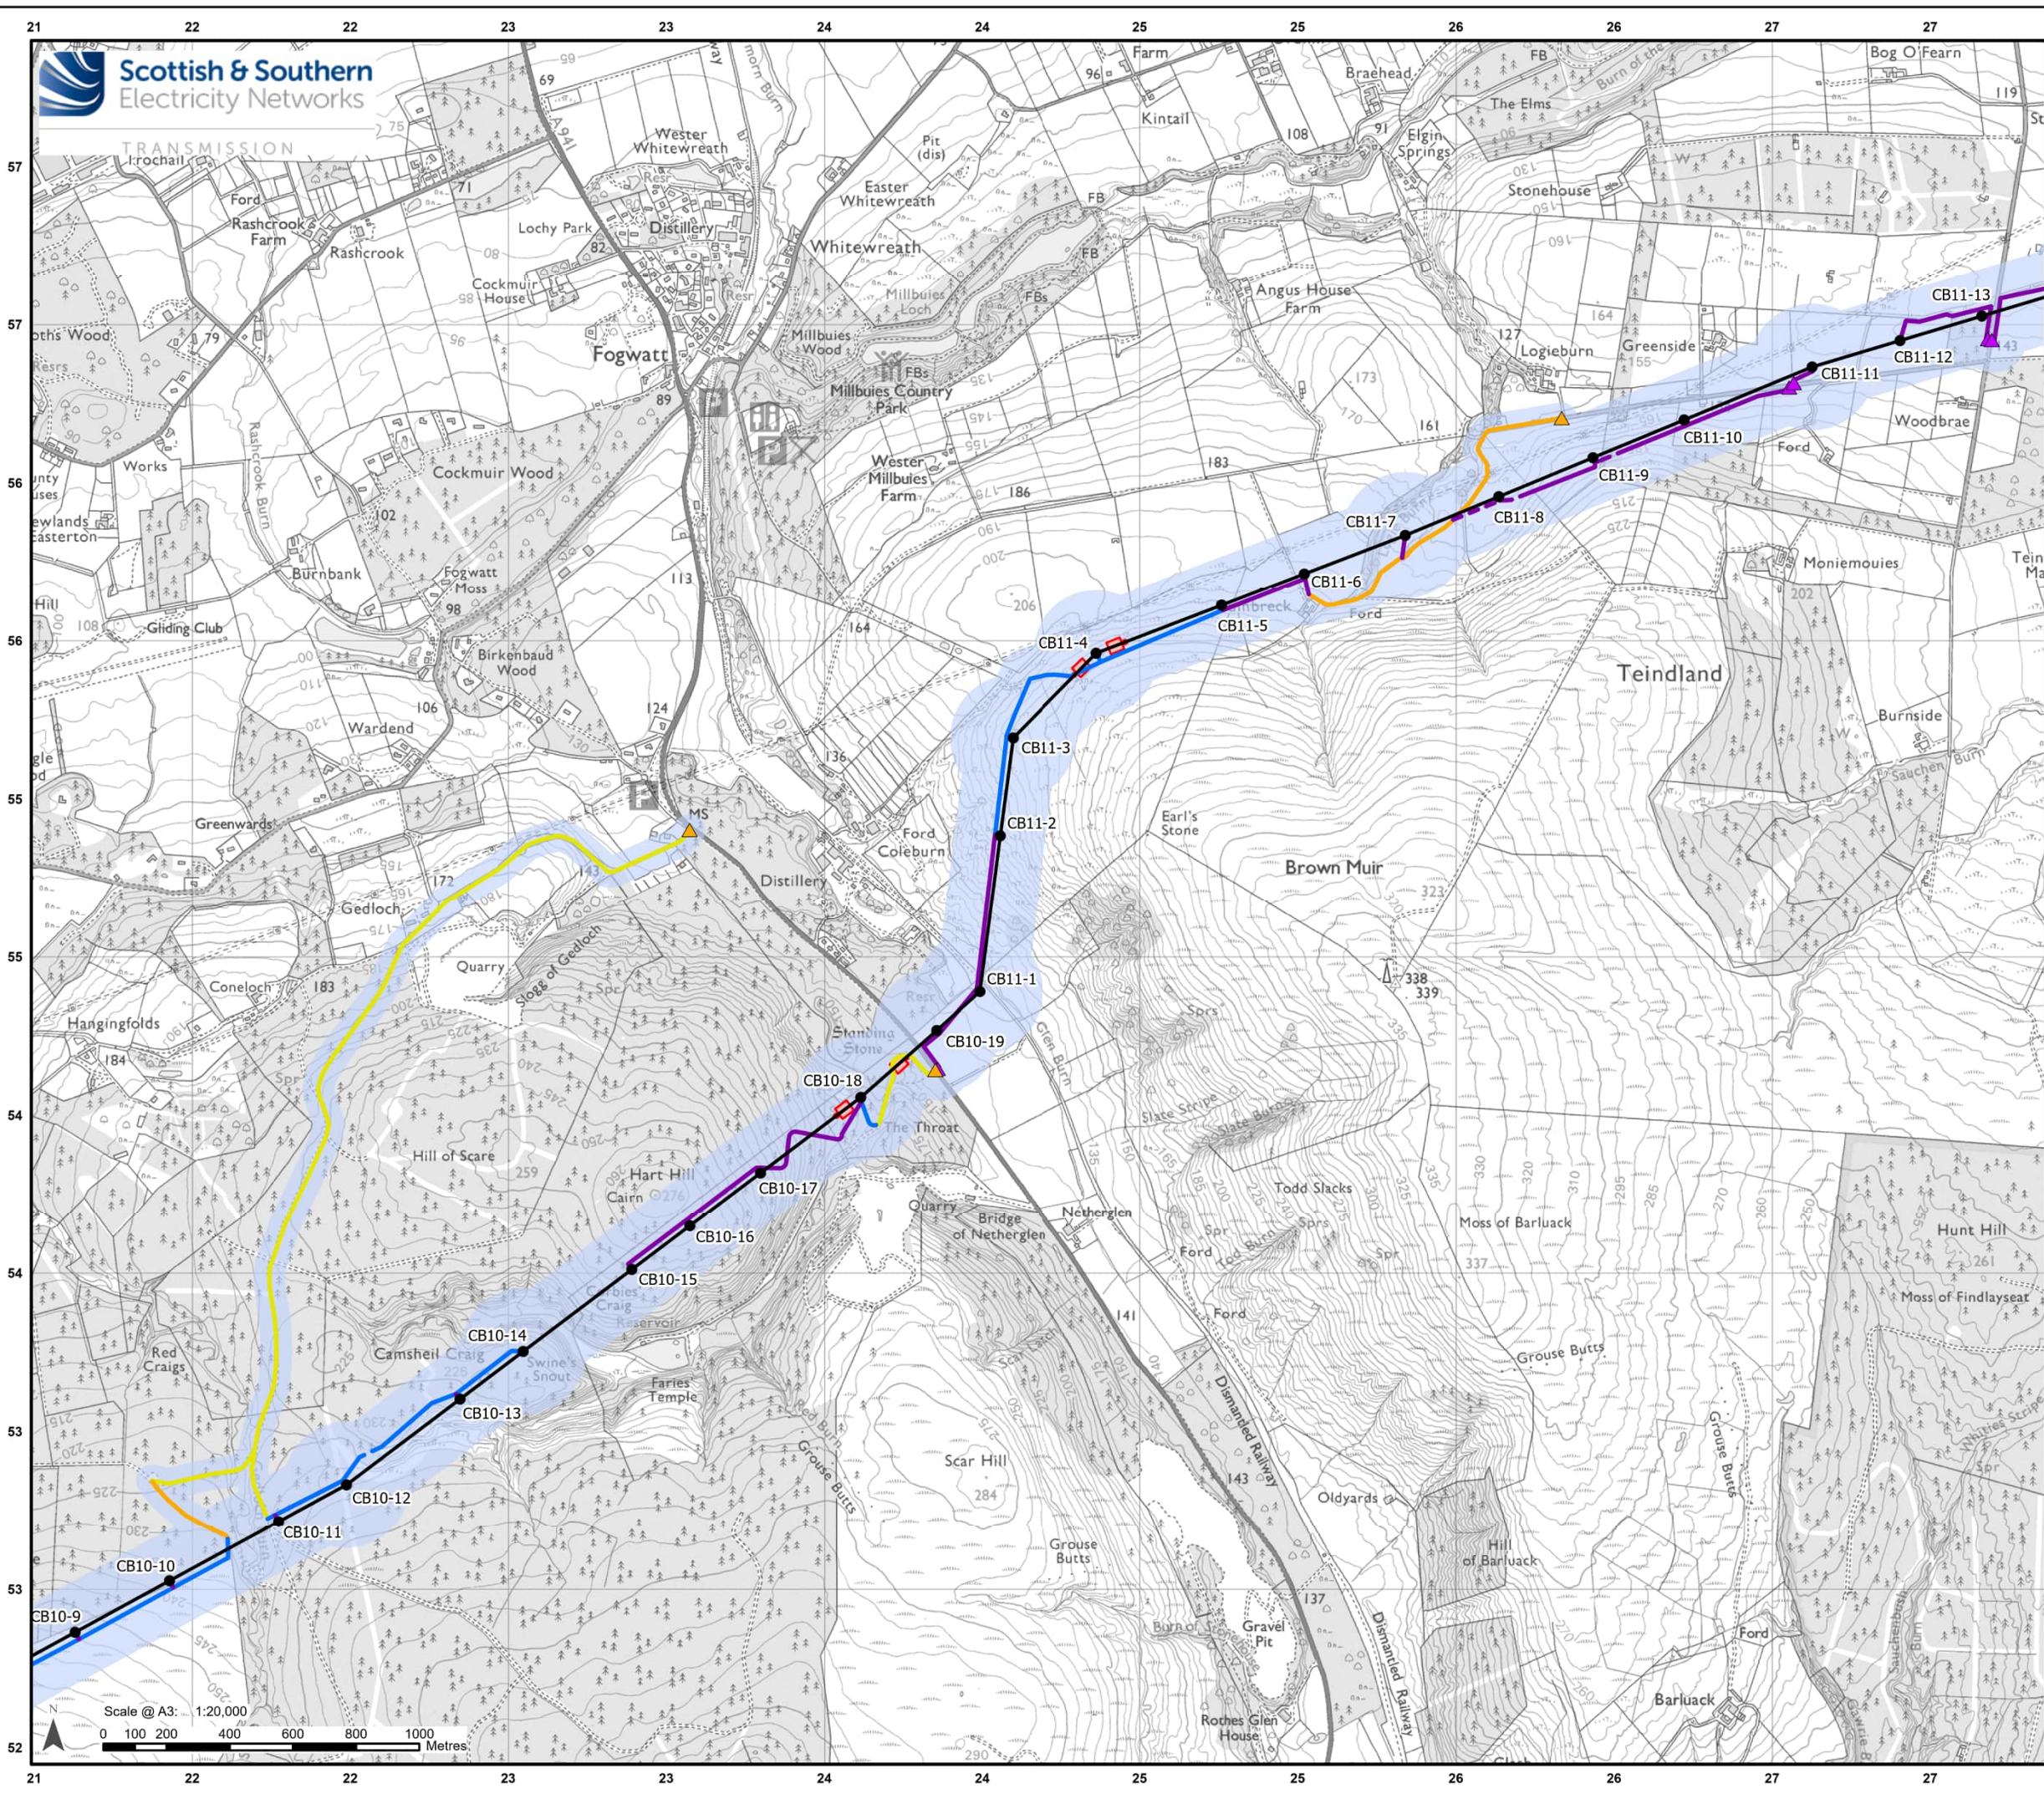

Legend

- Existing Tower
- Existing OHL

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation - Proposed Development

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Scale: 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 15 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187

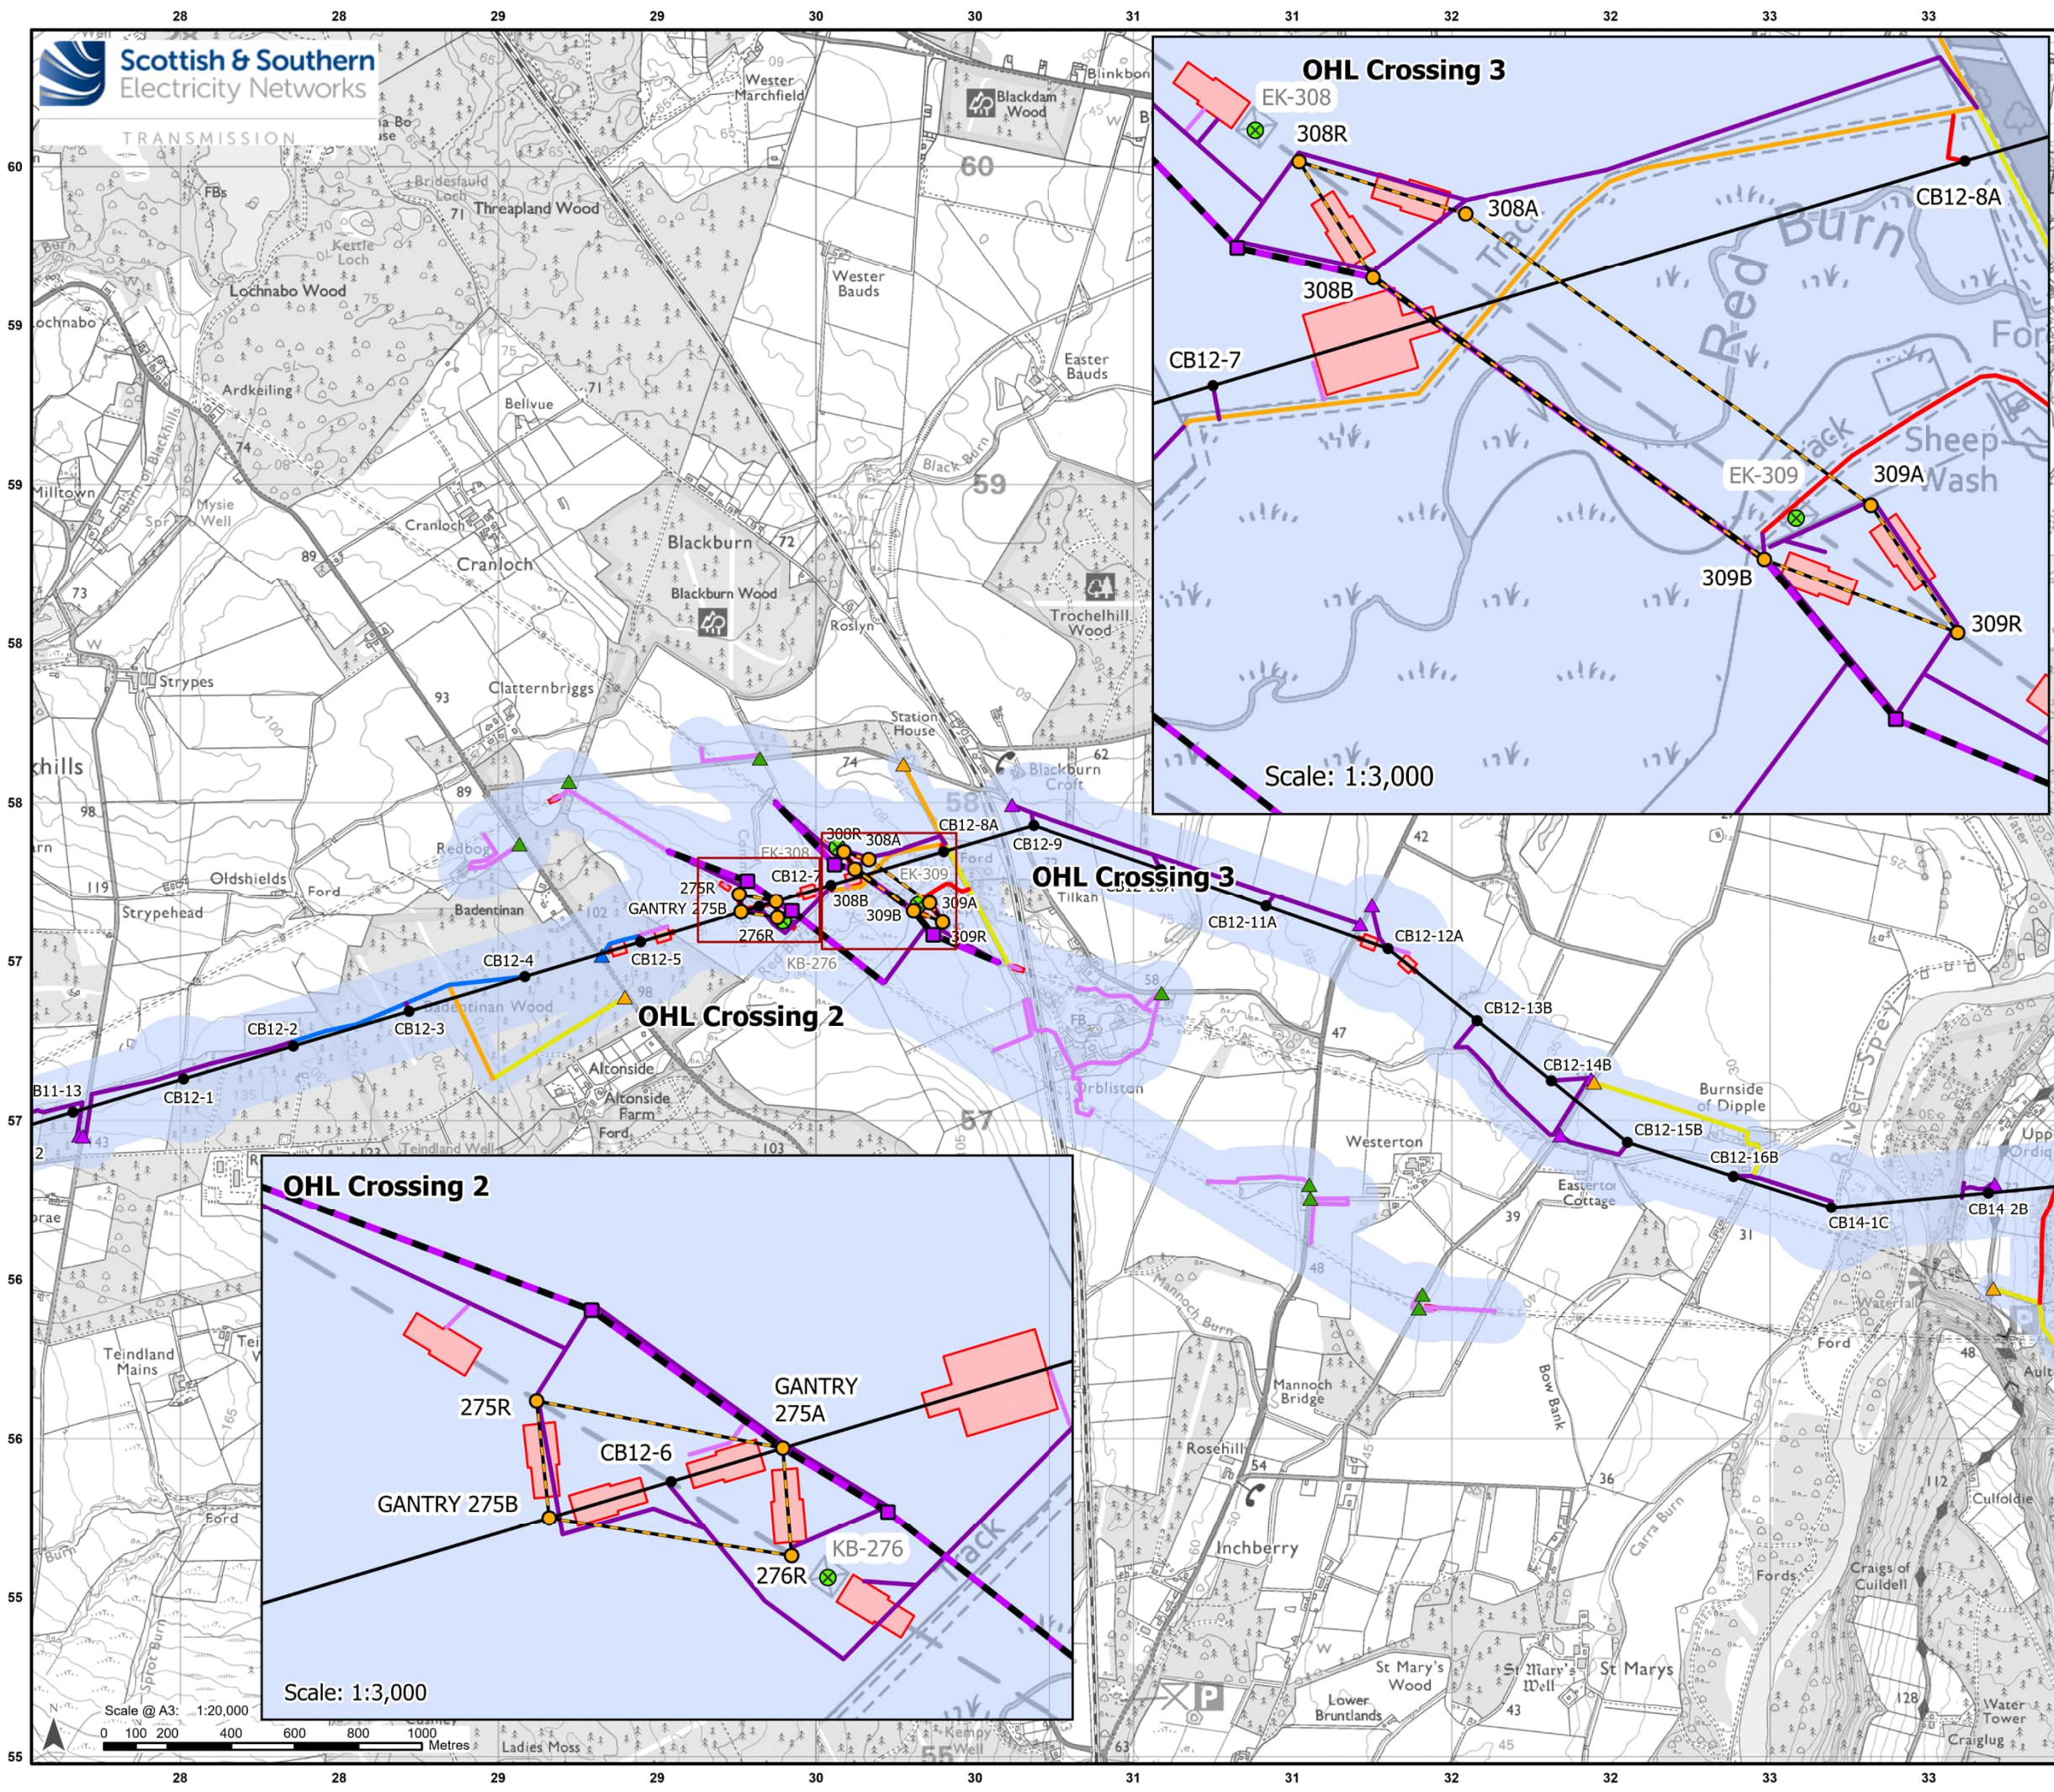

Legend


- Existing Tower
- Existing OHL

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary
- Limit of Deviation - Proposed Development

Ancillary Development

- Tower to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Existing Access - Upgrade - Good / Fair Condition
- Existing Access - Upgrade - Poor Condition
- Existing Access - Upgrade - Very Poor Condition
- Proposed Access - ATV or Temporary Trackway
- Proposed Access - Permanent
- Proposed Access - Temporary
- Proposed Bellmouth - Access Only / ATV
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

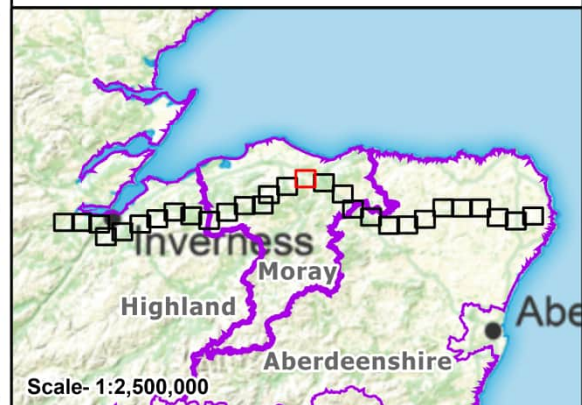


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 16 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187

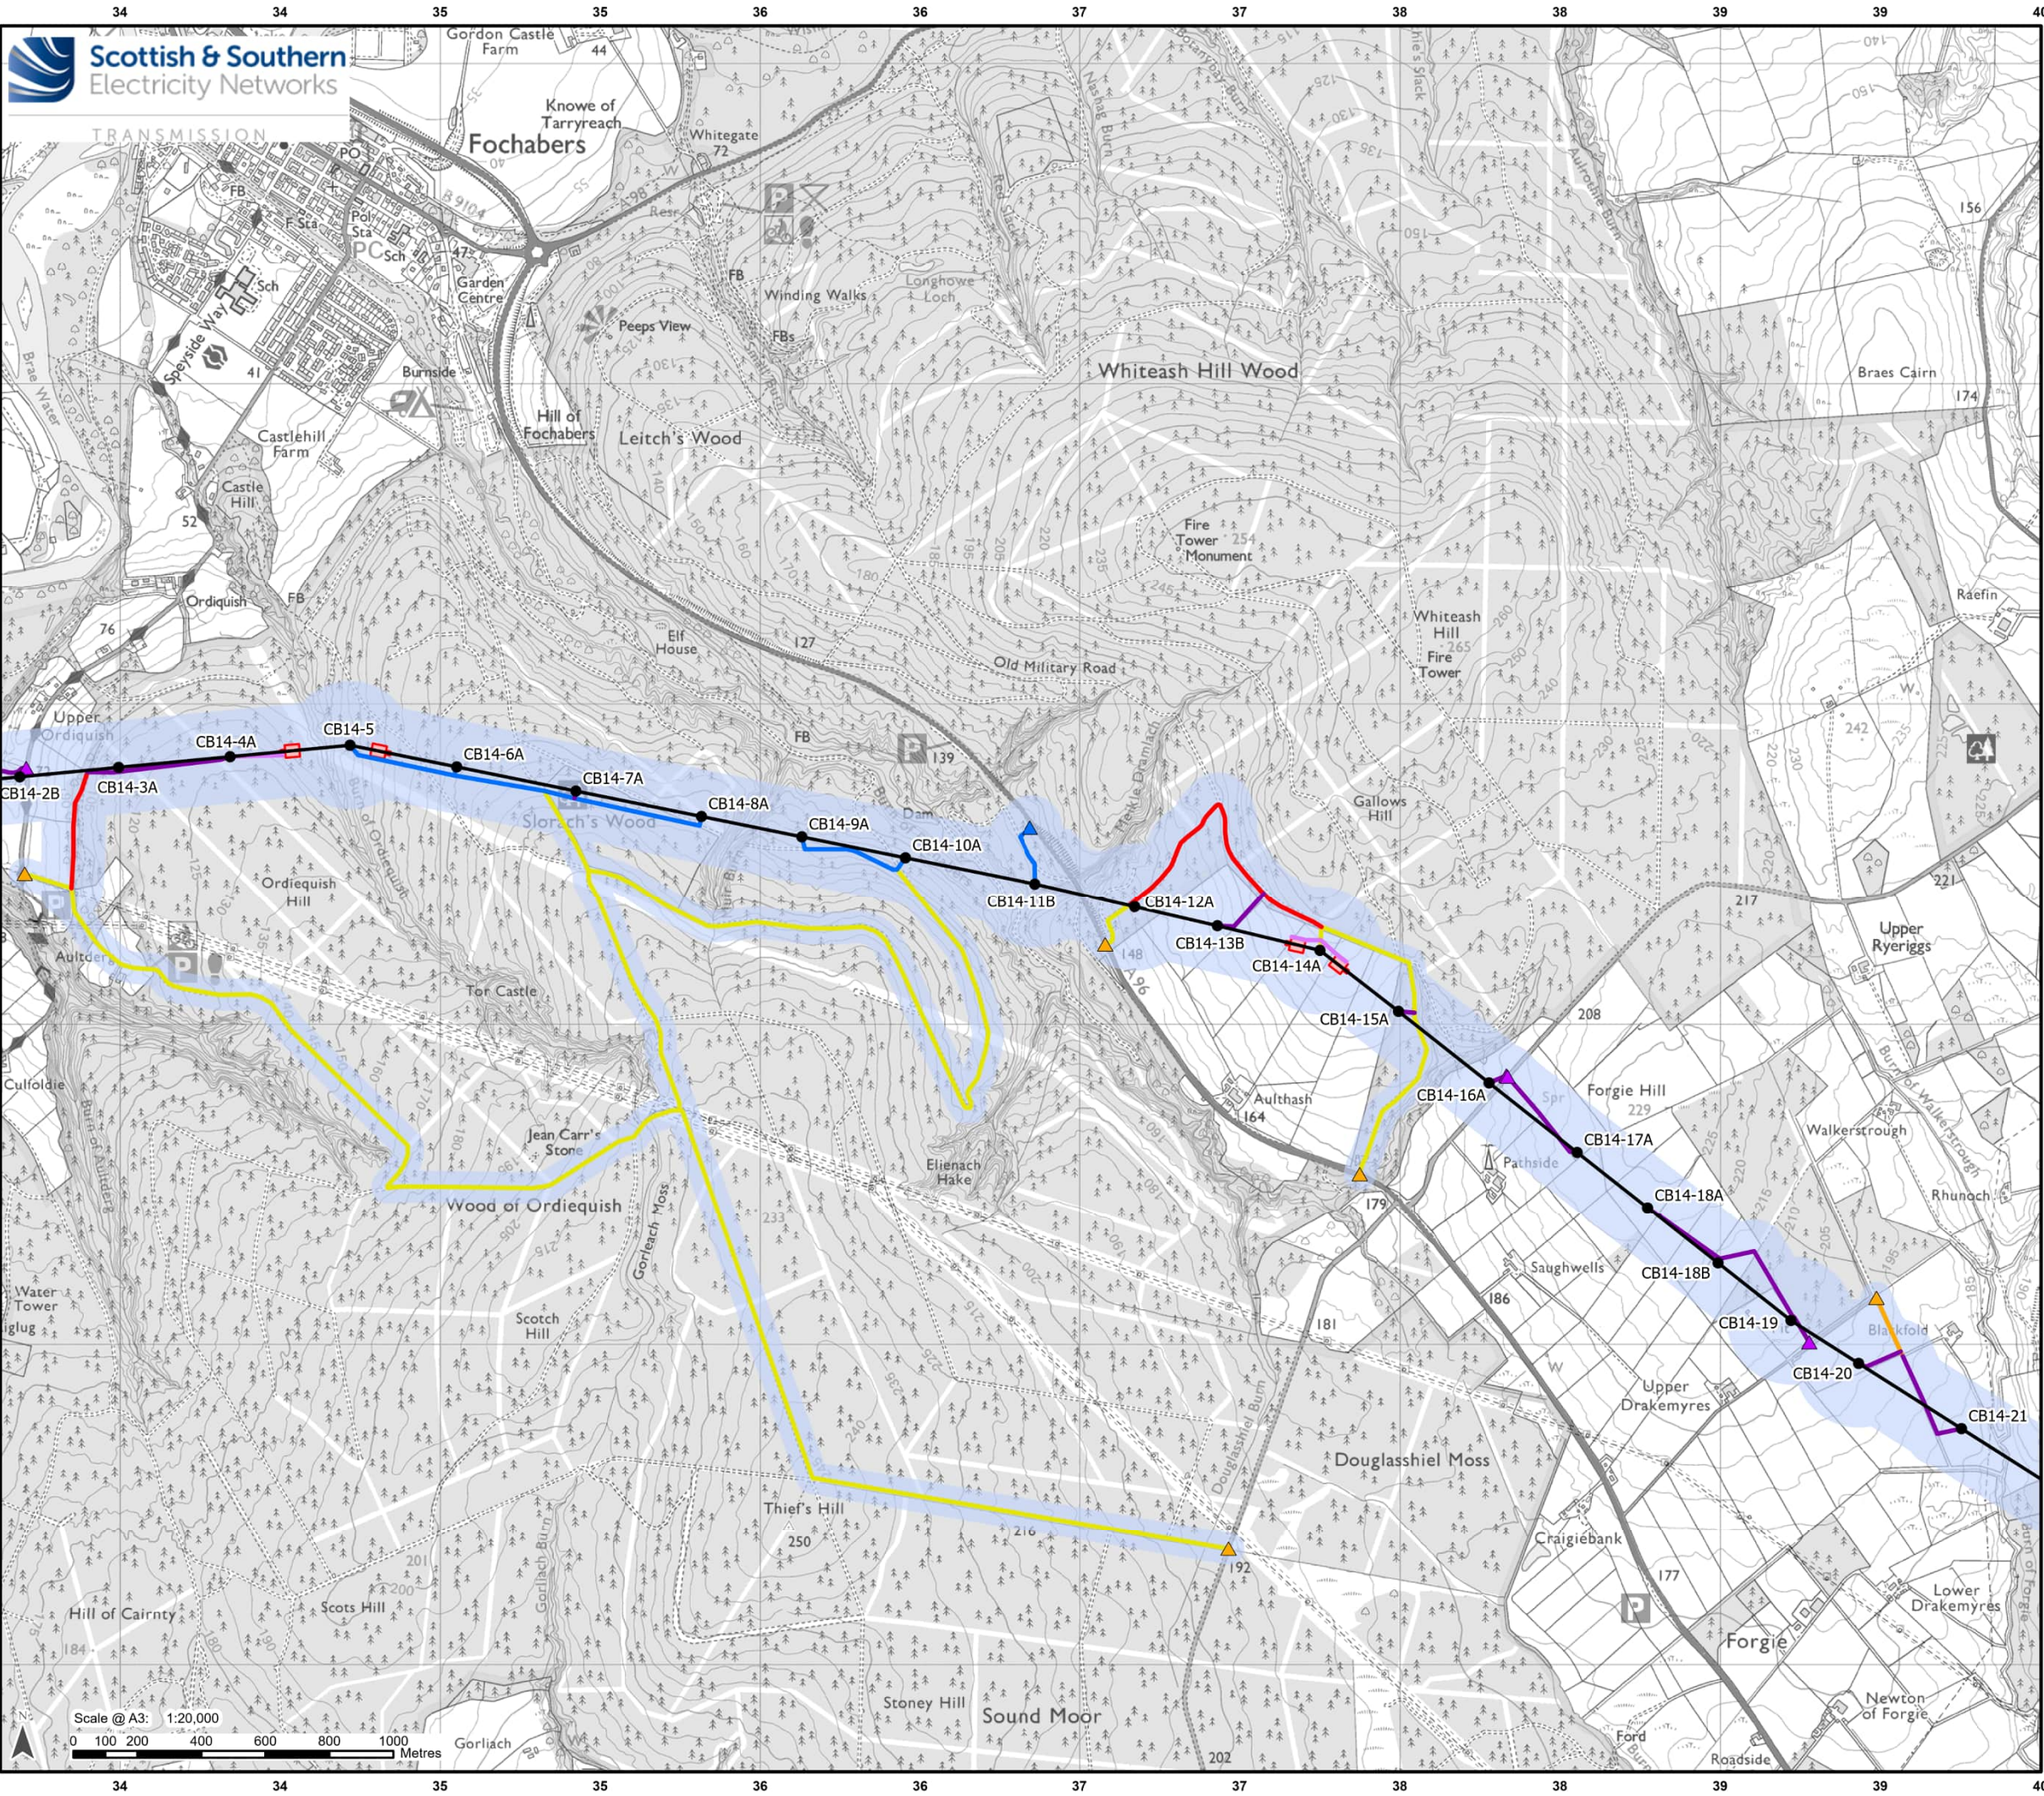

- Legend**
- Existing Tower

Existing OHL

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV (with tower number)

Limit of Deviation - Proposed Development

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Existing Access – Upgrade – Very Poor Condition

Proposed Access – ATV or Temporary Trackway


Proposed Access – Permanent

Proposed Access – Temporary

Proposed Bellmouth - Permanent

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade
-
- | | |
|--|--|
| Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey | |
| Project: | Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project |
| Title: | Figure 2 - Site Layout
Page 17 of 29 |
| Drawn by: | MAL |
| Date: | 25/09/2025 |
| Drawing: | B2P-WSP-DA-70092380-187 |

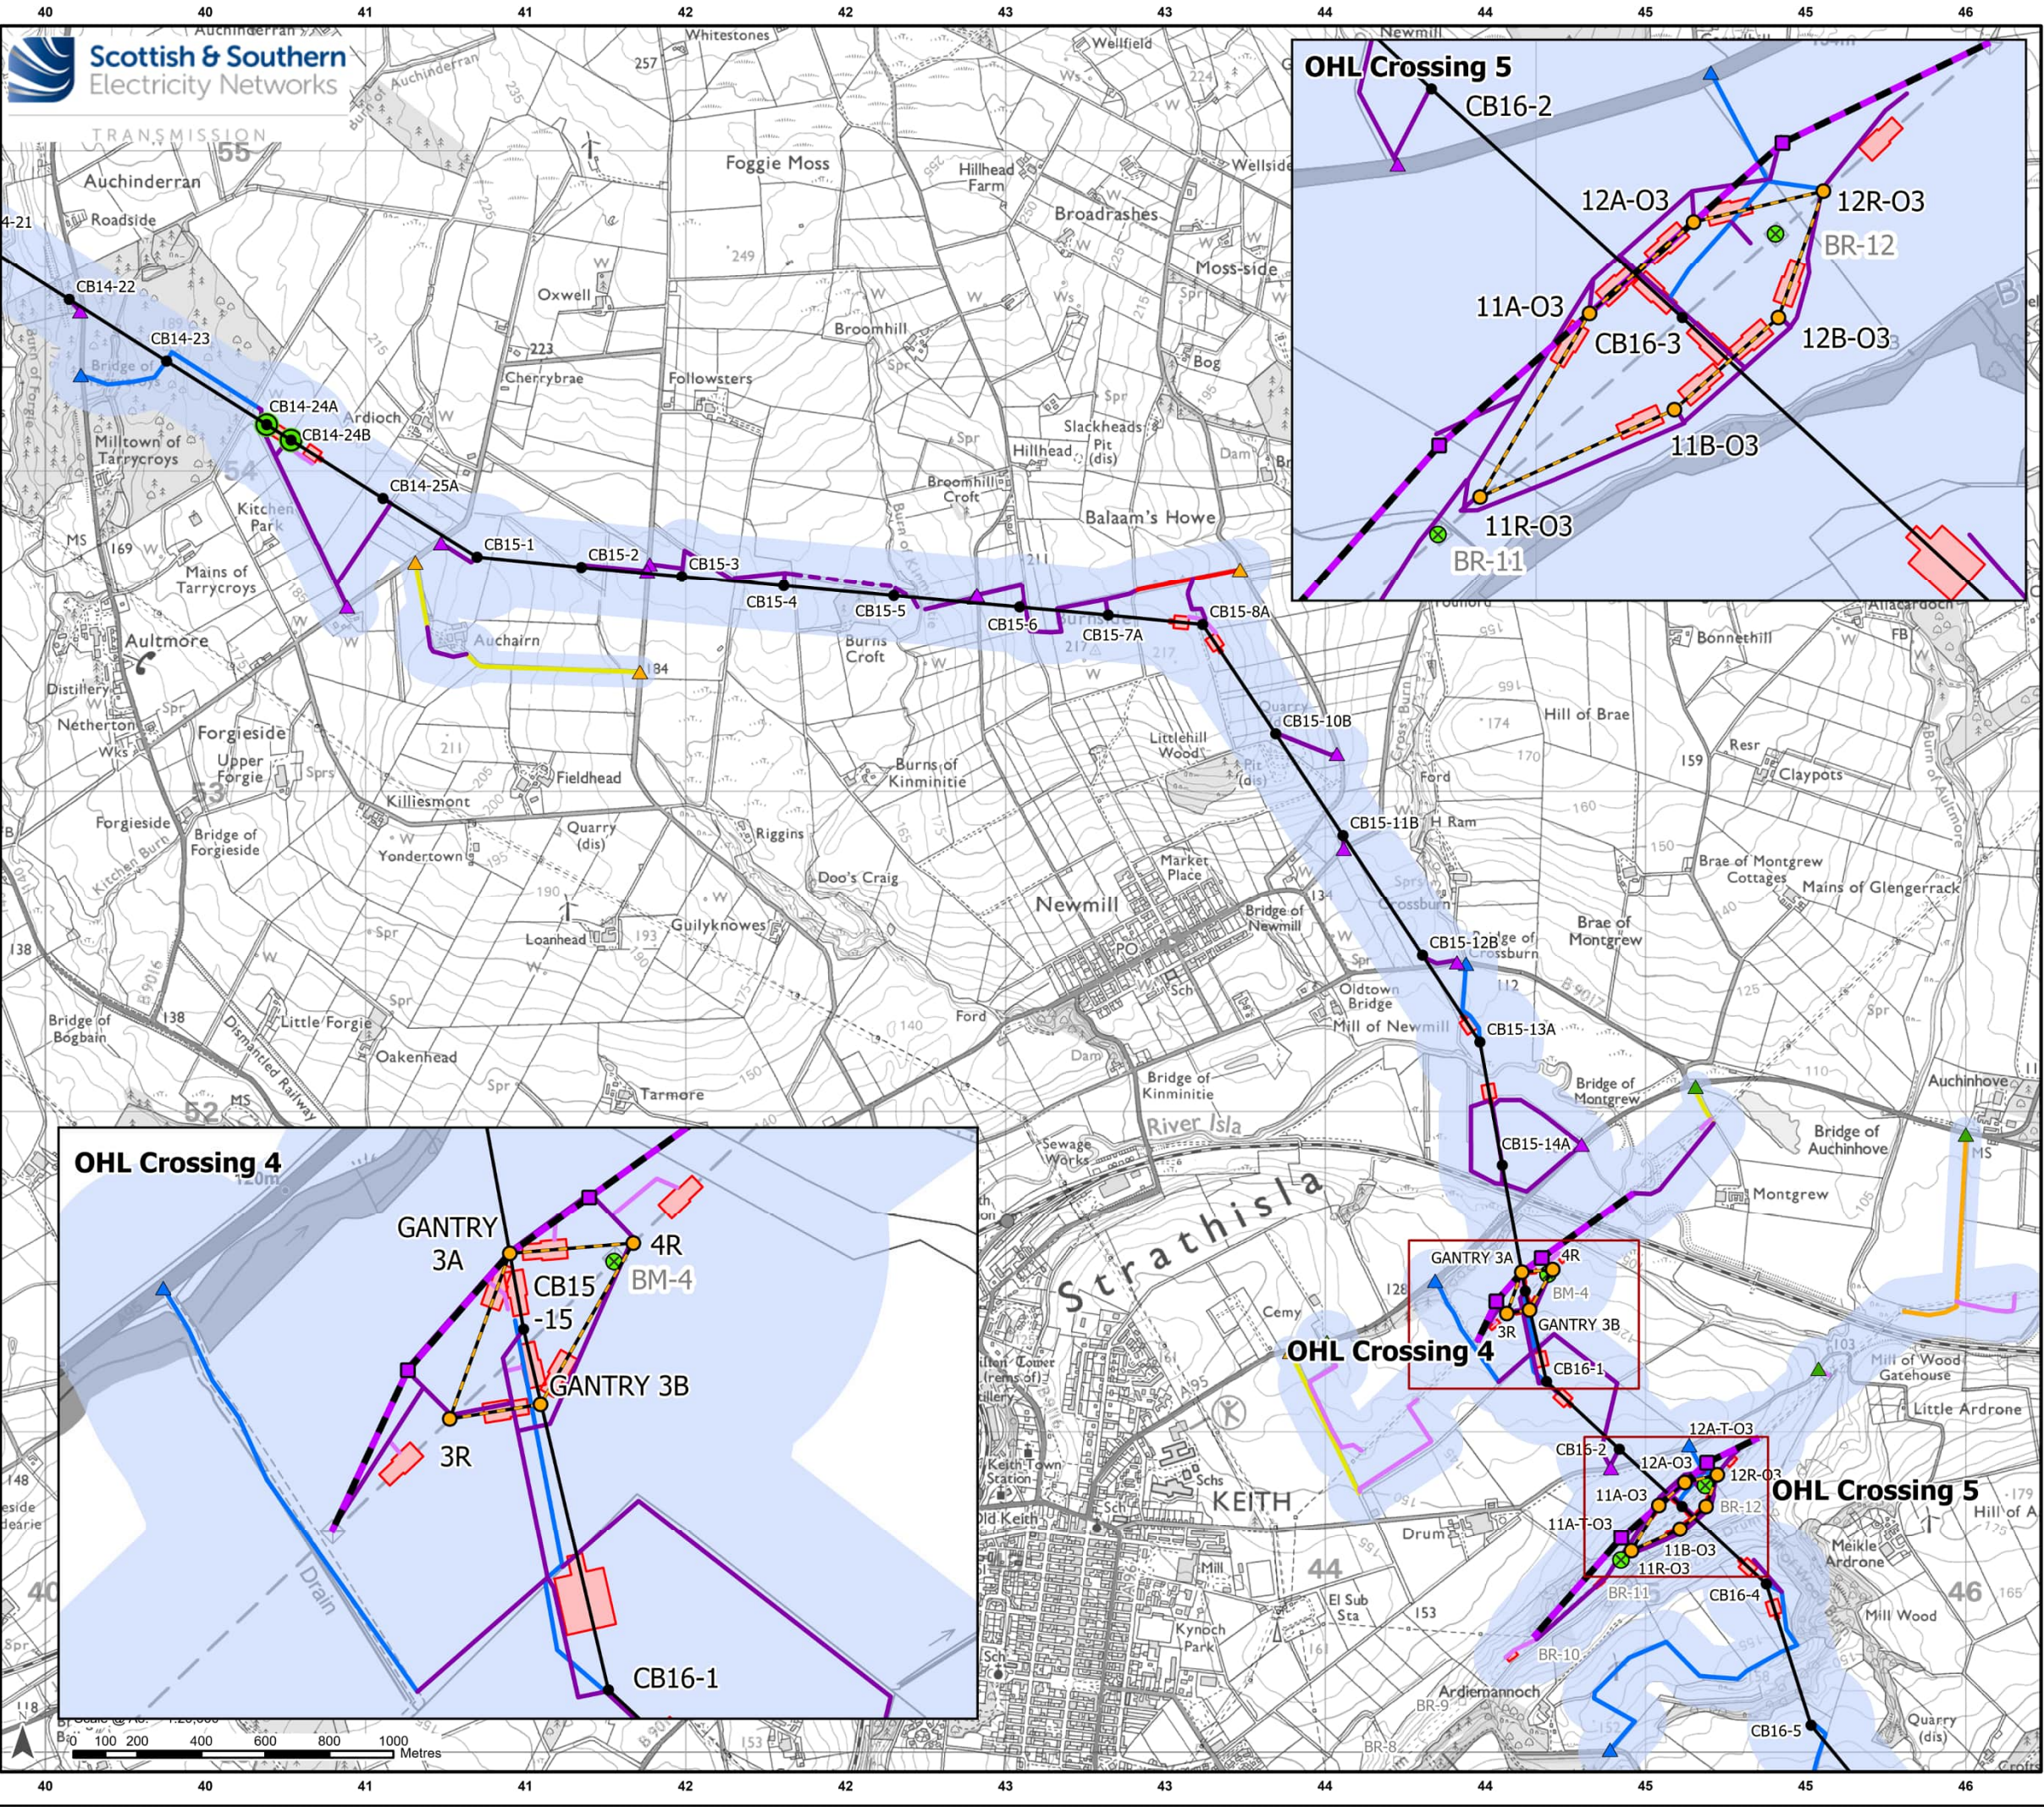

- Legend**
- Existing Tower
 - Existing OHL
 - Development for which Section 37 Consent is Sought**
 - Proposed OHL Alignment - 400 kV
 - Temporary OHL Diversion
 - Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
 - Proposed Tower - 400 kV (with tower number)
 - Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
 - Proposed Tower - Temporary
 - Transposition Towers
 - Limit of Deviation - Proposed Development
 - Ancillary Development**
 - Tower to be Removed
 - Proposed Conductor Pulling Area (EPZ)
 - Existing Access – Upgrade – Good / Fair Condition
 - Existing Access – Upgrade – Poor Condition
 - Existing Access – Upgrade – Very Poor Condition
 - Proposed Access – ATV or Temporary Trackway
 - Proposed Access – Permanent
 - Proposed Access – Temporary
 - Proposed Access – Temporary Floated
 - Proposed Bellmouth - Access Only / ATV
 - Proposed Bellmouth - Permanent
 - Proposed Bellmouth - Temporary
 - Proposed Bellmouth - Upgrade

