


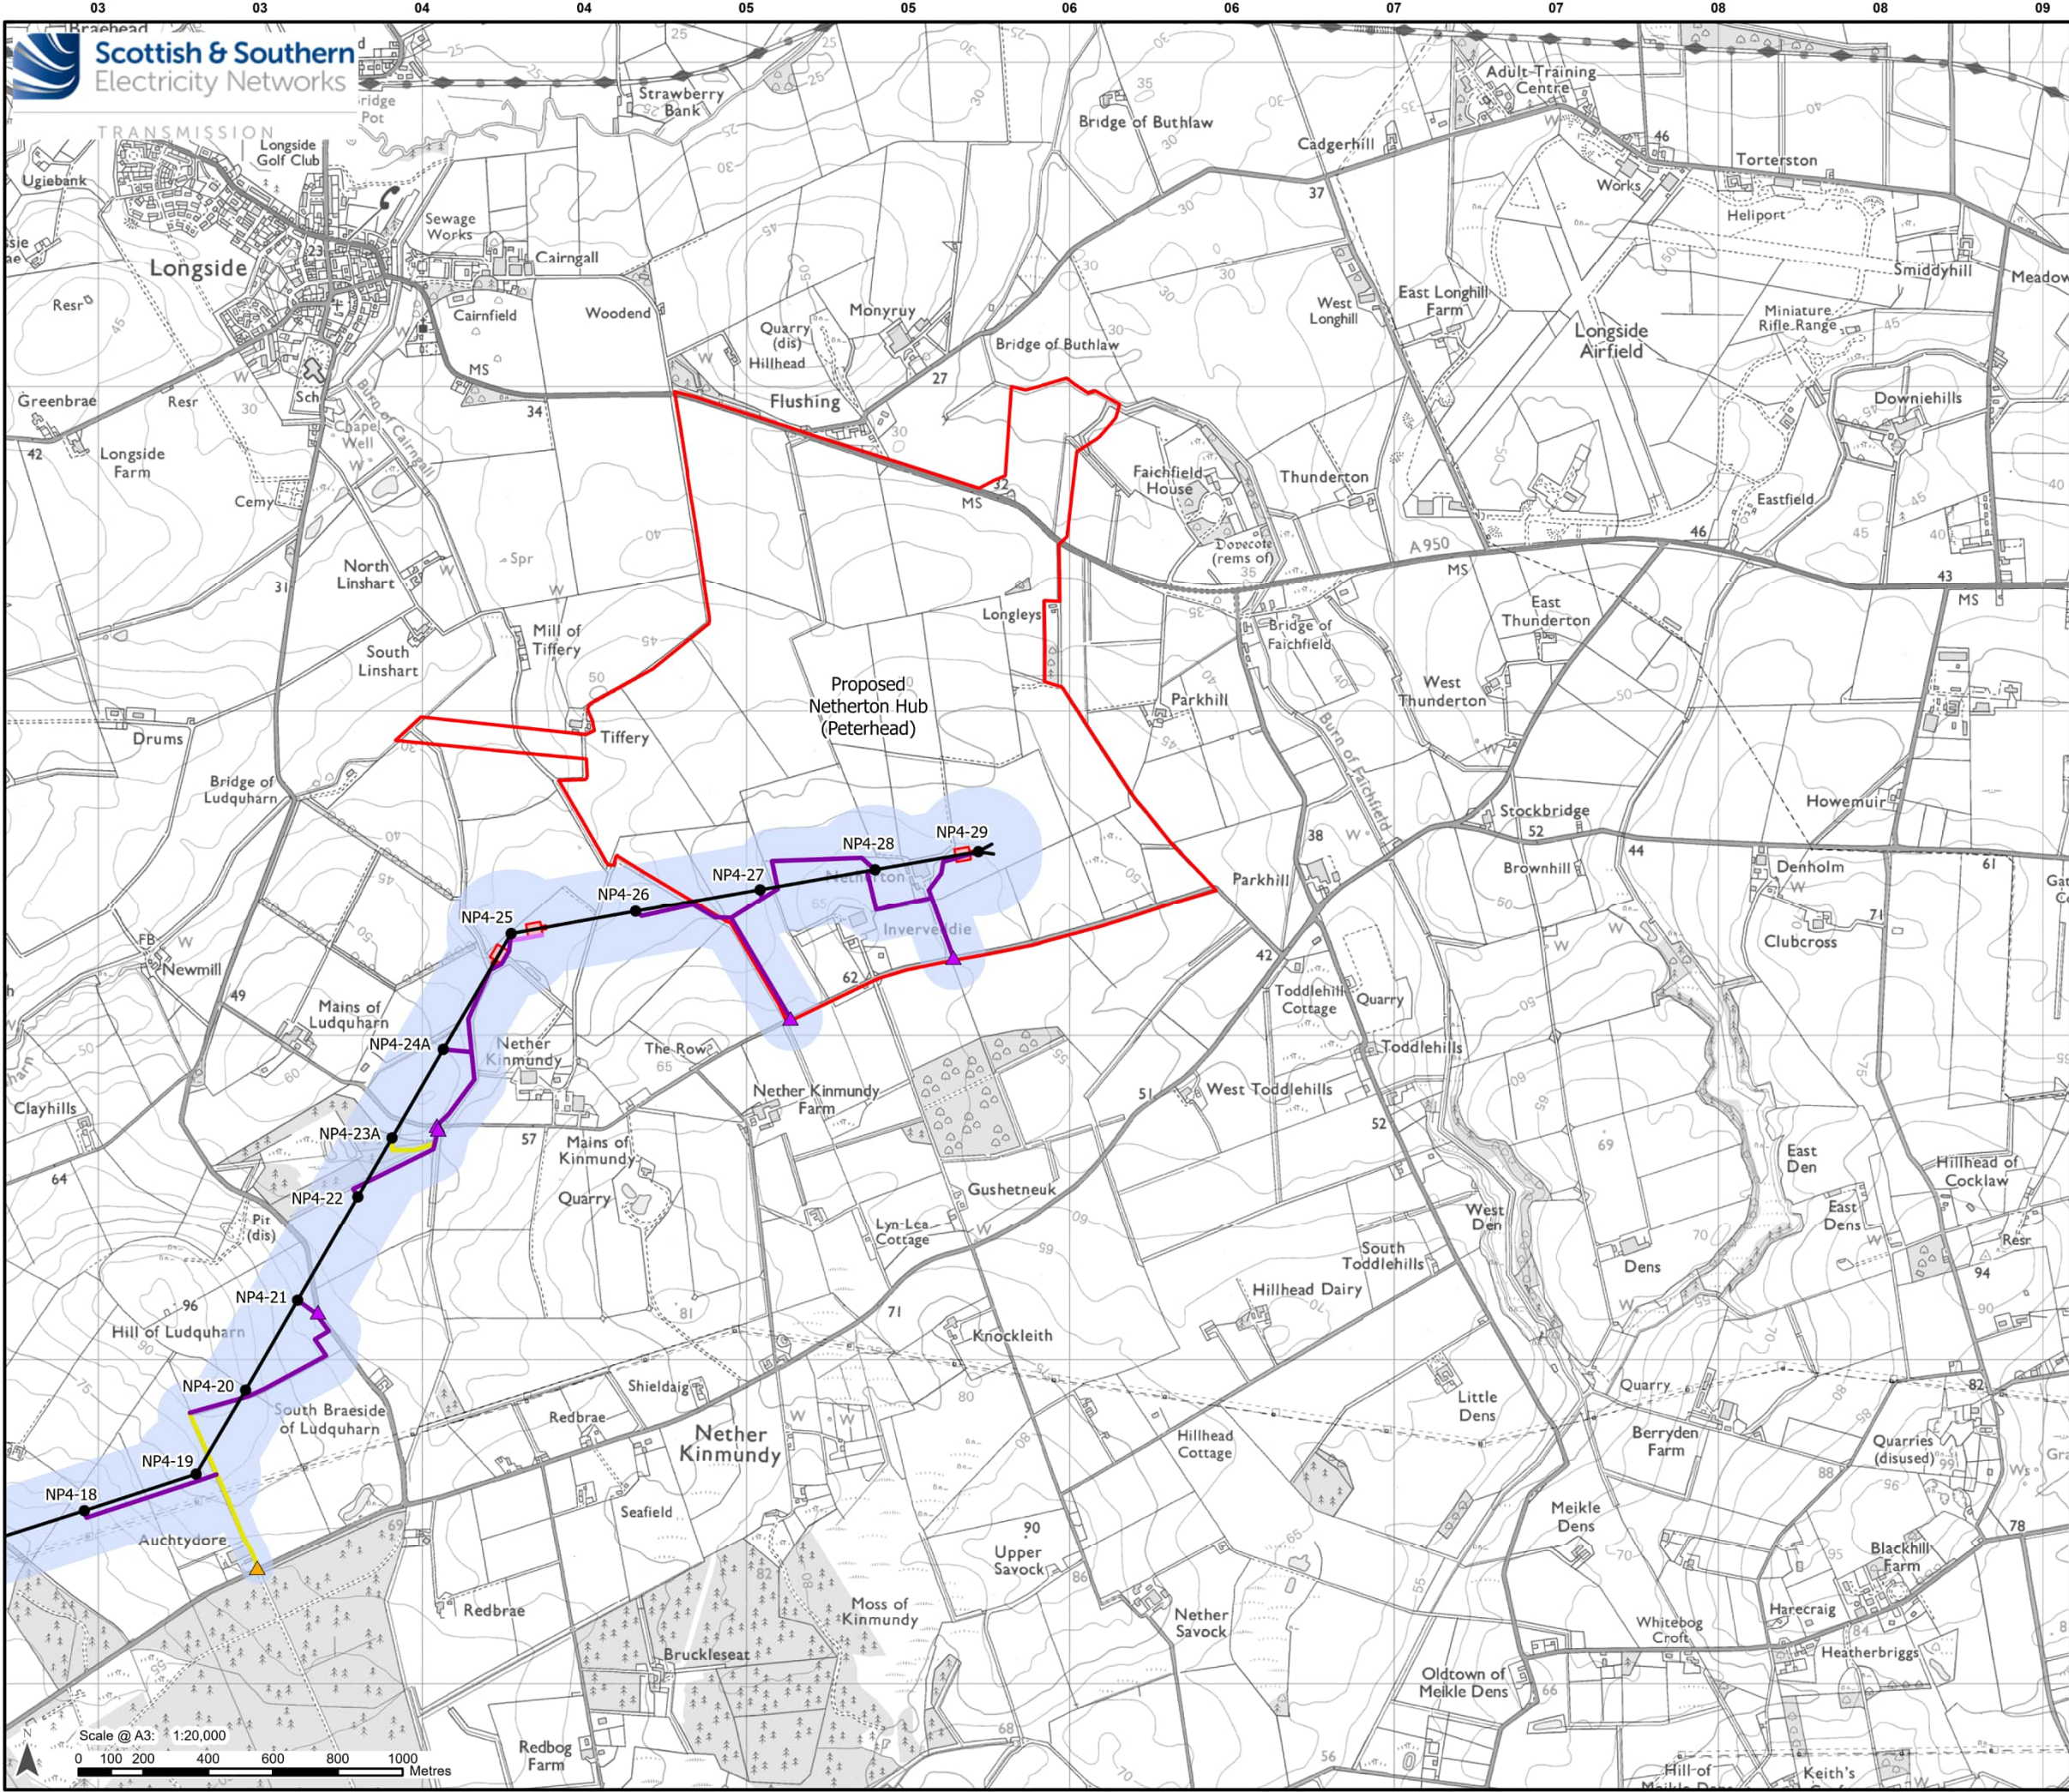

Legend

- Proposed Substation Site Planning Red Line Boundary
- Existing Tower
- Existing OHL

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation - Proposed Development

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Scale: 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 2 - Site Layout
Page 29 of 29

Drawn by: MAL Date: 25/09/2025

Drawing: B2P-WSP-DA-70092380-187