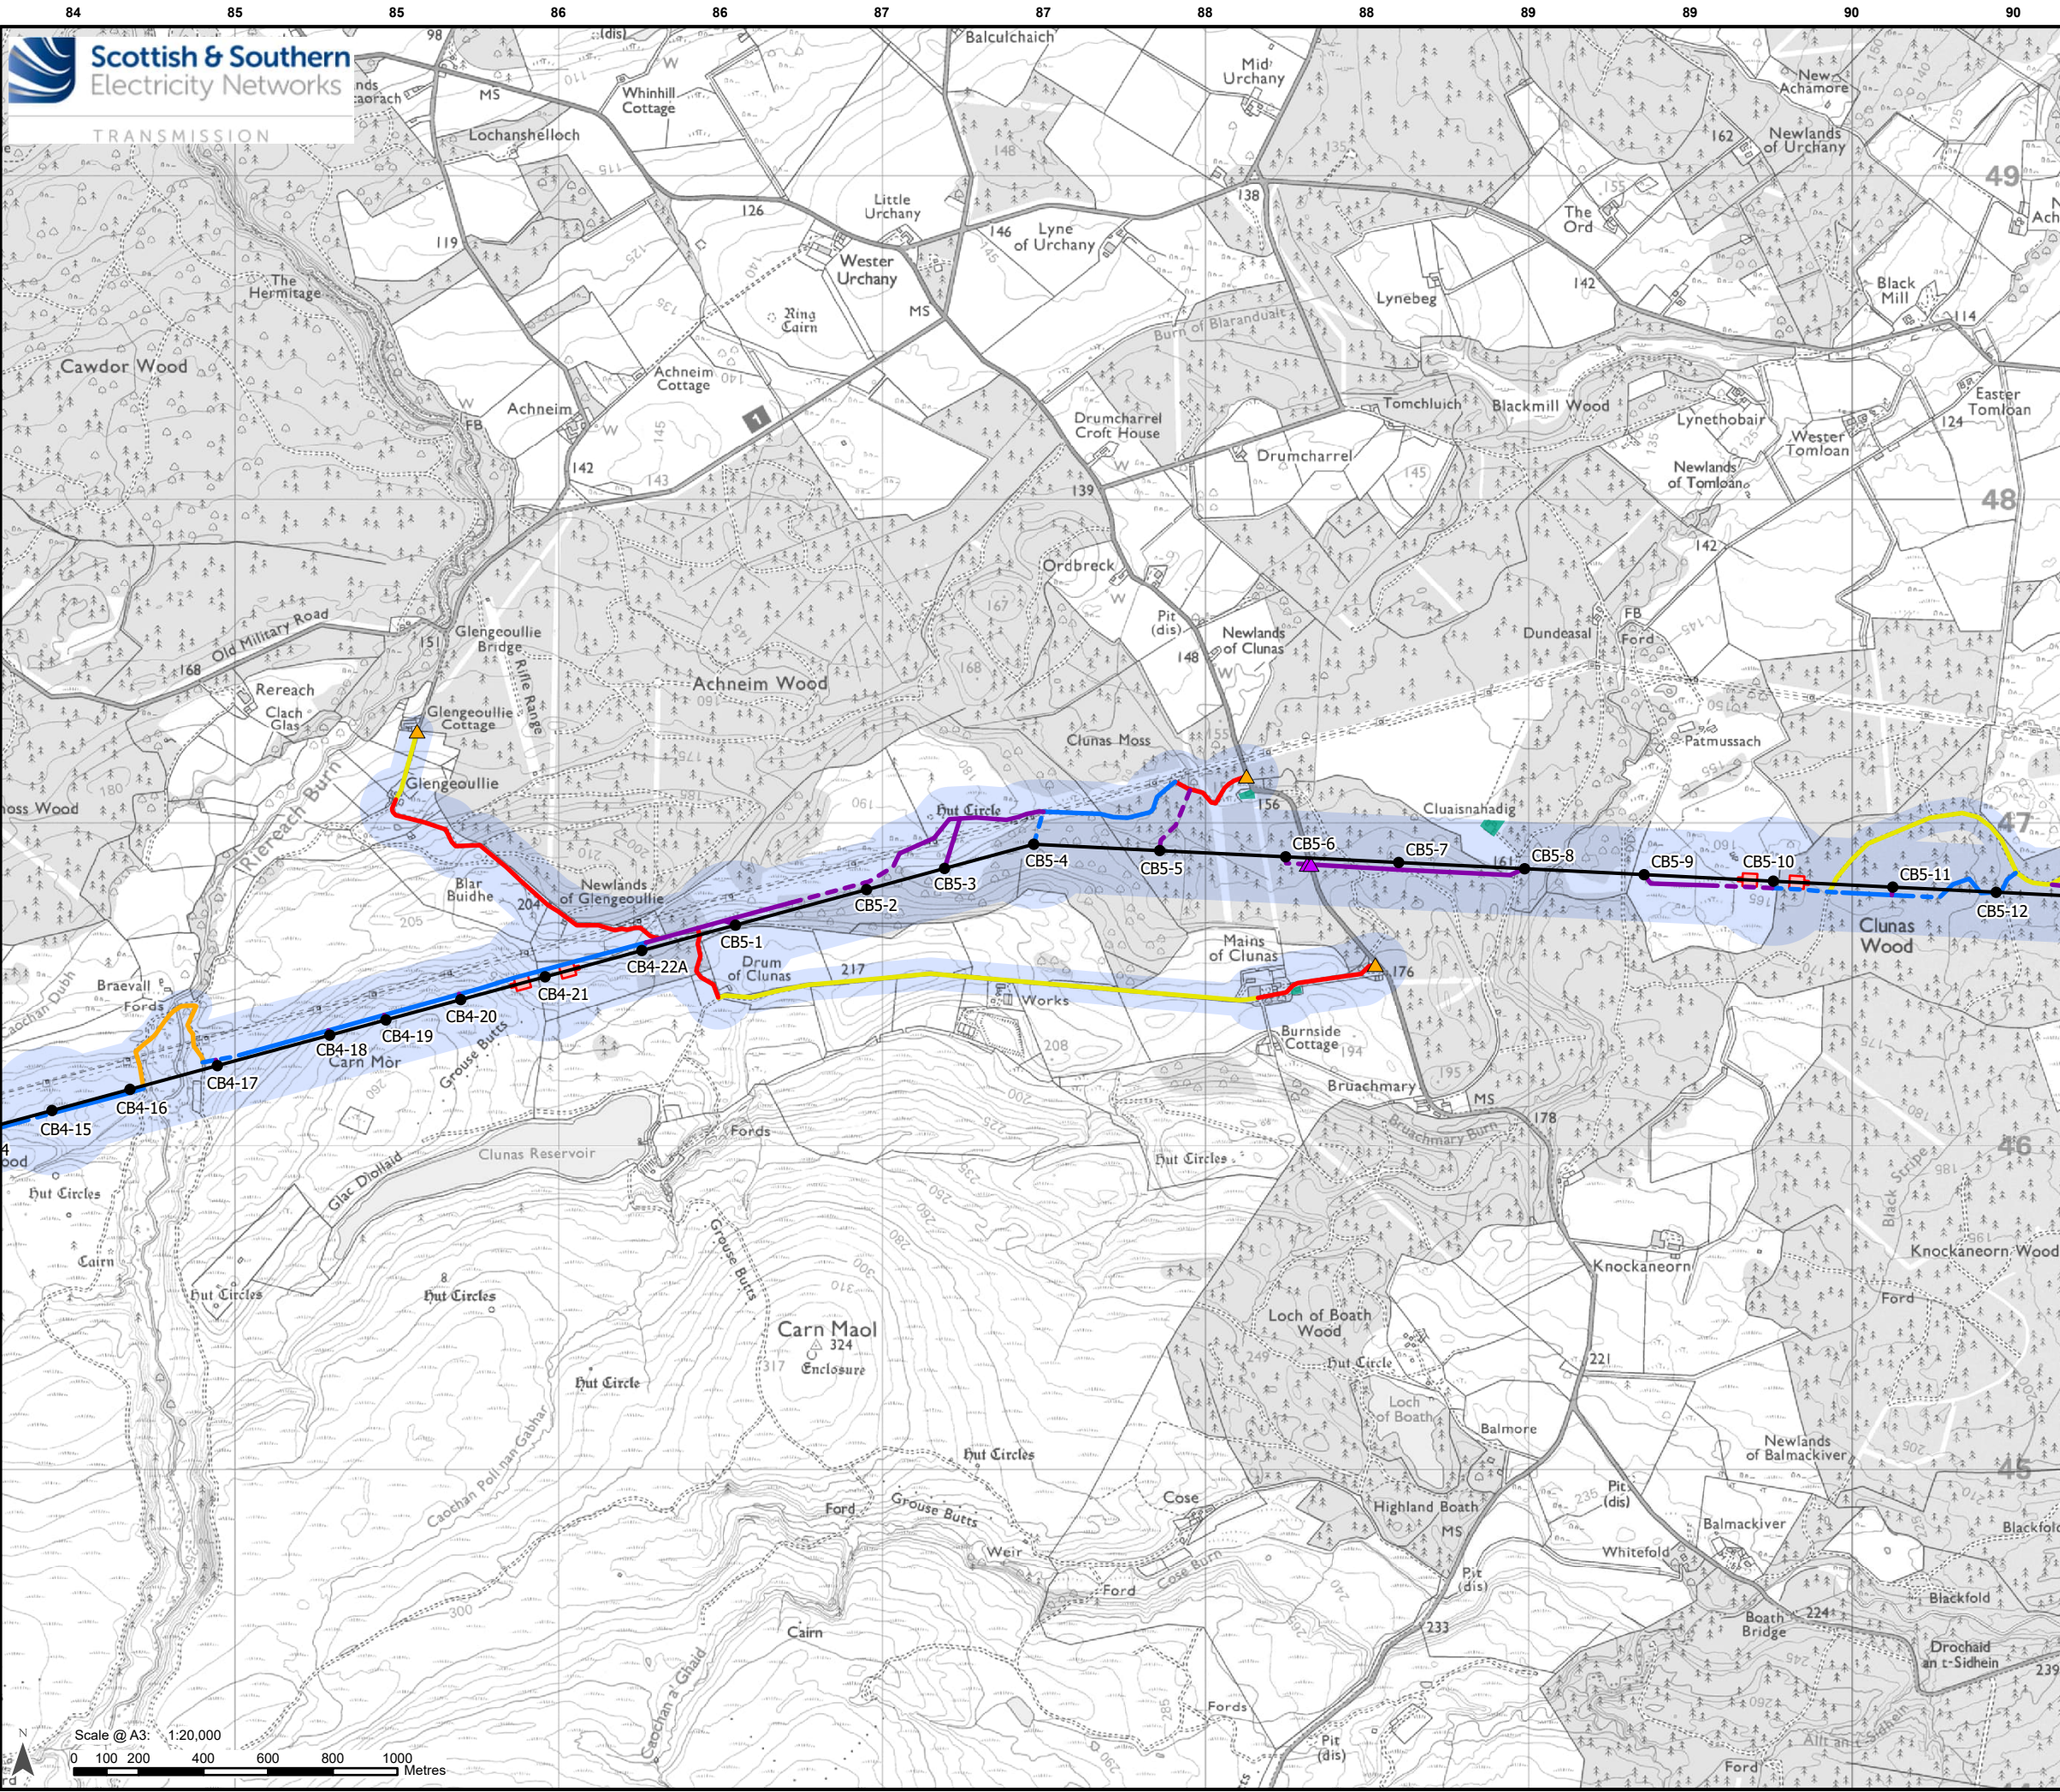


Legend

- Existing Tower
- Existing OHL
- Limit of Deviation - Proposed Development
- Landholdings Excluded from Limit of Deviation

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 3.10 - Landholdings Excluded from Limit of Deviation
Page 8 of 29

Drawn by: MAL Date: 12/09/2025

Drawing: B2P-WSP-DA-70092380-192

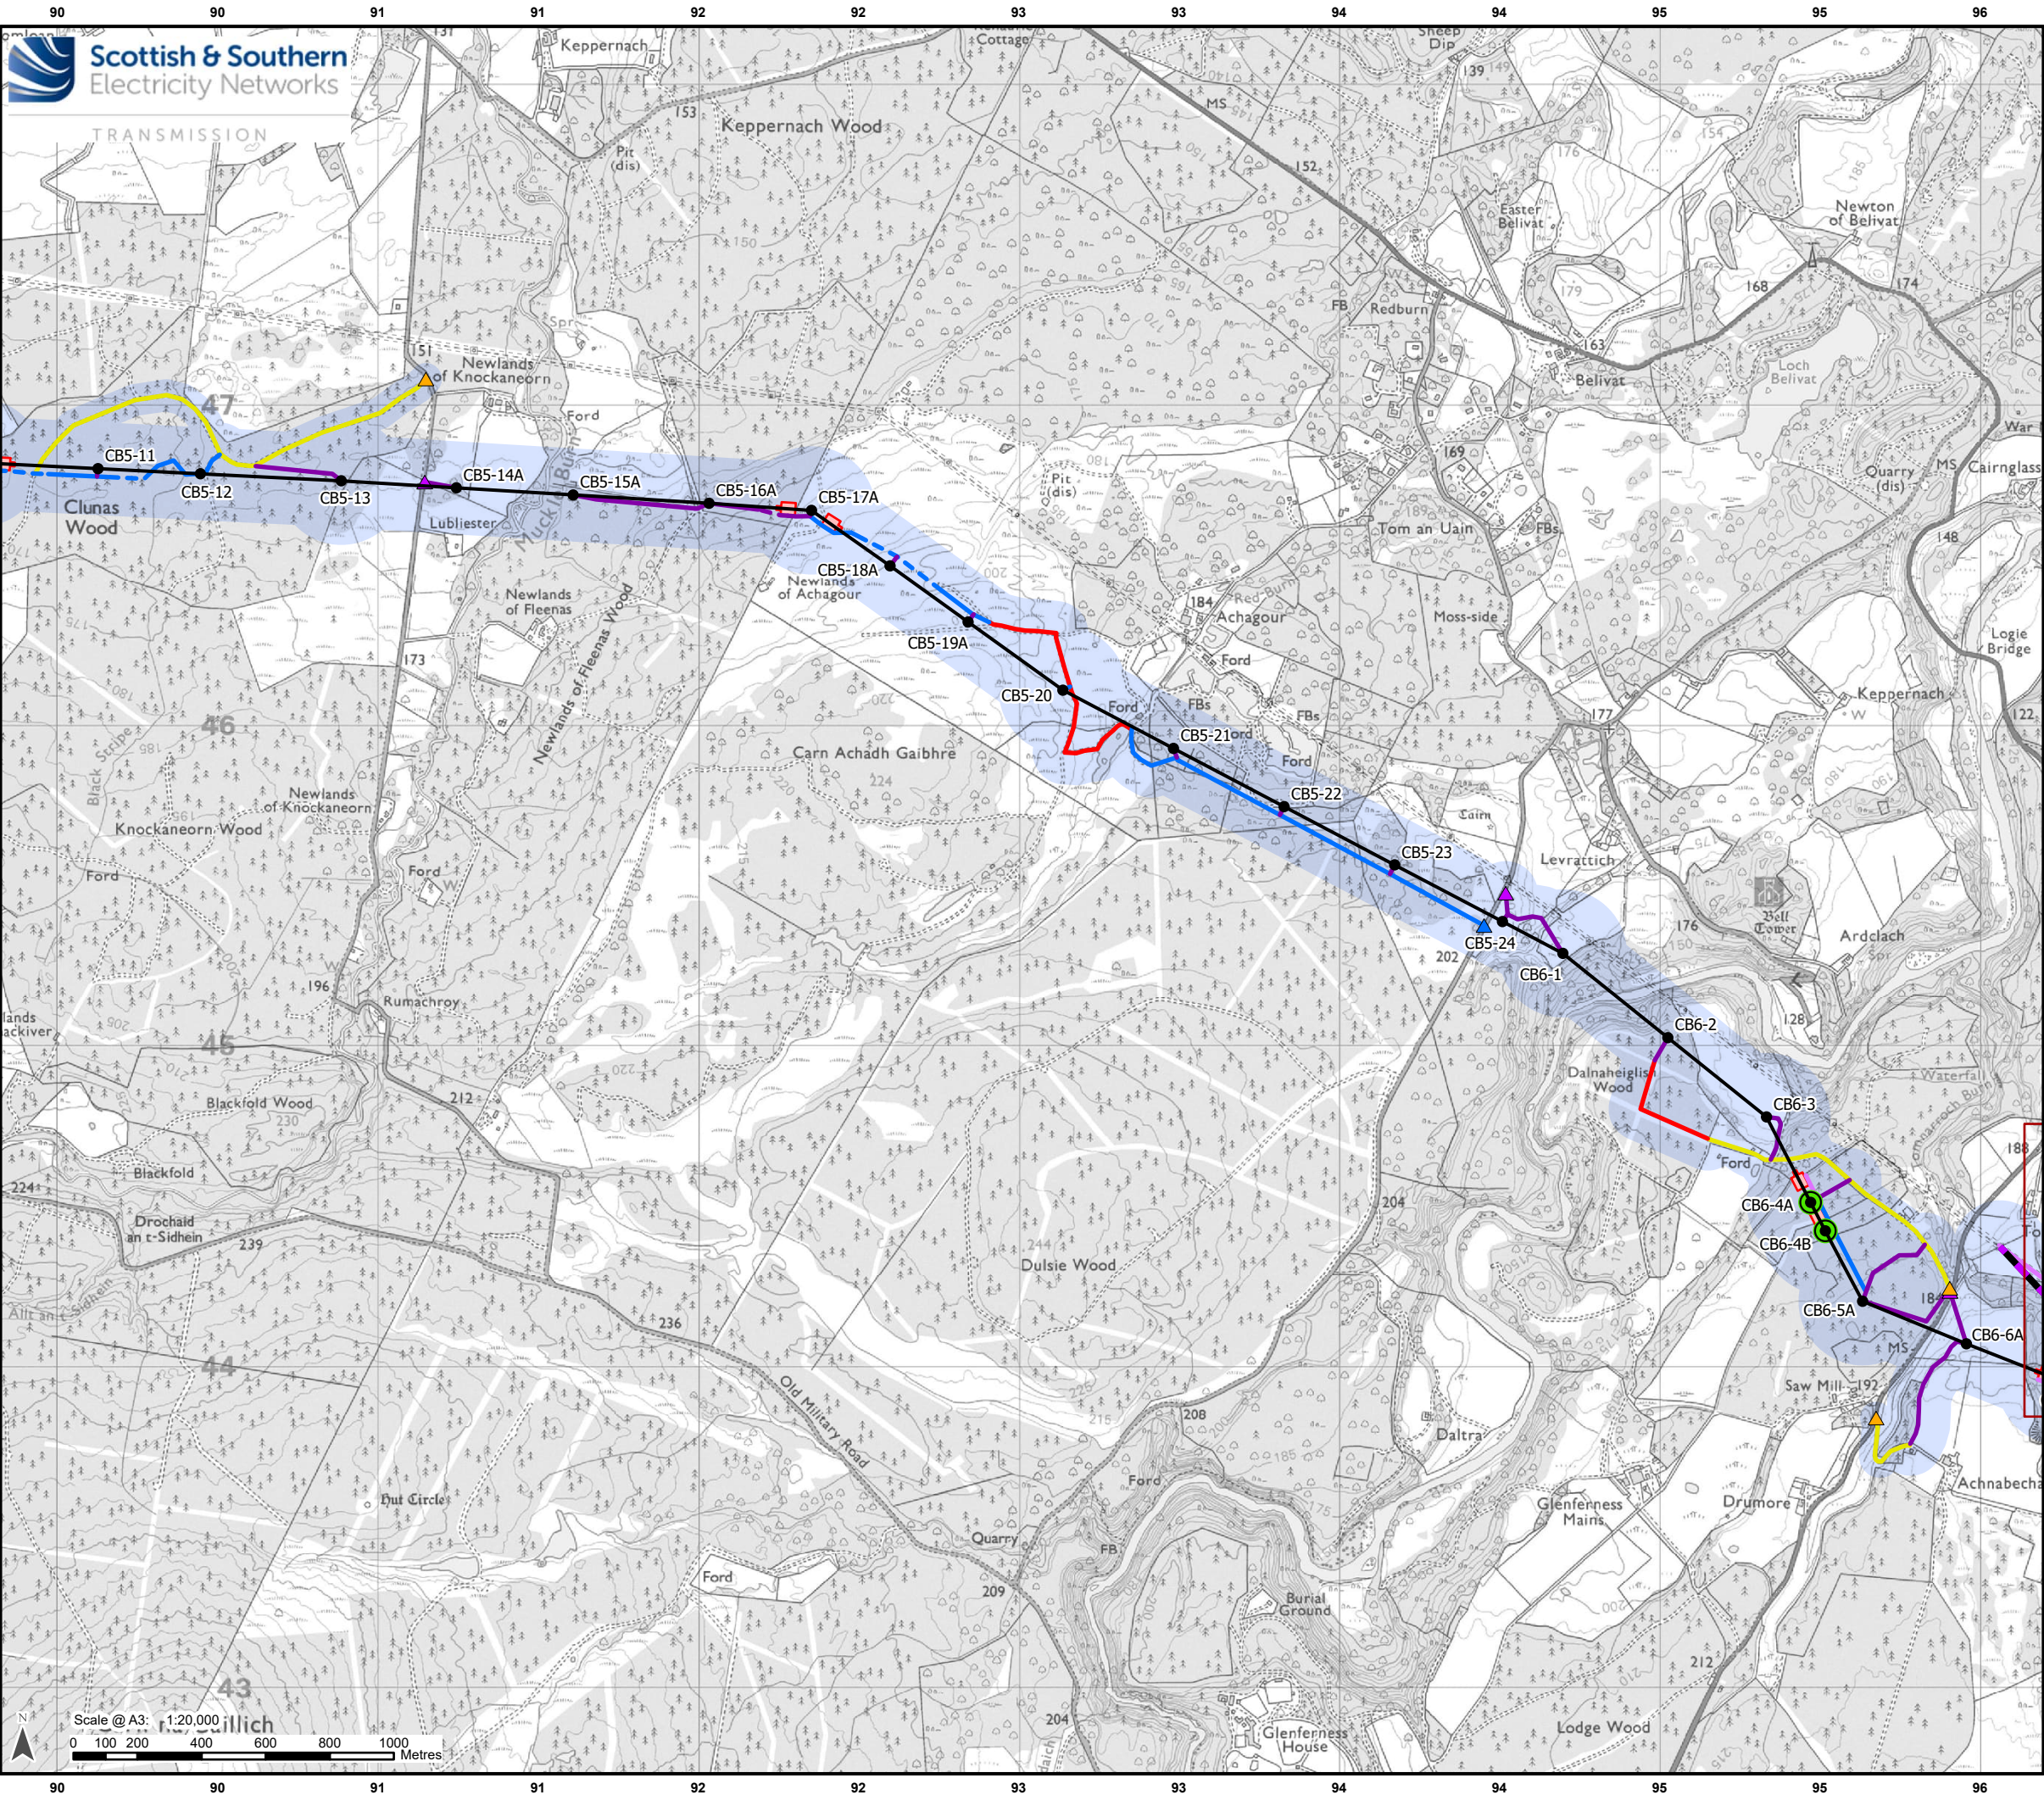

Legend

Existing Tower

Existing OHL

Limit of Deviation - Proposed Development

Landholdings Excluded from Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Temporary OHL Diversion

Proposed Tower - 400 kV (with tower number)

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Very Poor Condition

Proposed Access – ATV or Temporary Trackway

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

Proposed Bellmouth - Permanent

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 3.10 - Landholdings Excluded from Limit of Deviation
Page 9 of 29

Drawn by: MAL

Date: 12/09/2025

Drawing: B2P-WSP-DA-70092380-192

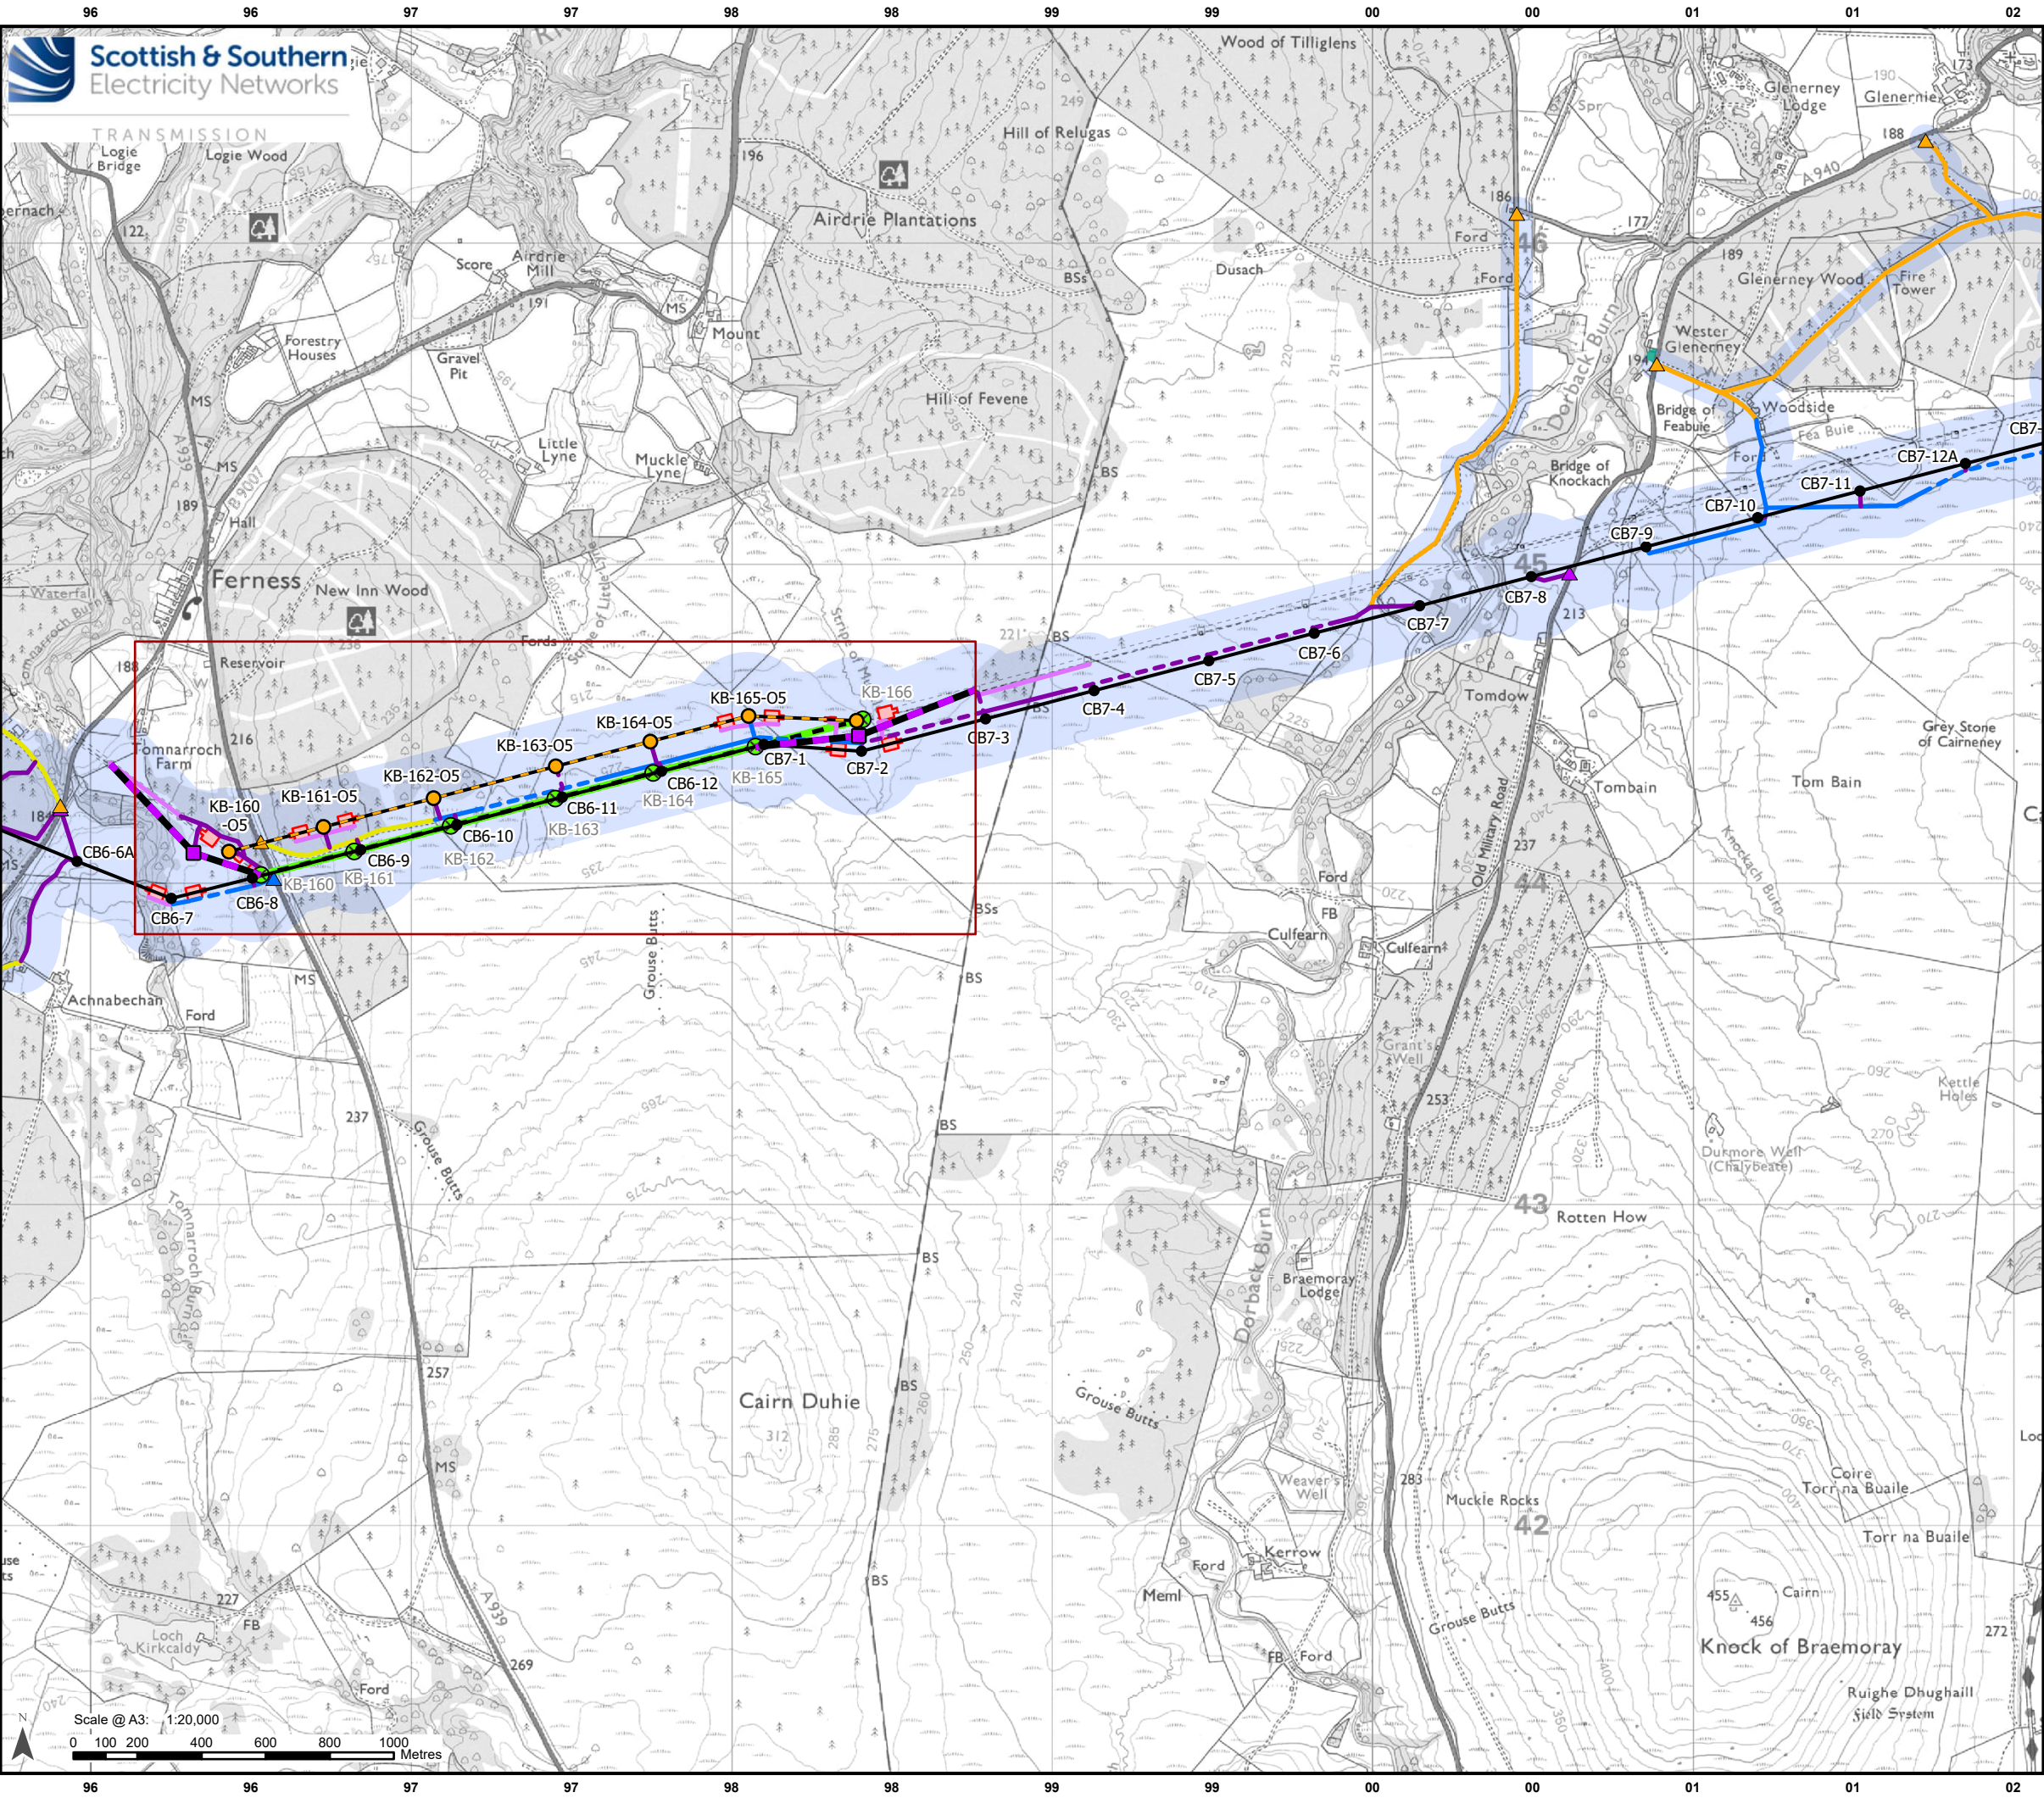

- Legend**
- Existing Tower

Existing OHL

Limit of Deviation - Proposed Development

Landholdings Excluded from Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Temporary OHL Diversion

Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Proposed Tower - 400 kV (with tower number)

Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)

Proposed Tower - Temporary

Ancillary Development

Tower to be Removed

OHL to be Removed

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Proposed Access – ATV or Temporary Trackway

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

Proposed Bellmouth - Permanent

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 3.10 - Landholdings Excluded from Limit of Deviation
Page 10 of 29

Drawn by: MAL Date: 12/09/2025

Drawing: B2P-WSP-DA-70092380-192

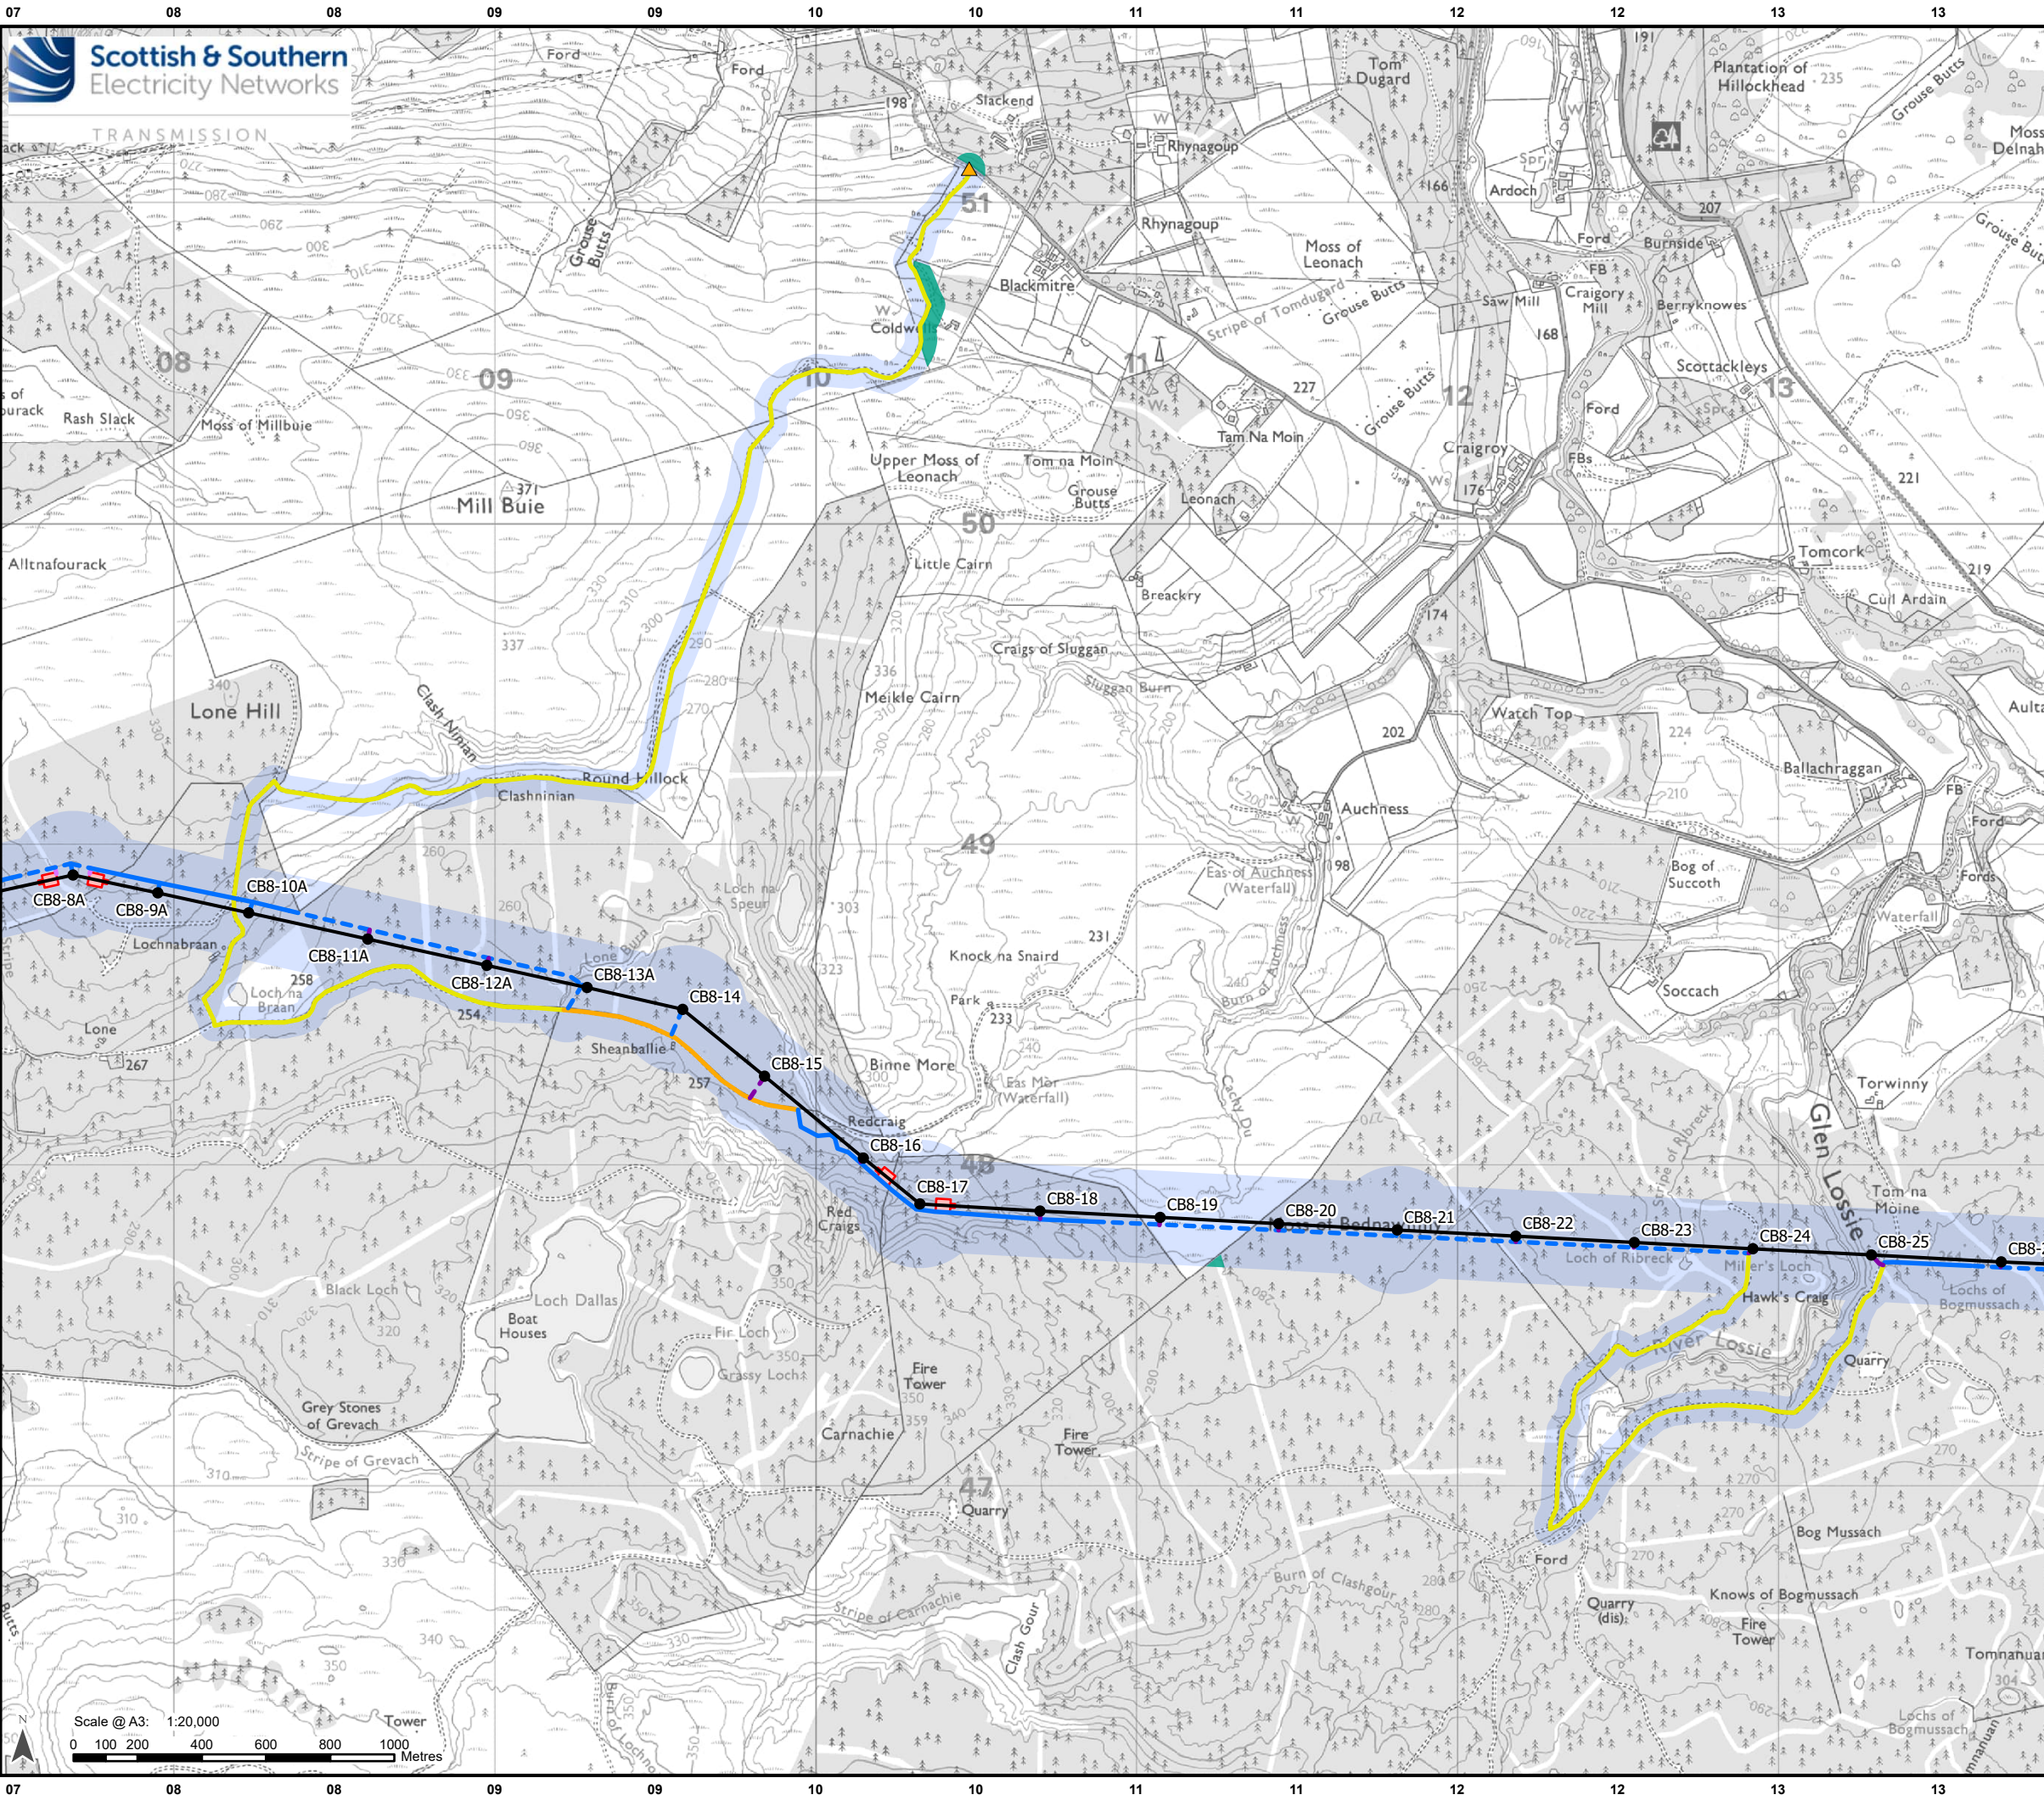

Legend

Existing Tower

Existing OHL

Limit of Deviation - Proposed Development

Landholdings Excluded from Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV (with tower number)

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Proposed Access – ATV or Temporary Trackway

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

Proposed Bellmouth - Upgrade

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 3.10 - Landholdings Excluded from Limit of Deviation
Page 12 of 29

Drawn by: MAL

Date: 12/09/2025

Drawing: B2P-WSP-DA-70092380-192

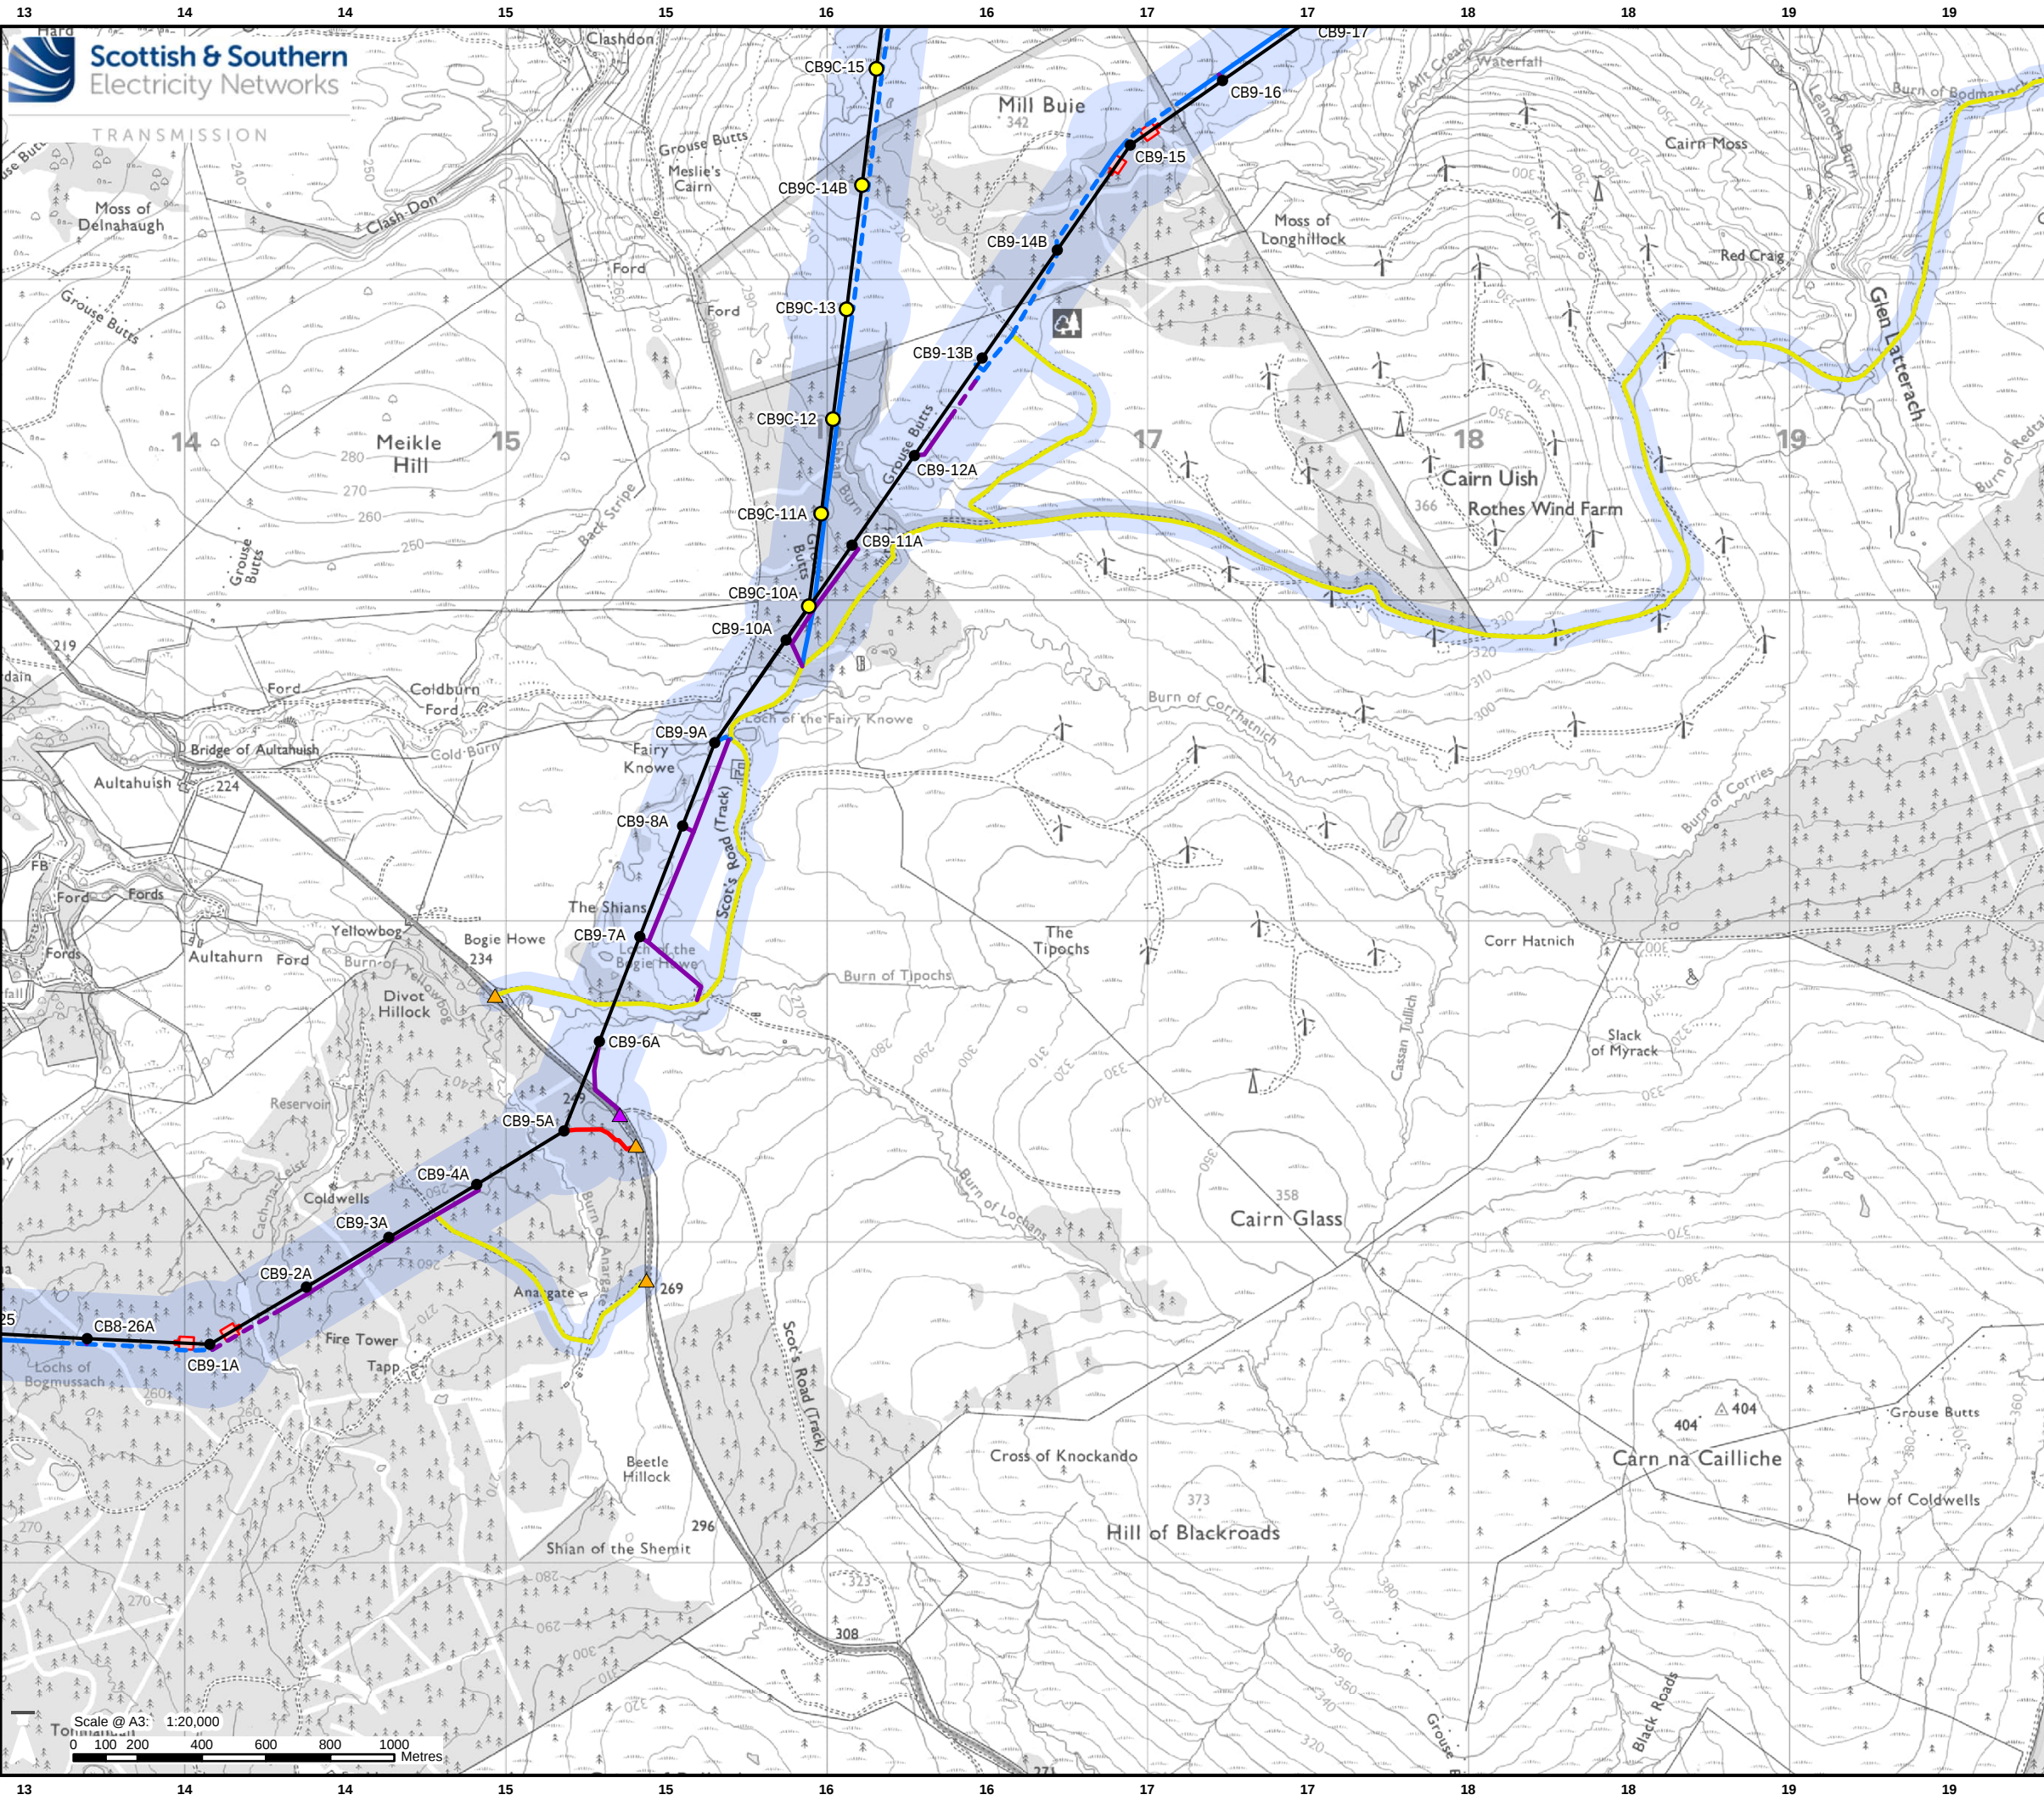

Legend

Limit of Deviation - Proposed Development

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV (with tower number)

Proposed Tower - Kellas Alternative Alignment

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Very Poor Condition

Proposed Access – Permanent


Proposed Access – Permanent Floated

Proposed Access – Temporary


Proposed Access – Temporary Floated

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade

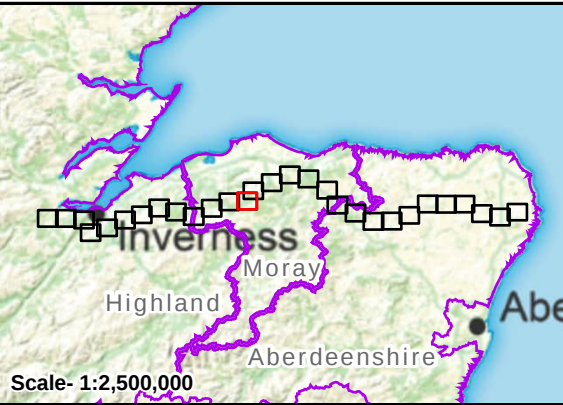

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000613445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 3.10 - Landholdings Excluded from Limit of Deviation Page 13 of 29
Drawn by:	MAL
Date:	01/10/2025
Drawing:	B2P-WSP-DA-70092380-192

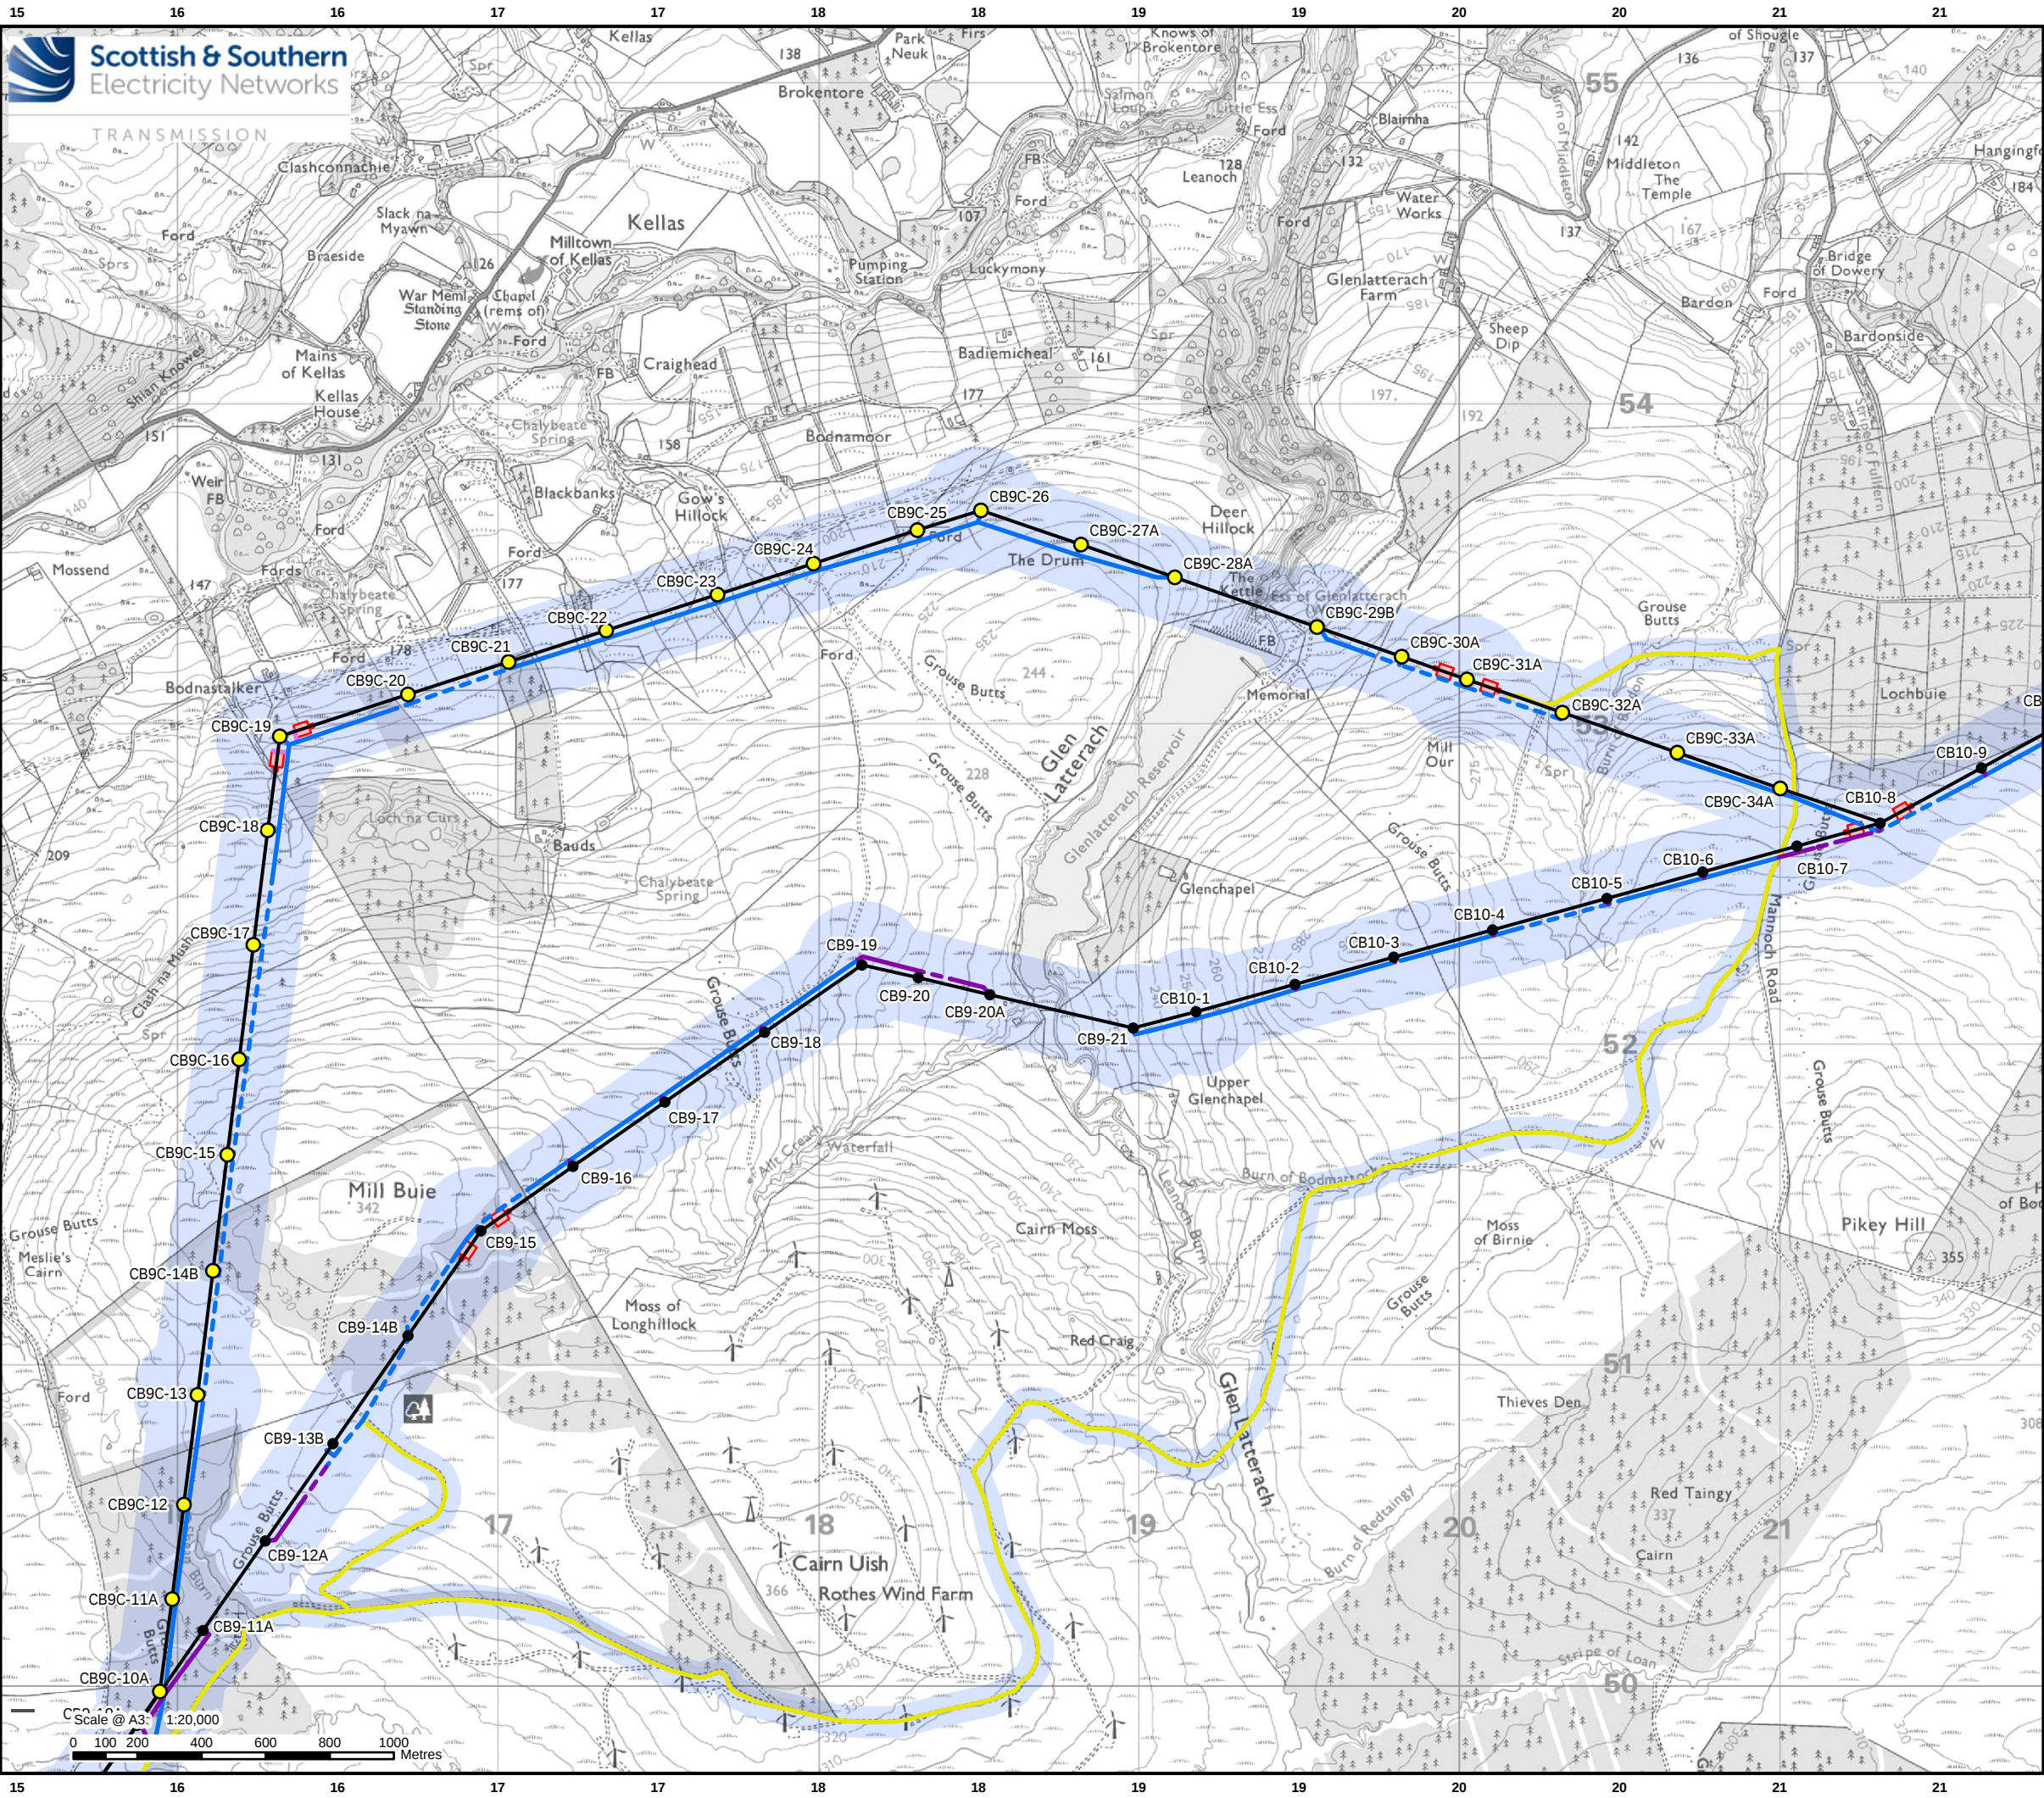

Legend

Existing Tower

Existing OHL

Limit of Deviation - Proposed Development

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV (with tower number)

Proposed Tower - Kellas Alternative Alignment

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Proposed Access – ATV or Temporary Trackway


Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000613445. SSN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 3.10 - Landholdings Excluded from Limit of Deviation Page 14 of 29
Drawn by:	MAL
Date:	01/10/2025
Drawing:	B2P-WSP-DA-70092380-192

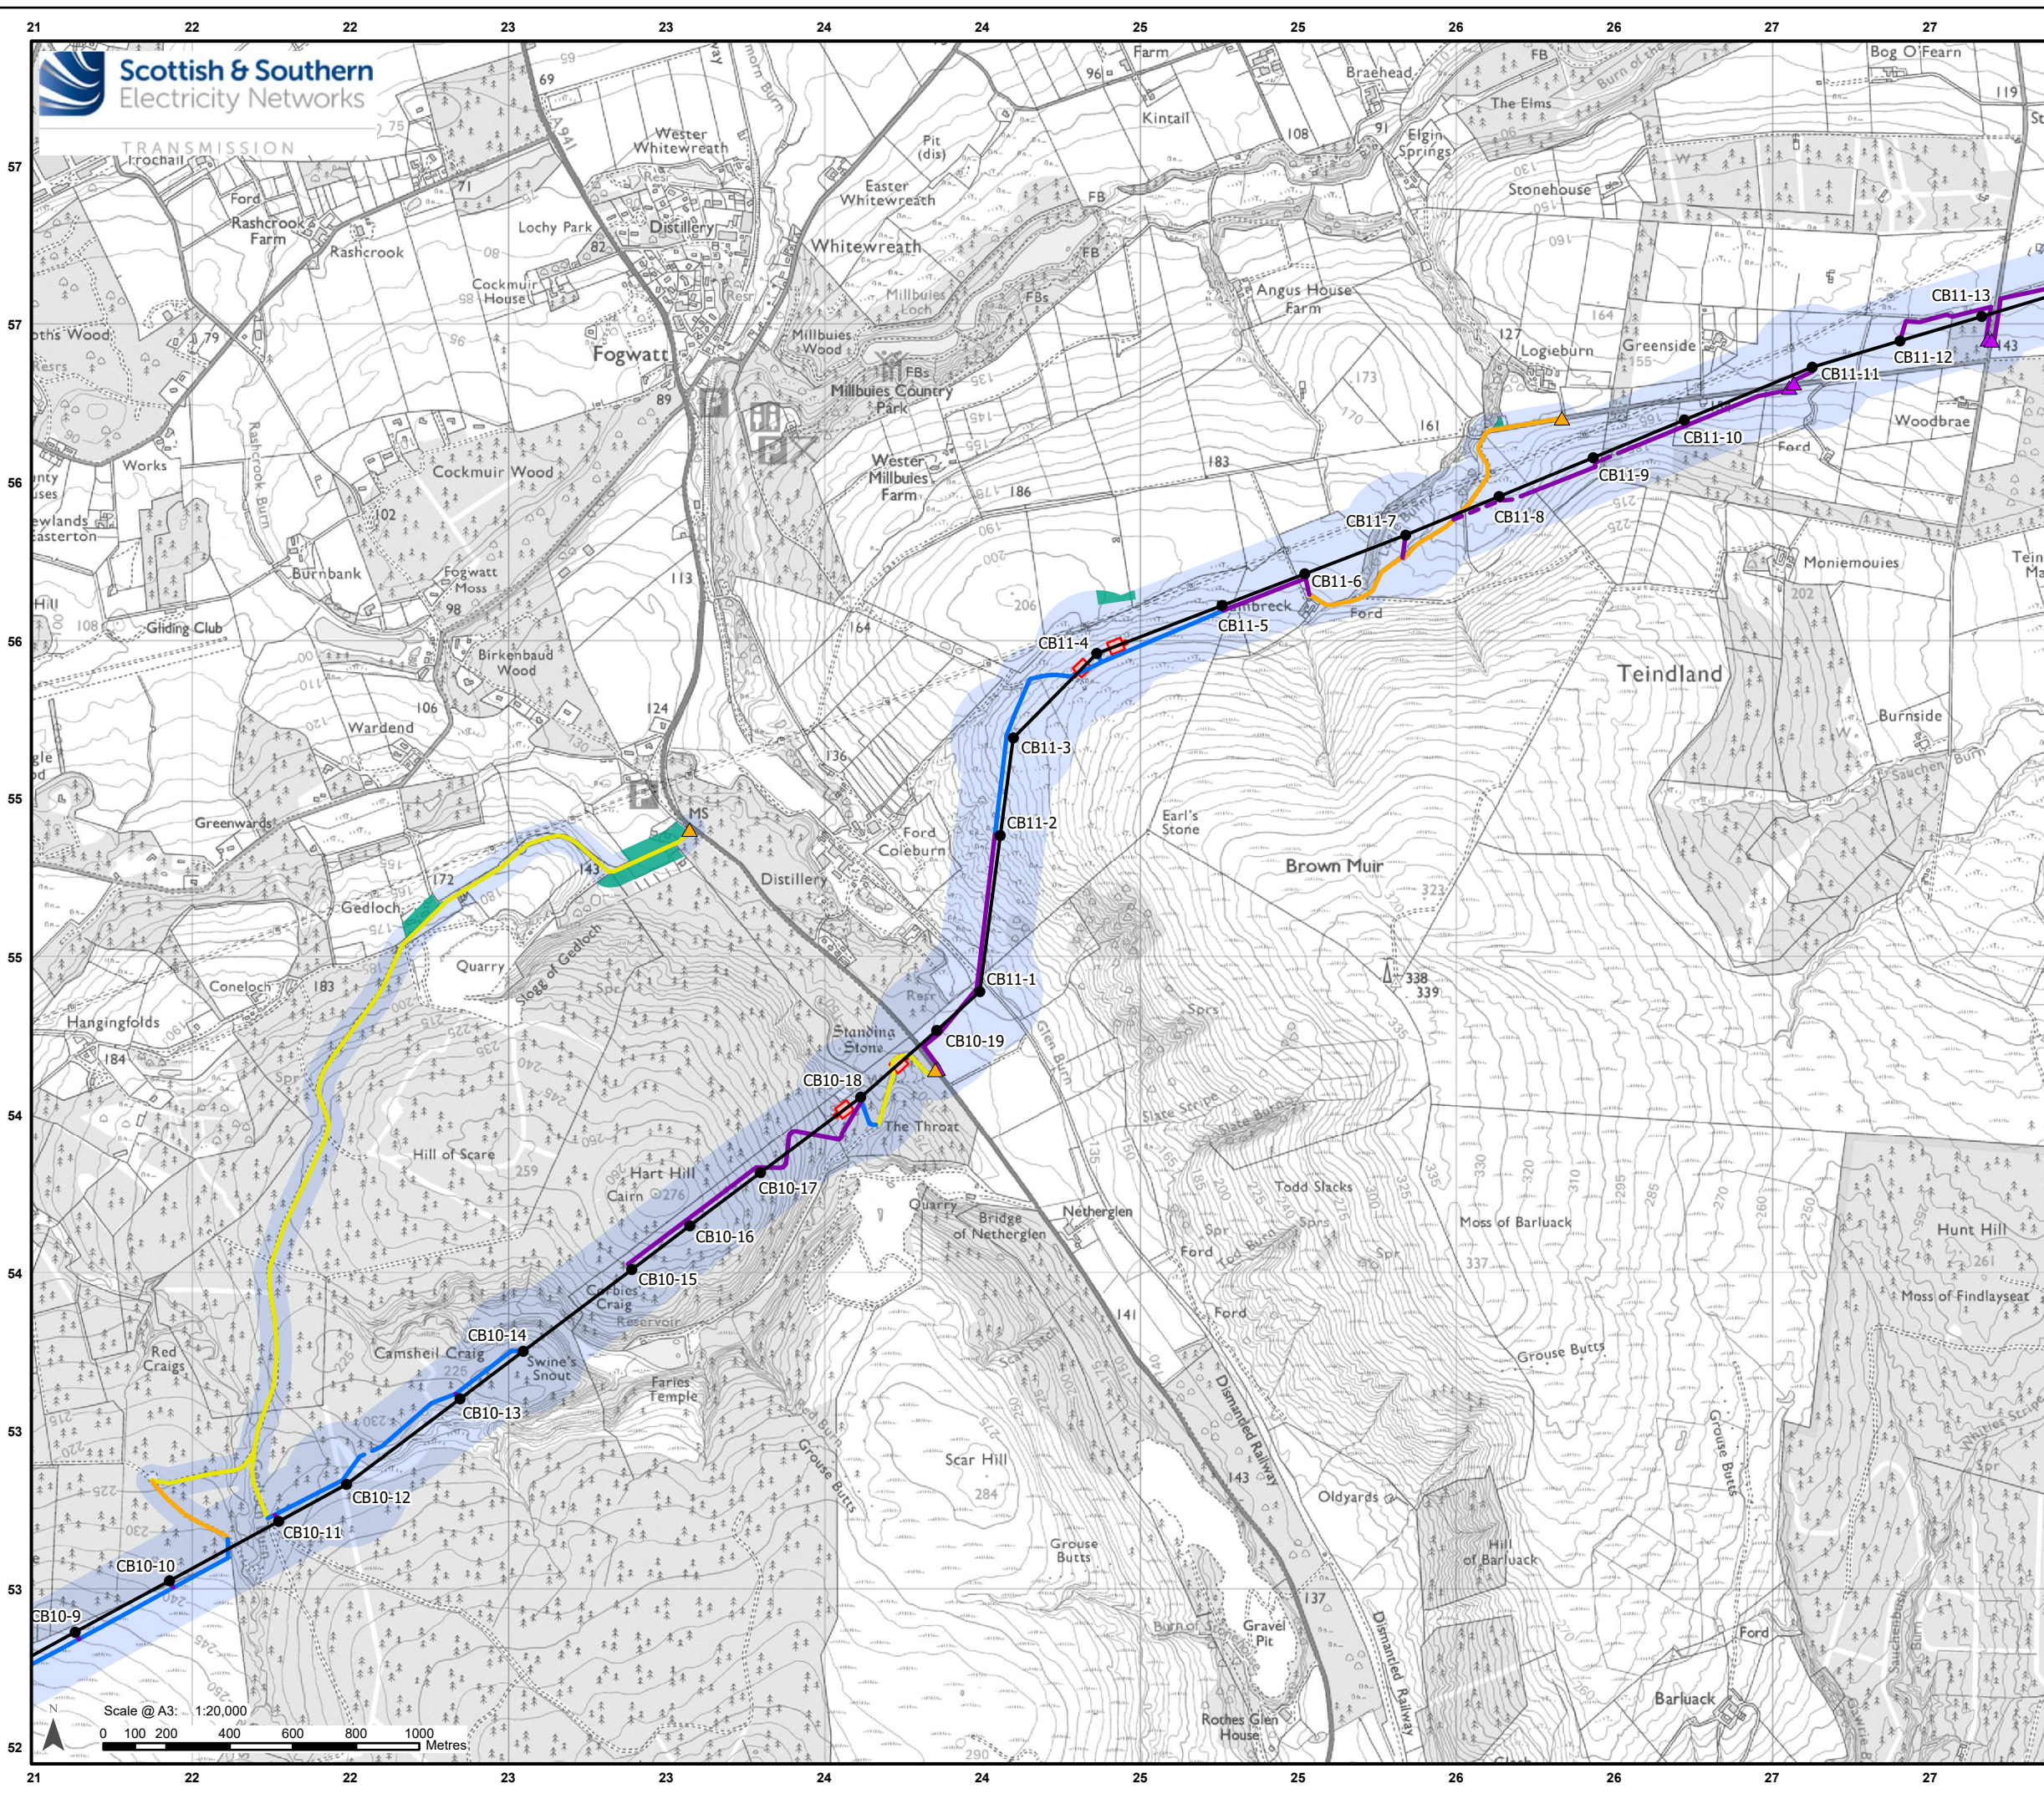

Legend

□

Existing Tower

Existing OHL

Limit of Deviation - Proposed Development

Landholdings Excluded from Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

●

Proposed Tower - 400 kV (with tower number)

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary


Proposed Access – Temporary Floated

▲

Proposed Bellmouth - Temporary

▲

Proposed Bellmouth - Upgrade

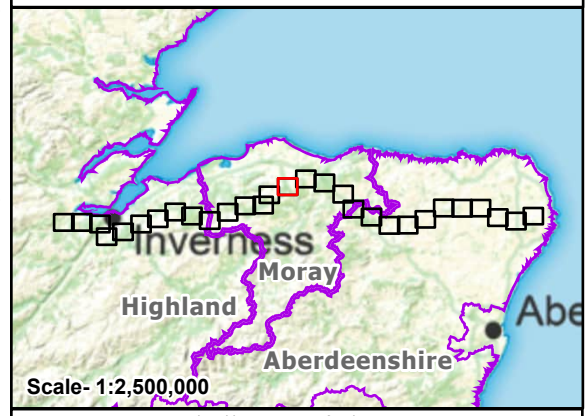

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 3.10 - Landholdings Excluded from Limit of Deviation Page 15 of 29
Drawn by:	MAL
Date:	12/09/2025
Drawing:	B2P-WSP-DA-70092380-192