


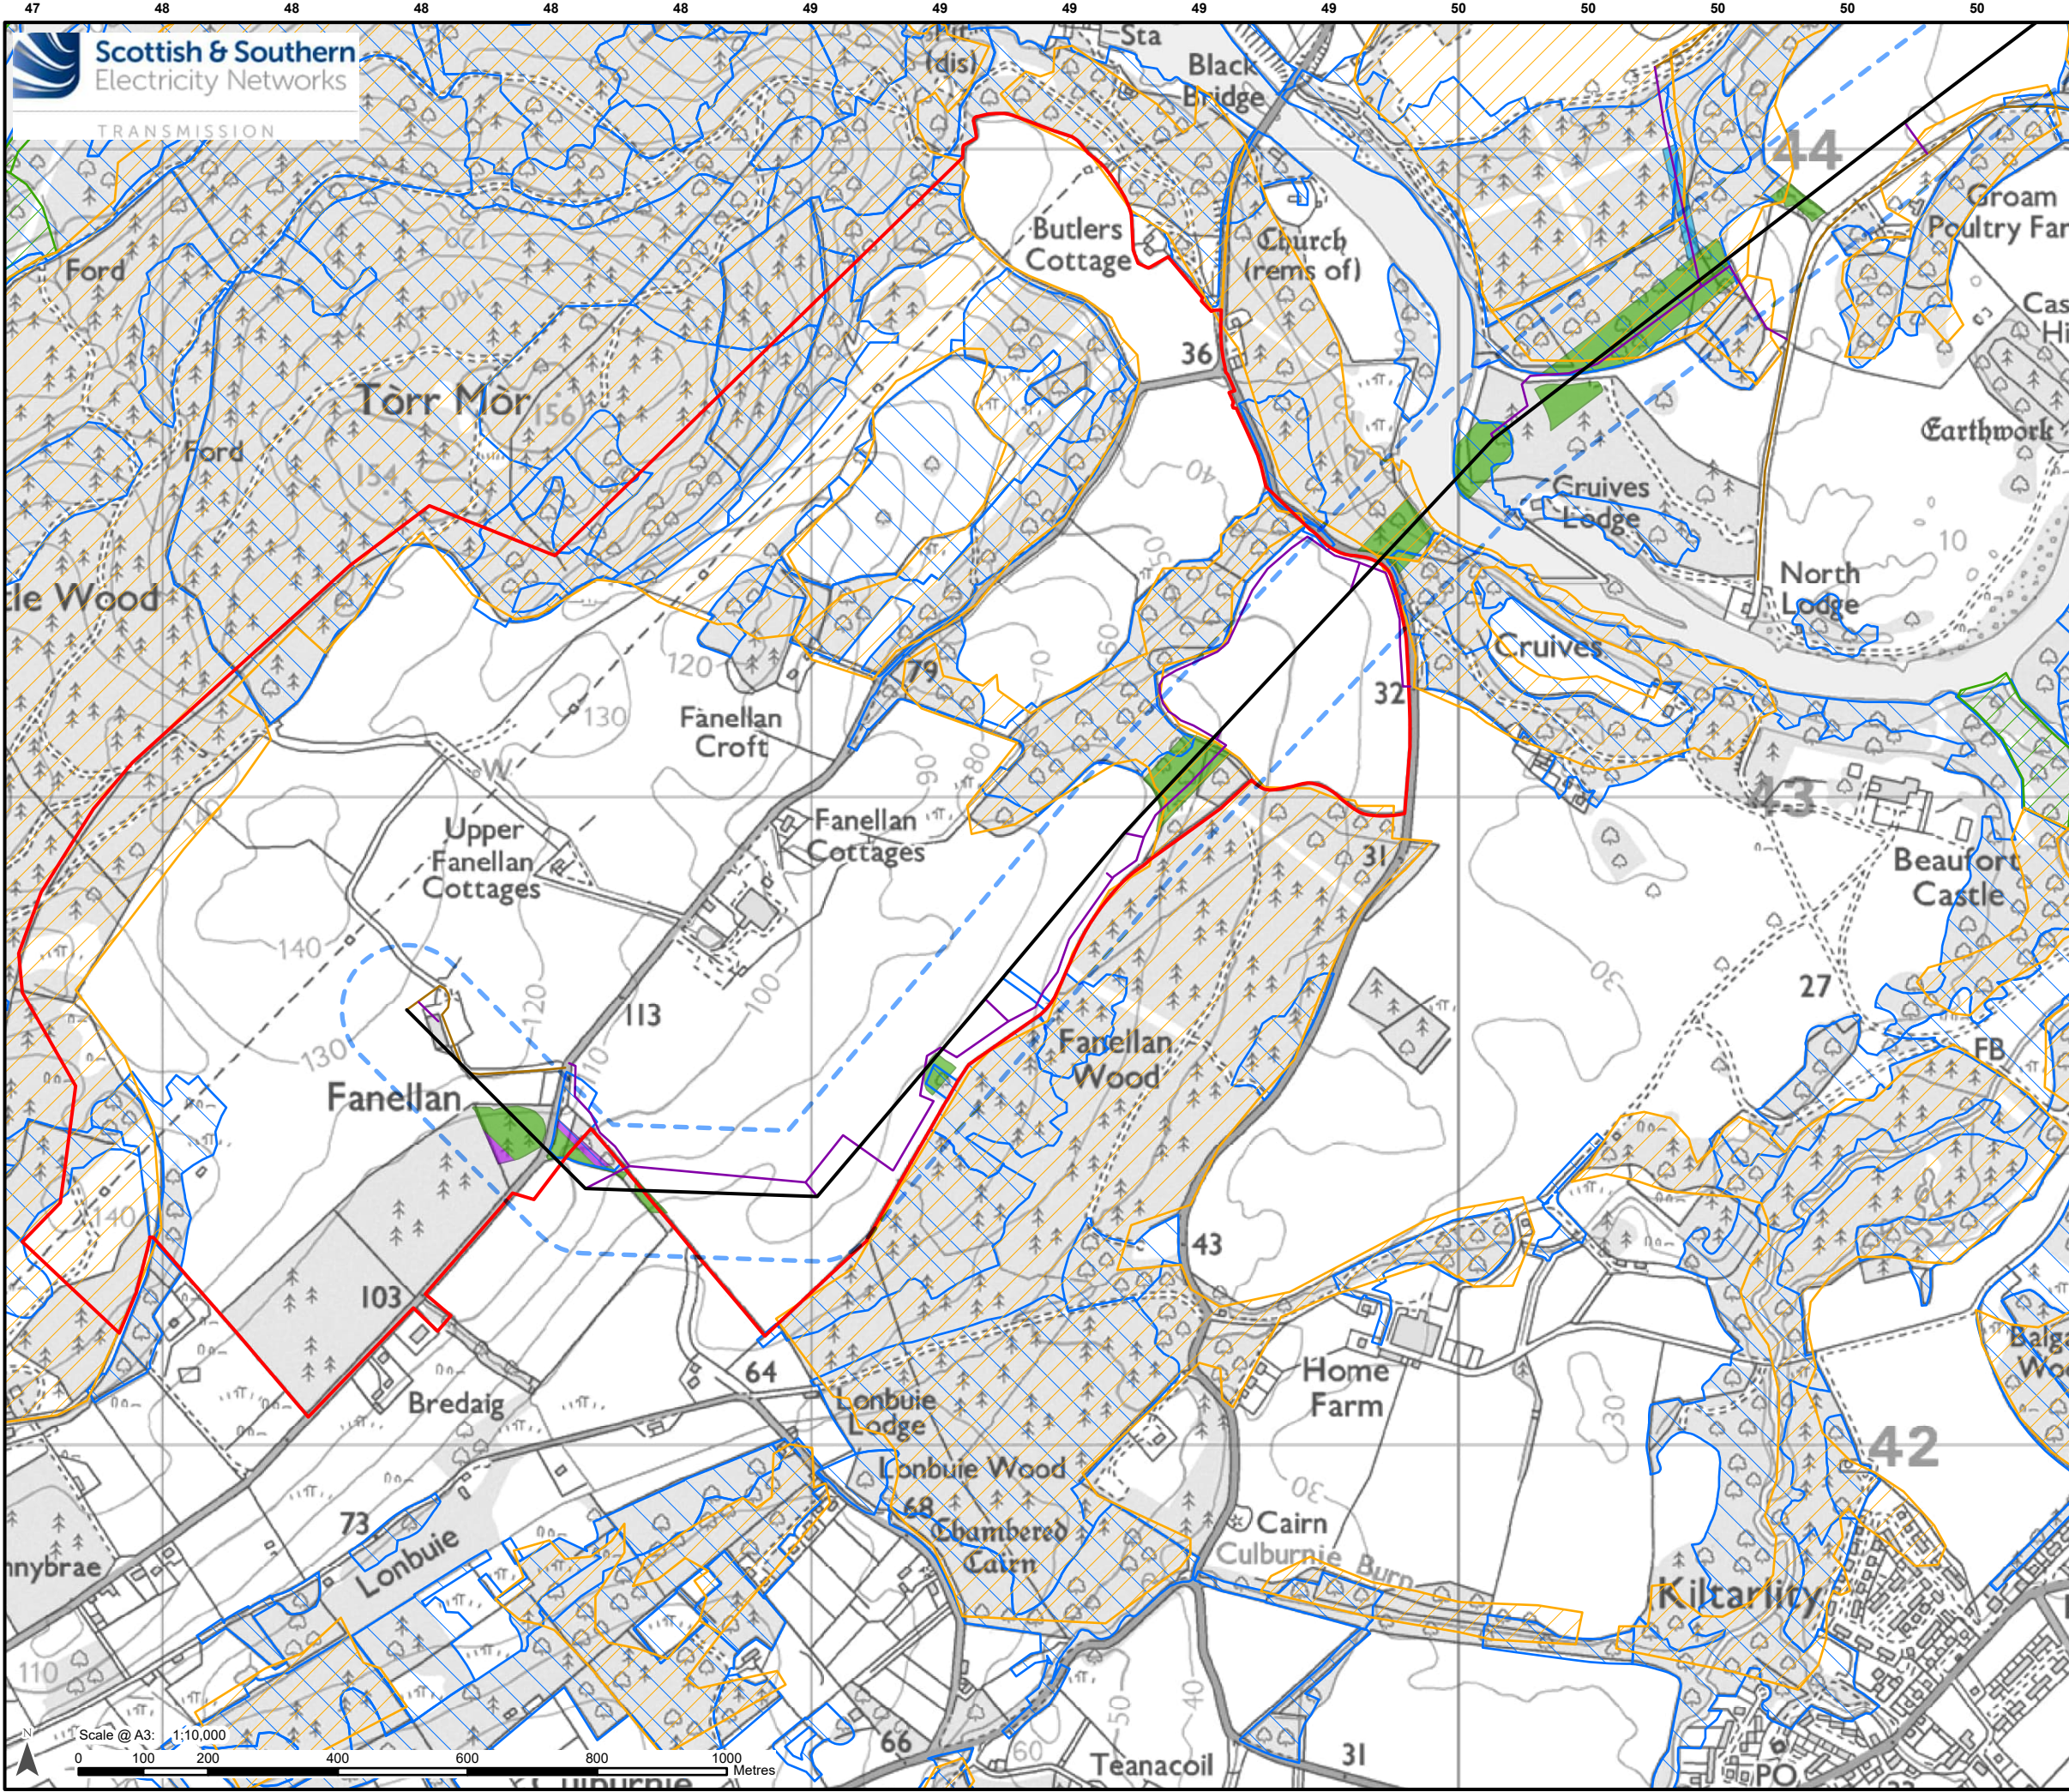

Legend

- Proposed Substation Site Planning Red Line Boundary
- Limit of Deviation – Proposed Towers and OHL Alignment*
- Proposed OHL Alignment - 400 kV

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV

Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV

Proposed Felling

- Management Felling Outwith Access Tracks and Operational Corridor
- Proposed Operational Corridor Felling
- Proposed Access Track Felling

Environmental Constraints


- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project	
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 1 of 45	
Drawn by:	MAL	Date: 20/08/2025
Drawing:	B2P-WSP-DA-70092380-185	

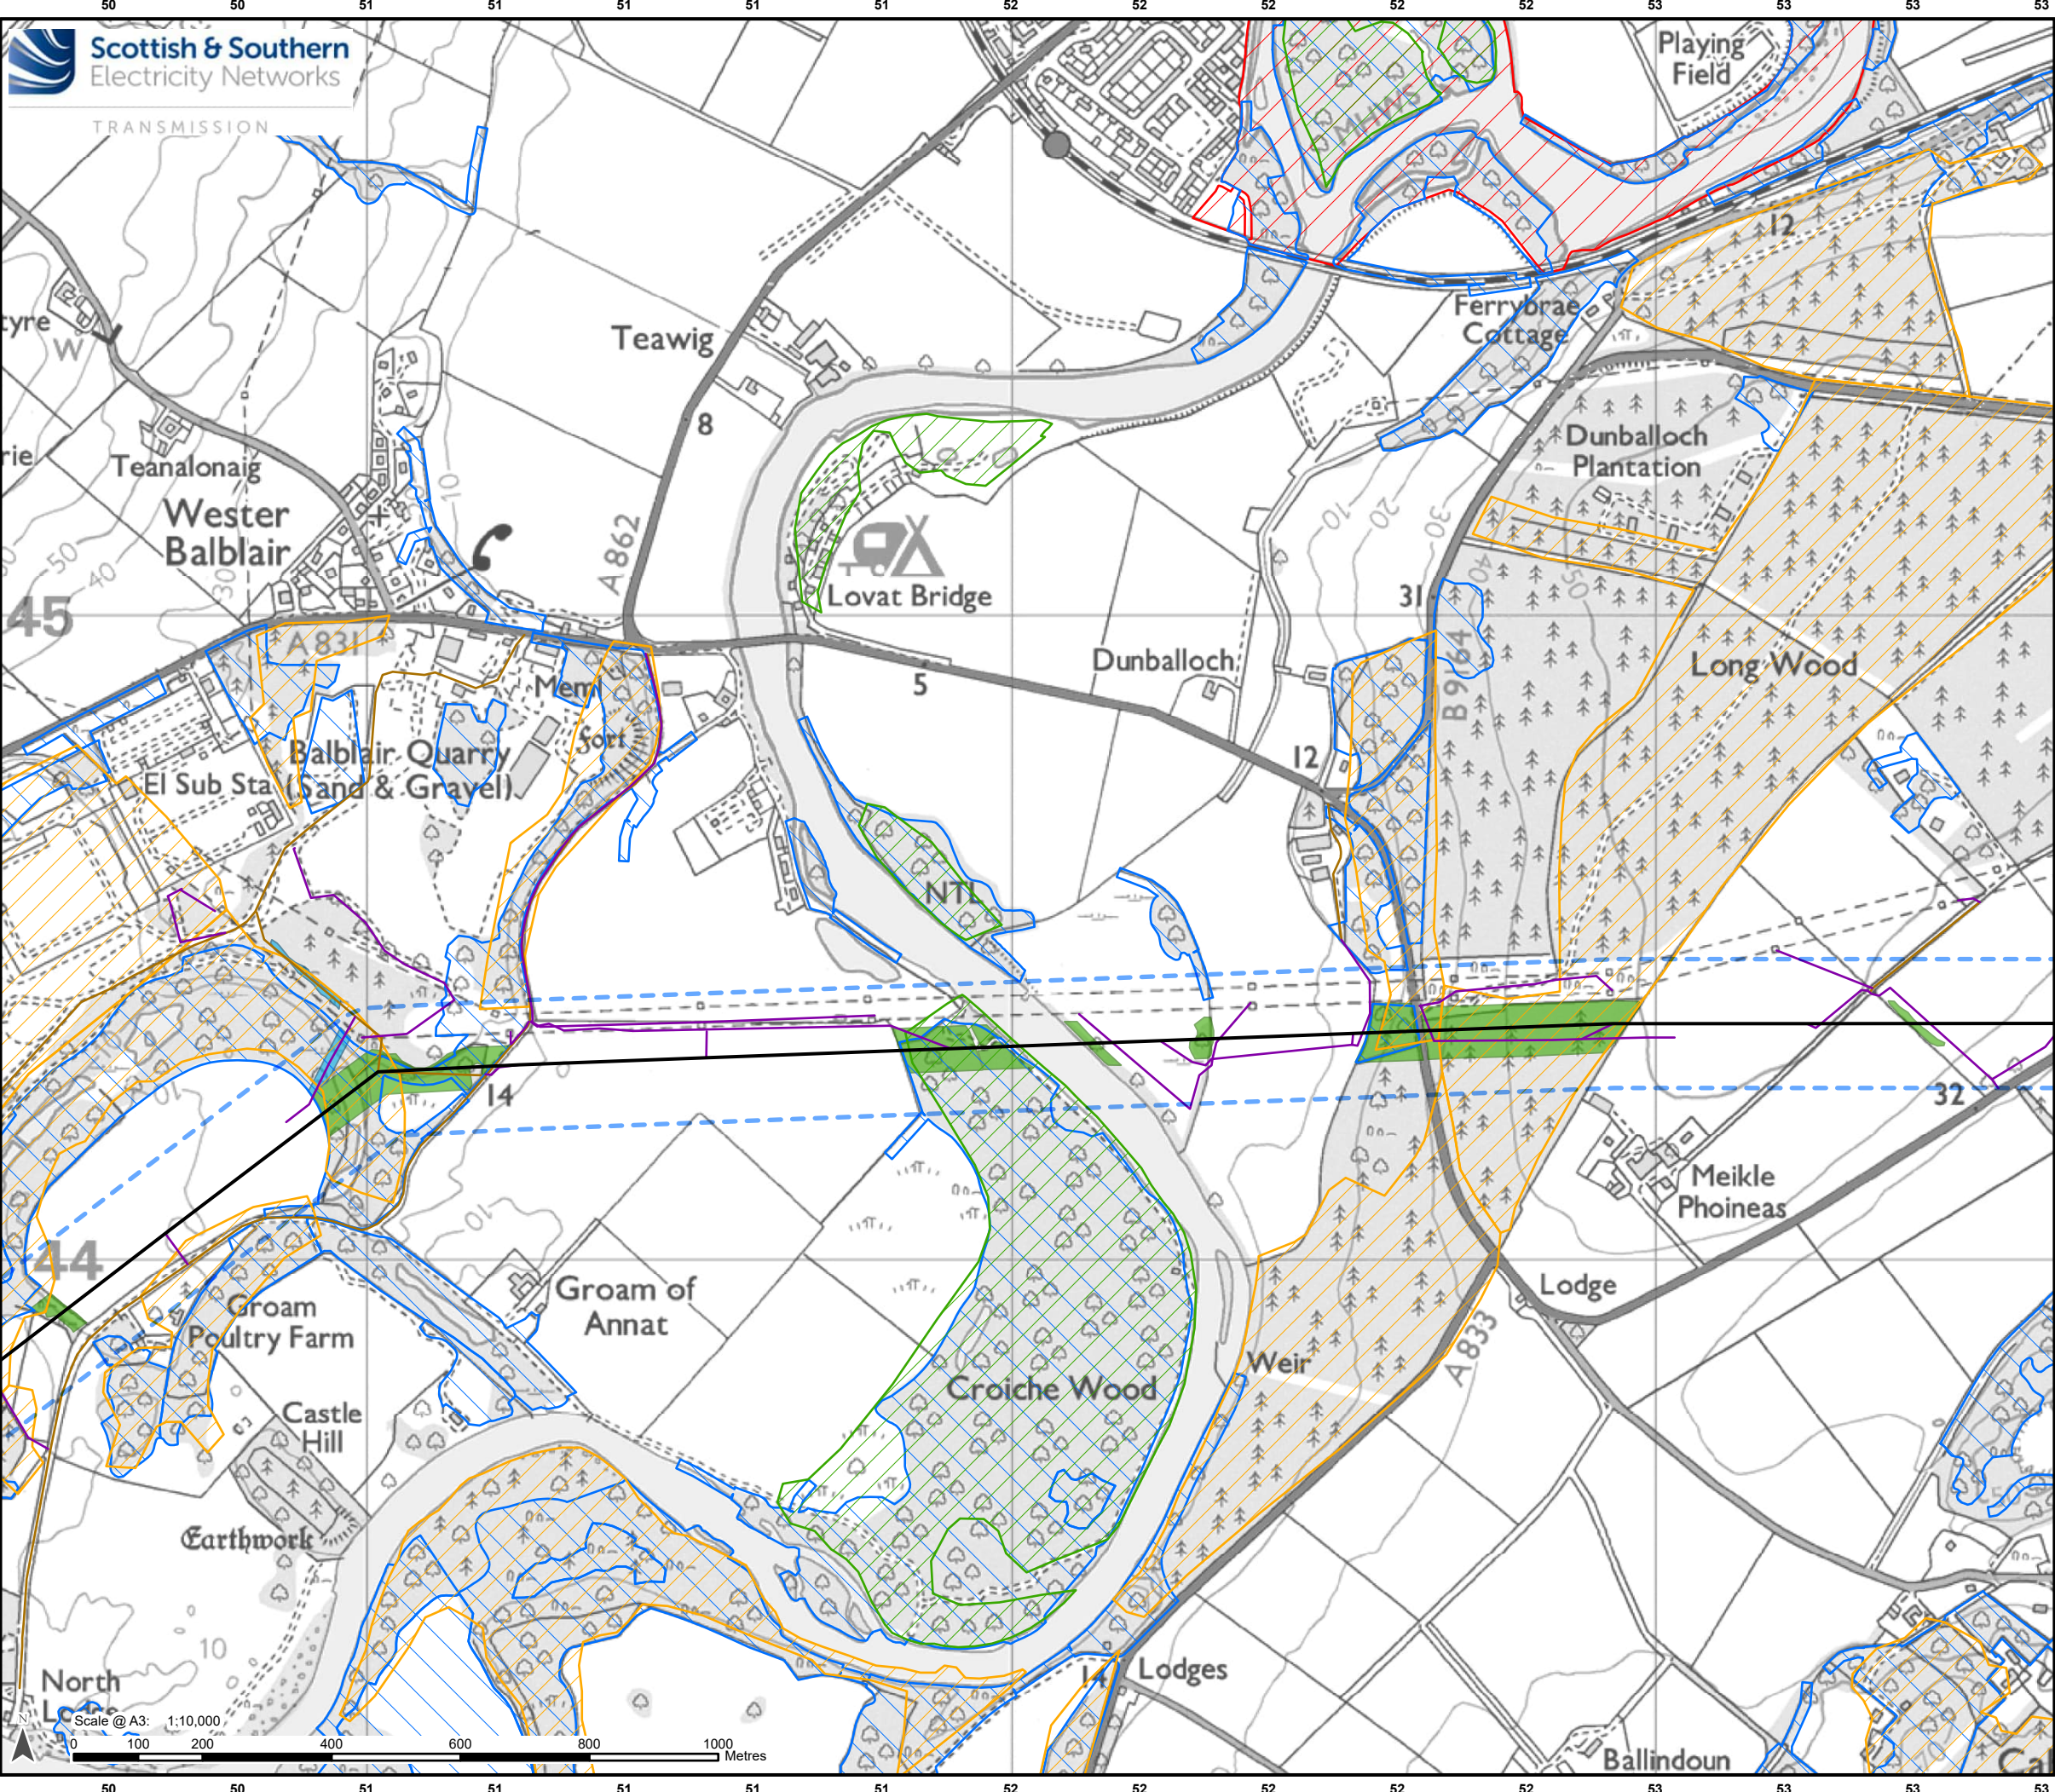


Legend

- Limit of Deviation – Proposed Towers and OHL Alignment*
- Development for which Section 37 Consent is Sought**
 - Proposed OHL Alignment - 400 kV
- Ancillary Development**
 - Access Track – Permanent
 - Access Track – Temporary and ATV
- Proposed Felling**
 - Proposed Operational Corridor Felling
 - Proposed Access Track Felling
- Environmental Constraints**
 - Site of Special Scientific Interest
 - Native Woodland Survey of Scotland
 - Ancient Woodland of Semi-Natural Origin
 - Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 2 of 45		
Drawn by:	MAL	Date:	20/08/2025
Drawing:	B2P-WSP-DA-70092380-185		

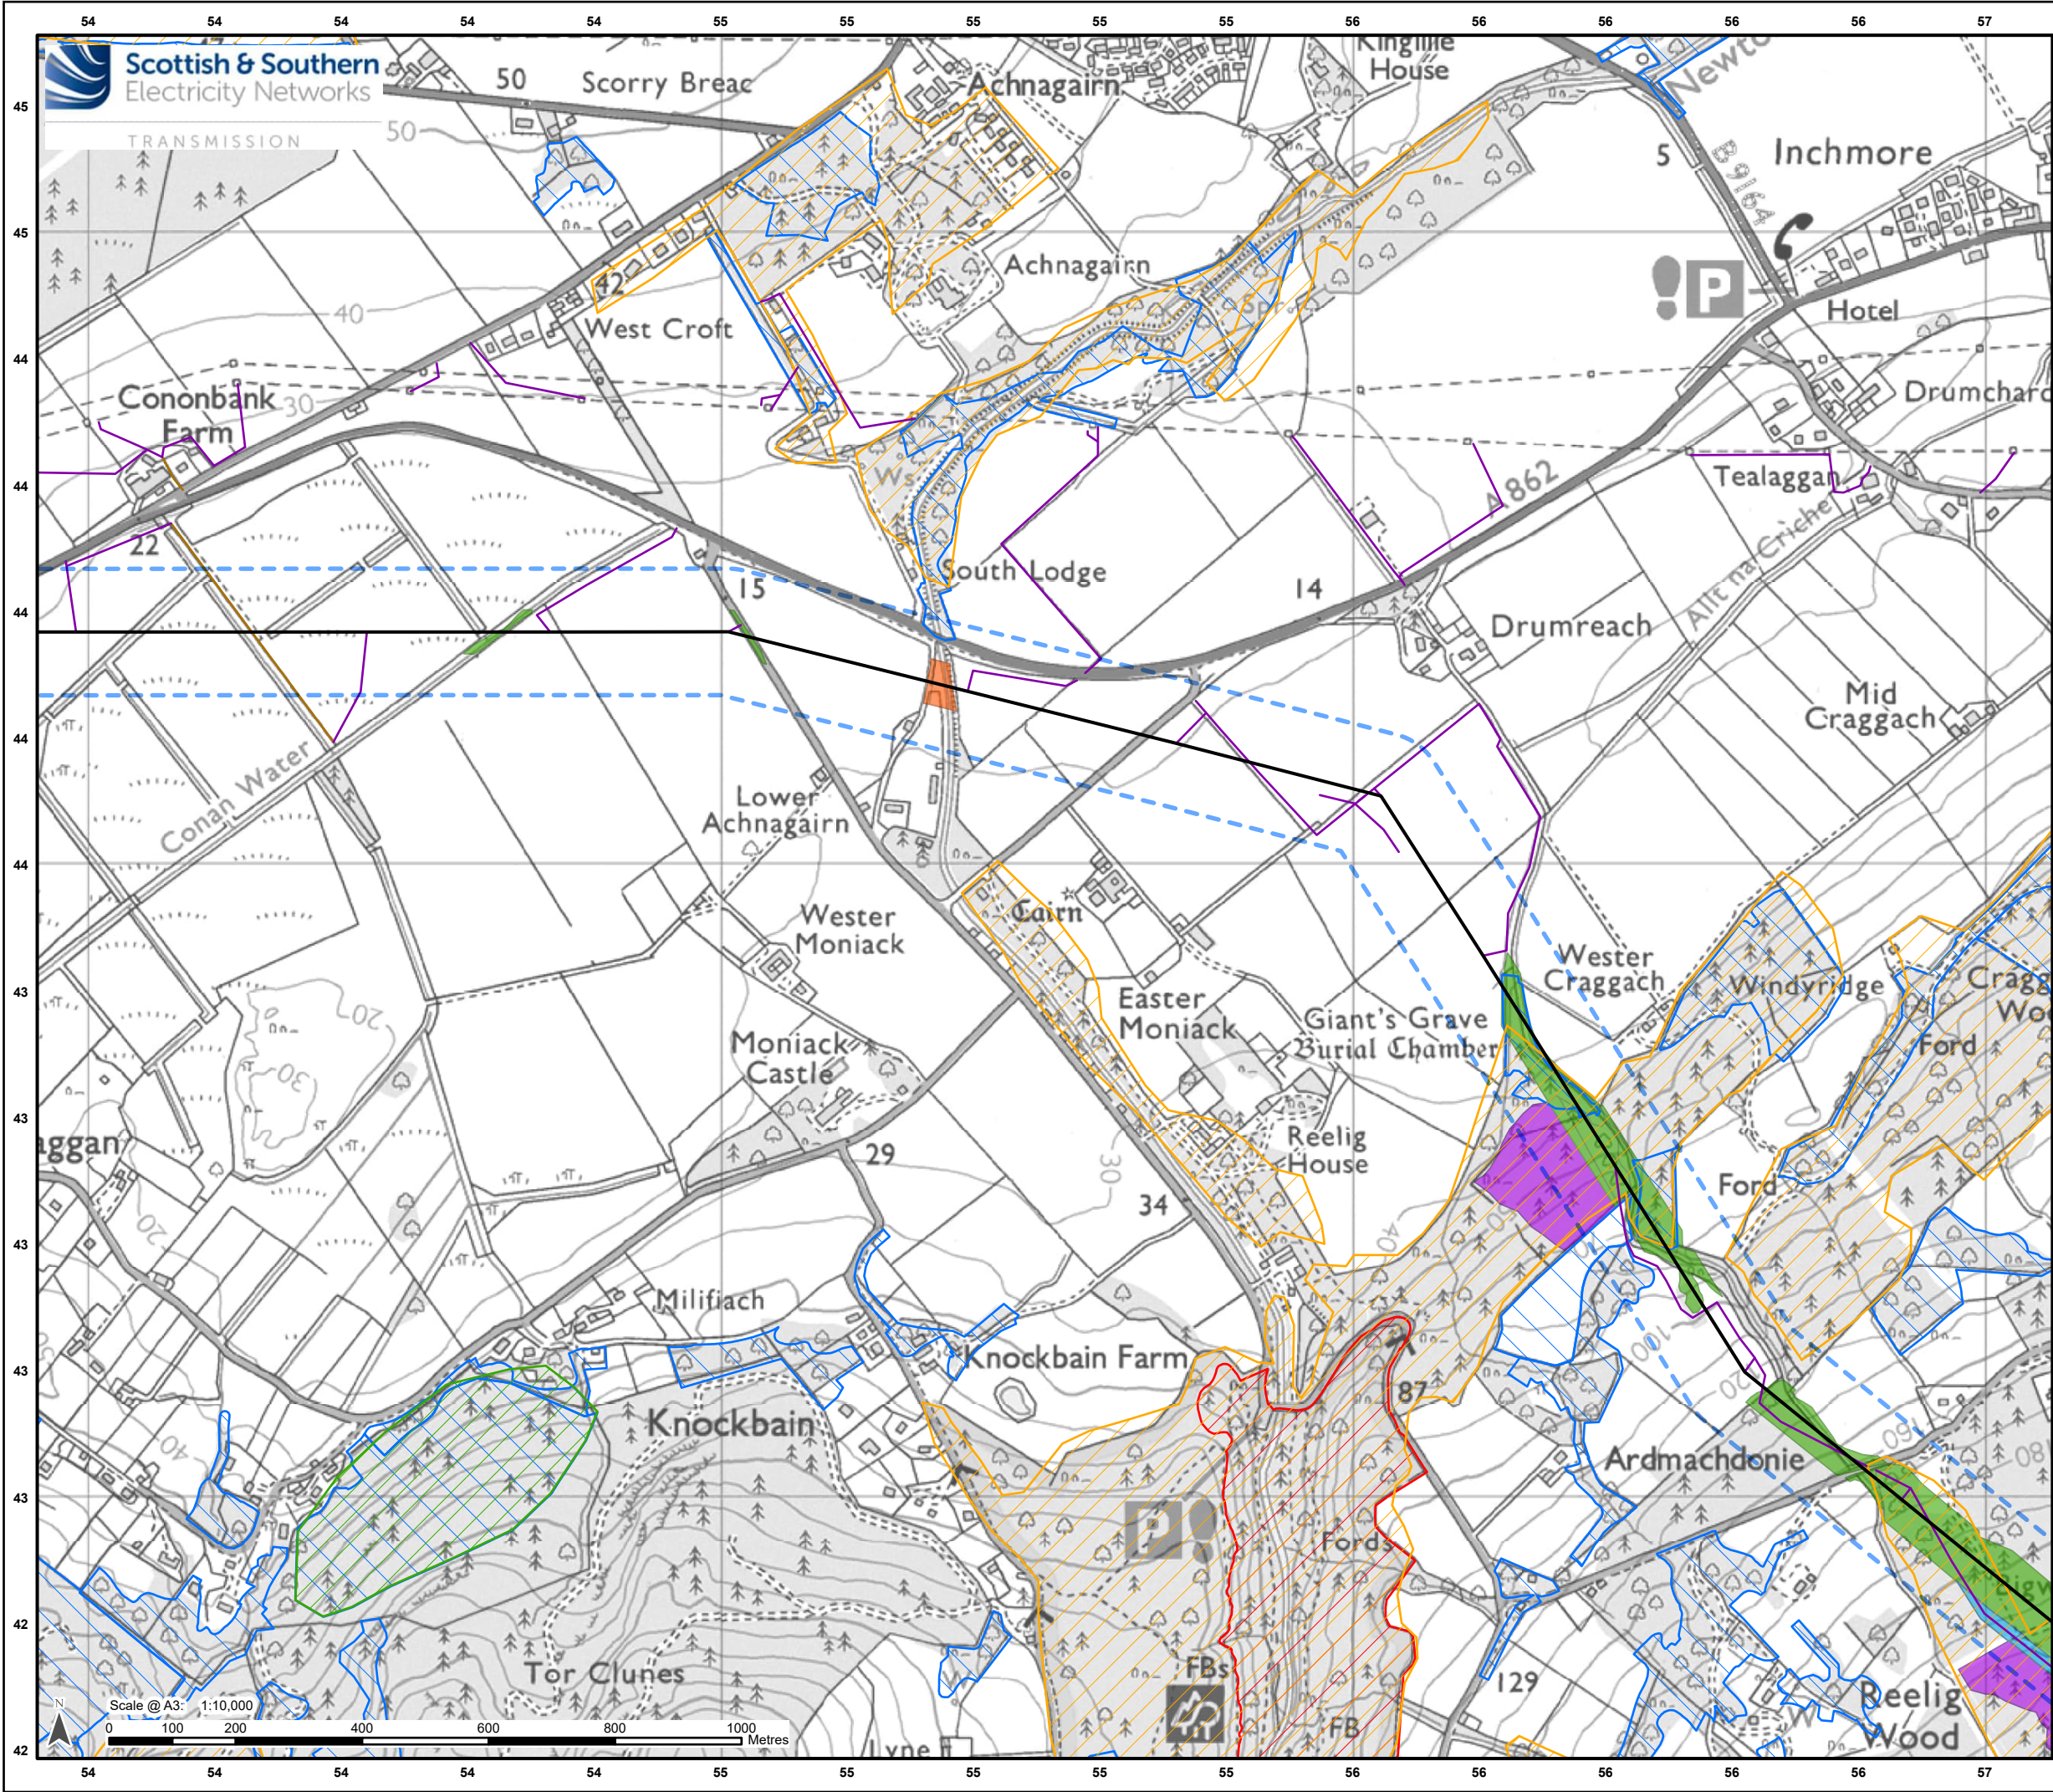

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Proposed Operational Corridor Crown Reduction

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

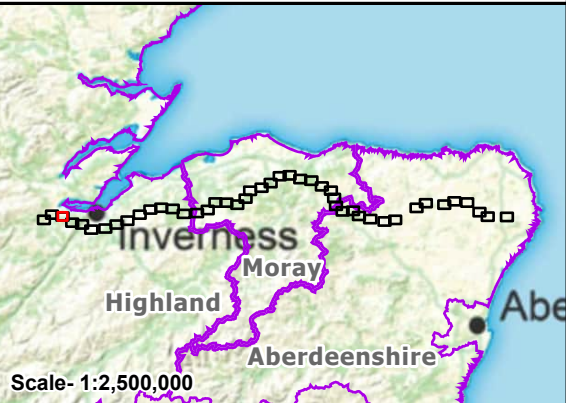


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 3 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

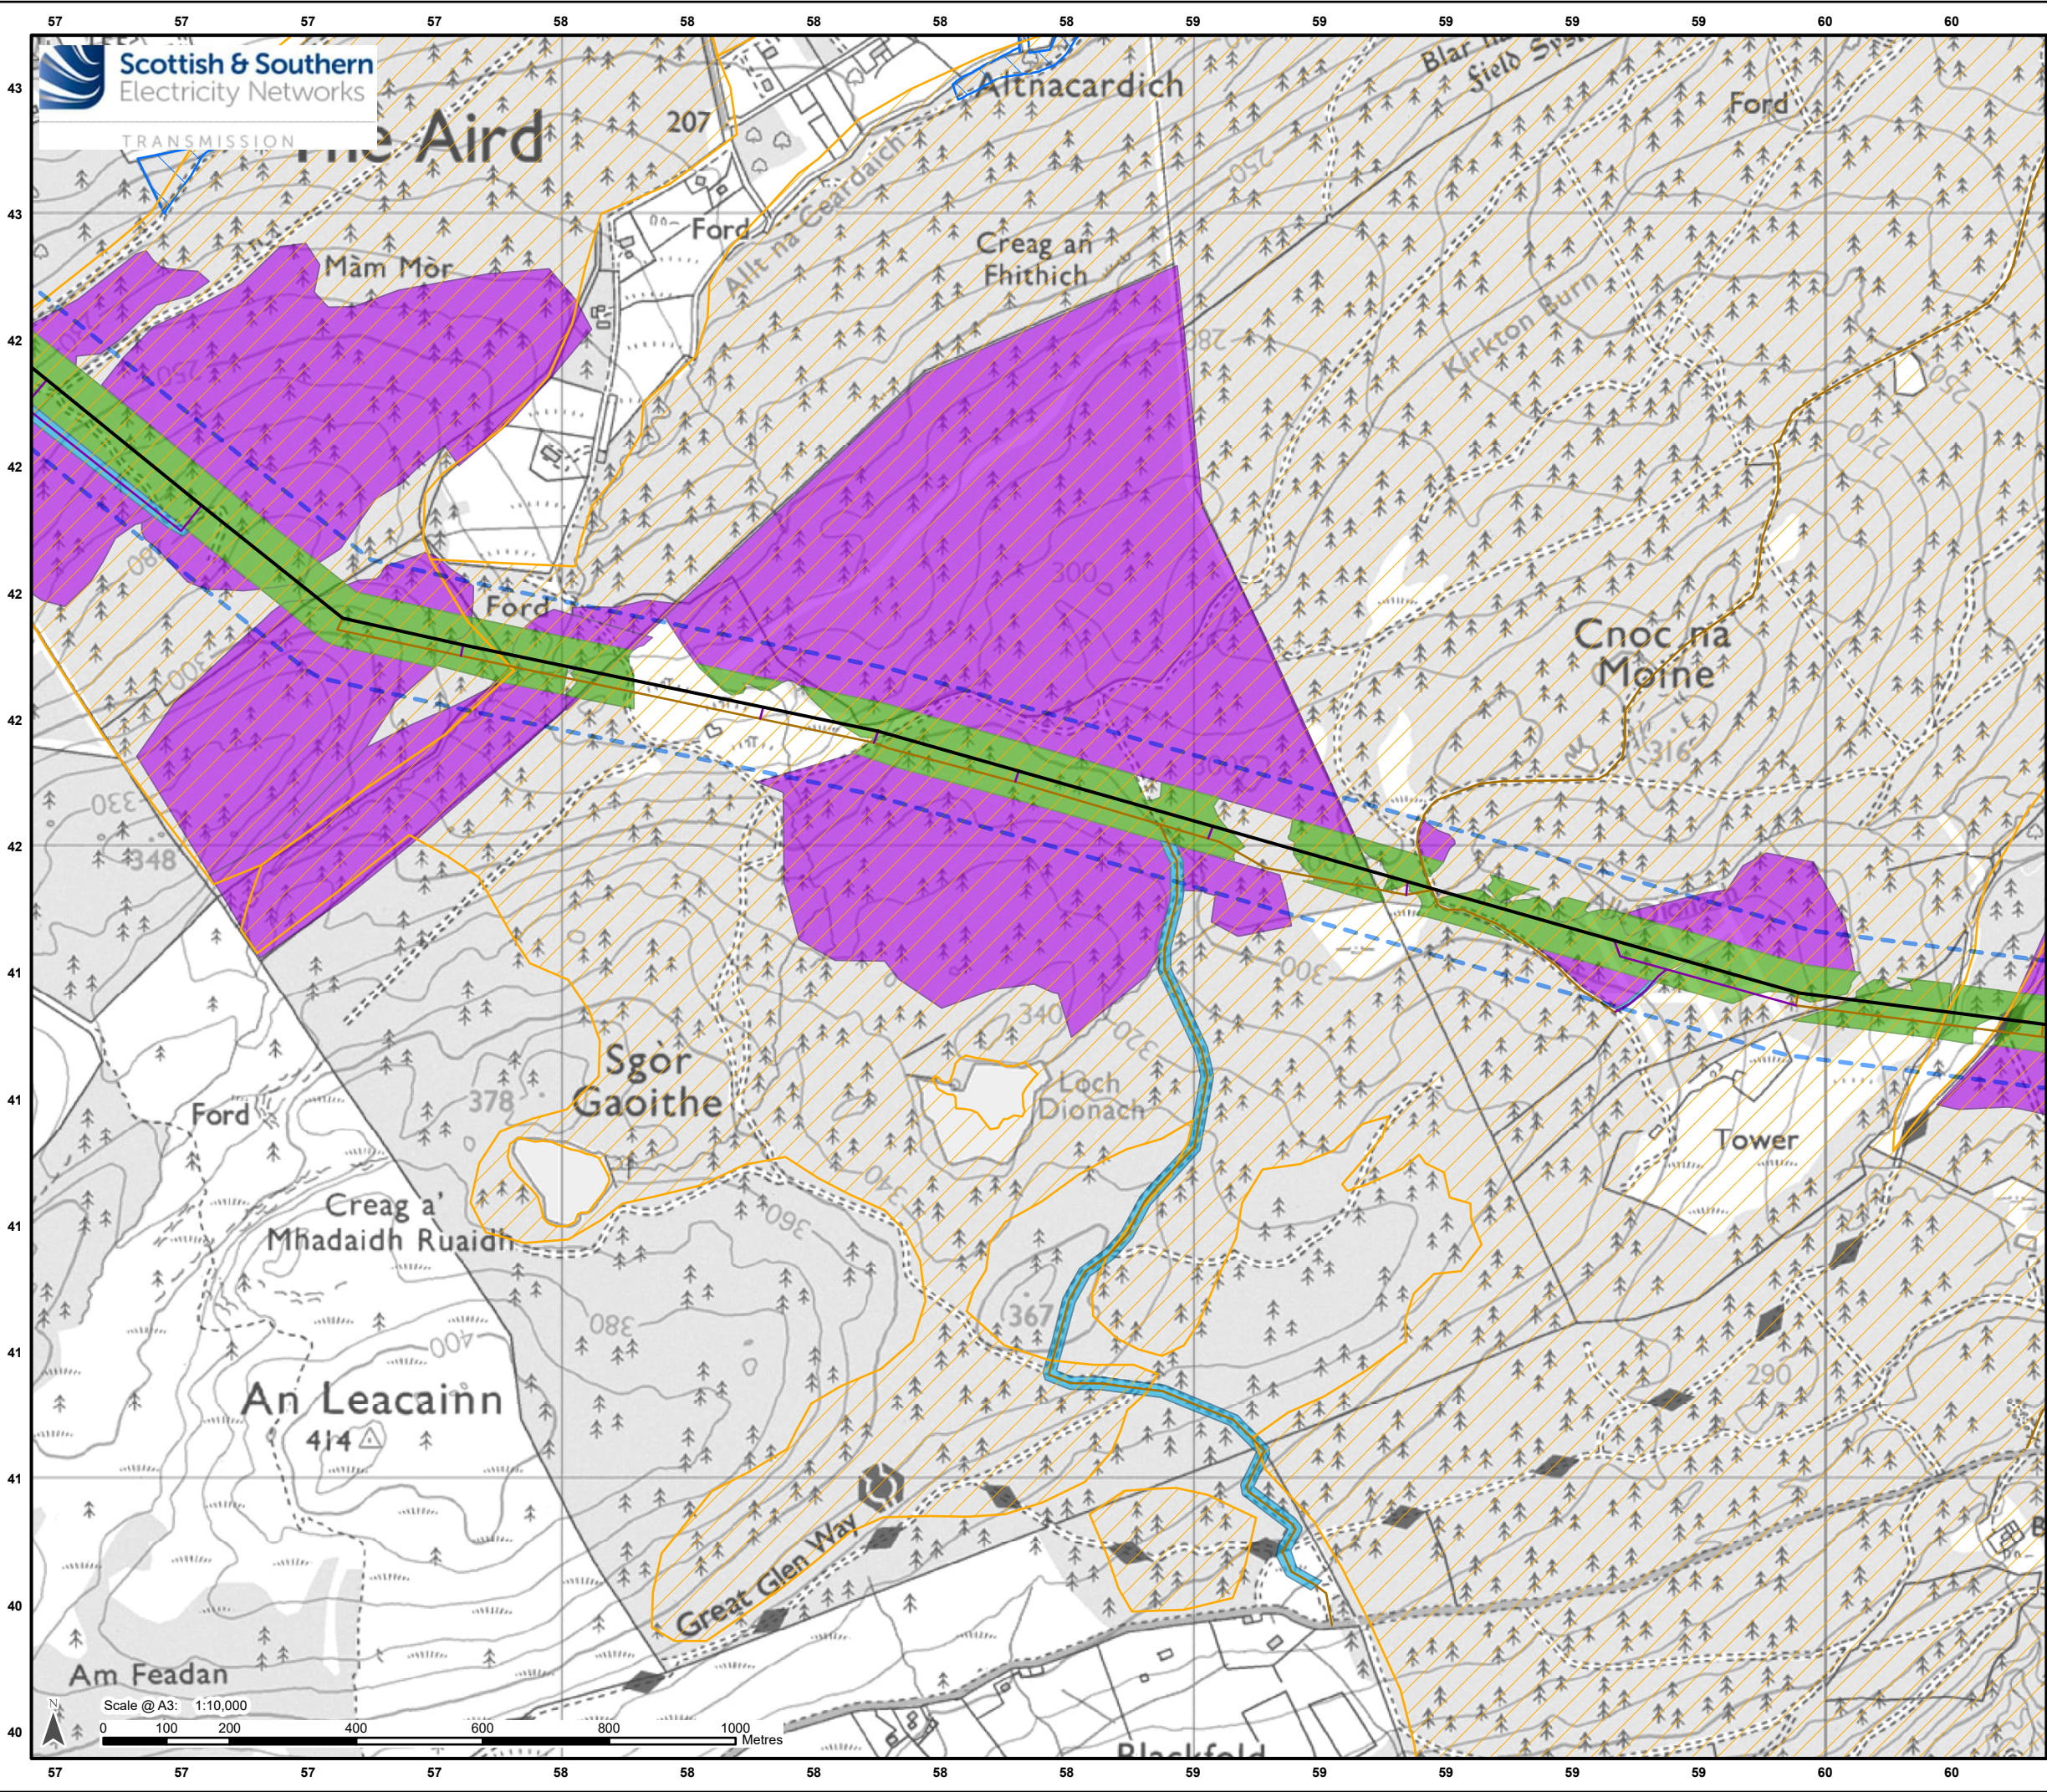

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Environmental Constraints

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.




Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 4 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

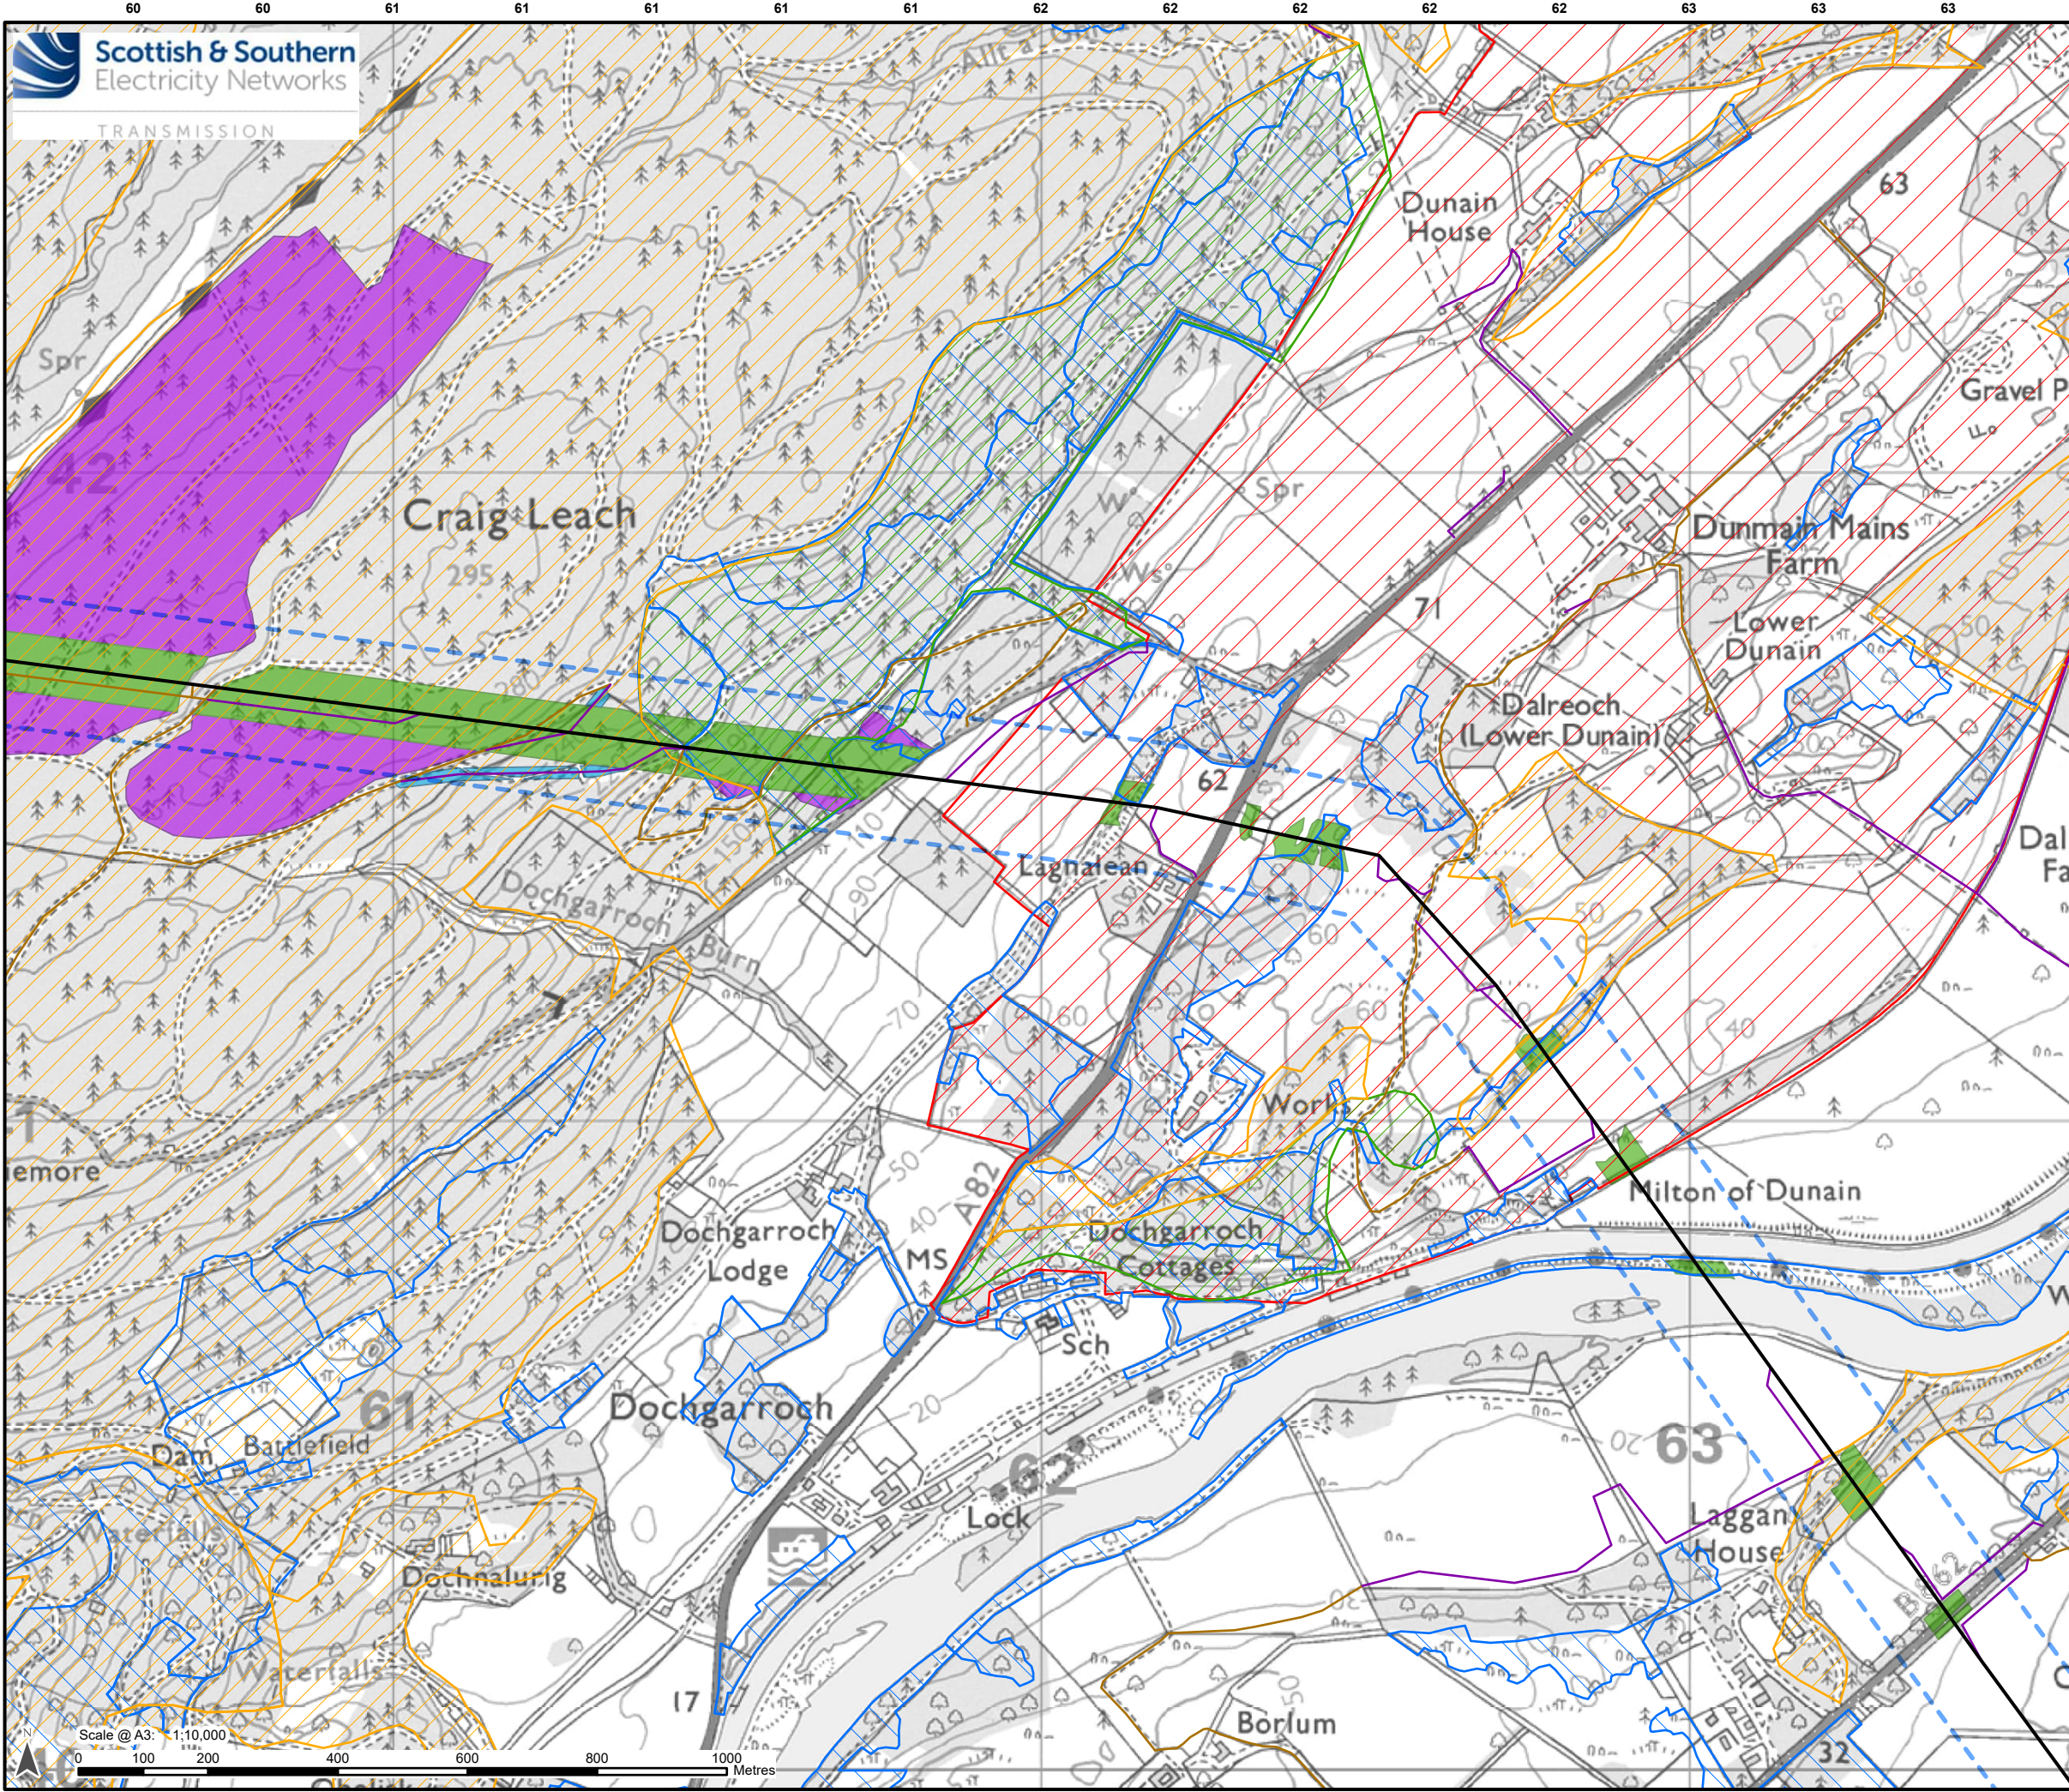

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin


Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

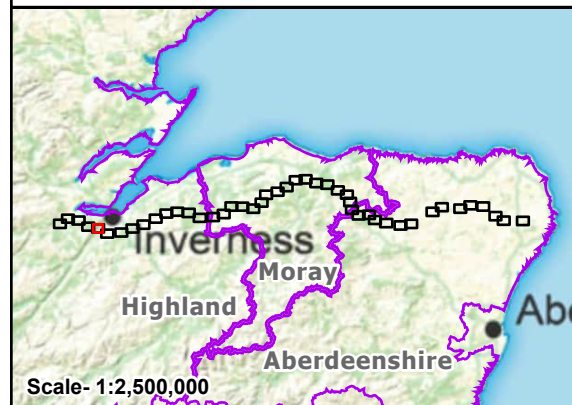

Scale- 1:2,500,000
Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project	
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 5 of 45	
Drawn by:	MAL	Date: 20/08/2025
Drawing:	B2P-WSP-DA-70092380-185	

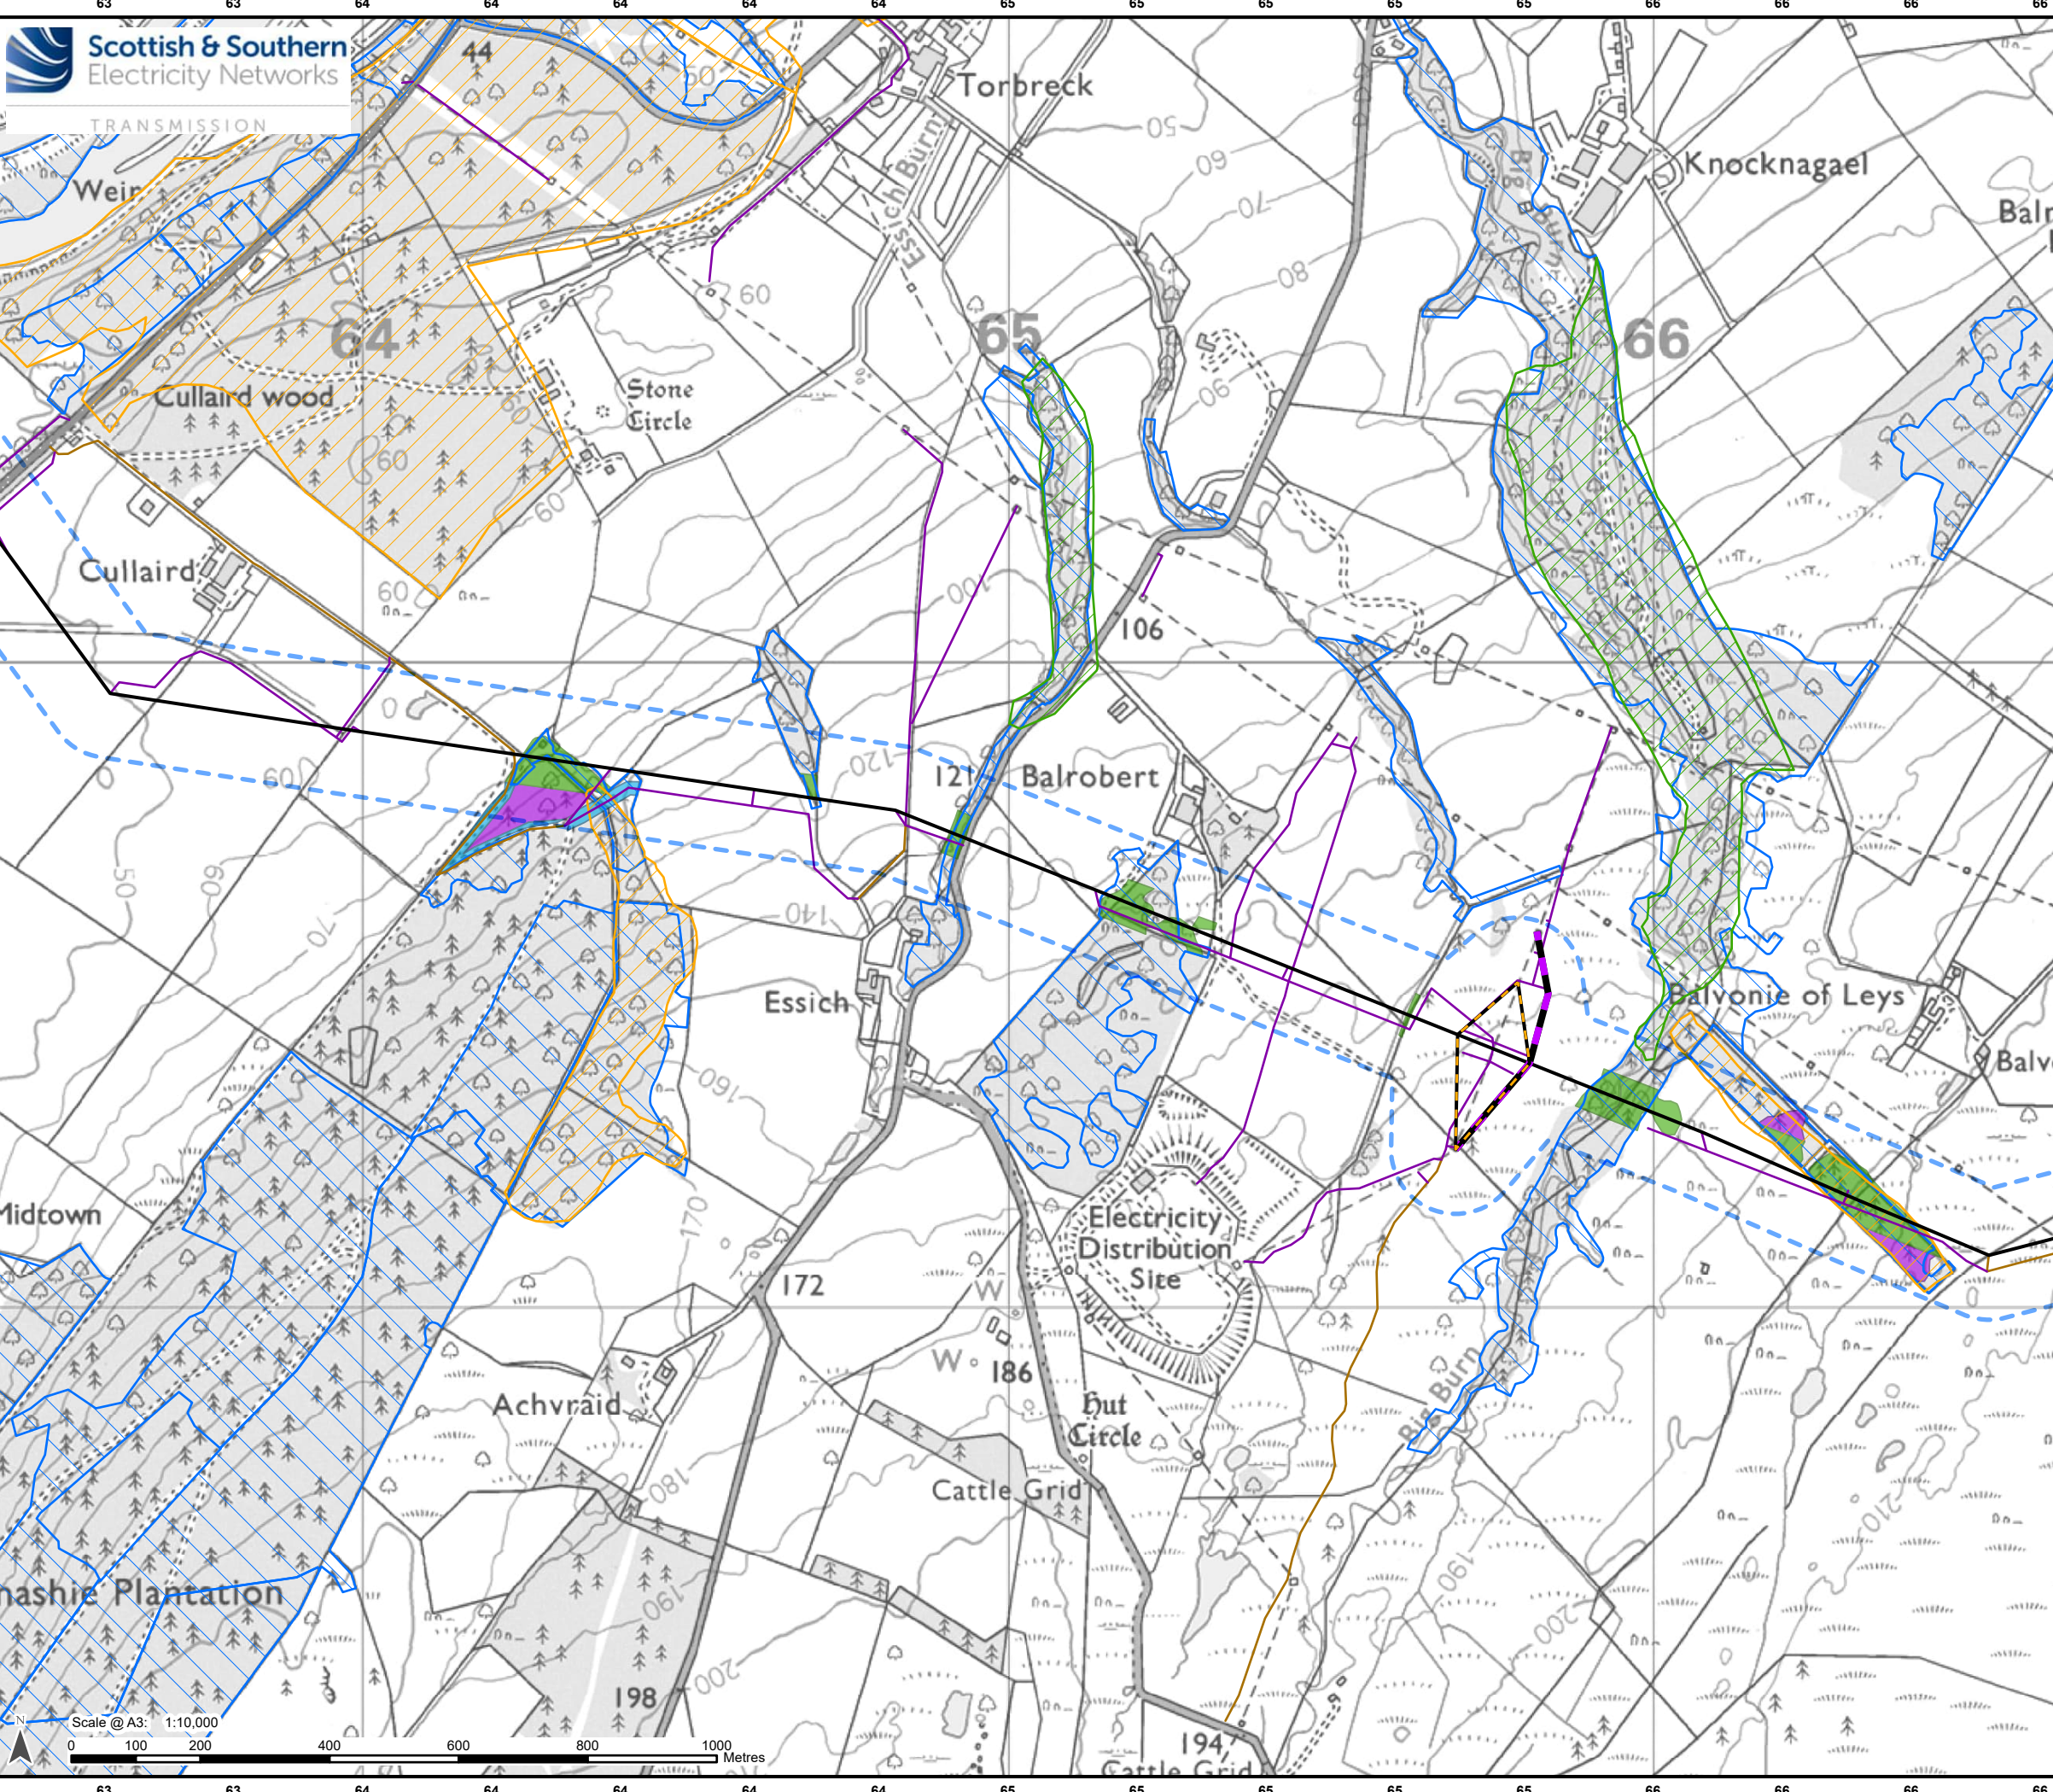

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV


Proposed Felling

- Management Felling Outwith Access Tracks and Operational Corridor
- Proposed Operational Corridor Felling
- Proposed Access Track Felling

Environmental Constraints

- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

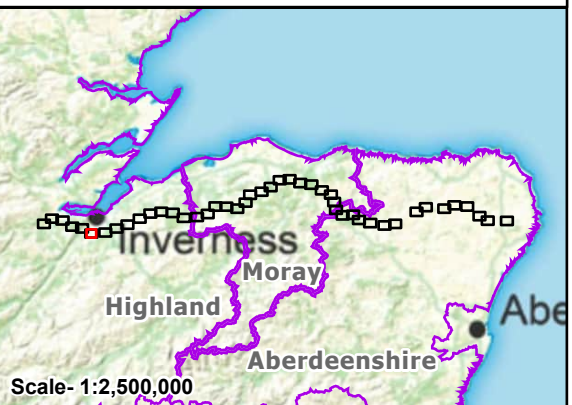


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 6 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

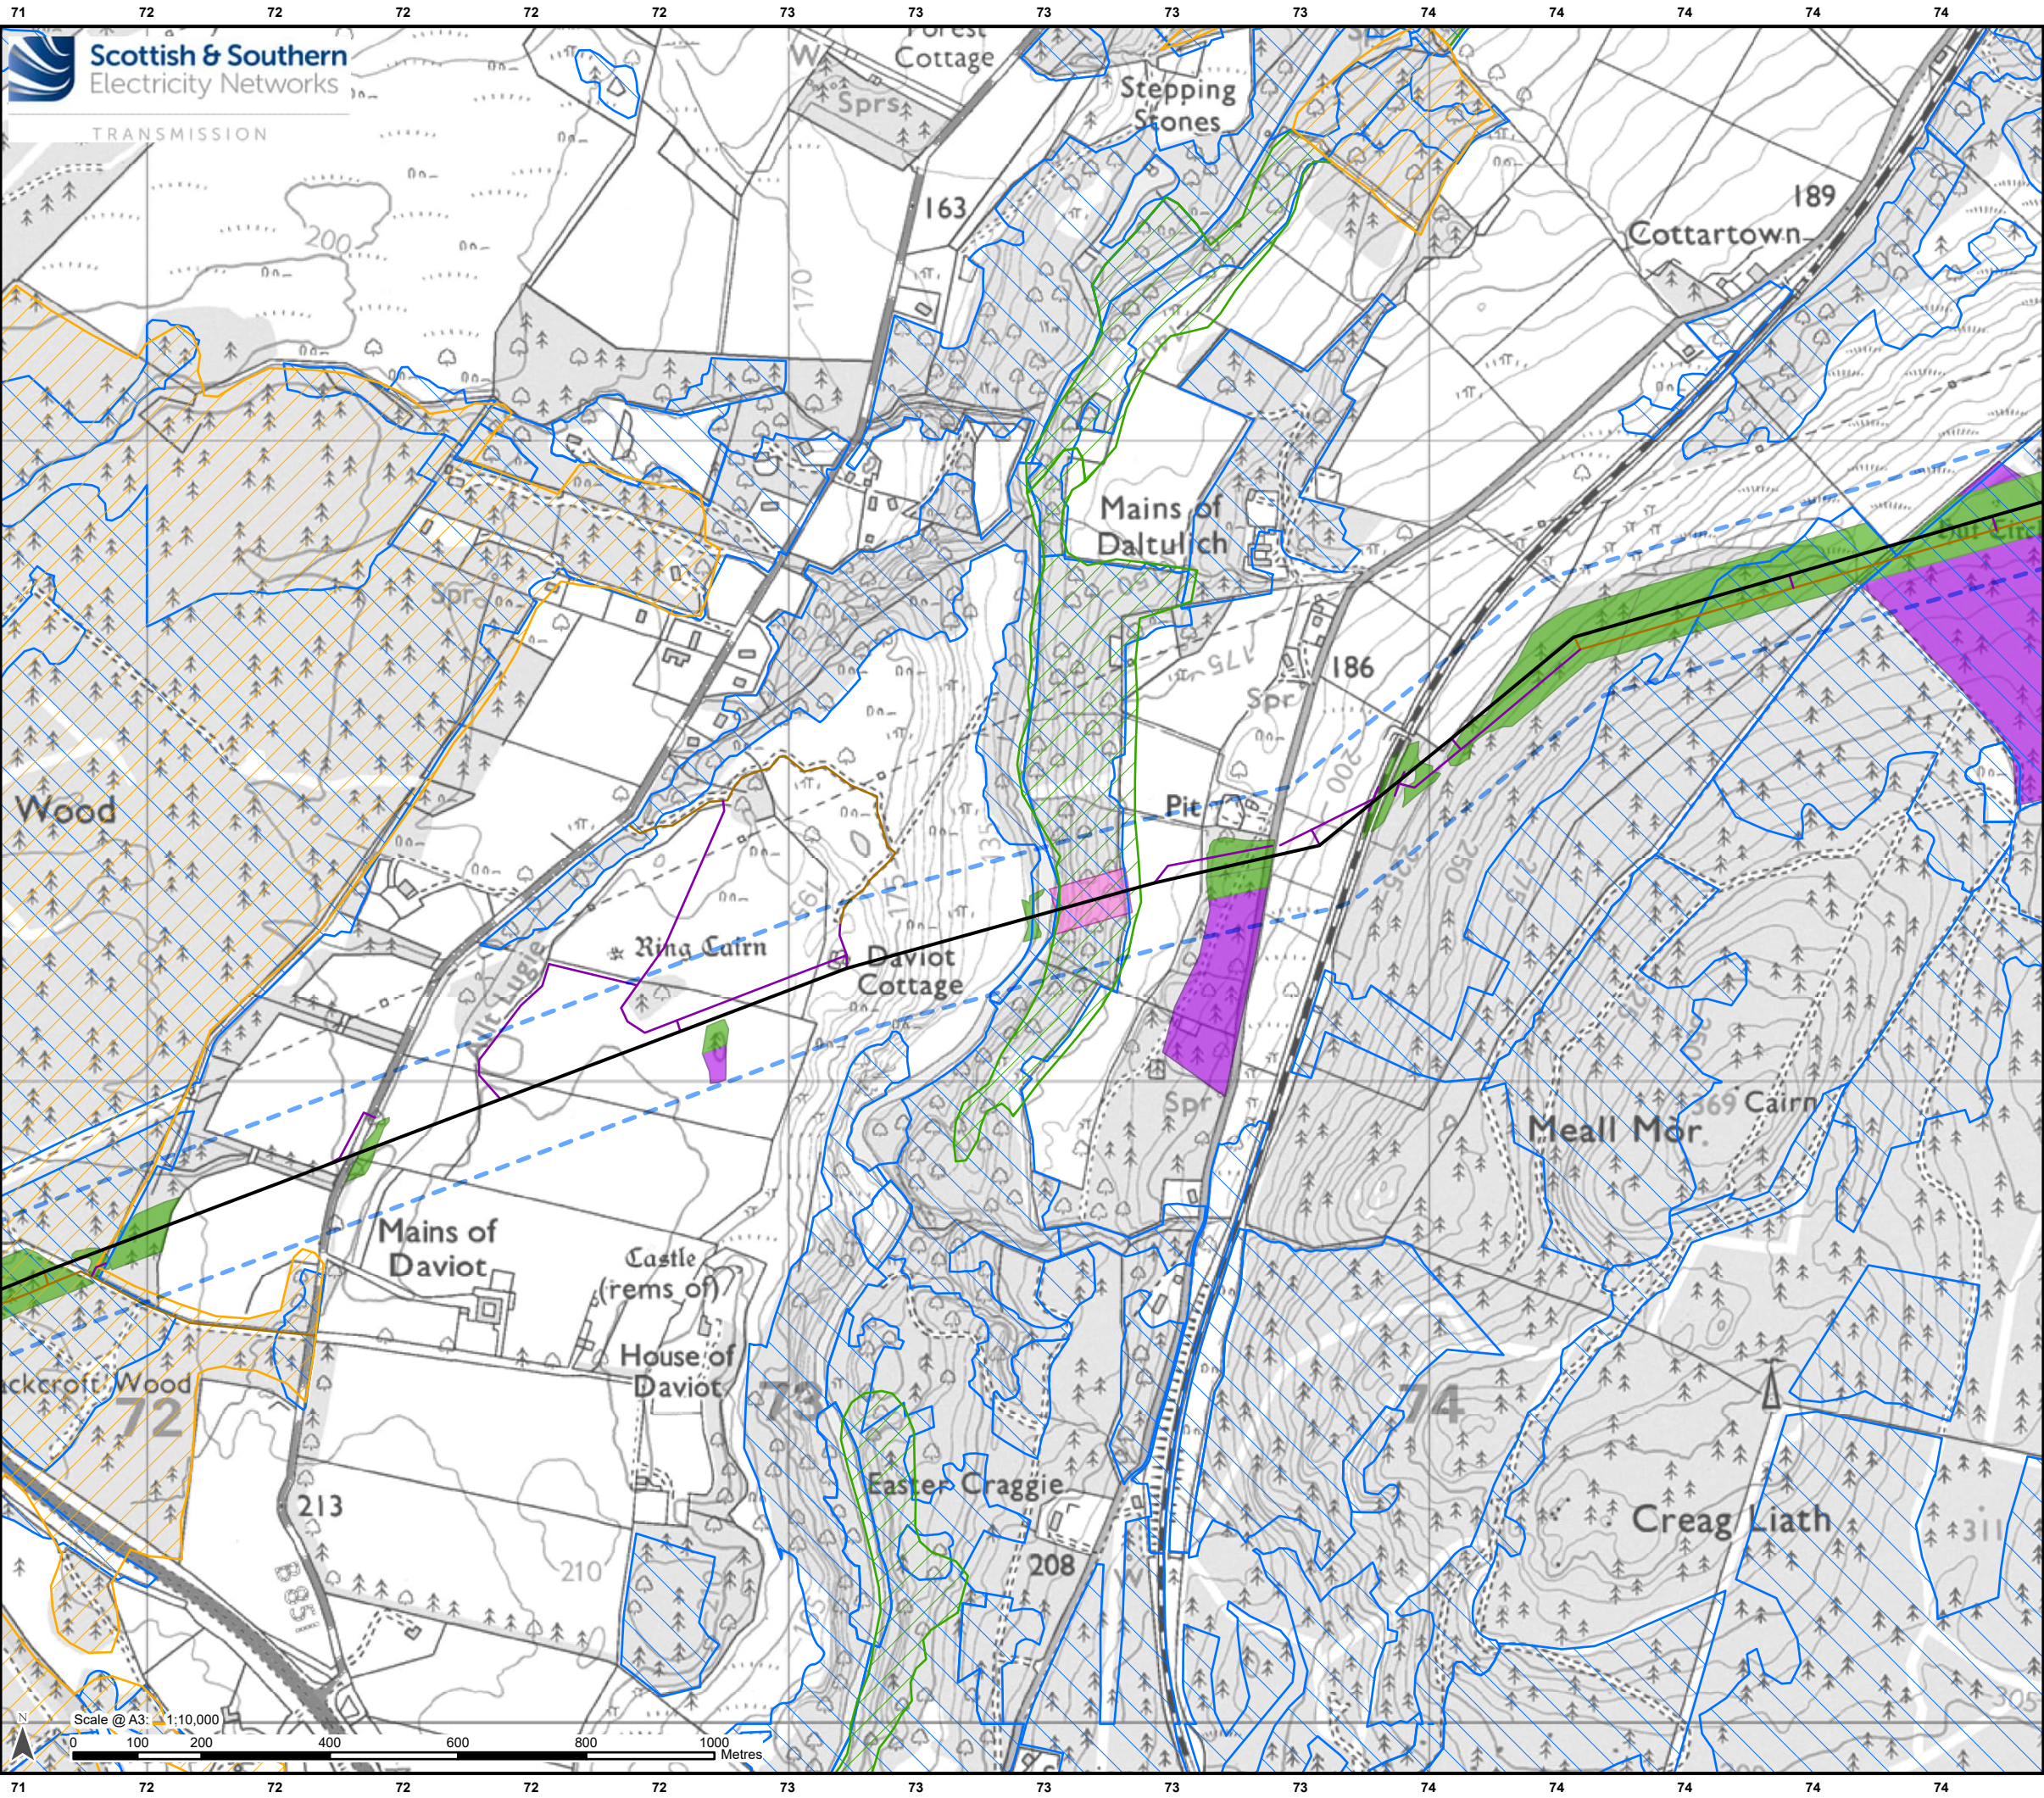

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Selective Felling Outwith Access Tracks and Operational Corridor

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland


Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

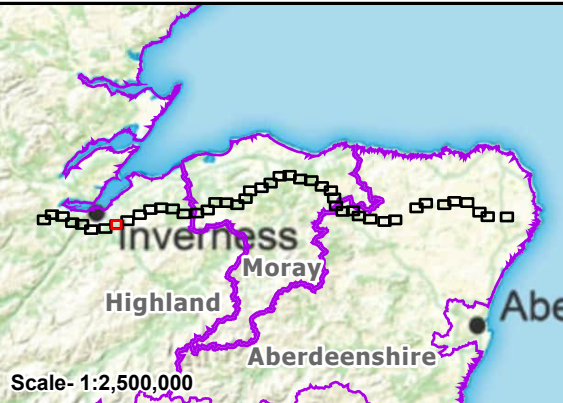

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 8 of 45
Drawn by:	MAL
Date:	20/08/2025
Drawing:	B2P-WSP-DA-70092380-185

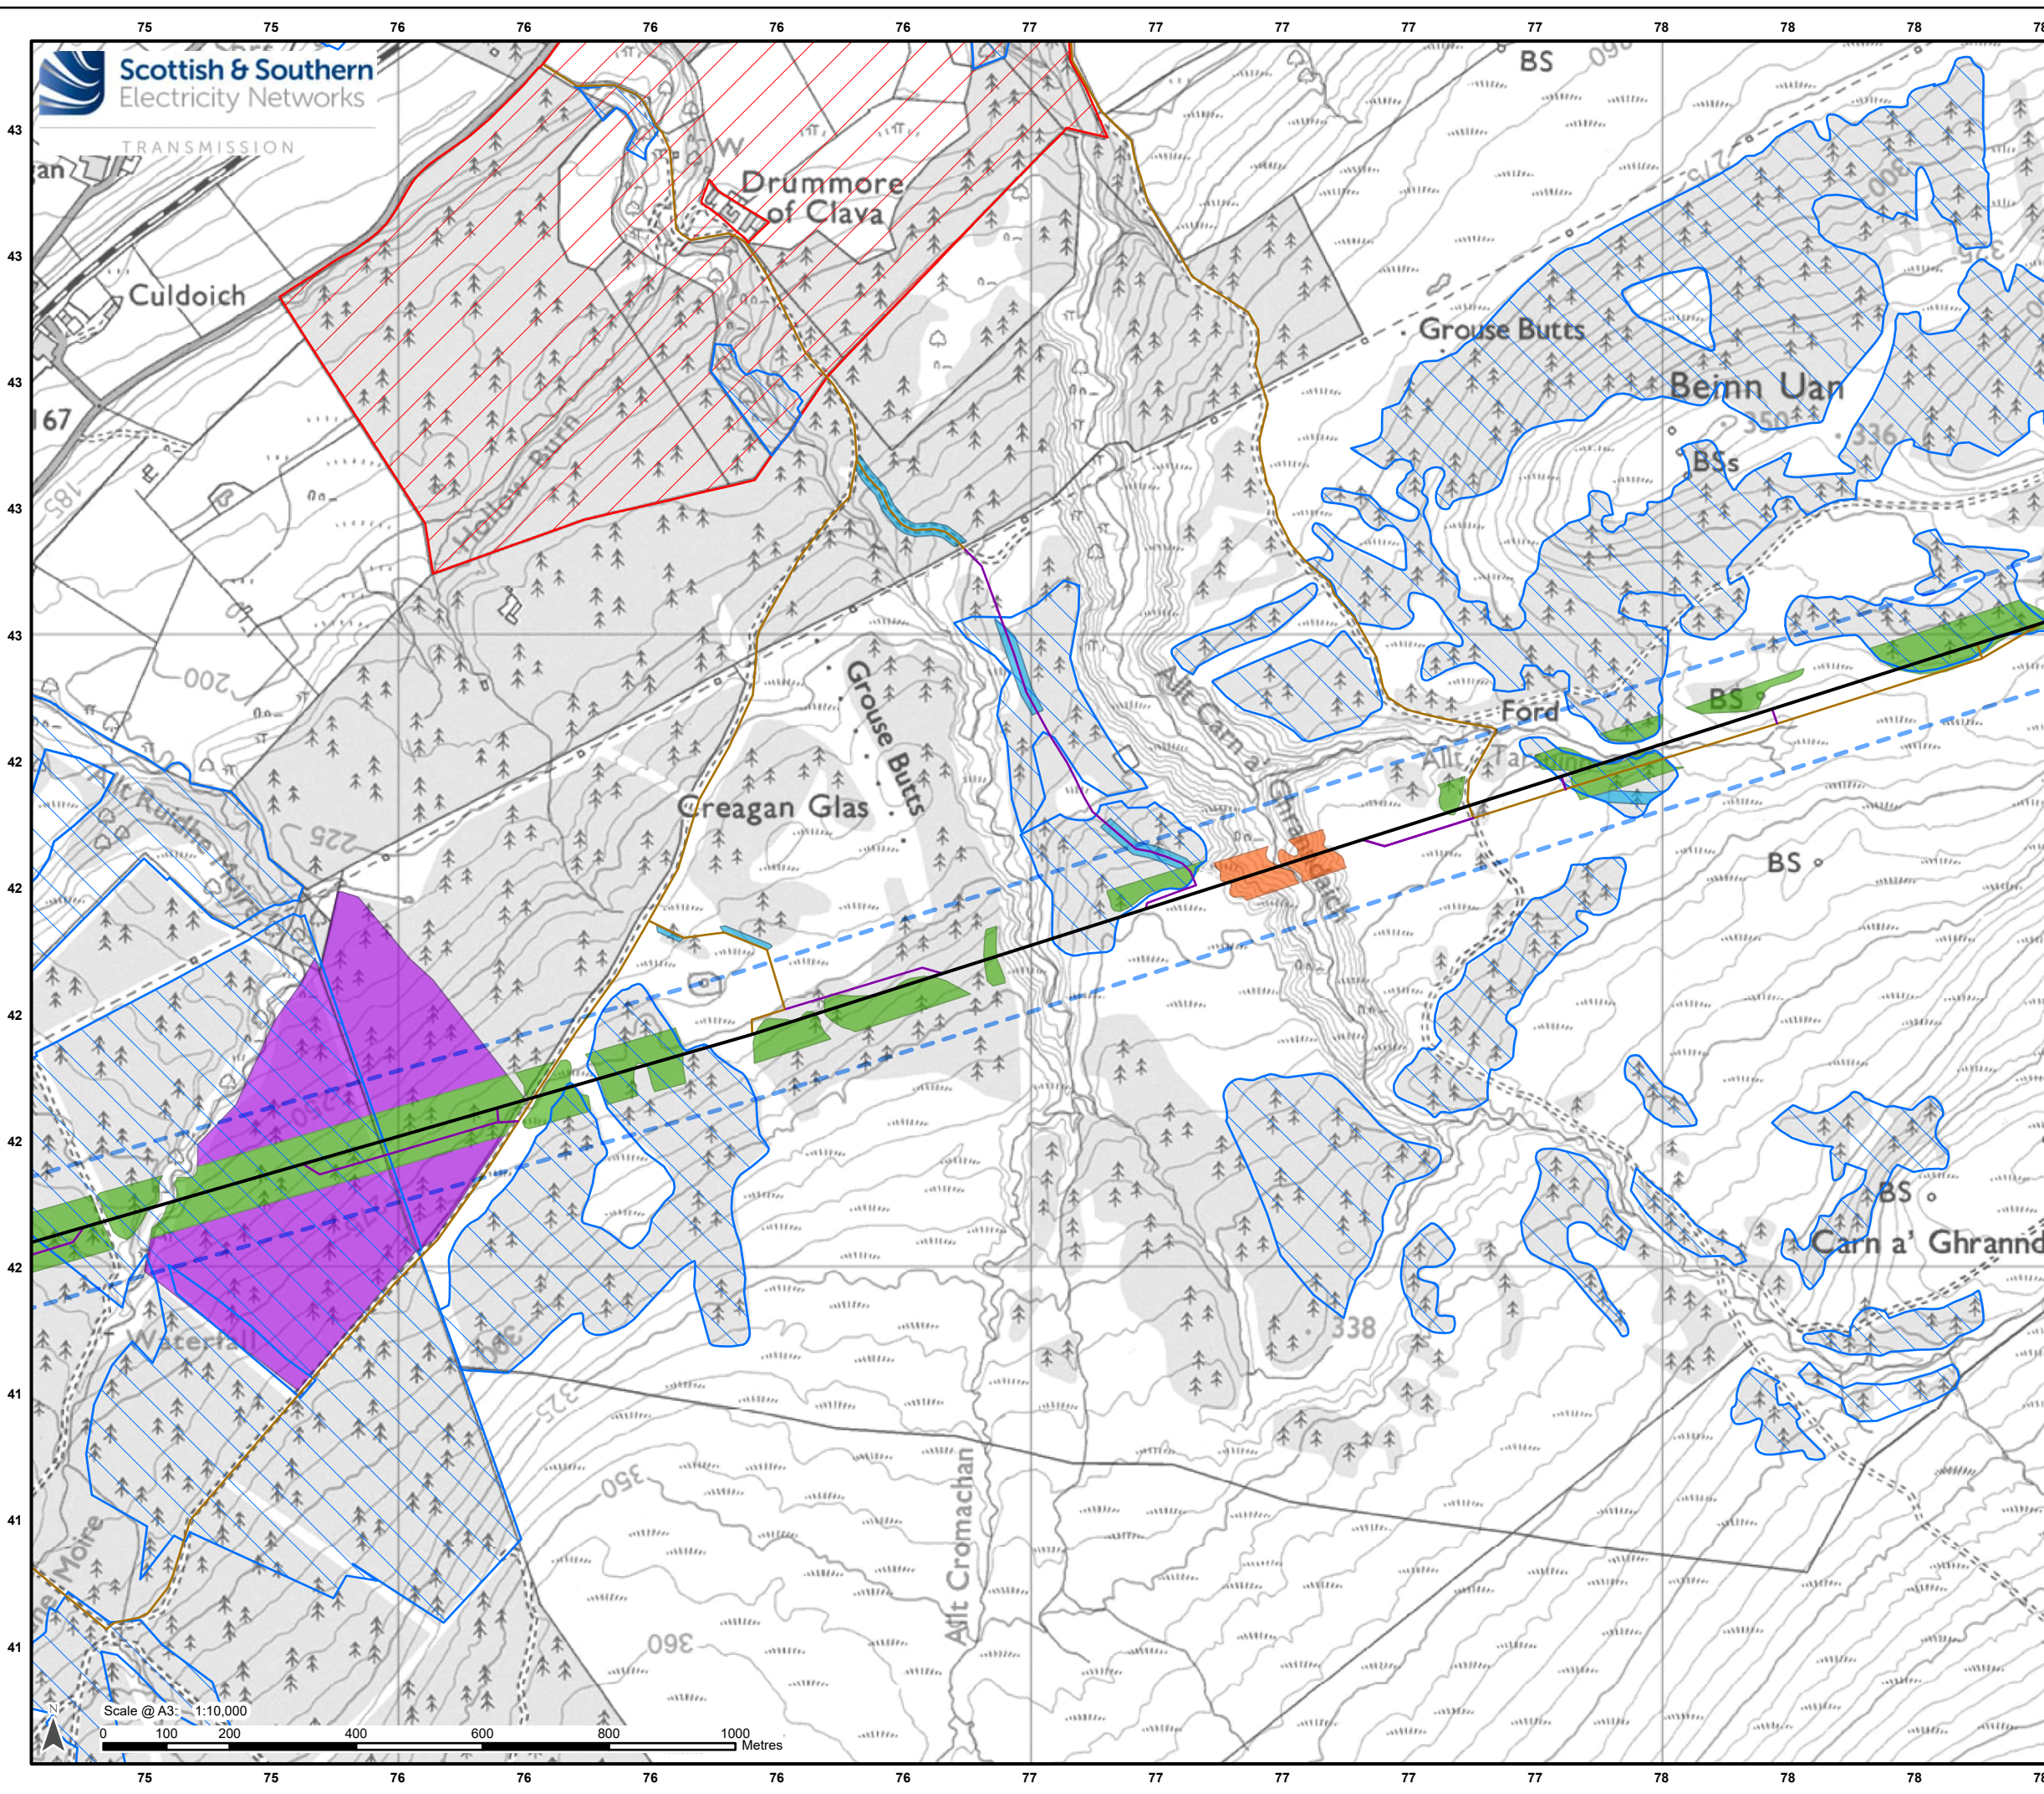

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Proposed Operational Corridor Crown Reduction

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Environmental Constraints

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin


Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 9 of 45		
Drawn by:	MAL	Date:	20/08/2025
Drawing:	B2P-WSP-DA-70092380-185		

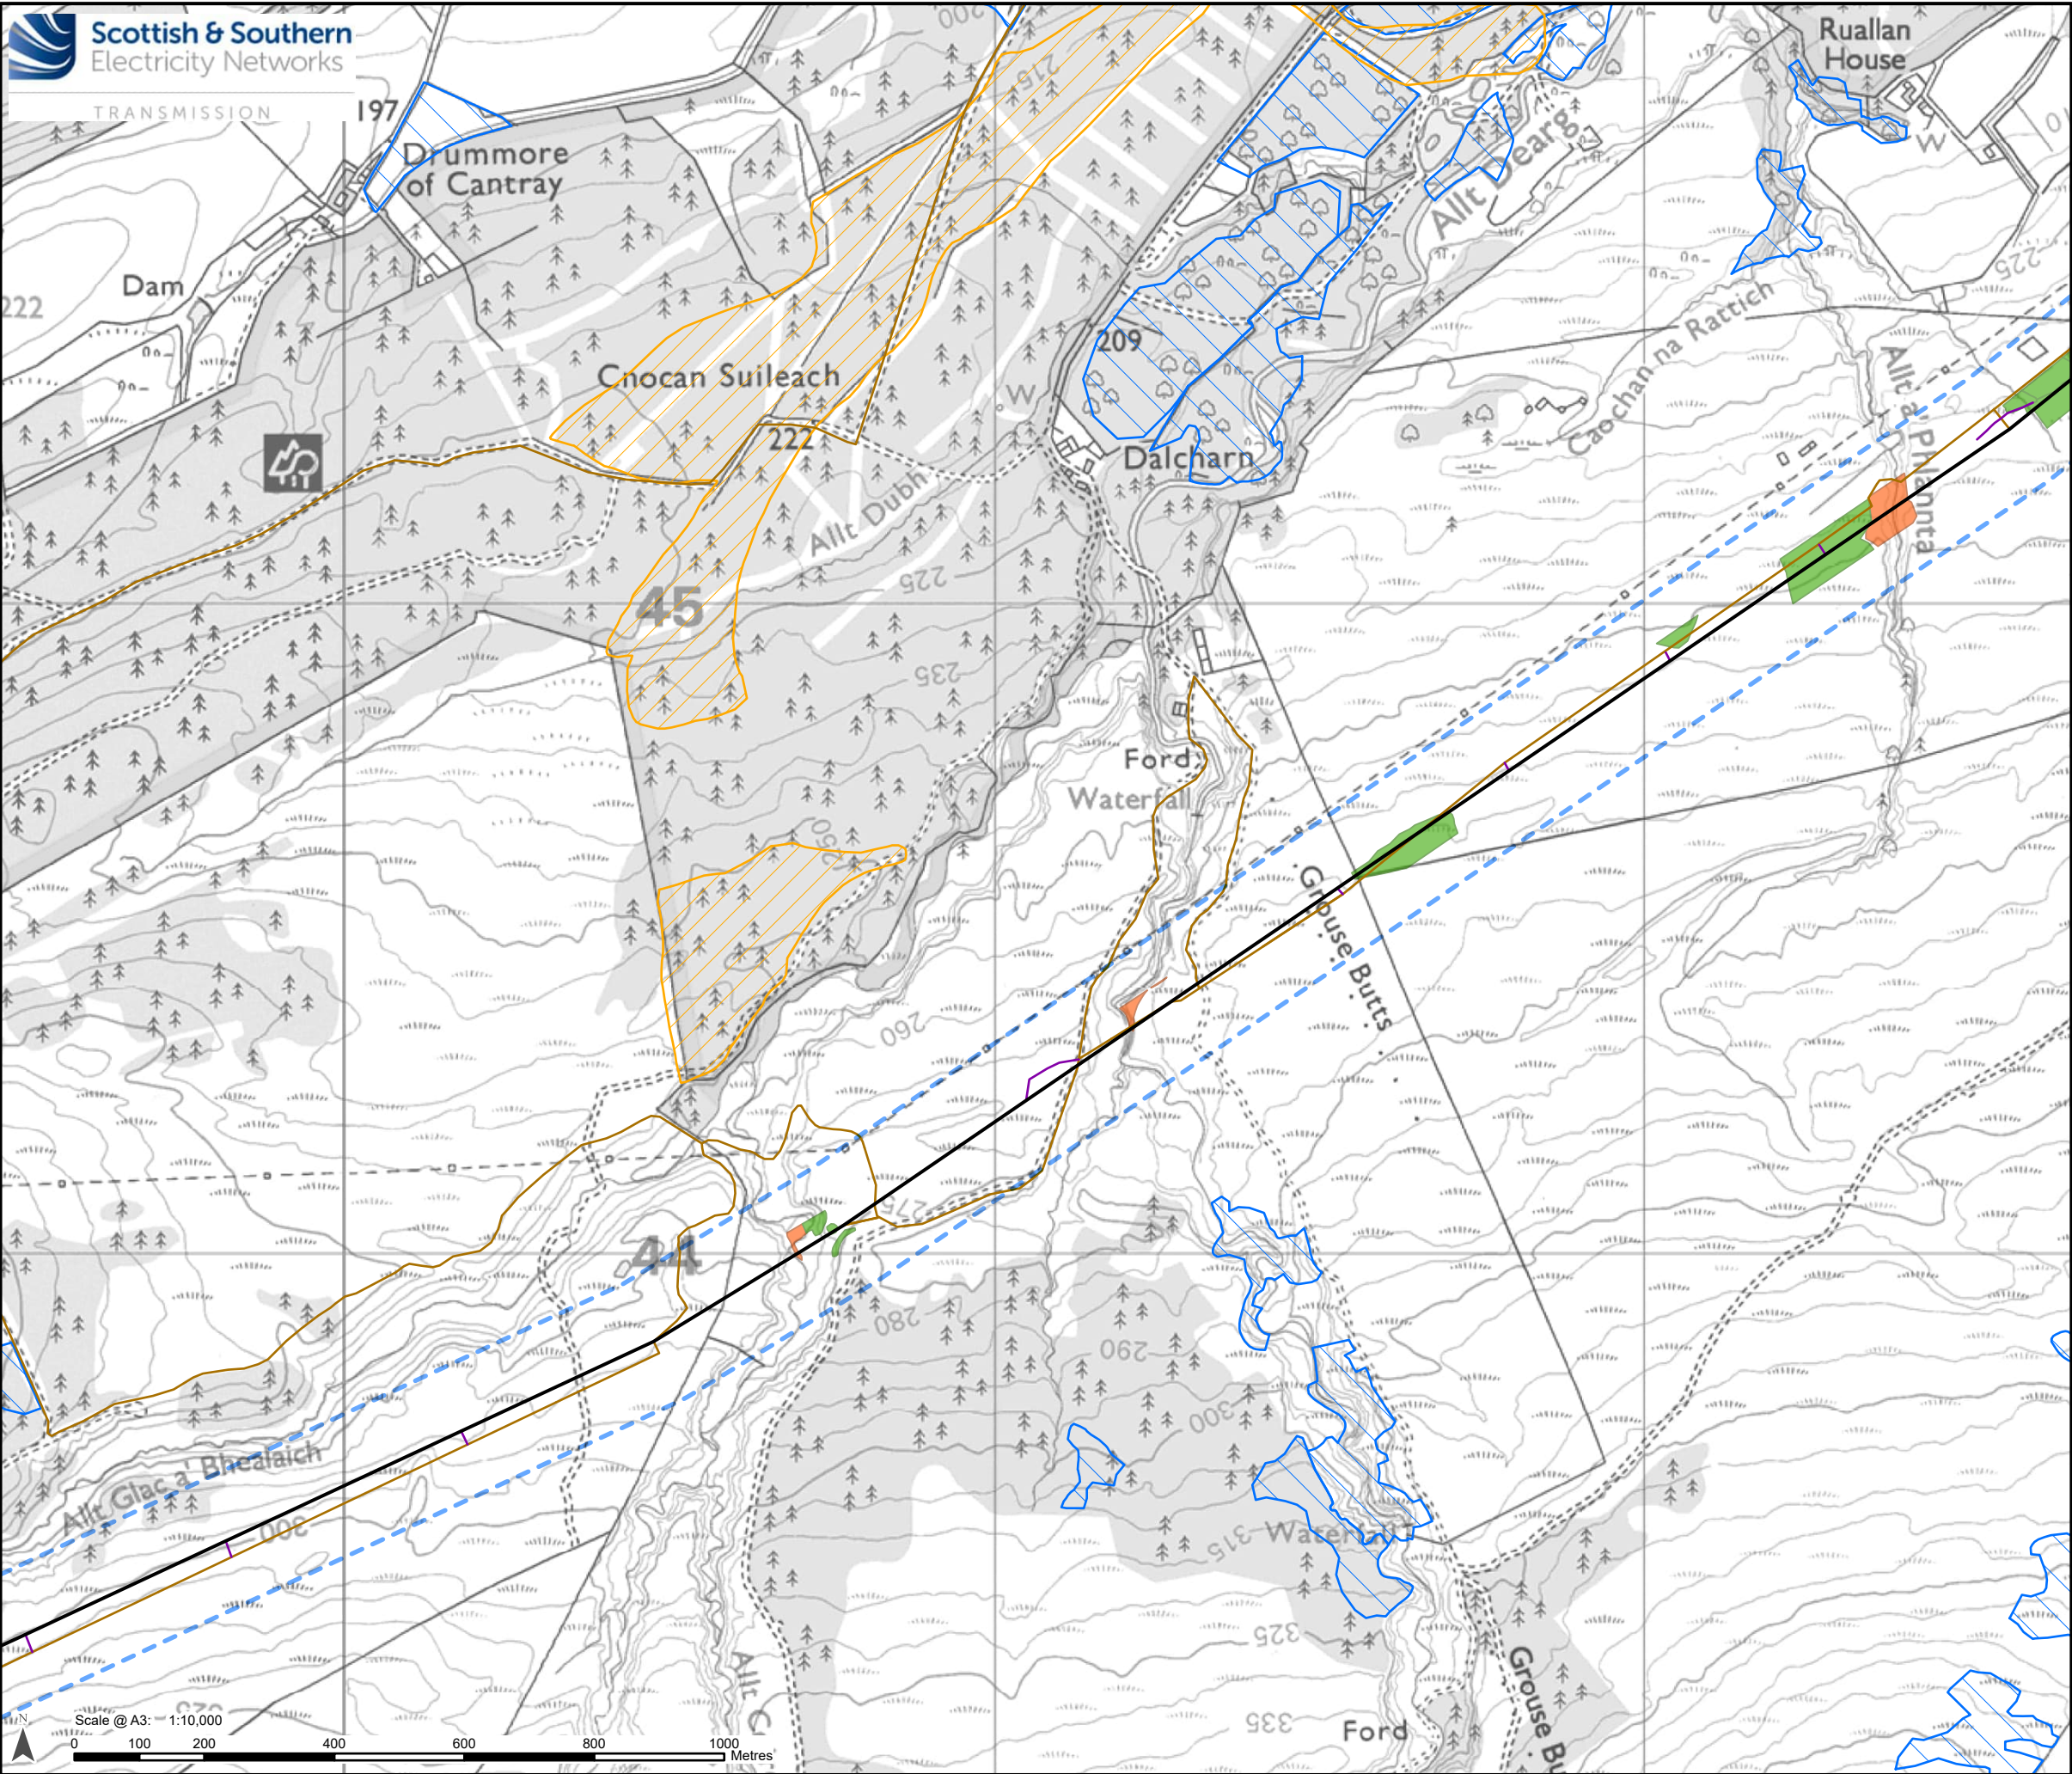

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Proposed Operational Corridor Crown Reduction

Proposed Operational Corridor Felling

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

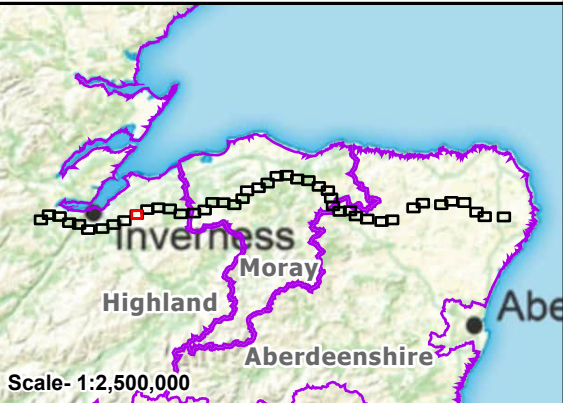

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 10 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185