


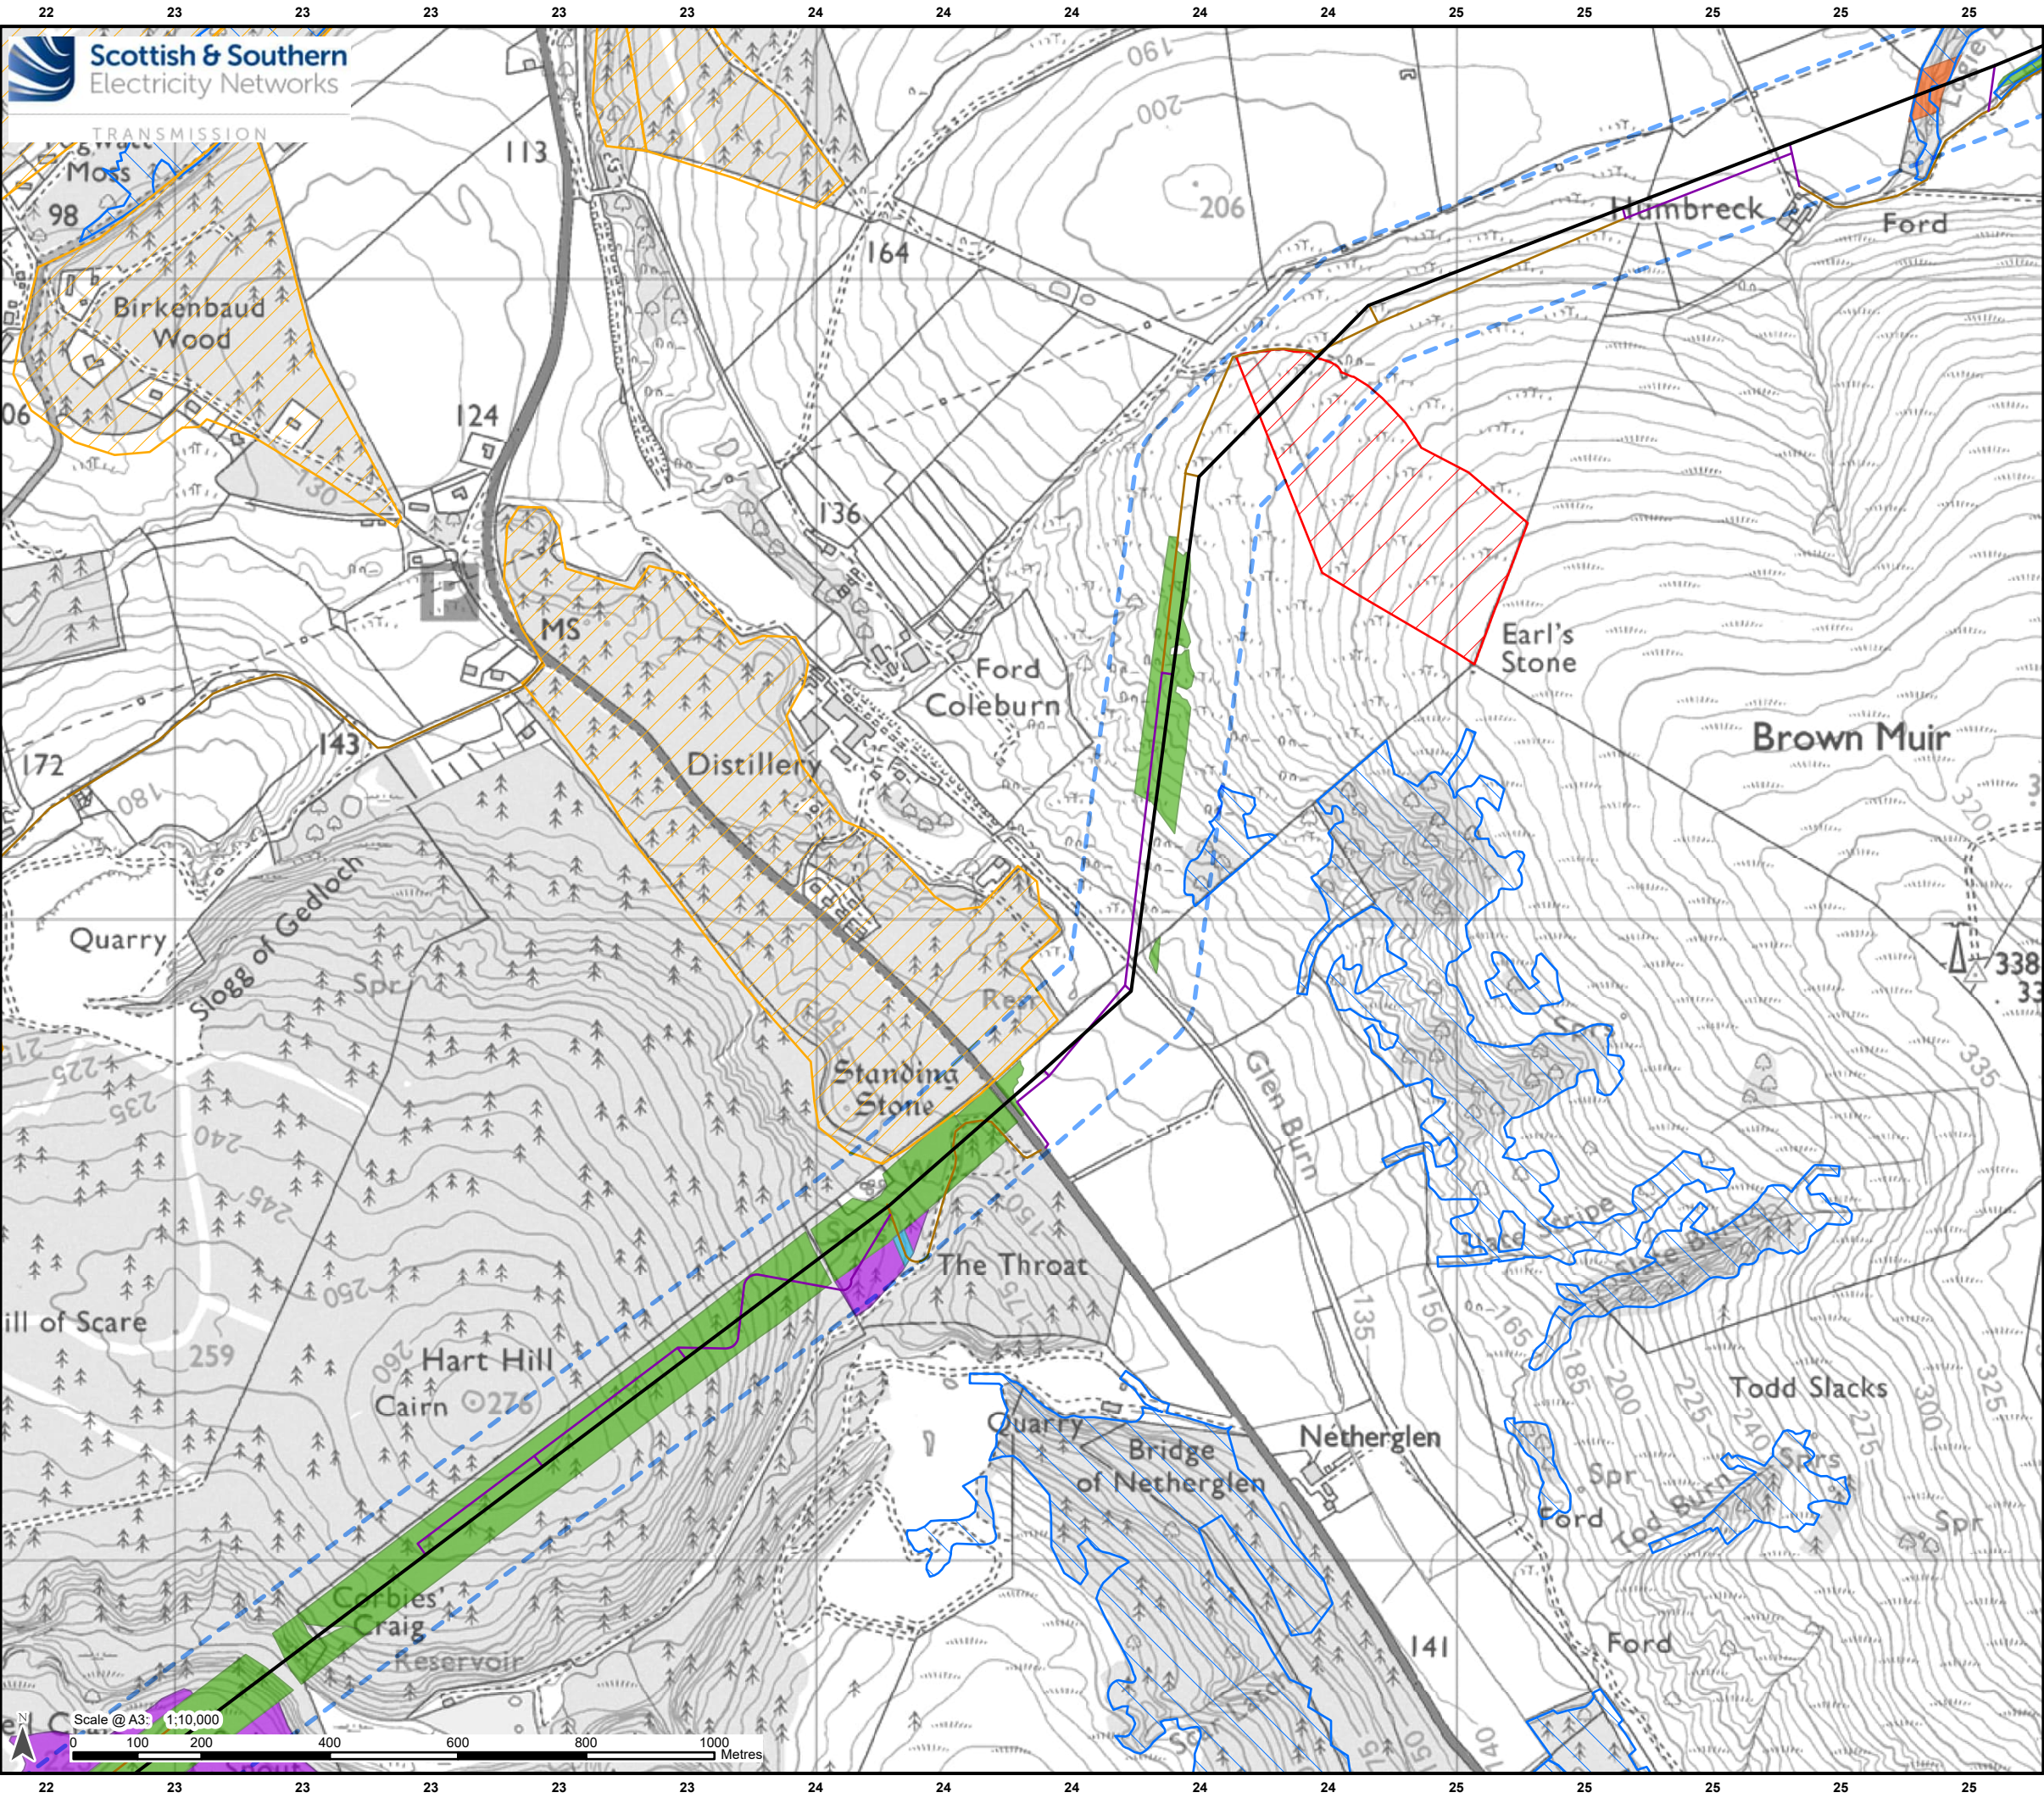

Legend


- Limit of Deviation – Proposed Towers and OHL Alignment*
- Proposed OHL Alignment - 400 kV
- Ancillary Development**
 - Access Track – Permanent
 - Access Track – Temporary and ATV
- Proposed Felling**
 - Proposed Operational Corridor Crown Reduction
 - Management Felling Outwith Access Tracks and Operational Corridor
 - Proposed Operational Corridor Felling
 - Proposed Access Track Felling
- Environmental Constraints**
 - Site of Special Scientific Interest
 - Native Woodland Survey of Scotland
 - Ancient Woodland of Semi-Natural Origin
 - Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 23 of 45		
Drawn by:	MAL	Date:	20/08/2025
Drawing:	B2P-WSP-DA-70092380-185		

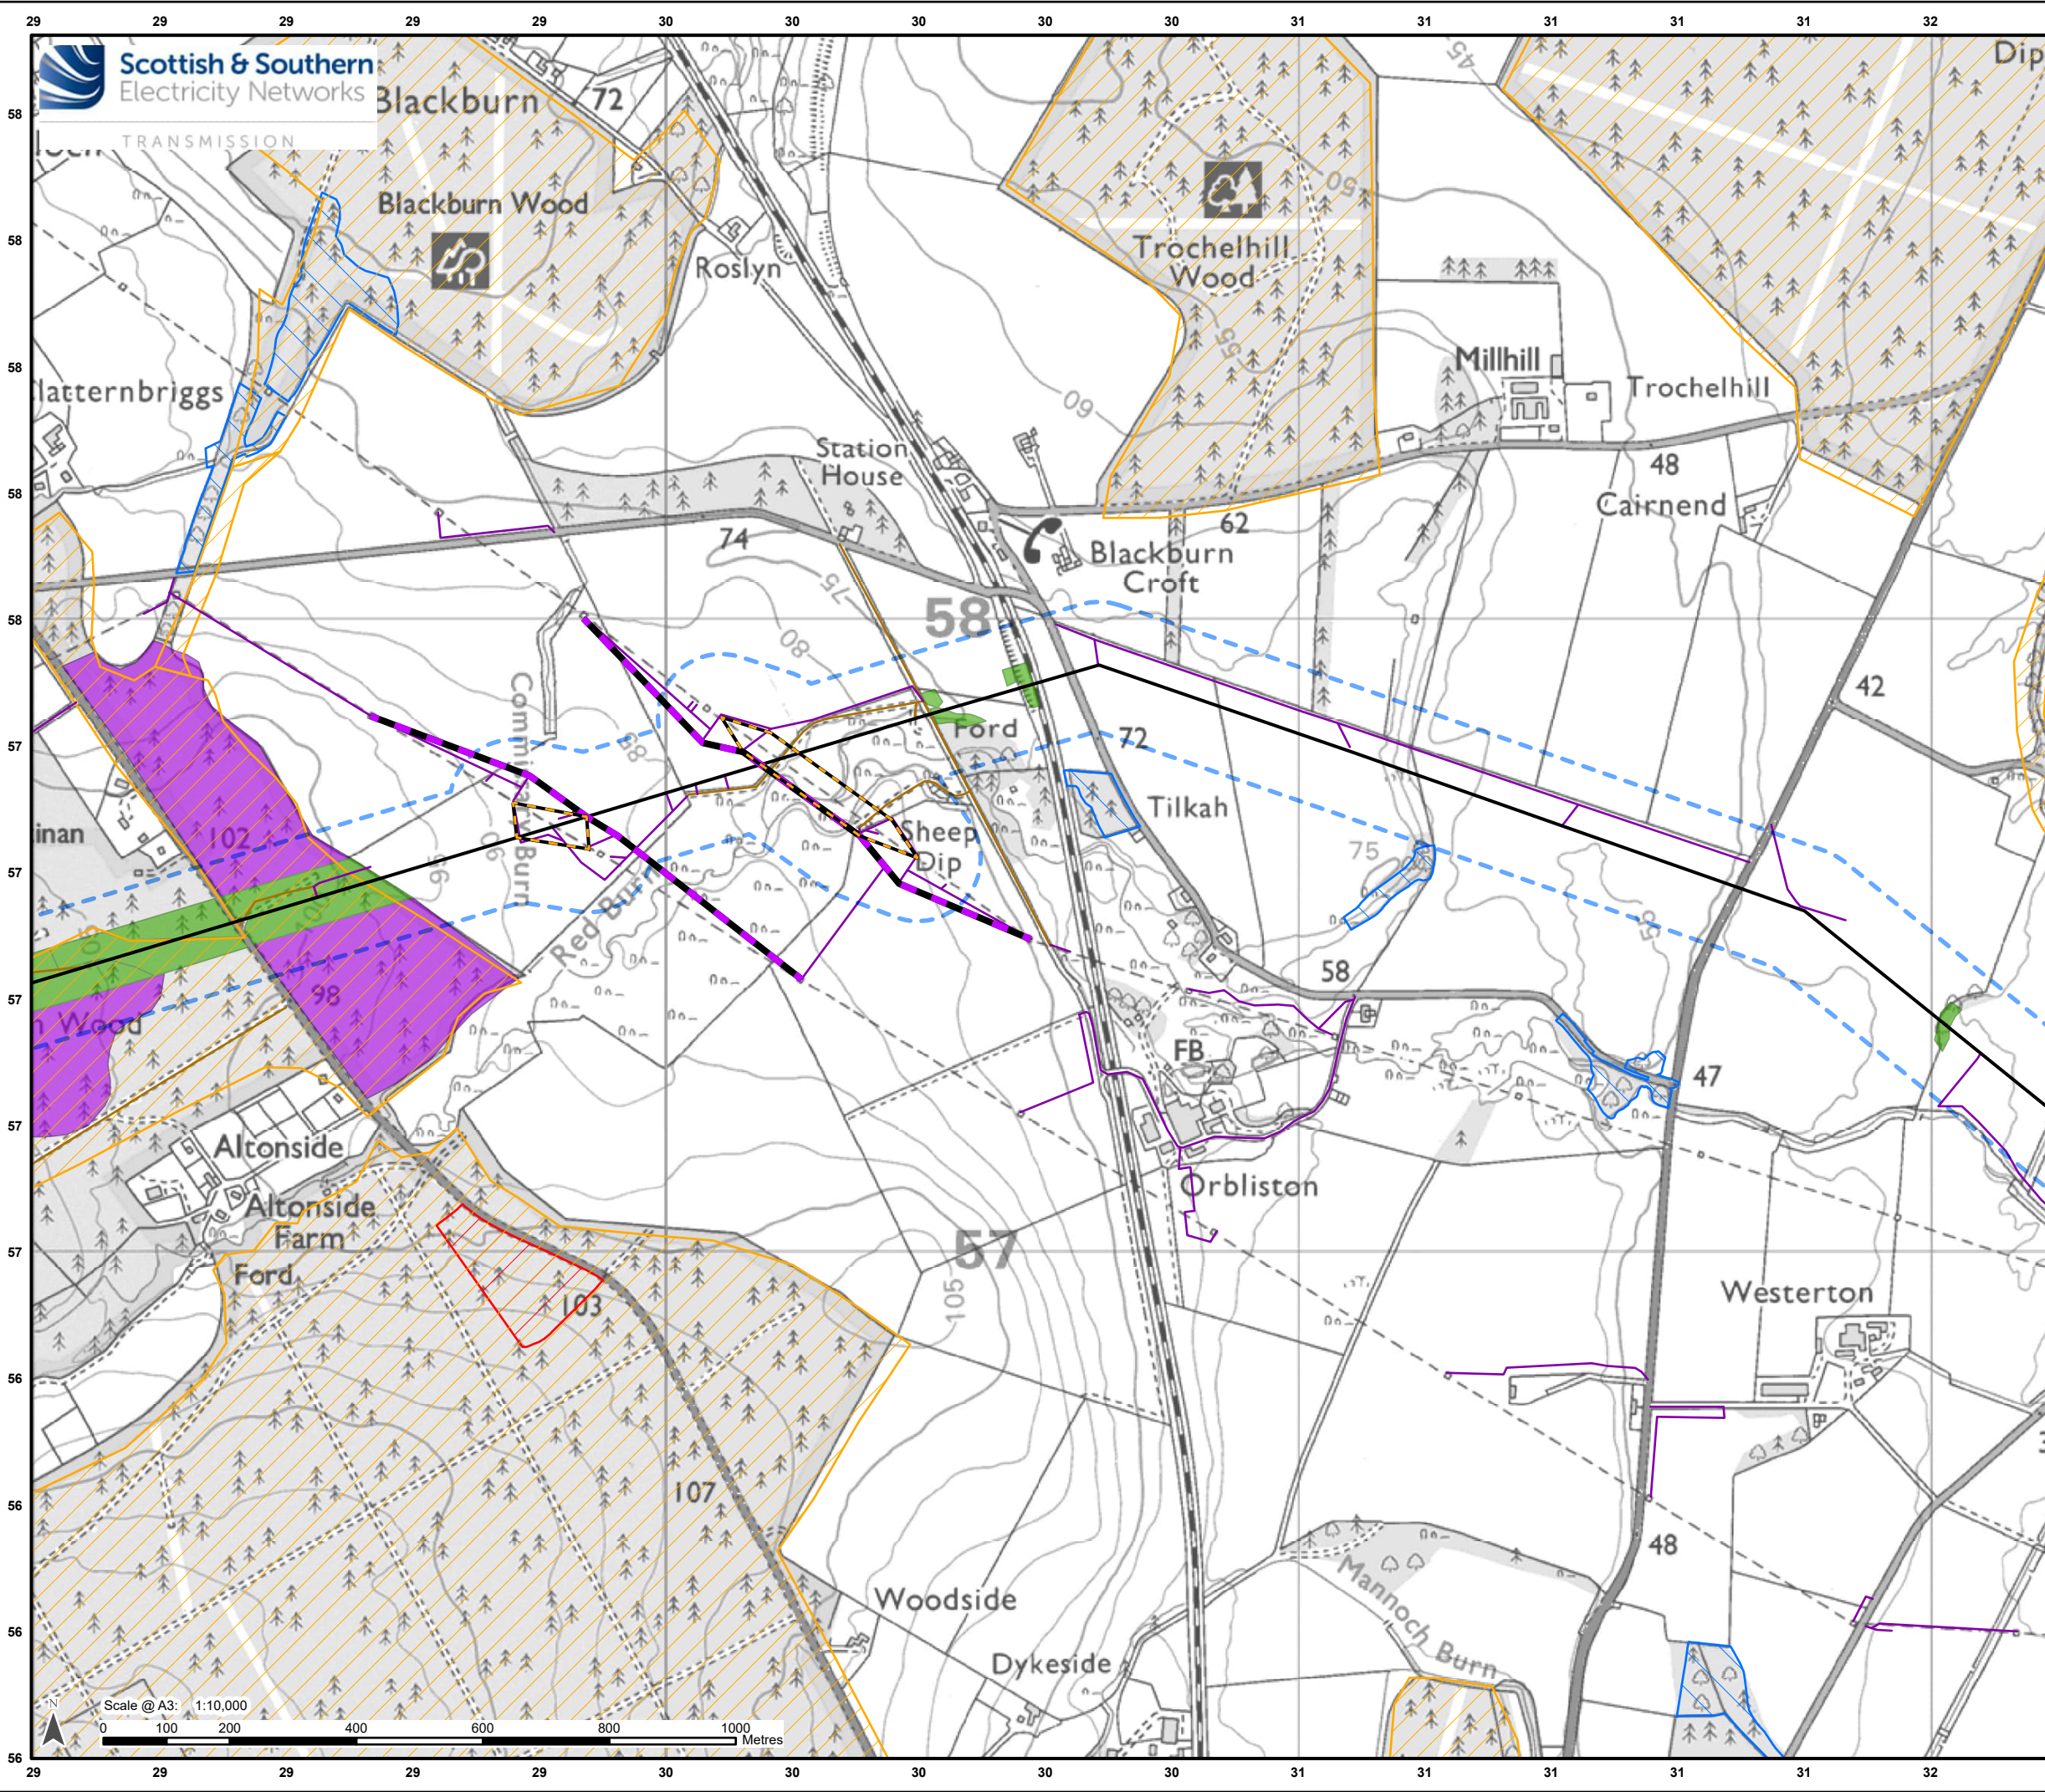

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV

Proposed Felling

- Management Felling Outwith Access Tracks and Operational Corridor
- Proposed Operational Corridor Felling

Environmental Constraints

- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.




Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 25 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

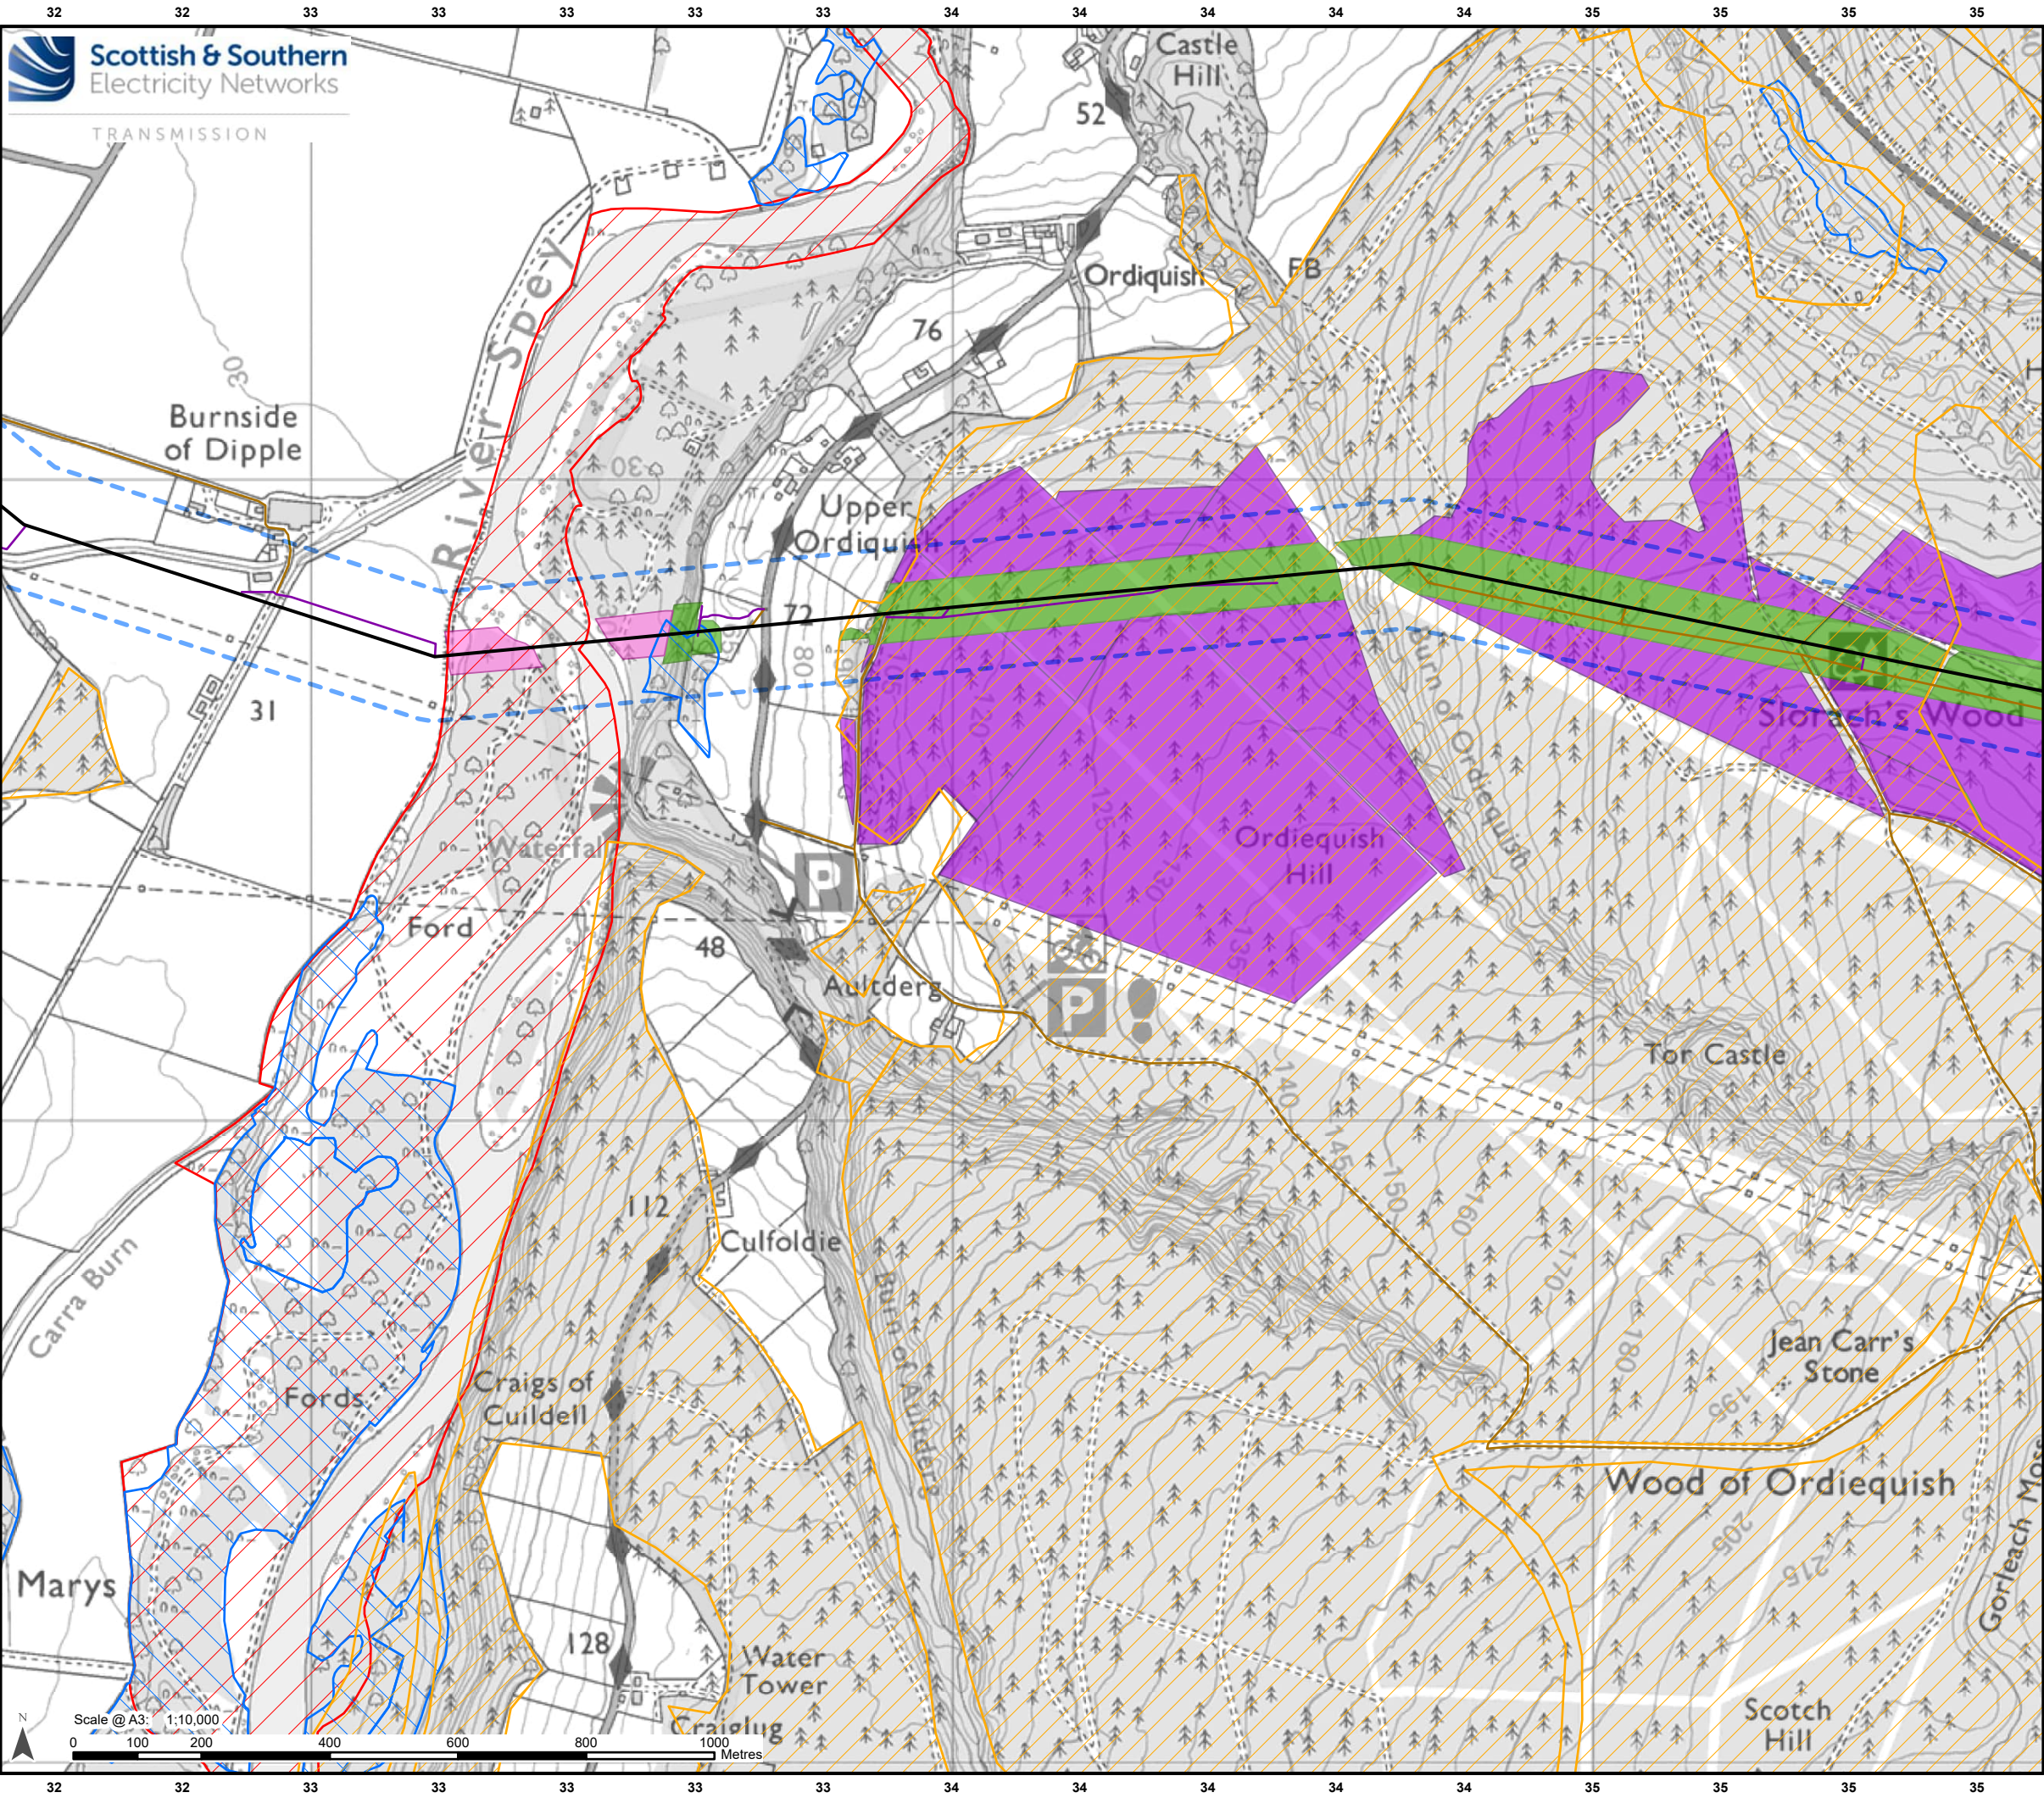

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Selective Felling Outwith Access Tracks and Operational Corridor

Environmental Constraints

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.




Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 26 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

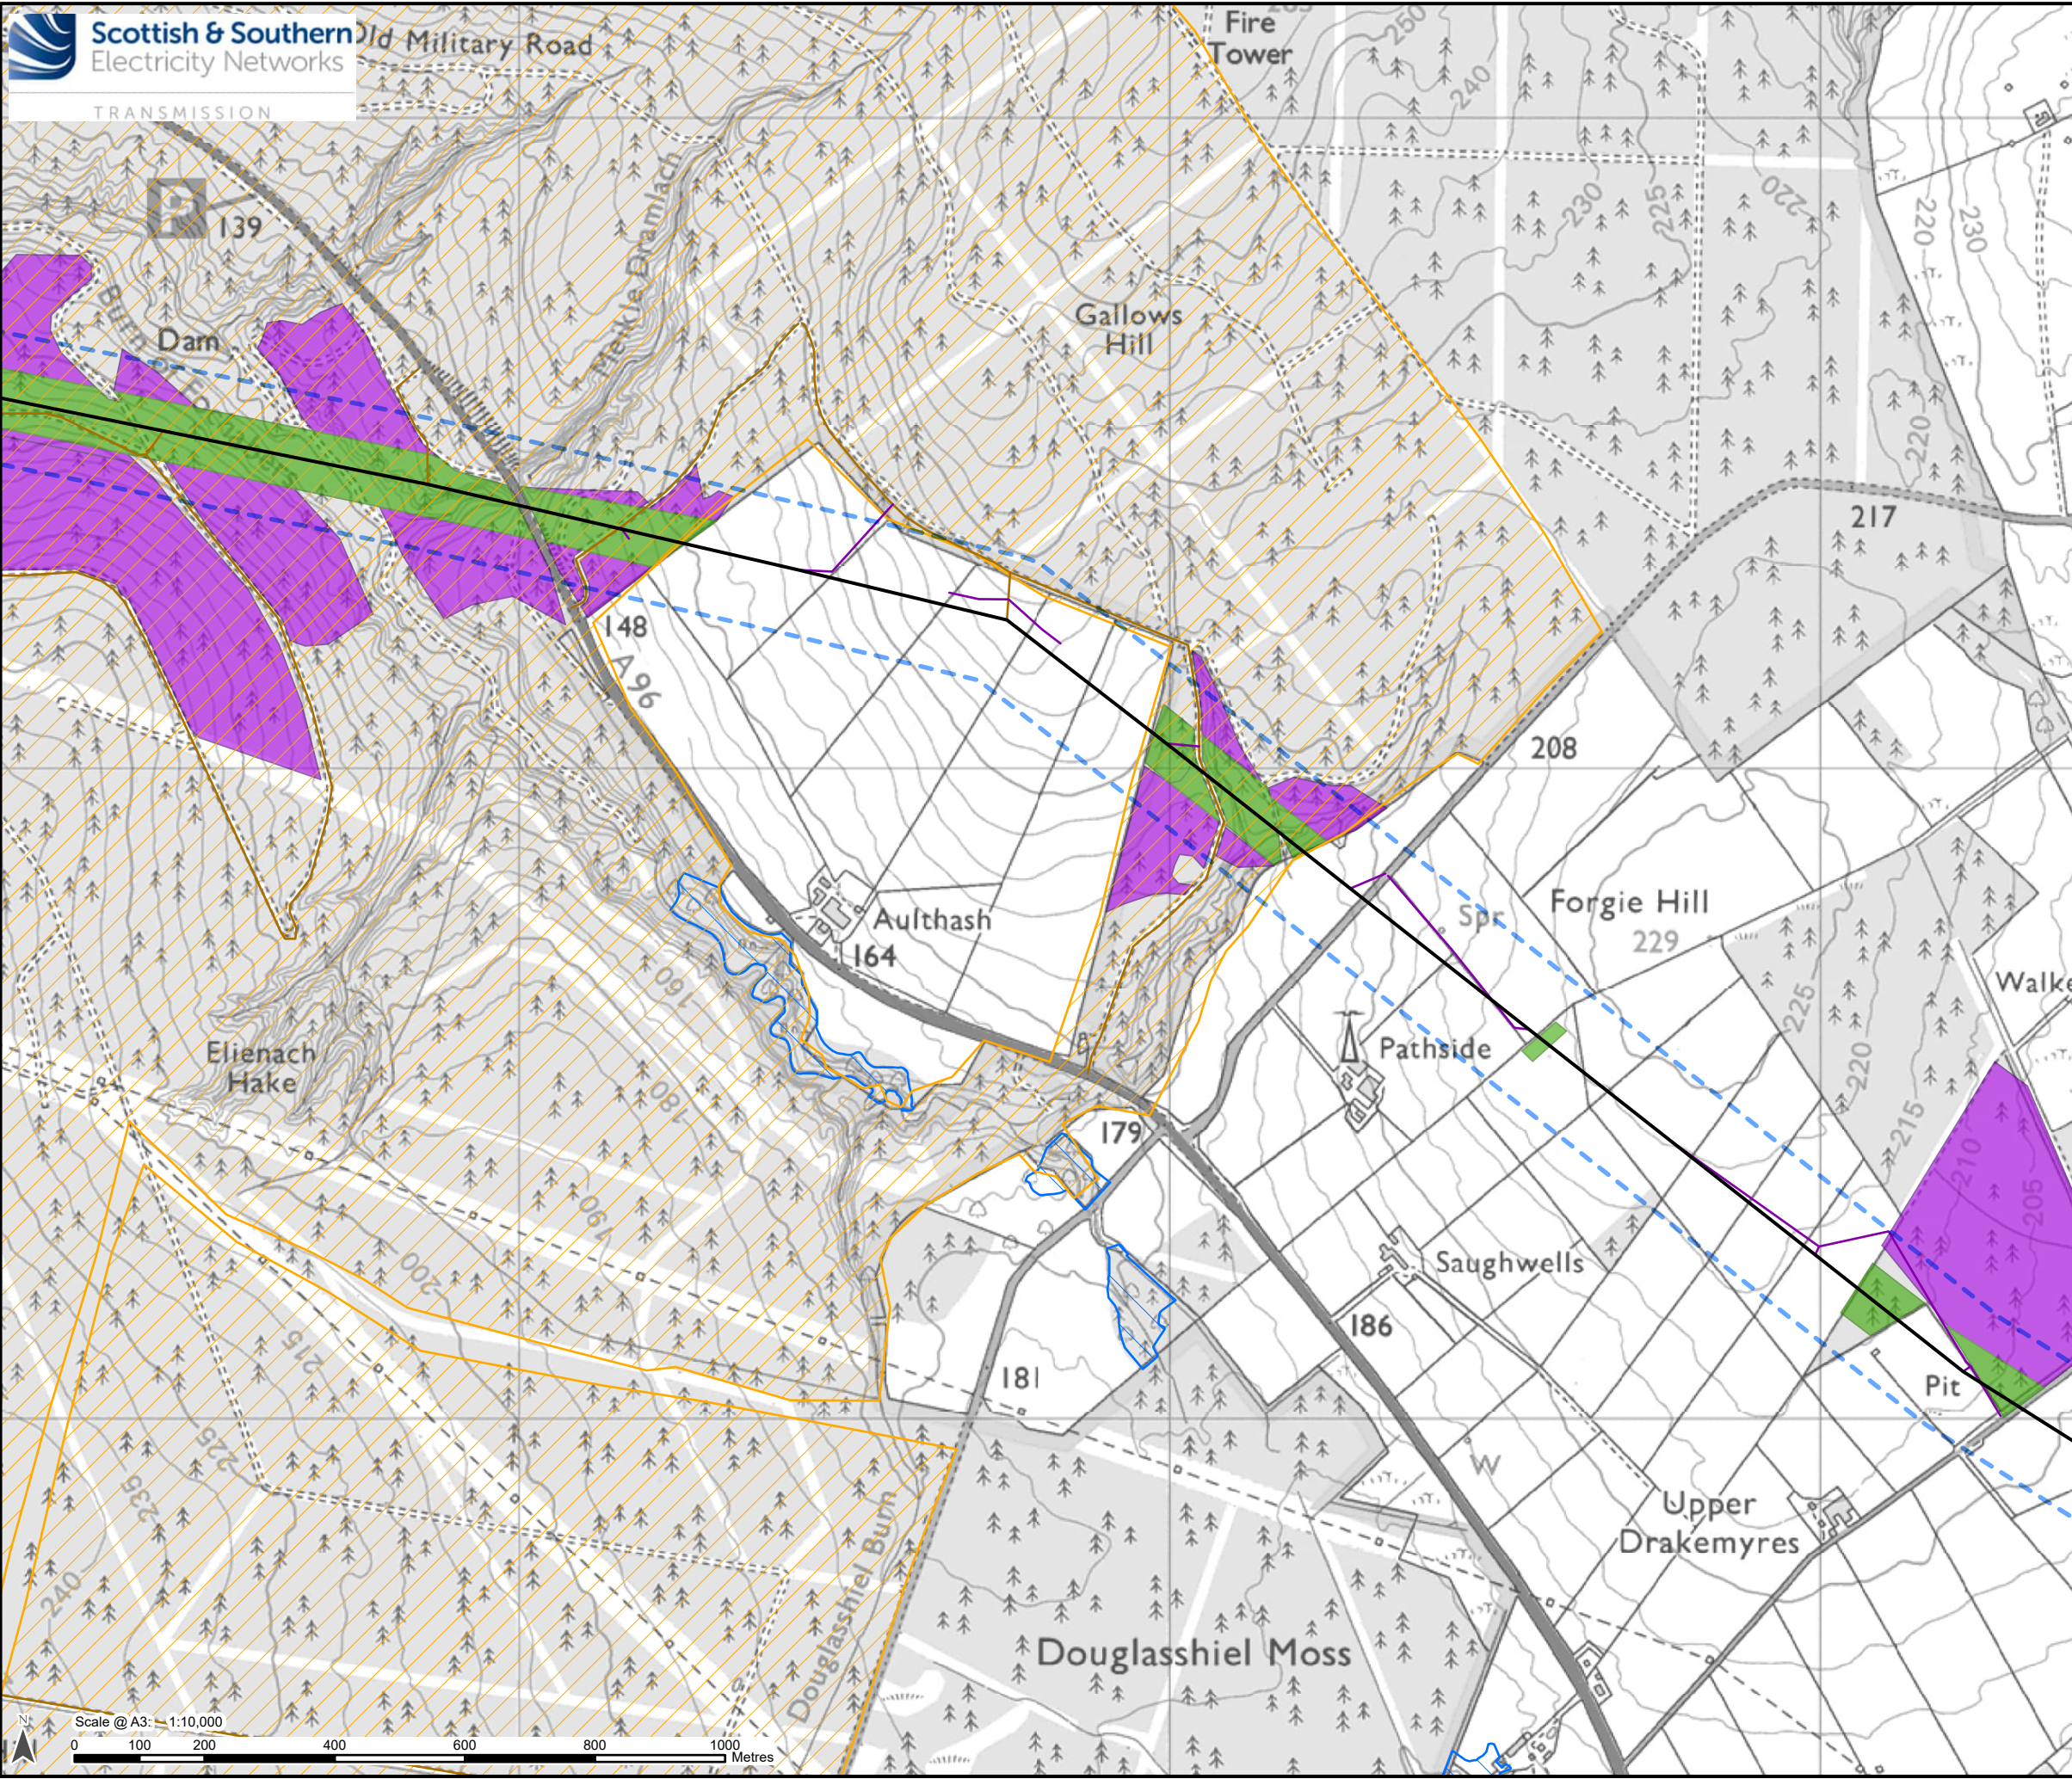

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

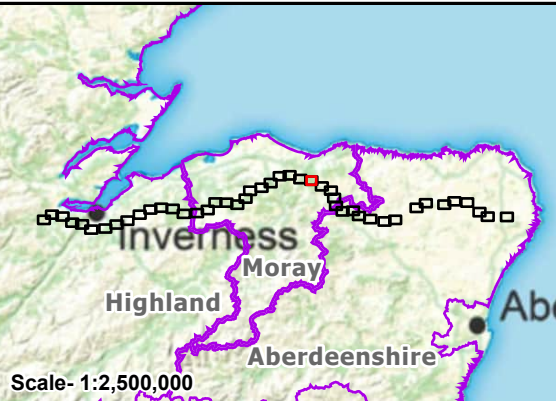

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 27 of 45

Drawn by: MAL

Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

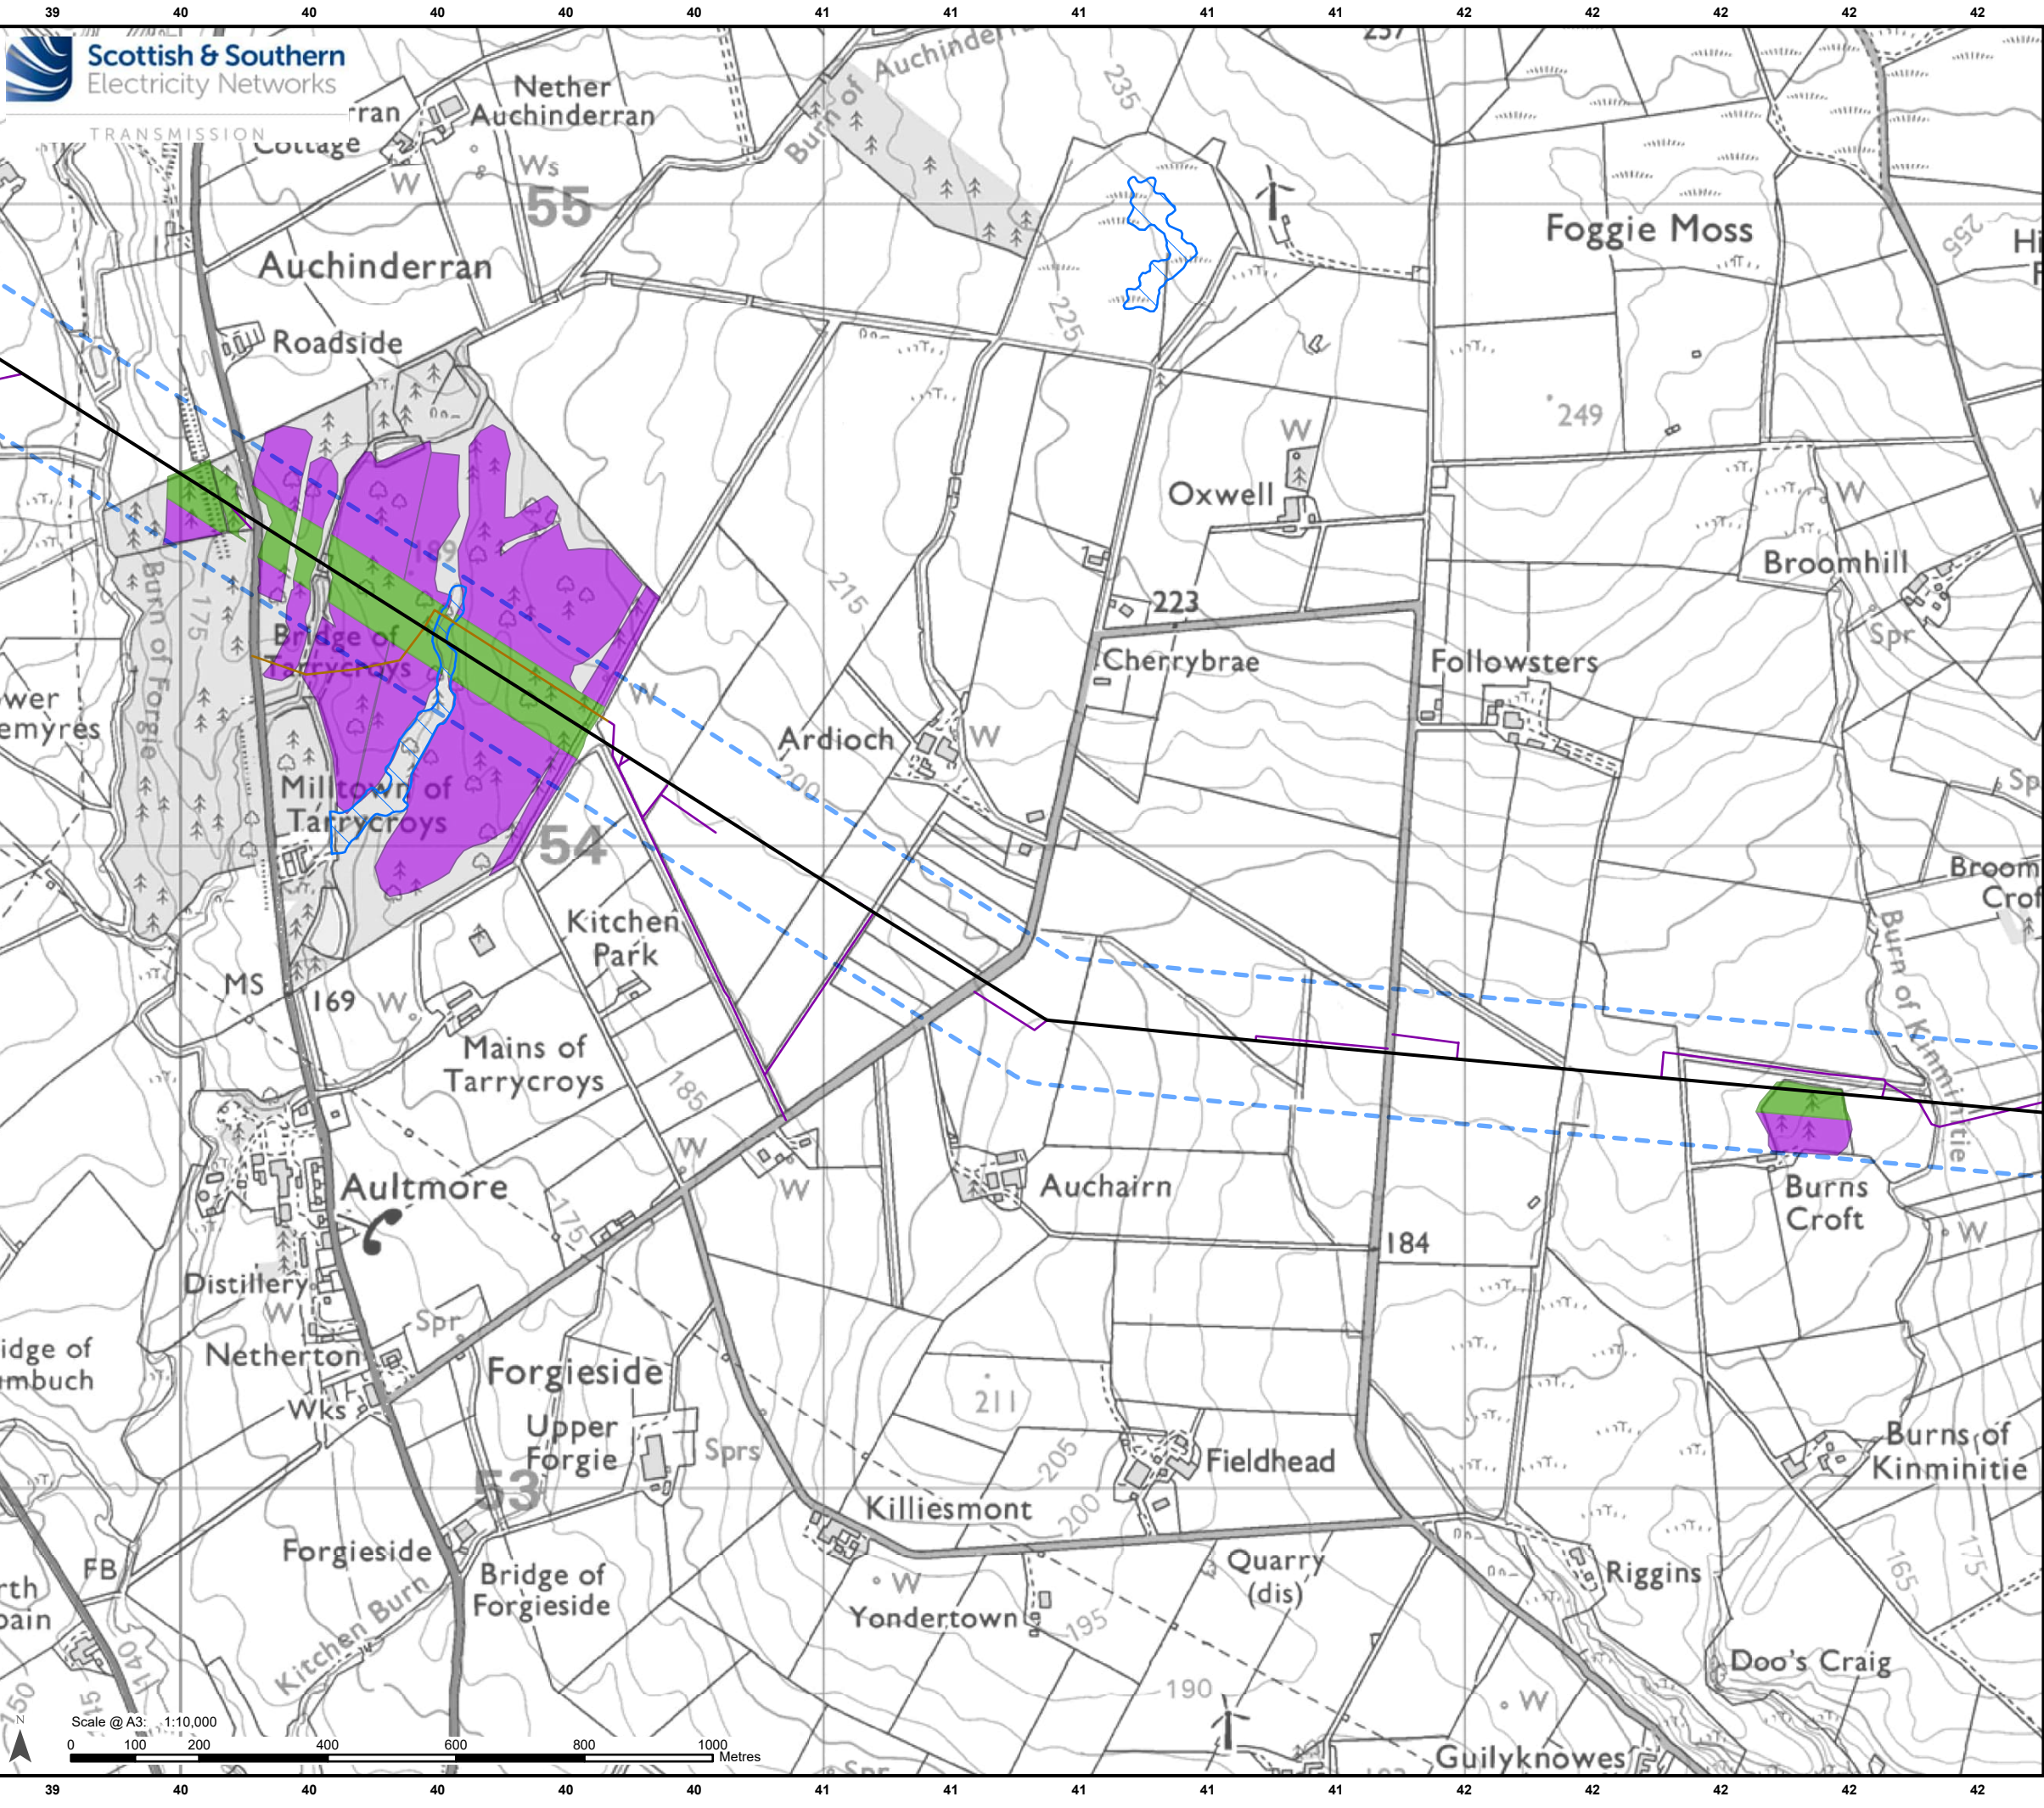

- Legend**
- Limit of Deviation – Proposed Towers and OHL Alignment*

Proposed OHL Alignment - 400 kV

Access Track – Permanent

Access Track – Temporary and ATV

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin
- Development for which Section 37 Consent is Sought**

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Environmental Constraints

Site of Special Scientific Interest

Native Woodland Survey of Scotland


Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project	
Title:	Figure 12.2 - Proposed Felling and Environmental Constraints Page 28 of 45	
Drawn by:	MAL	Date: 20/08/2025
Drawing:	B2P-WSP-DA-70092380-185	

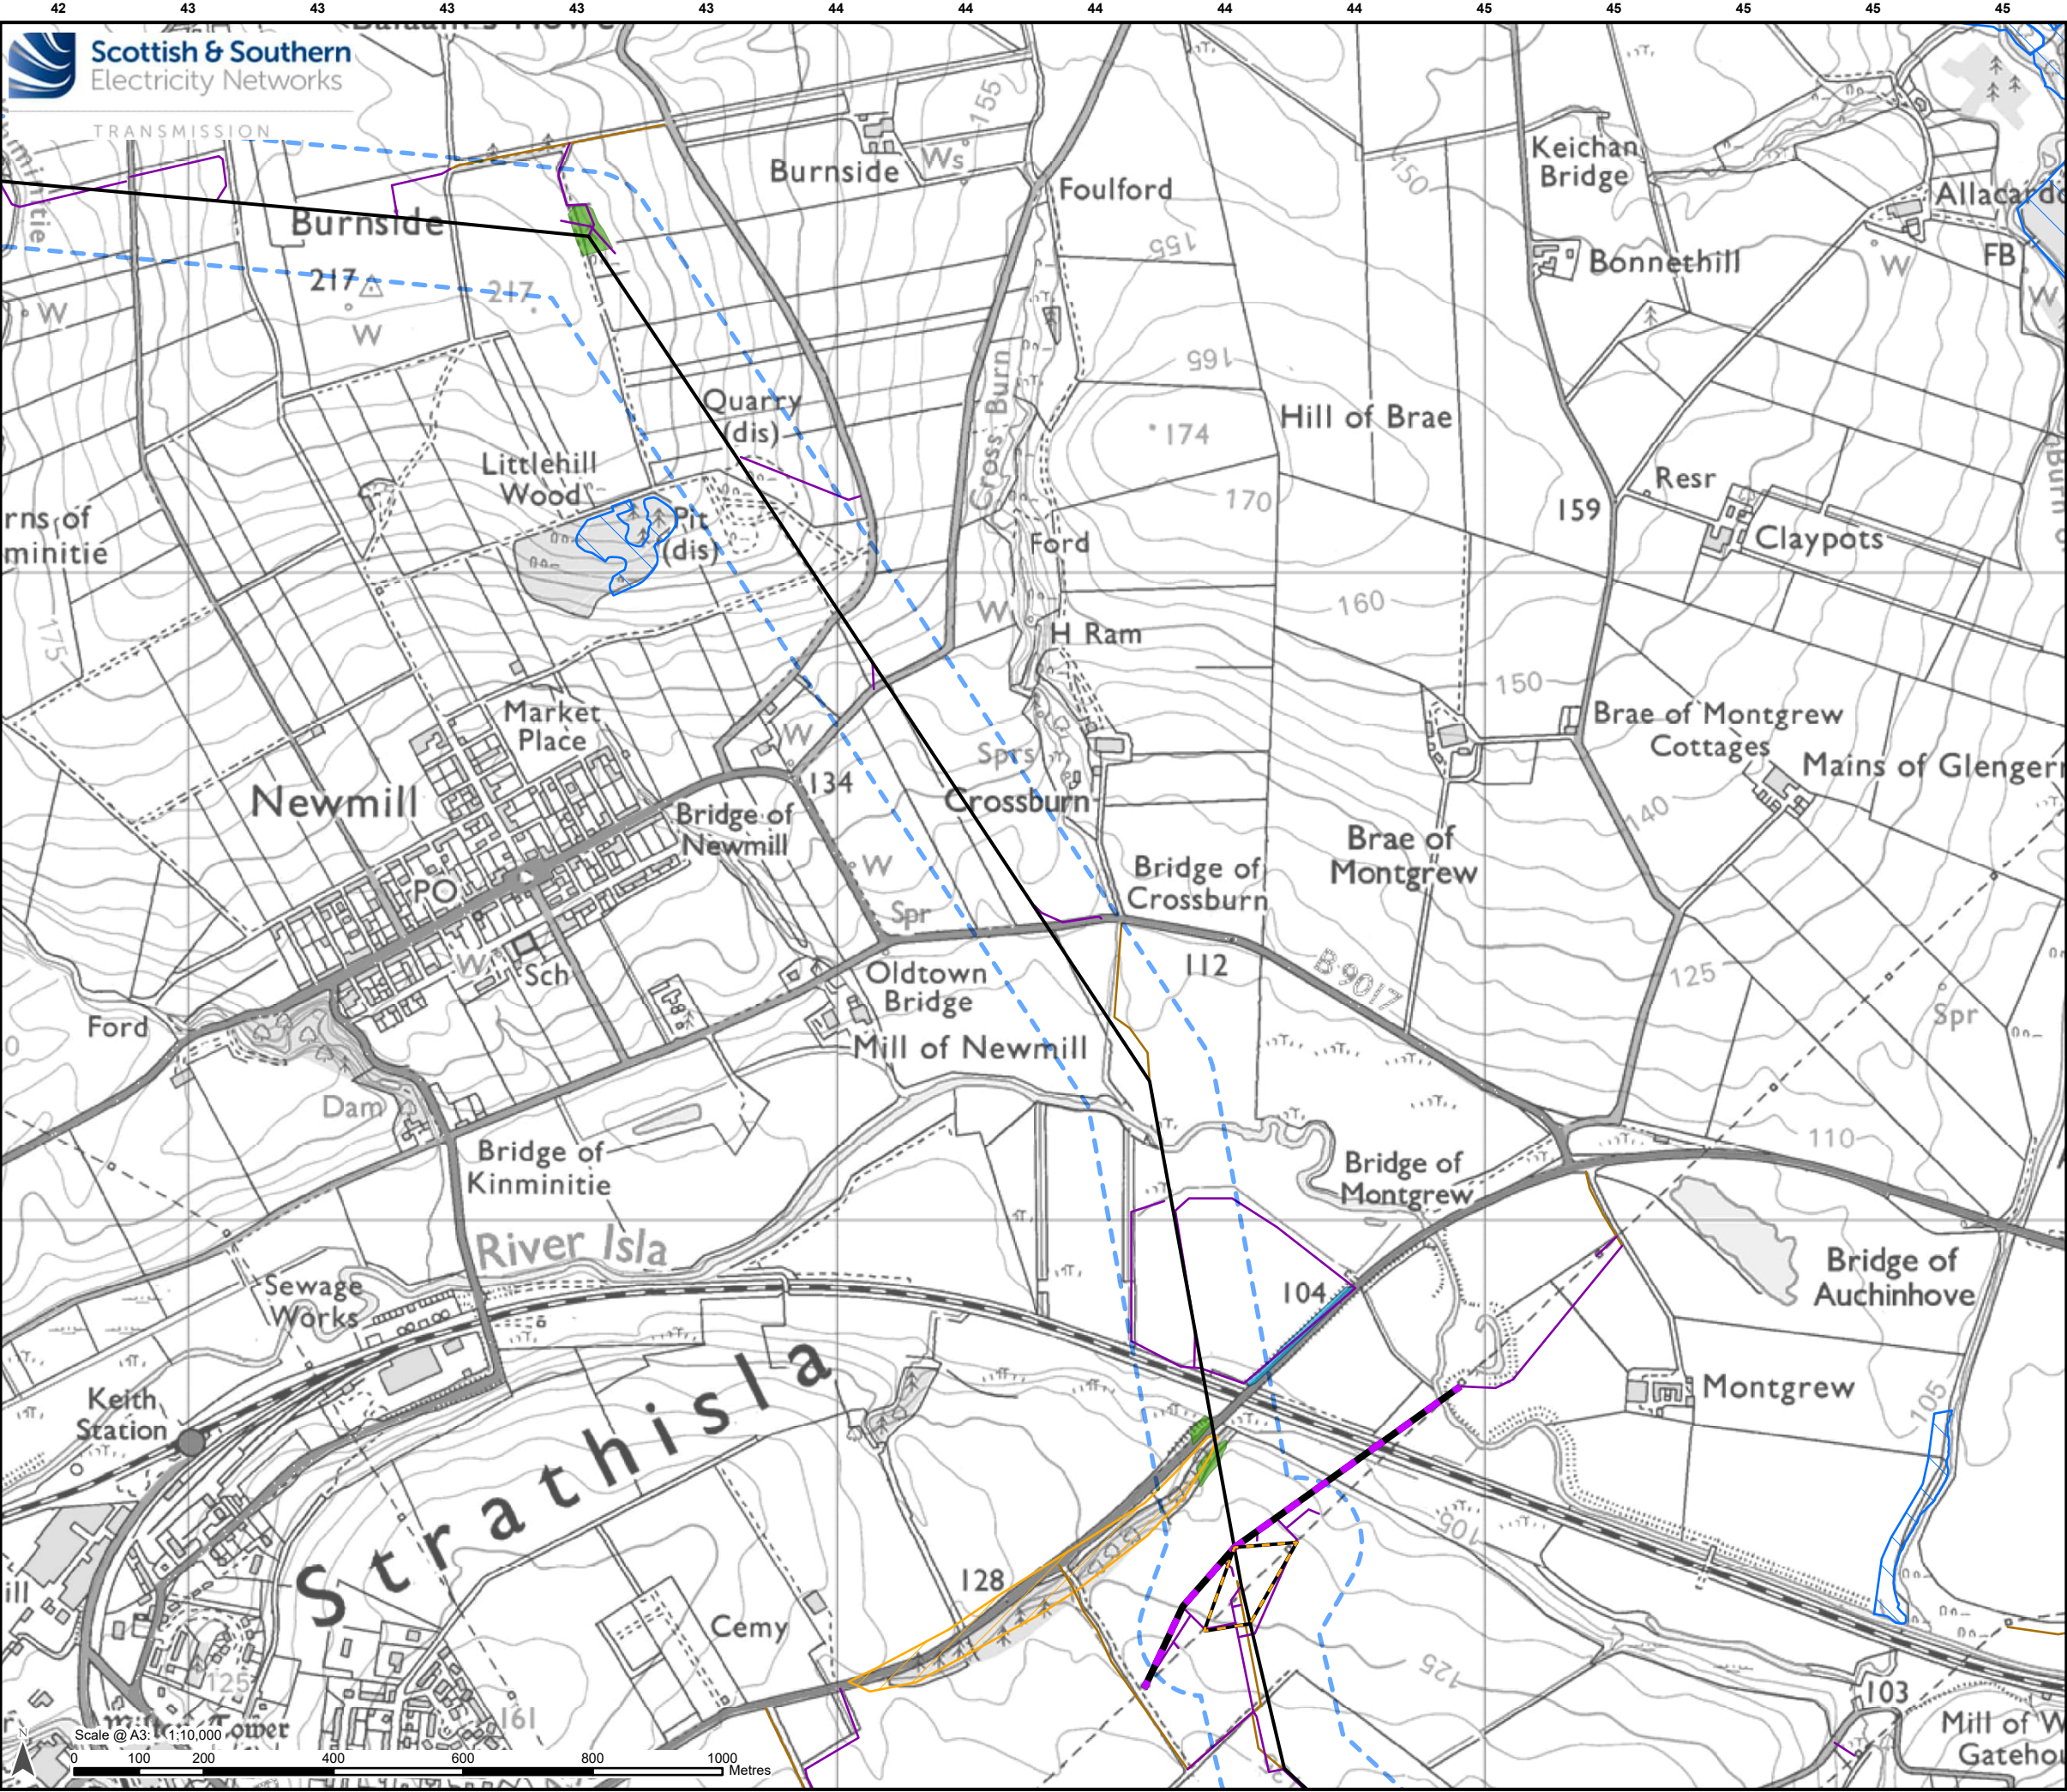

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Proposed OHL Alignment - 400 kV

Temporary OHL Diversion

Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Development for which Section 37 Consent is Sought

Access Track – Permanent

Access Track – Temporary and ATV

Ancillary Development

Proposed Operational Corridor Felling

Proposed Access Track Felling

Proposed Felling

Proposed Operational Corridor Felling

Proposed Access Track Felling

Environmental Constraints

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 29 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

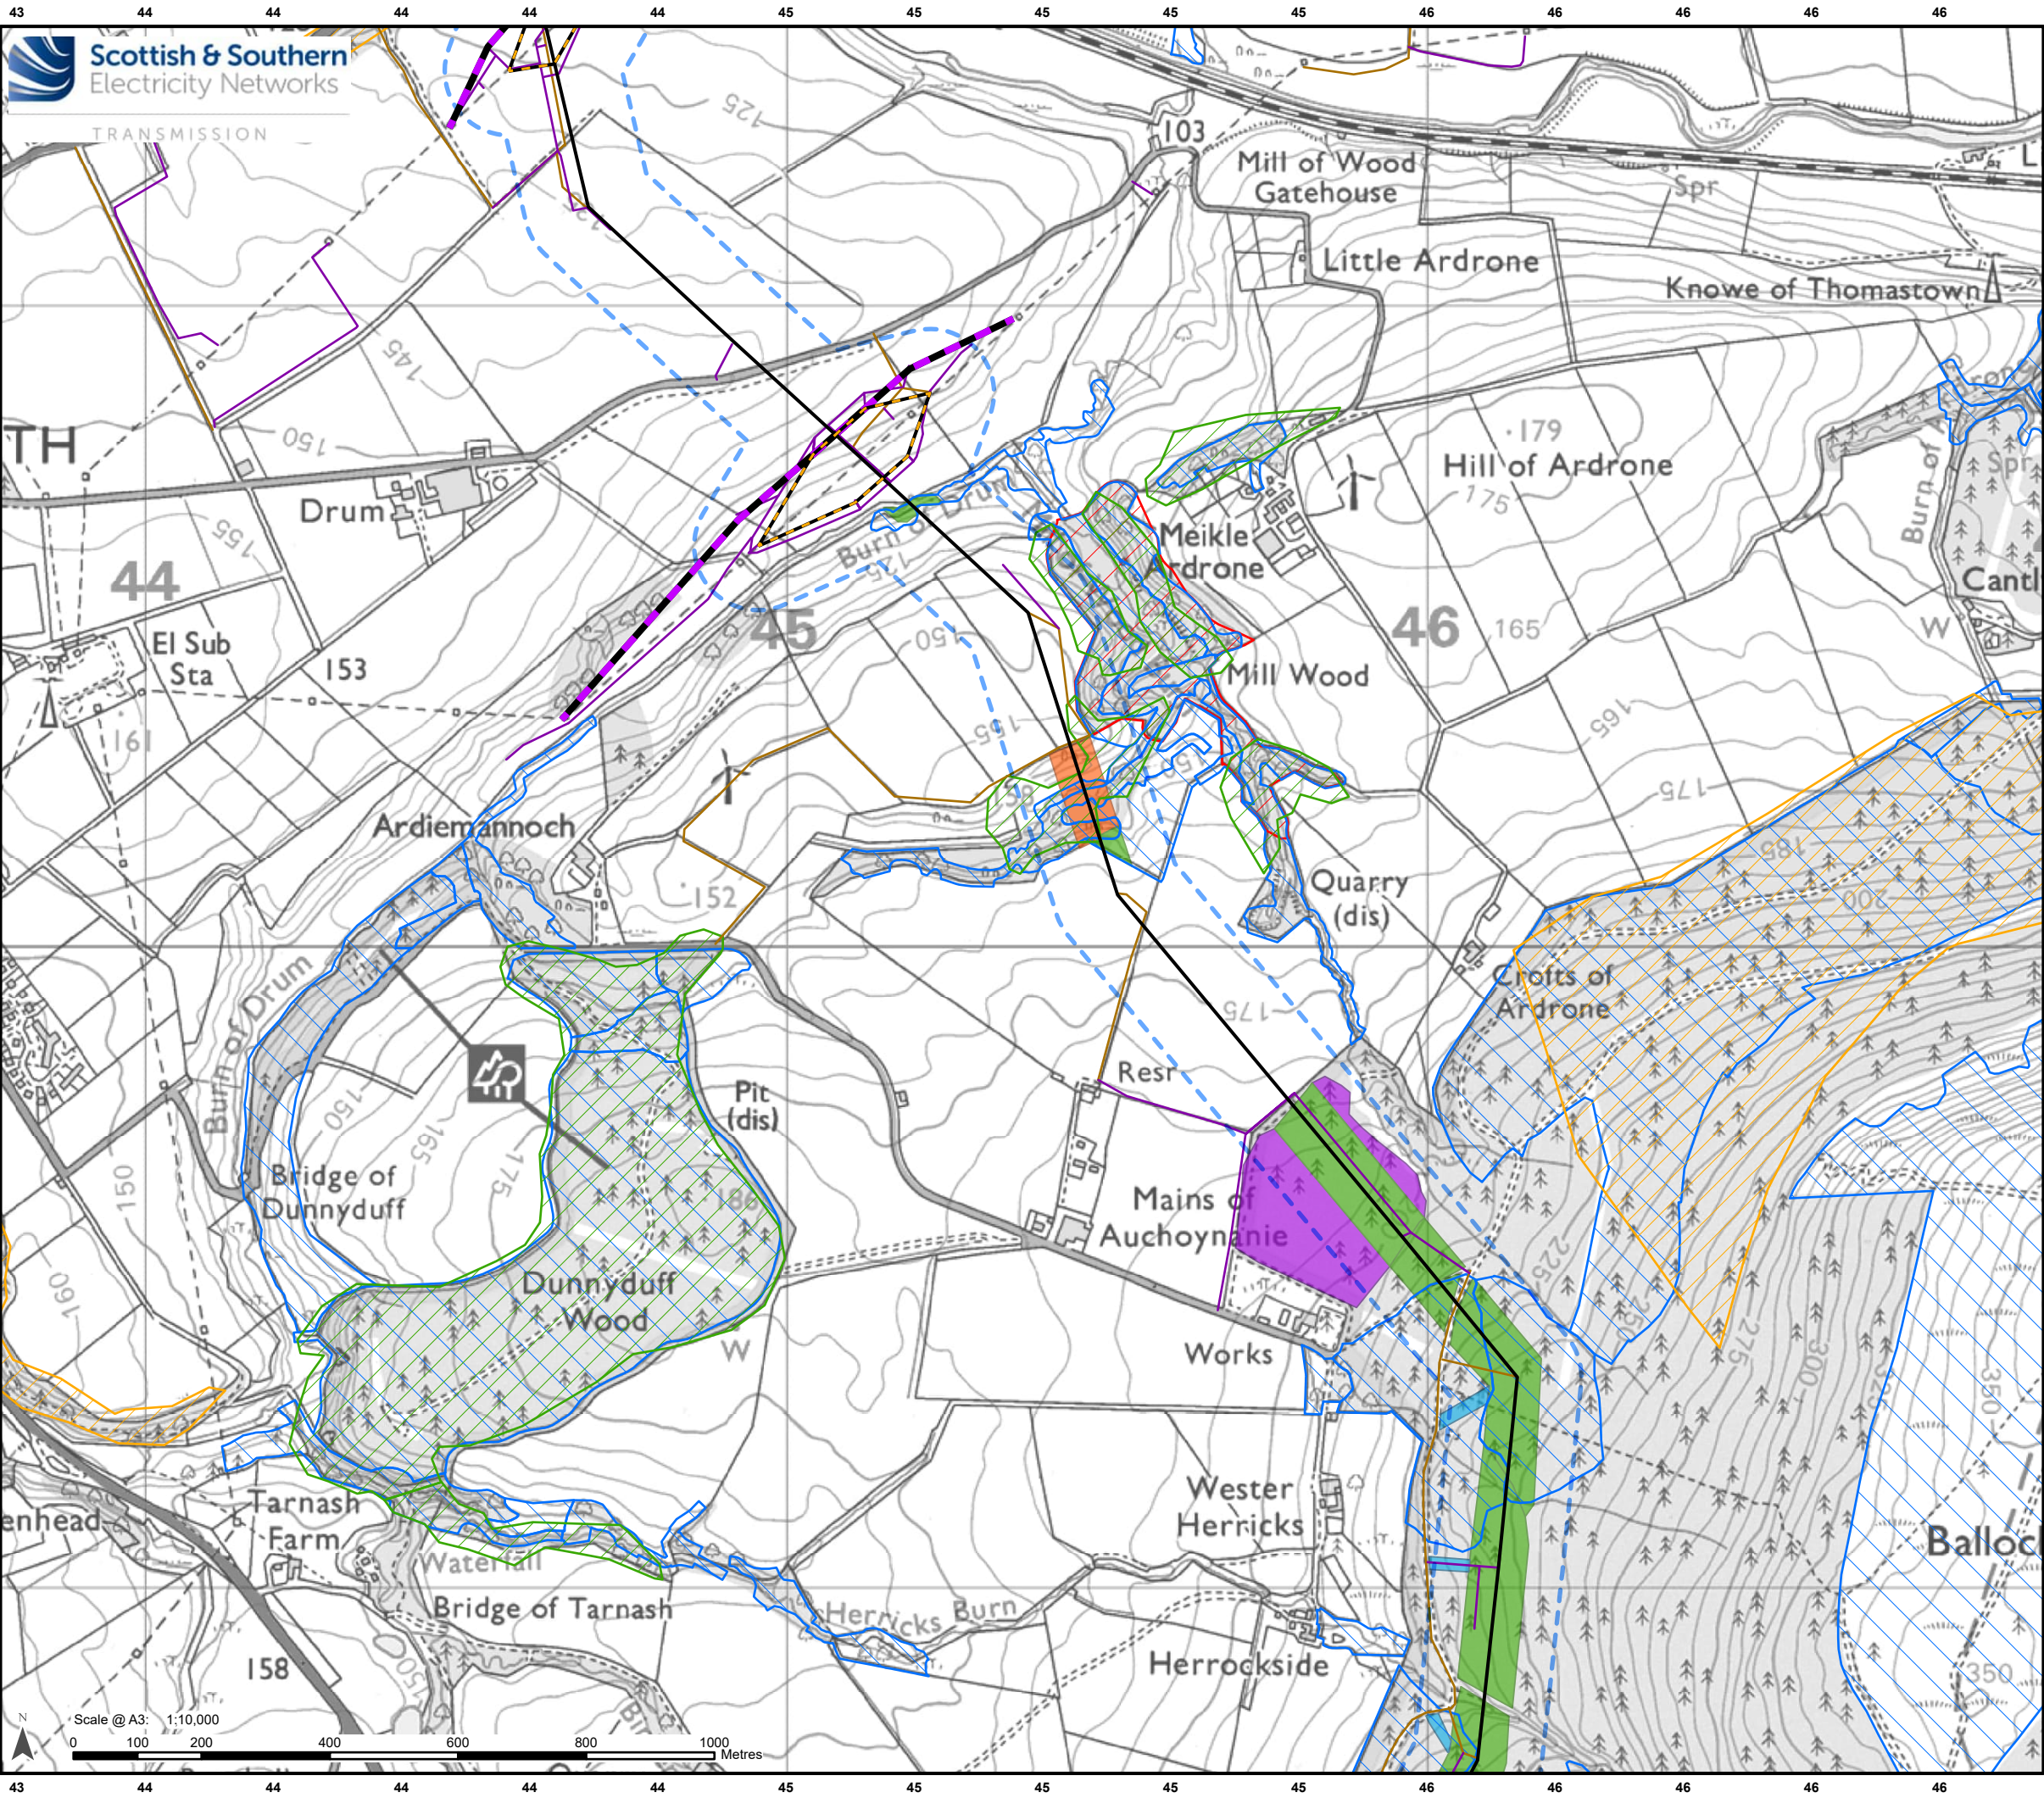

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV


Proposed Felling

- Proposed Operational Corridor Crown Reduction
- Management Felling Outwith Access Tracks and Operational Corridor
- Proposed Operational Corridor Felling
- Proposed Access Track Felling

Environmental Constraints

- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

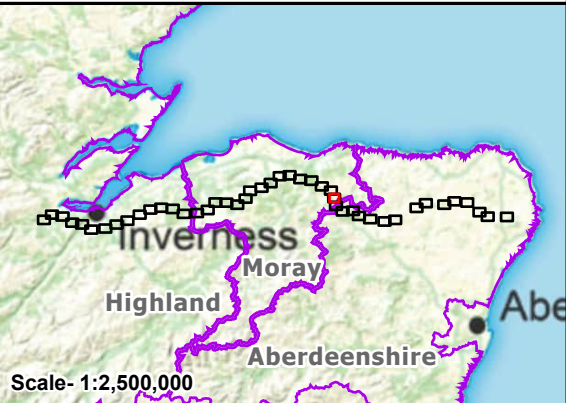


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 30 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

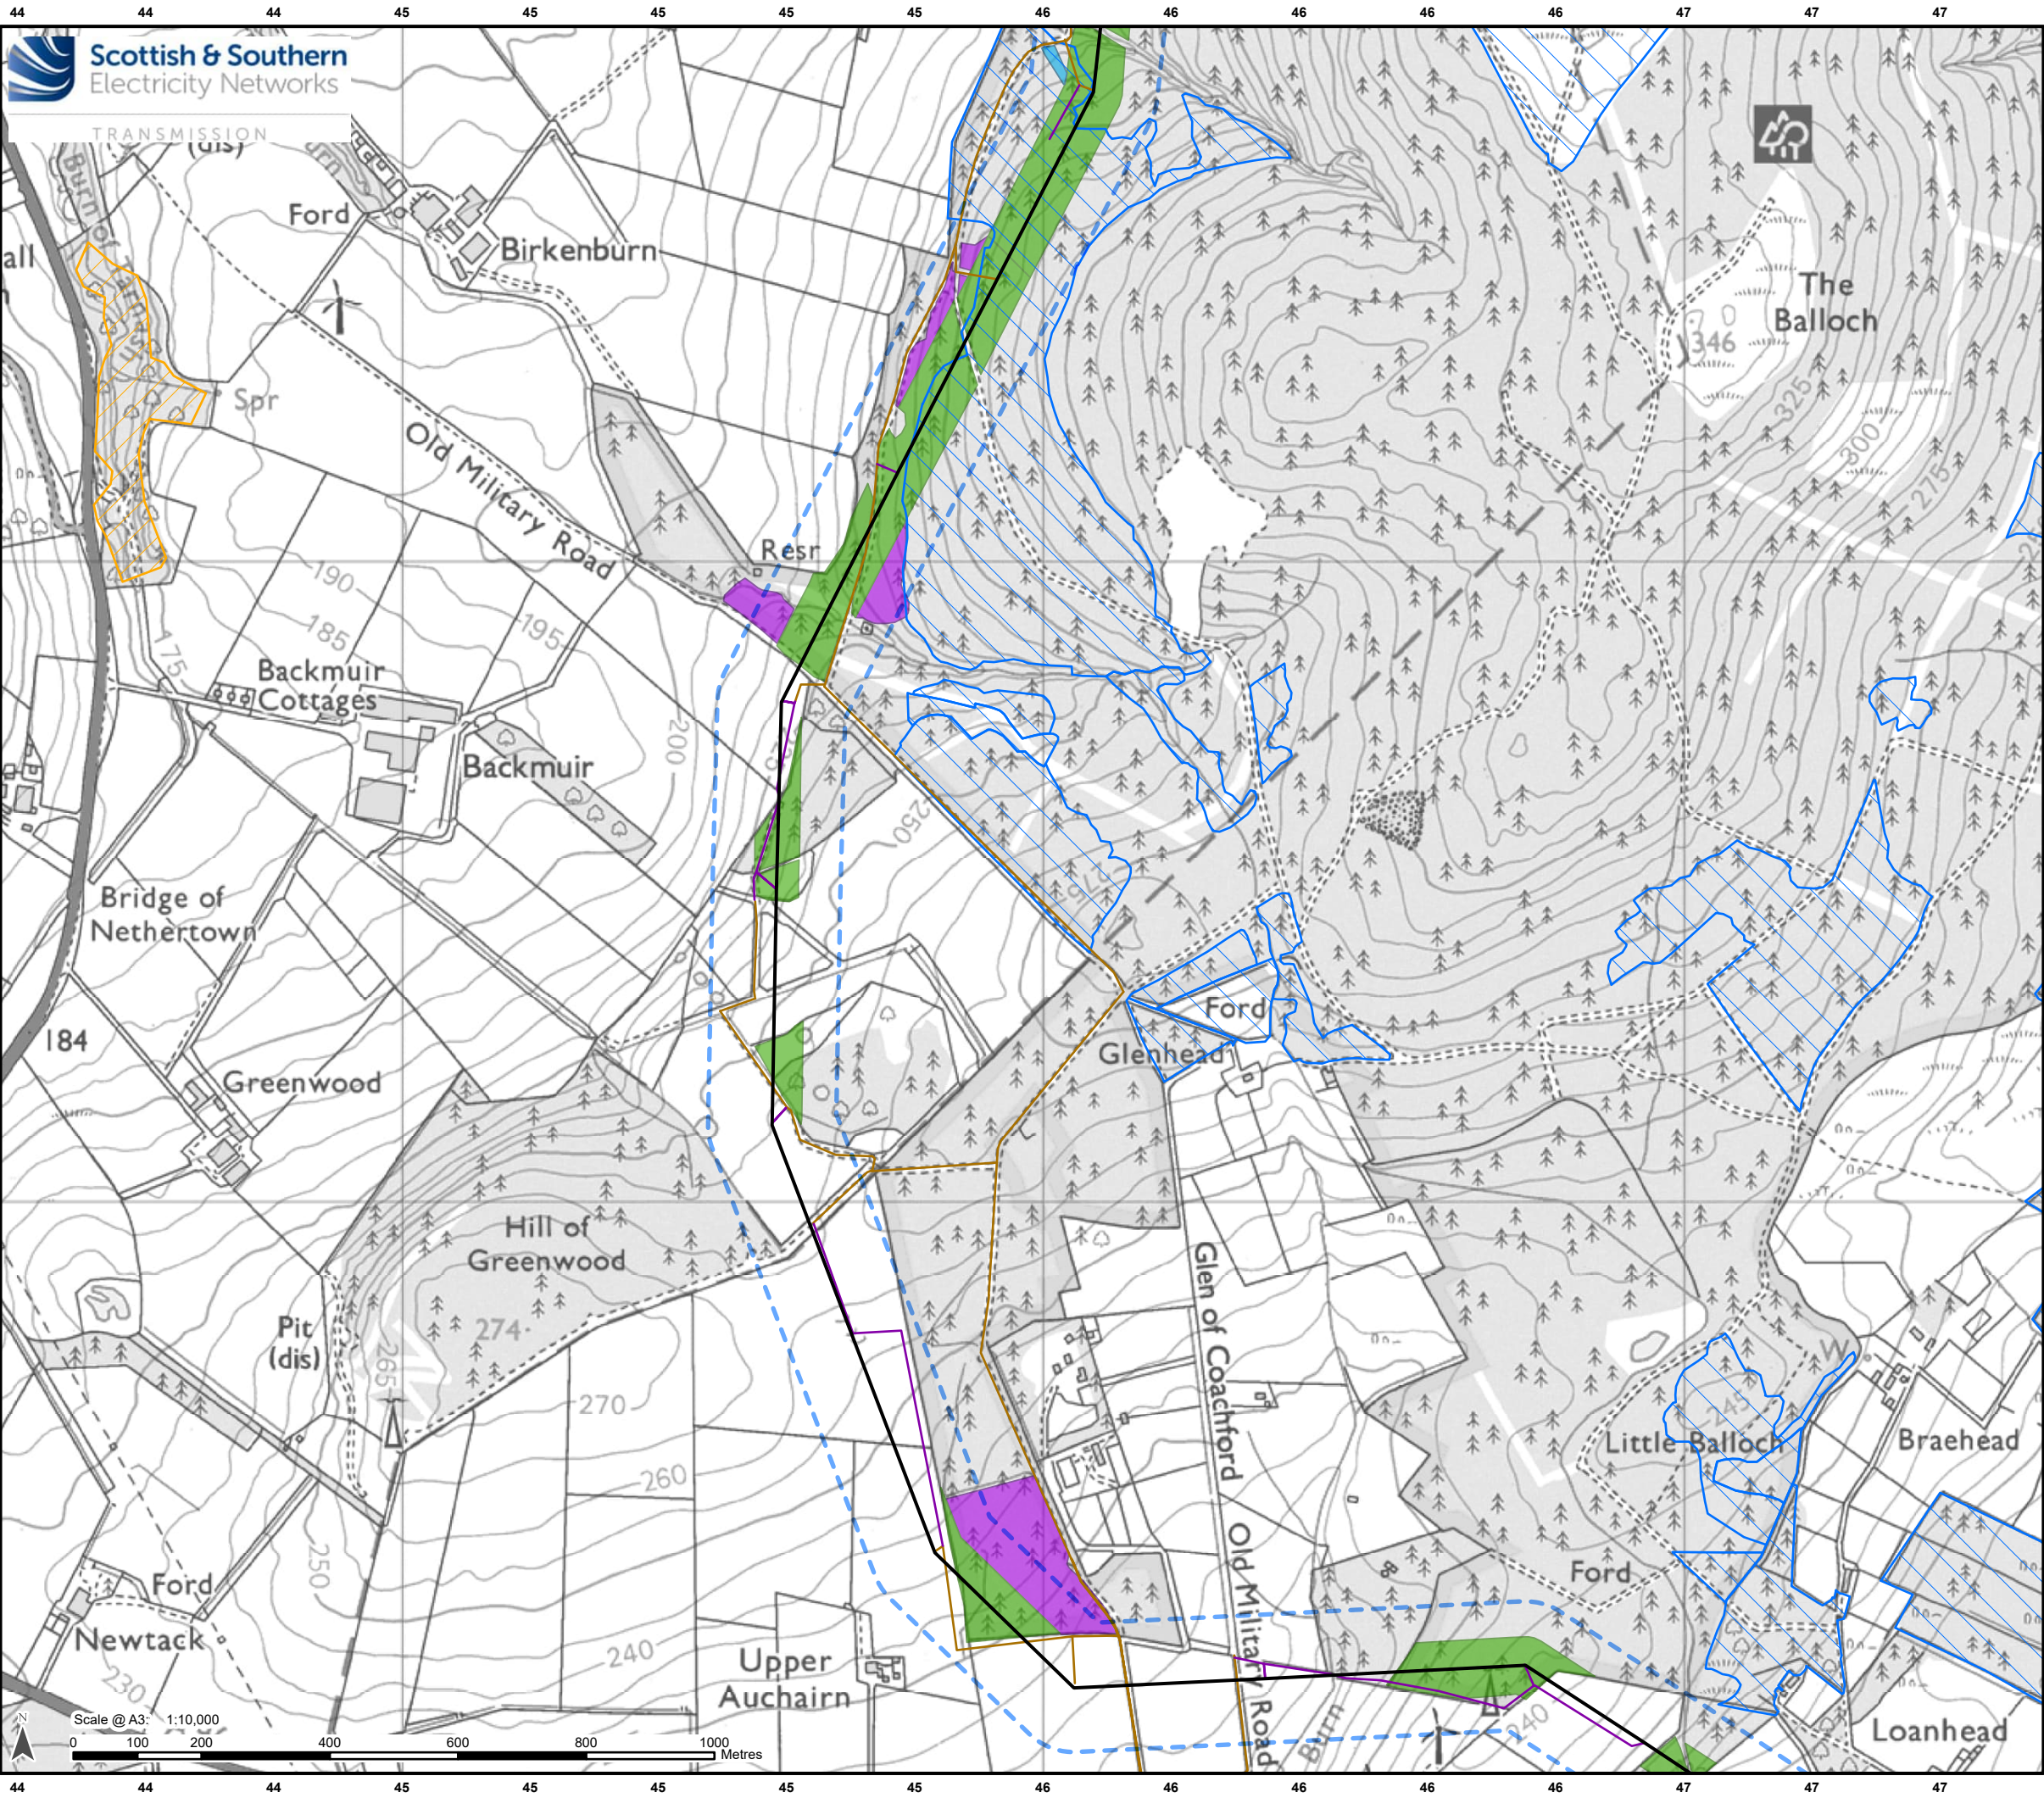

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Proposed OHL Alignment - 400 kV

Access Track – Permanent

Access Track – Temporary and ATV

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin


Development for which Section 37 Consent is Sought

Ancillary Development

Proposed Felling

Environmental Constraints

*Note: Excludes temporary towers and temporary OHL alignments.

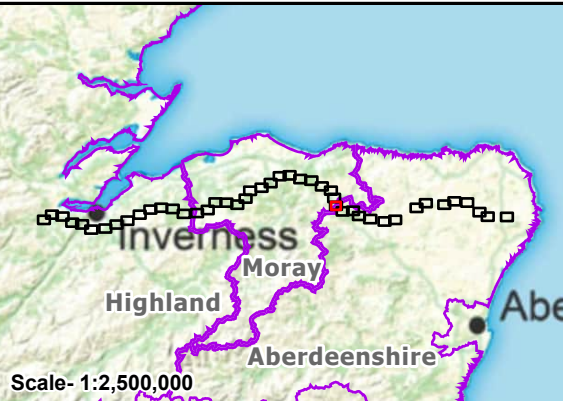


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 31 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

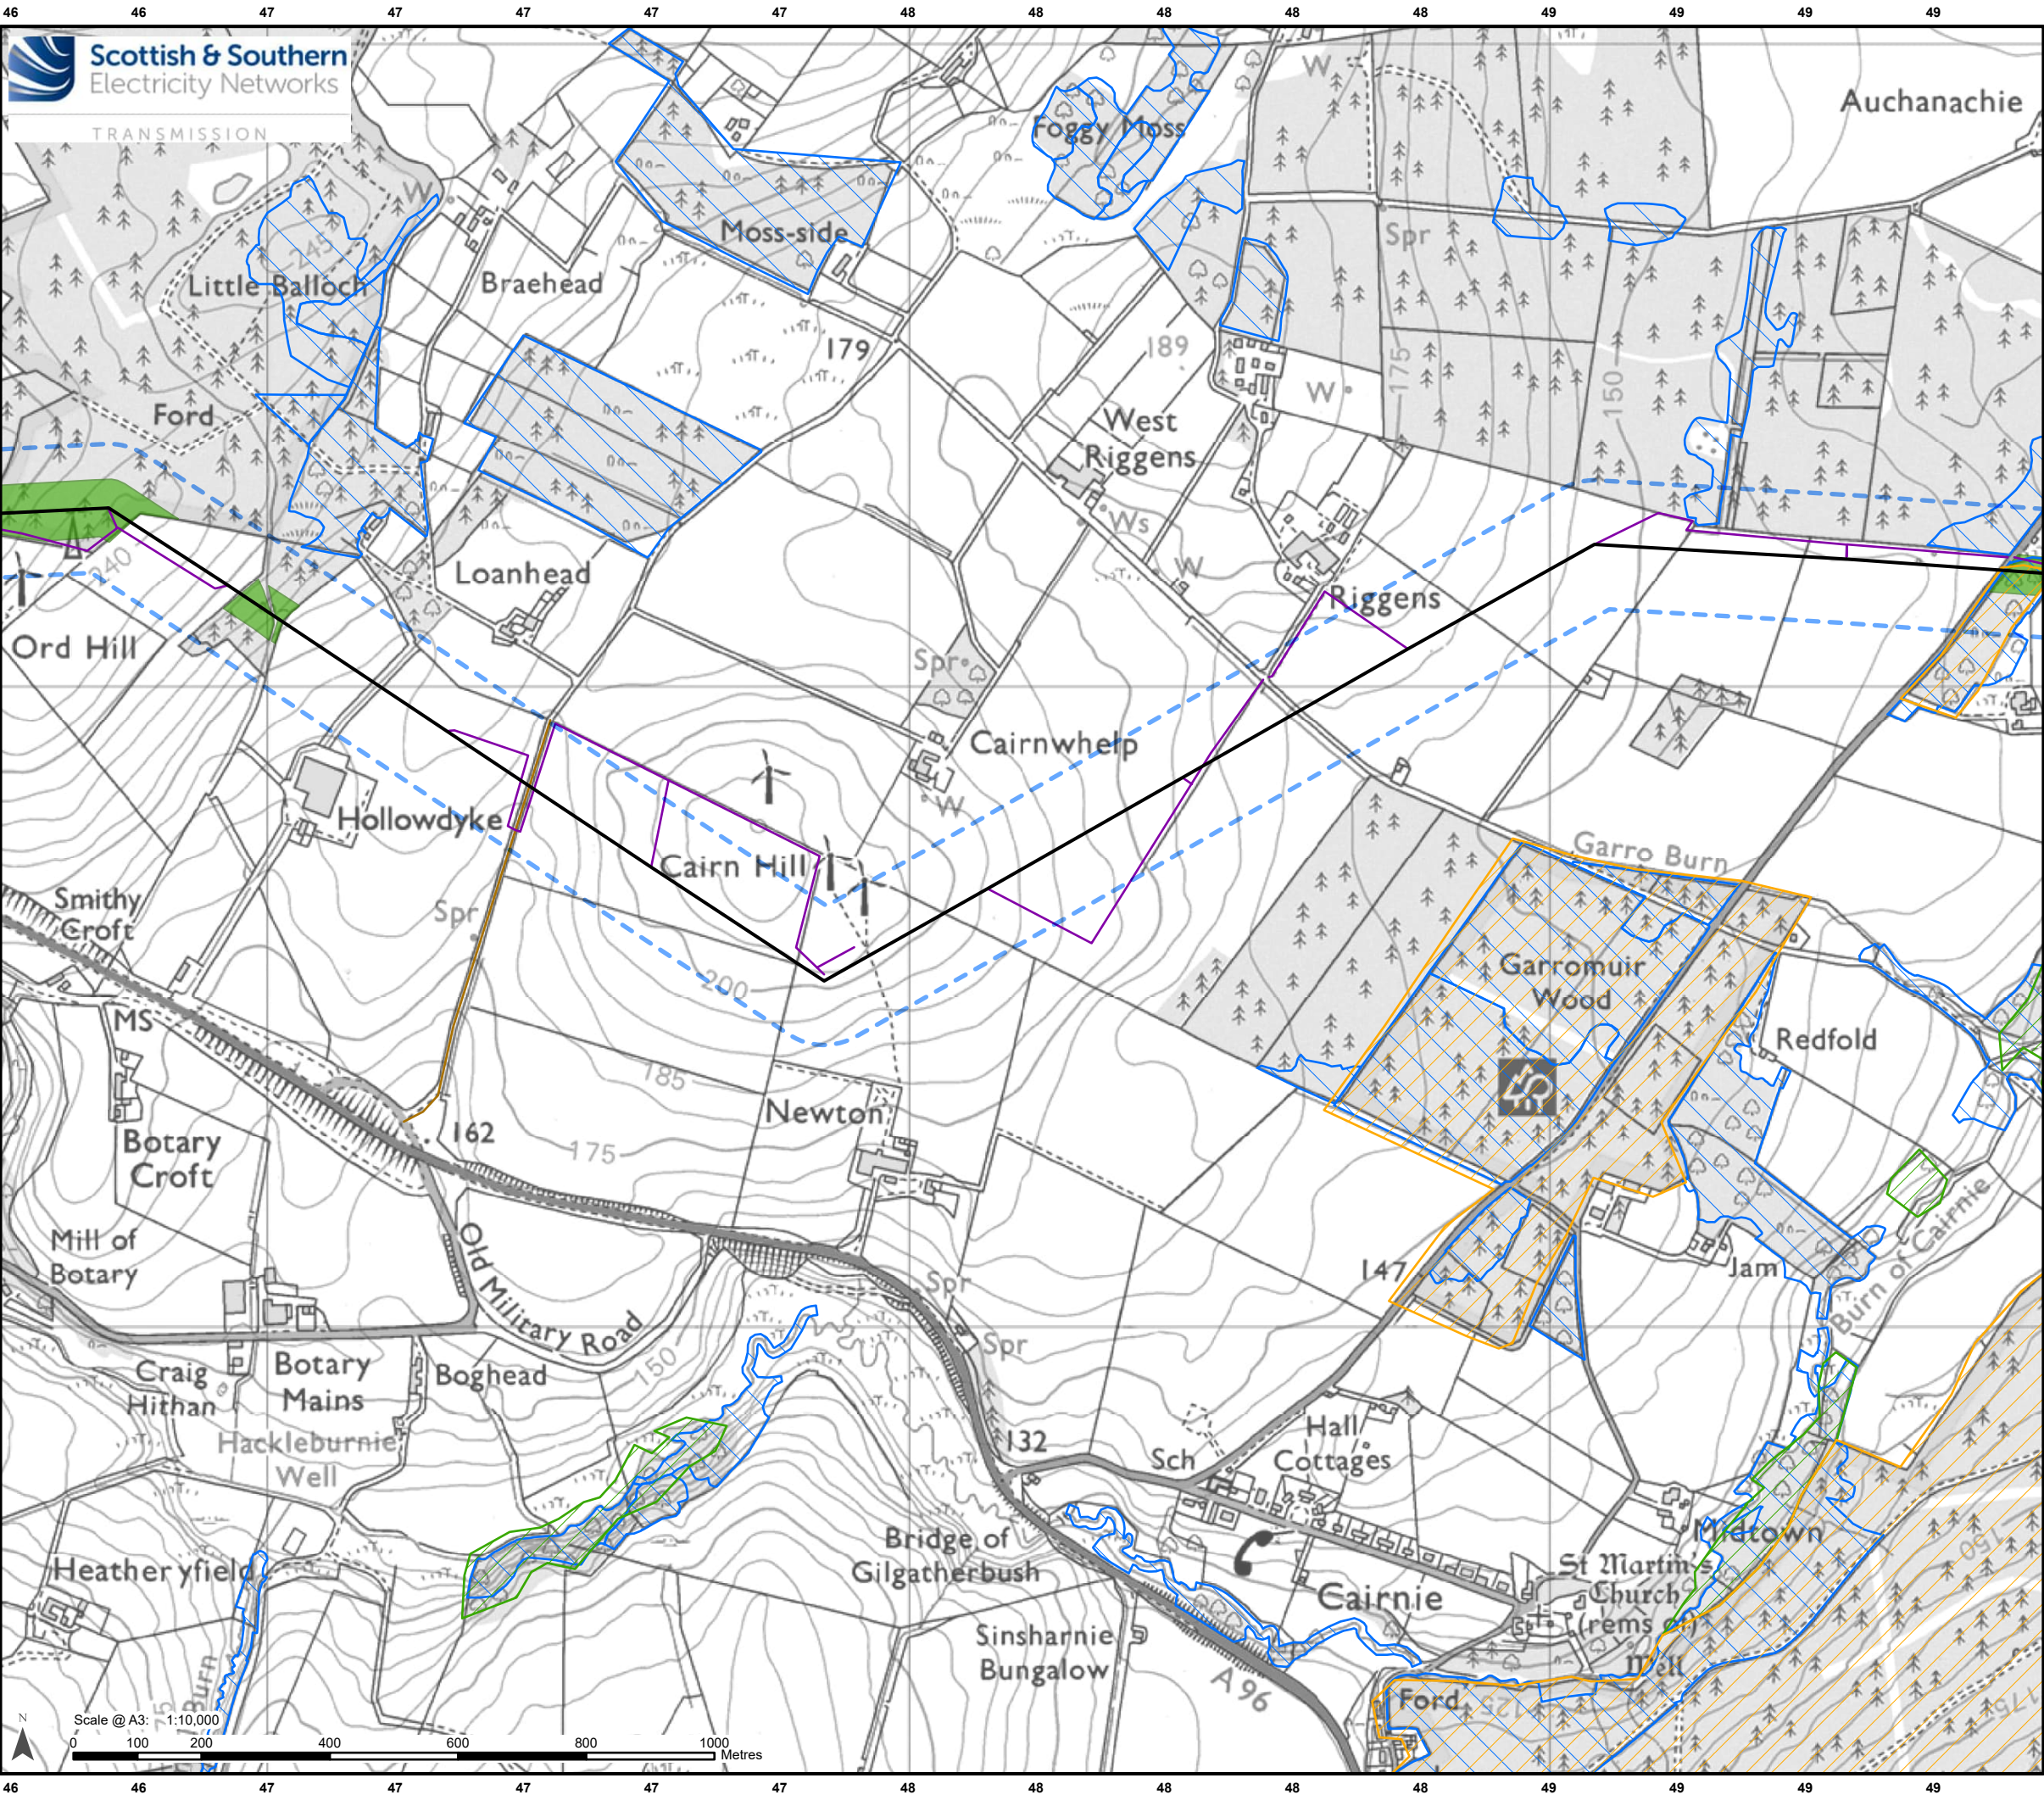

Legend

Limit of Deviation – Proposed Towers and OHL Alignment*

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

Proposed Felling

Proposed Operational Corridor Felling

Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

*Note: Excludes temporary towers and temporary OHL alignments.

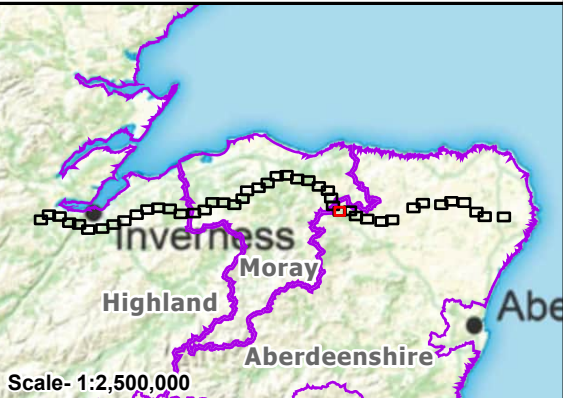

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints
Page 32 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185