


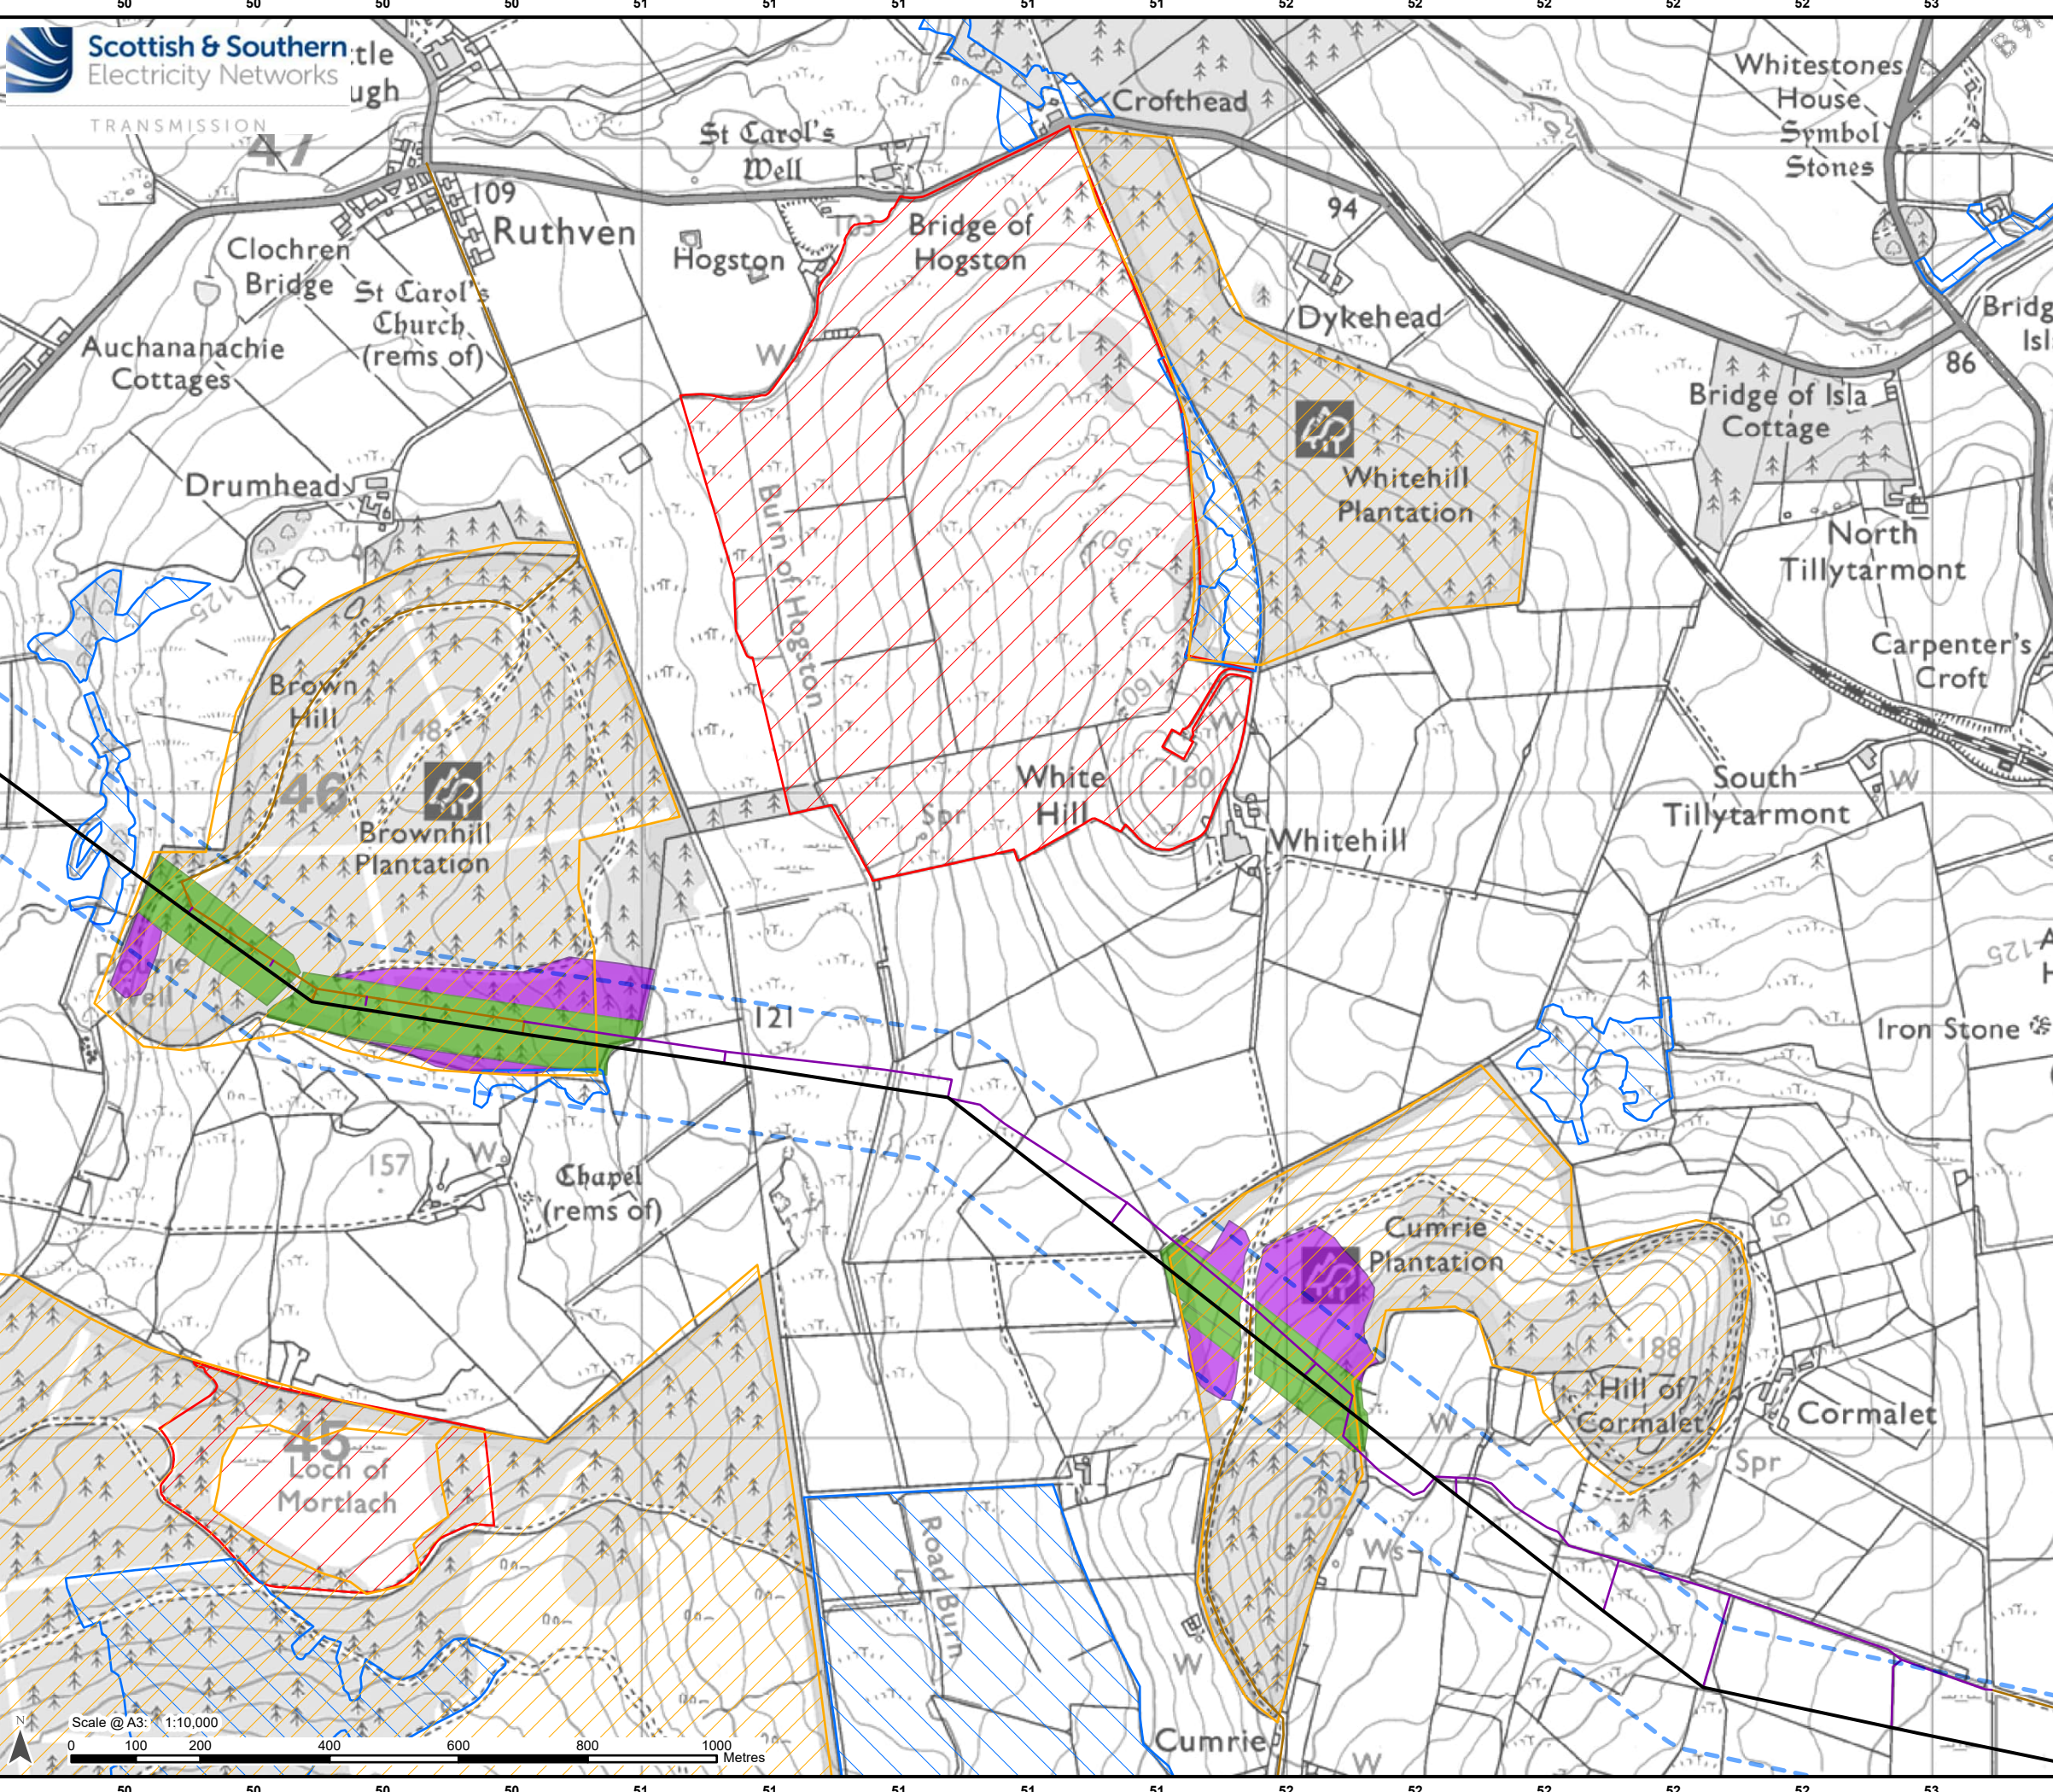

### Legend

Limit of Deviation – Proposed Towers and OHL Alignment\*

### Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

### Ancillary Development

Access Track – Permanent  
Access Track – Temporary and ATV

### Proposed Felling

Management Felling Outwith Access Tracks and Operational Corridor  
Proposed Operational Corridor Felling

### Environmental Constraints


Site of Special Scientific Interest  
Native Woodland Survey of Scotland  
Ancient Woodland of Semi-Natural Origin  
Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

The inset map shows the location of the project within Scotland. The project area is highlighted in purple, showing a route from Inverness in the north to Aberdeen in the south, passing through Moray and Highland. The map is labeled with 'Inverness', 'Moray', 'Highland', and 'Aberdeenshire'. A scale of 1:2,500,000 is indicated.

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |       |            |
|-----------|-------------------------------------------------------------------------------|-------|------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project             |       |            |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 33 of 45 |       |            |
| Drawn by: | MAL                                                                           | Date: | 20/08/2025 |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |       |            |

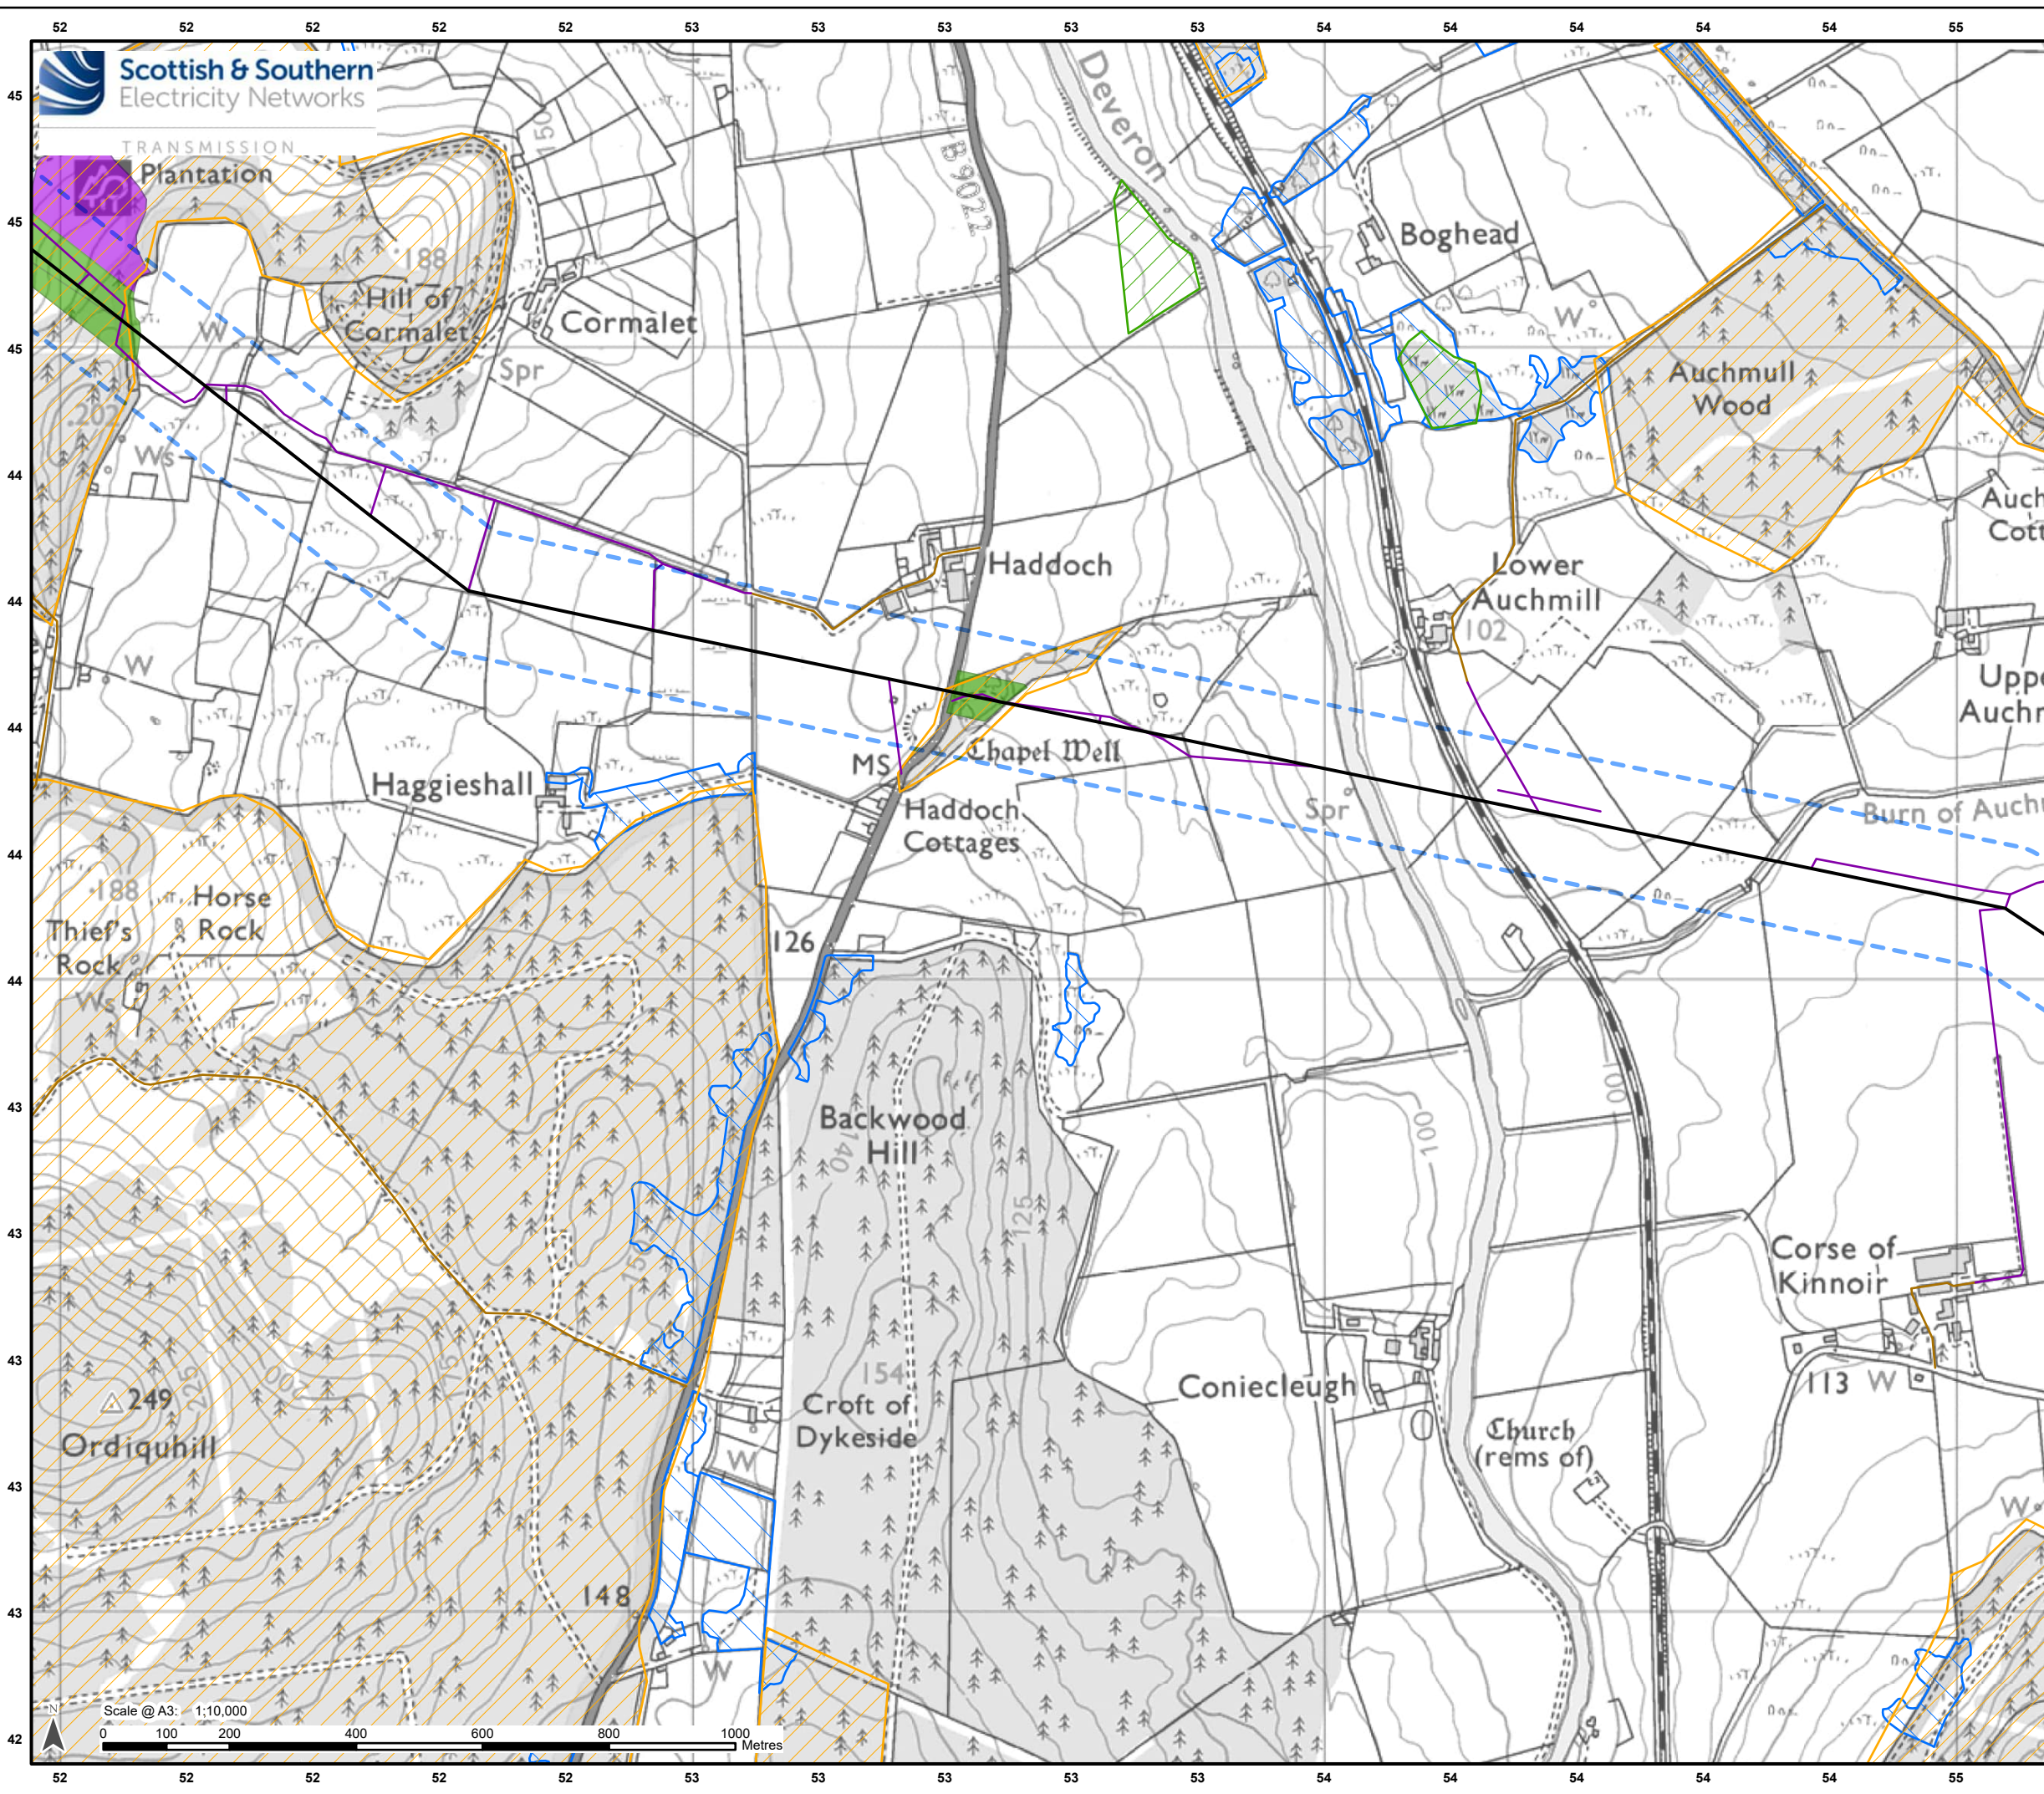

**Legend**

- Limit of Deviation – Proposed Towers and OHL Alignment\*
- Proposed OHL Alignment - 400 kV
- Ancillary Development**
  - Access Track – Permanent
  - Access Track – Temporary and ATV
- Proposed Felling**
  - Management Felling Outwith Access Tracks and Operational Corridor
  - Proposed Operational Corridor Felling
- Environmental Constraints**
  - Site of Special Scientific Interest
  - Native Woodland Survey of Scotland
  - Ancient Woodland of Semi-Natural Origin
  - Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints  
Page 34 of 45

Drawn by: MAL Date: 20/08/2025

Drawing: B2P-WSP-DA-70092380-185

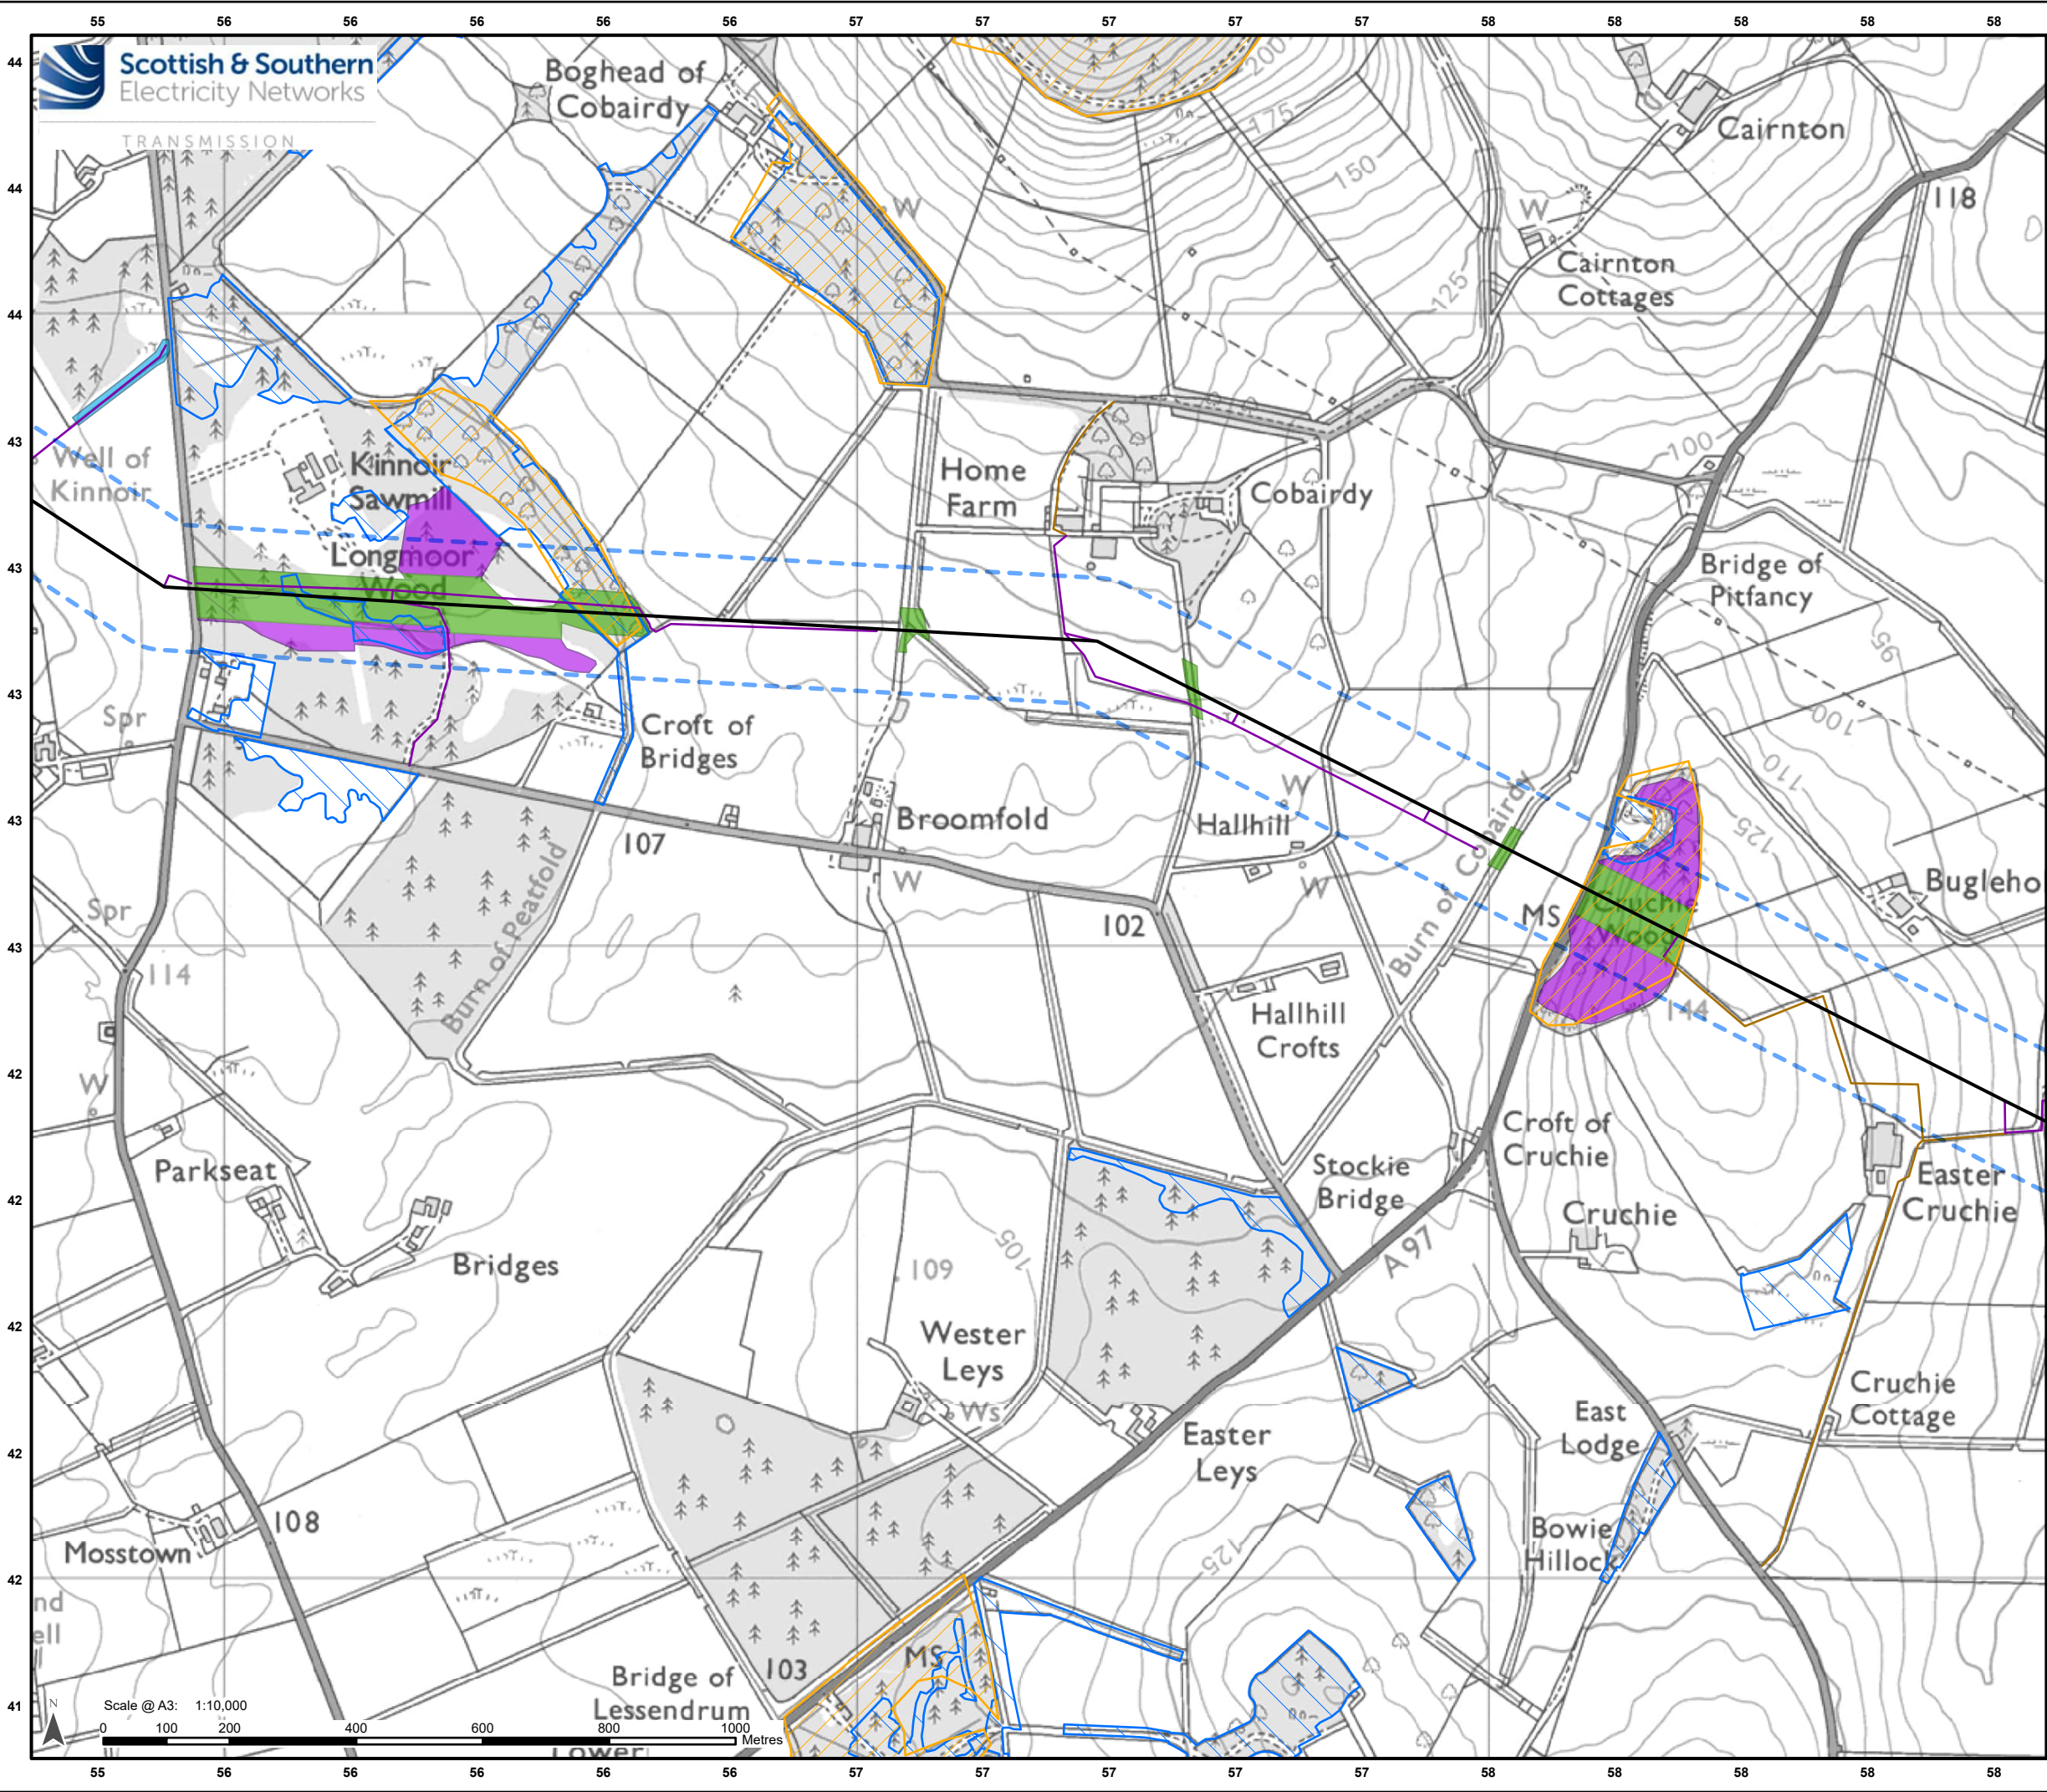

**Legend**

Limit of Deviation – Proposed Towers and OHL Alignment\*

**Development for which Section 37 Consent is Sought**

Proposed OHL Alignment - 400 kV

**Ancillary Development**

Access Track – Permanent

Access Track – Temporary and ATV

**Proposed Felling**

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

**Environmental Constraints**

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.


Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |       |            |
|-----------|-------------------------------------------------------------------------------|-------|------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project             |       |            |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 35 of 45 |       |            |
| Drawn by: | MAL                                                                           | Date: | 21/08/2025 |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |       |            |





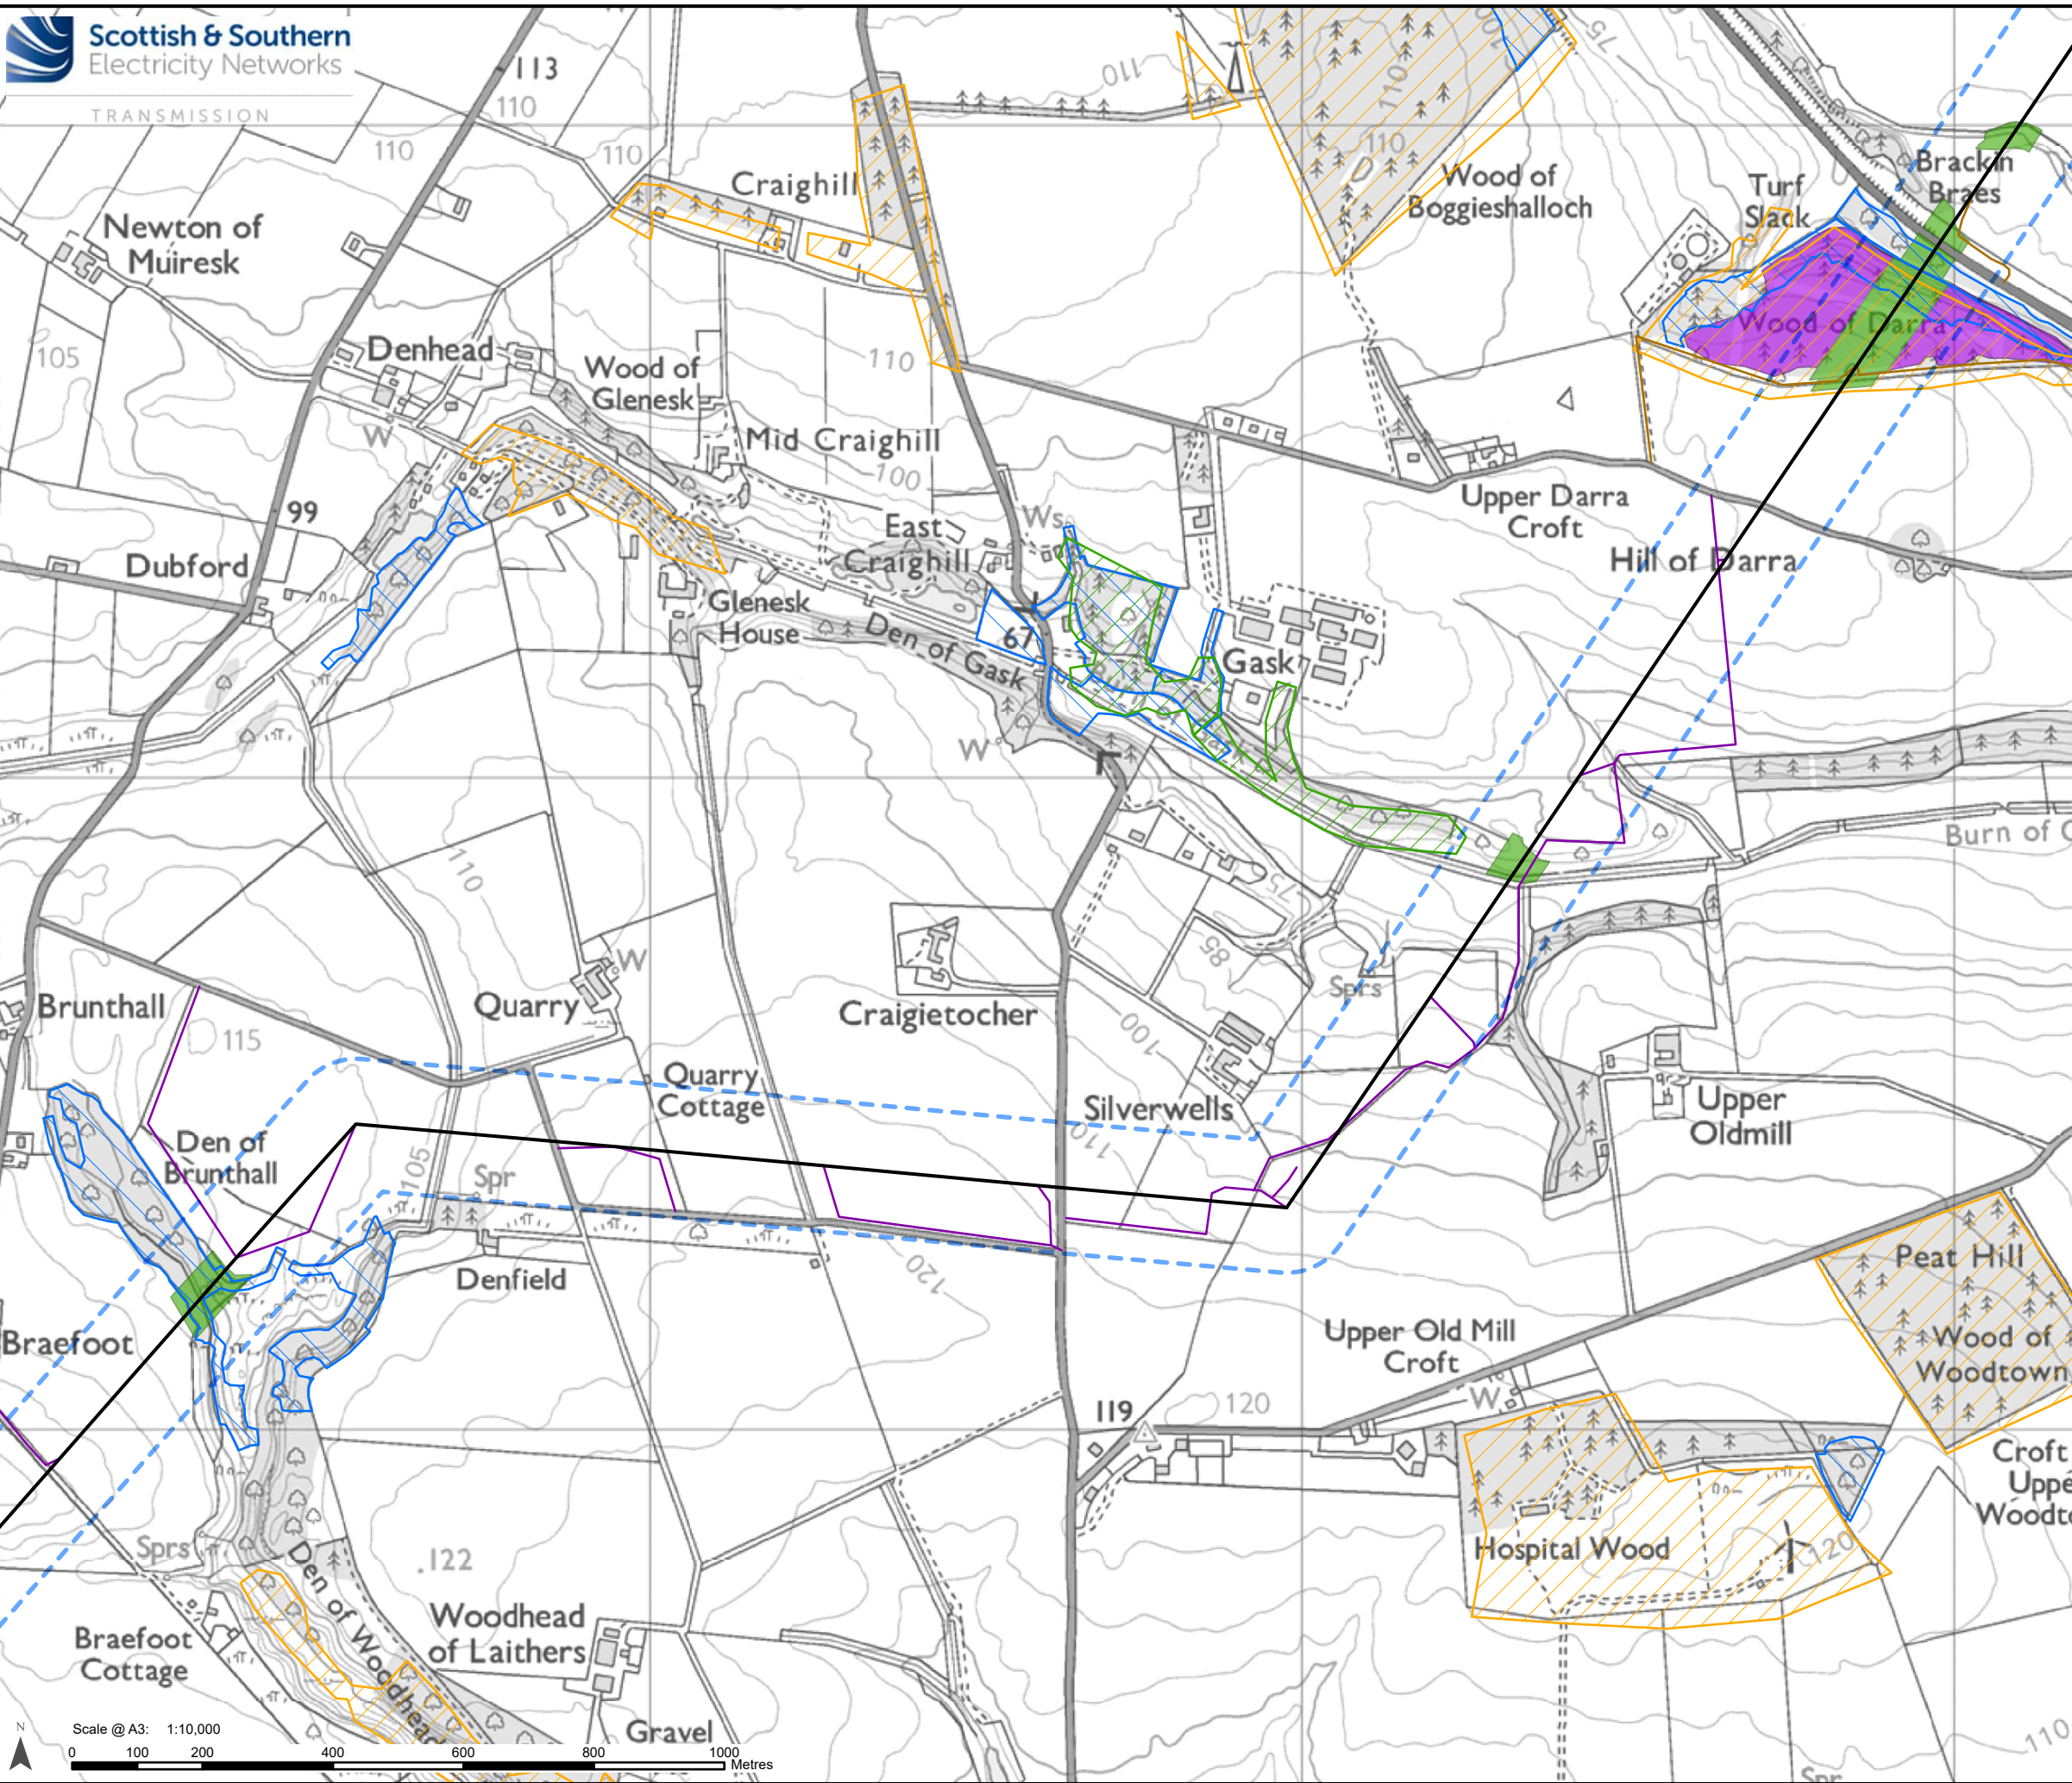

**Legend**

Limit of Deviation – Proposed Towers and OHL Alignment\*

**Development for which Section 37 Consent is Sought**

Proposed OHL Alignment - 400 kV

**Ancillary Development**

Access Track – Permanent

Access Track – Temporary and ATV

**Proposed Felling**

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

**Environmental Constraints**


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

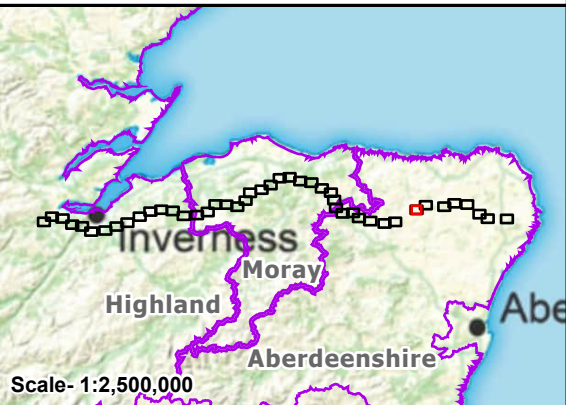

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints  
Page 38 of 45

Drawn by: MAL

Date: 21/08/2025

Drawing: B2P-WSP-DA-70092380-185

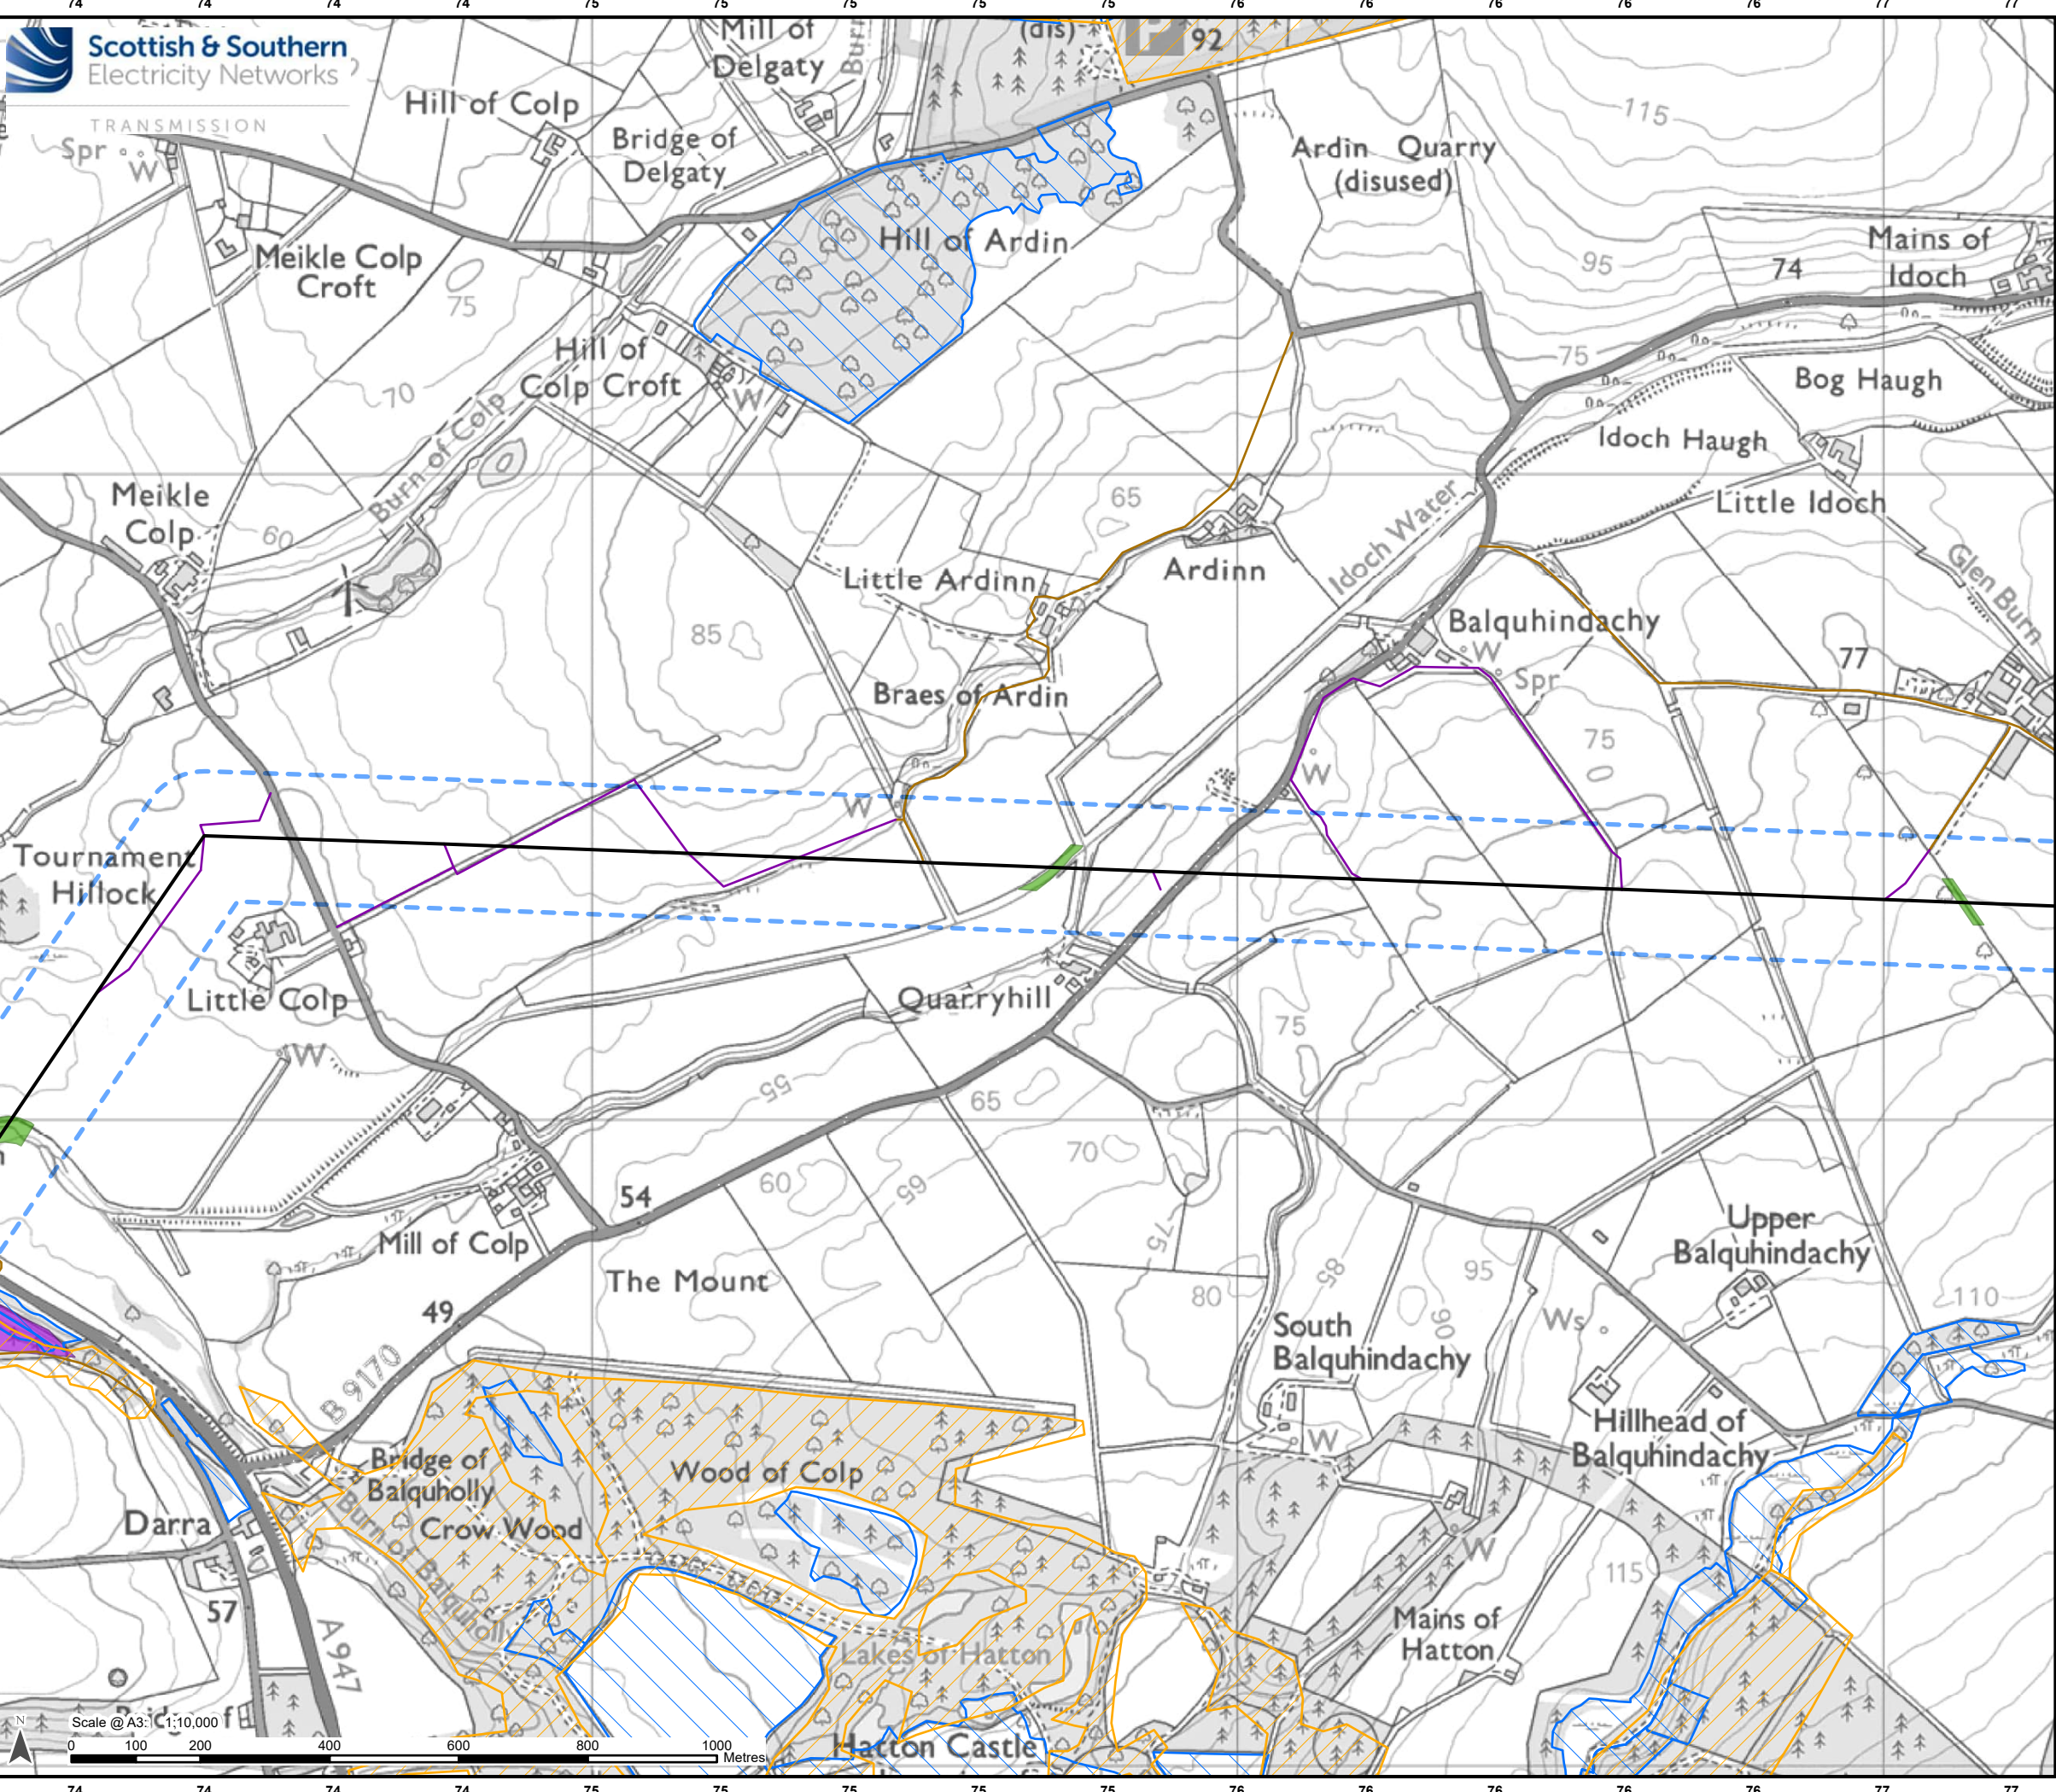

**Legend**  

Limit of Deviation – Proposed Towers and OHL Alignment\*

**Development for which Section 37 Consent is Sought**  

Proposed OHL Alignment - 400 kV

**Ancillary Development**  

Access Track – Permanent

Access Track – Temporary and ATV

**Proposed Felling**  

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

**Environmental Constraints**  

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin


Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |       |            |
|-----------|-------------------------------------------------------------------------------|-------|------------|
| Project:  | Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project           |       |            |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 39 of 45 |       |            |
| Drawn by: | MAL                                                                           | Date: | 21/08/2025 |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |       |            |

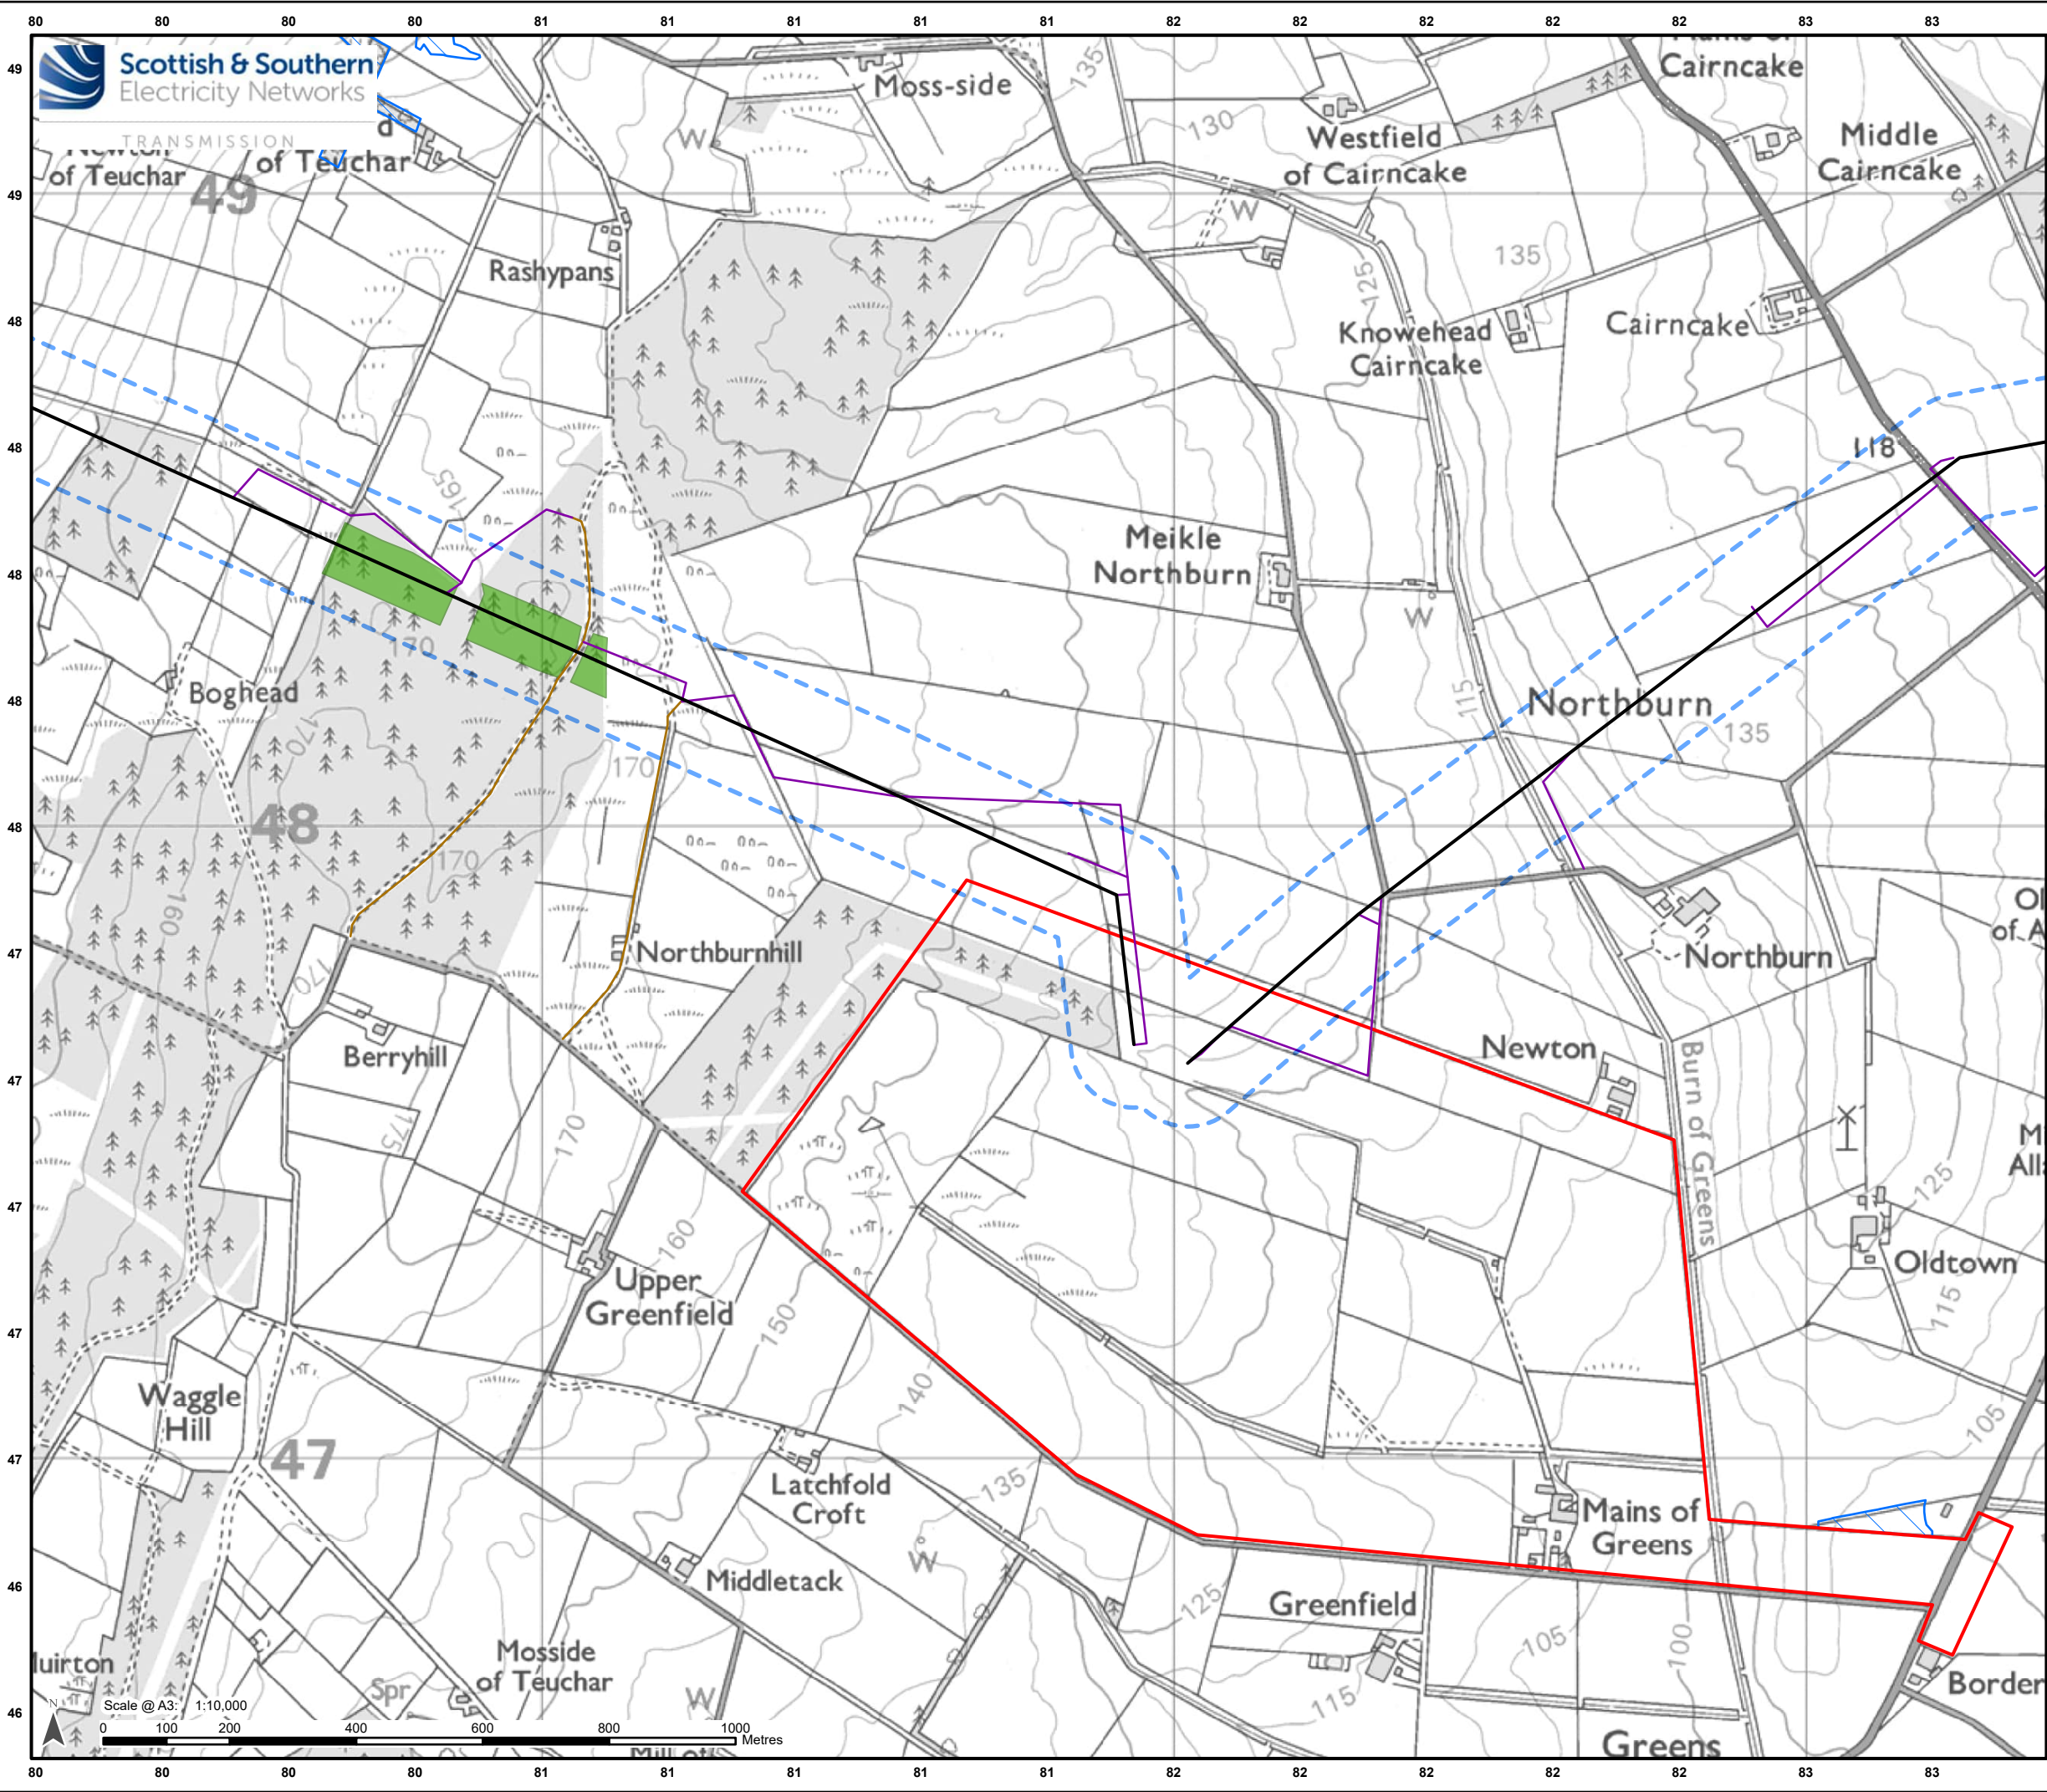

### Legend

- Proposed Substation Site Planning Red Line Boundary
- Limit of Deviation – Proposed Towers and OHL Alignment\*

### Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV

### Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV

### Proposed Felling

- Proposed Operational Corridor Felling

### Environmental Constraints

- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints  
Page 40 of 45

Drawn by: MAL Date: 21/08/2025

Drawing: B2P-WSP-DA-70092380-185

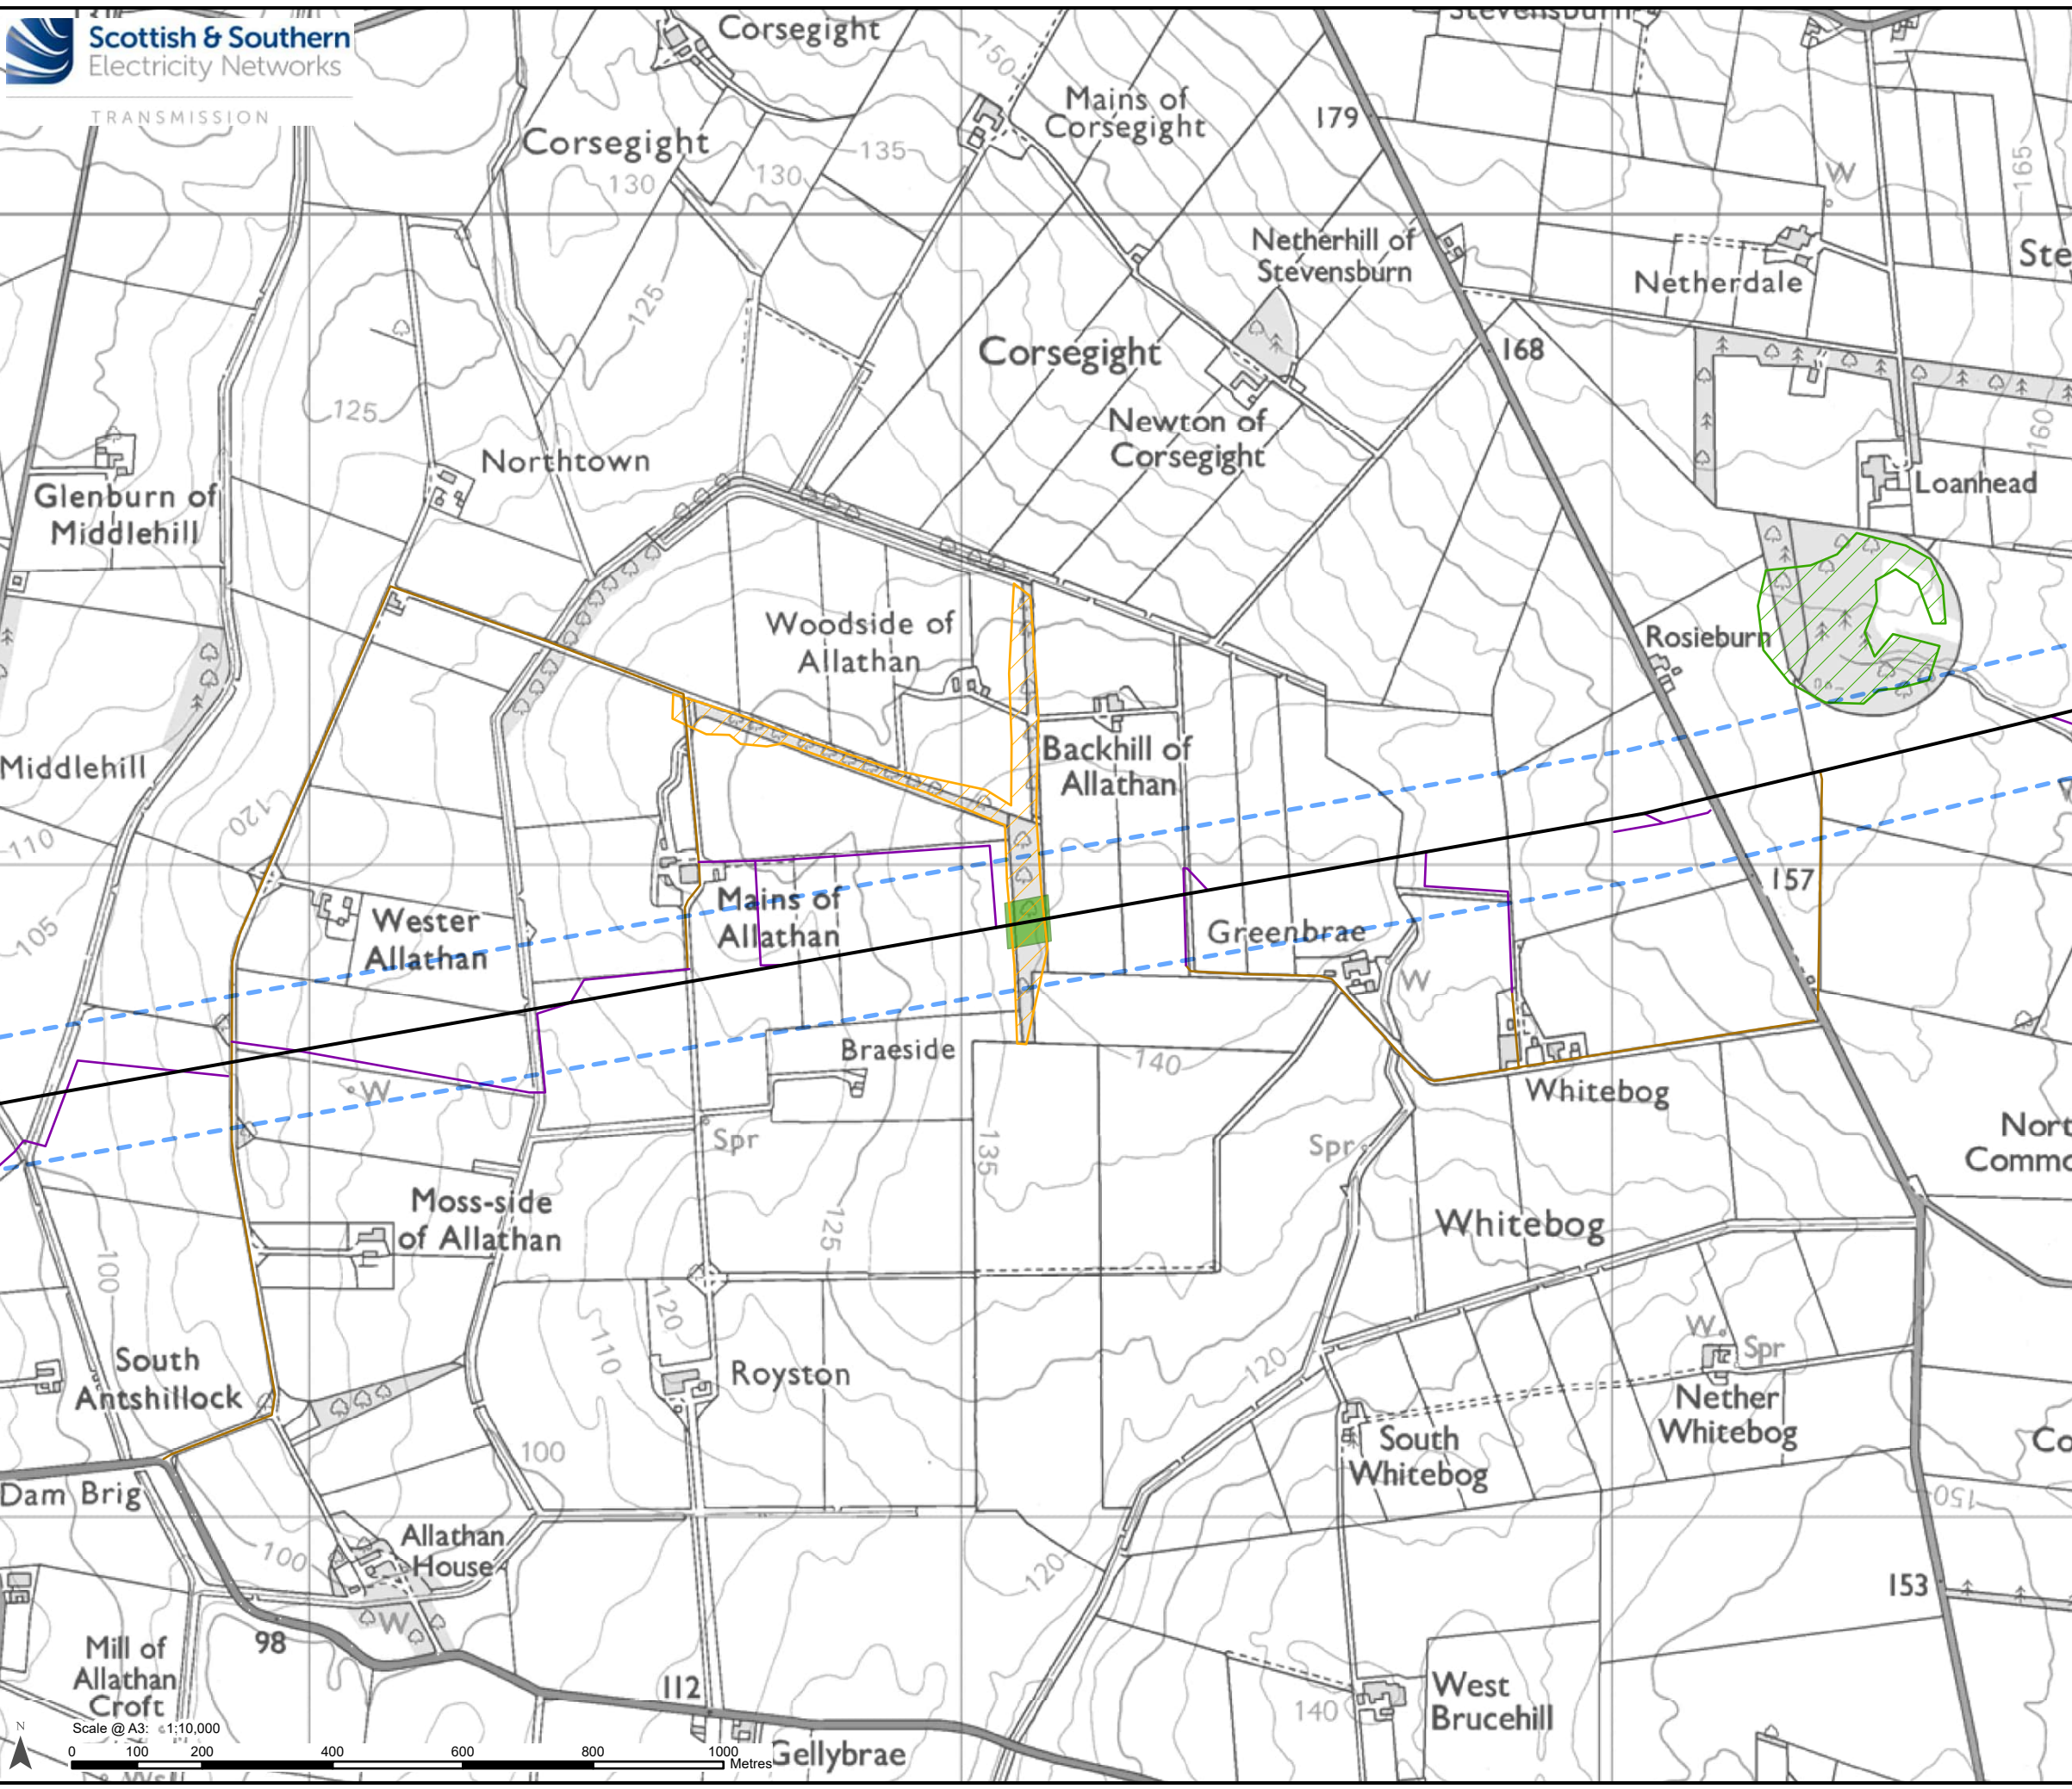

## Legend

Limit of Deviation – Proposed Towers and OHL Alignment\*

## Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

## Ancillary Development

Access Track – Permanent

Access Track – Temporary and ATV

## Proposed Felling

Proposed Operational Corridor Felling

## Environmental Constraints


Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

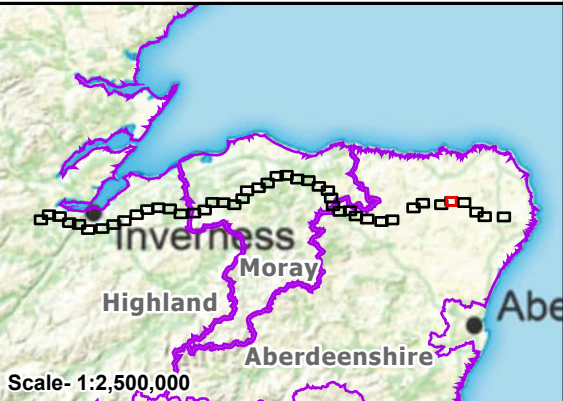


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 12.2 - Proposed Felling and Environmental Constraints  
Page 41 of 45

Drawn by: MAL Date: 21/08/2025

Drawing: B2P-WSP-DA-70092380-185

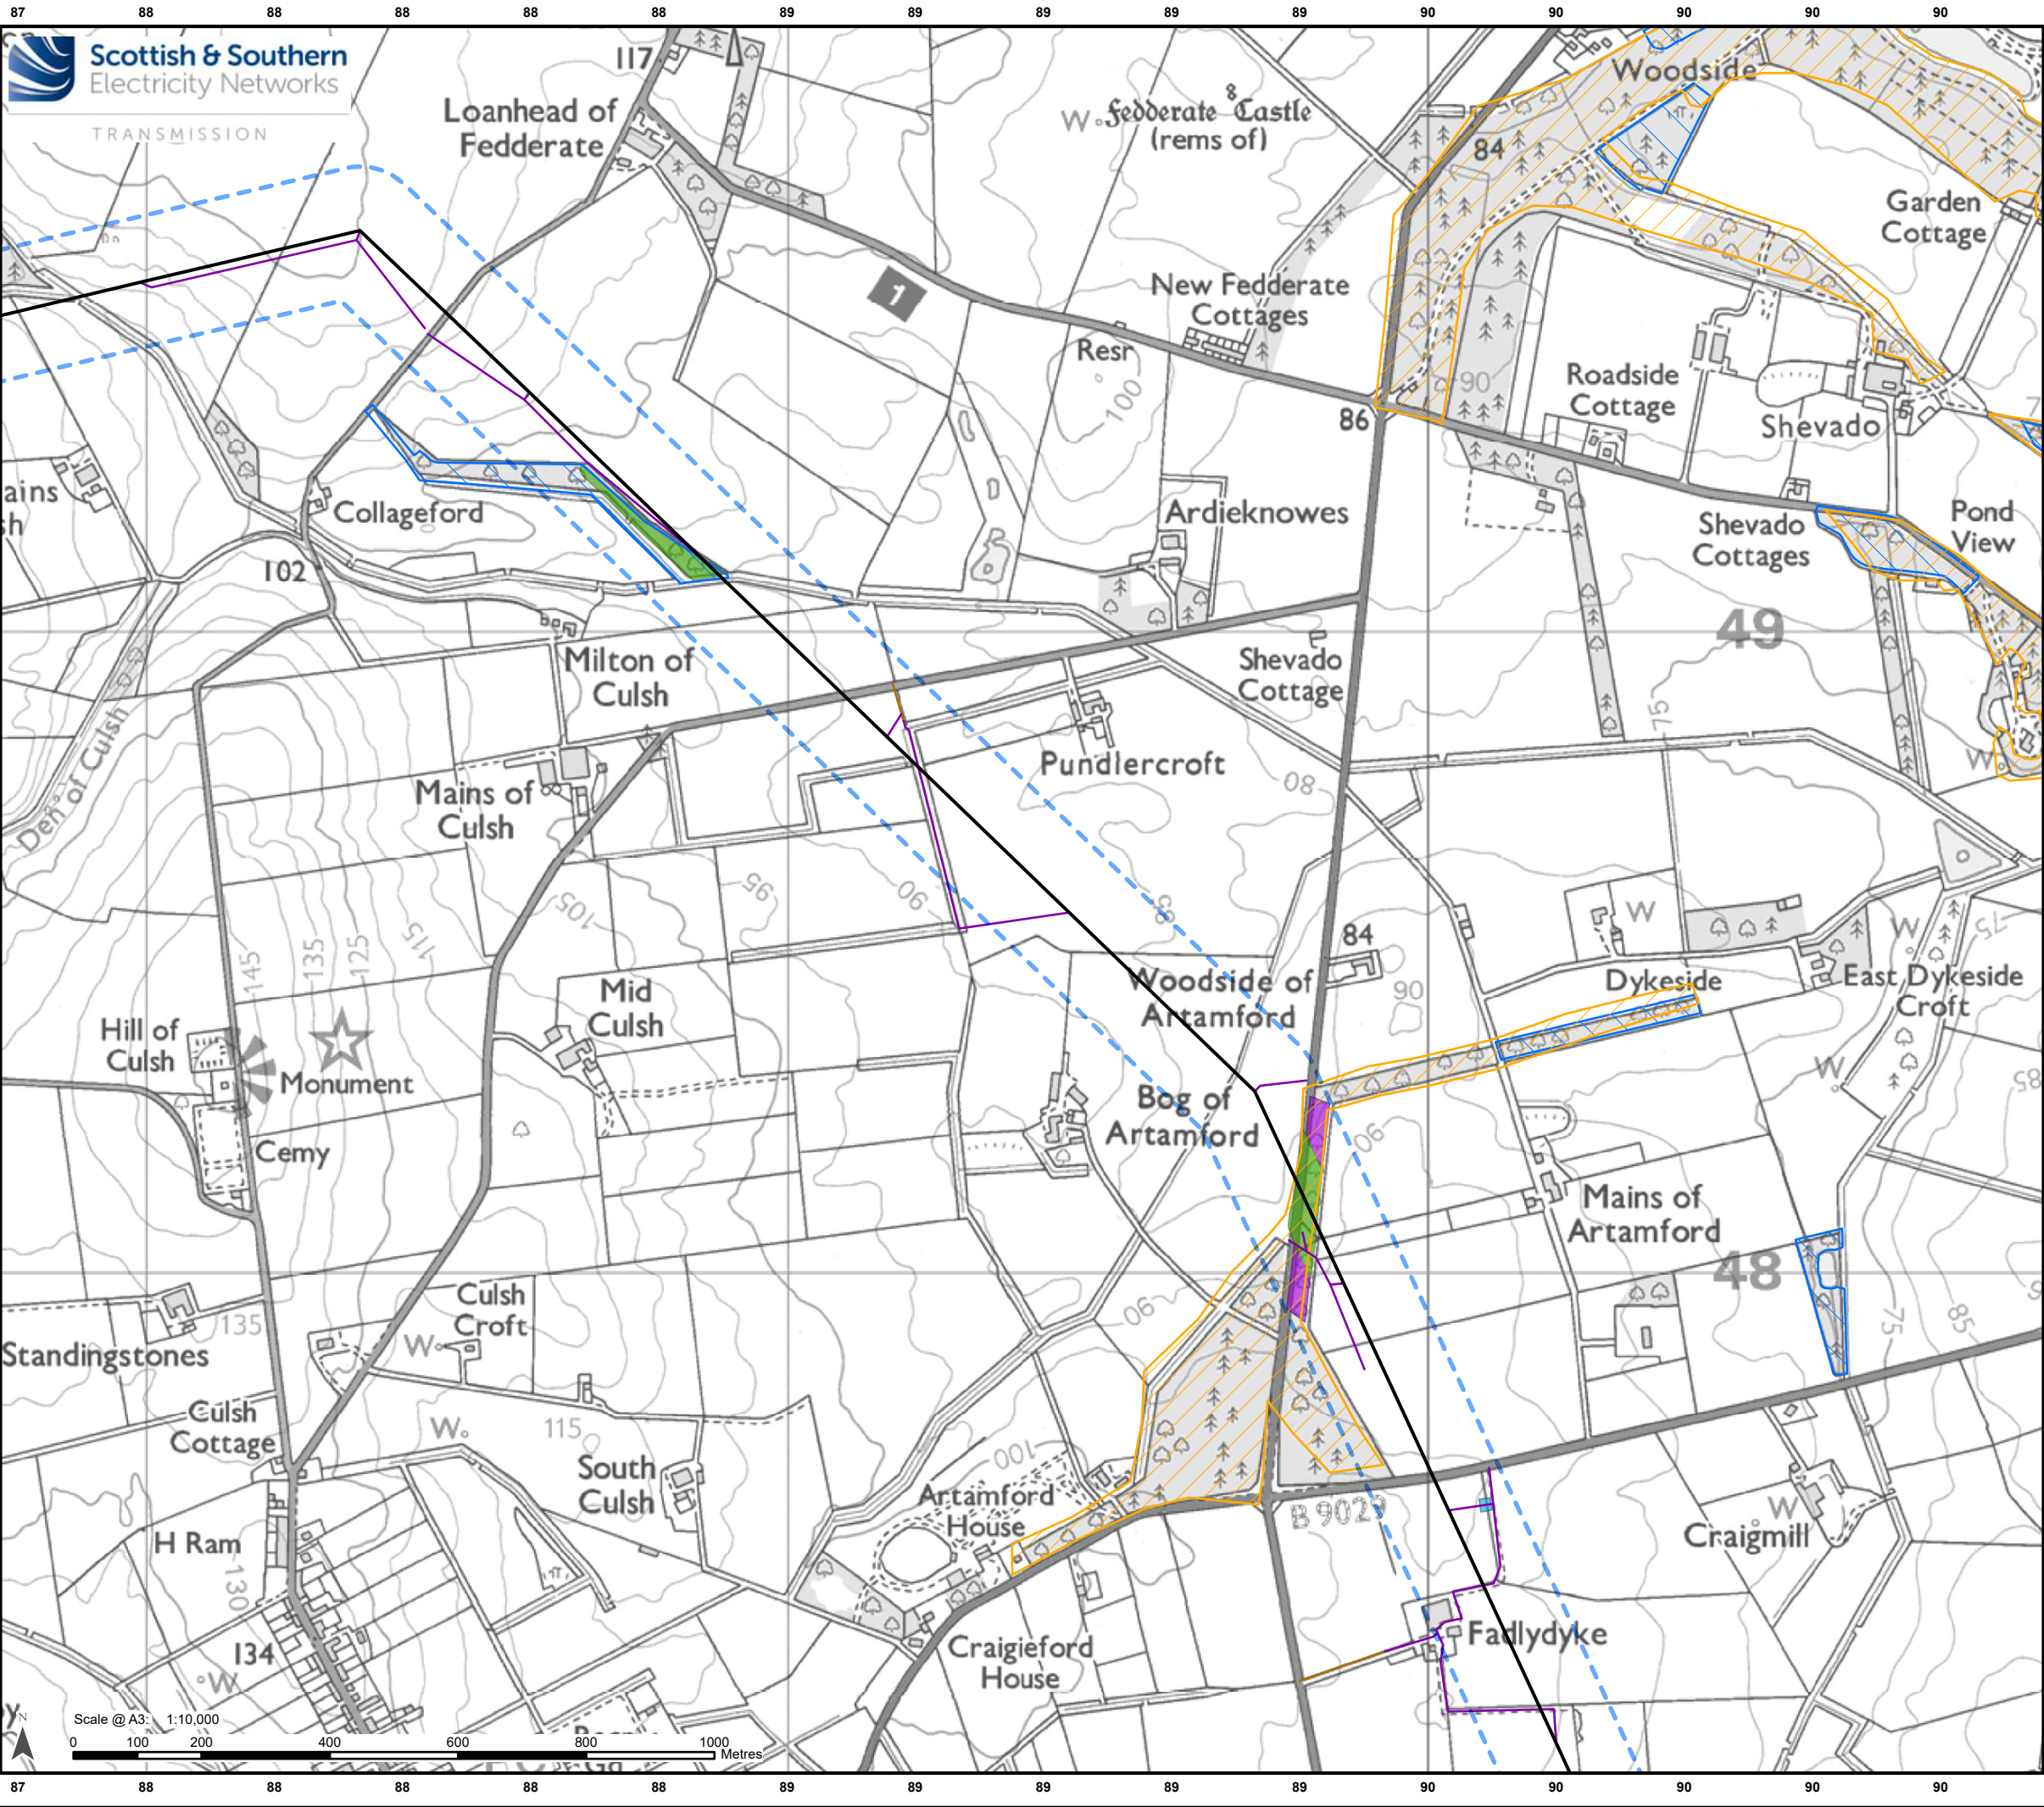

**Legend**

Limit of Deviation – Proposed Towers and OHL Alignment\*

Proposed OHL Alignment - 400 kV

Access Track – Permanent

Access Track – Temporary and ATV

Management Felling Outwith Access Tracks and Operational Corridor

Proposed Operational Corridor Felling

Proposed Access Track Felling

Site of Special Scientific Interest

Native Woodland Survey of Scotland

Ancient Woodland of Semi-Natural Origin

Long-Established Woodland of Plantation Origin

**Development for which Section 37 Consent is Sought**

**Ancillary Development**

**Proposed Felling**


**Environmental Constraints**

\*Note: Excludes temporary towers and temporary OHL alignments.



Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |
|-----------|-------------------------------------------------------------------------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project             |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 42 of 45 |
| Drawn by: | MAL                                                                           |
| Date:     | 21/08/2025                                                                    |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |

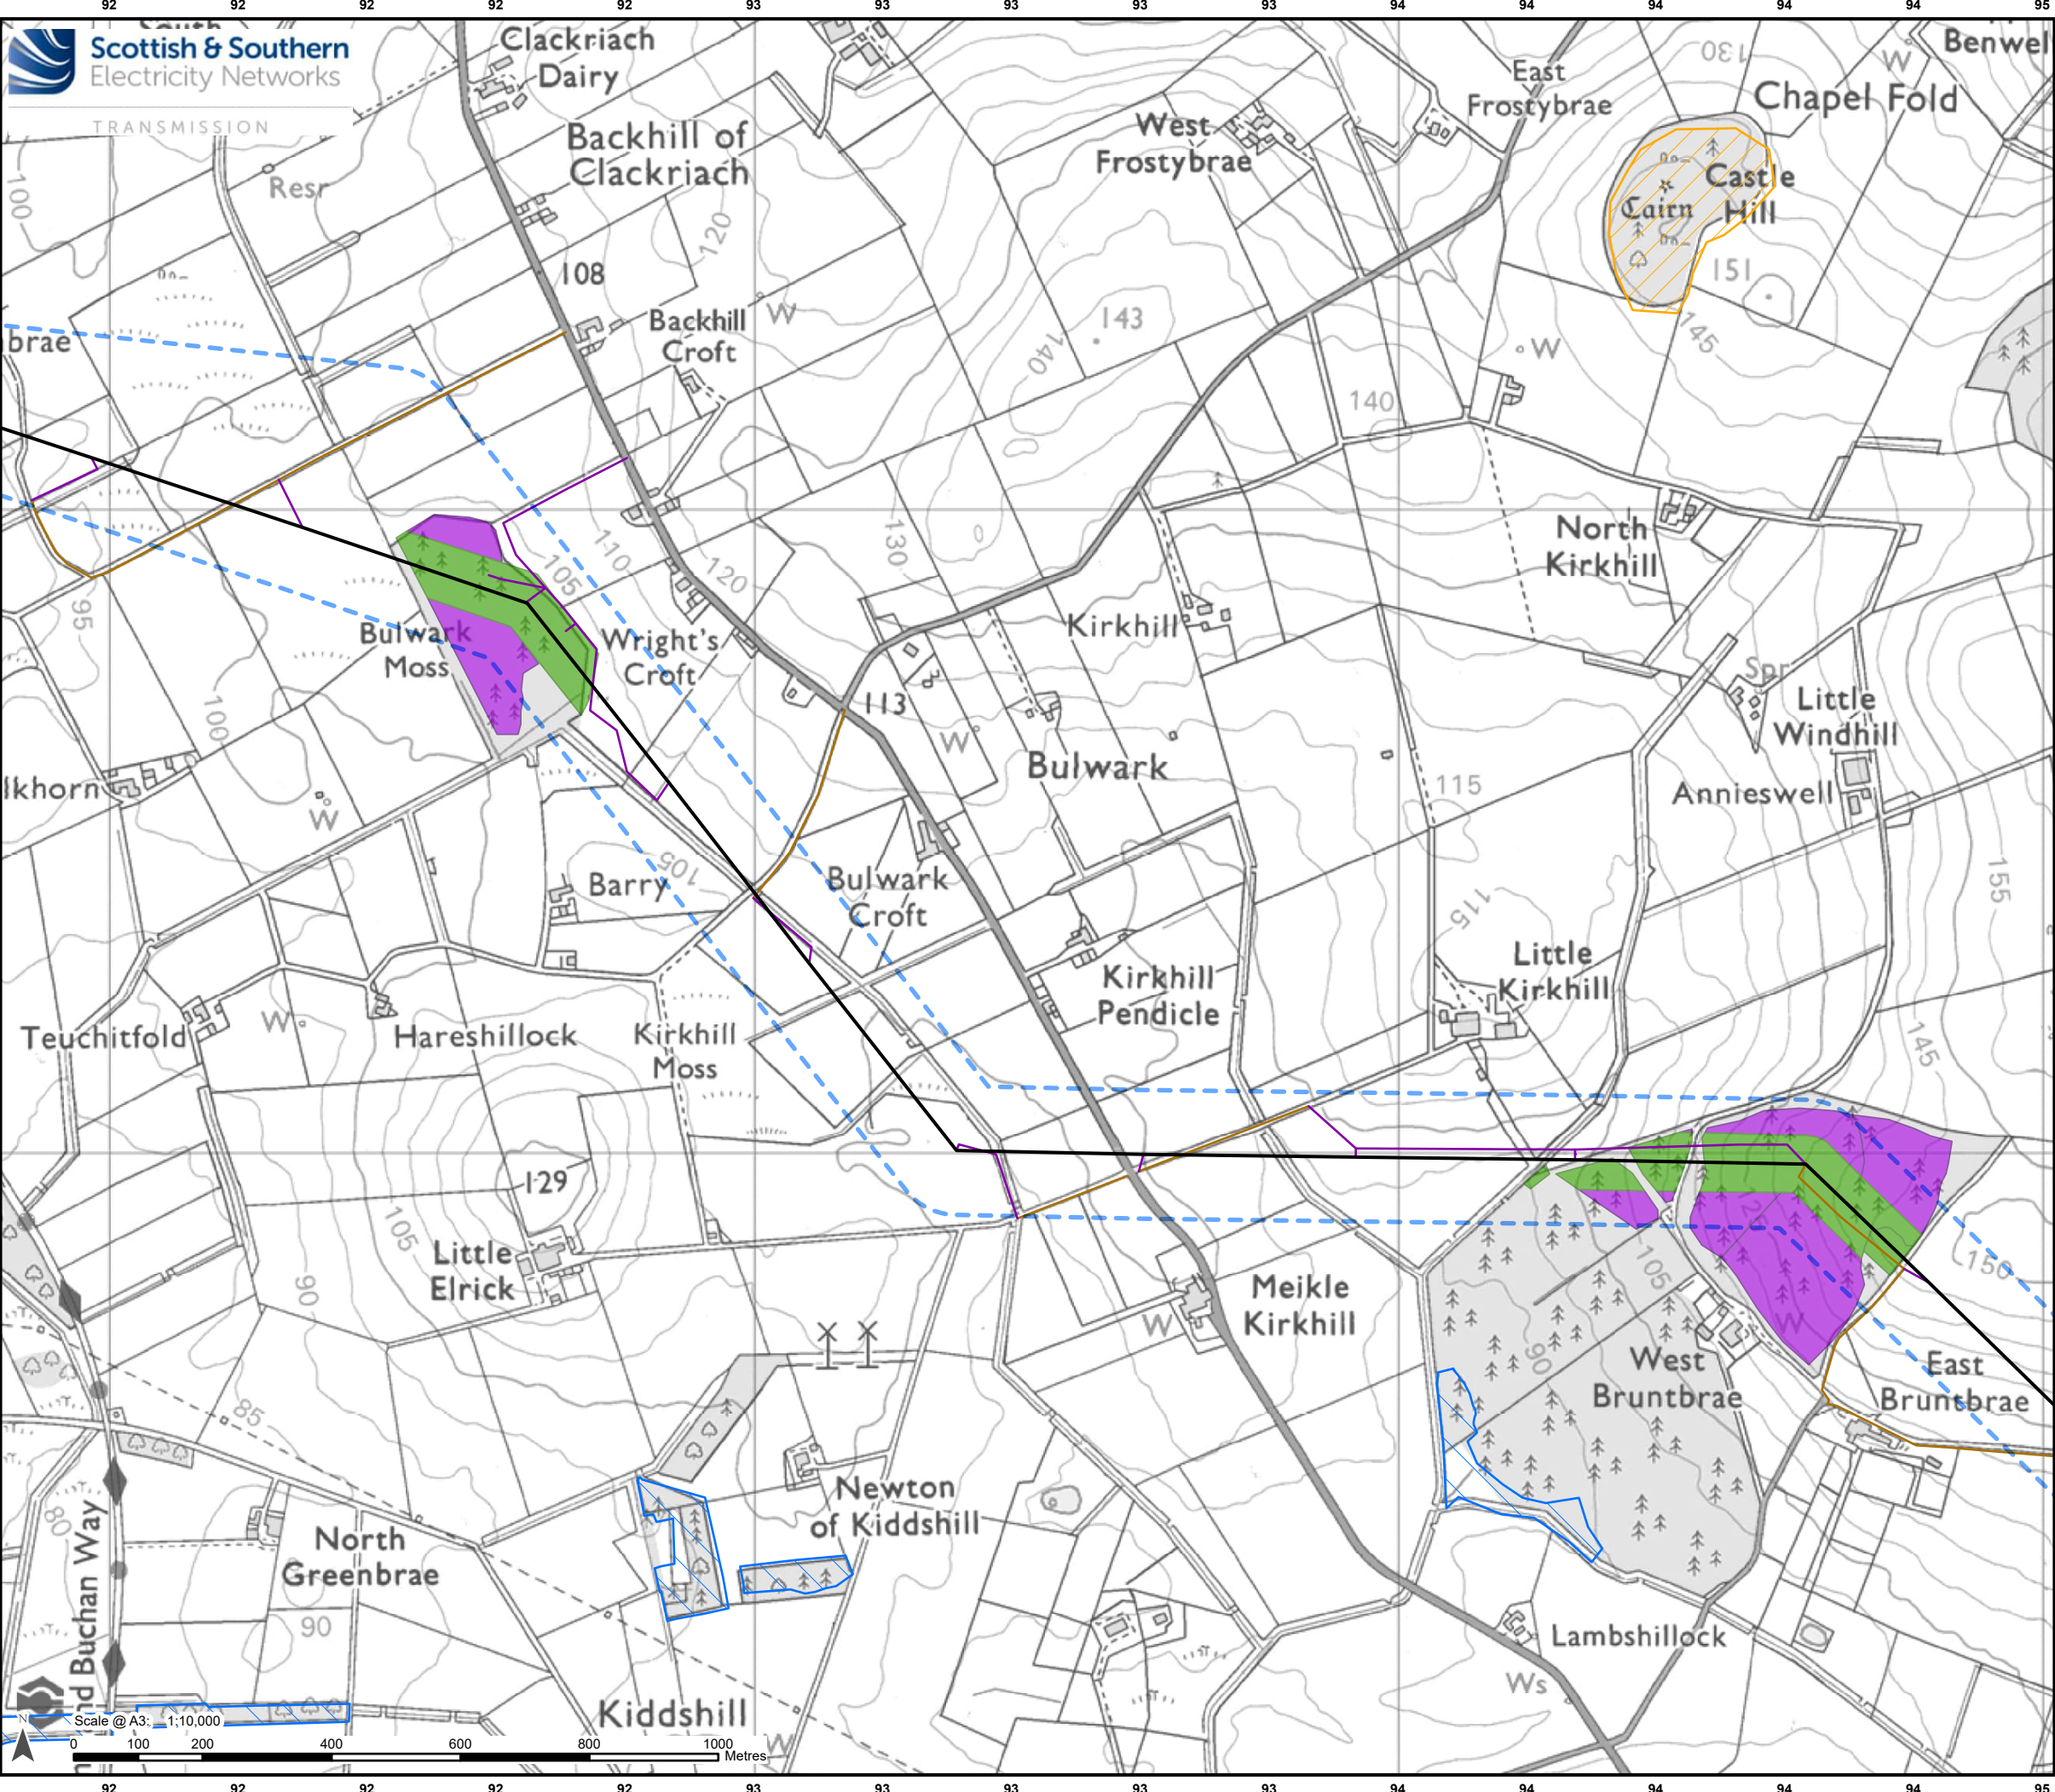

**Legend**


- Limit of Deviation – Proposed Towers and OHL Alignment\*
- Proposed OHL Alignment - 400 kV
- Ancillary Development**
  - Access Track – Permanent
  - Access Track – Temporary and ATV
- Proposed Felling**
  - Management Felling Outwith Access Tracks and Operational Corridor
  - Proposed Operational Corridor Felling
- Environmental Constraints**
  - Site of Special Scientific Interest
  - Native Woodland Survey of Scotland
  - Ancient Woodland of Semi-Natural Origin
  - Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |       |            |
|-----------|-------------------------------------------------------------------------------|-------|------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project             |       |            |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 43 of 45 |       |            |
| Drawn by: | MAL                                                                           | Date: | 21/08/2025 |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |       |            |

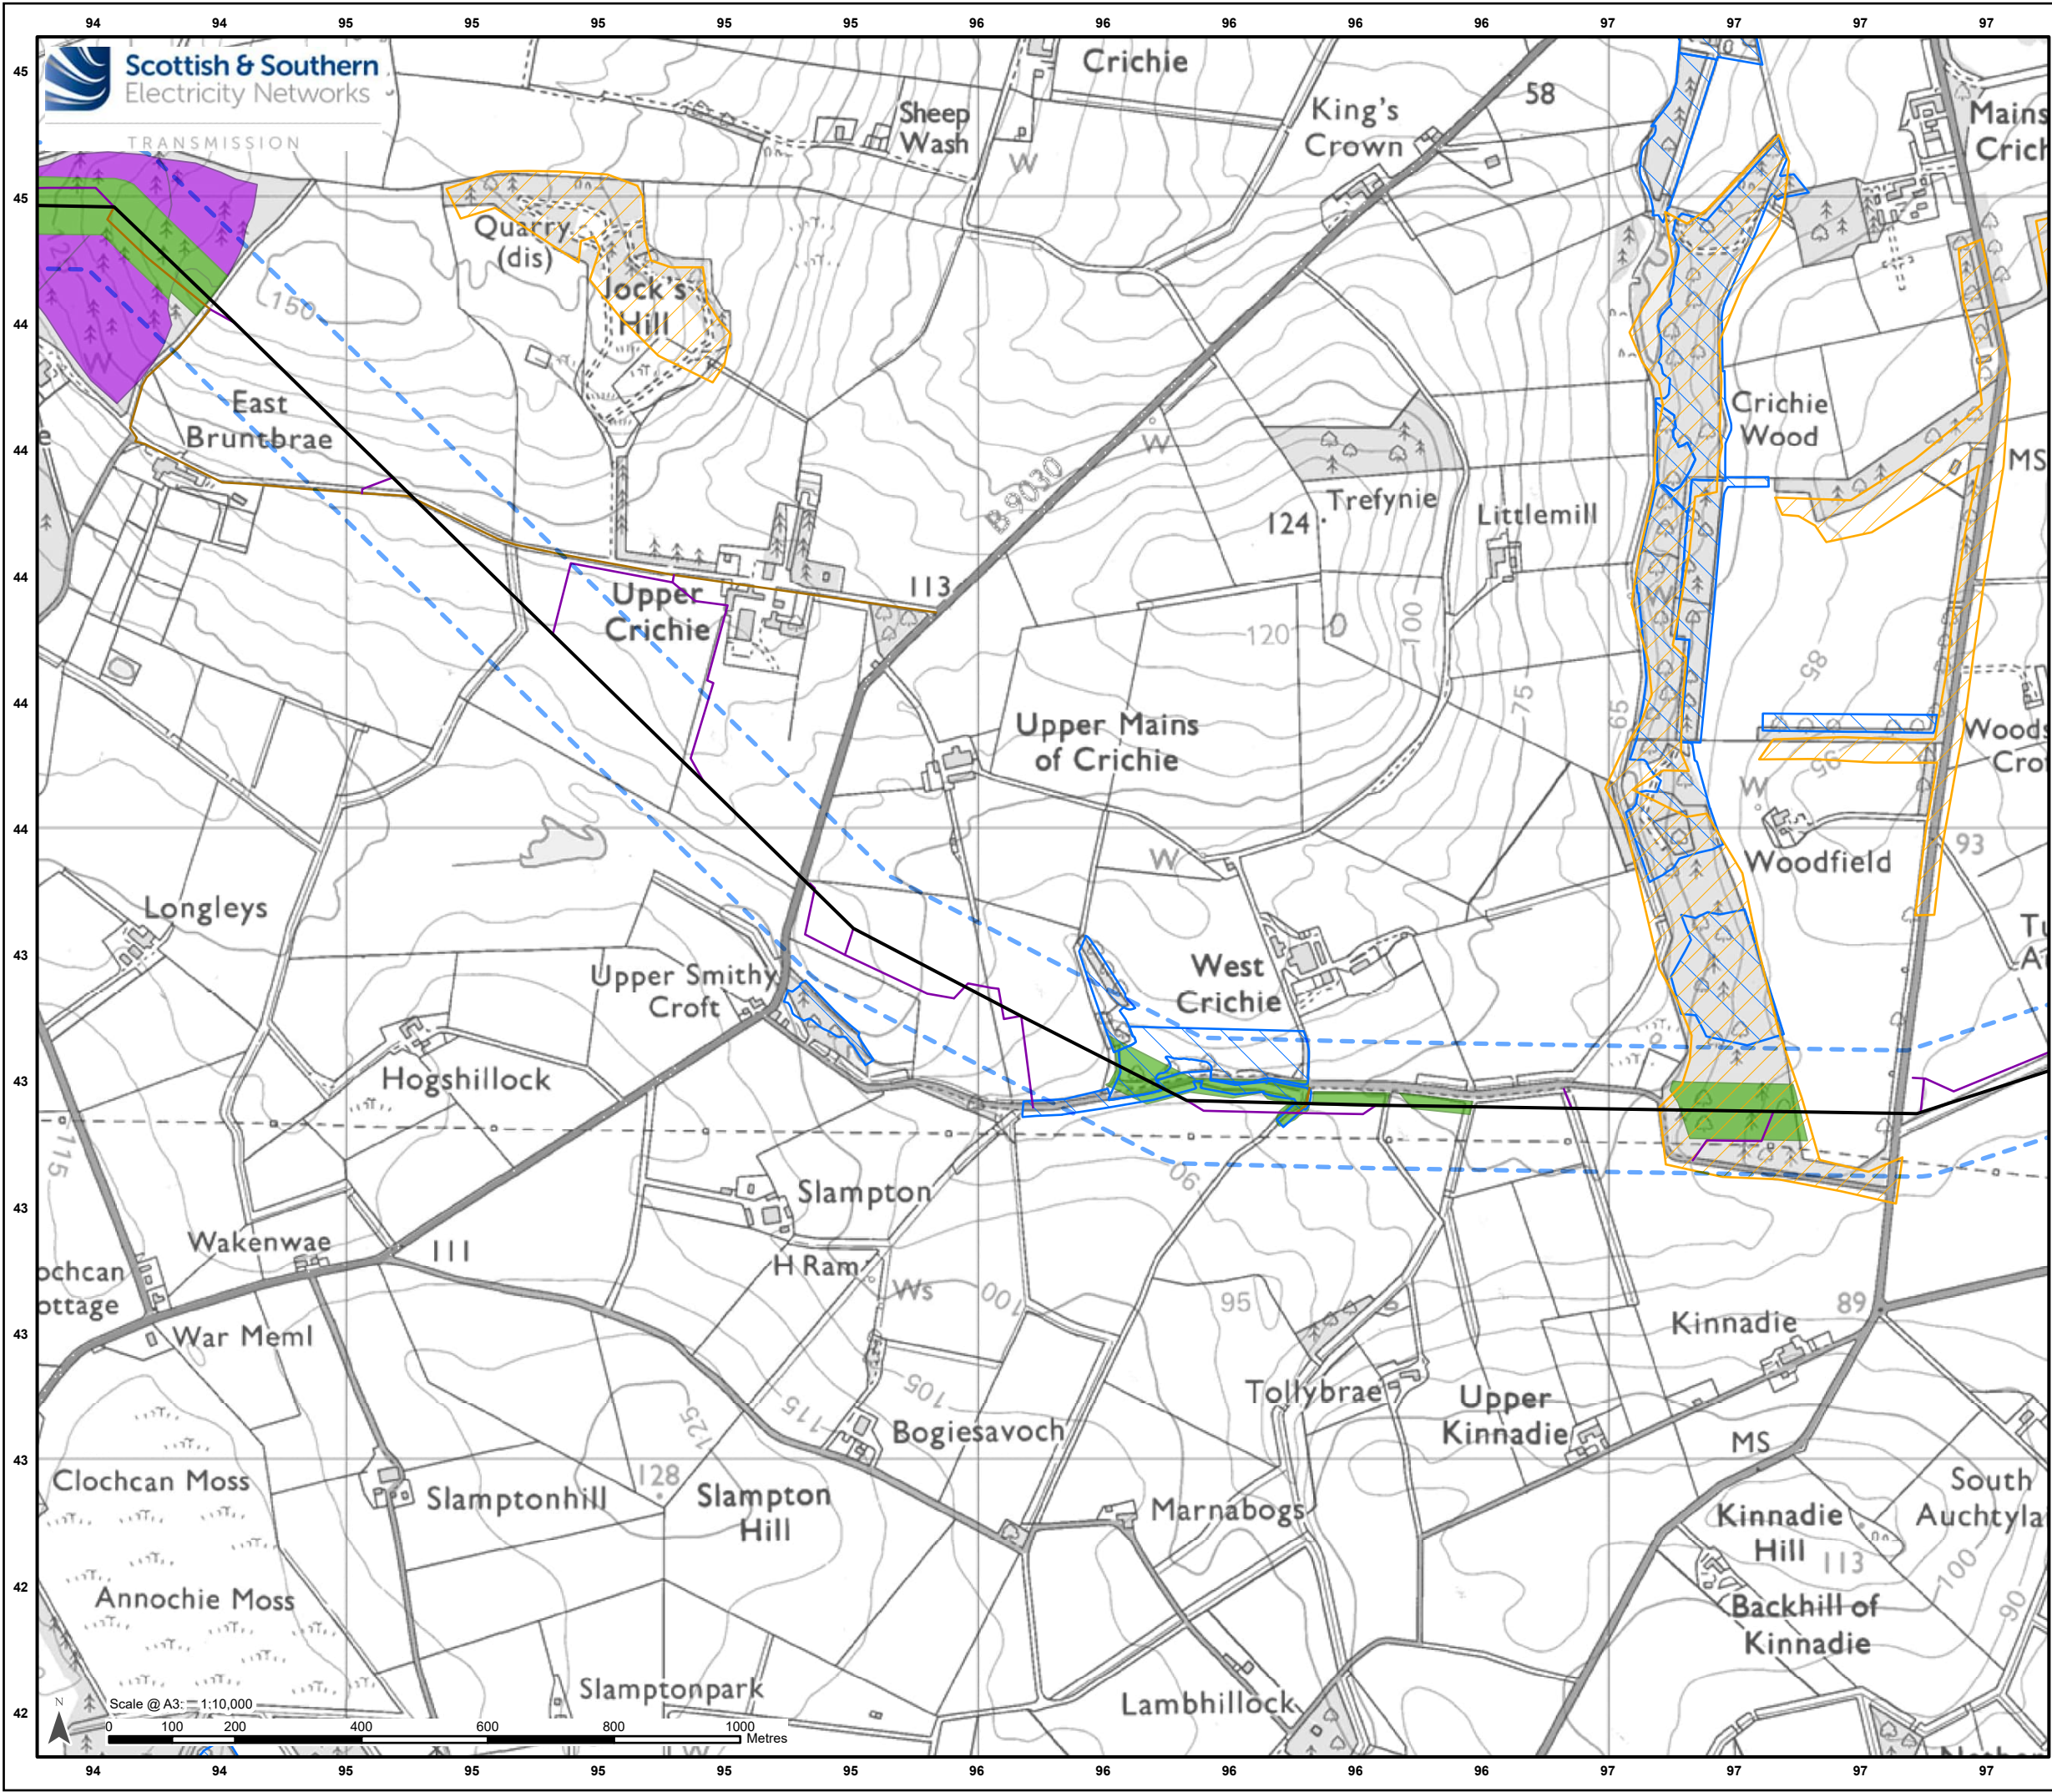

### Legend

- Limit of Deviation – Proposed Towers and OHL Alignment\*

### Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV

### Ancillary Development

- Access Track – Permanent
- Access Track – Temporary and ATV

### Proposed Felling

- Management Felling Outwith Access Tracks and Operational Corridor
- Proposed Operational Corridor Felling

### Environmental Constraints

- Site of Special Scientific Interest
- Native Woodland Survey of Scotland
- Ancient Woodland of Semi-Natural Origin
- Long-Established Woodland of Plantation Origin

\*Note: Excludes temporary towers and temporary OHL alignments.

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445.  
Copyright NatureScot Contains Ordnance Survey data © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0.  
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                               |                  |
|-----------|-------------------------------------------------------------------------------|------------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project             |                  |
| Title:    | Figure 12.2 - Proposed Felling and Environmental Constraints<br>Page 44 of 45 |                  |
| Drawn by: | MAL                                                                           | Date: 21/08/2025 |
| Drawing:  | B2P-WSP-DA-70092380-185                                                       |                  |