



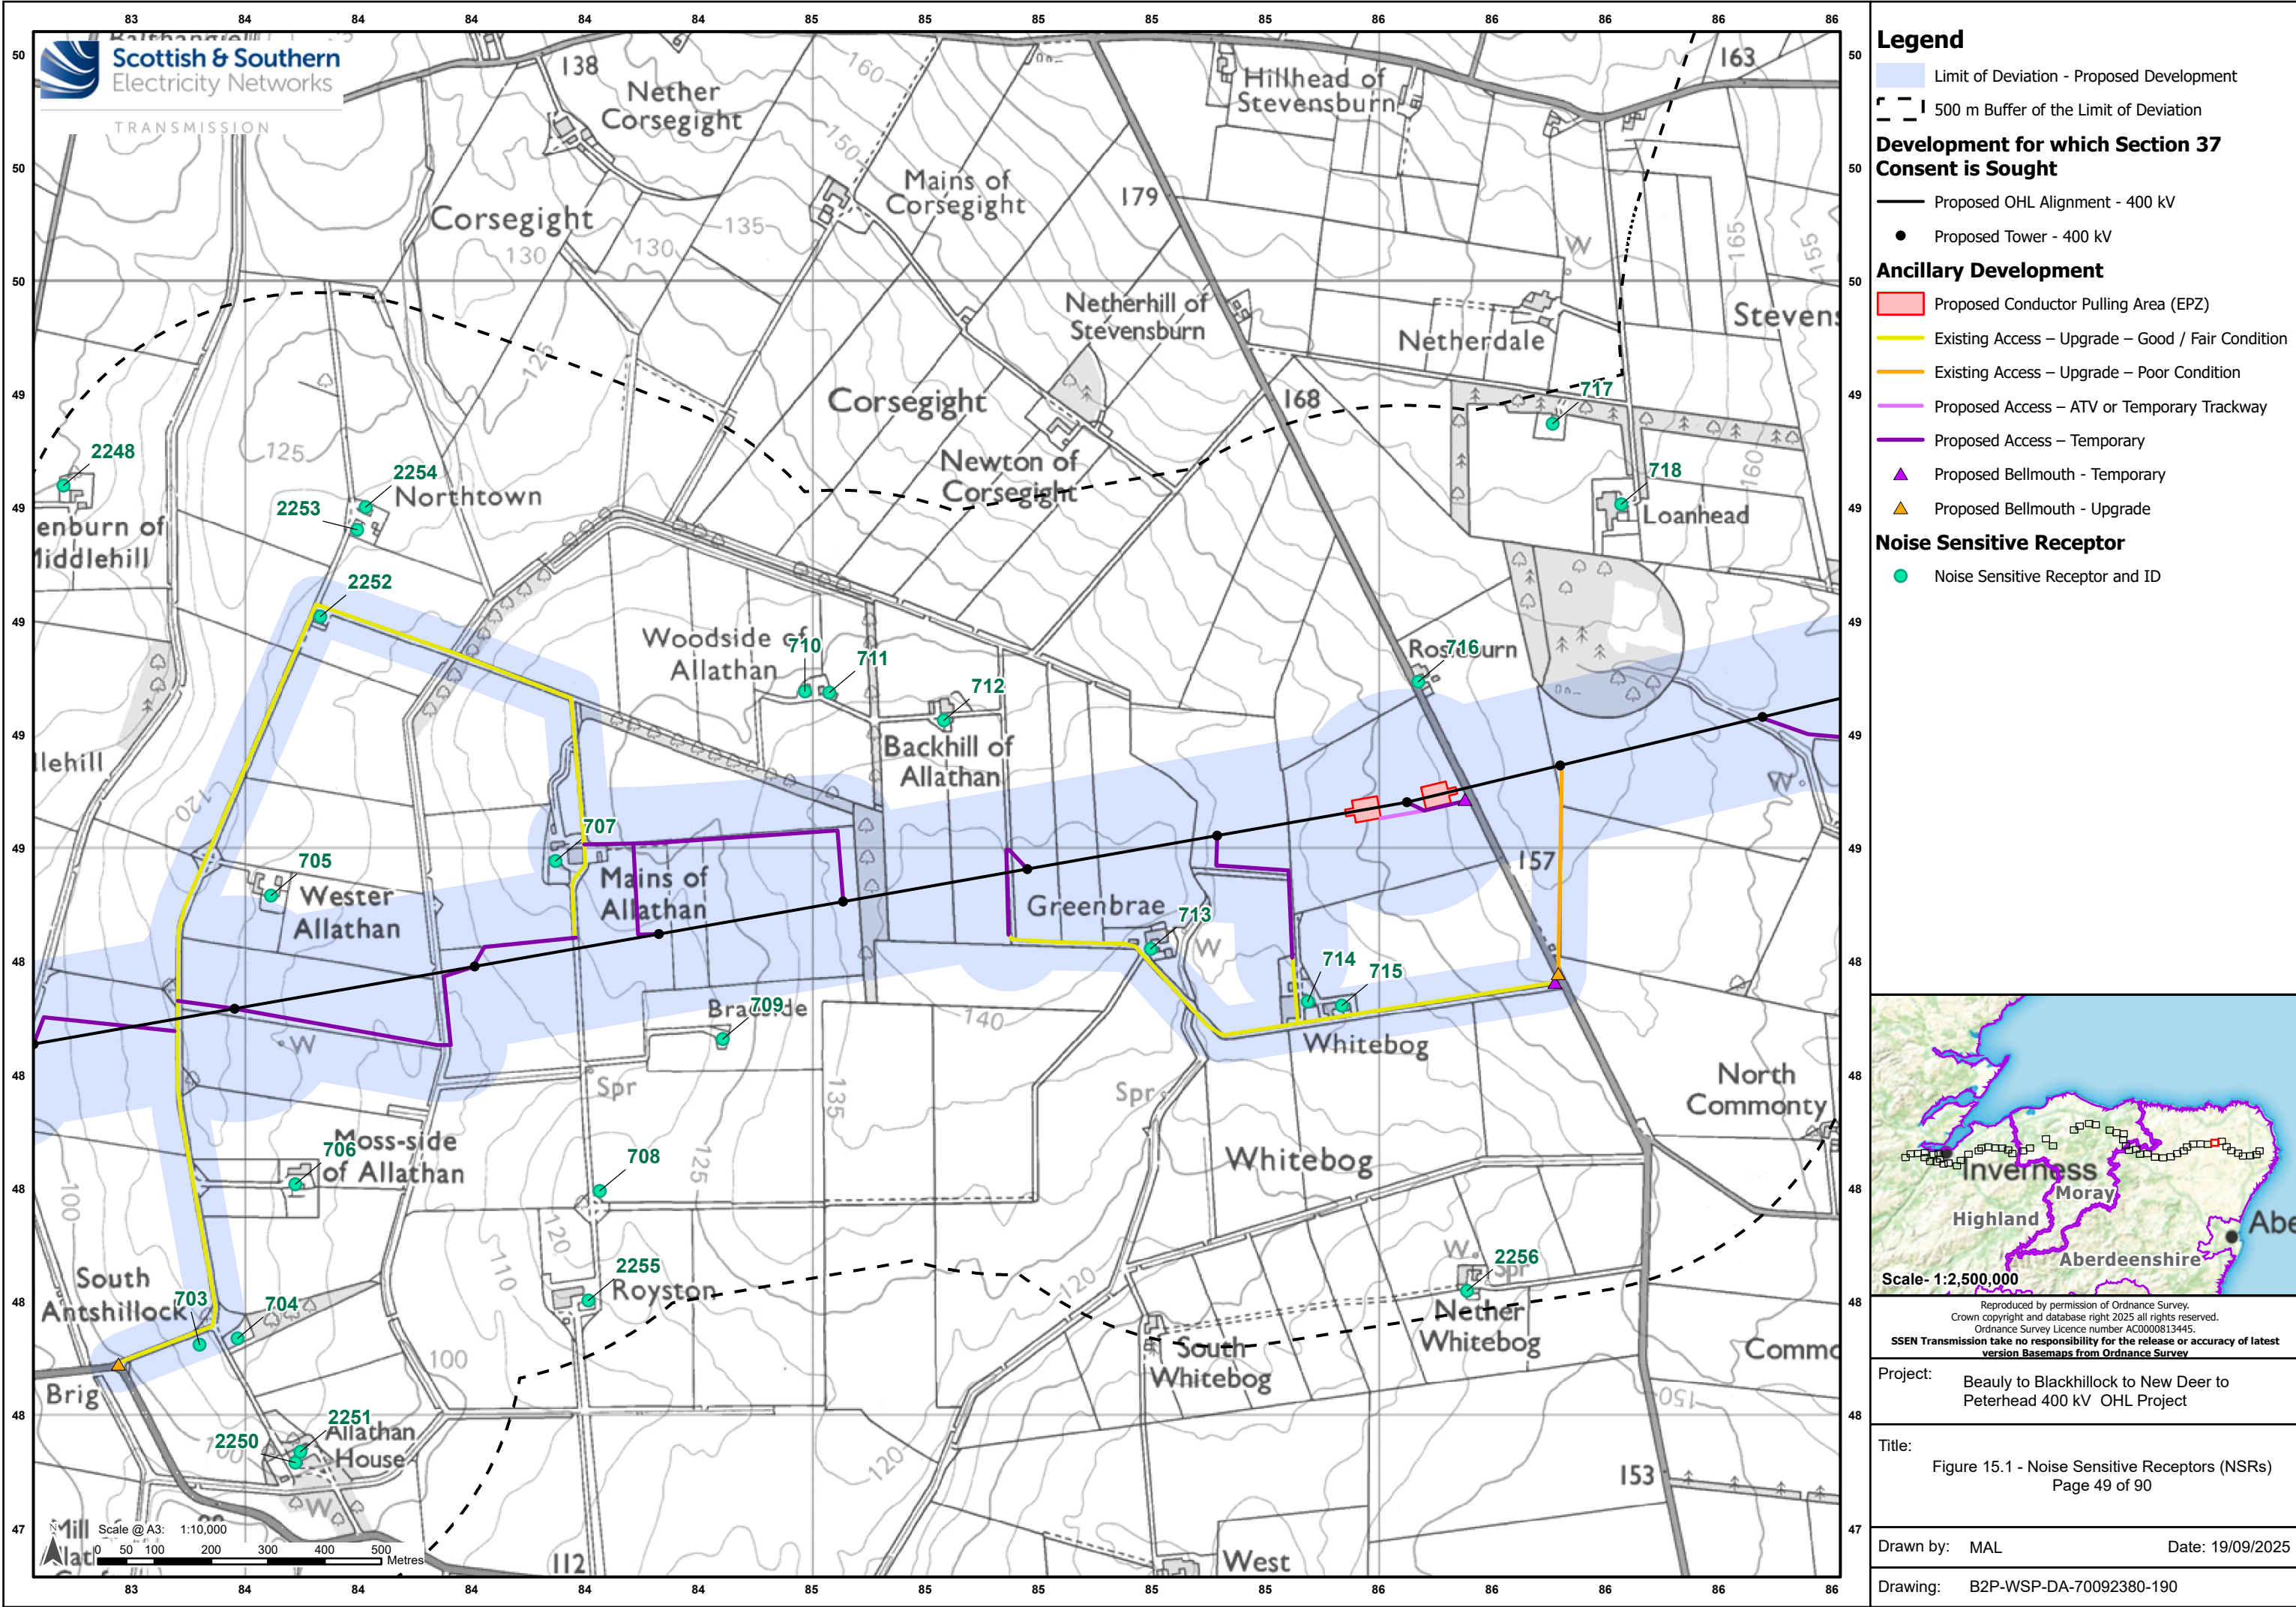

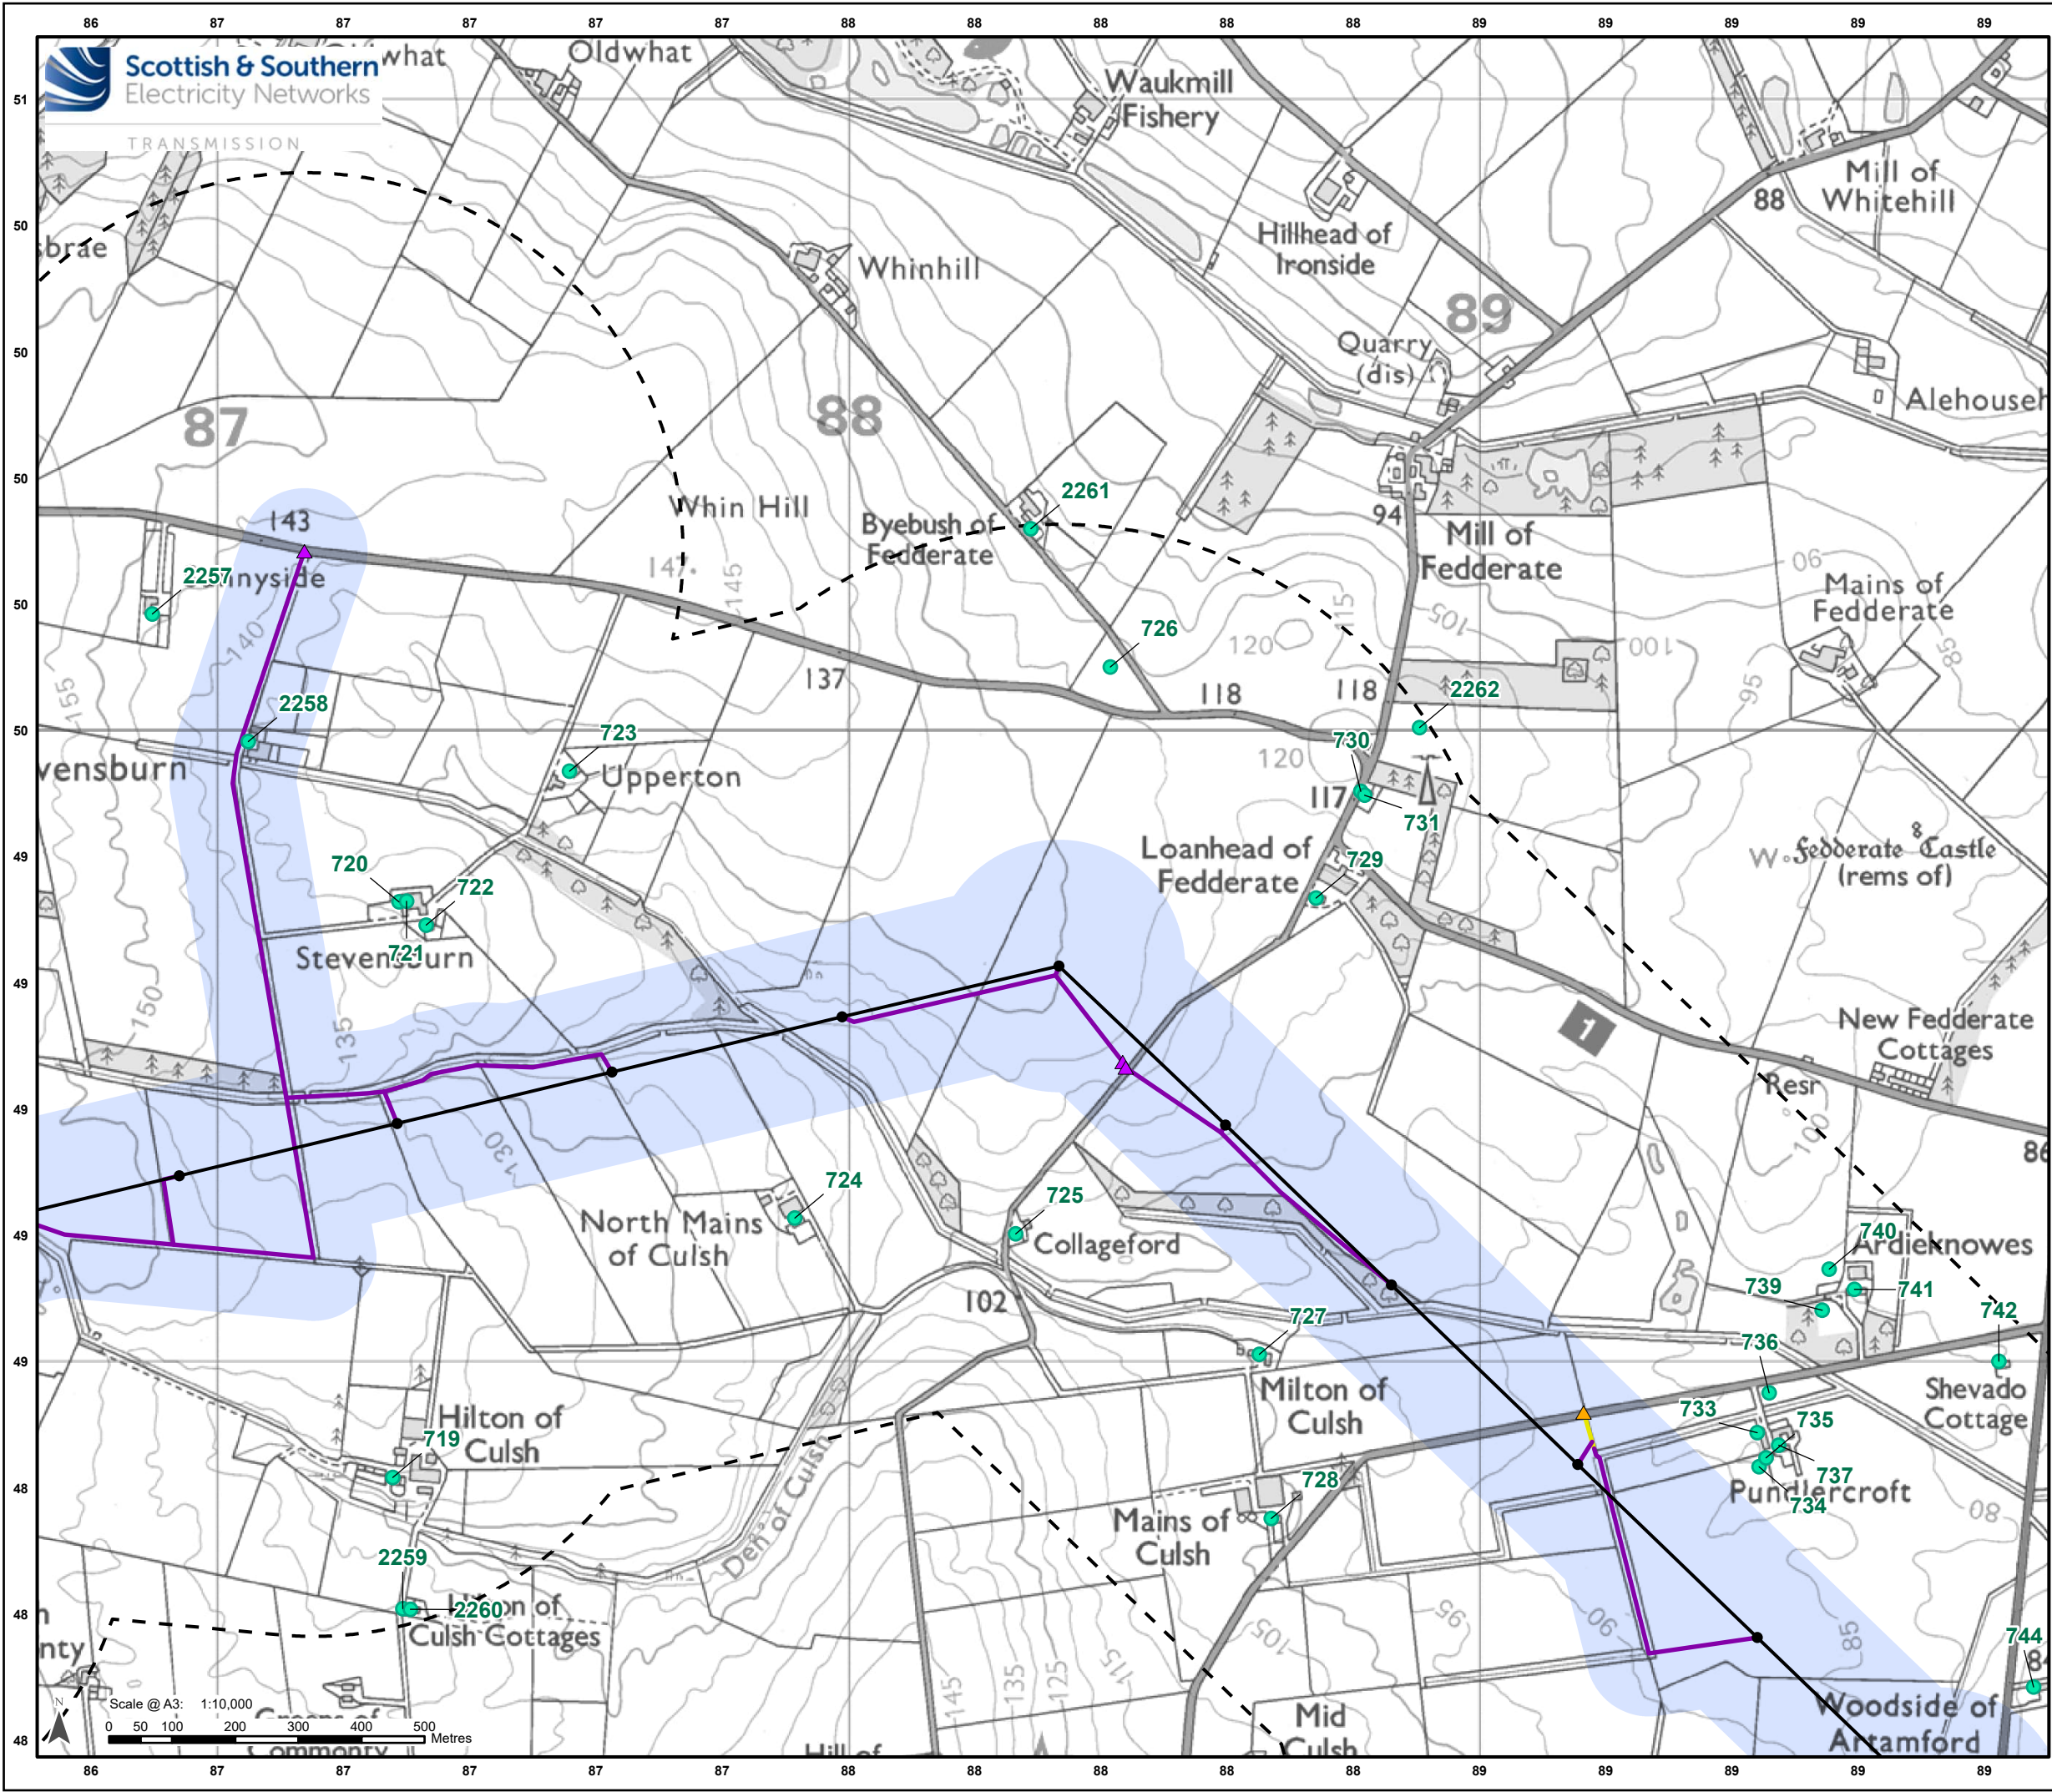

Legend

- Limit of Deviation - Proposed Development
- 500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV
- Existing Access – Upgrade – Good / Fair Condition
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Noise Sensitive Receptor

- Noise Sensitive Receptor and ID

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 50 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

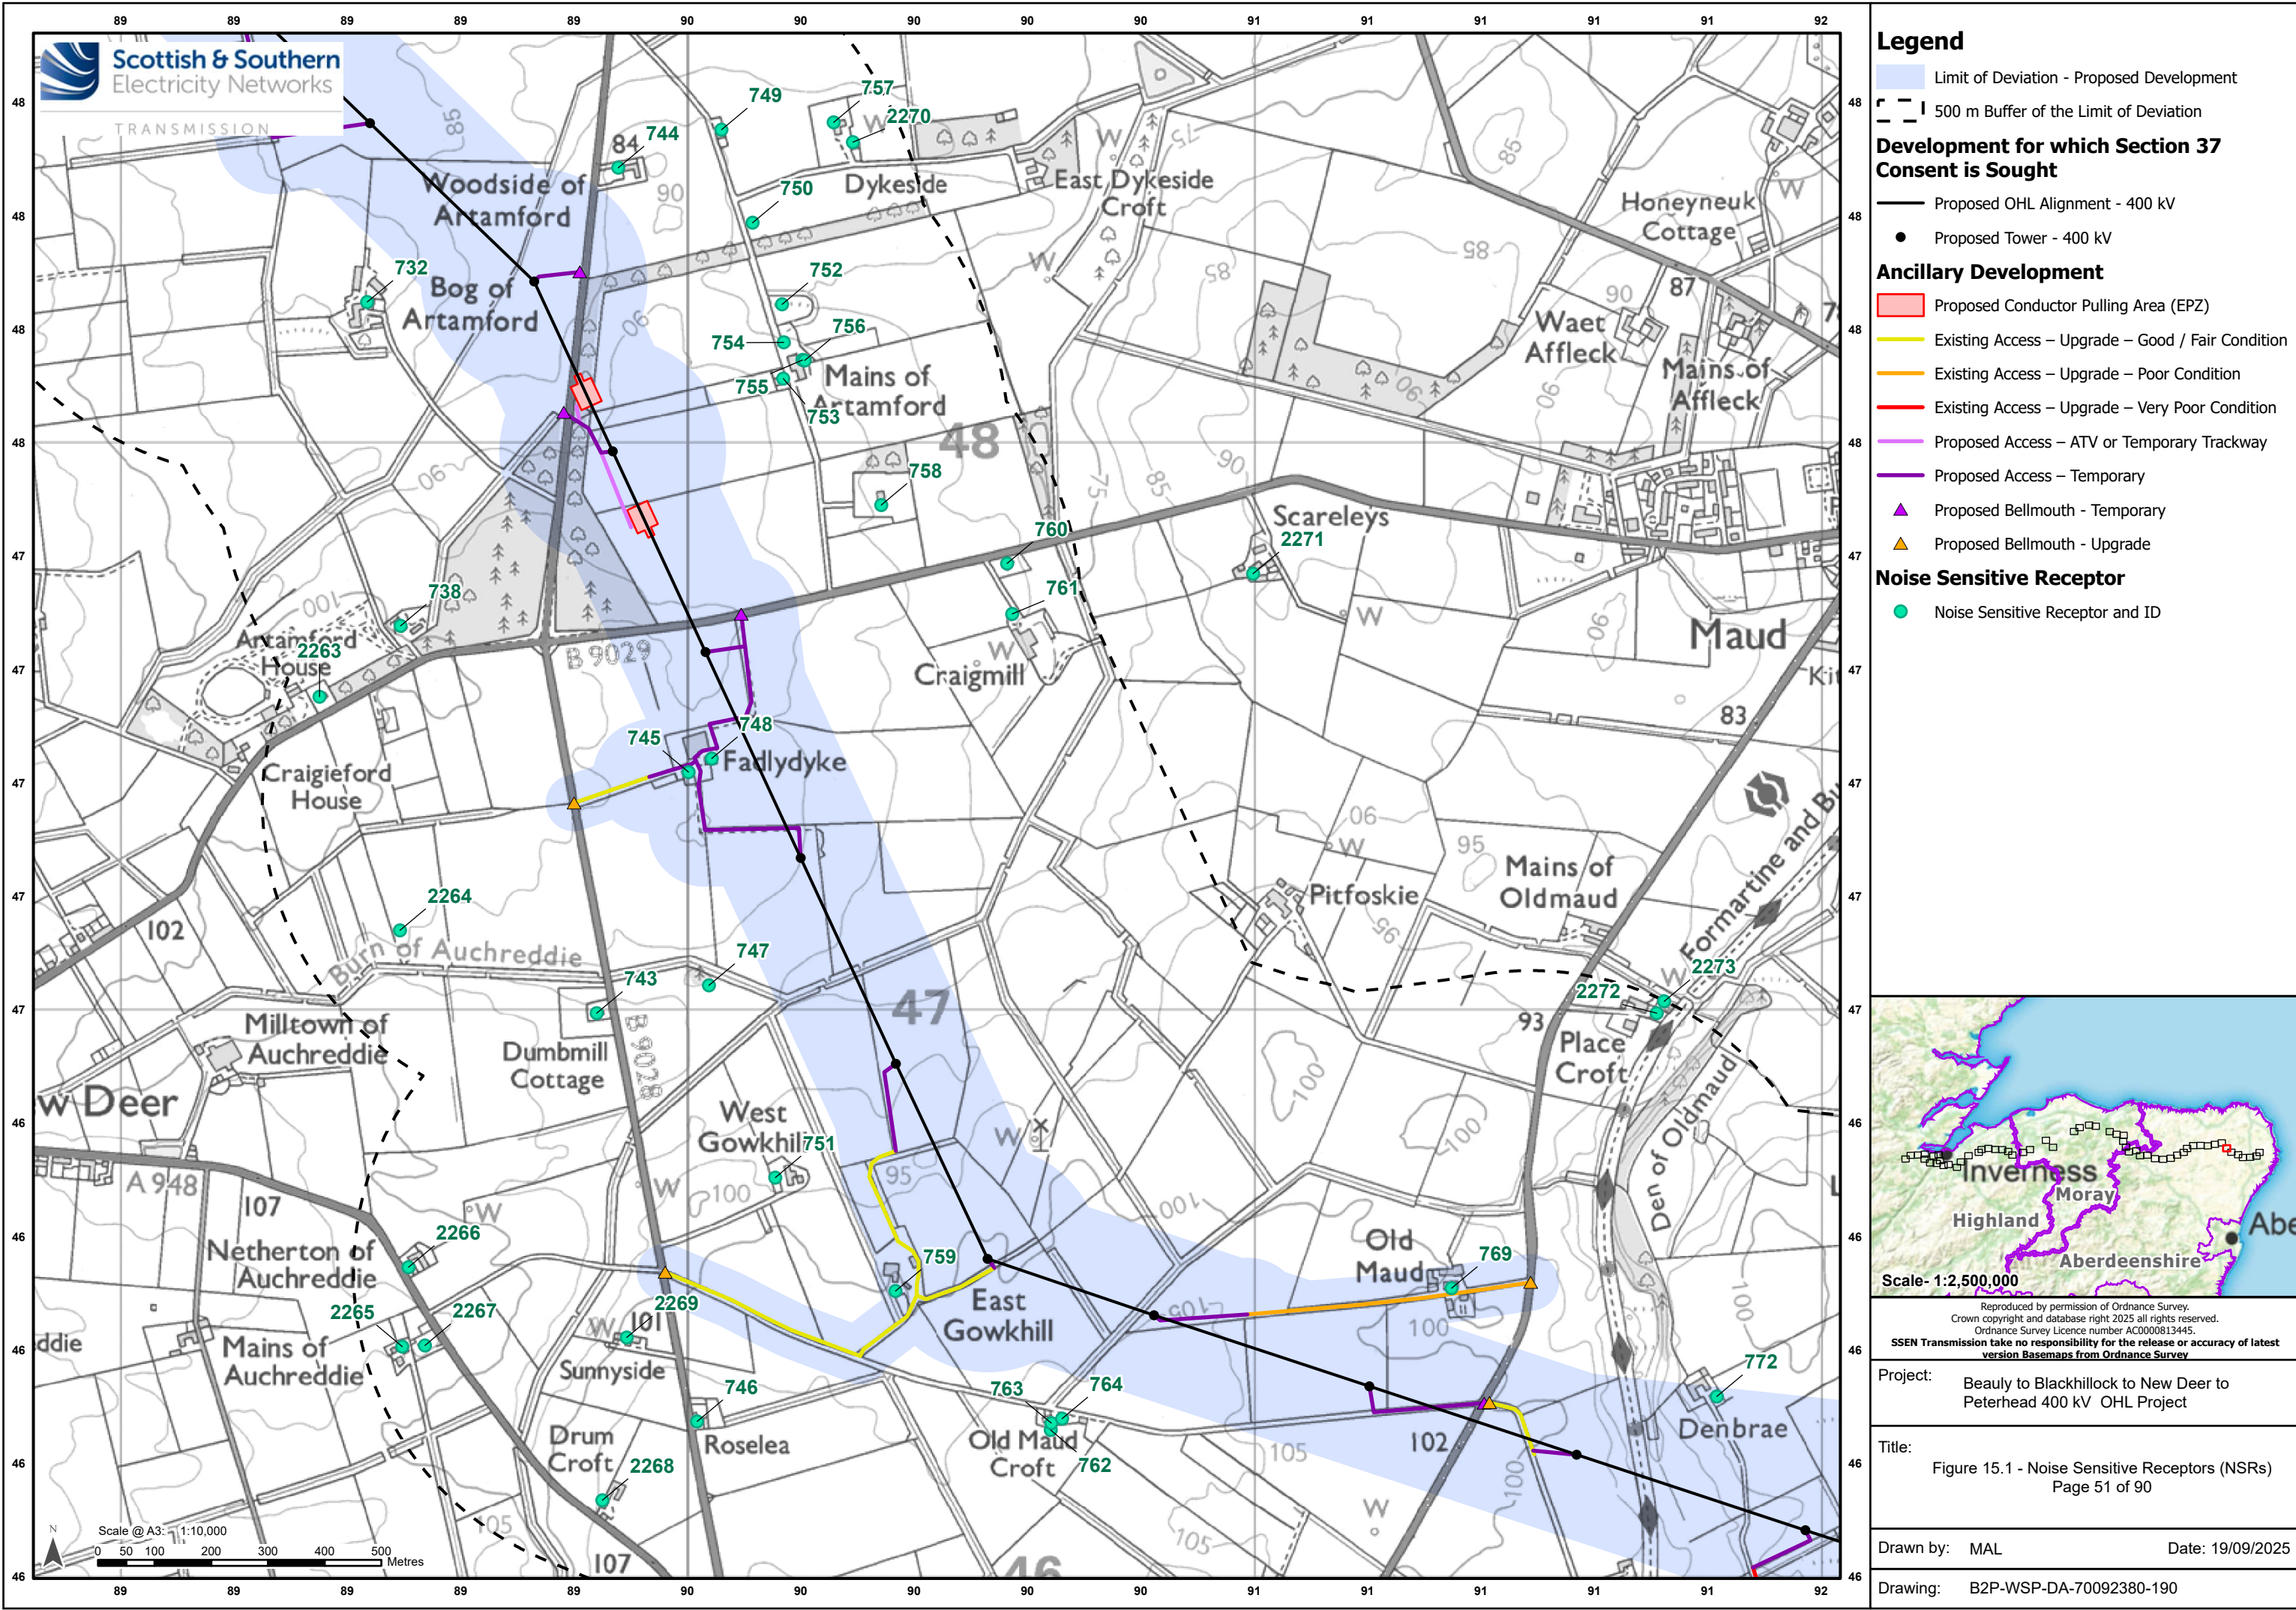

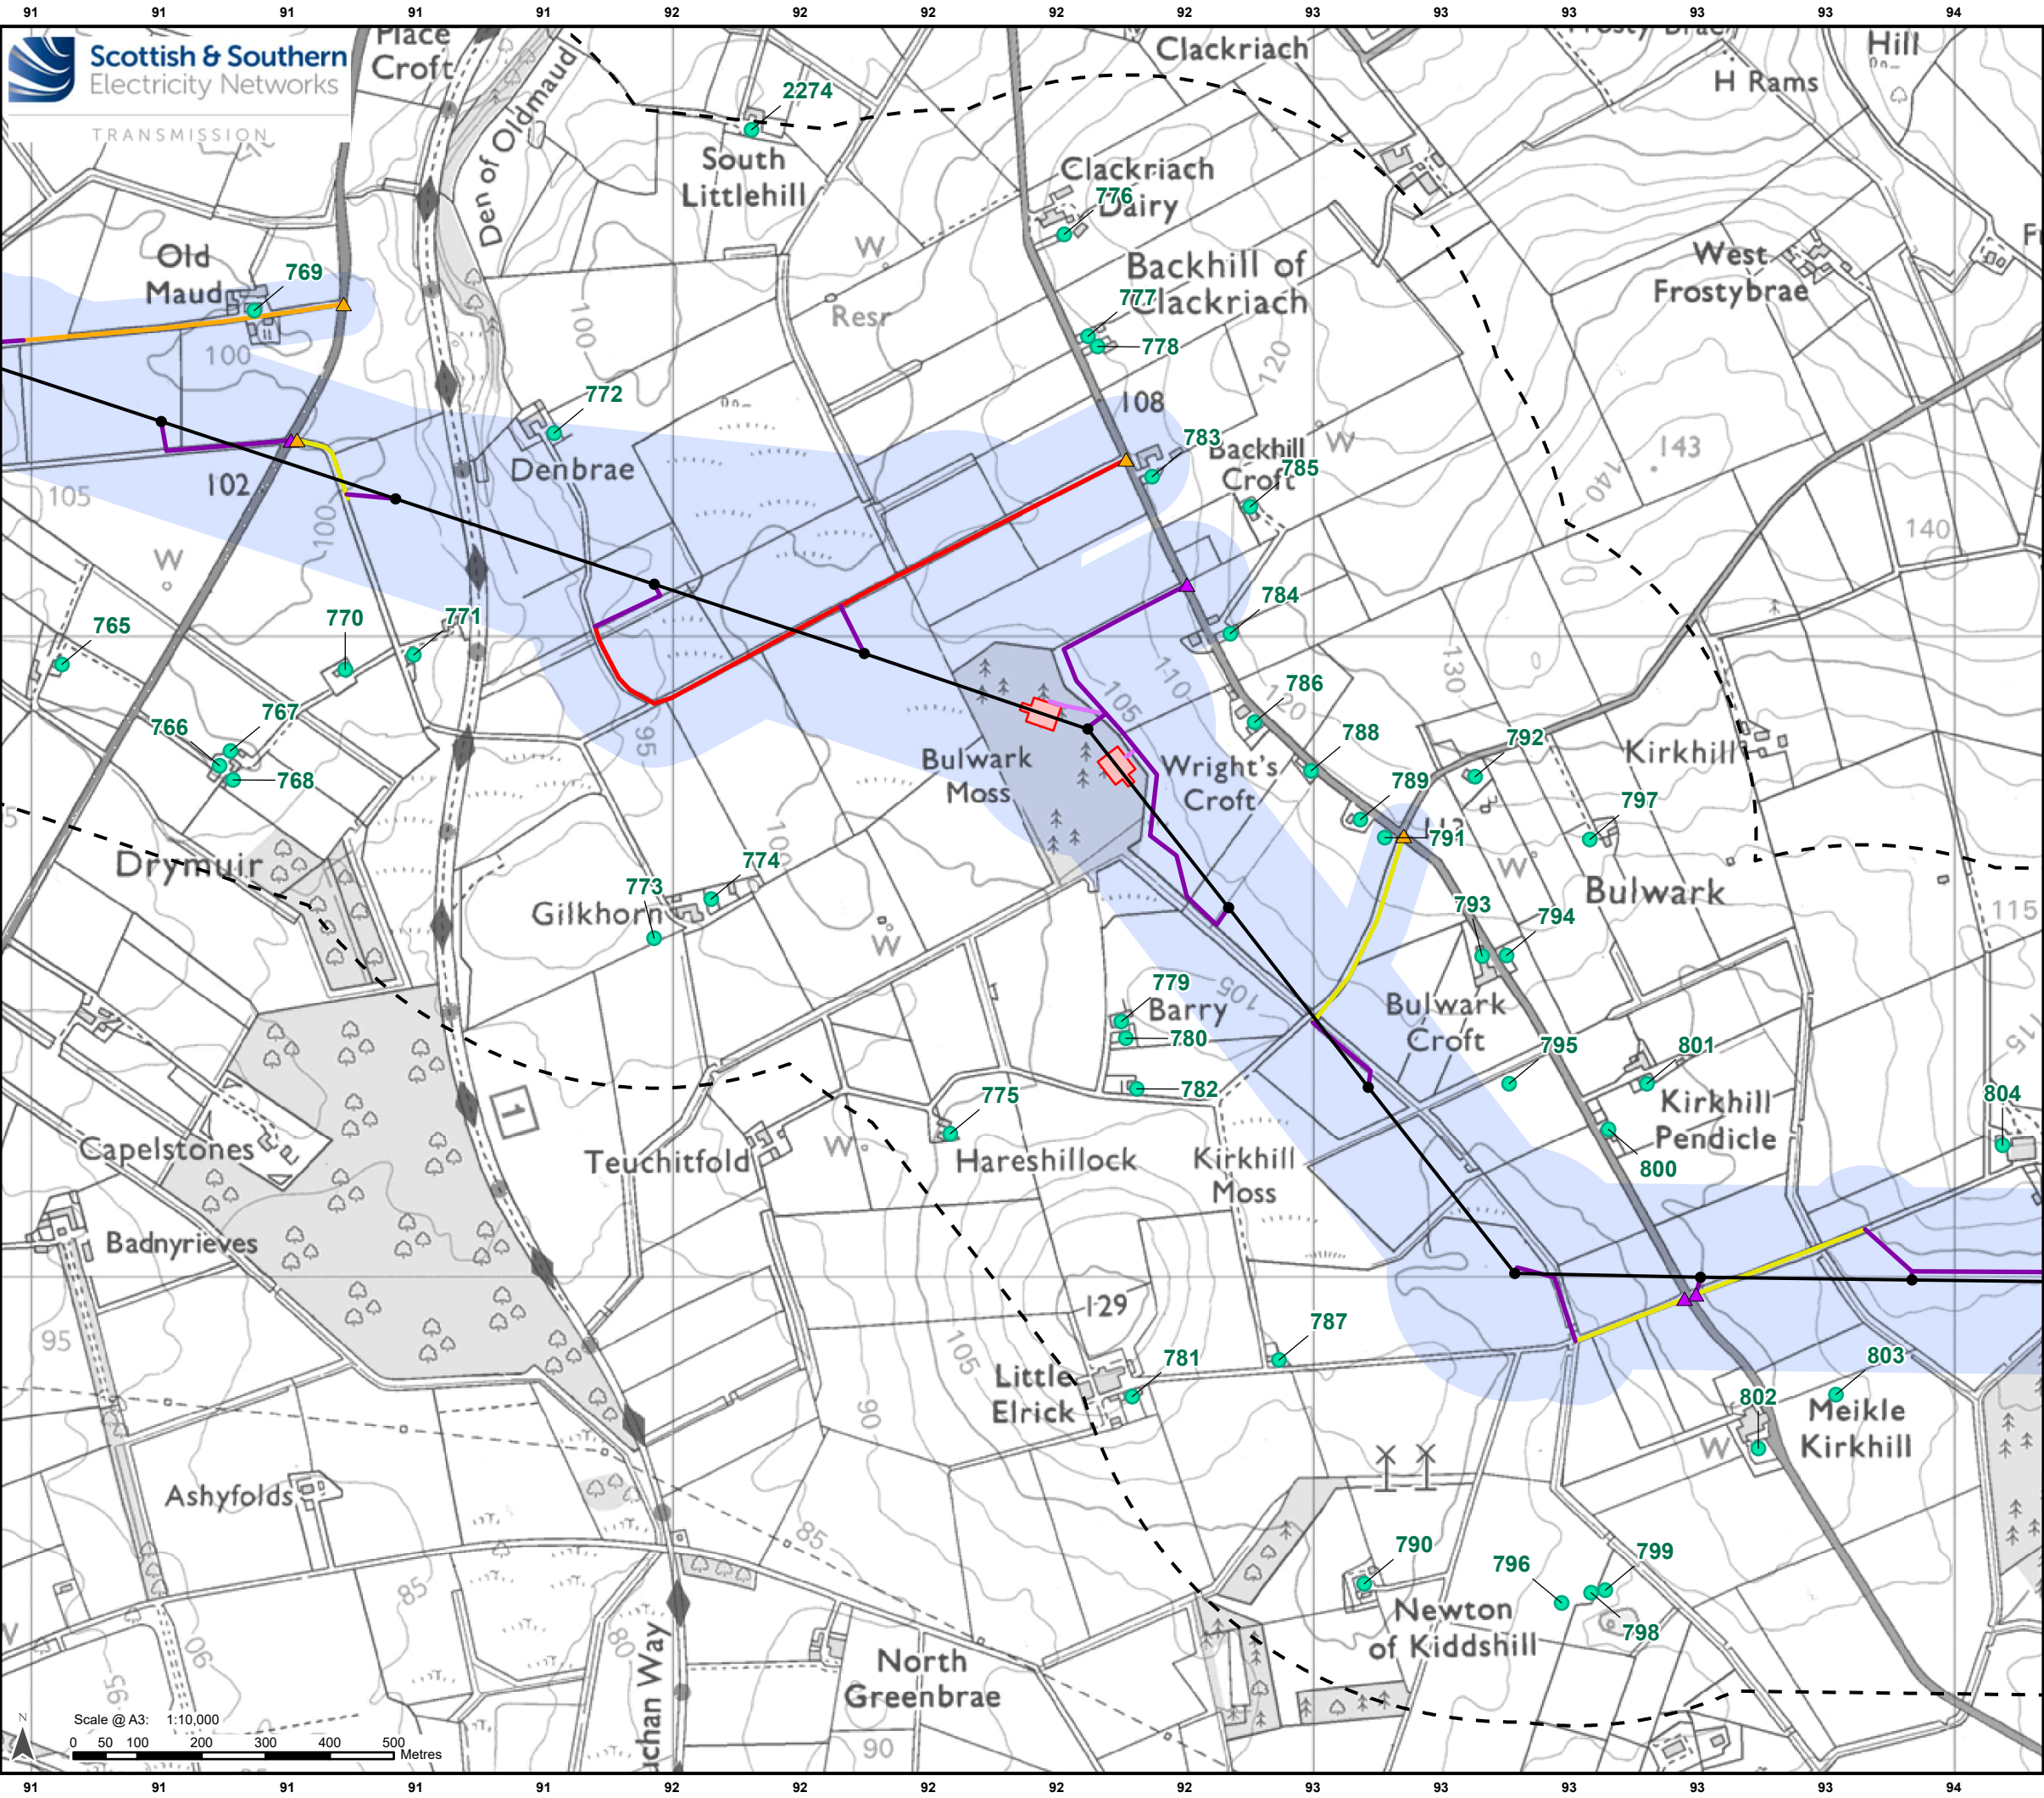

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Existing Access – Upgrade – Very Poor Condition

Proposed Access – ATV or Temporary Trackway


Proposed Access – Temporary

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

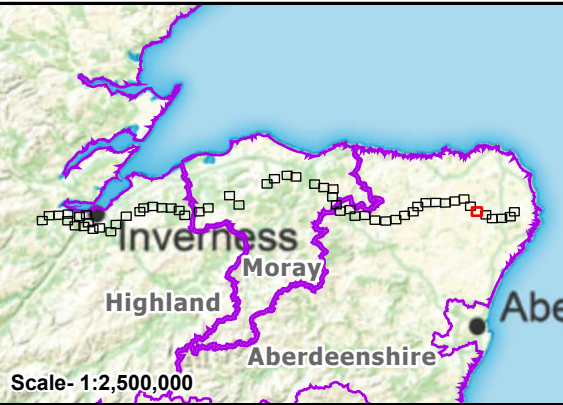

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:

Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title:

Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 52 of 90

Drawn by:

MAL


Date:

19/09/2025

Drawing:

B2P-WSP-DA-70092380-190

TRANSMISSION

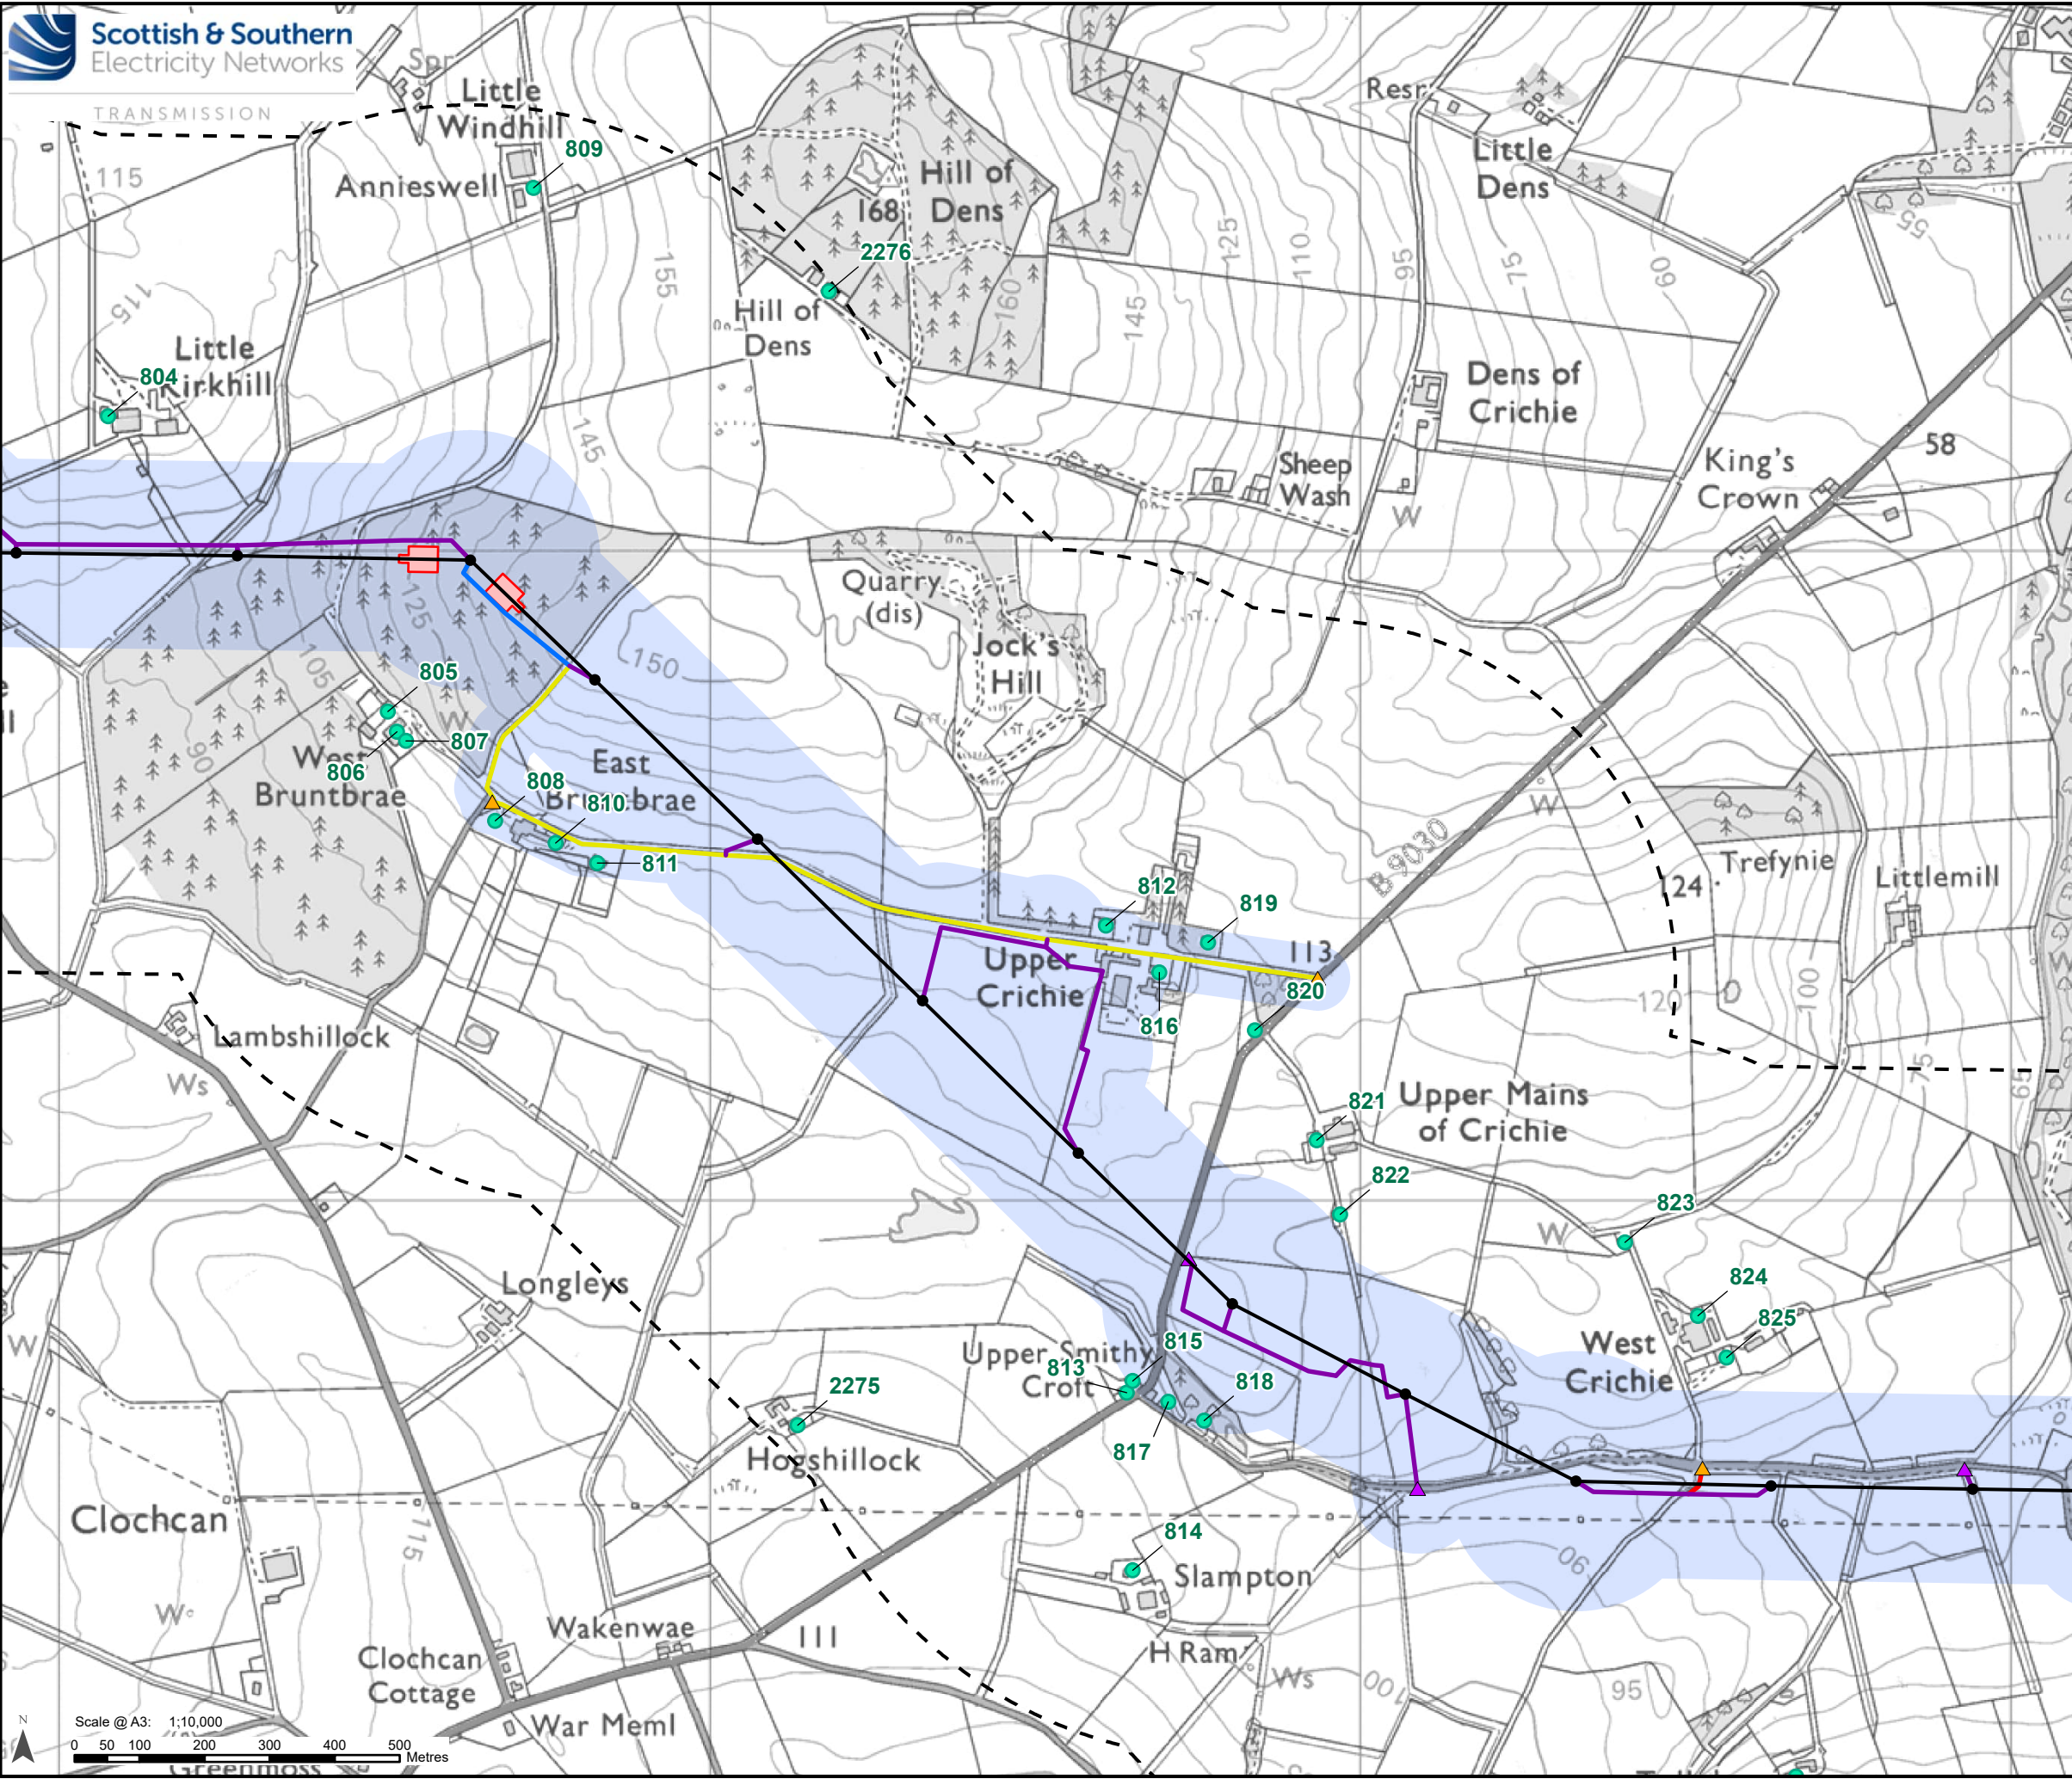

Legend

- Limit of Deviation - Proposed Development
- 500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Noise Sensitive Receptor

- Noise Sensitive Receptor and ID

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 53 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

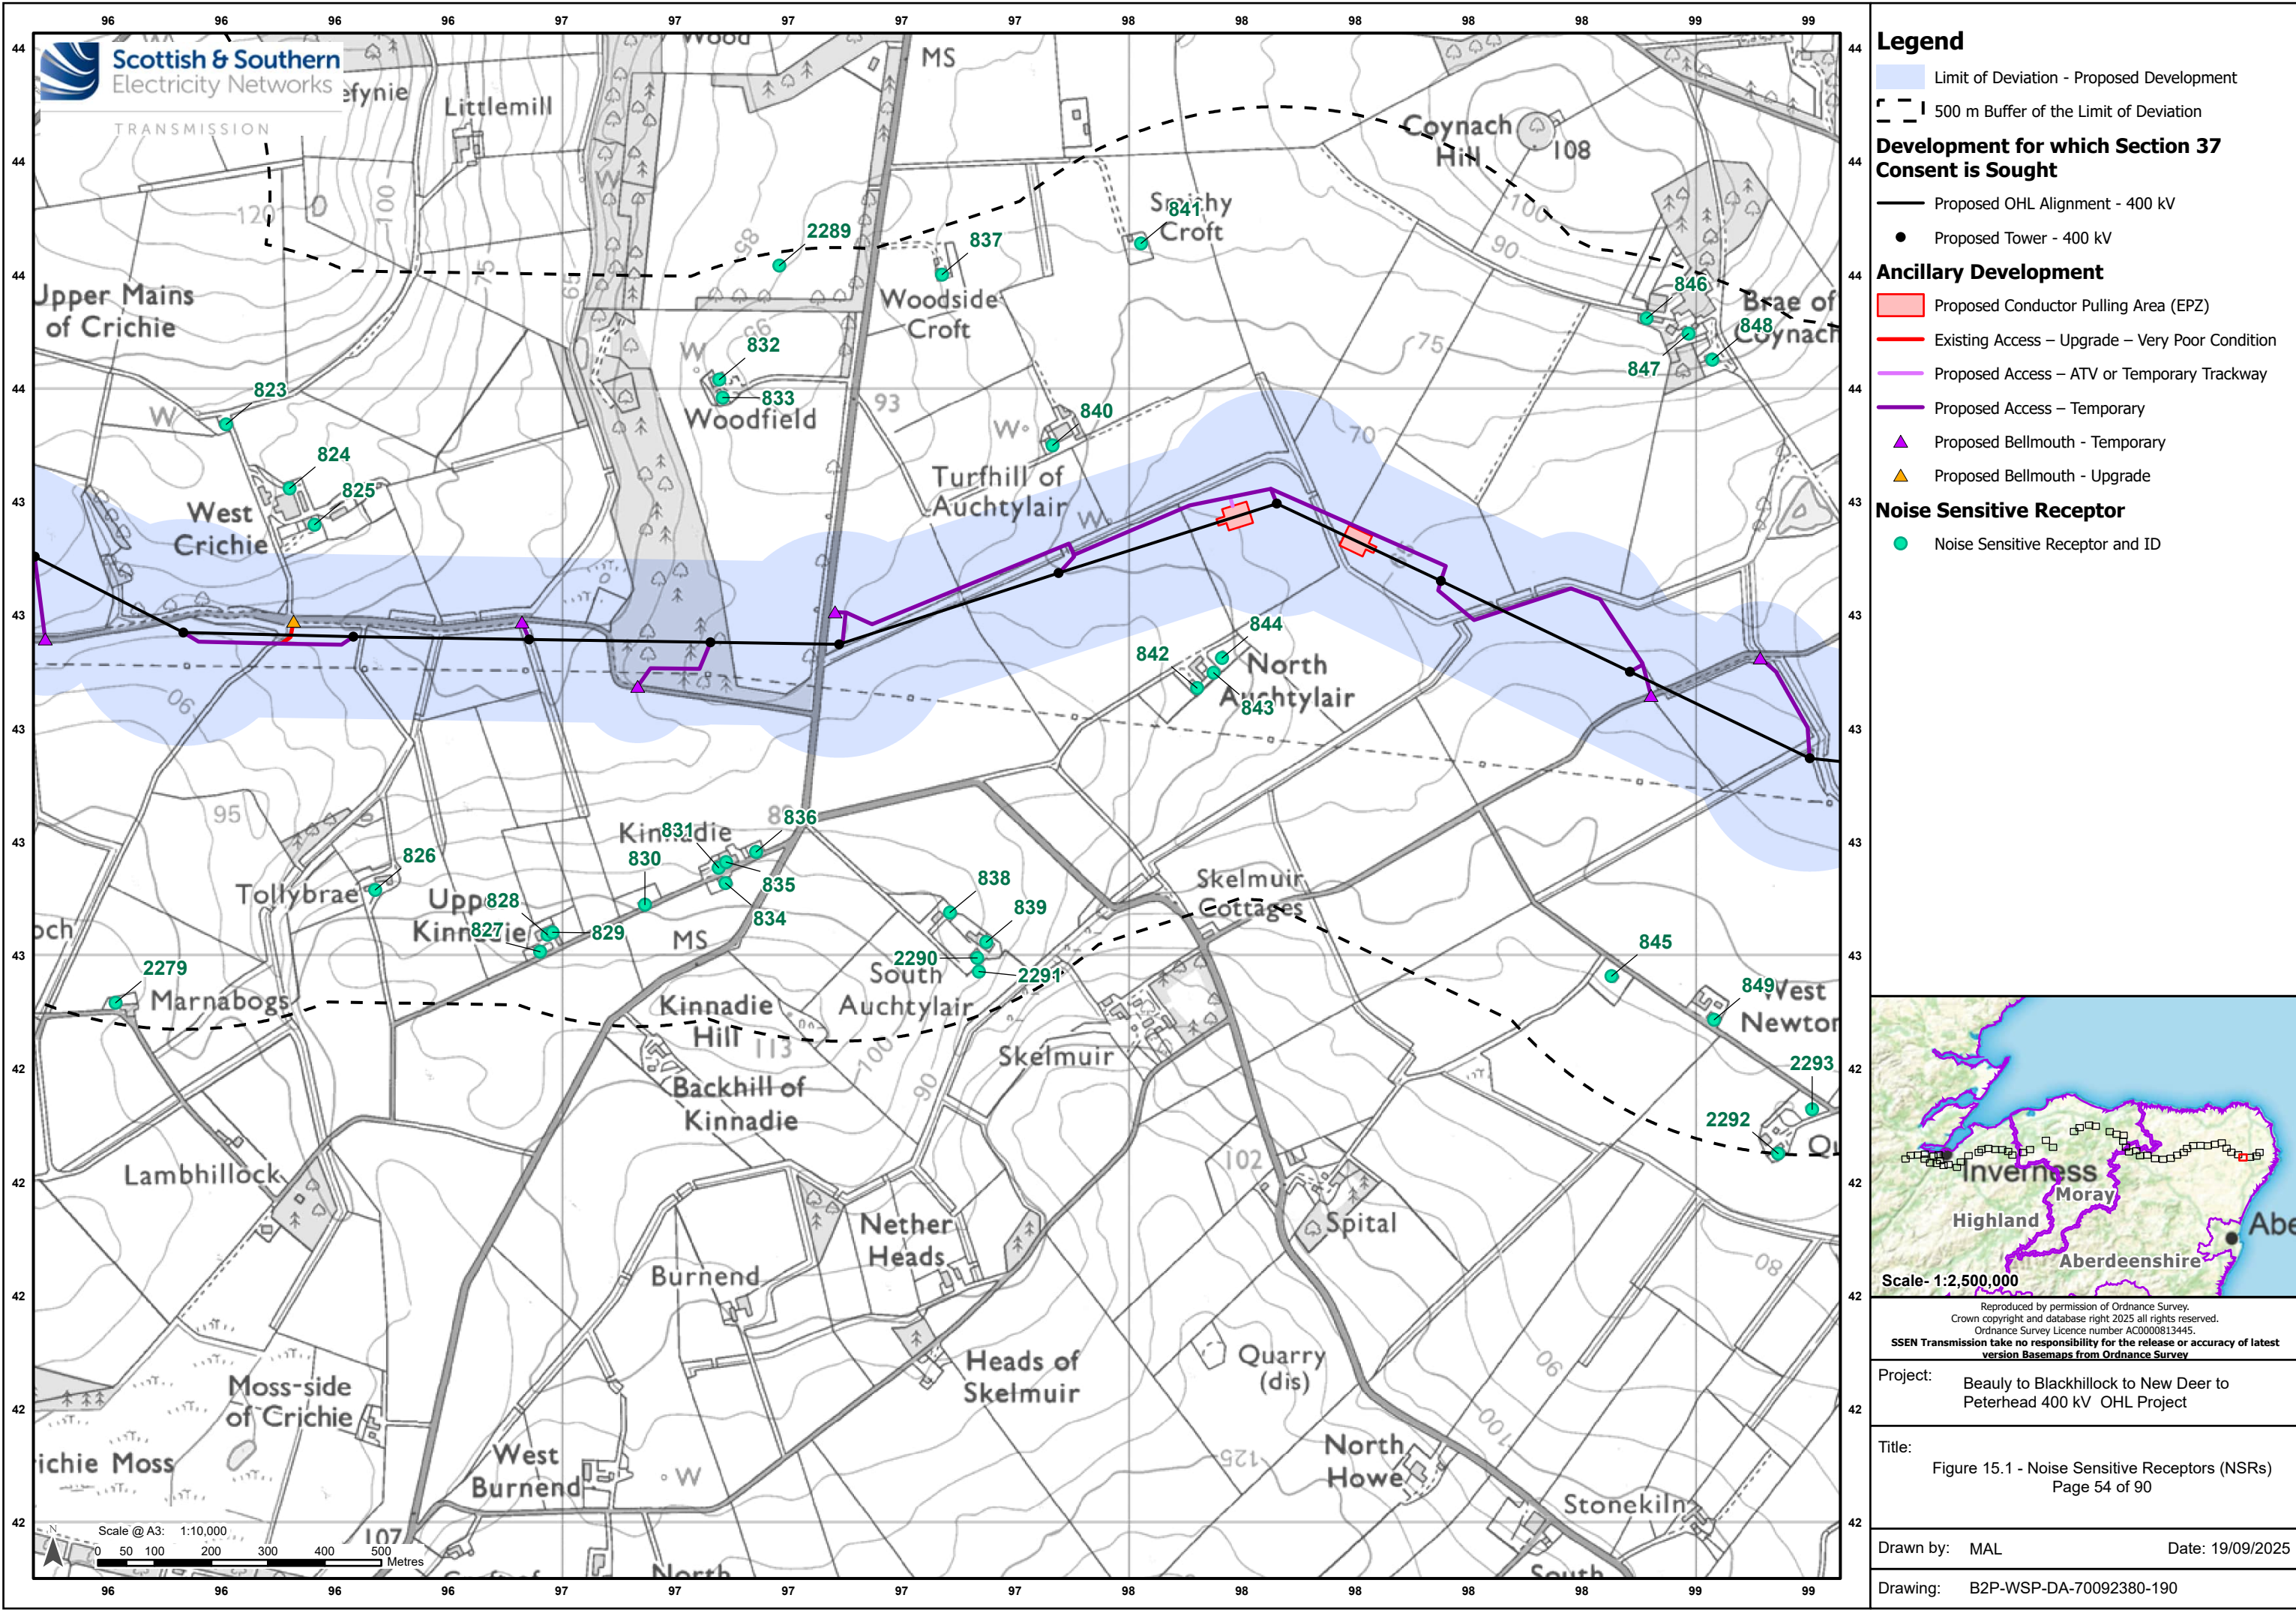

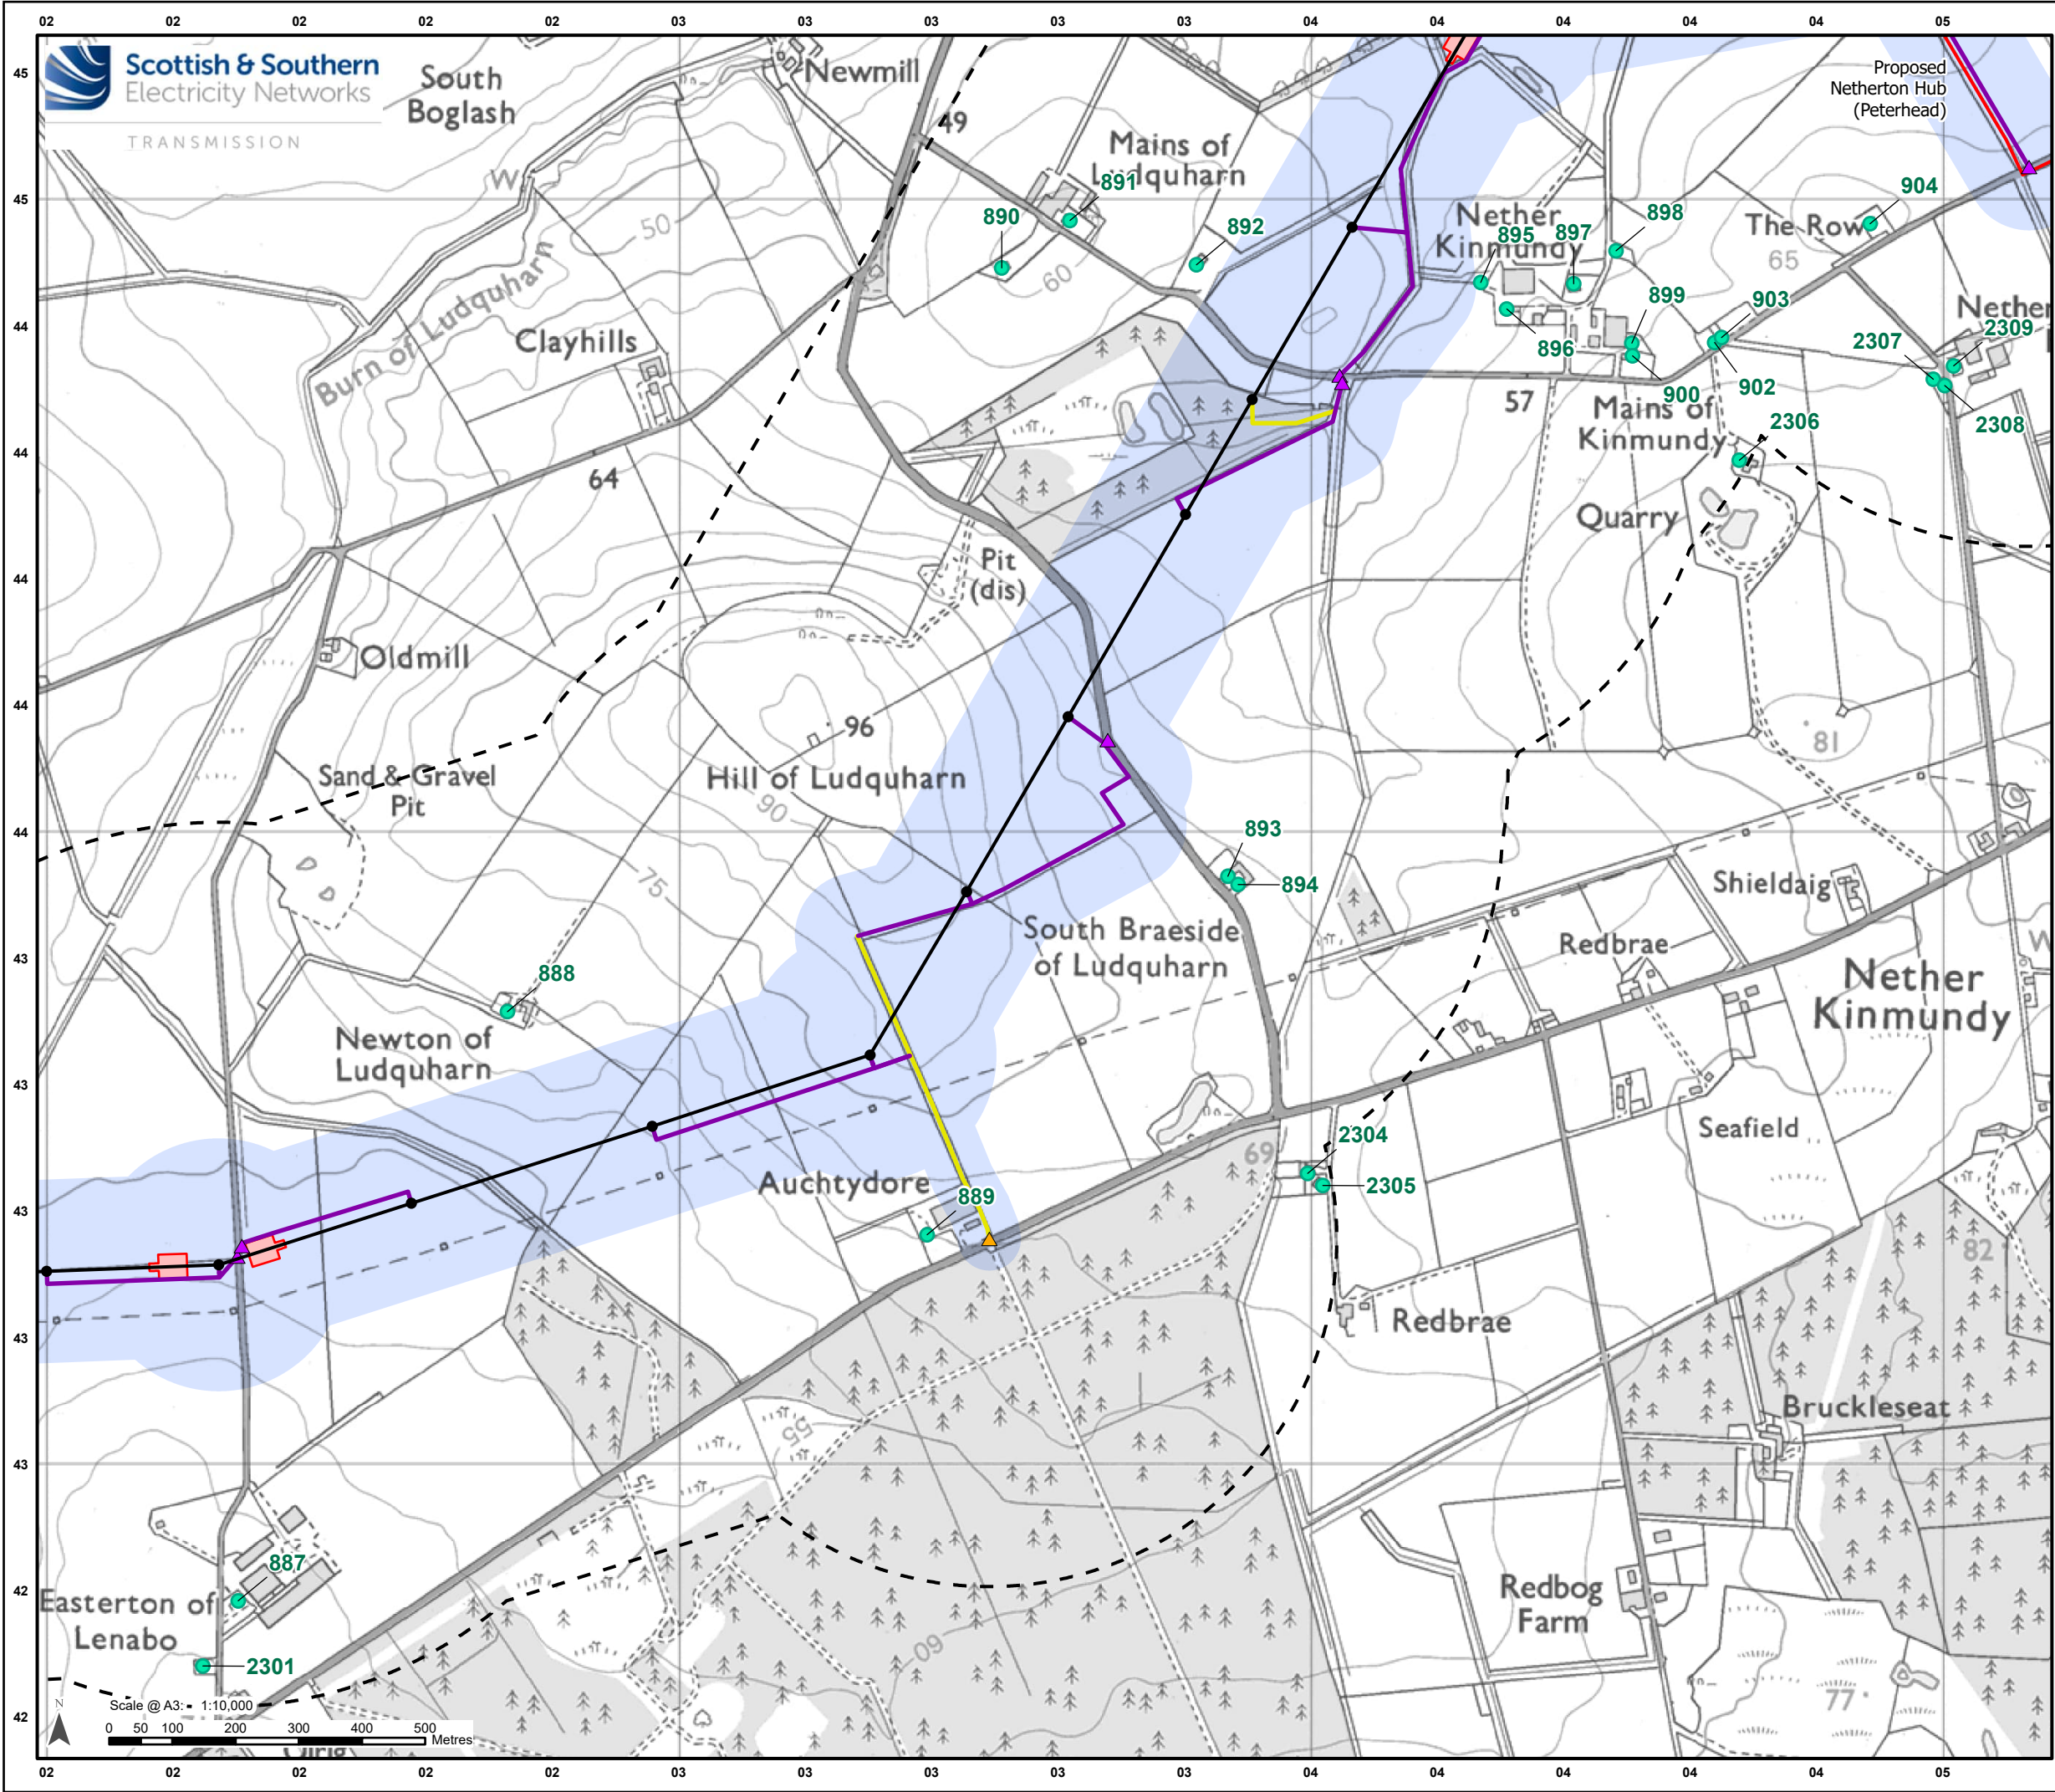

Legend

Proposed Substation Site Planning Red Line Boundary

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition


Proposed Access – Temporary

Proposed Bellmouth - Temporary


Proposed Bellmouth - Upgrade

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

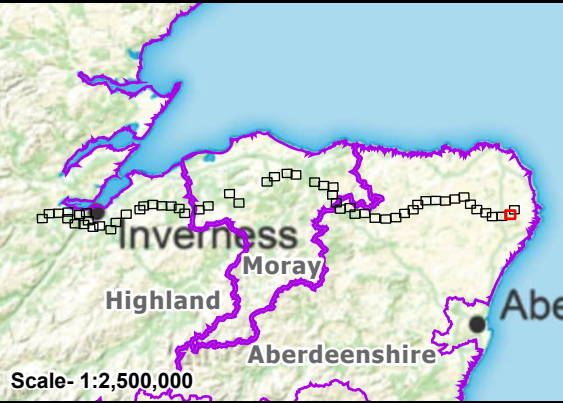

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 15.1 - Noise Sensitive Receptors (NSRs) Page 56 of 90
Drawn by:	MAL
Date:	19/09/2025
Drawing:	B2P-WSP-DA-70092380-190

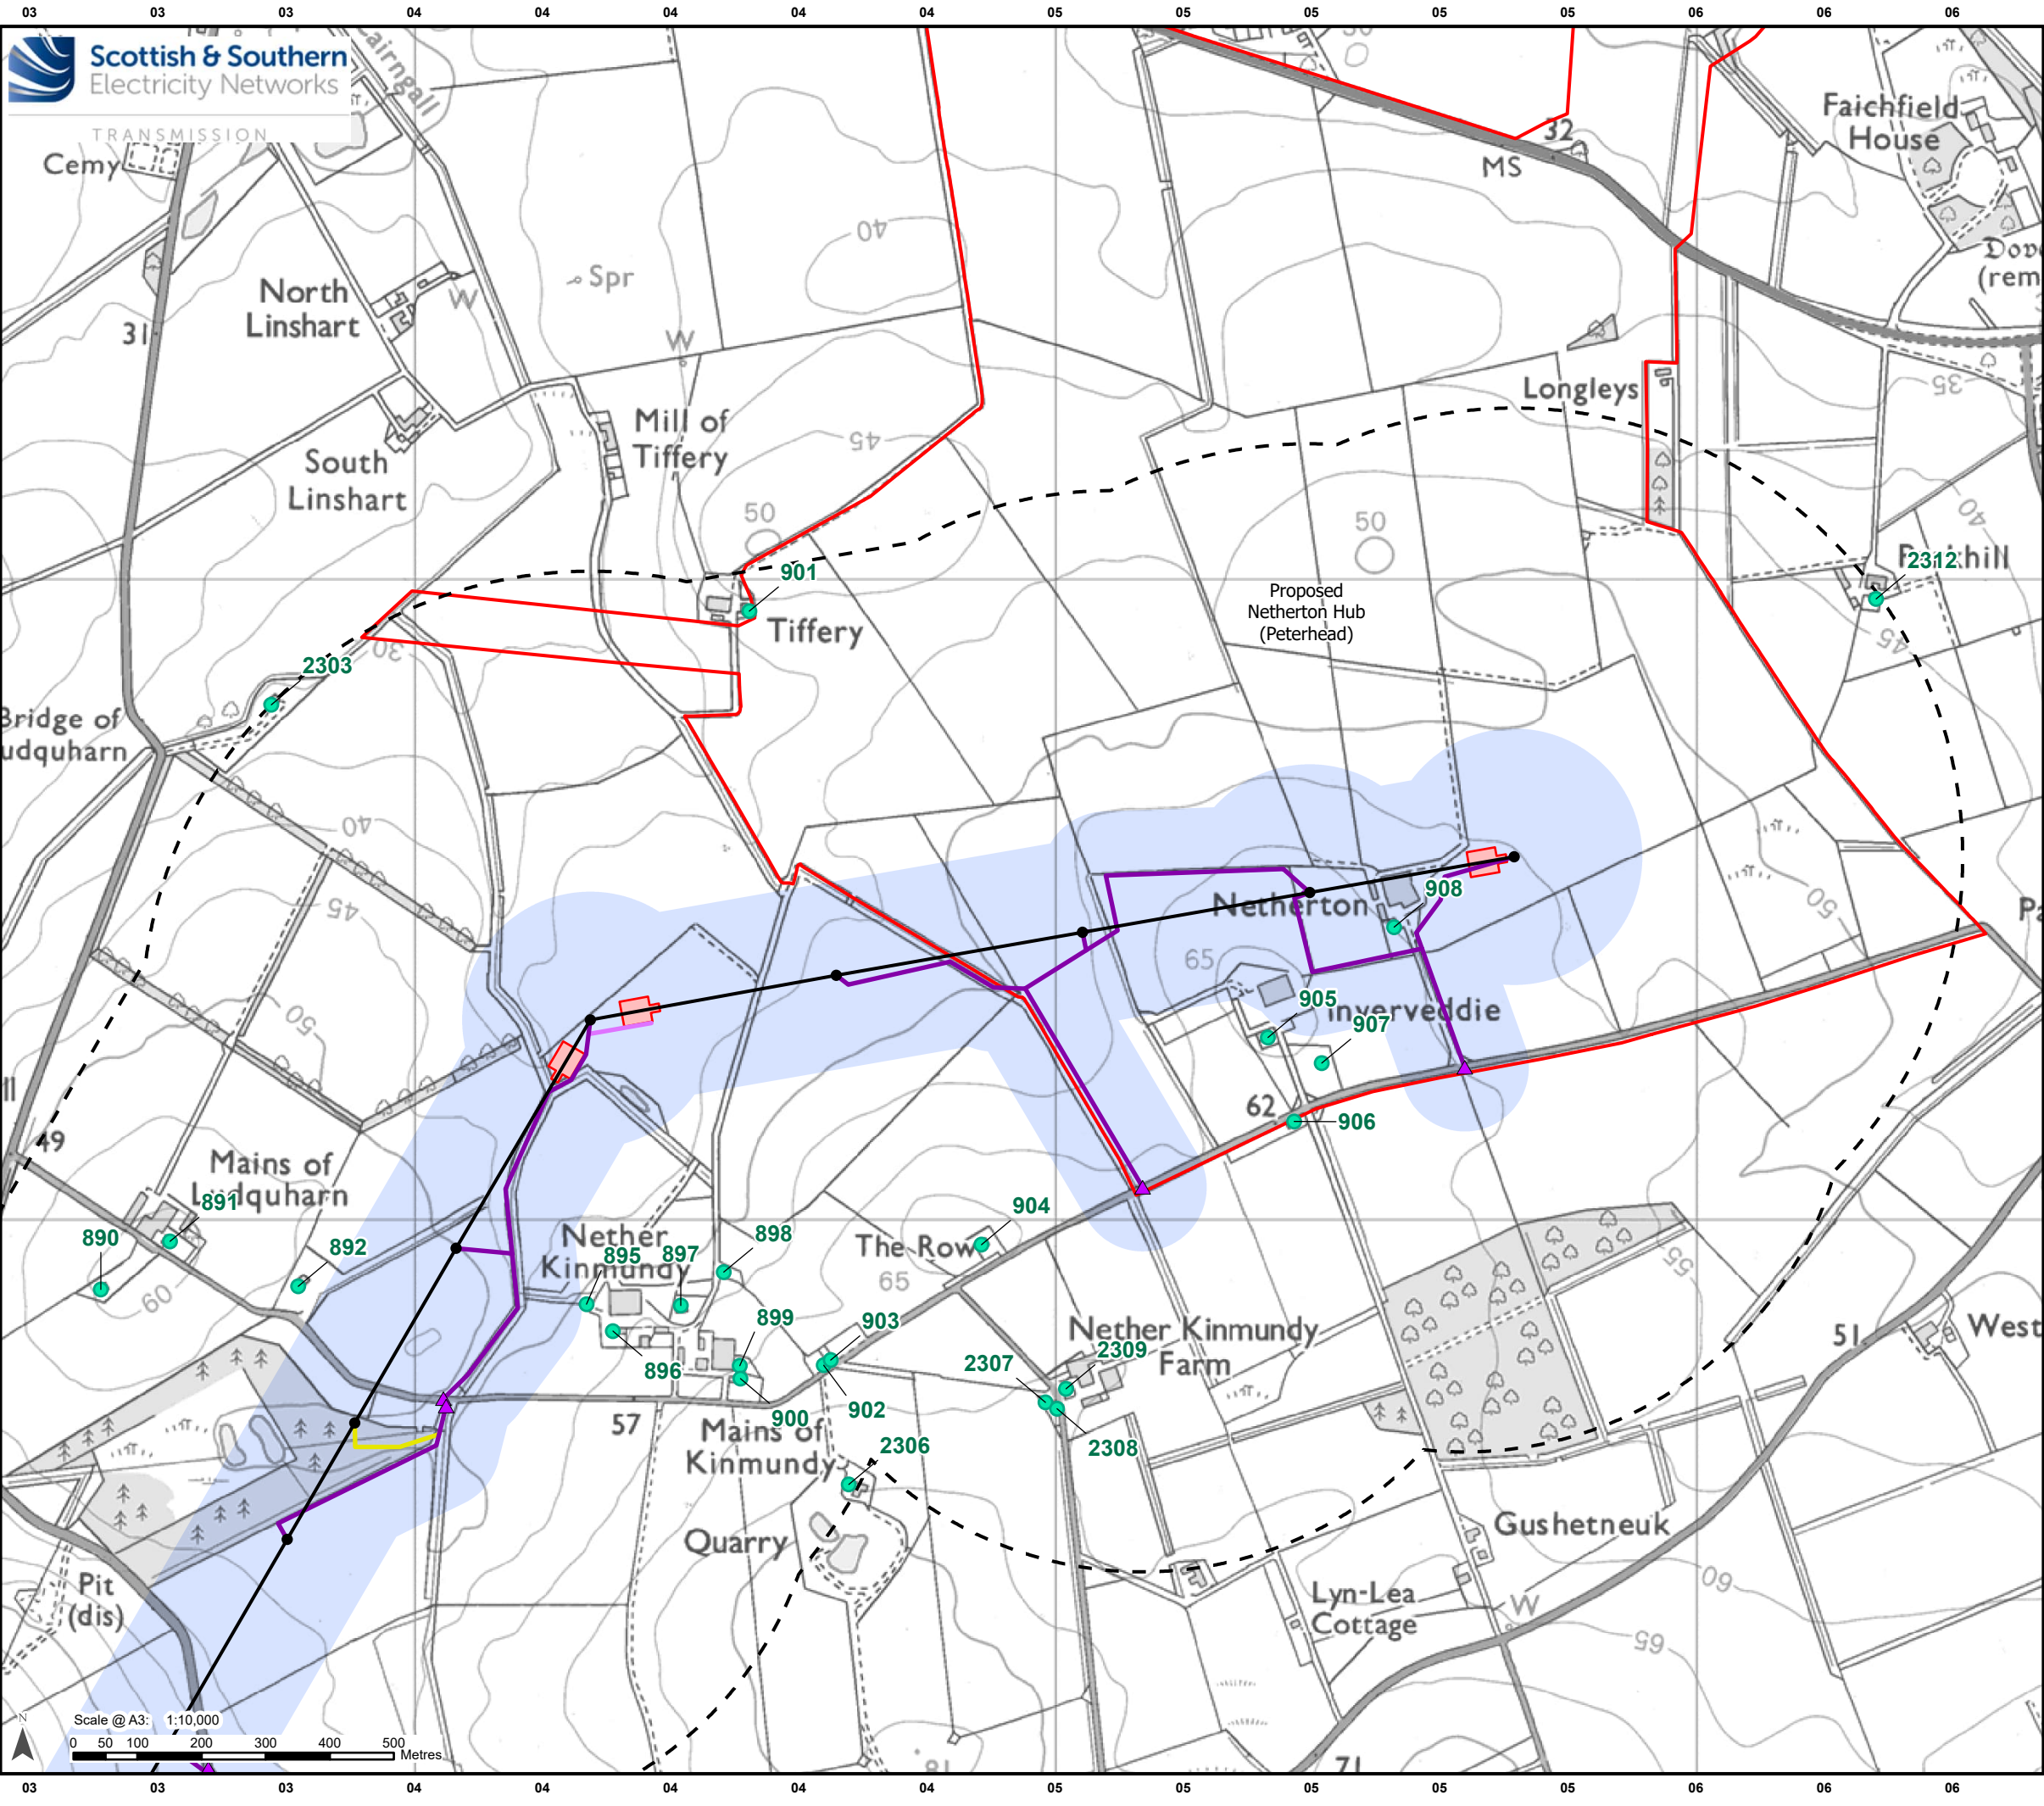

Legend

Proposed Substation Site Planning Red Line Boundary

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV

Ancillary Development

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good / Fair Condition


Proposed Access – ATV or Temporary Trackway

Proposed Access – Temporary

Proposed Bellmouth - Temporary

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

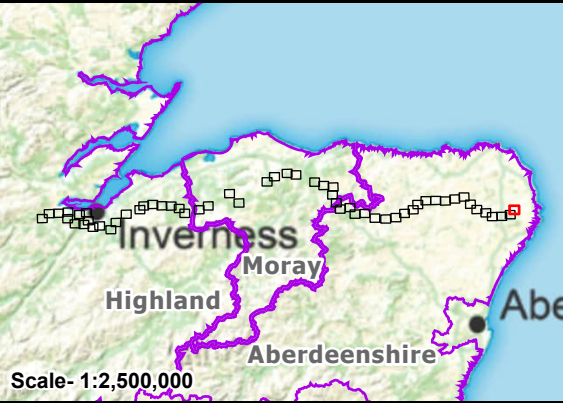

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 57 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

TRANSMISSION

Path

Teanalonaig 914

937 Eldon

938 Allt Buidhe
946 Craig Dhu
940 Pradigill

934 Strathnaver
935 Glendale
943 Lynwood
936 Cranleigh

928 Clematis Cottage
924 Cala Sona
931 Dalmora
927 Church
939 Braeview
942

920 Wester Balblair
918 Witsend
919 Croft House
922 Glengarry
926 Kilmore
933 Wester Balblair
948 The Firs

916 Teanalonaig Cottage
917 Rowanlea
925 Ben Loyal
930 Tanera Mor
941
949 Caberfeidh
950 Ellemford
929 Morven A 831
932 TCB
945 LB Shelter 27.8m

30.4m
915

28.7m

Path

14.8m

War Memorial

Conveyor

Hopper

ETL

Track

Pond

WB

Tank Hopper

El Sub Sta

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation


Ancillary Development

Proposed Bellmouth - Upgrade

Existing Access – Upgrade – Poor Condition

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

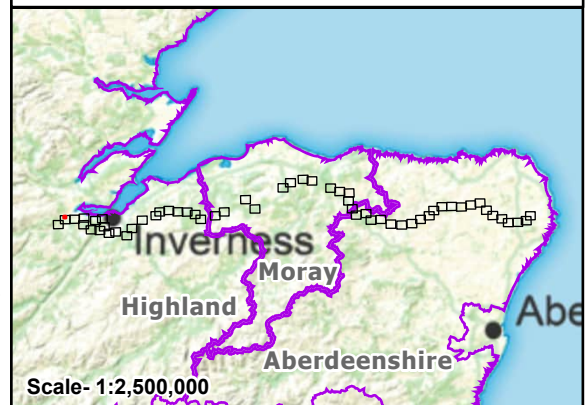


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 58 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

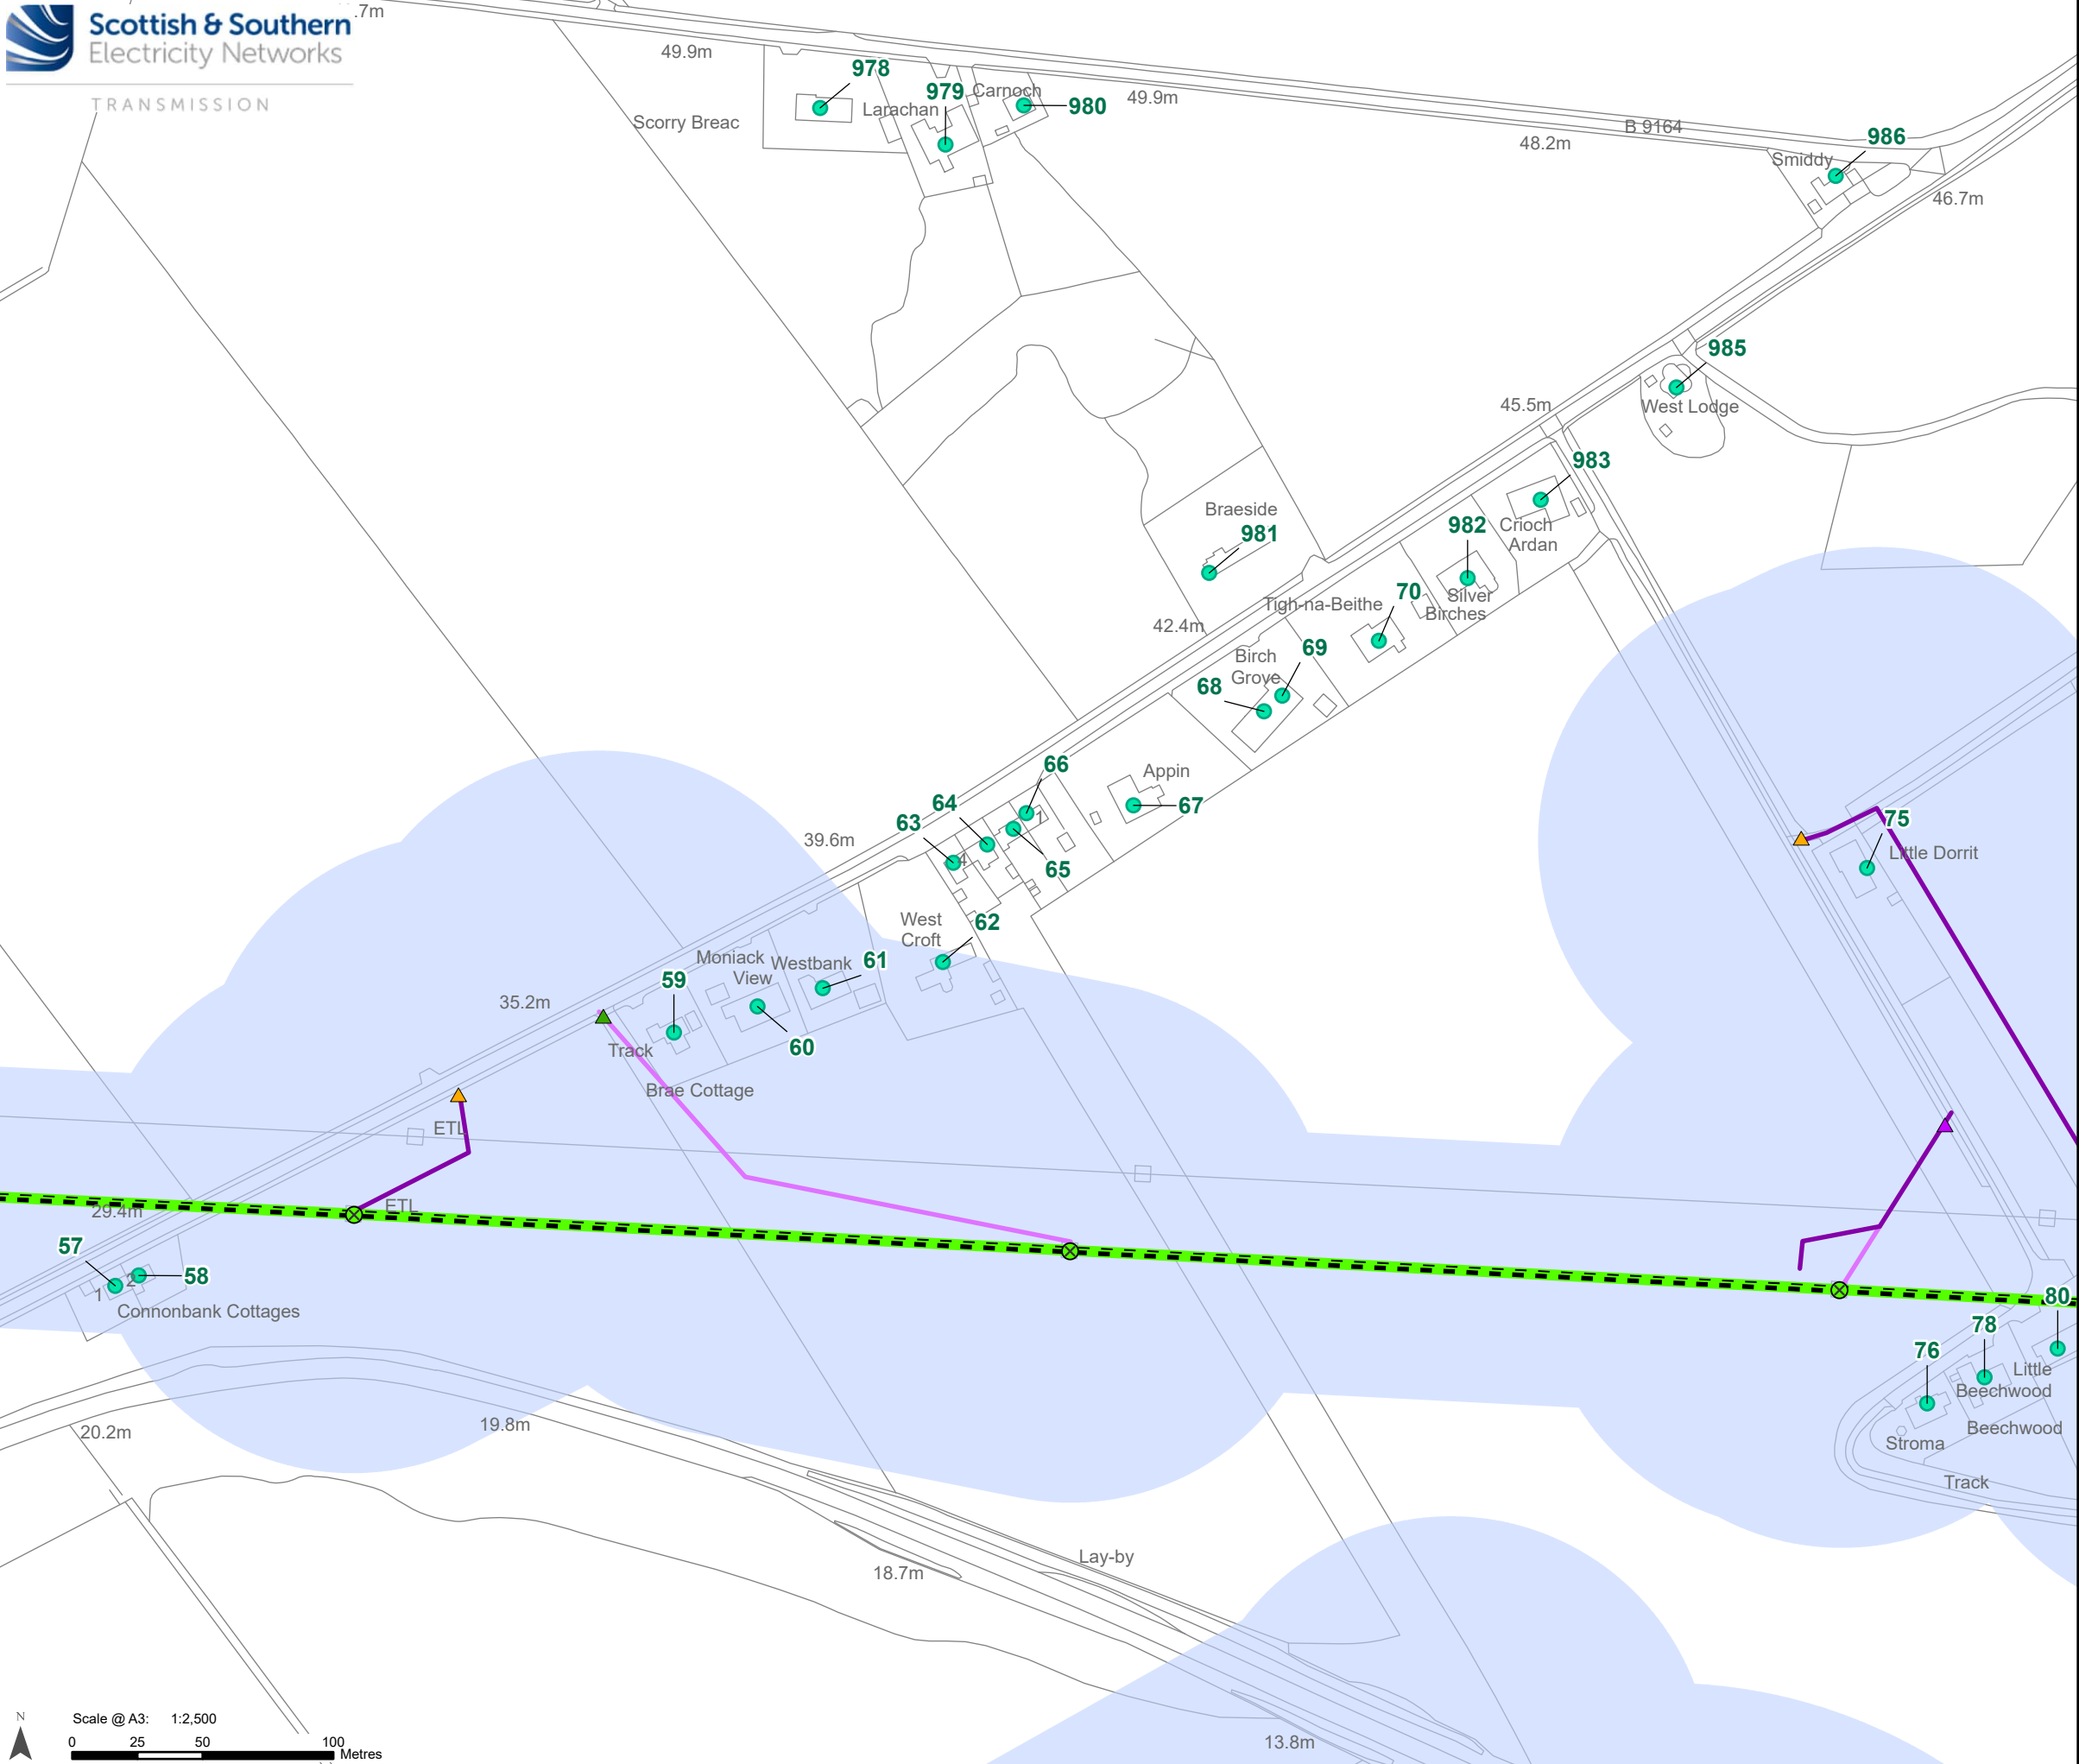

Legend

Limit of Deviation - Proposed Development


500 m Buffer of the Limit of Deviation

Ancillary Development

- Tower to be Removed
- Proposed Bellmouth - Access Only / ATV
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- OHL to be Removed

Noise Sensitive Receptor

- Noise Sensitive Receptor and ID

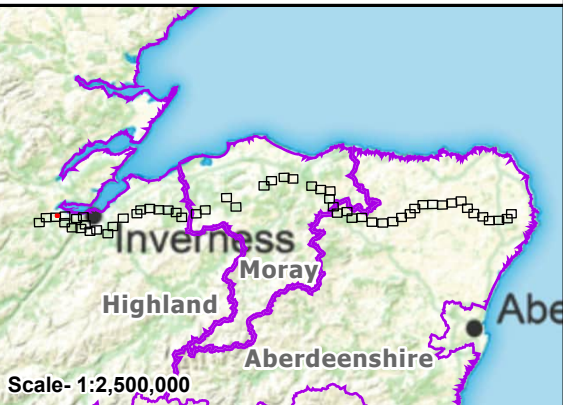


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 60 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

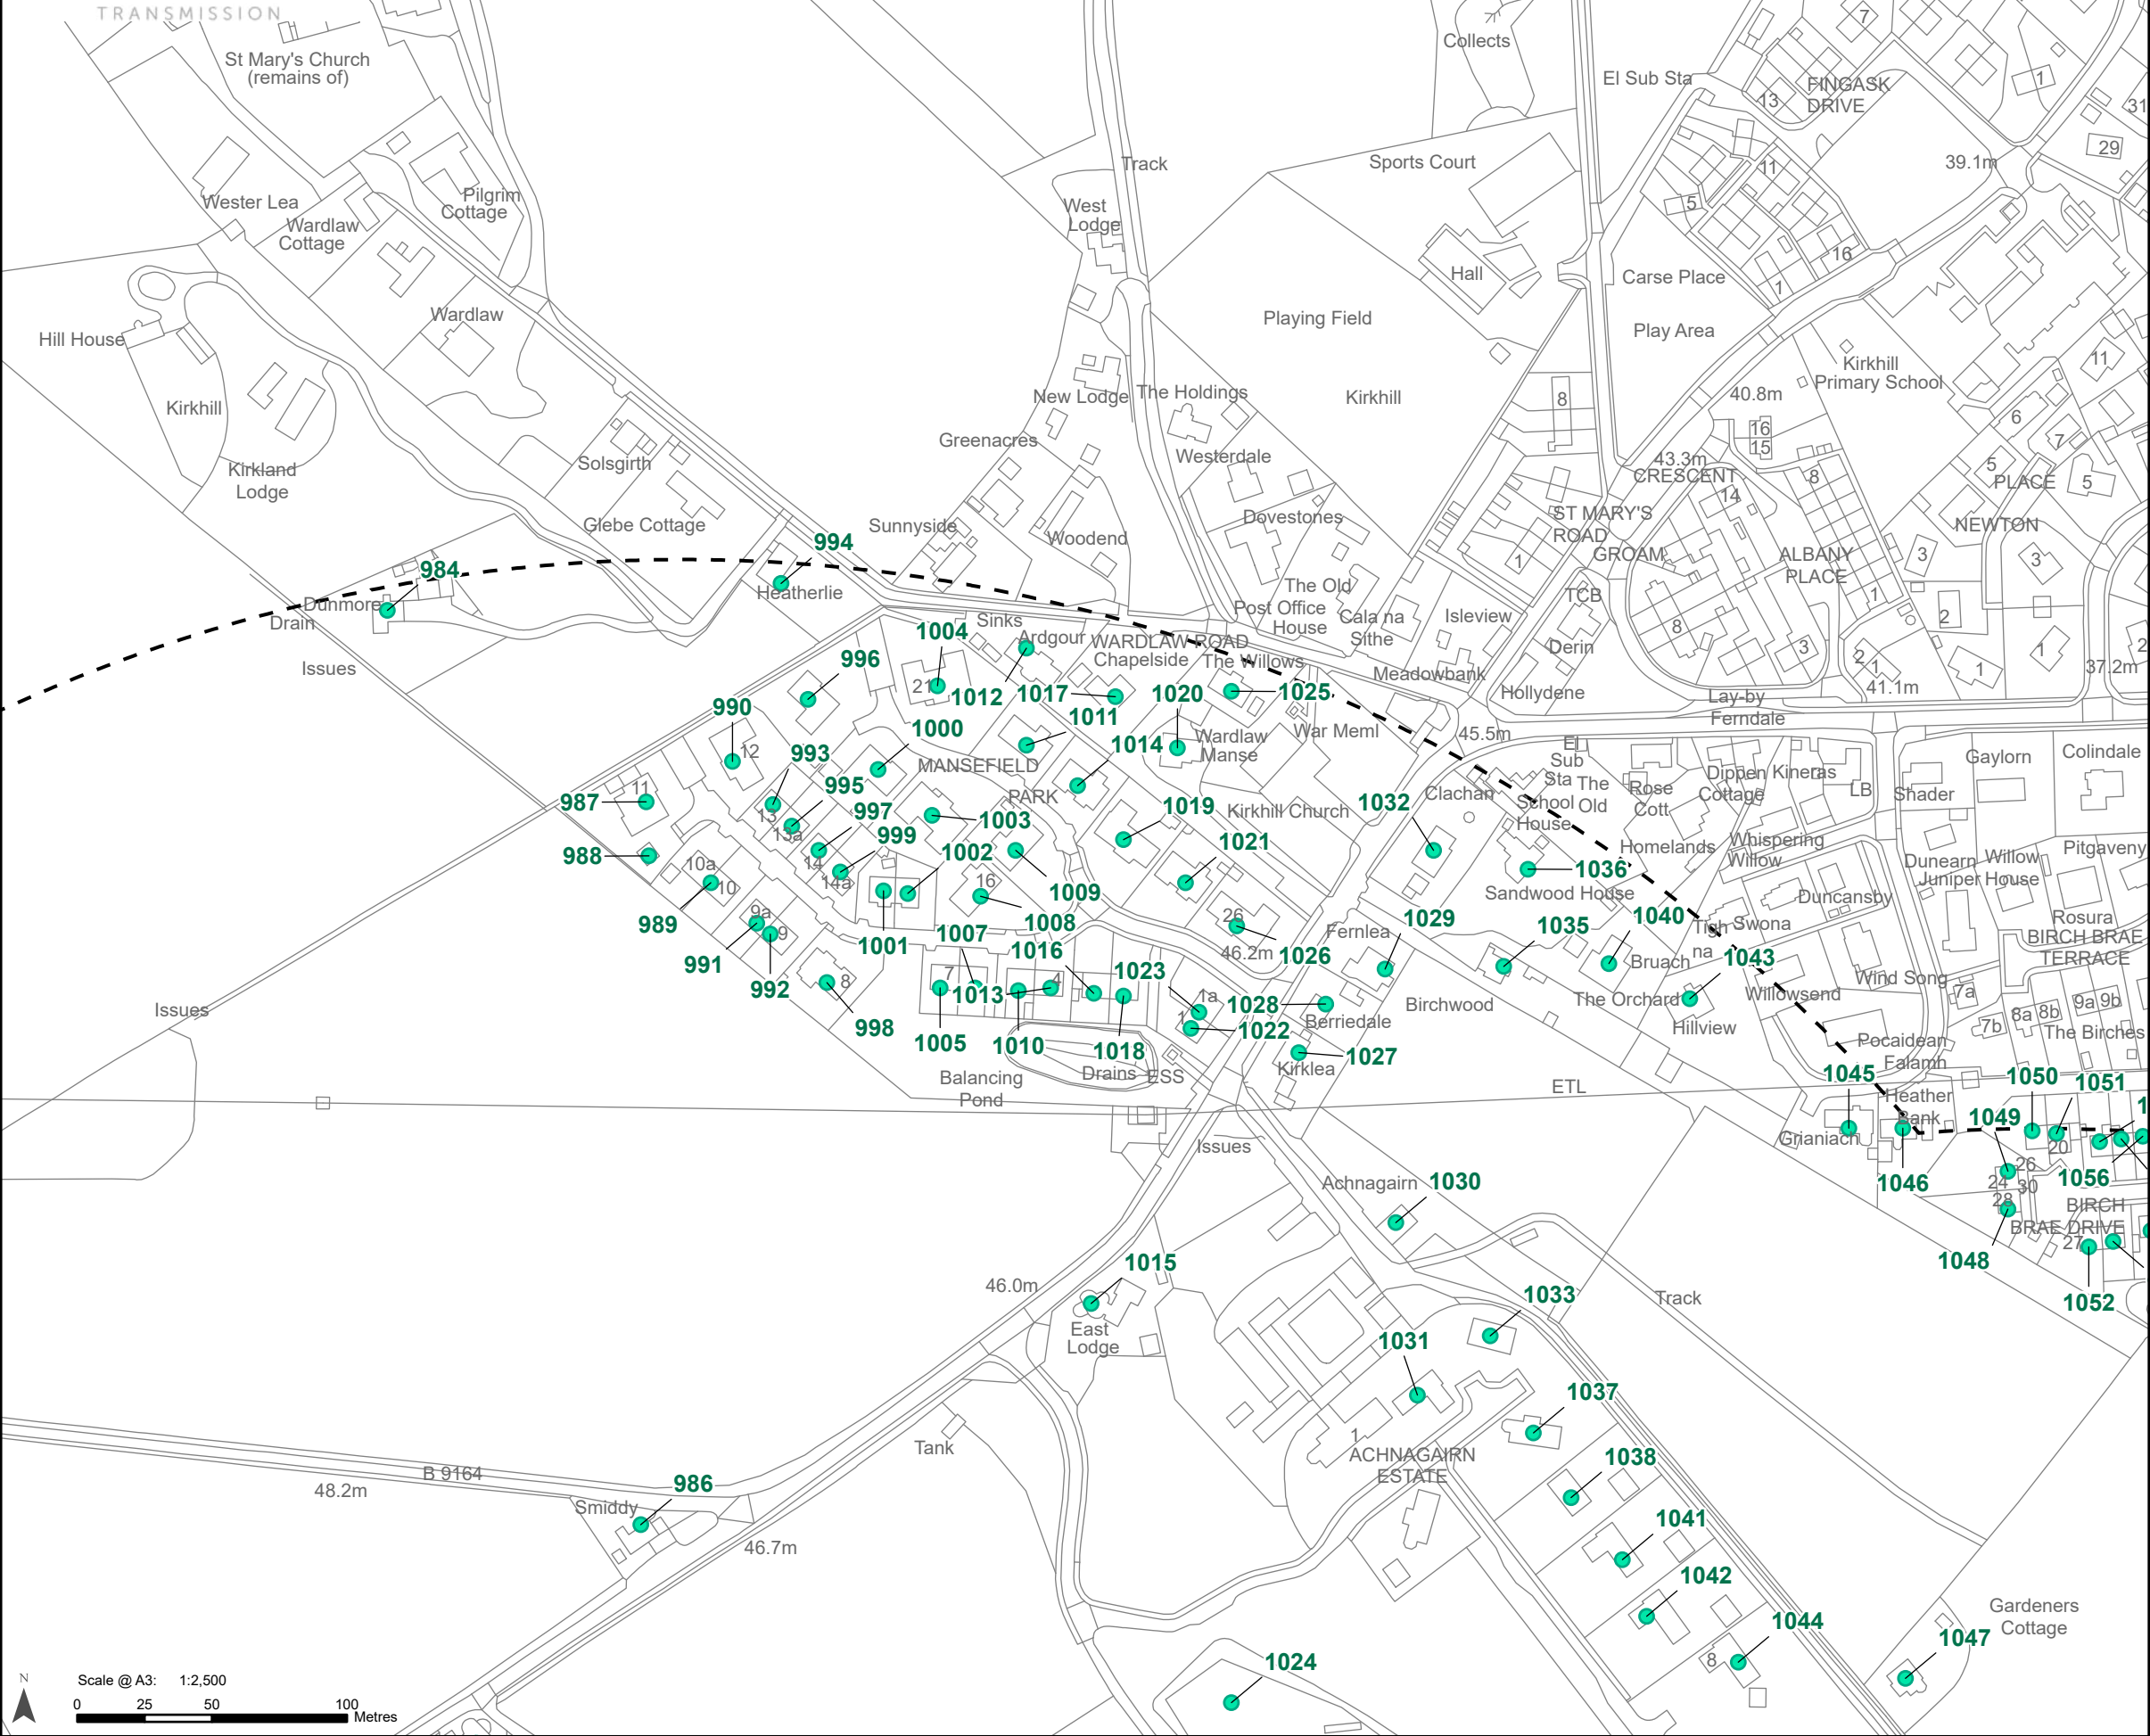

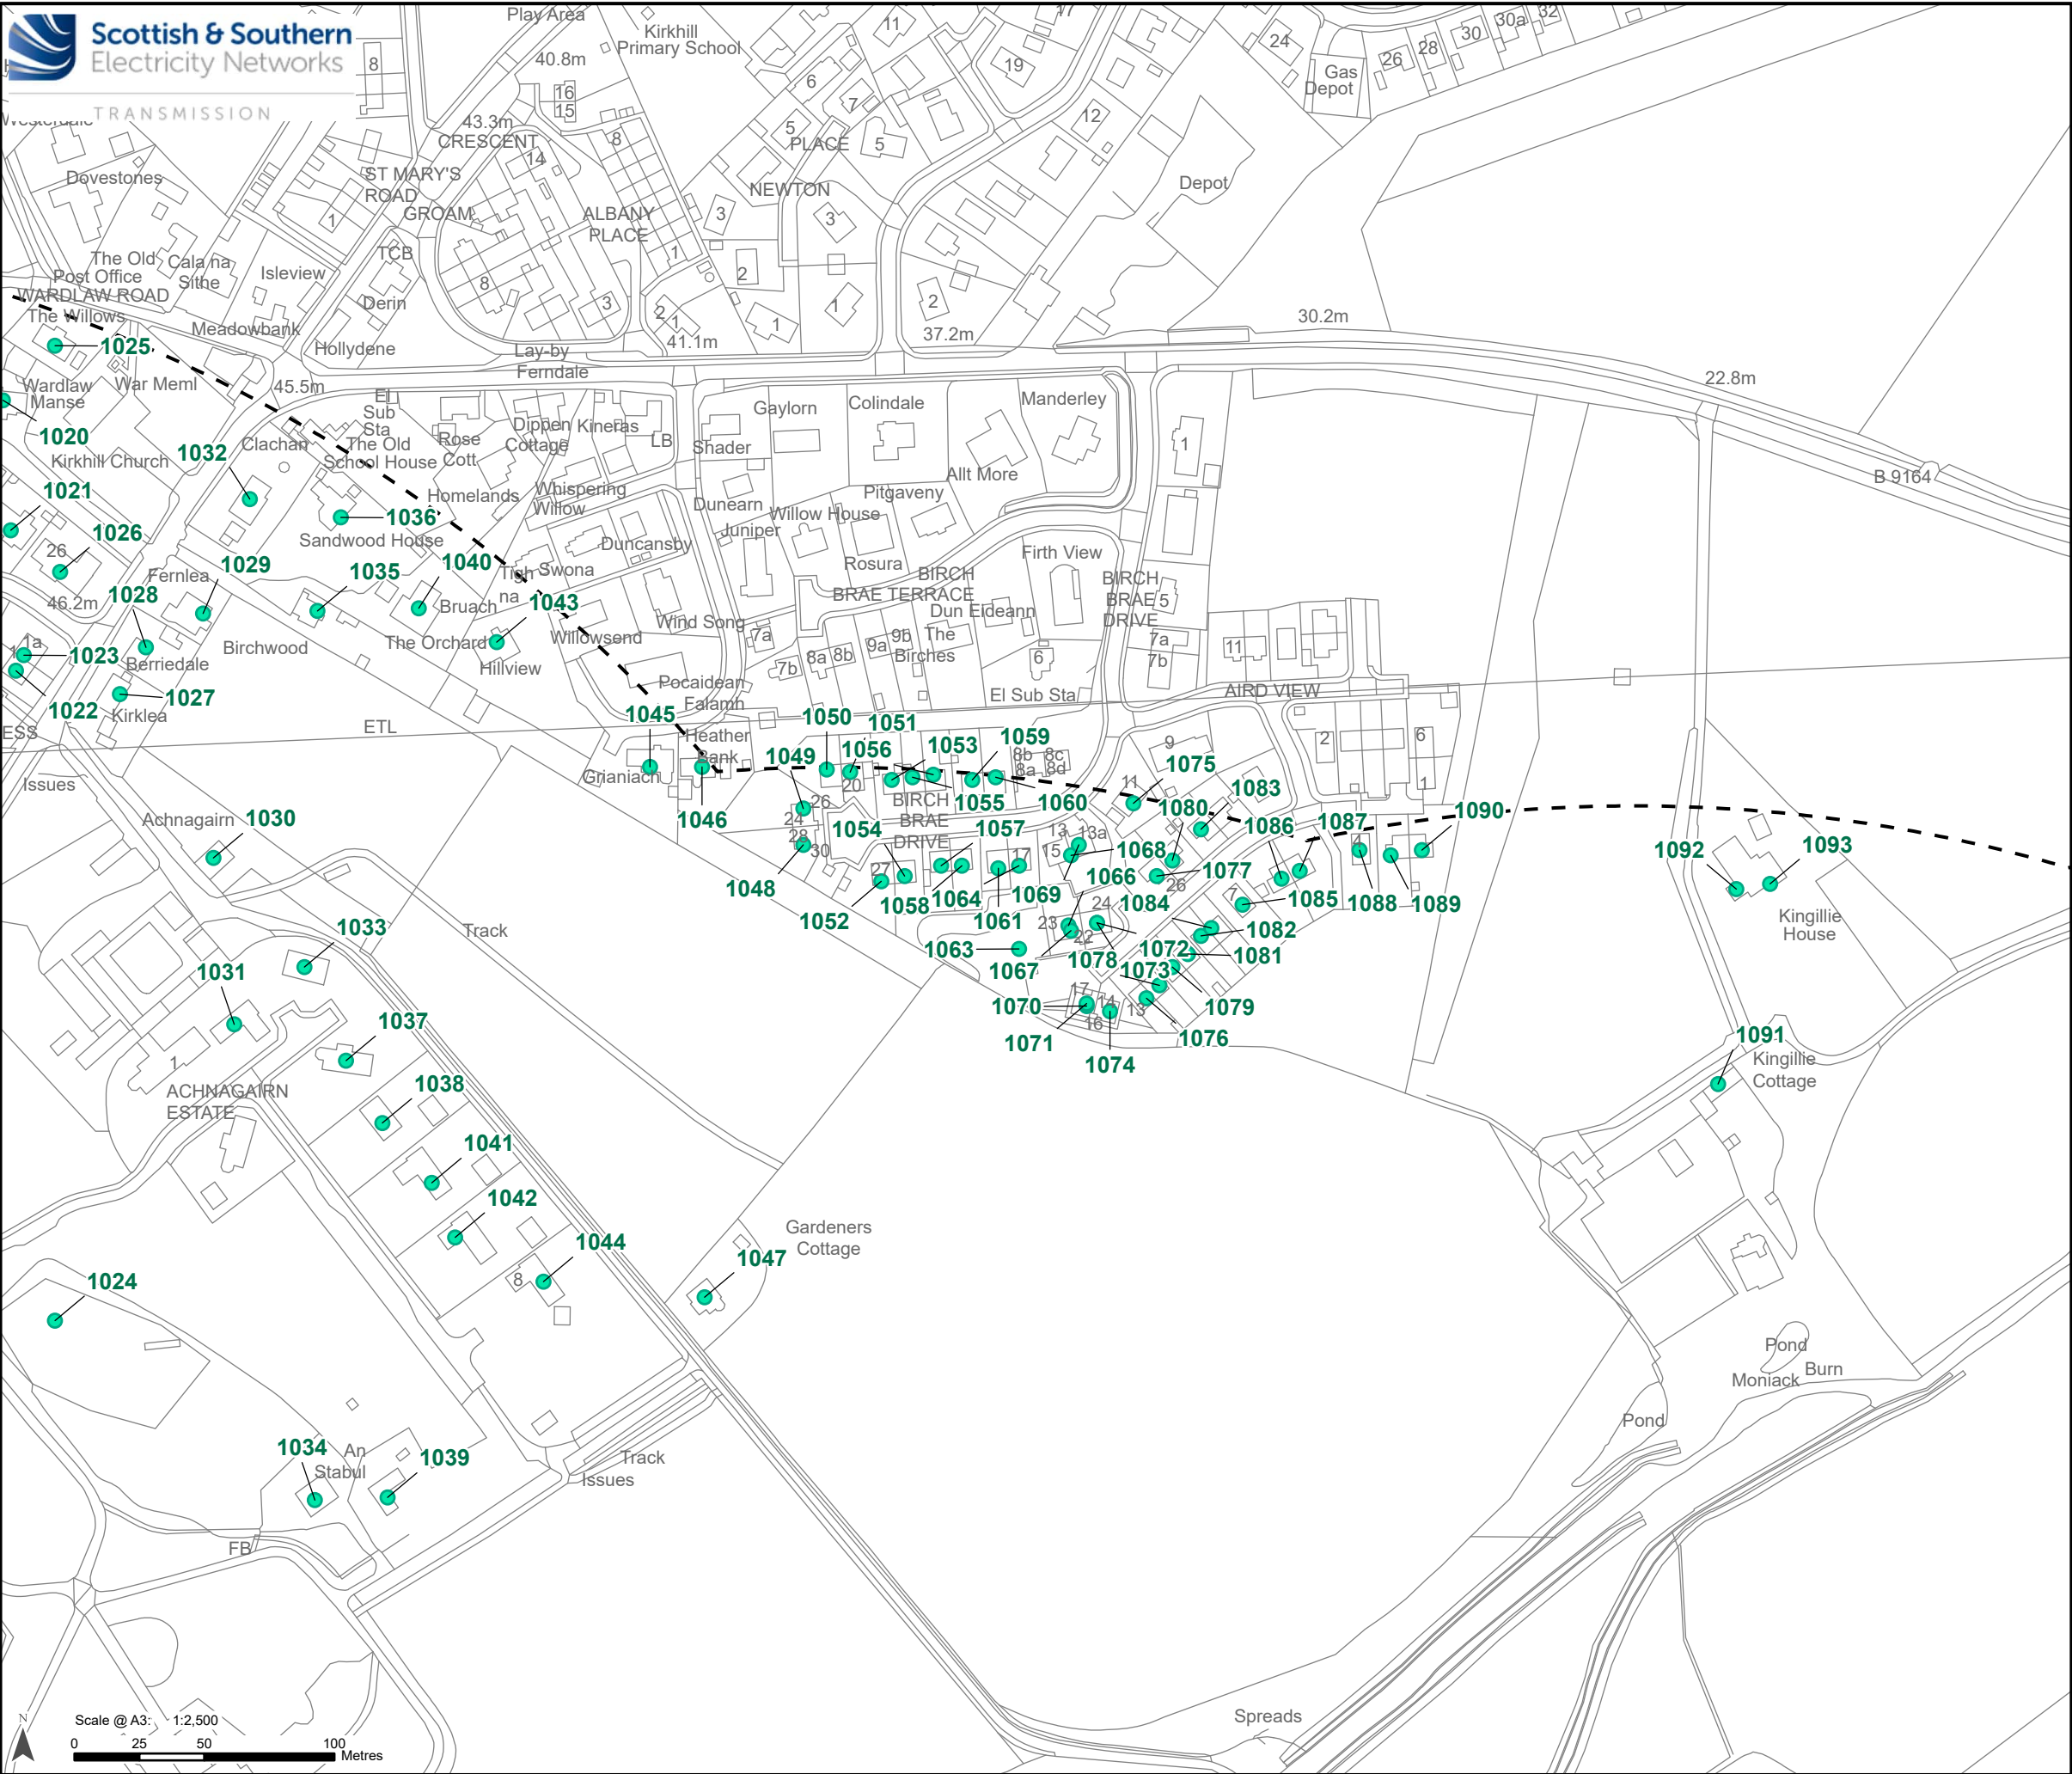

Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 62 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

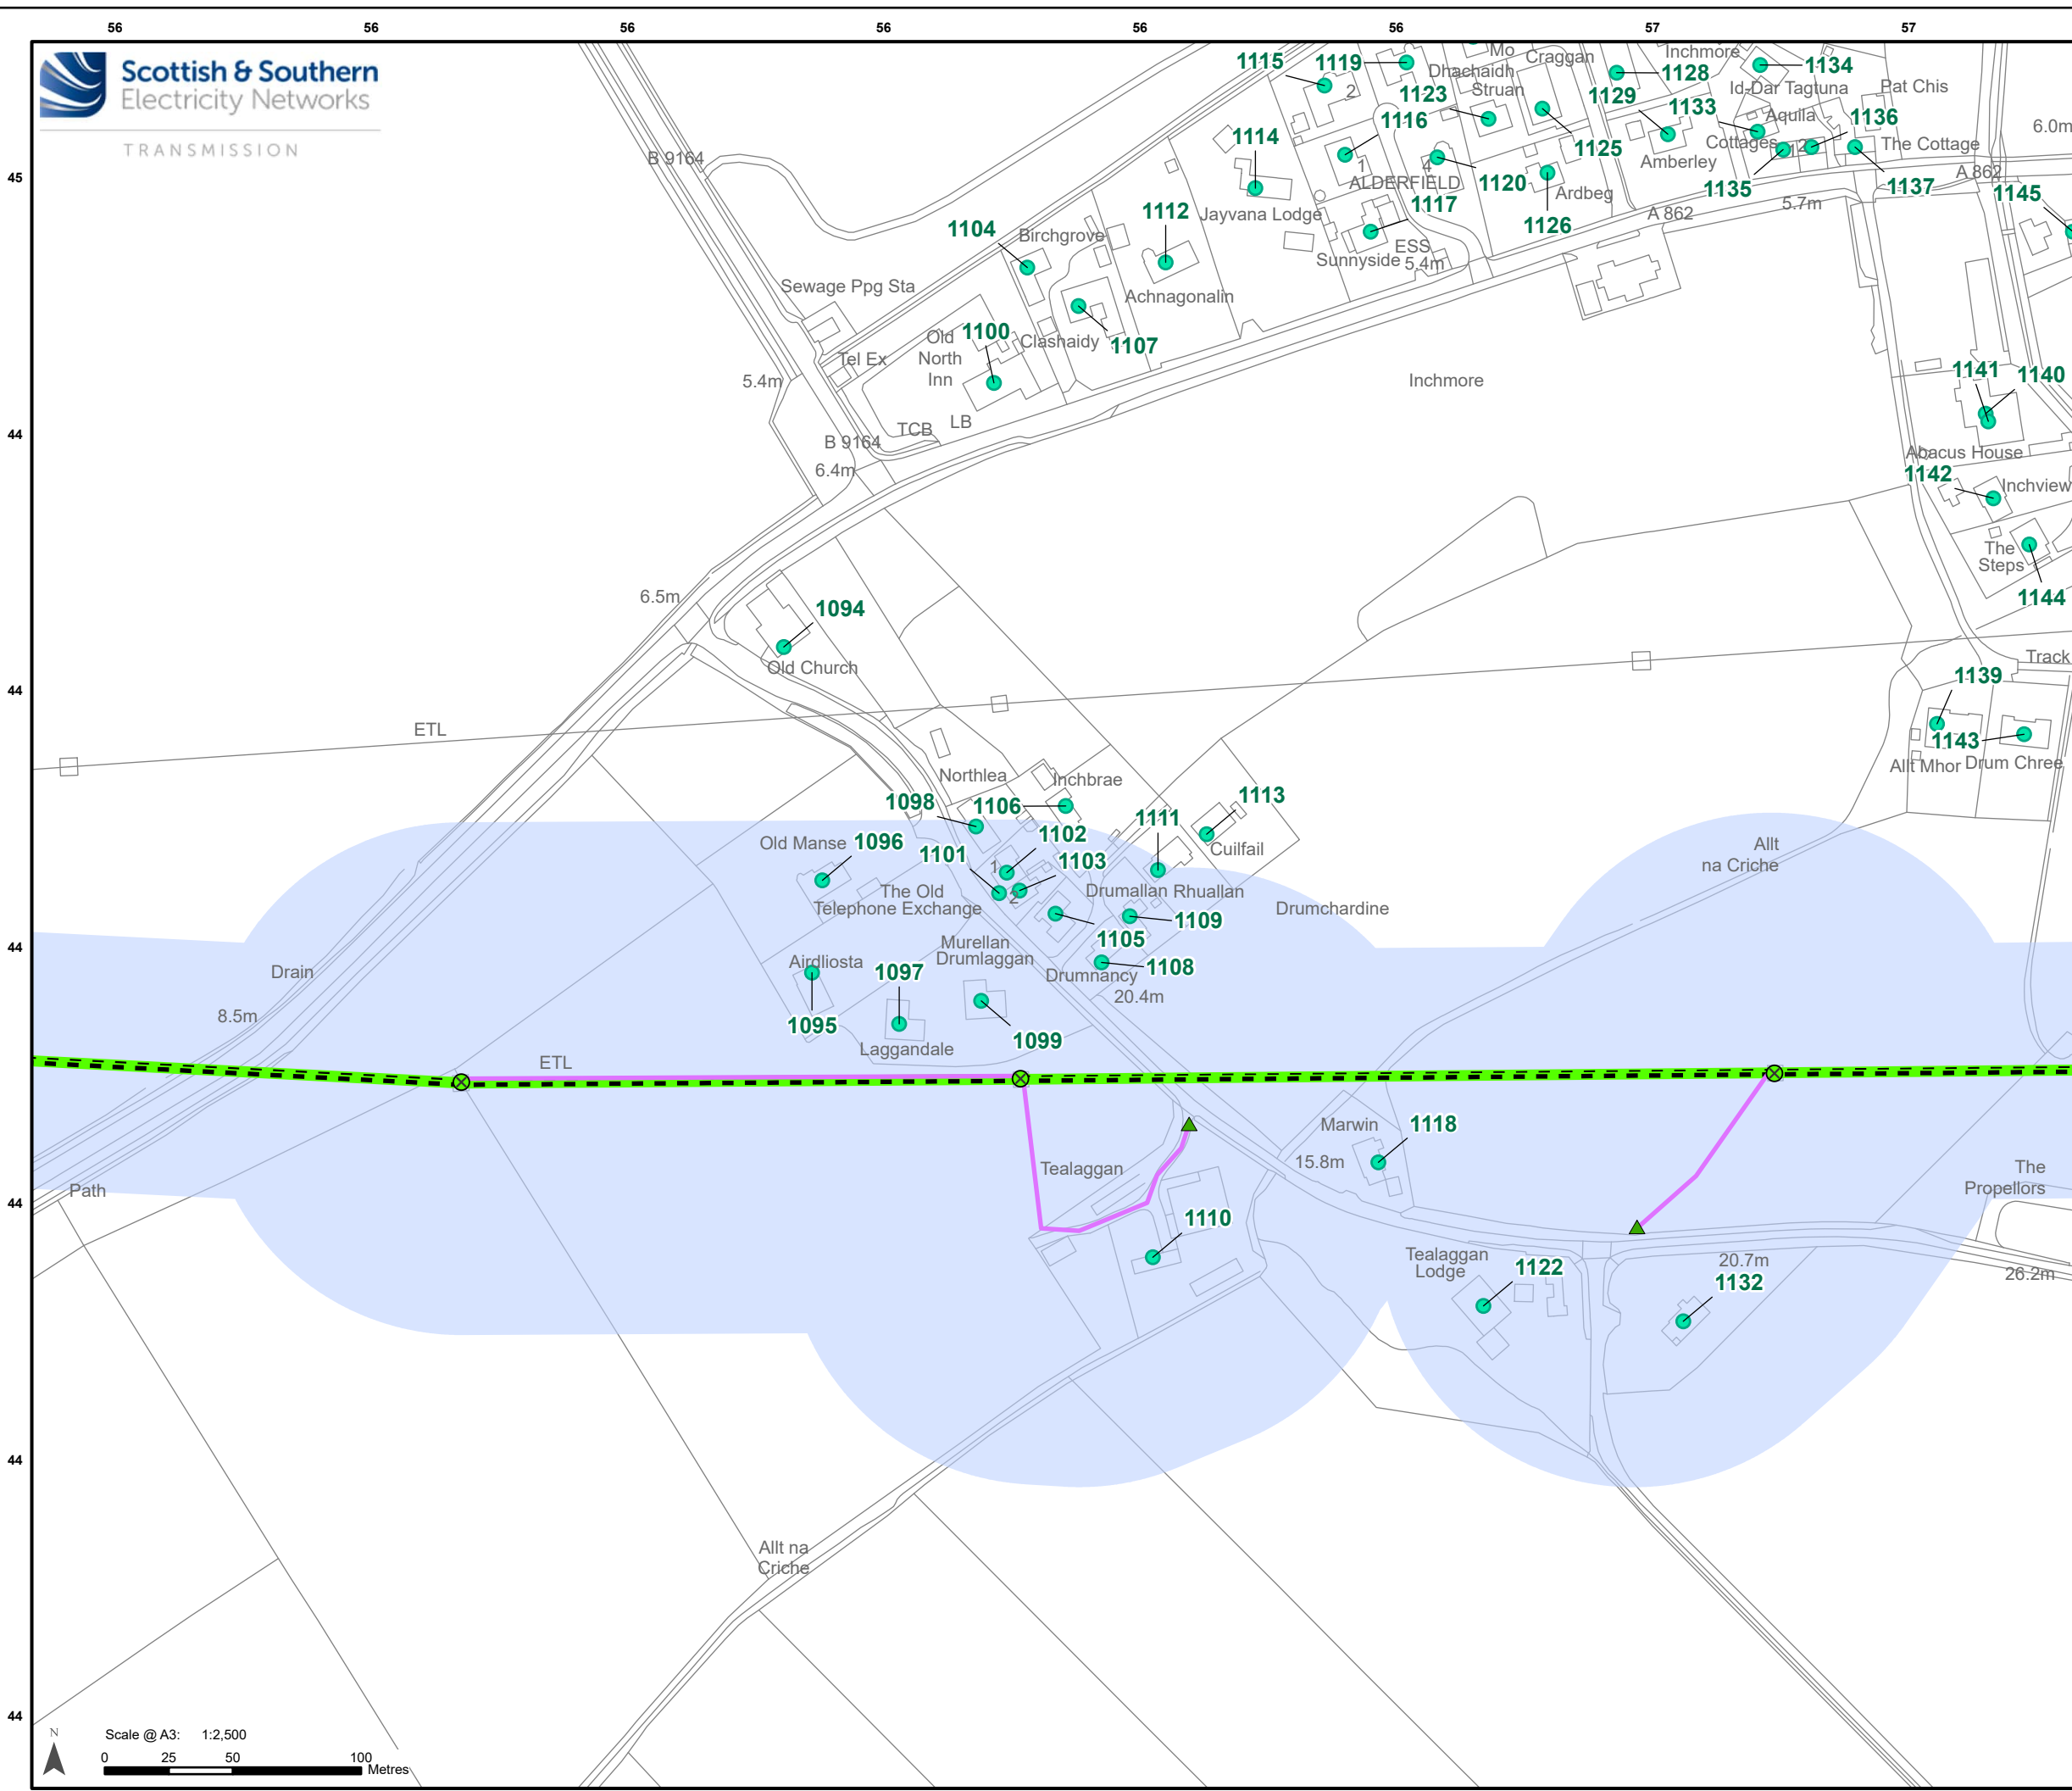

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Ancillary Development

Tower to be Removed


Proposed Bellmouth - Access Only / ATV

Proposed Access – ATV or Temporary Trackway

OHL to be Removed

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

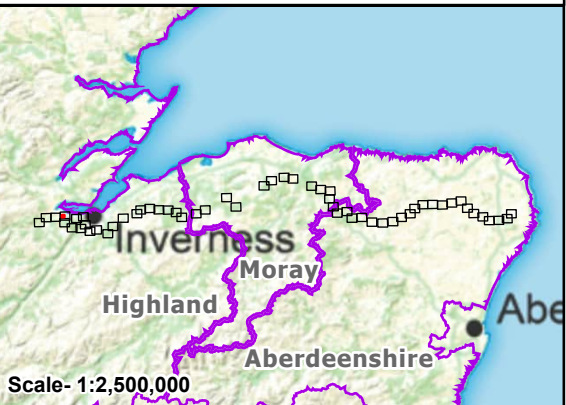

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project


Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 63 of 90


Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190



- Noise Sensitive Receptor and ID



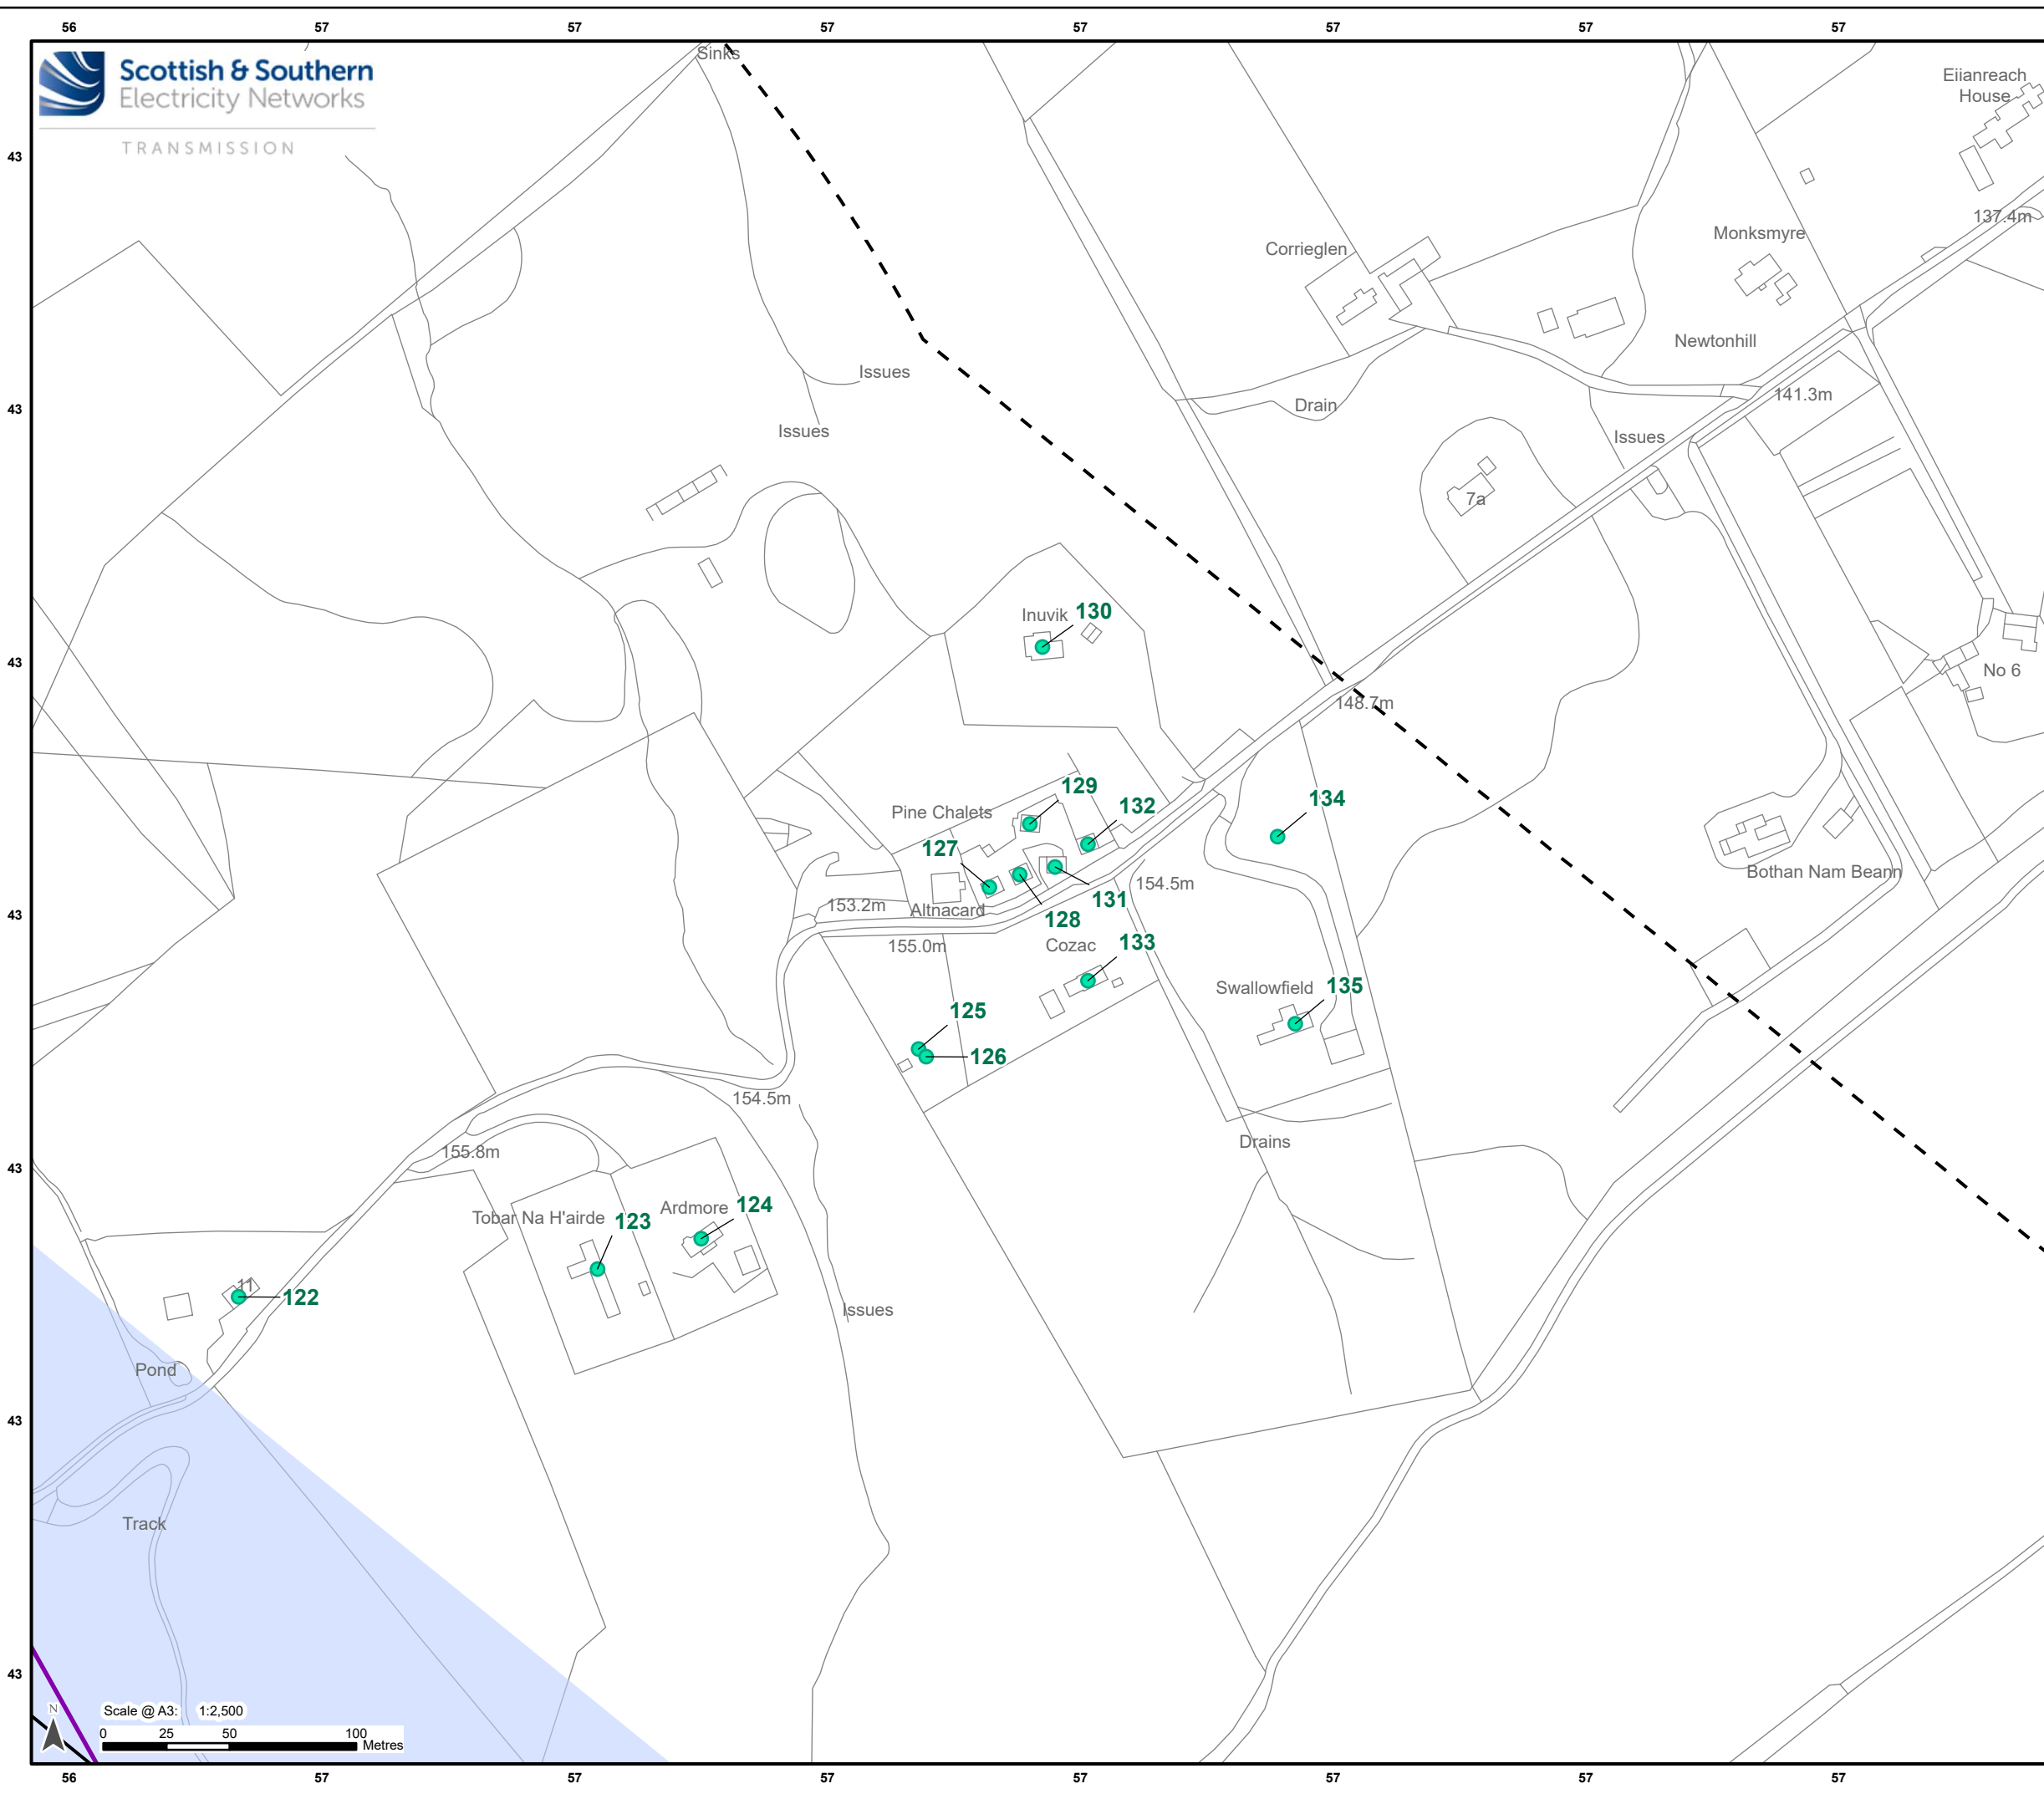

Legend

- Limit of Deviation - Proposed Development
- 500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV

Ancillary Development

- Proposed Access – Temporary

Noise Sensitive Receptor

- Noise Sensitive Receptor and ID

Scale- 1:2,500,000


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 65 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

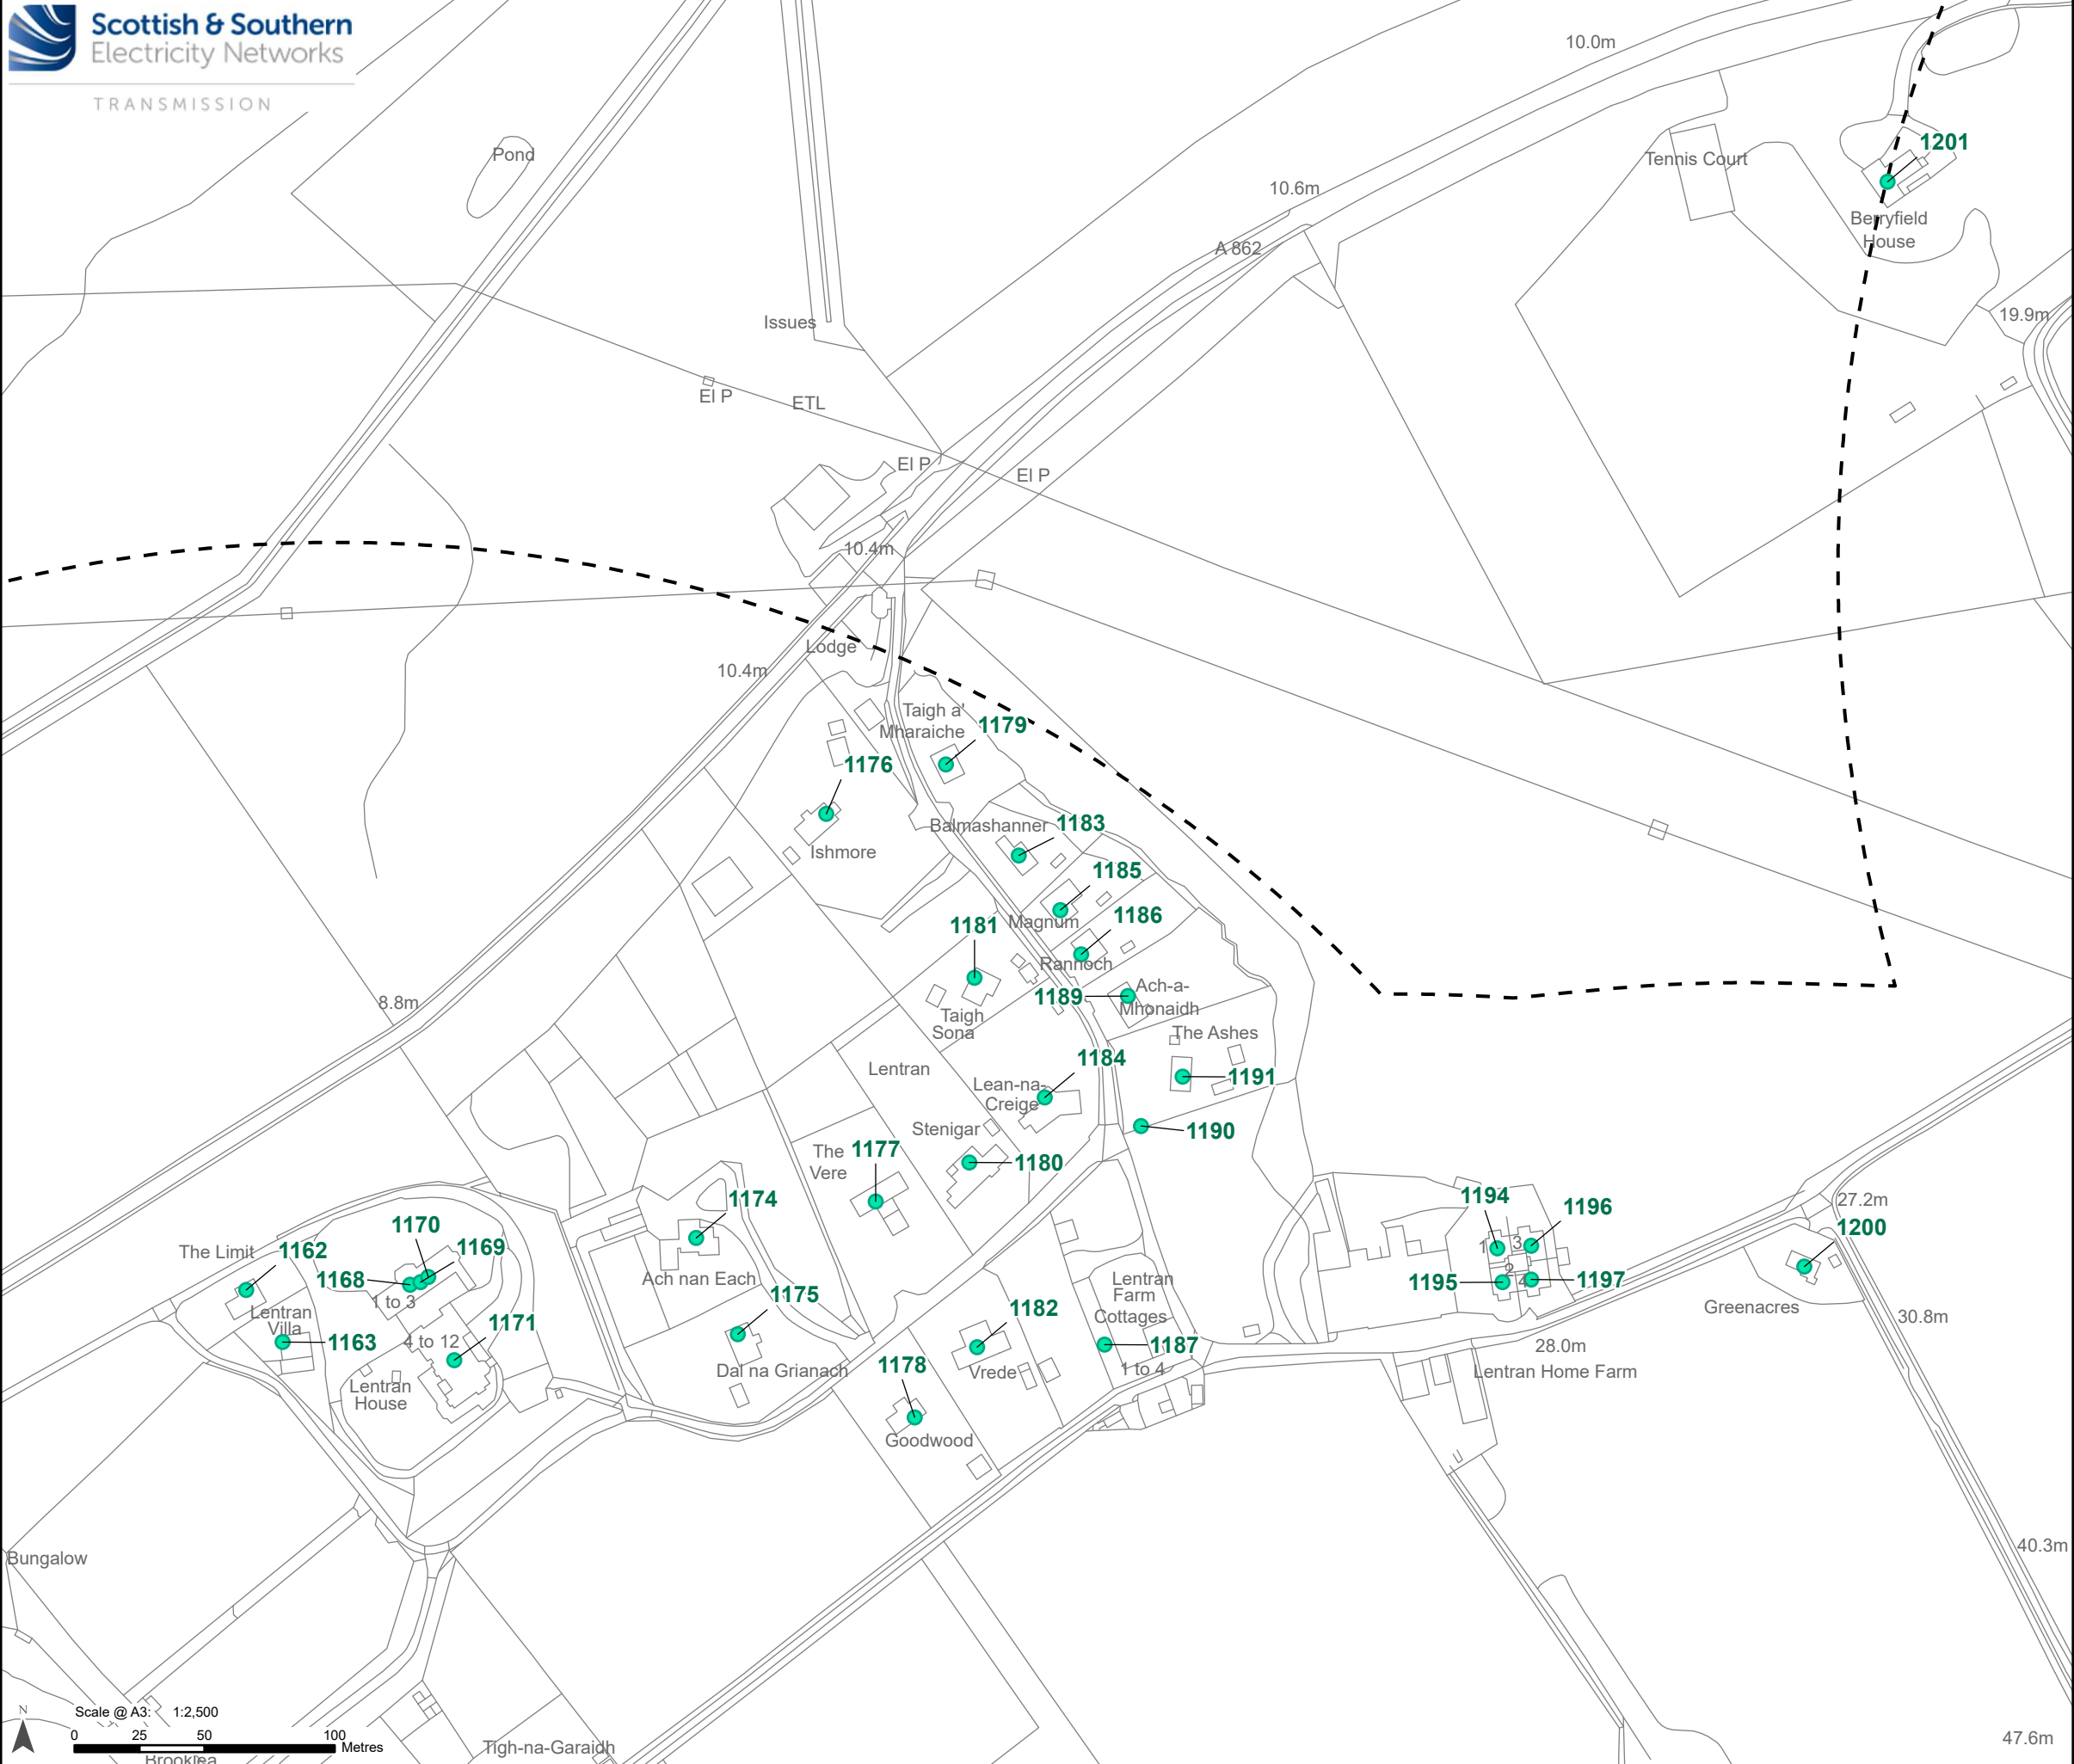


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

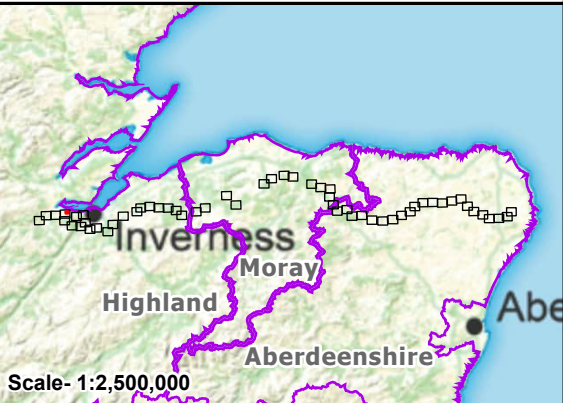


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 66 of 90


Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

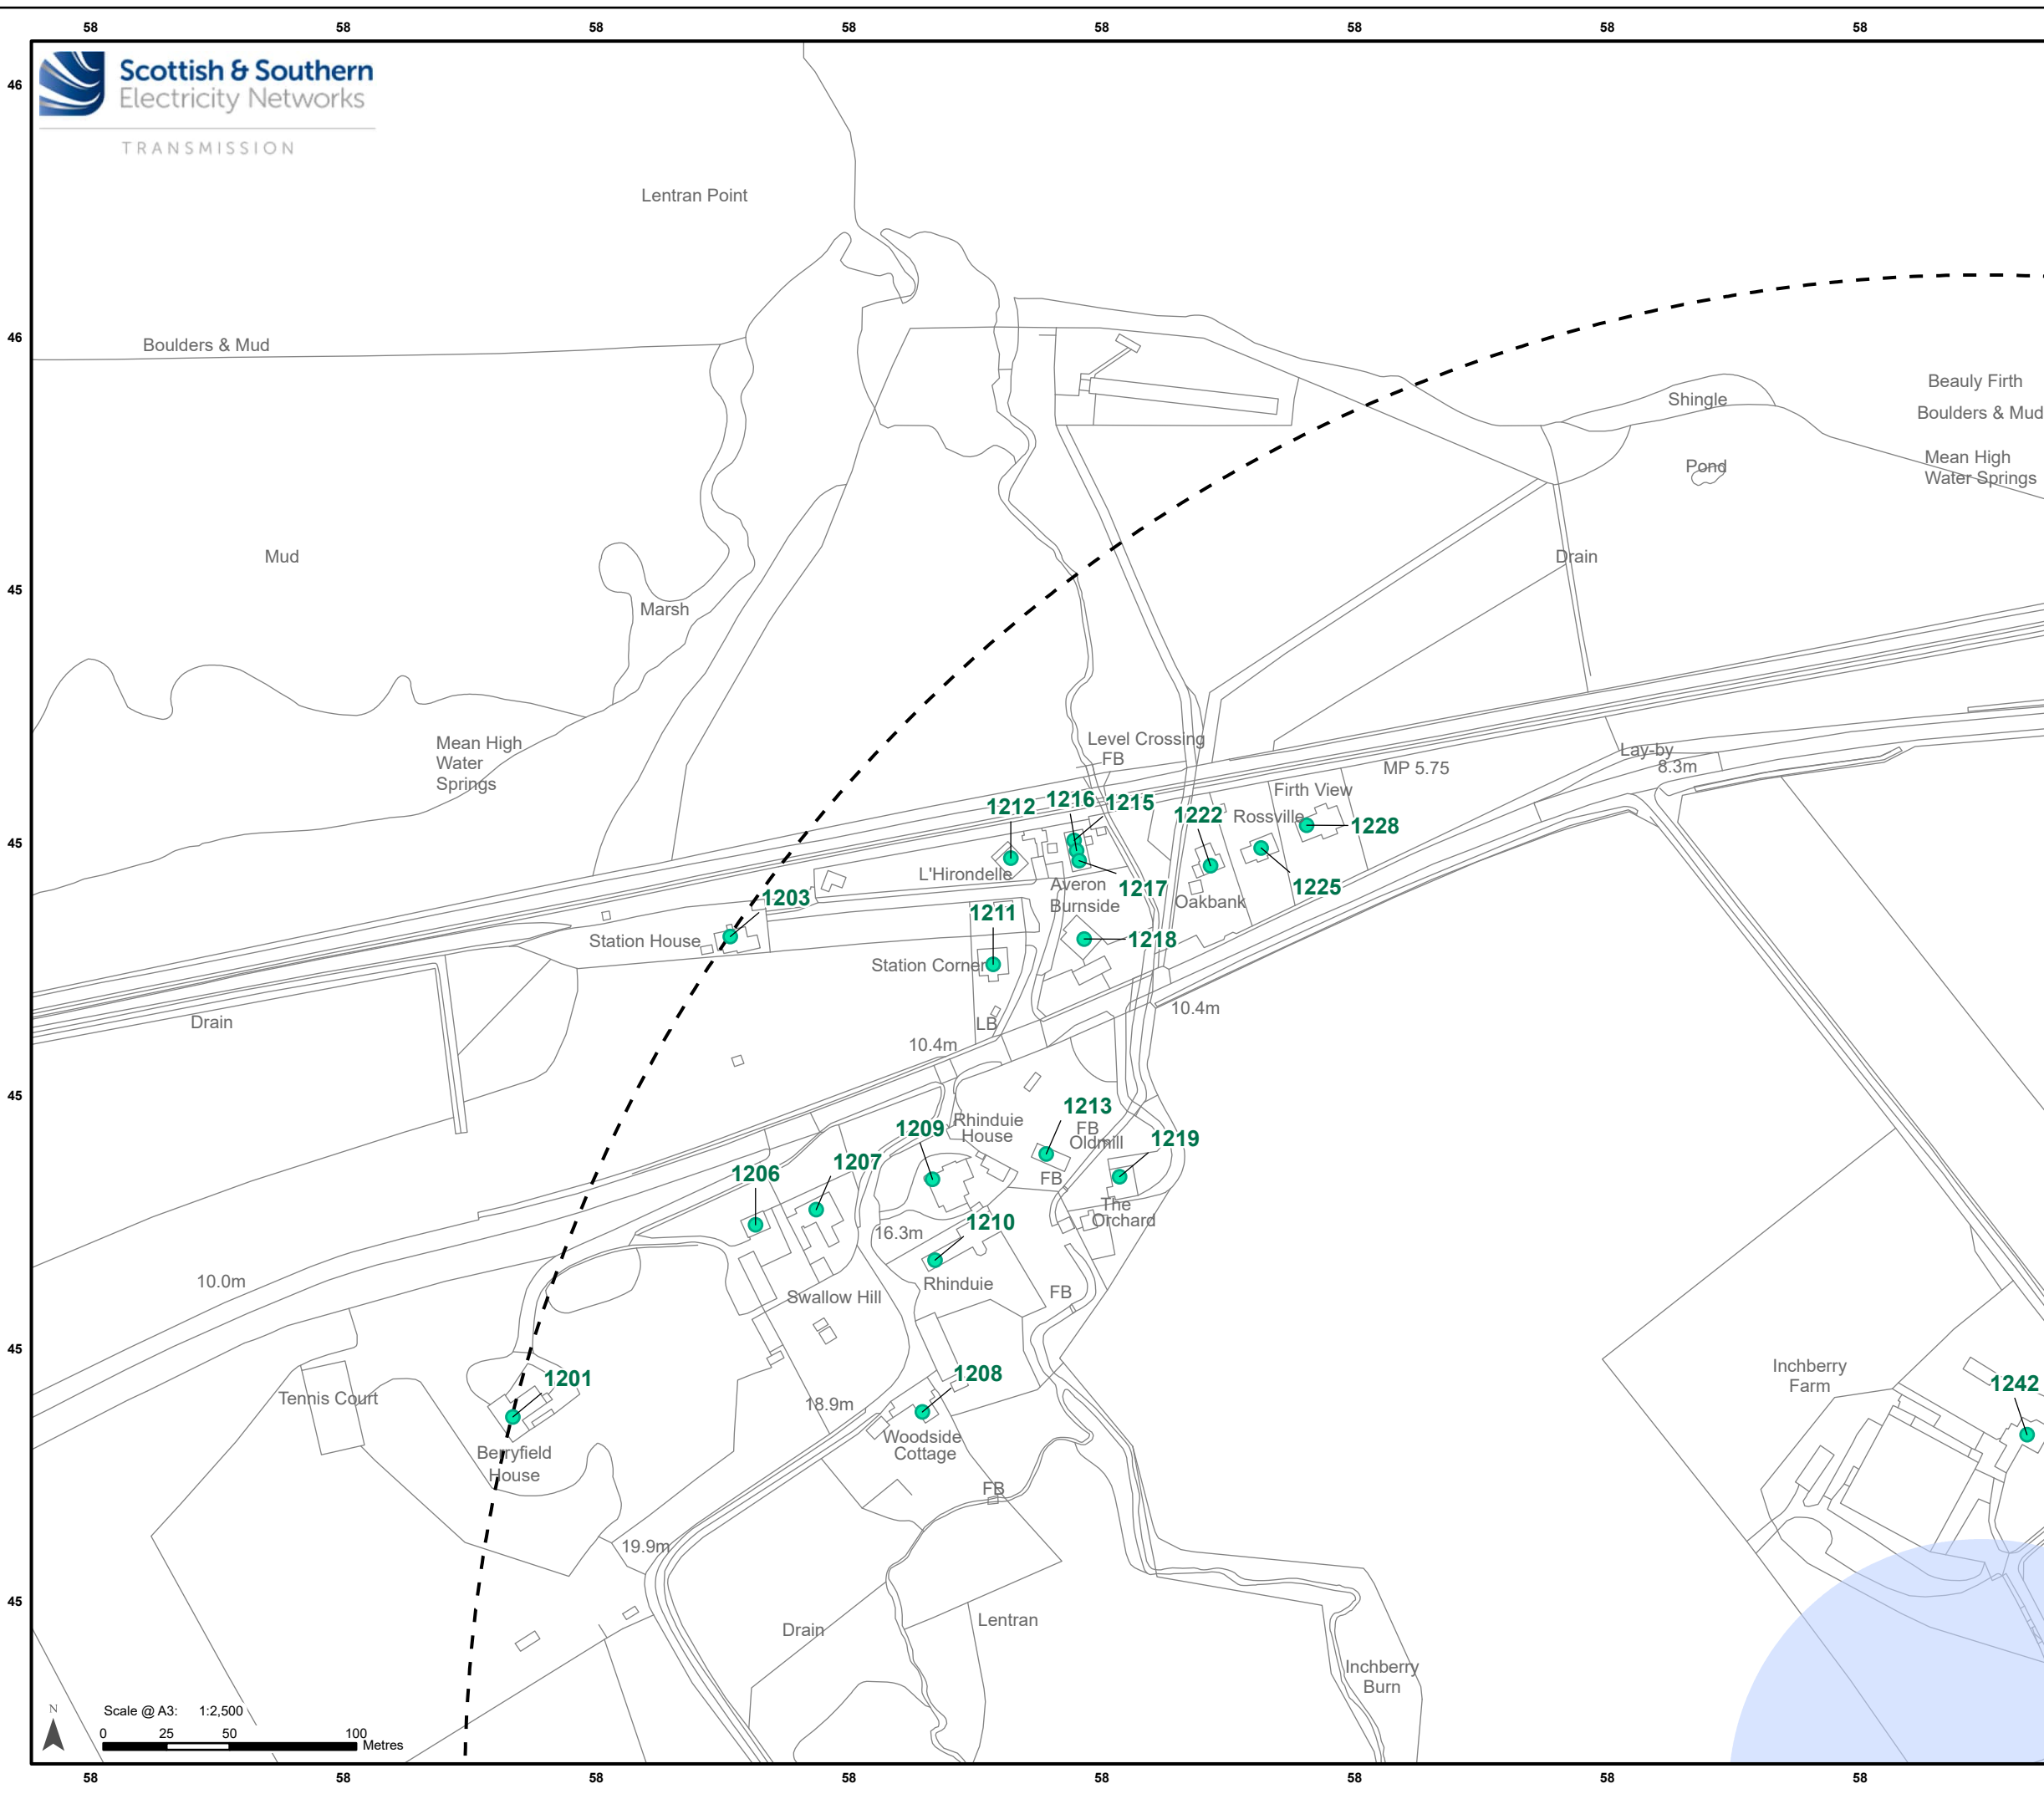

Legend

- Limit of Deviation - Proposed Development
- 500 m Buffer of the Limit of Deviation
- Noise Sensitive Receptor
- Noise Sensitive Receptor and ID

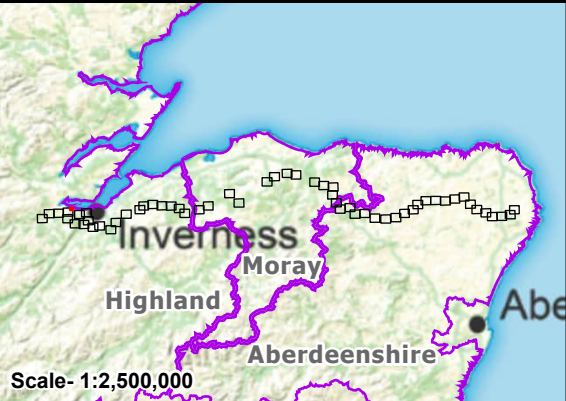

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaully to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 67 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

TRANSMISSION

1201
Berryfield House

1205
Greenloaning

1206
Swallow Hill

1207
Rhinduie

1208
Woodside Cottage

1209
Rhinduie House

1210
The Orchard

1213
FB

1219
FB

1220
Derin

1221
Corriemore

1222
Bhraggie Cottage

1223
Calder Dyke

1224
Lynbaird

1226
Rosemore

1227
Blar-nan-Craobh

1229
Inchberry Brook

1230
Inchberry

1231
Inchberry

1232
Inchberry Lodge

1233
Inchberry Bungalow

1234
Tigh Aluinn

1235
Valleyside

1237
Inchberry Cottage

1238
May Cottage

1239
Inchberry Cottage

1240
Inchberry House

1242
Inchberry House

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation


Ancillary Development

Proposed Bellmouth - Access Only / ATV

Proposed Access - ATV or Temporary Trackway

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

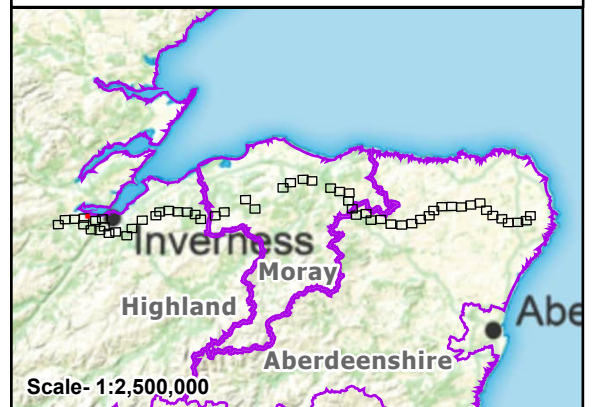


Scale- 1:2,500,000
Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 68 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

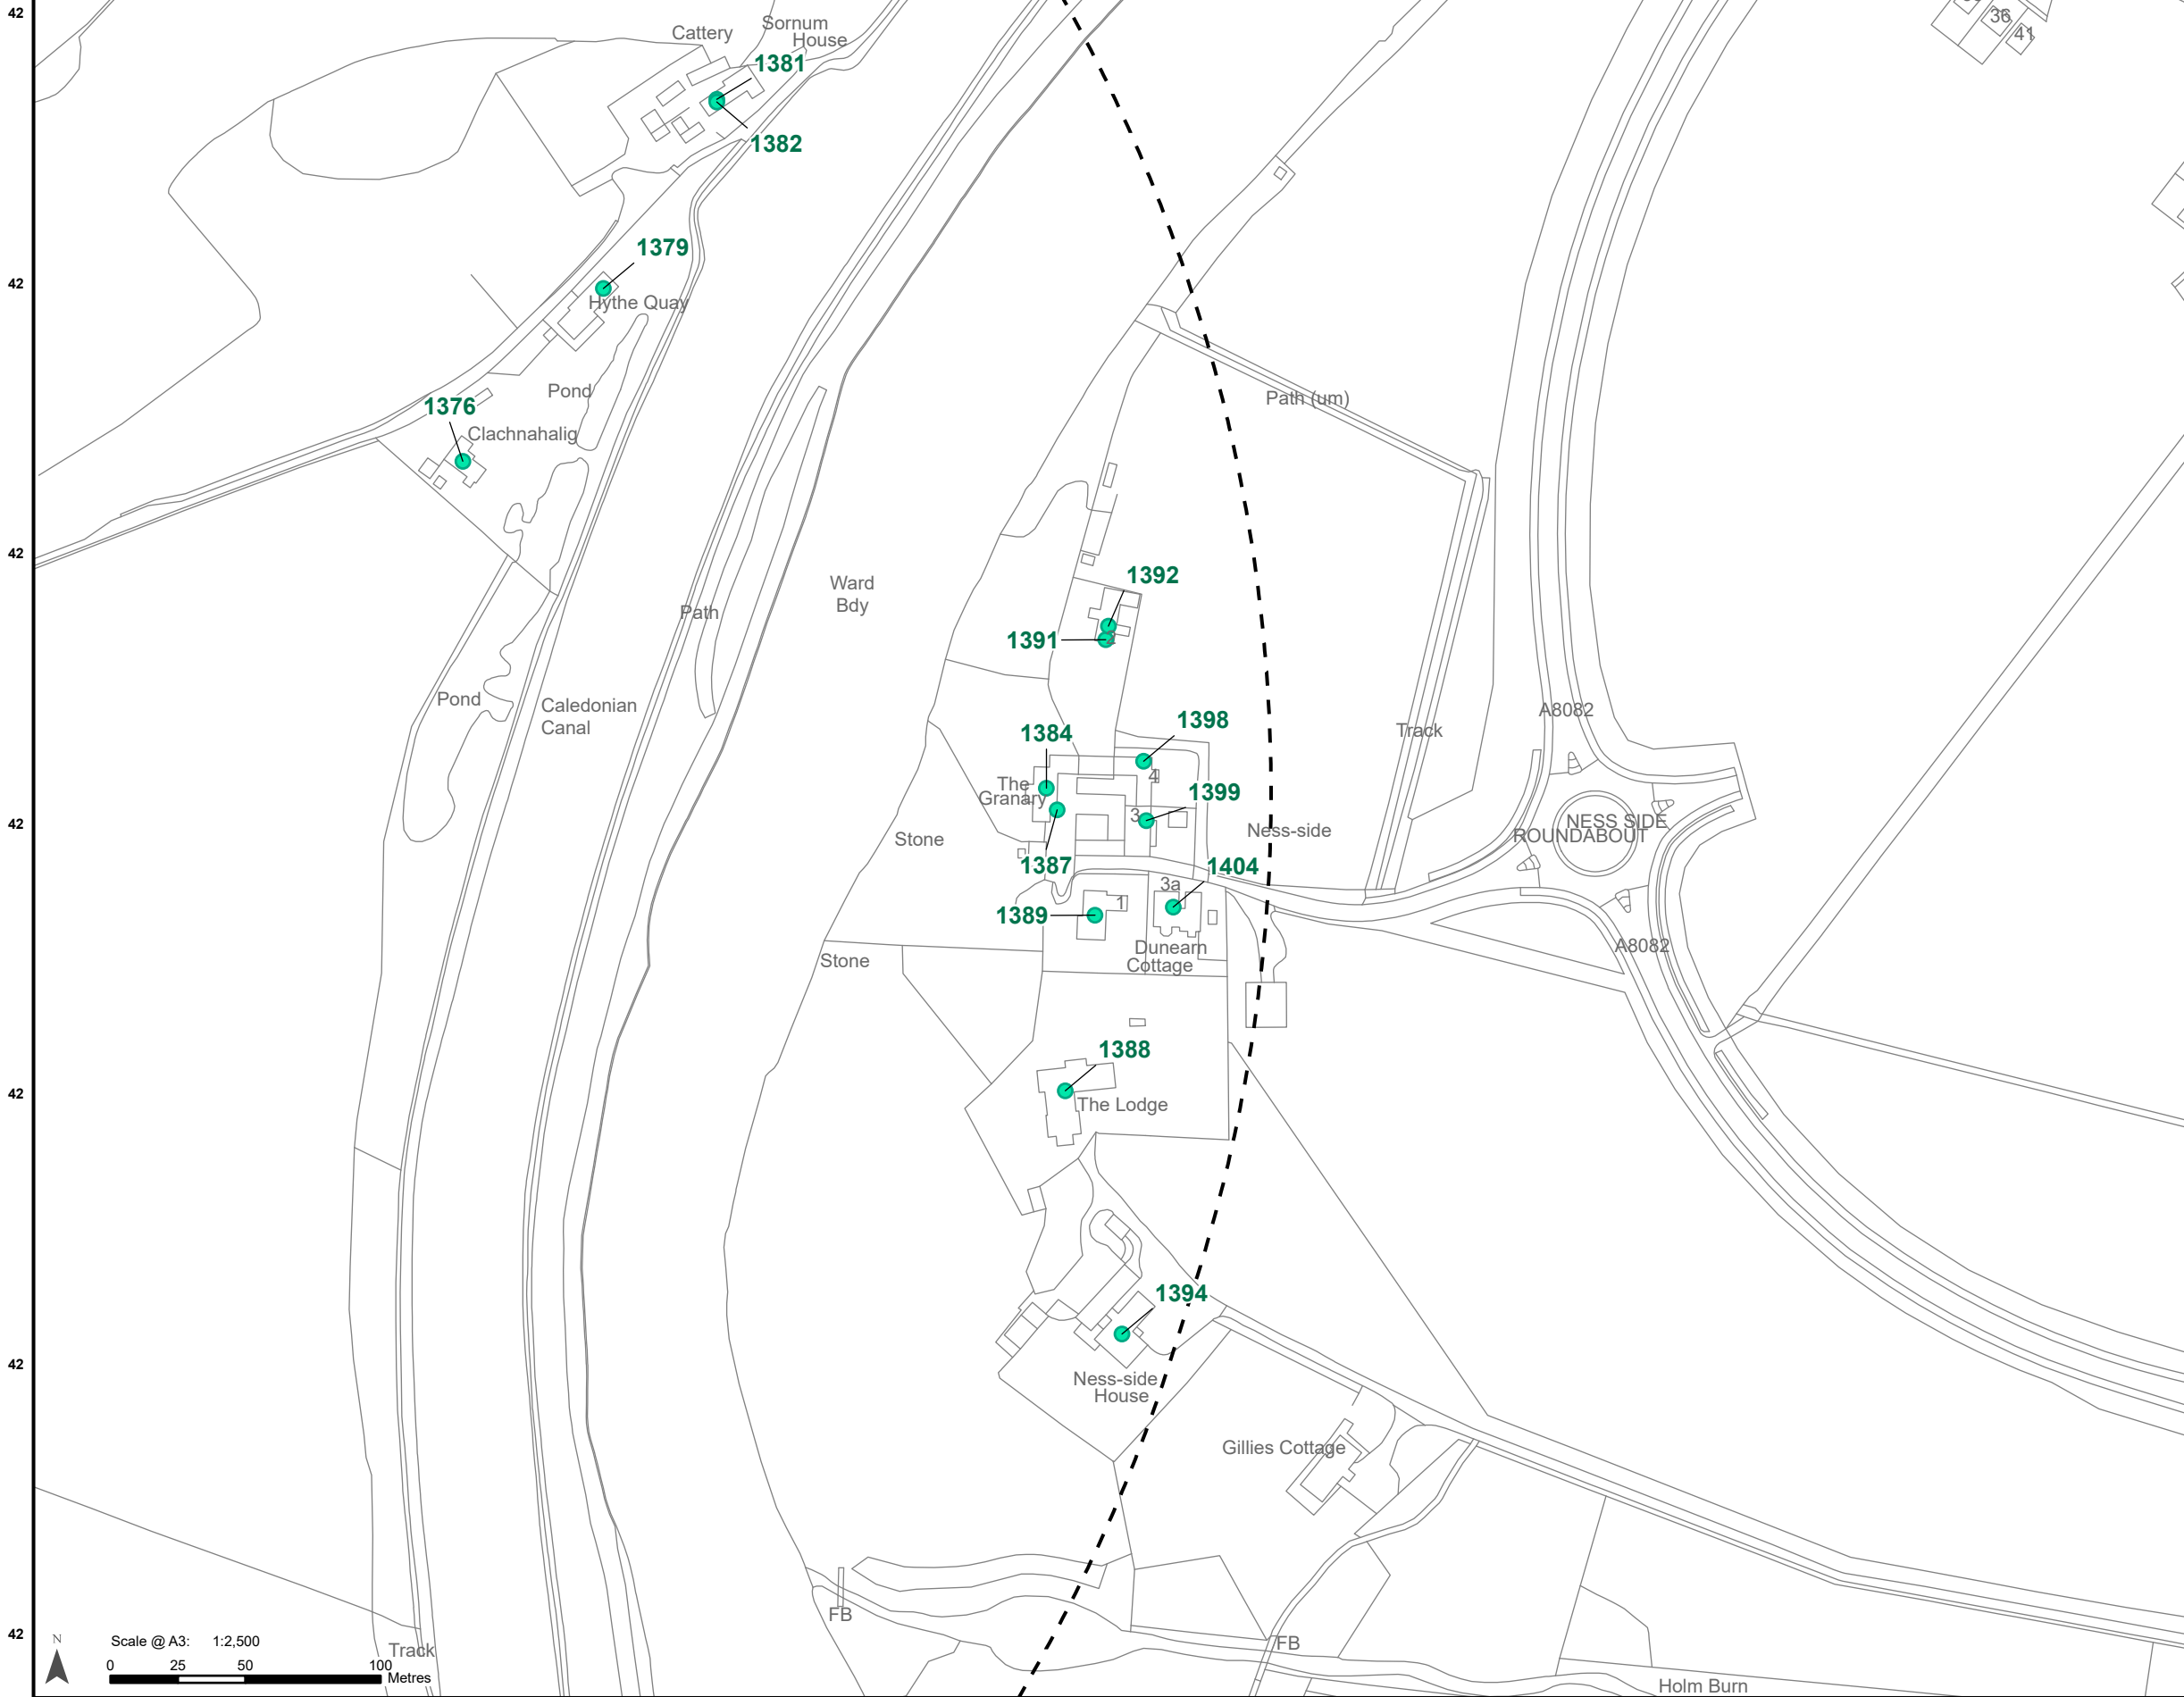


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

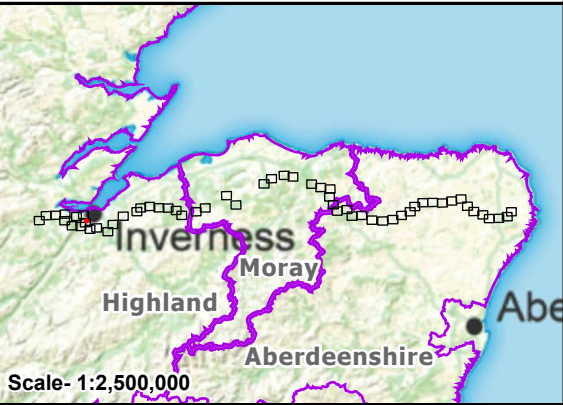


Scale- 1:2,500,000
Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 71 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

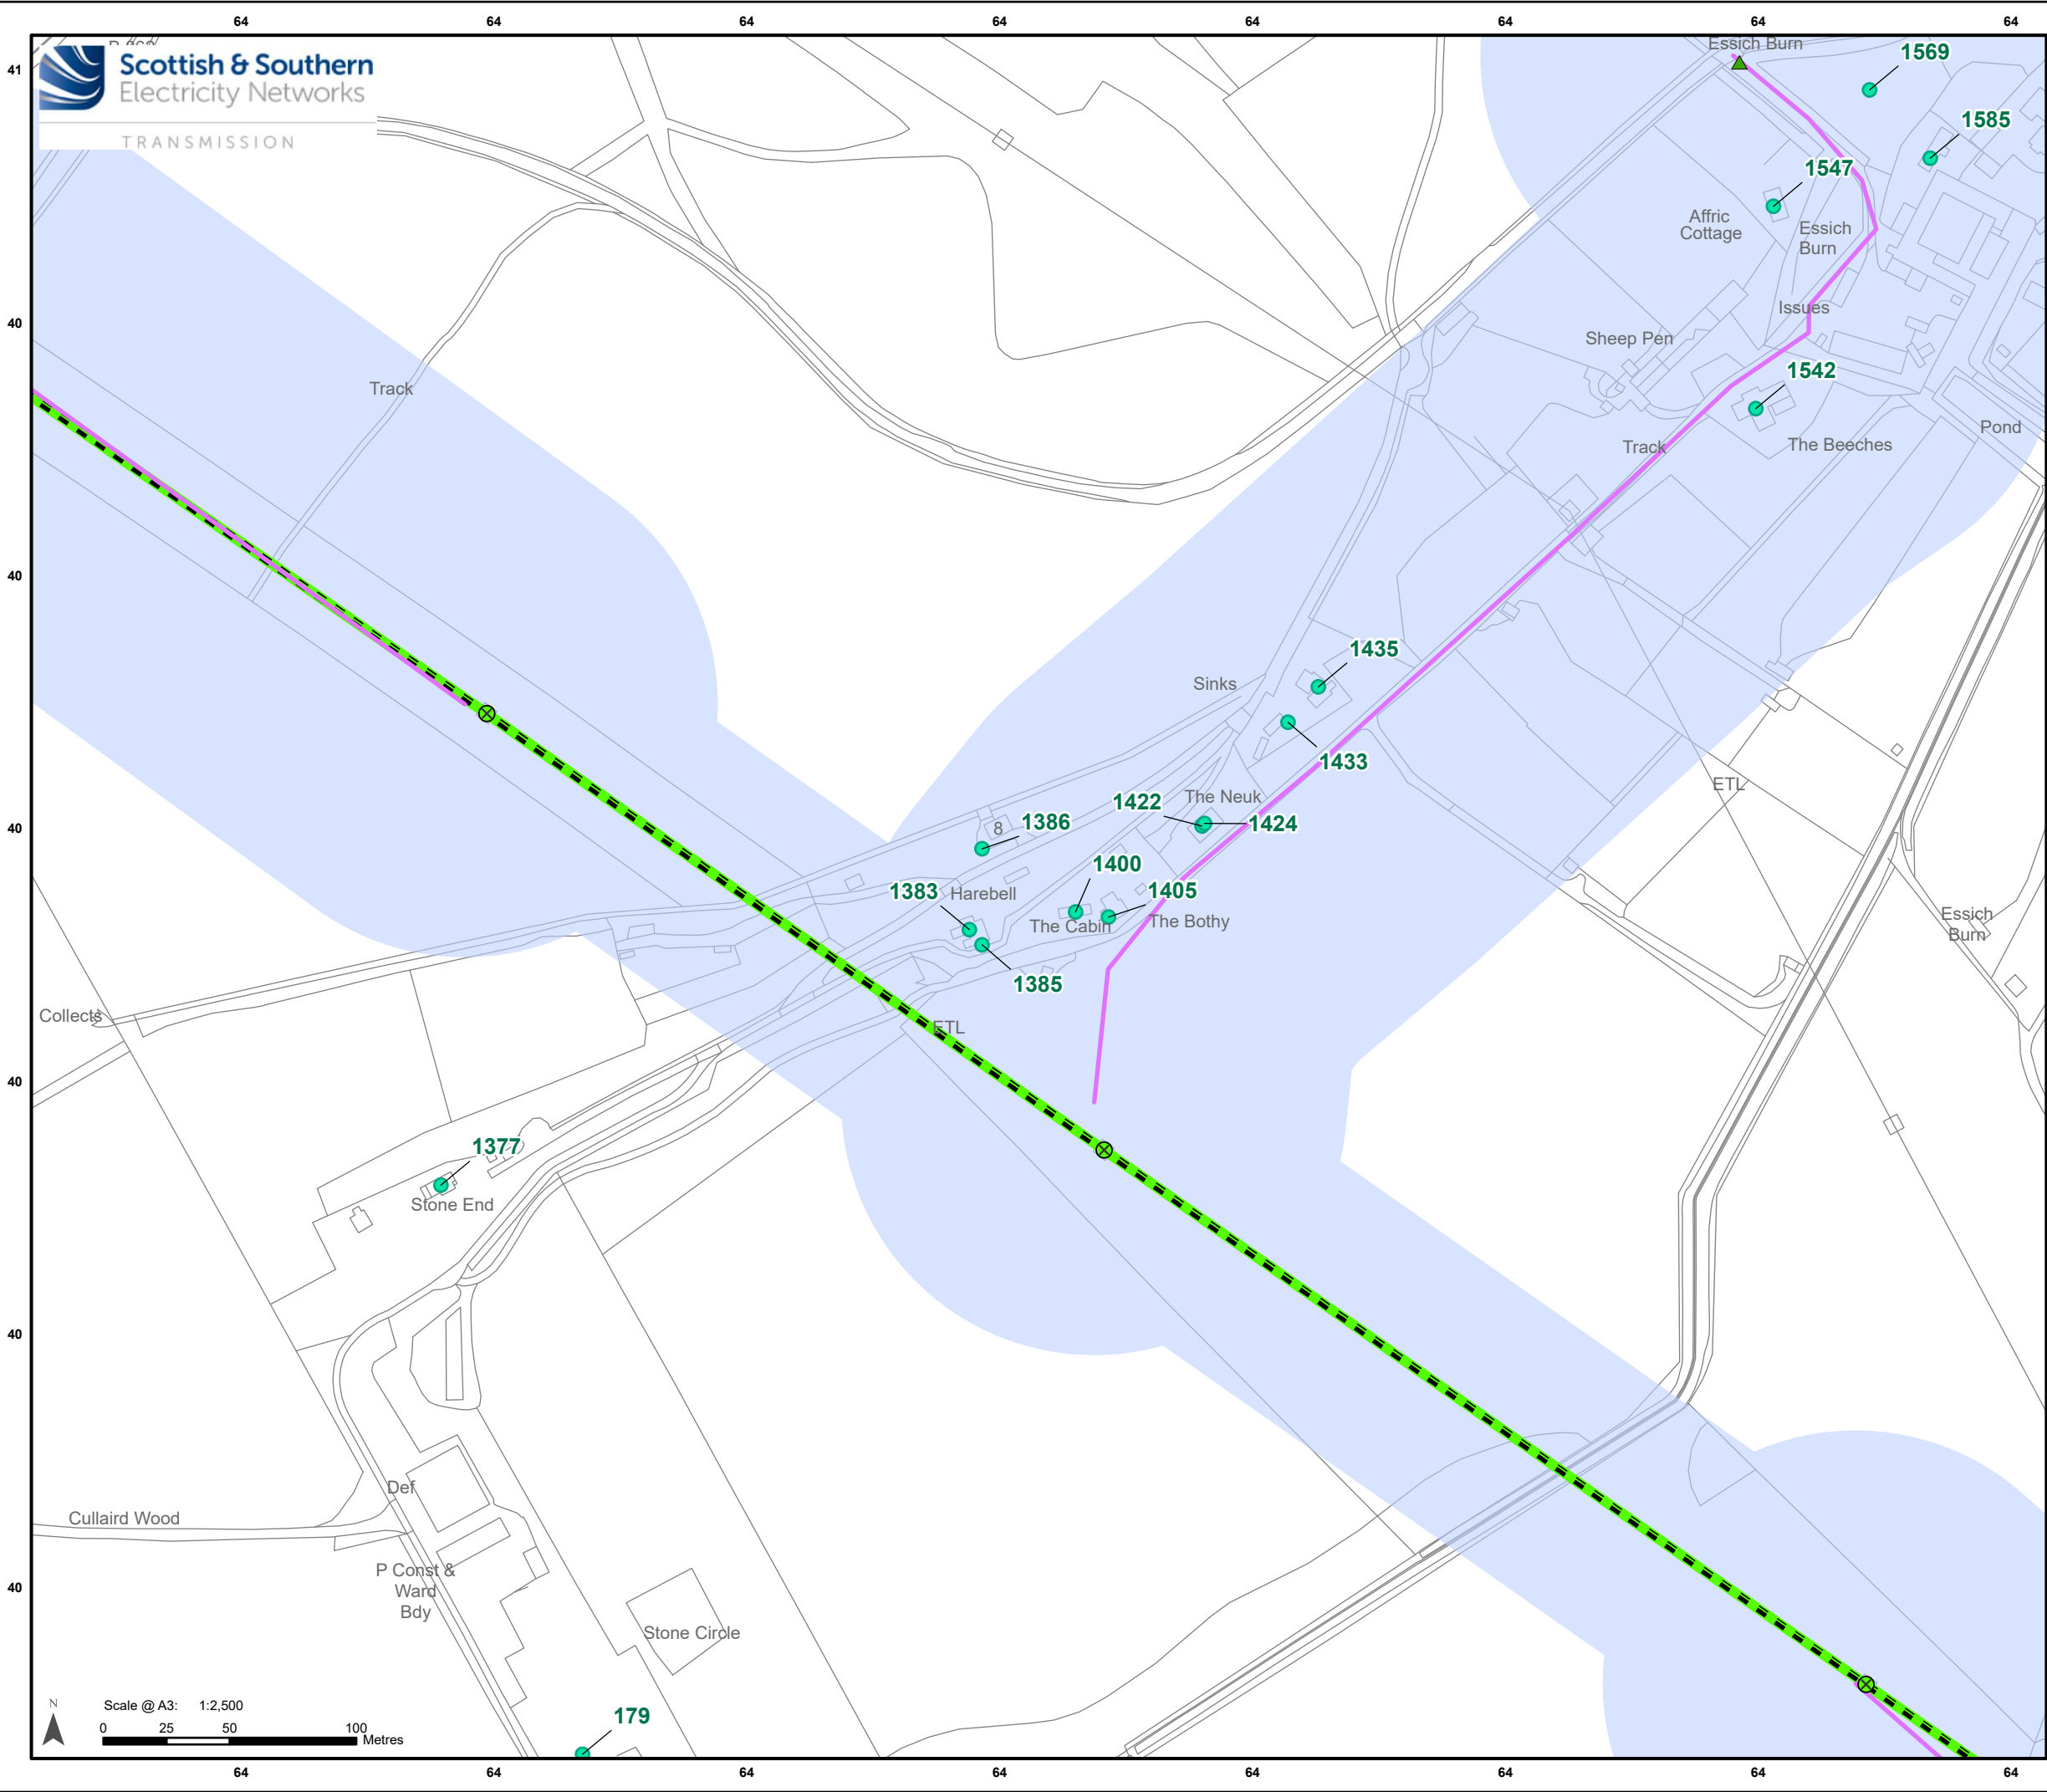

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Ancillary Development

Tower to be Removed


Proposed Bellmouth - Access Only / ATV

Proposed Access – ATV or Temporary Trackway

OHL to be Removed

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

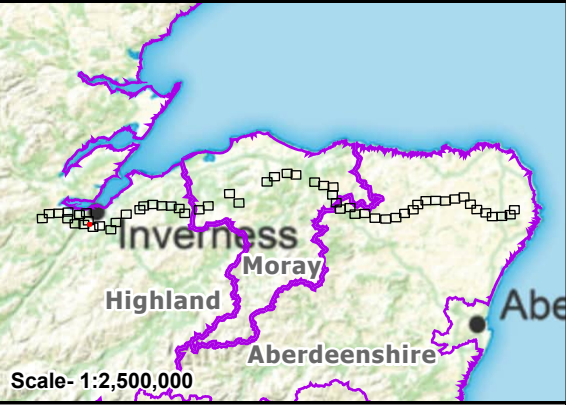

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 15.1 - Noise Sensitive Receptors (NSRs) Page 72 of 90
Drawn by:	MAL
Date:	19/09/2025
Drawing:	B2P-WSP-DA-70092380-190