


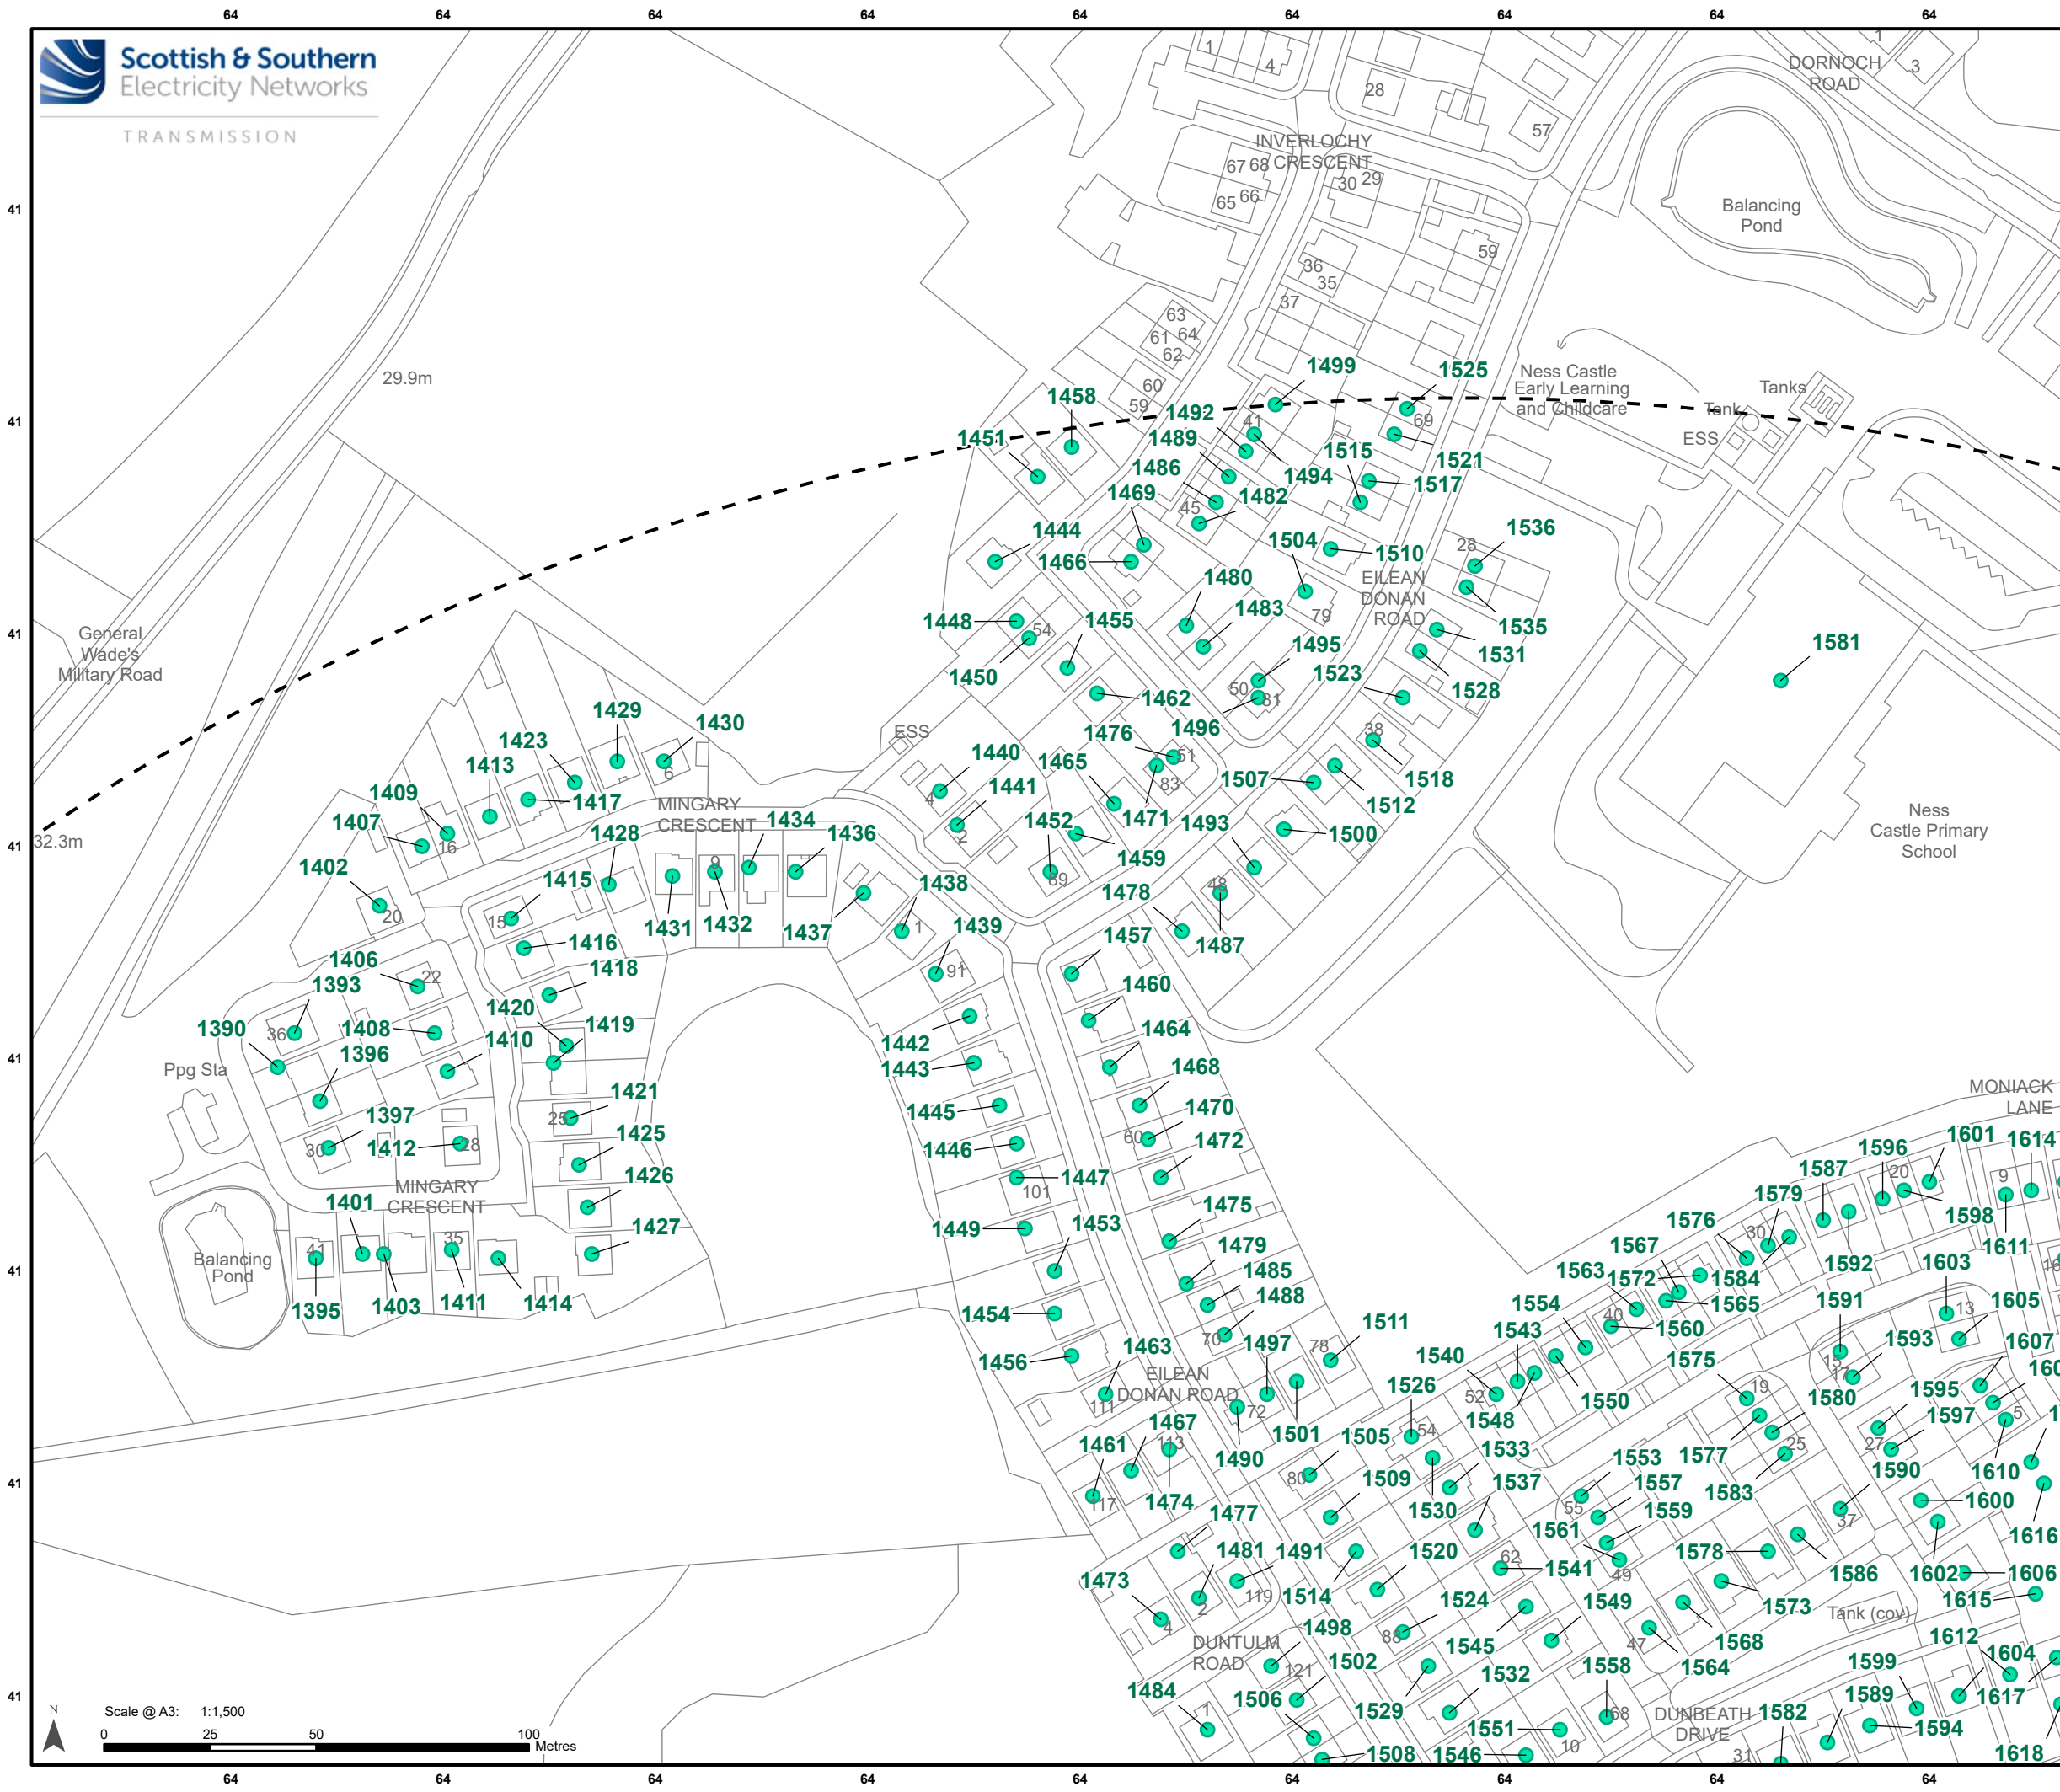


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

● Noise Sensitive Receptor and ID

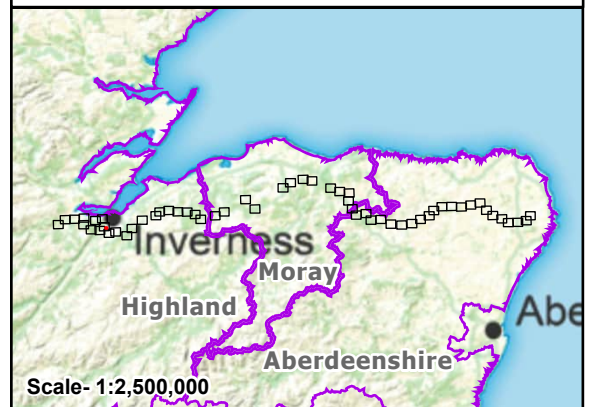



Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 73 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

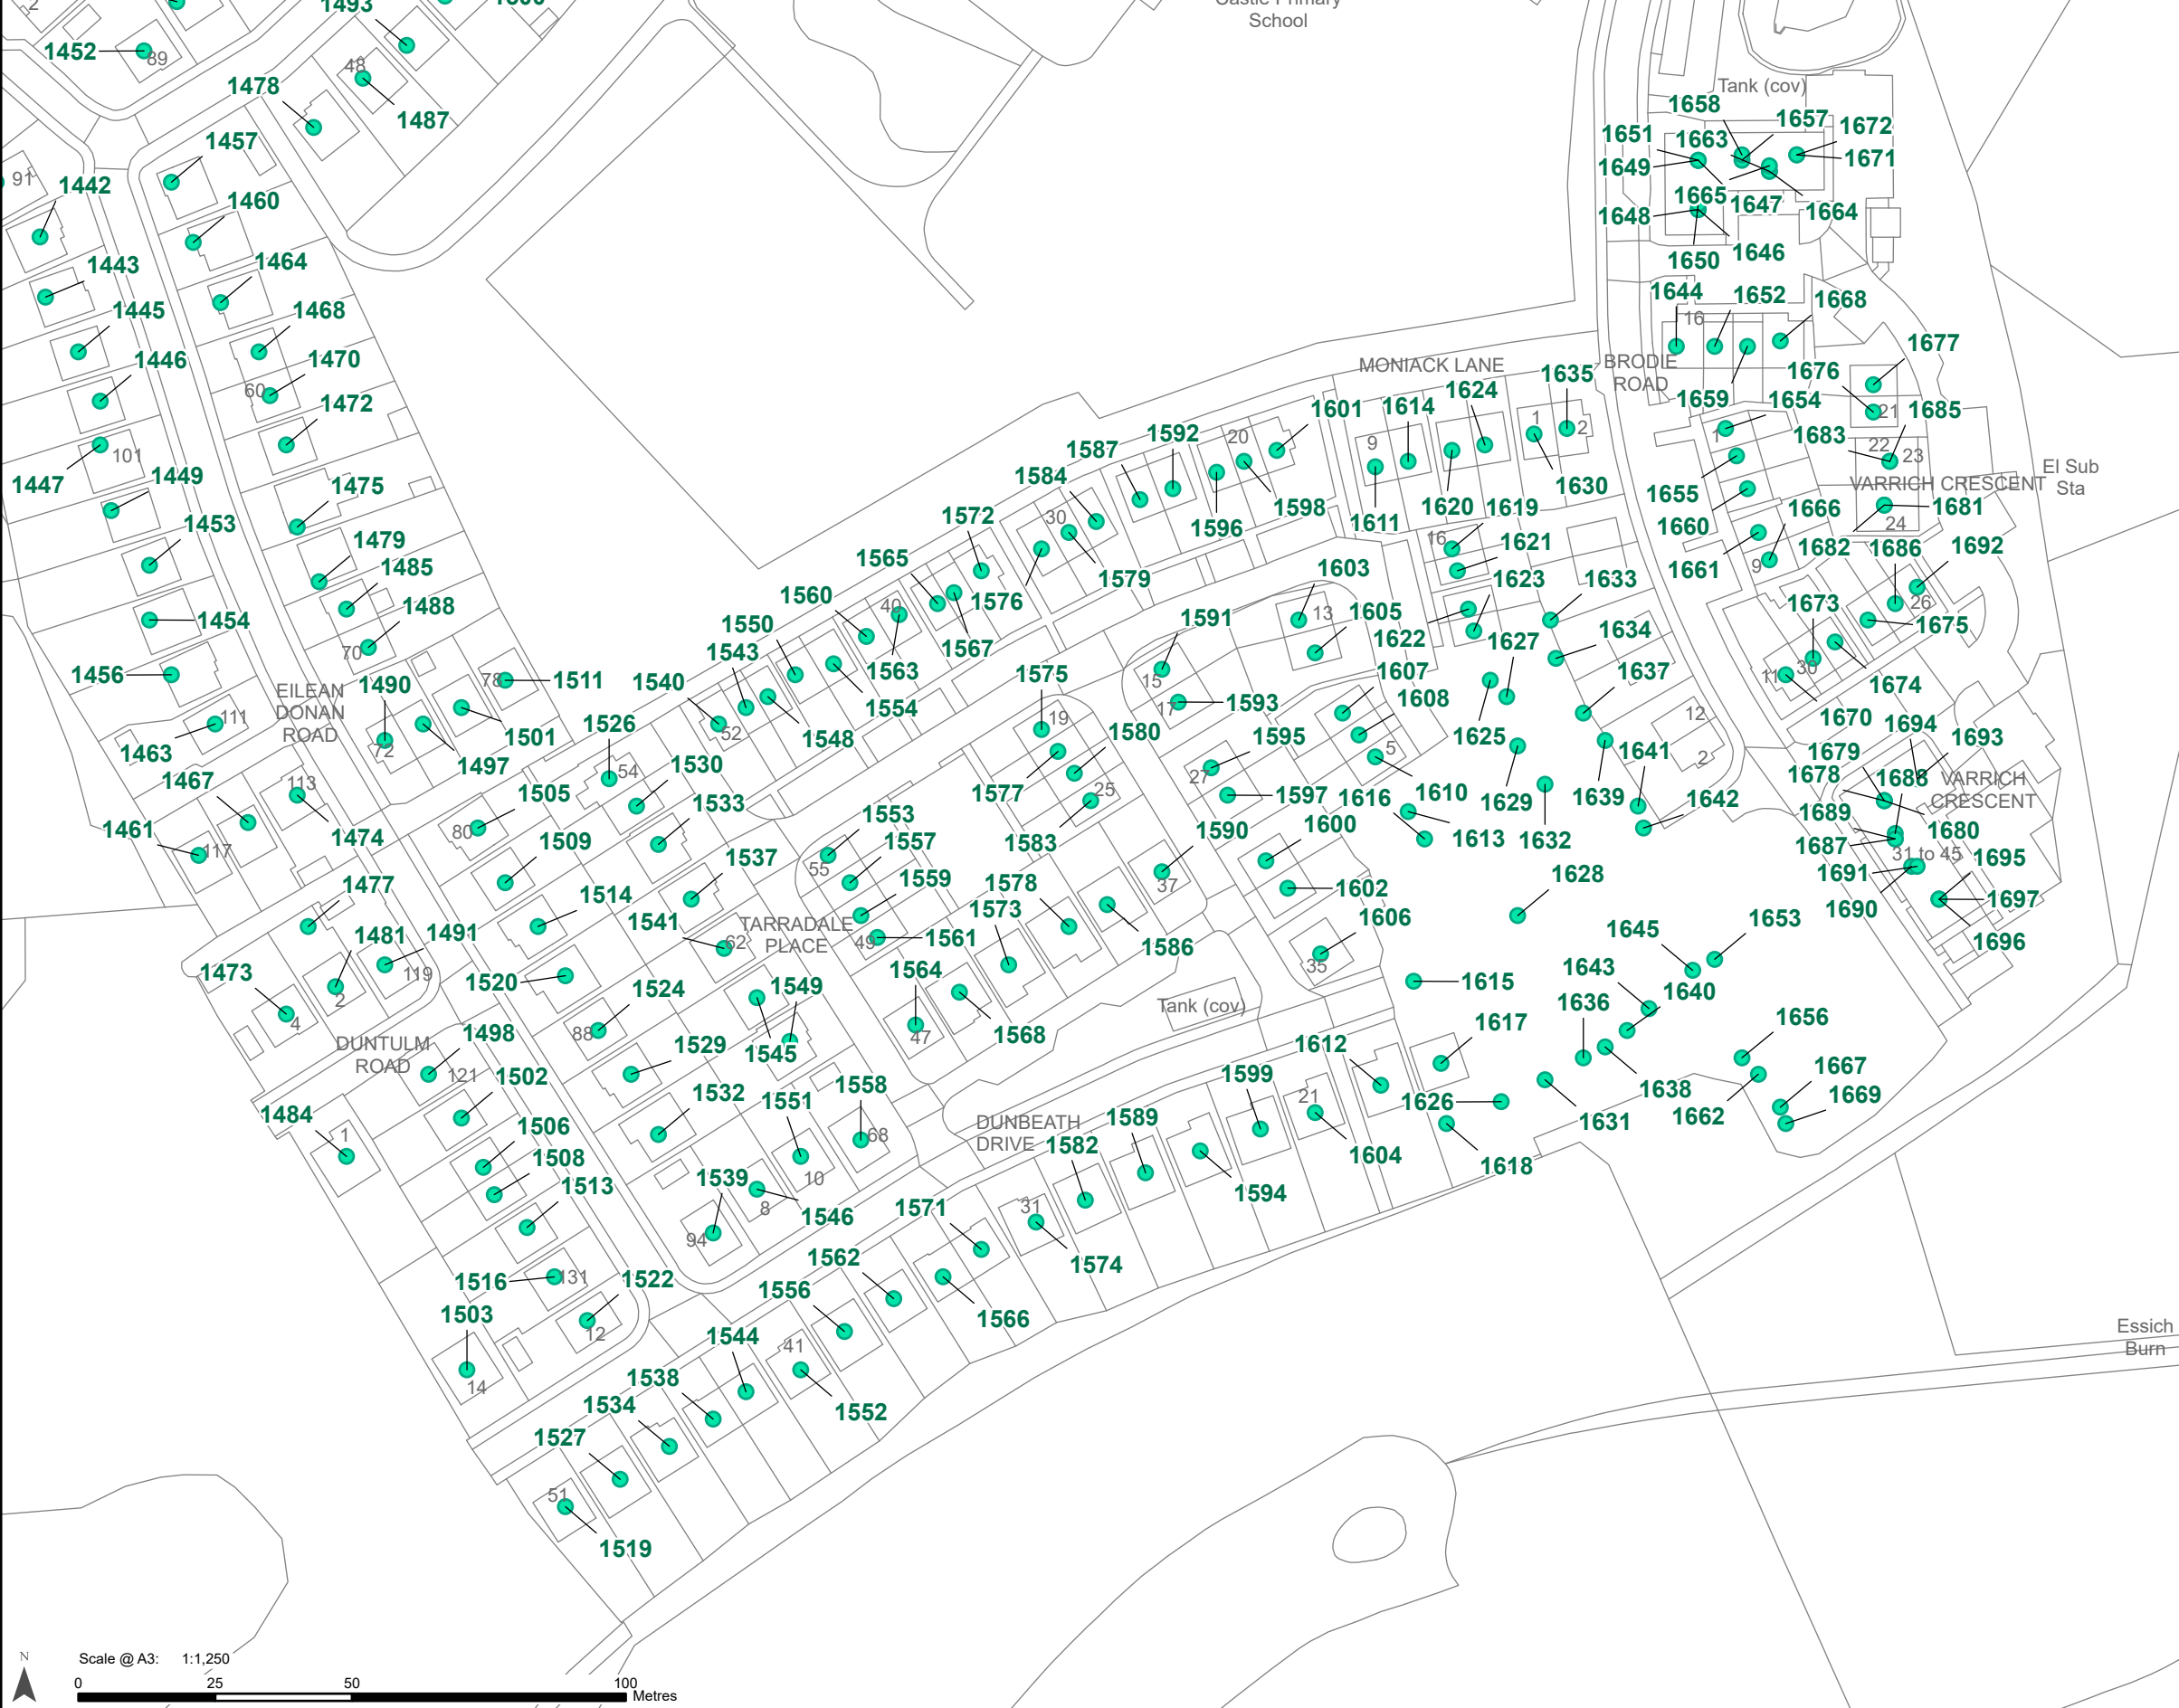

Legend

500 m Buffer of the Limit of Deviation


Noise Sensitive Receptor

Noise Sensitive Receptor and ID

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 15.1 - Noise Sensitive Receptors (NSRs) Page 74 of 90
Drawn by:	MAL
Date:	19/09/2025
Drawing:	B2P-WSP-DA-70092380-190

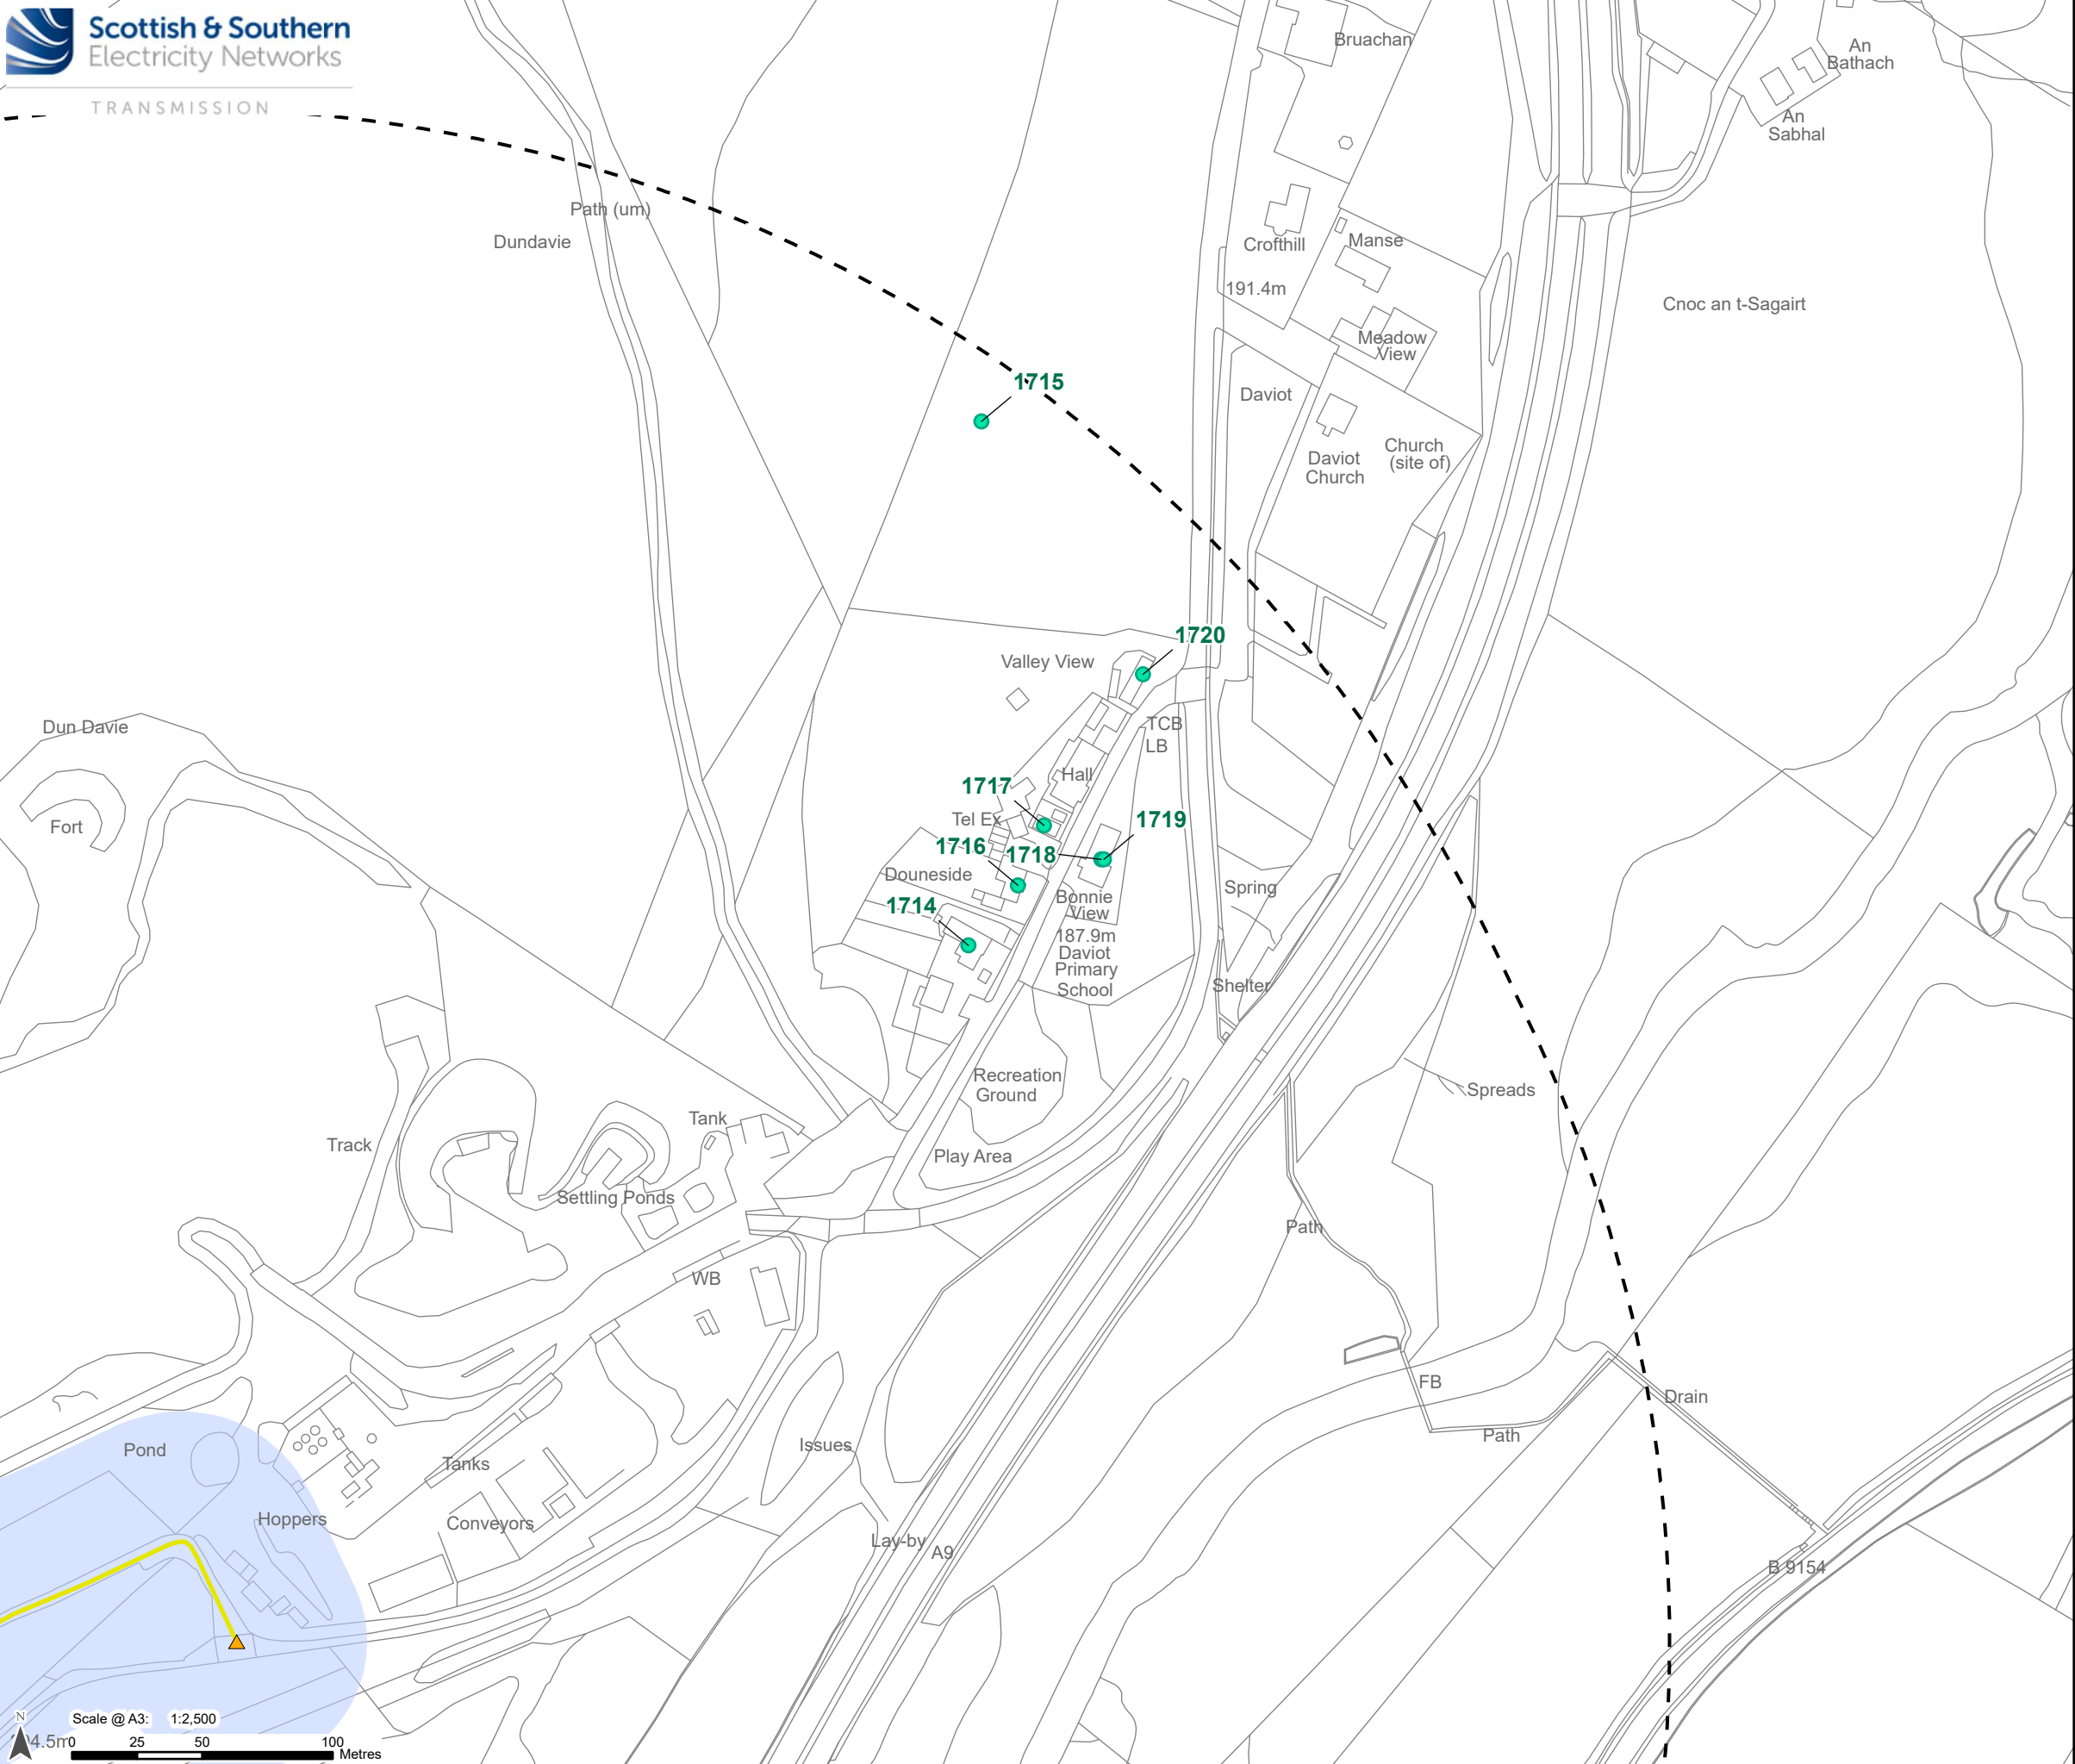

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation


Ancillary Development

Proposed Bellmouth - Upgrade

Existing Access - Upgrade - Good / Fair Condition

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

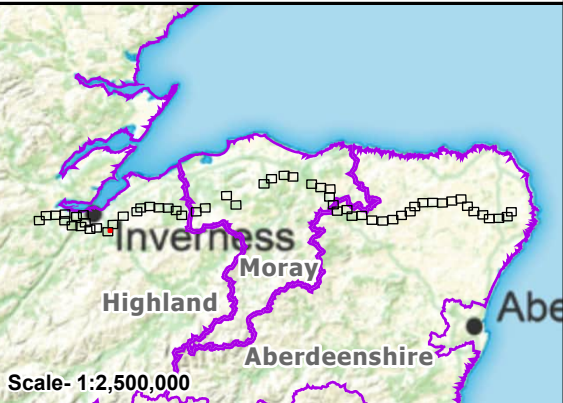


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 75 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

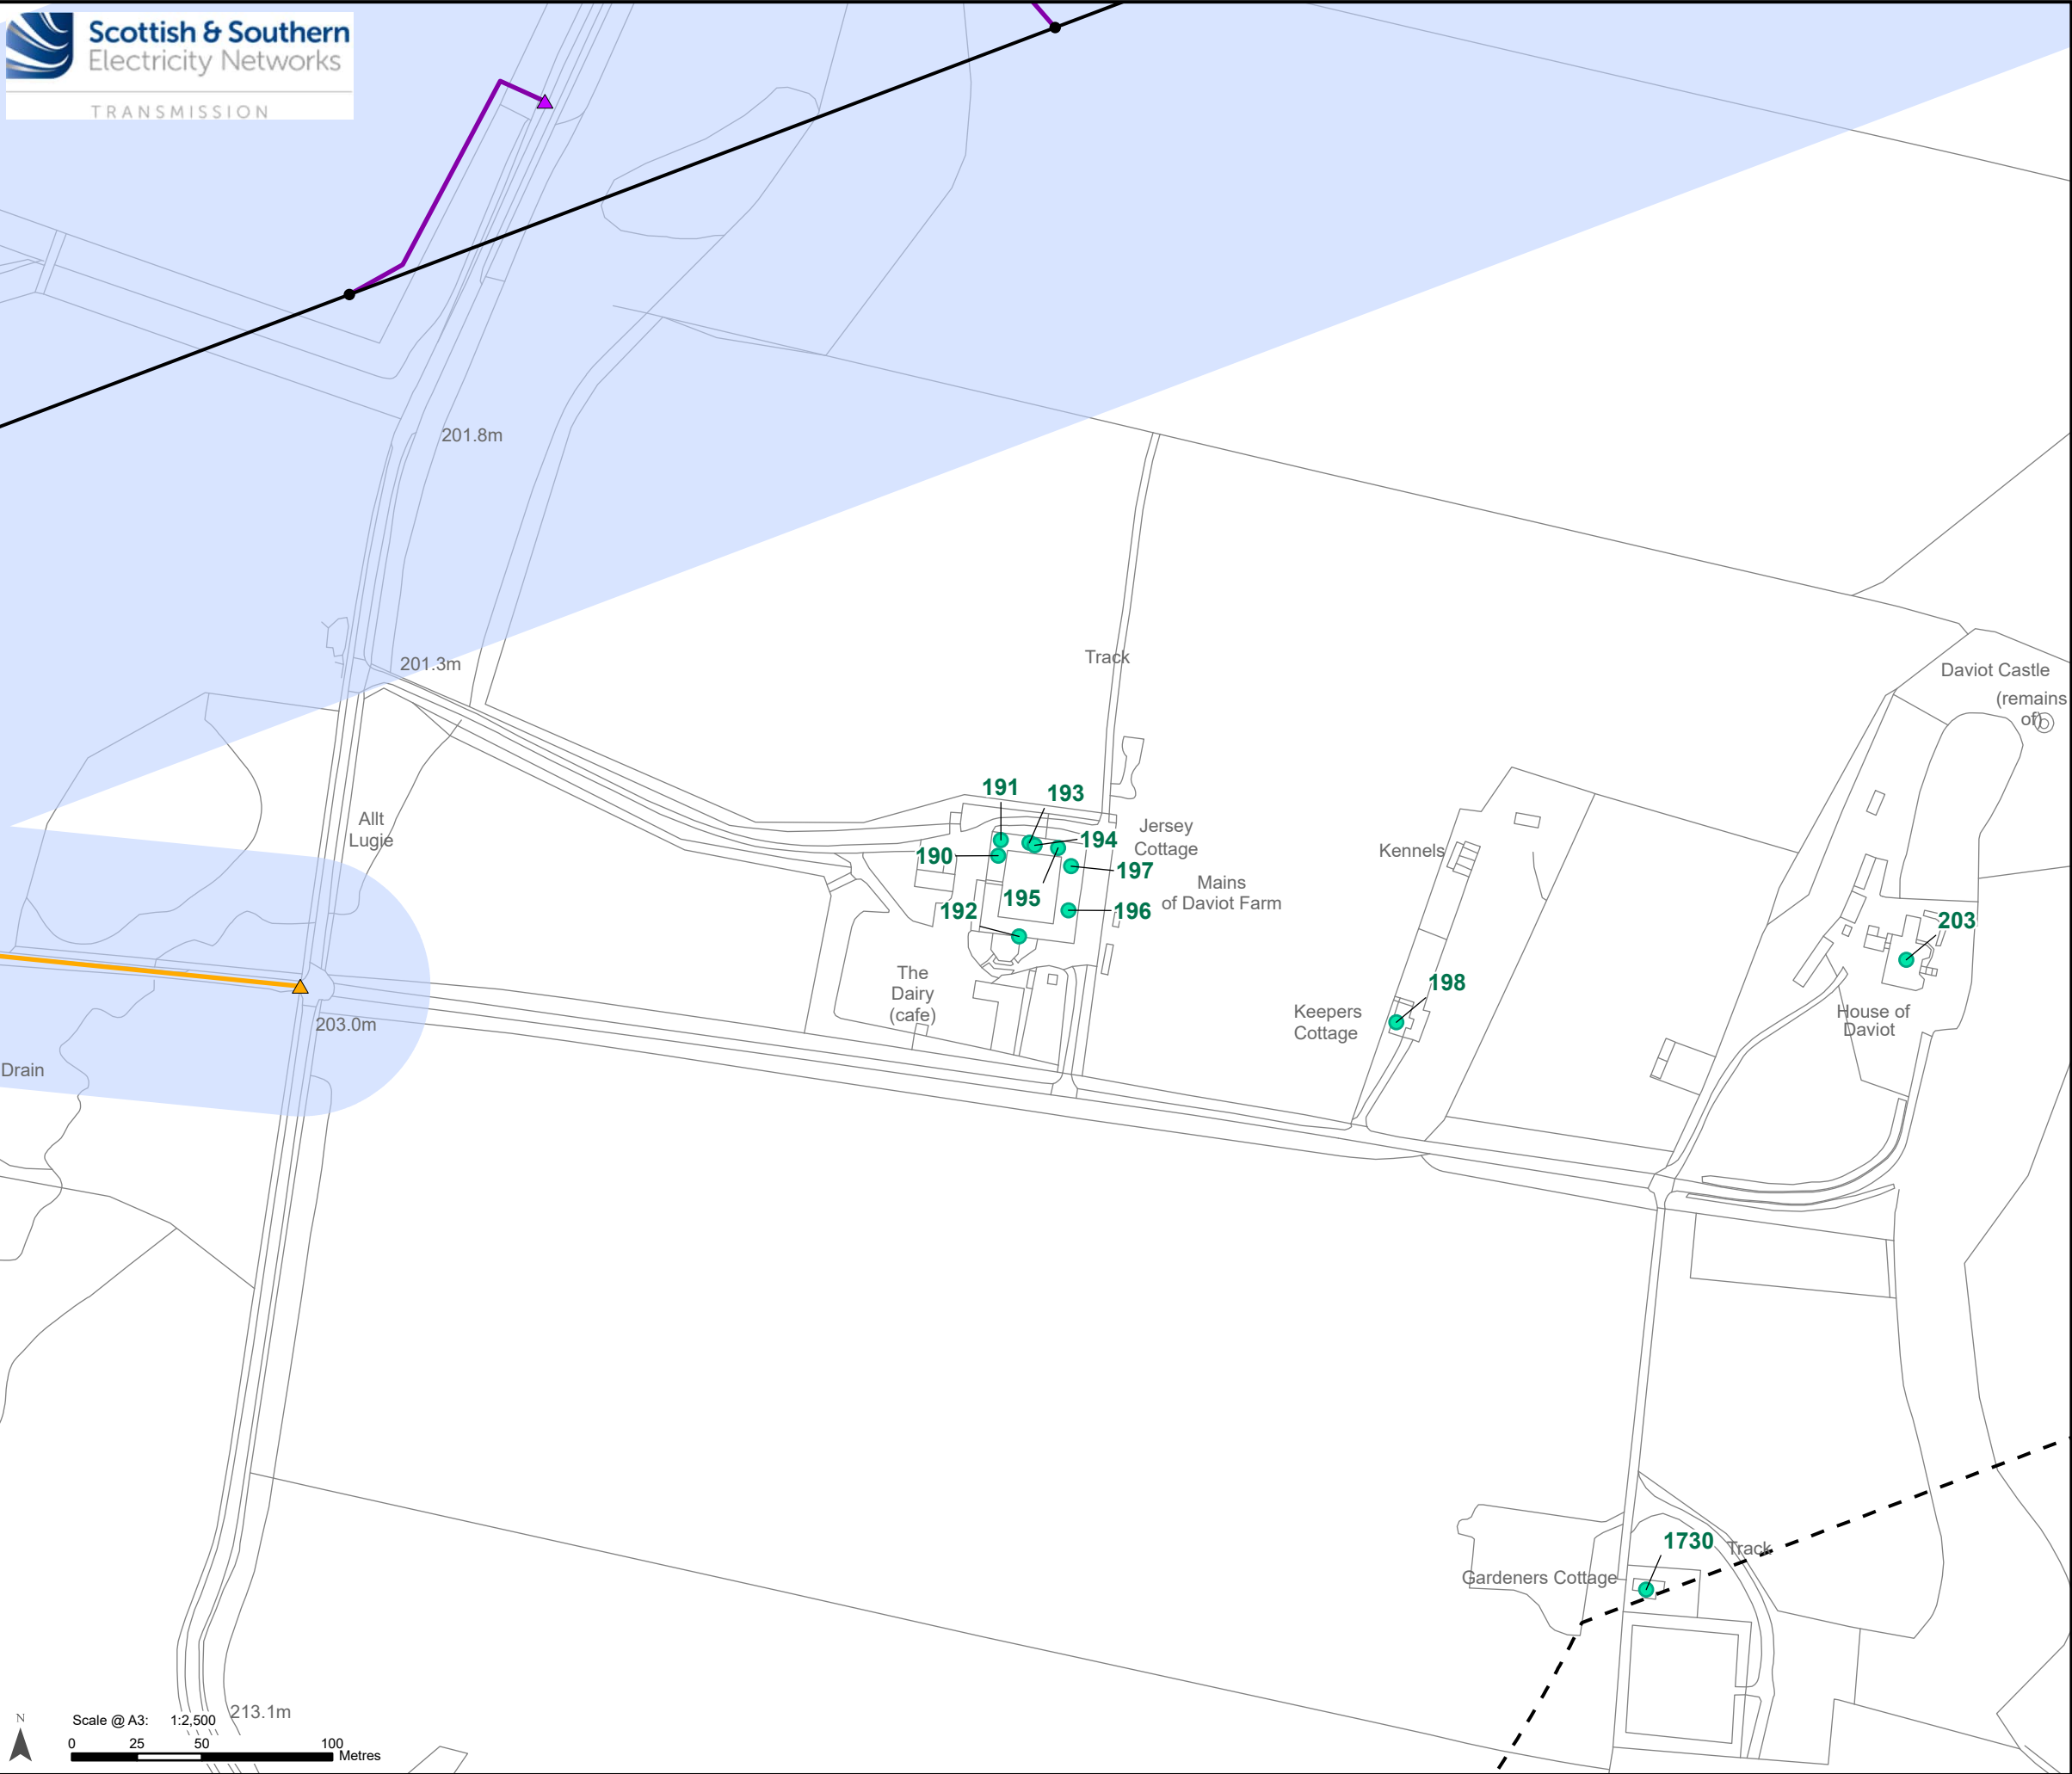

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Label

Proposed Tower - 400 kV

Ancillary Development

Proposed Bellmouth - Temporary


Proposed Bellmouth - Upgrade

Existing Access – Upgrade – Poor Condition

Proposed Access – Temporary

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

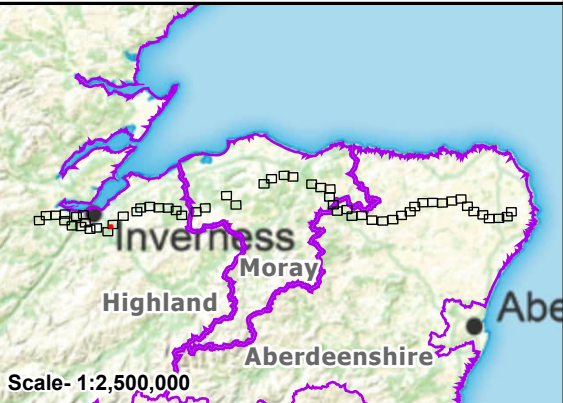


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 76 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

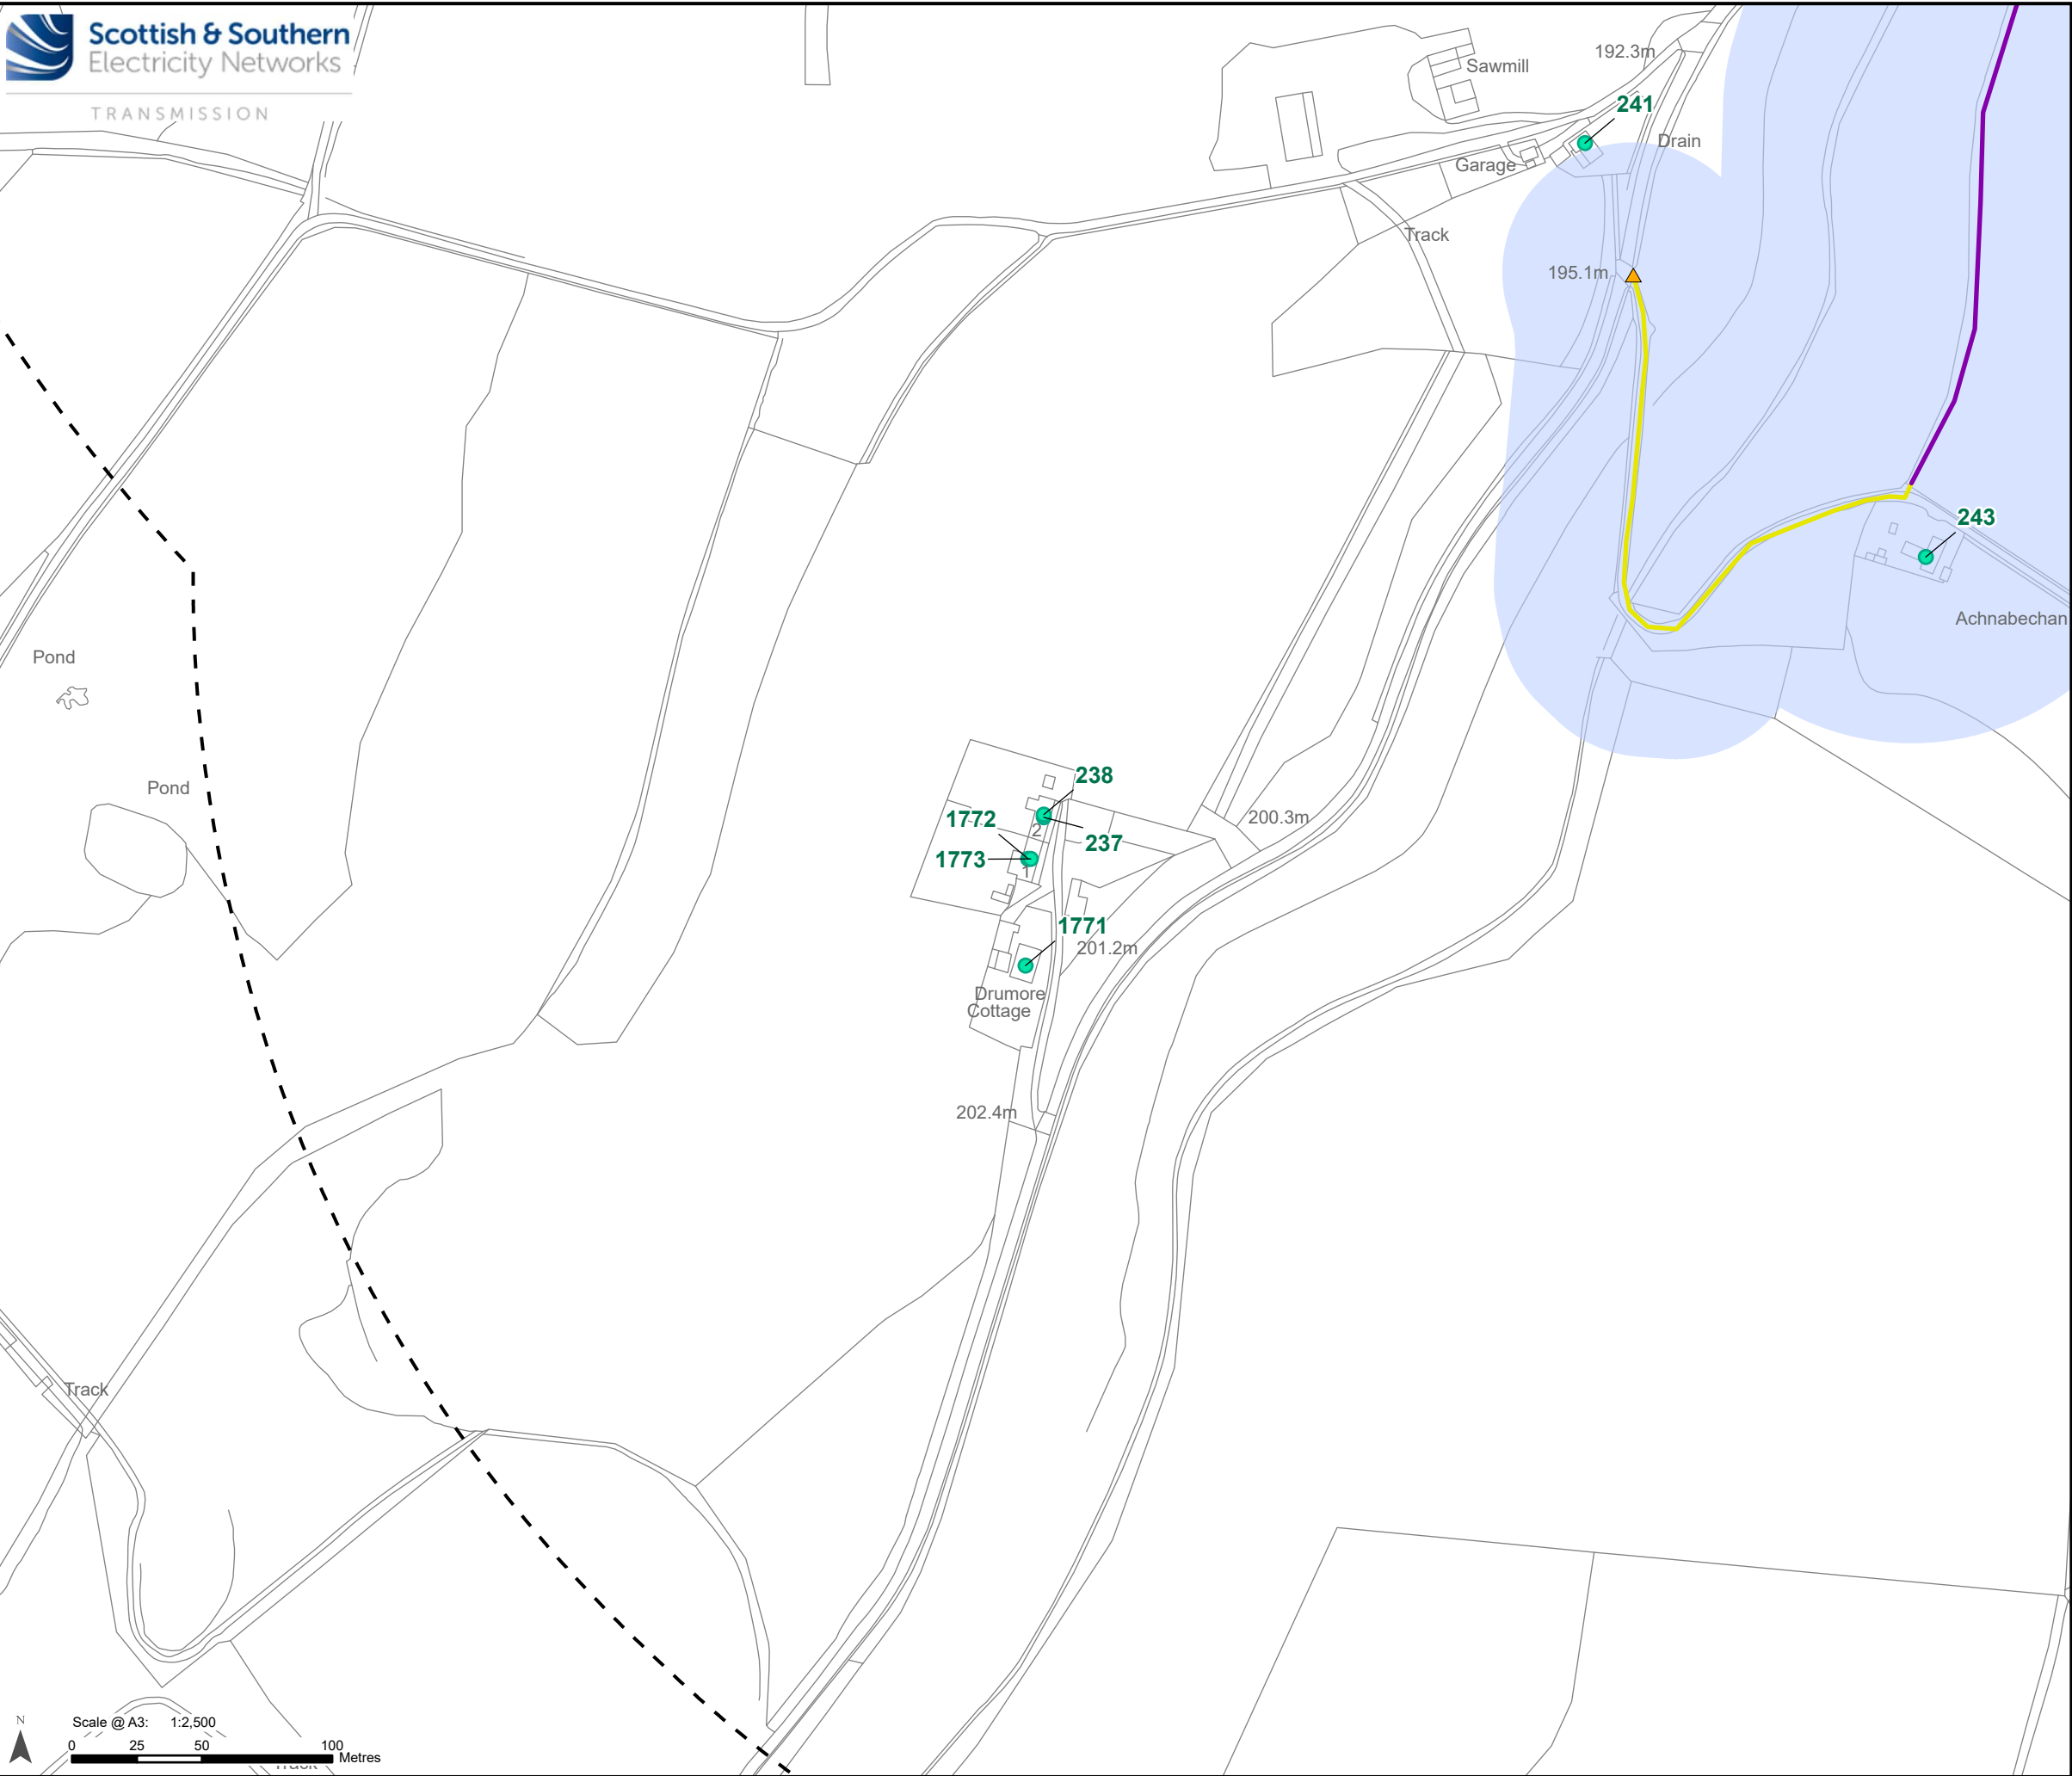

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Ancillary Development


Proposed Bellmouth - Upgrade

Existing Access - Upgrade - Good / Fair Condition

Proposed Access - Temporary

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

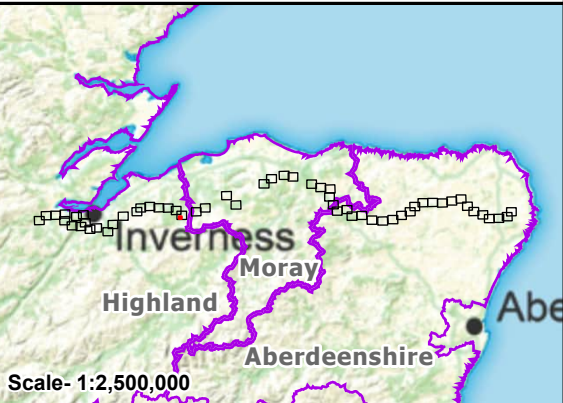


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 77 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

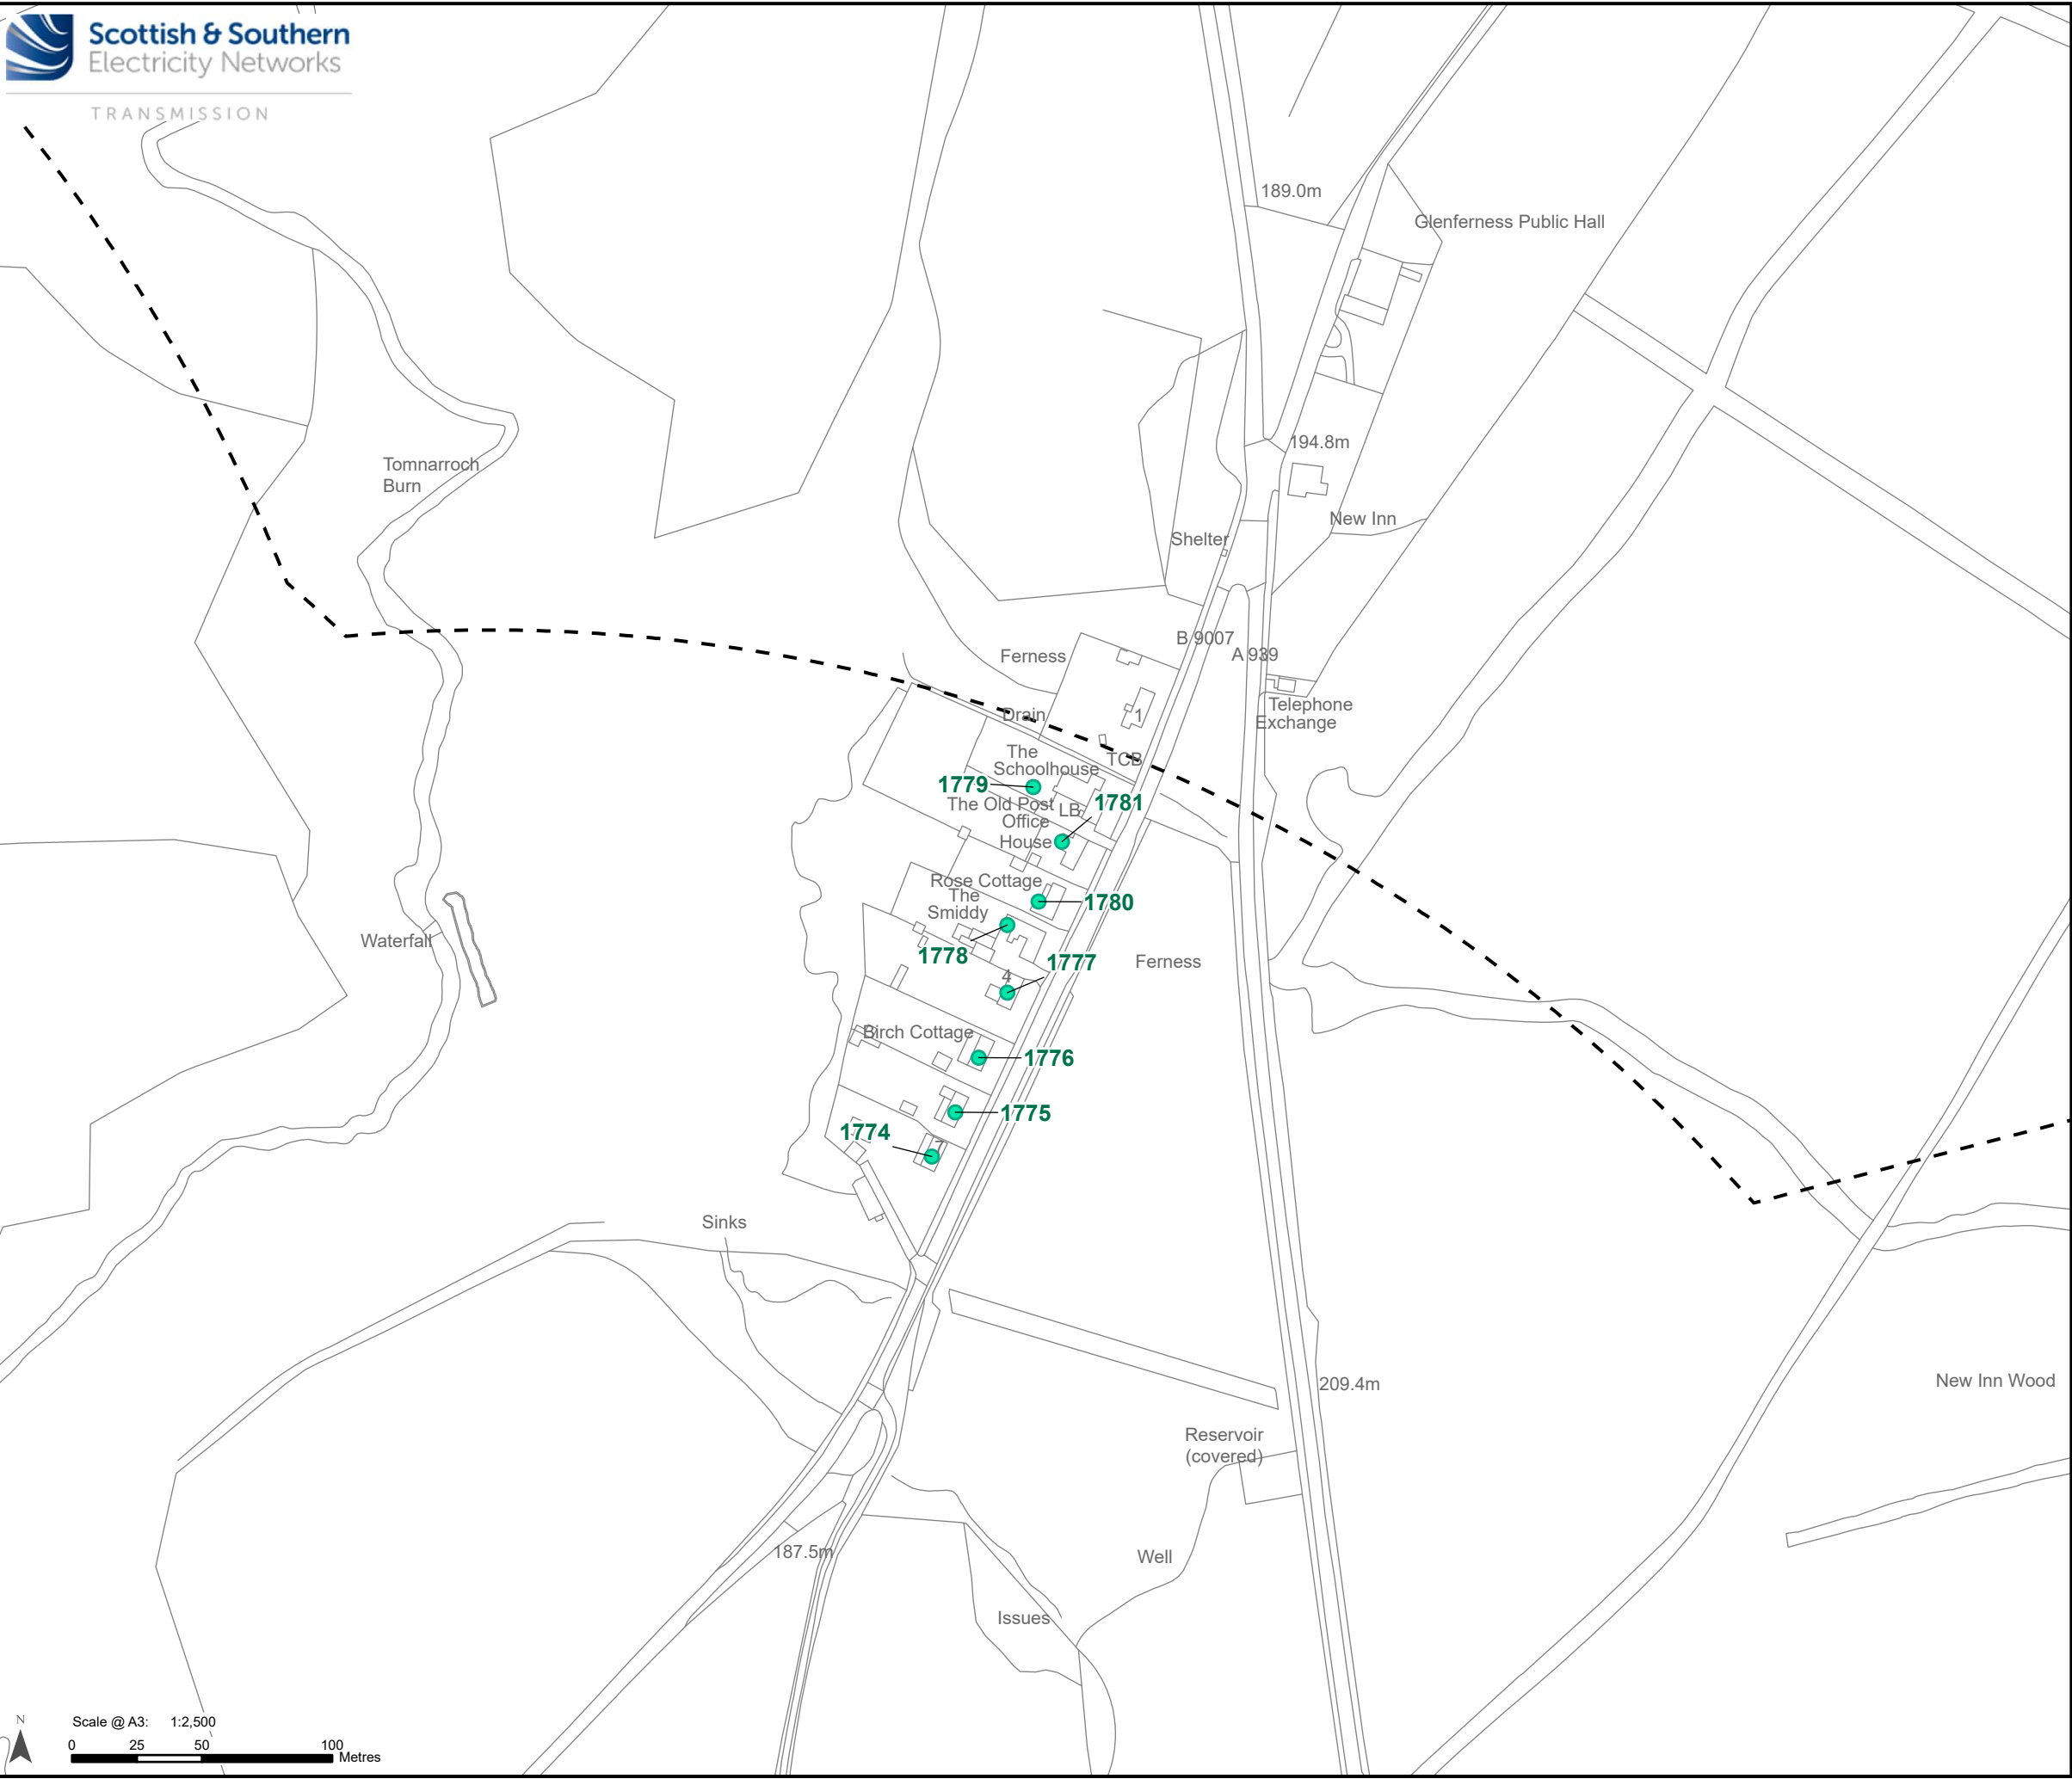


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

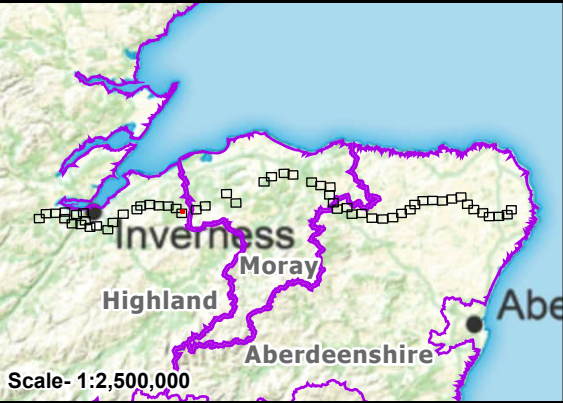

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 78 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

TRANSMISSION
132.6m

55

55

55

55

54

54

54



Scale @ A3: 1:2,500

0 25 50 100 Metres

23

23

23


24

24

24

24

24

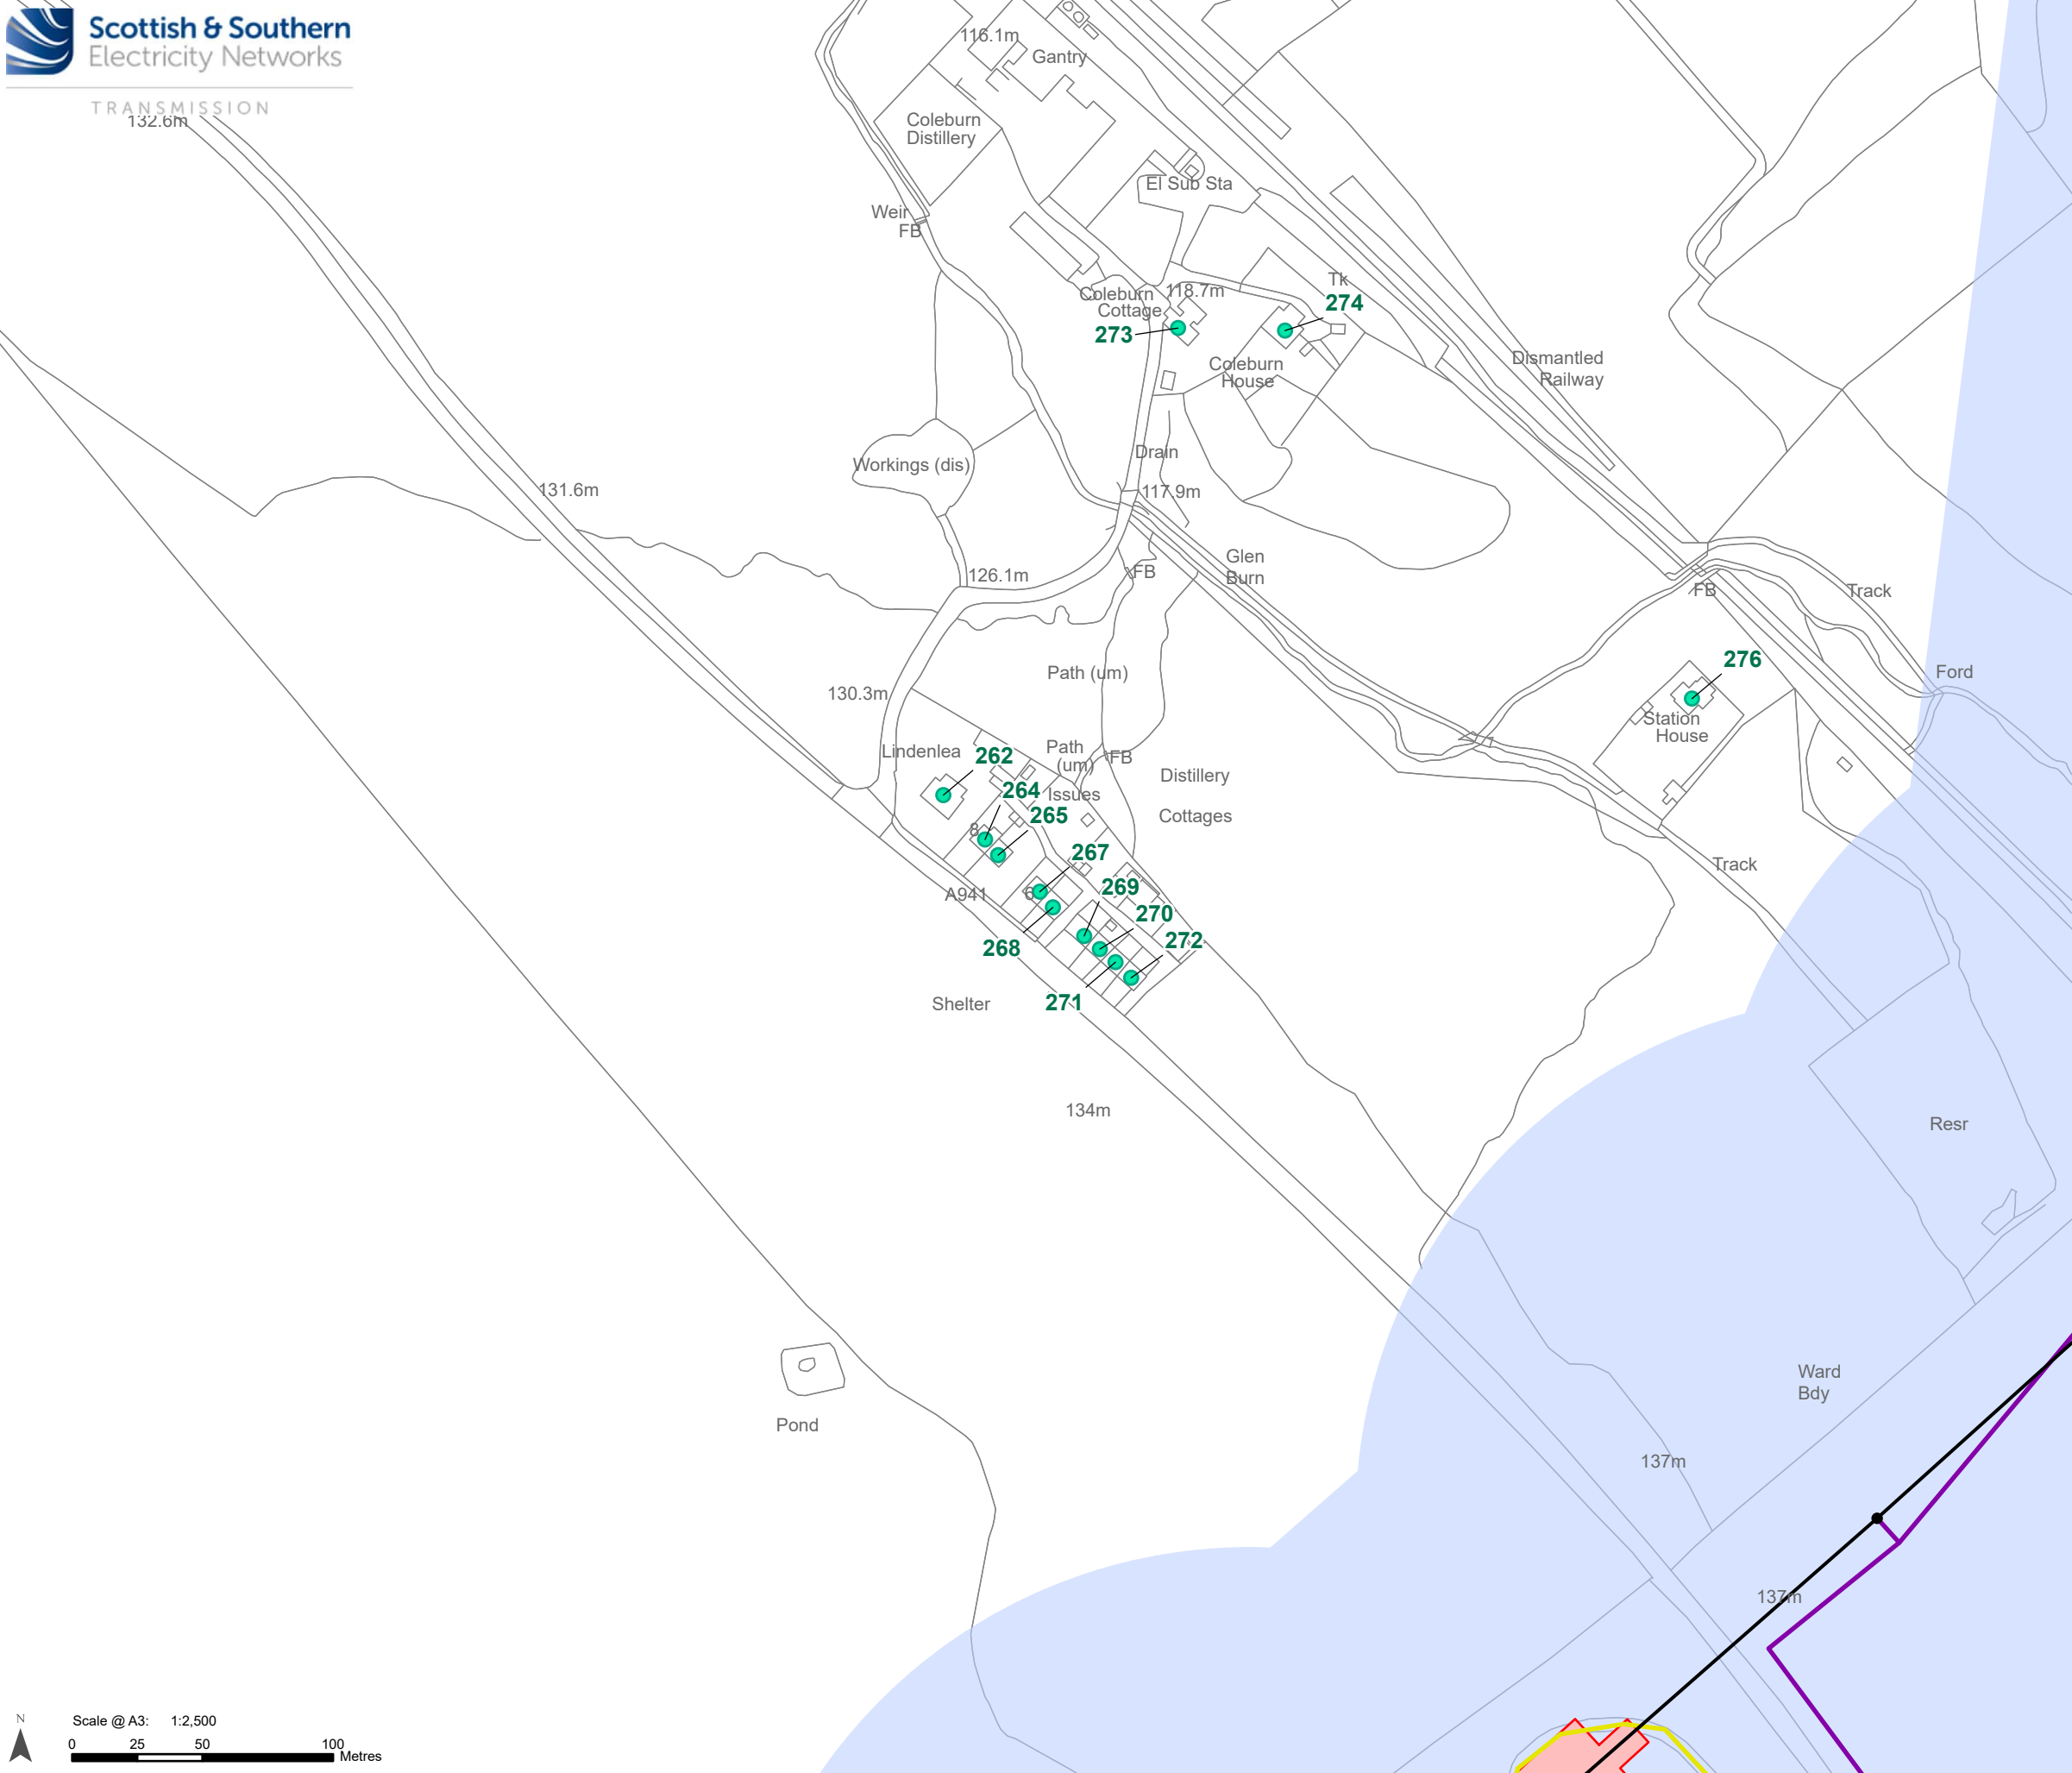

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Label

Proposed Tower - 400 kV

Ancillary Development


Existing Access – Upgrade – Good / Fair Condition

Proposed Access – Temporary

Proposed Conductor Pulling Area (EPZ)

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

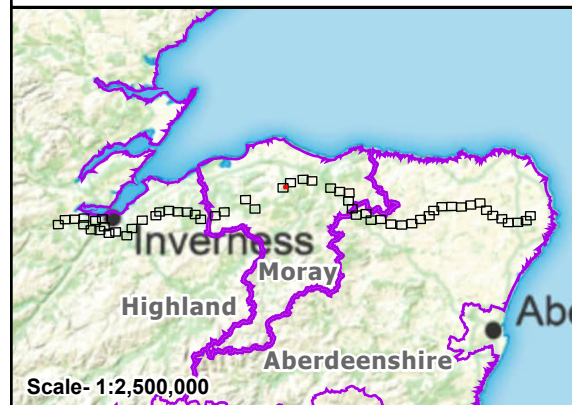


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 79 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

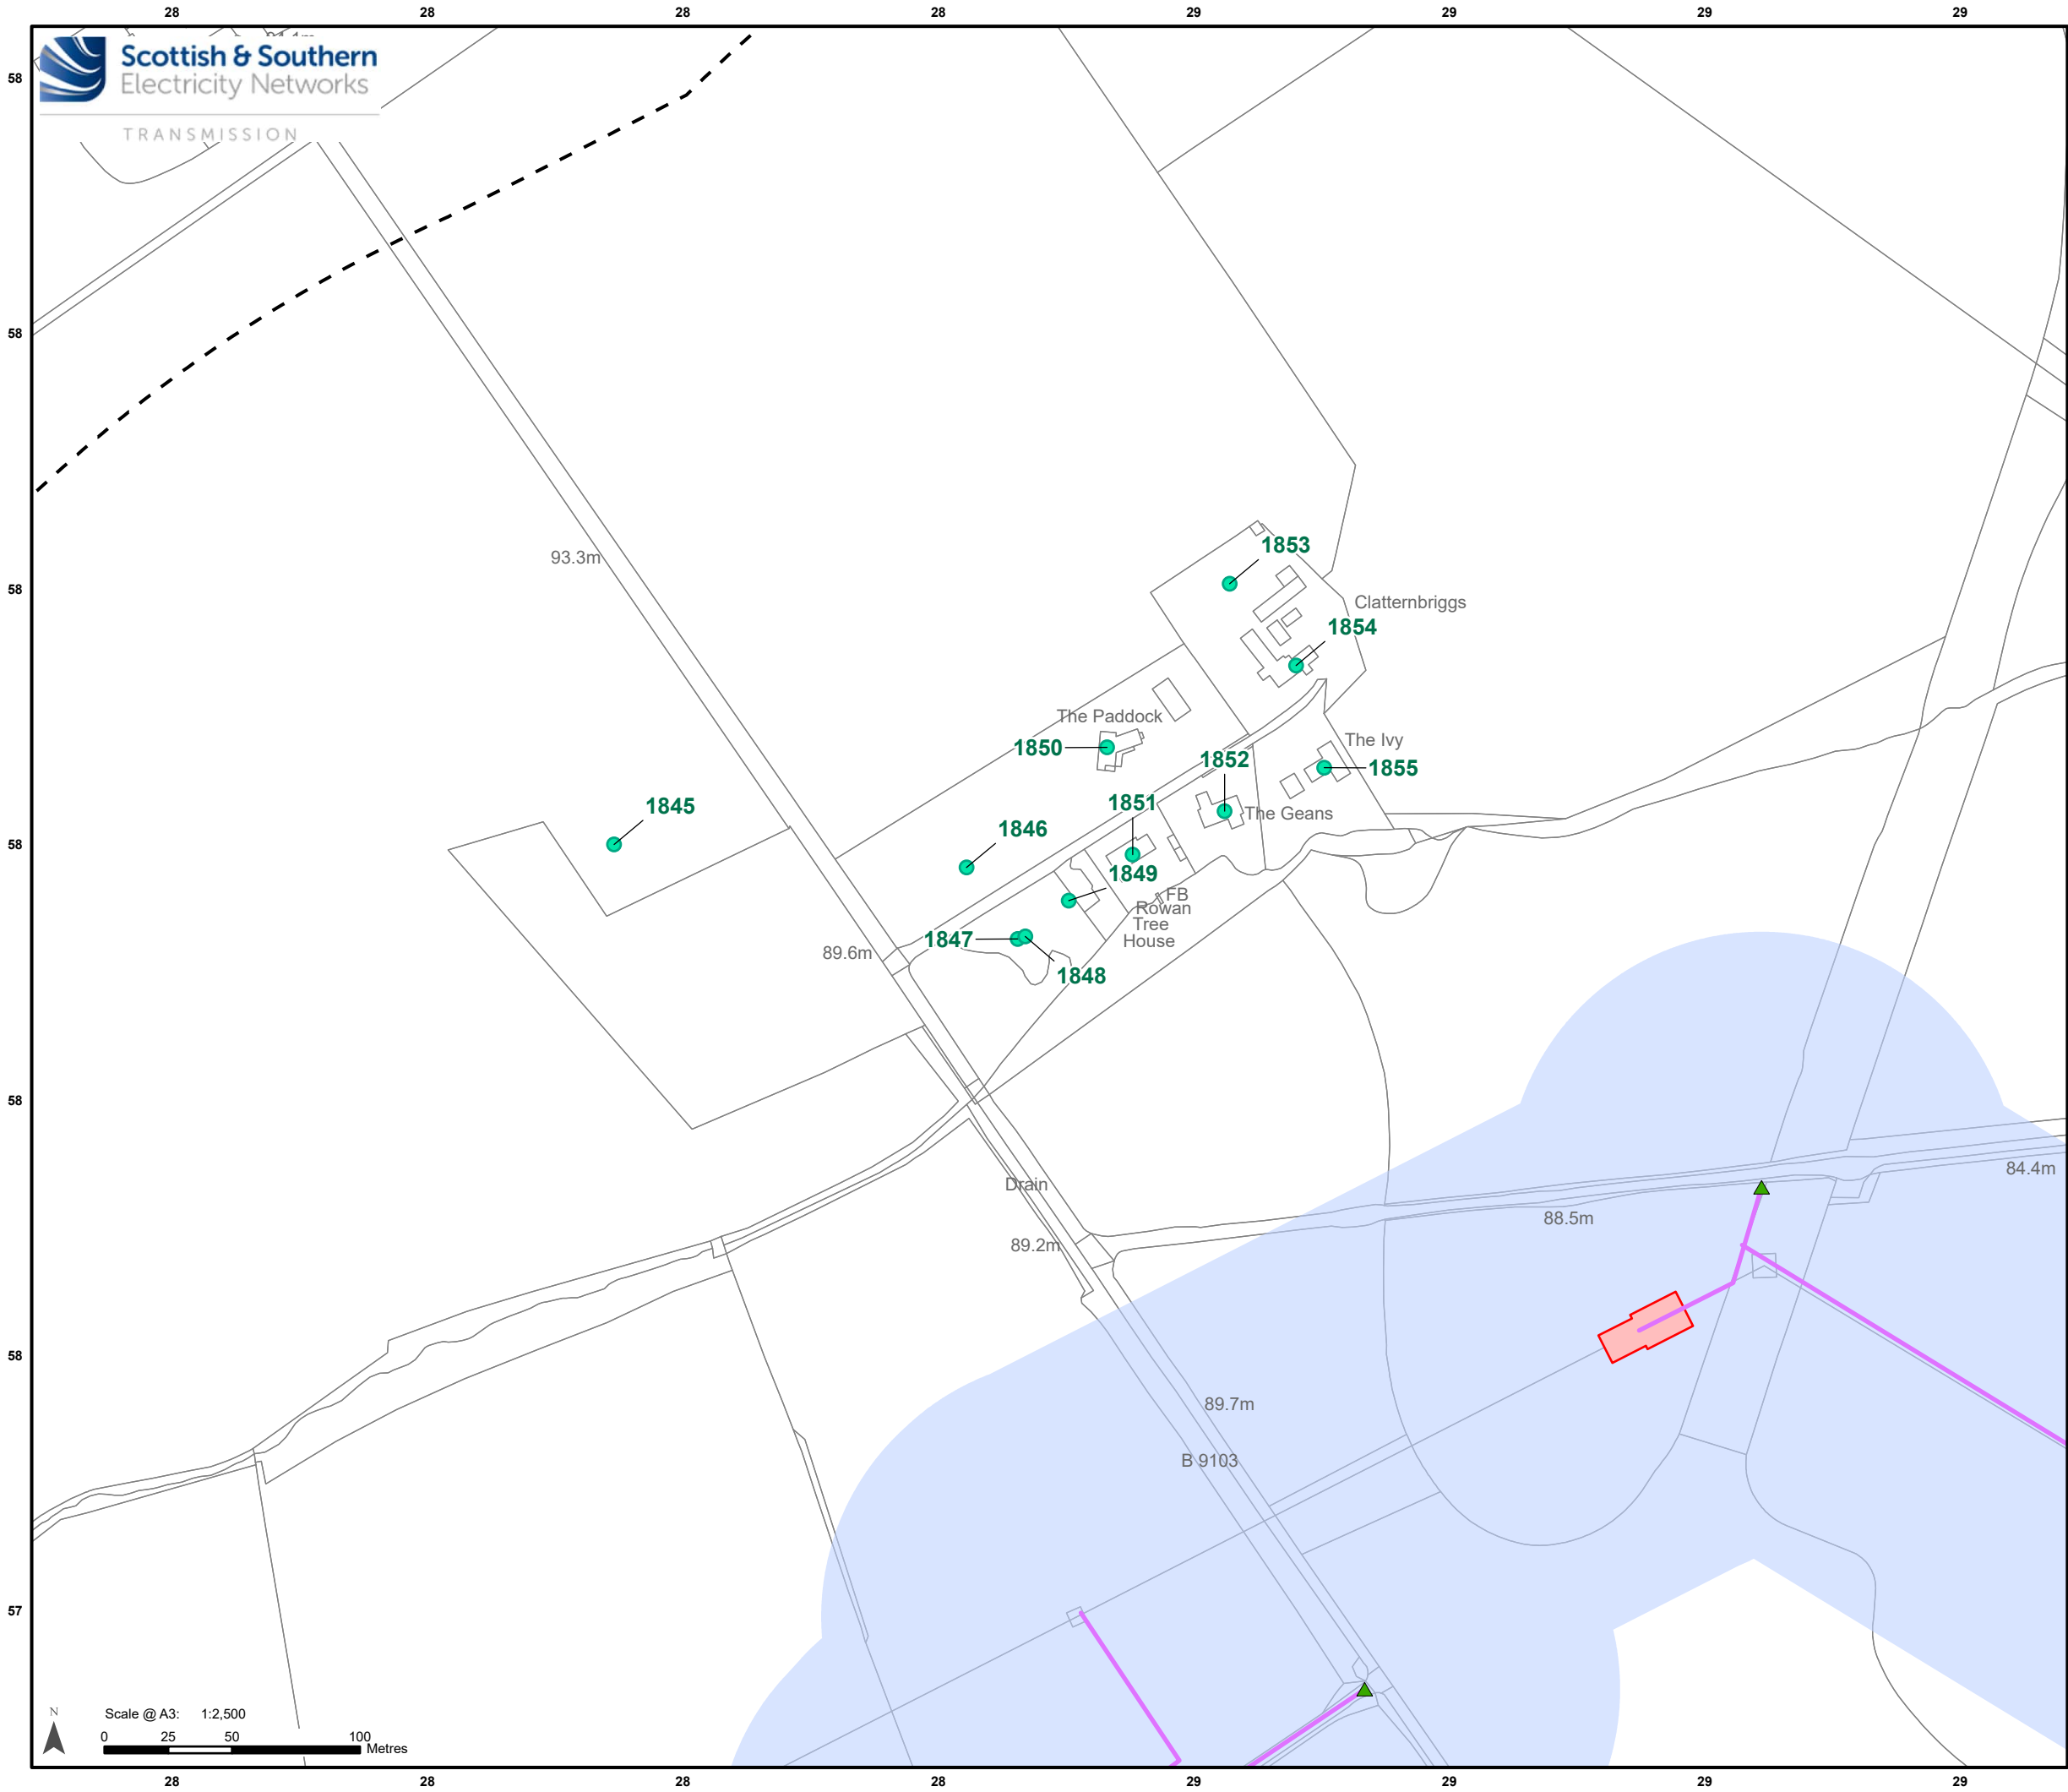

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Ancillary Development


Proposed Bellmouth - Access Only / ATV

Proposed Access - ATV or Temporary Trackway

Proposed Conductor Pulling Area (EPZ)

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

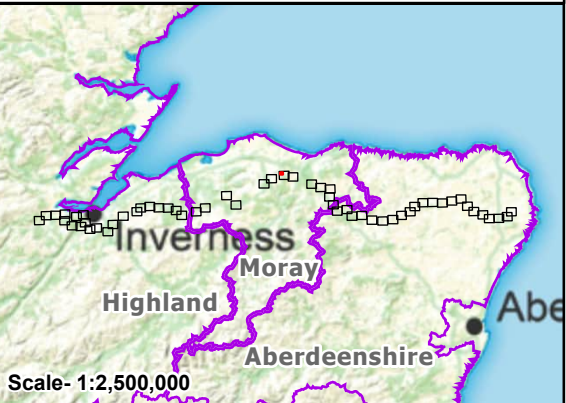


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 80 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

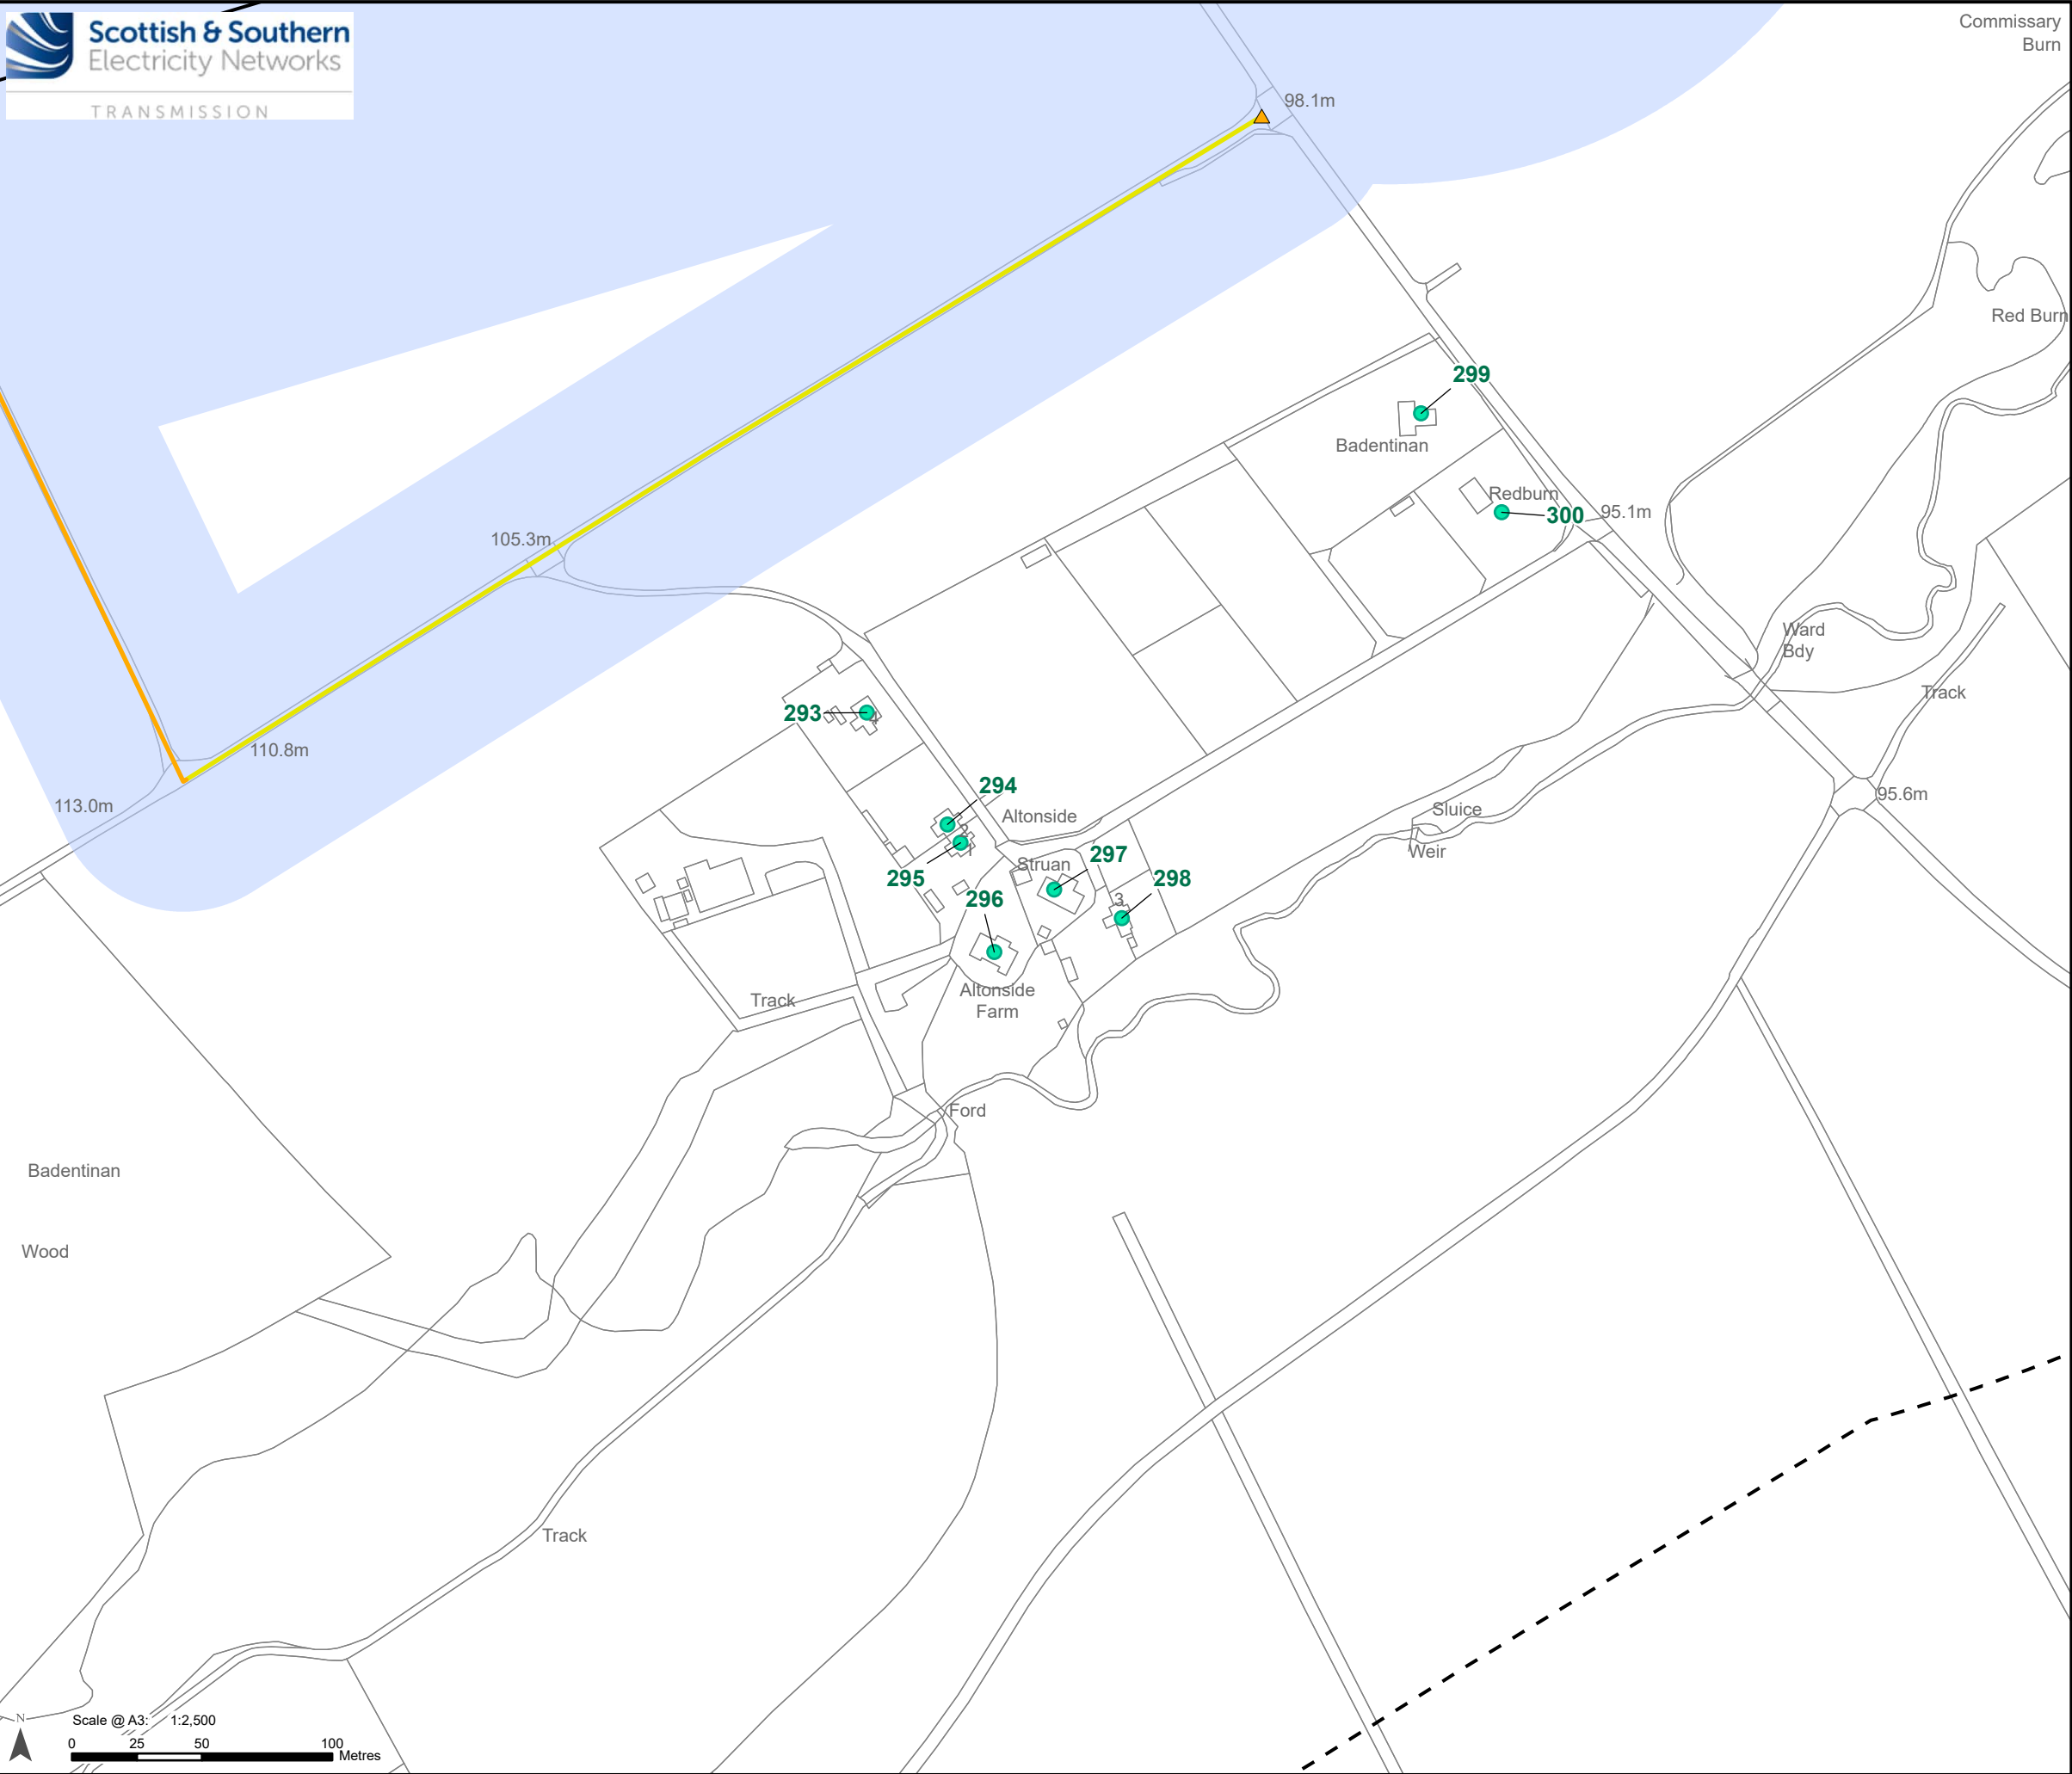

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Ancillary Development


Proposed Bellmouth - Upgrade

Existing Access – Upgrade – Good / Fair Condition

Existing Access – Upgrade – Poor Condition

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

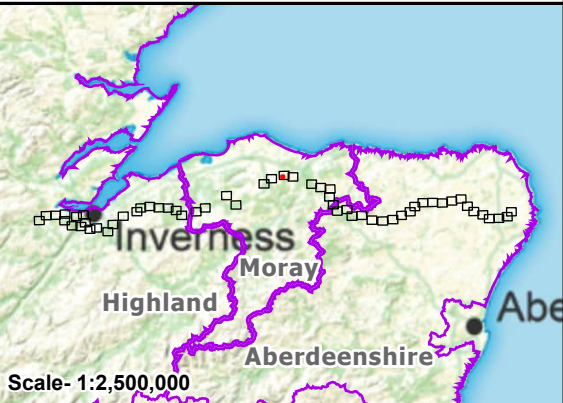

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
**SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 81 of 90

Drawn by: MAL Date: 19/09/2025


Drawing: B2P-WSP-DA-70092380-190

Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

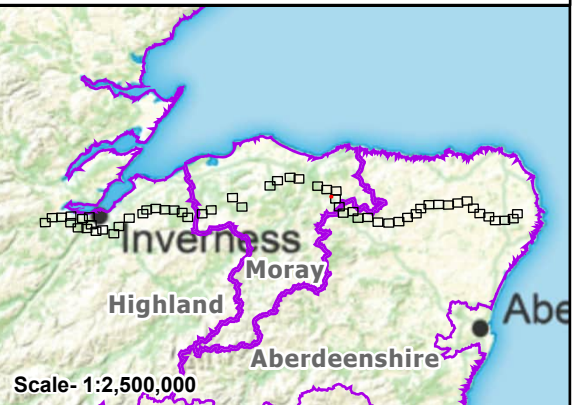


Scale- 1:2,500,000
Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 82 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

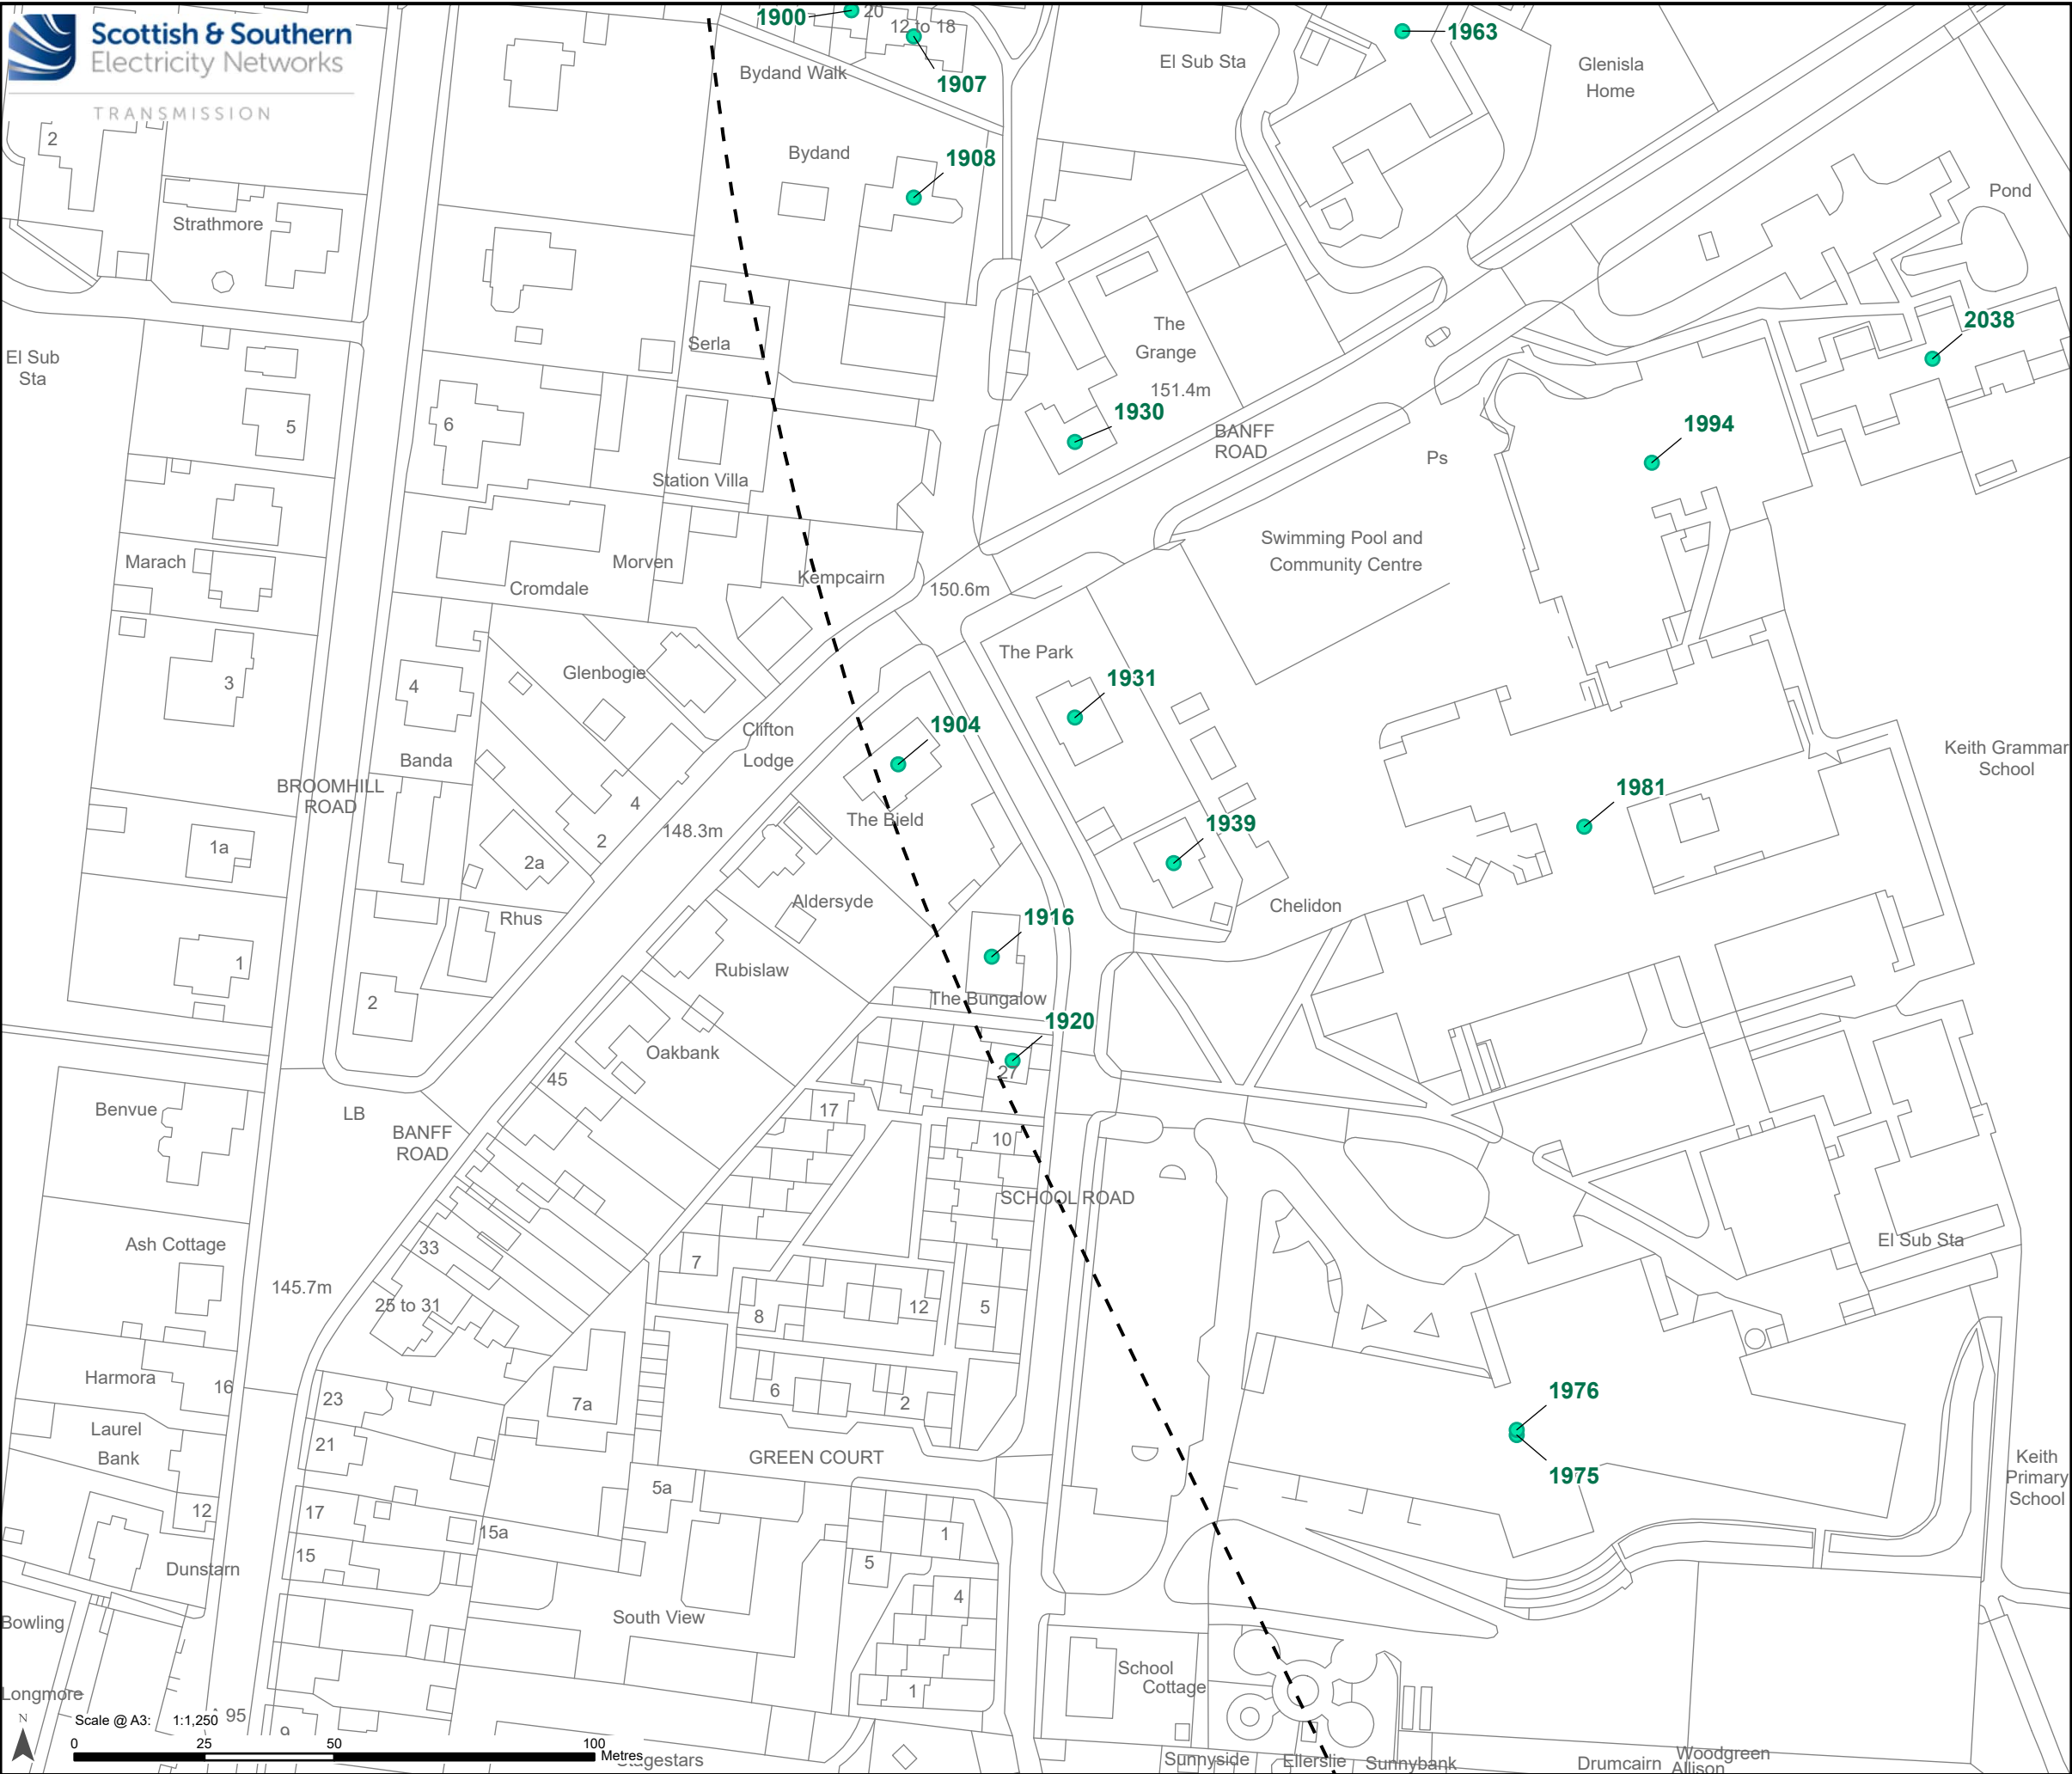


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

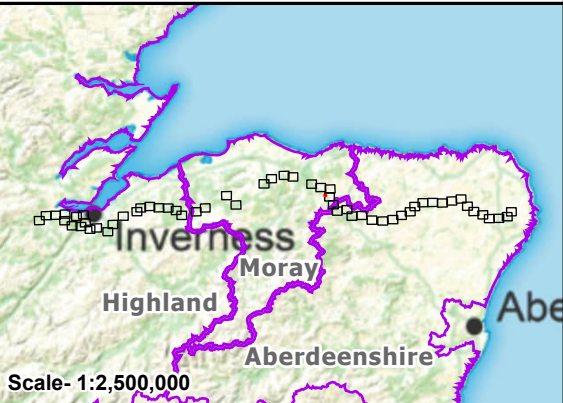


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 83 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

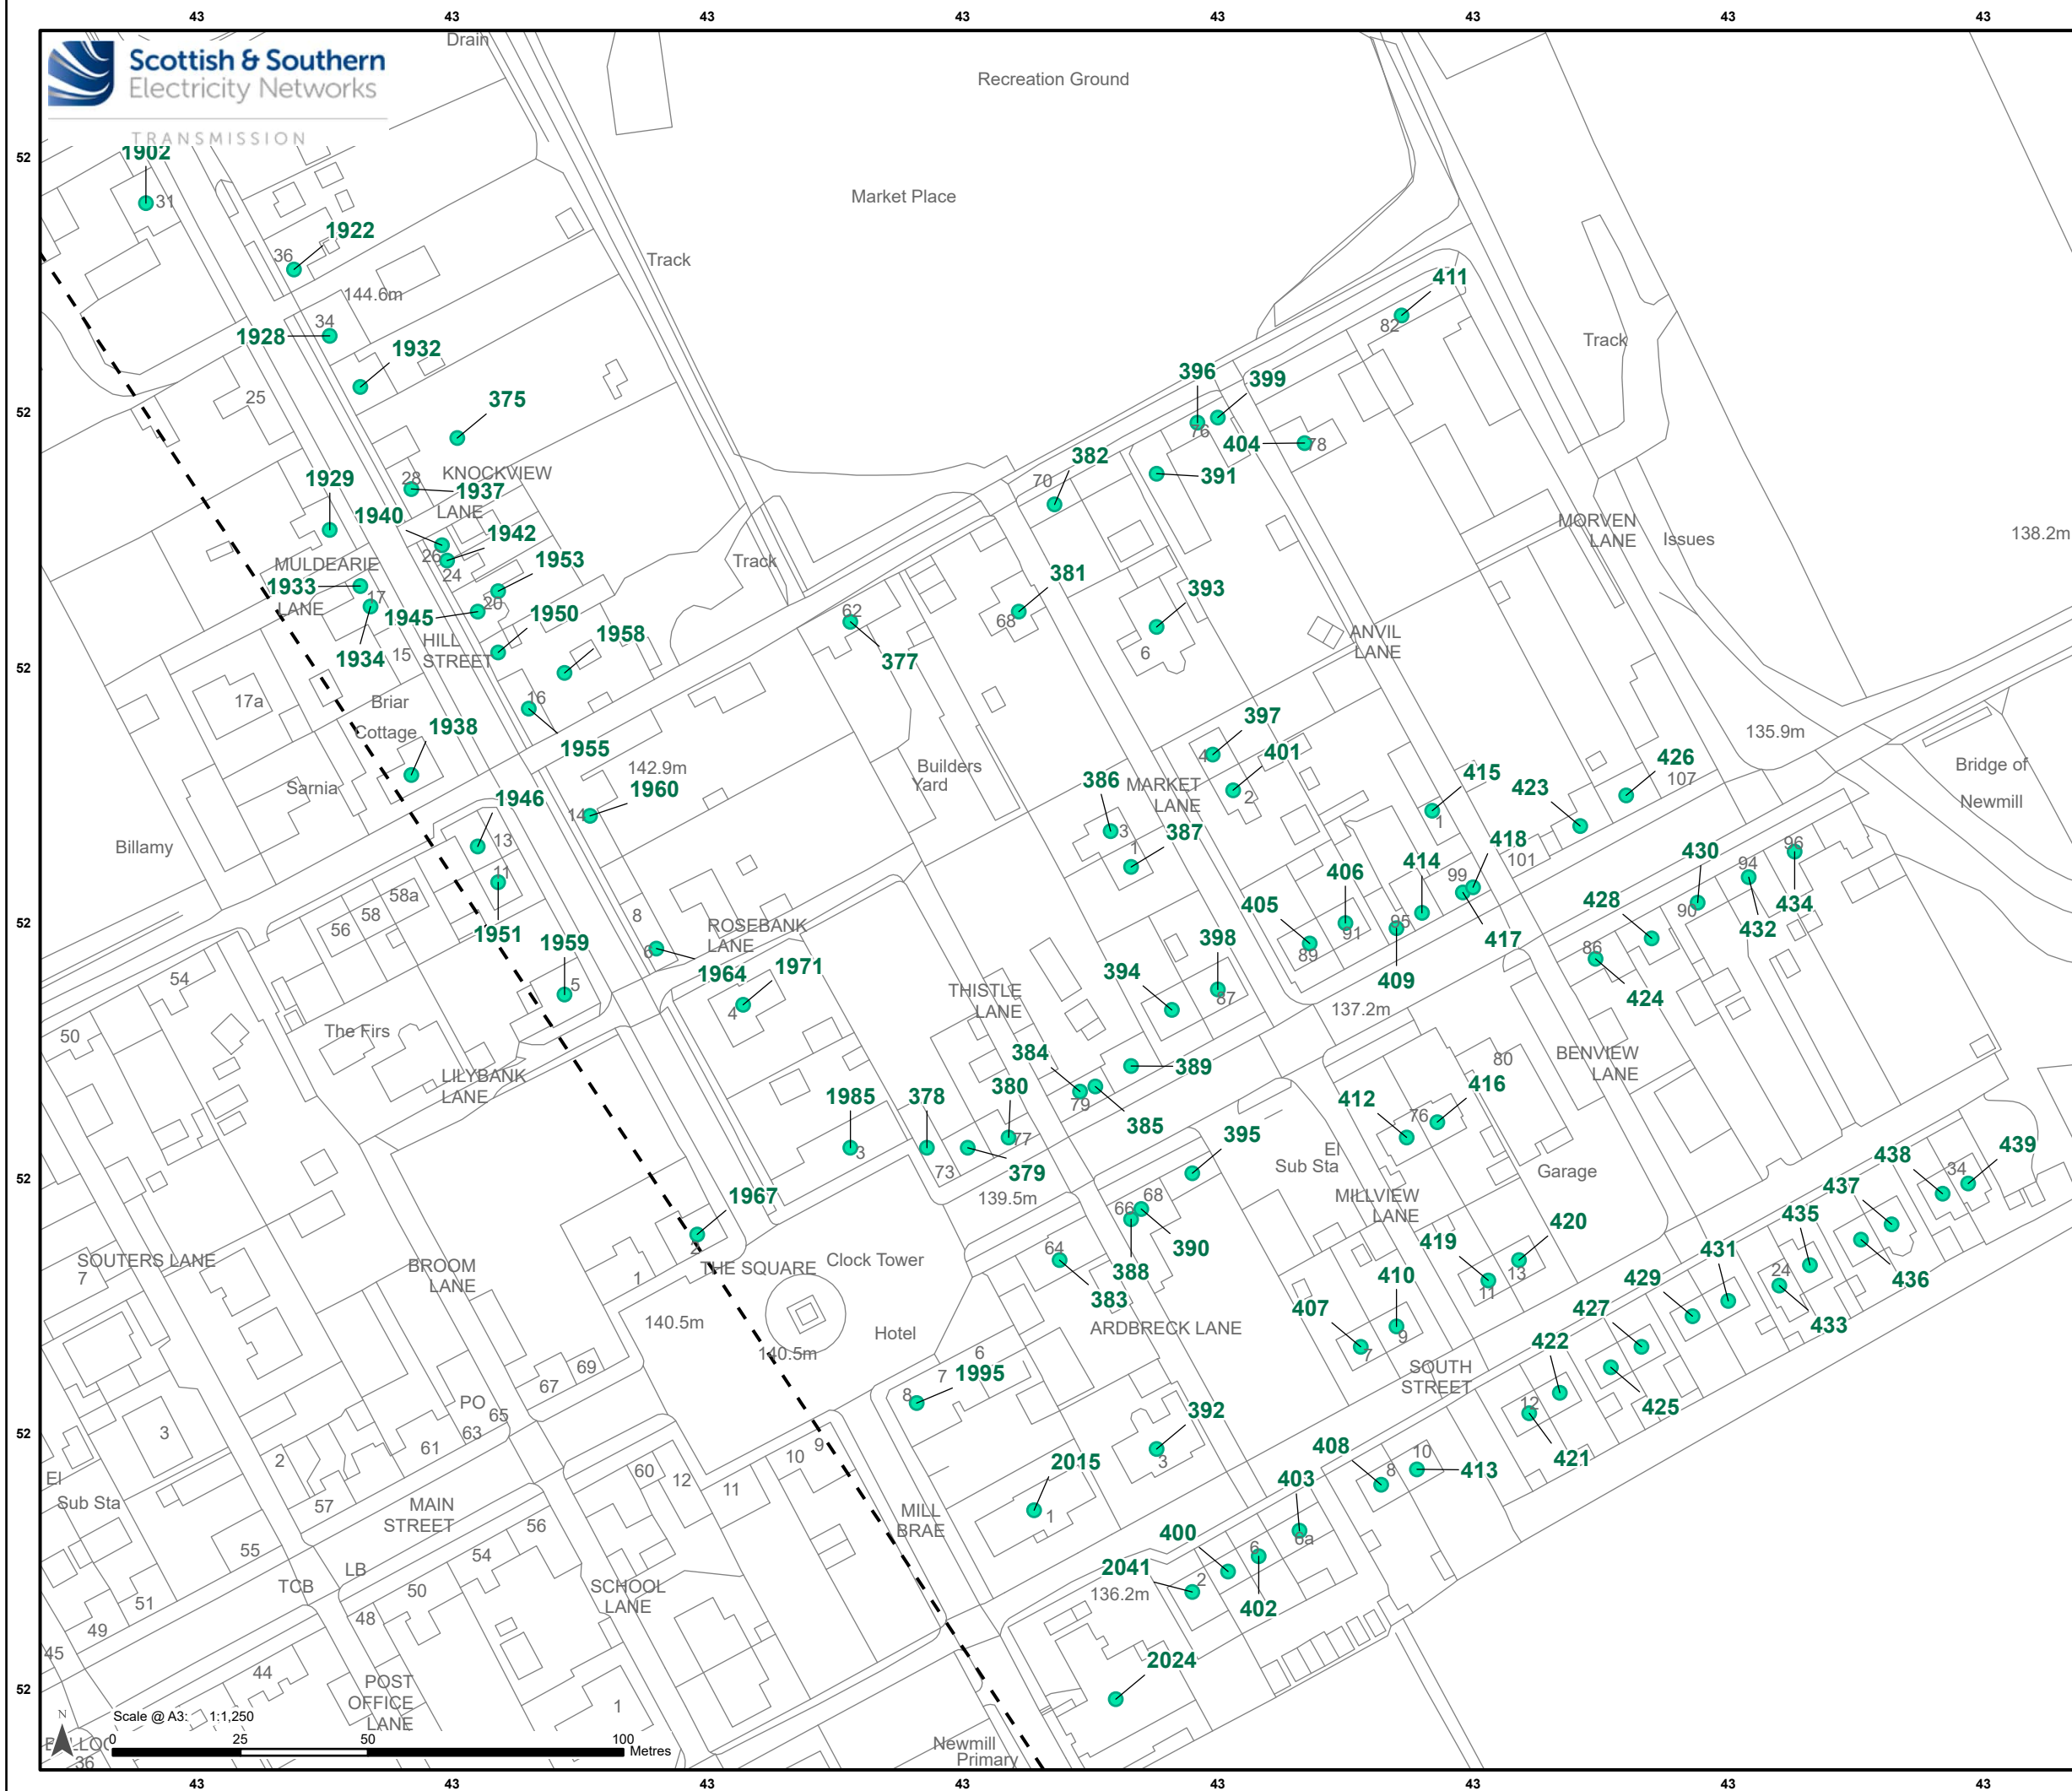


Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

- Noise Sensitive Receptor and ID

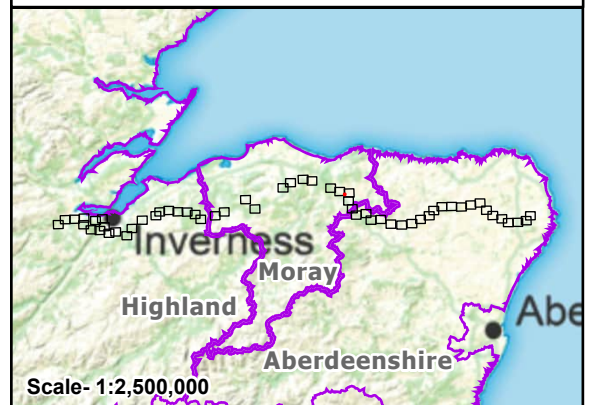

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
**SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project
----------	--

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 84 of 90

Drawn by: MAL	Date: 19/09/2025
---------------	------------------

Drawing: B2P-WSP-DA-70092380-190

TRANSMISSION

Track

Path

Cemetery

Broomhill
Lodge

139.9m

SOUTHVIEW
DRIVE

Balancing
Pond

Drain


146.2m

Legend

500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

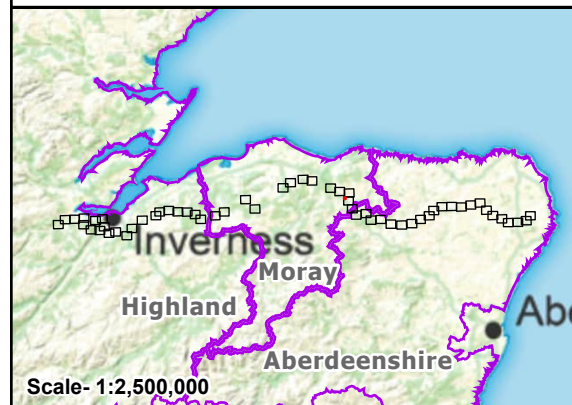

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 85 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

Scale @ A3: 1:1,500
0 25 50 100 Metres

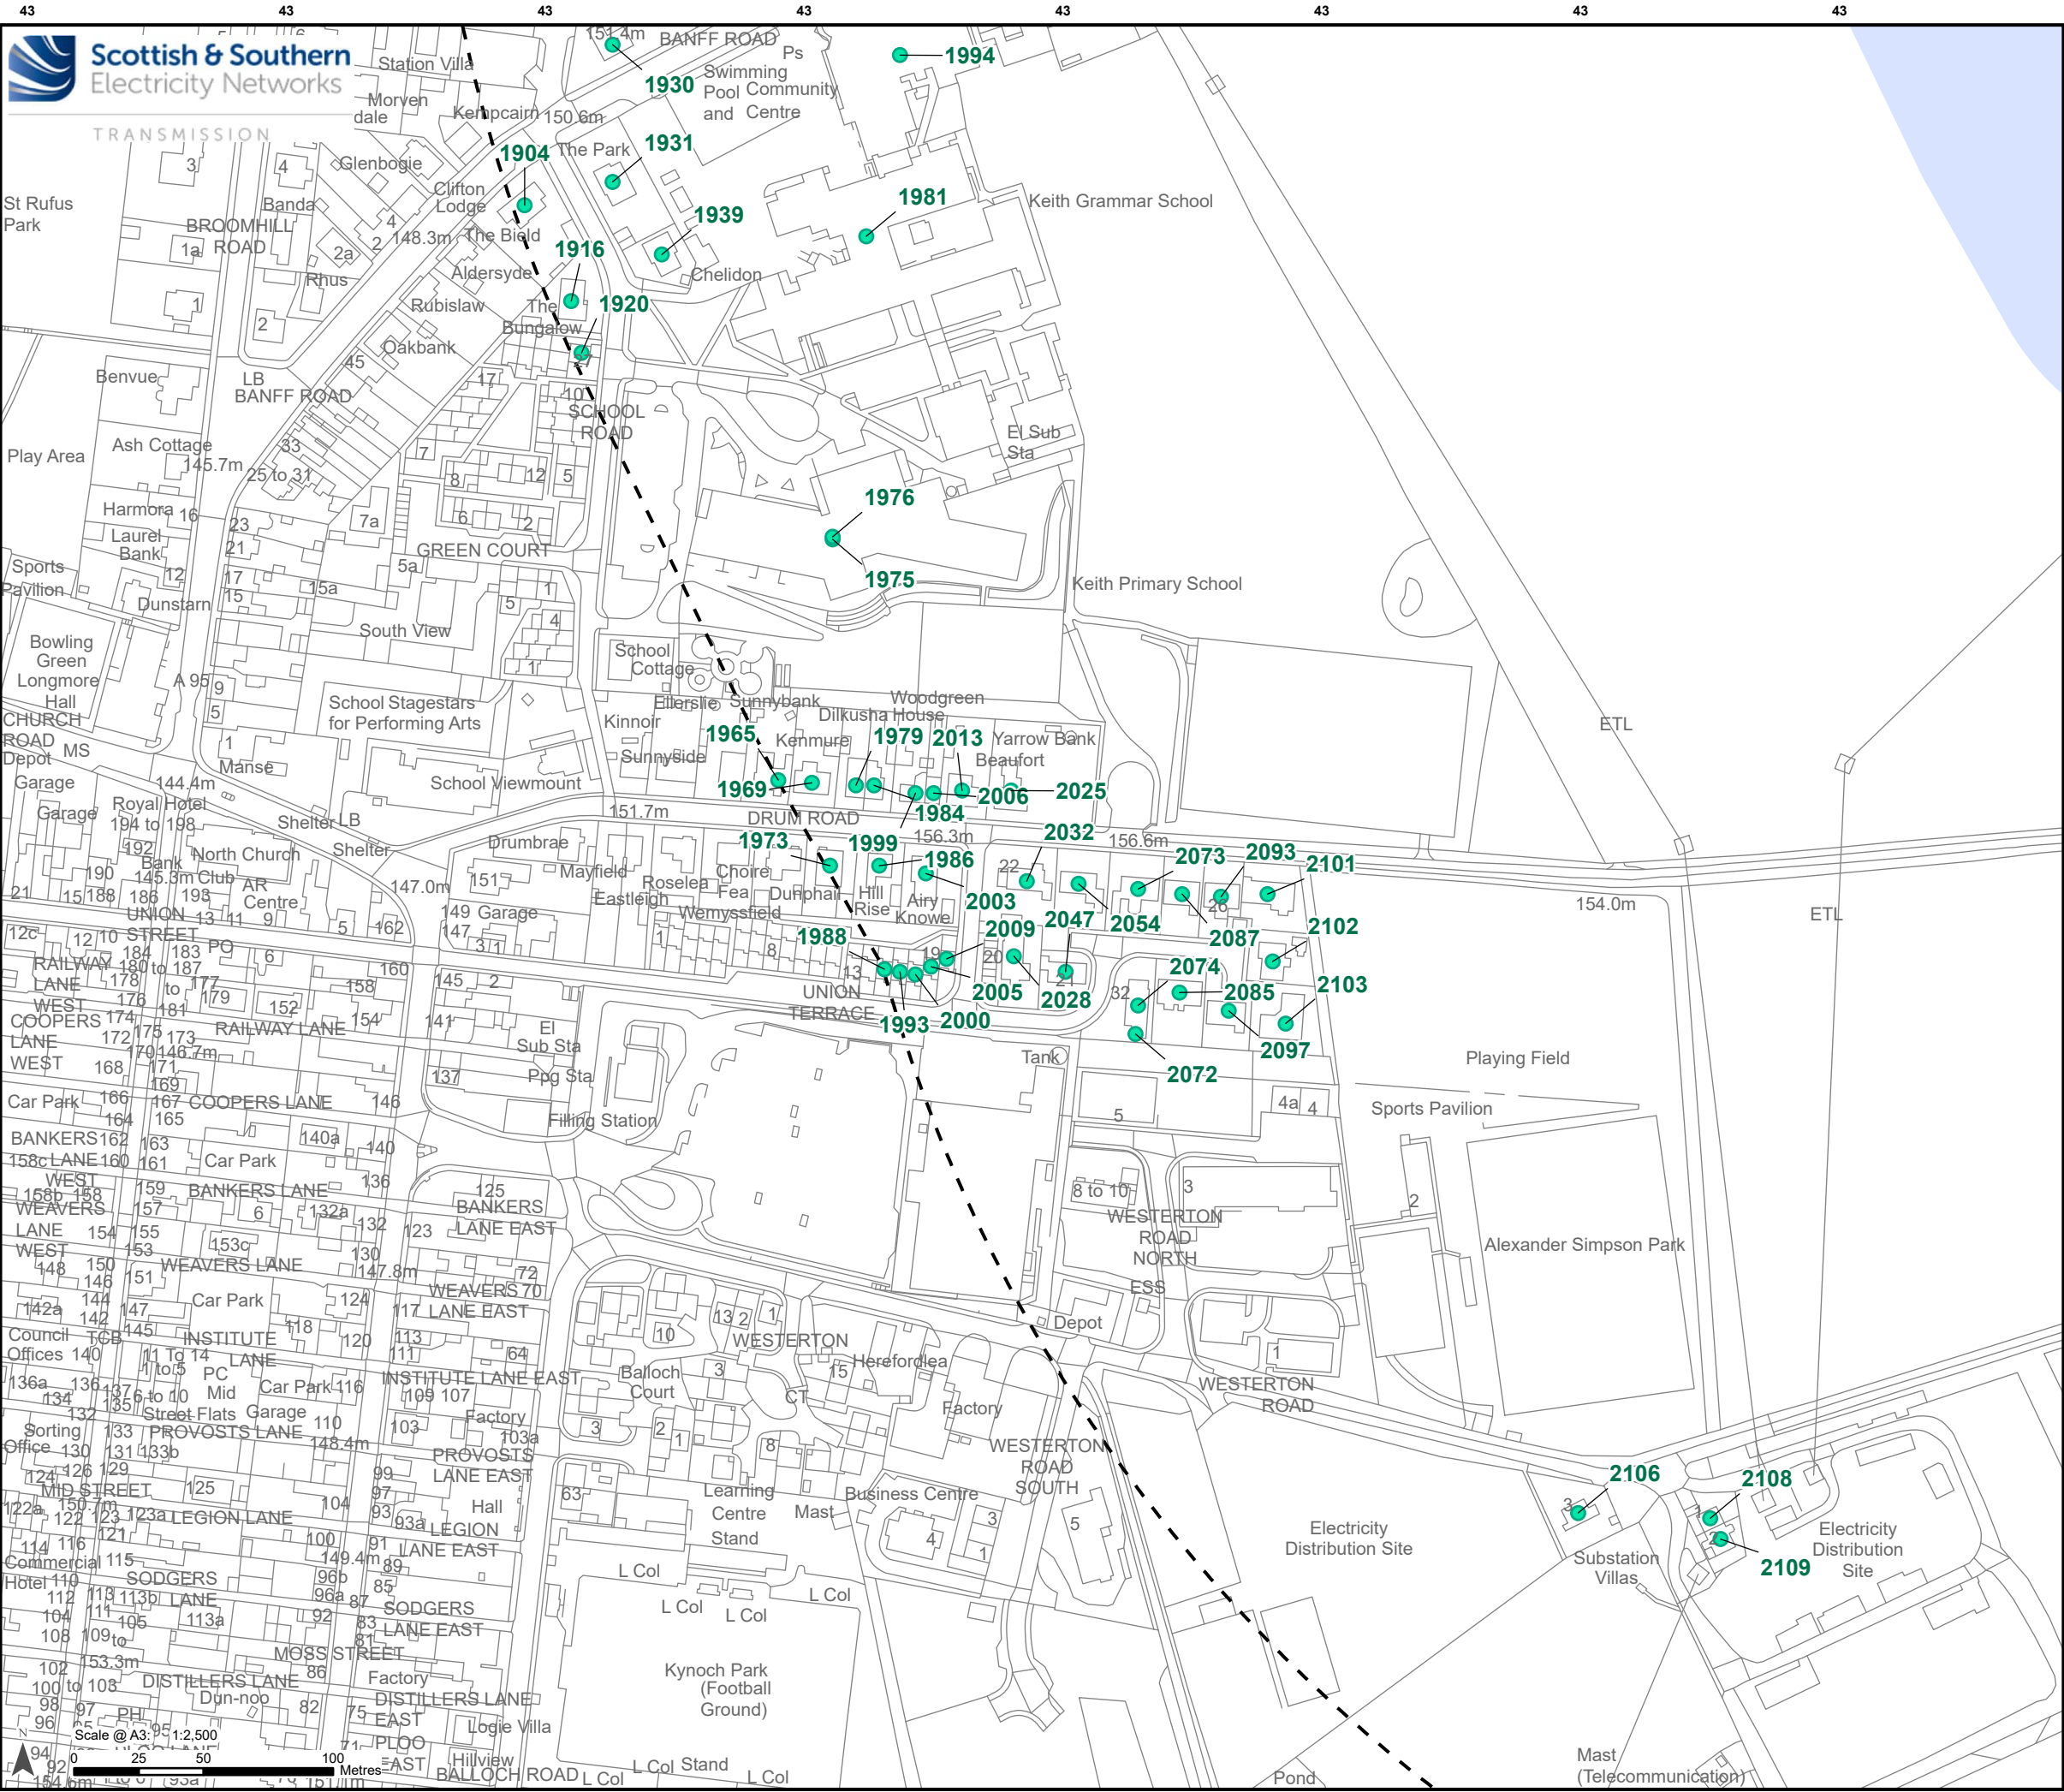


Legend

Limit of Deviation - Proposed Development


500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

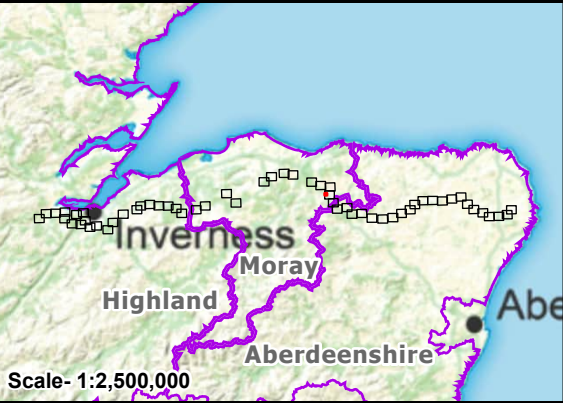

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 15.1 - Noise Sensitive Receptors (NSRs) Page 86 of 90
Drawn by:	MAL
Date:	19/09/2025
Drawing:	B2P-WSP-DA-70092380-190

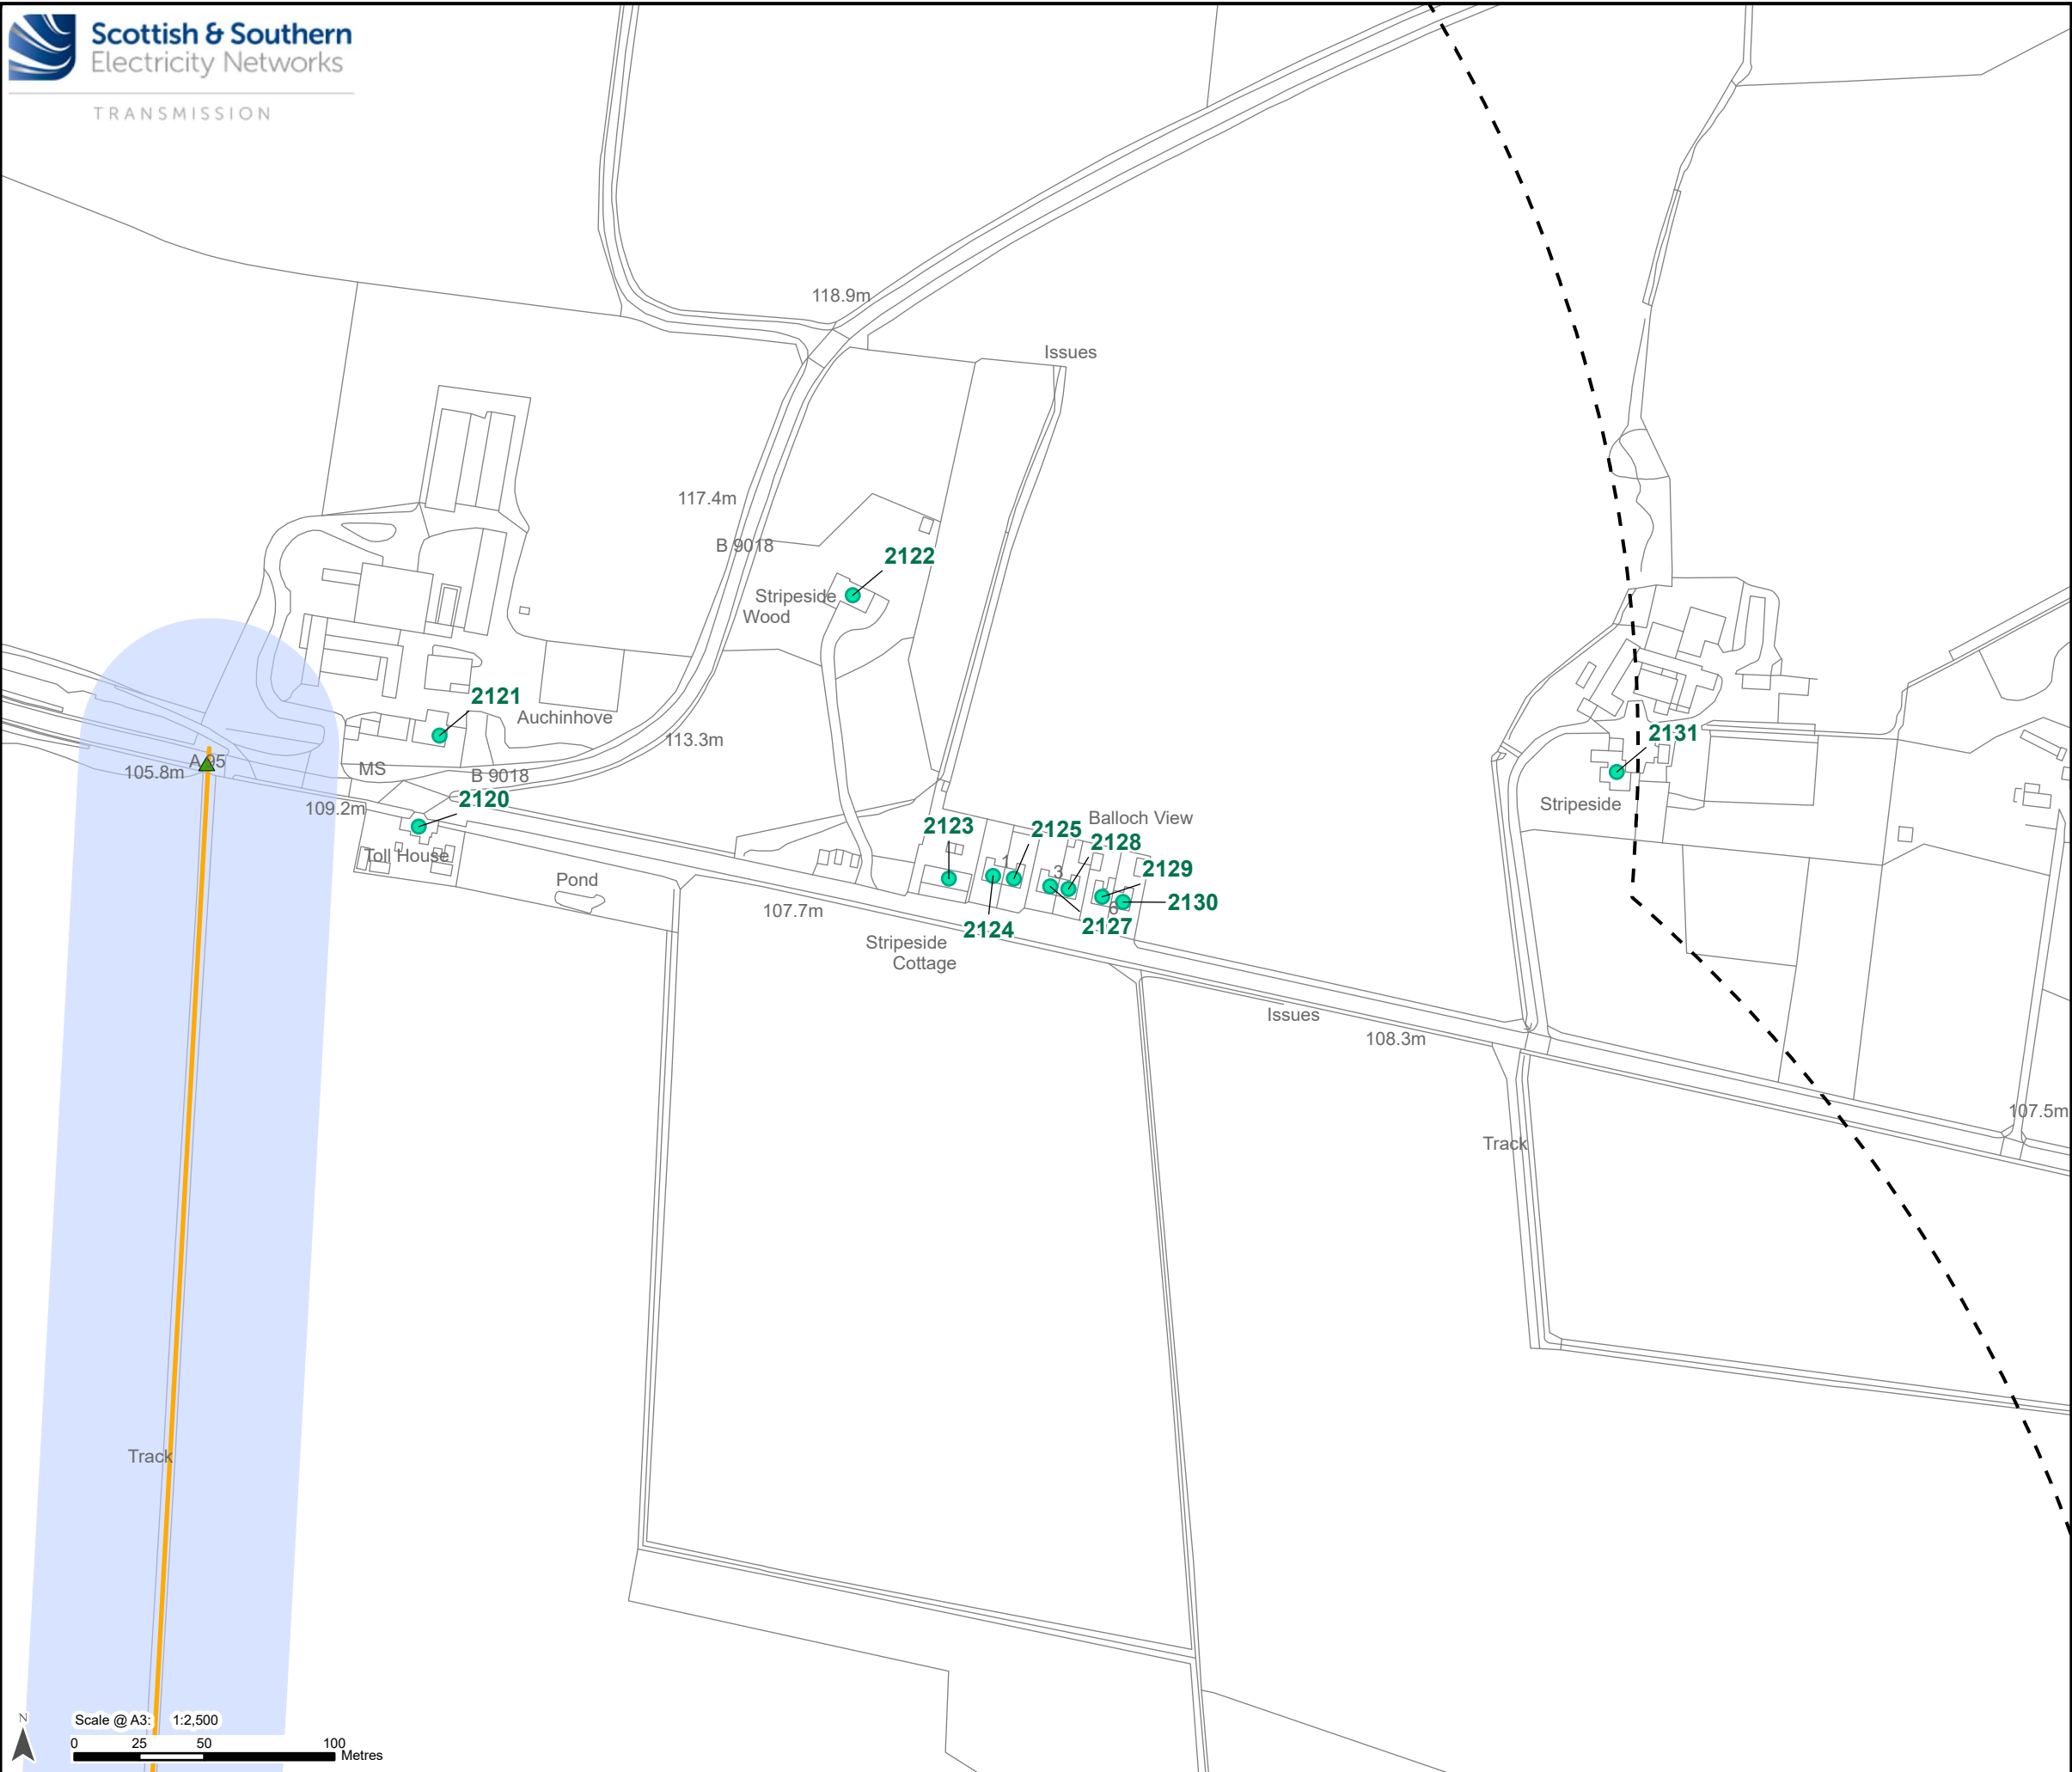

Legend

- Limit of Deviation - Proposed Development
- 500 m Buffer of the Limit of Deviation
- Ancillary Development**
 - Proposed Bellmouth - Access Only / ATV
 - Existing Access – Upgrade – Poor Condition
- Noise Sensitive Receptor**
 - Noise Sensitive Receptor and ID




Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 87 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

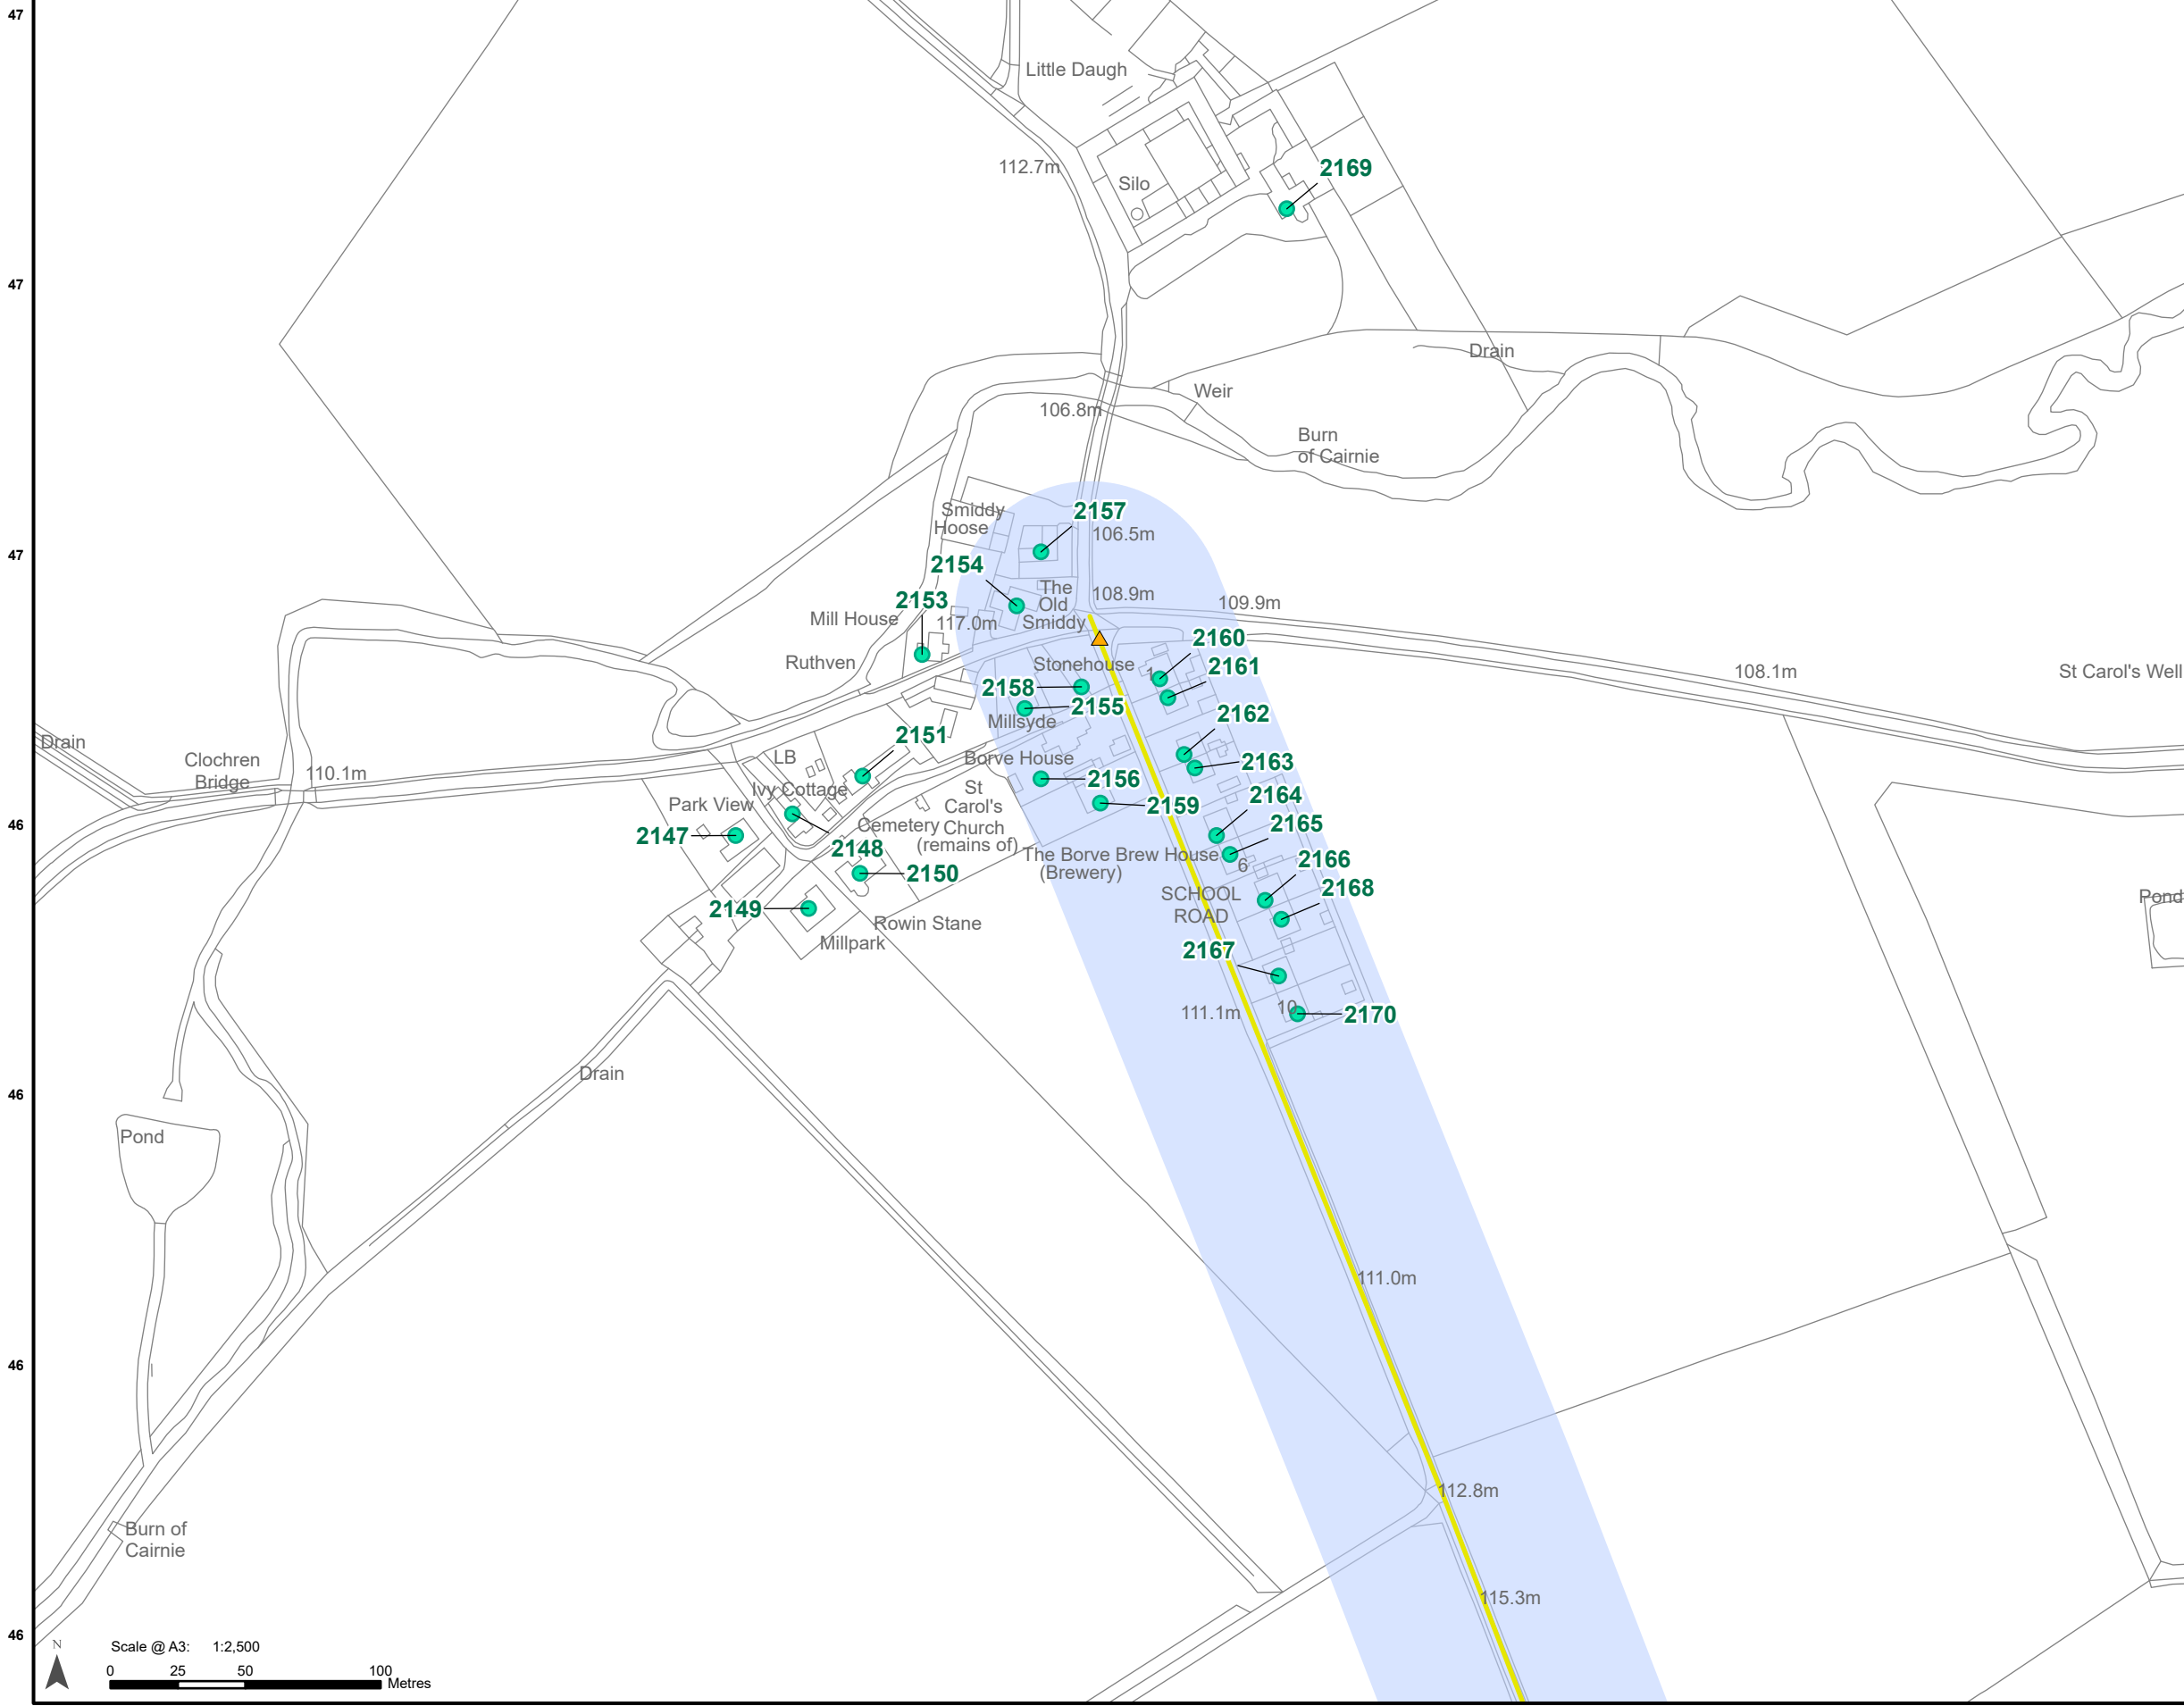

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation


Ancillary Development

Proposed Bellmouth - Upgrade

Existing Access - Upgrade - Good / Fair Condition

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

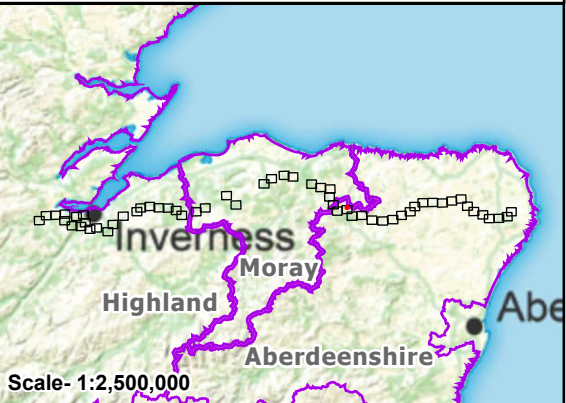


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 88 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190

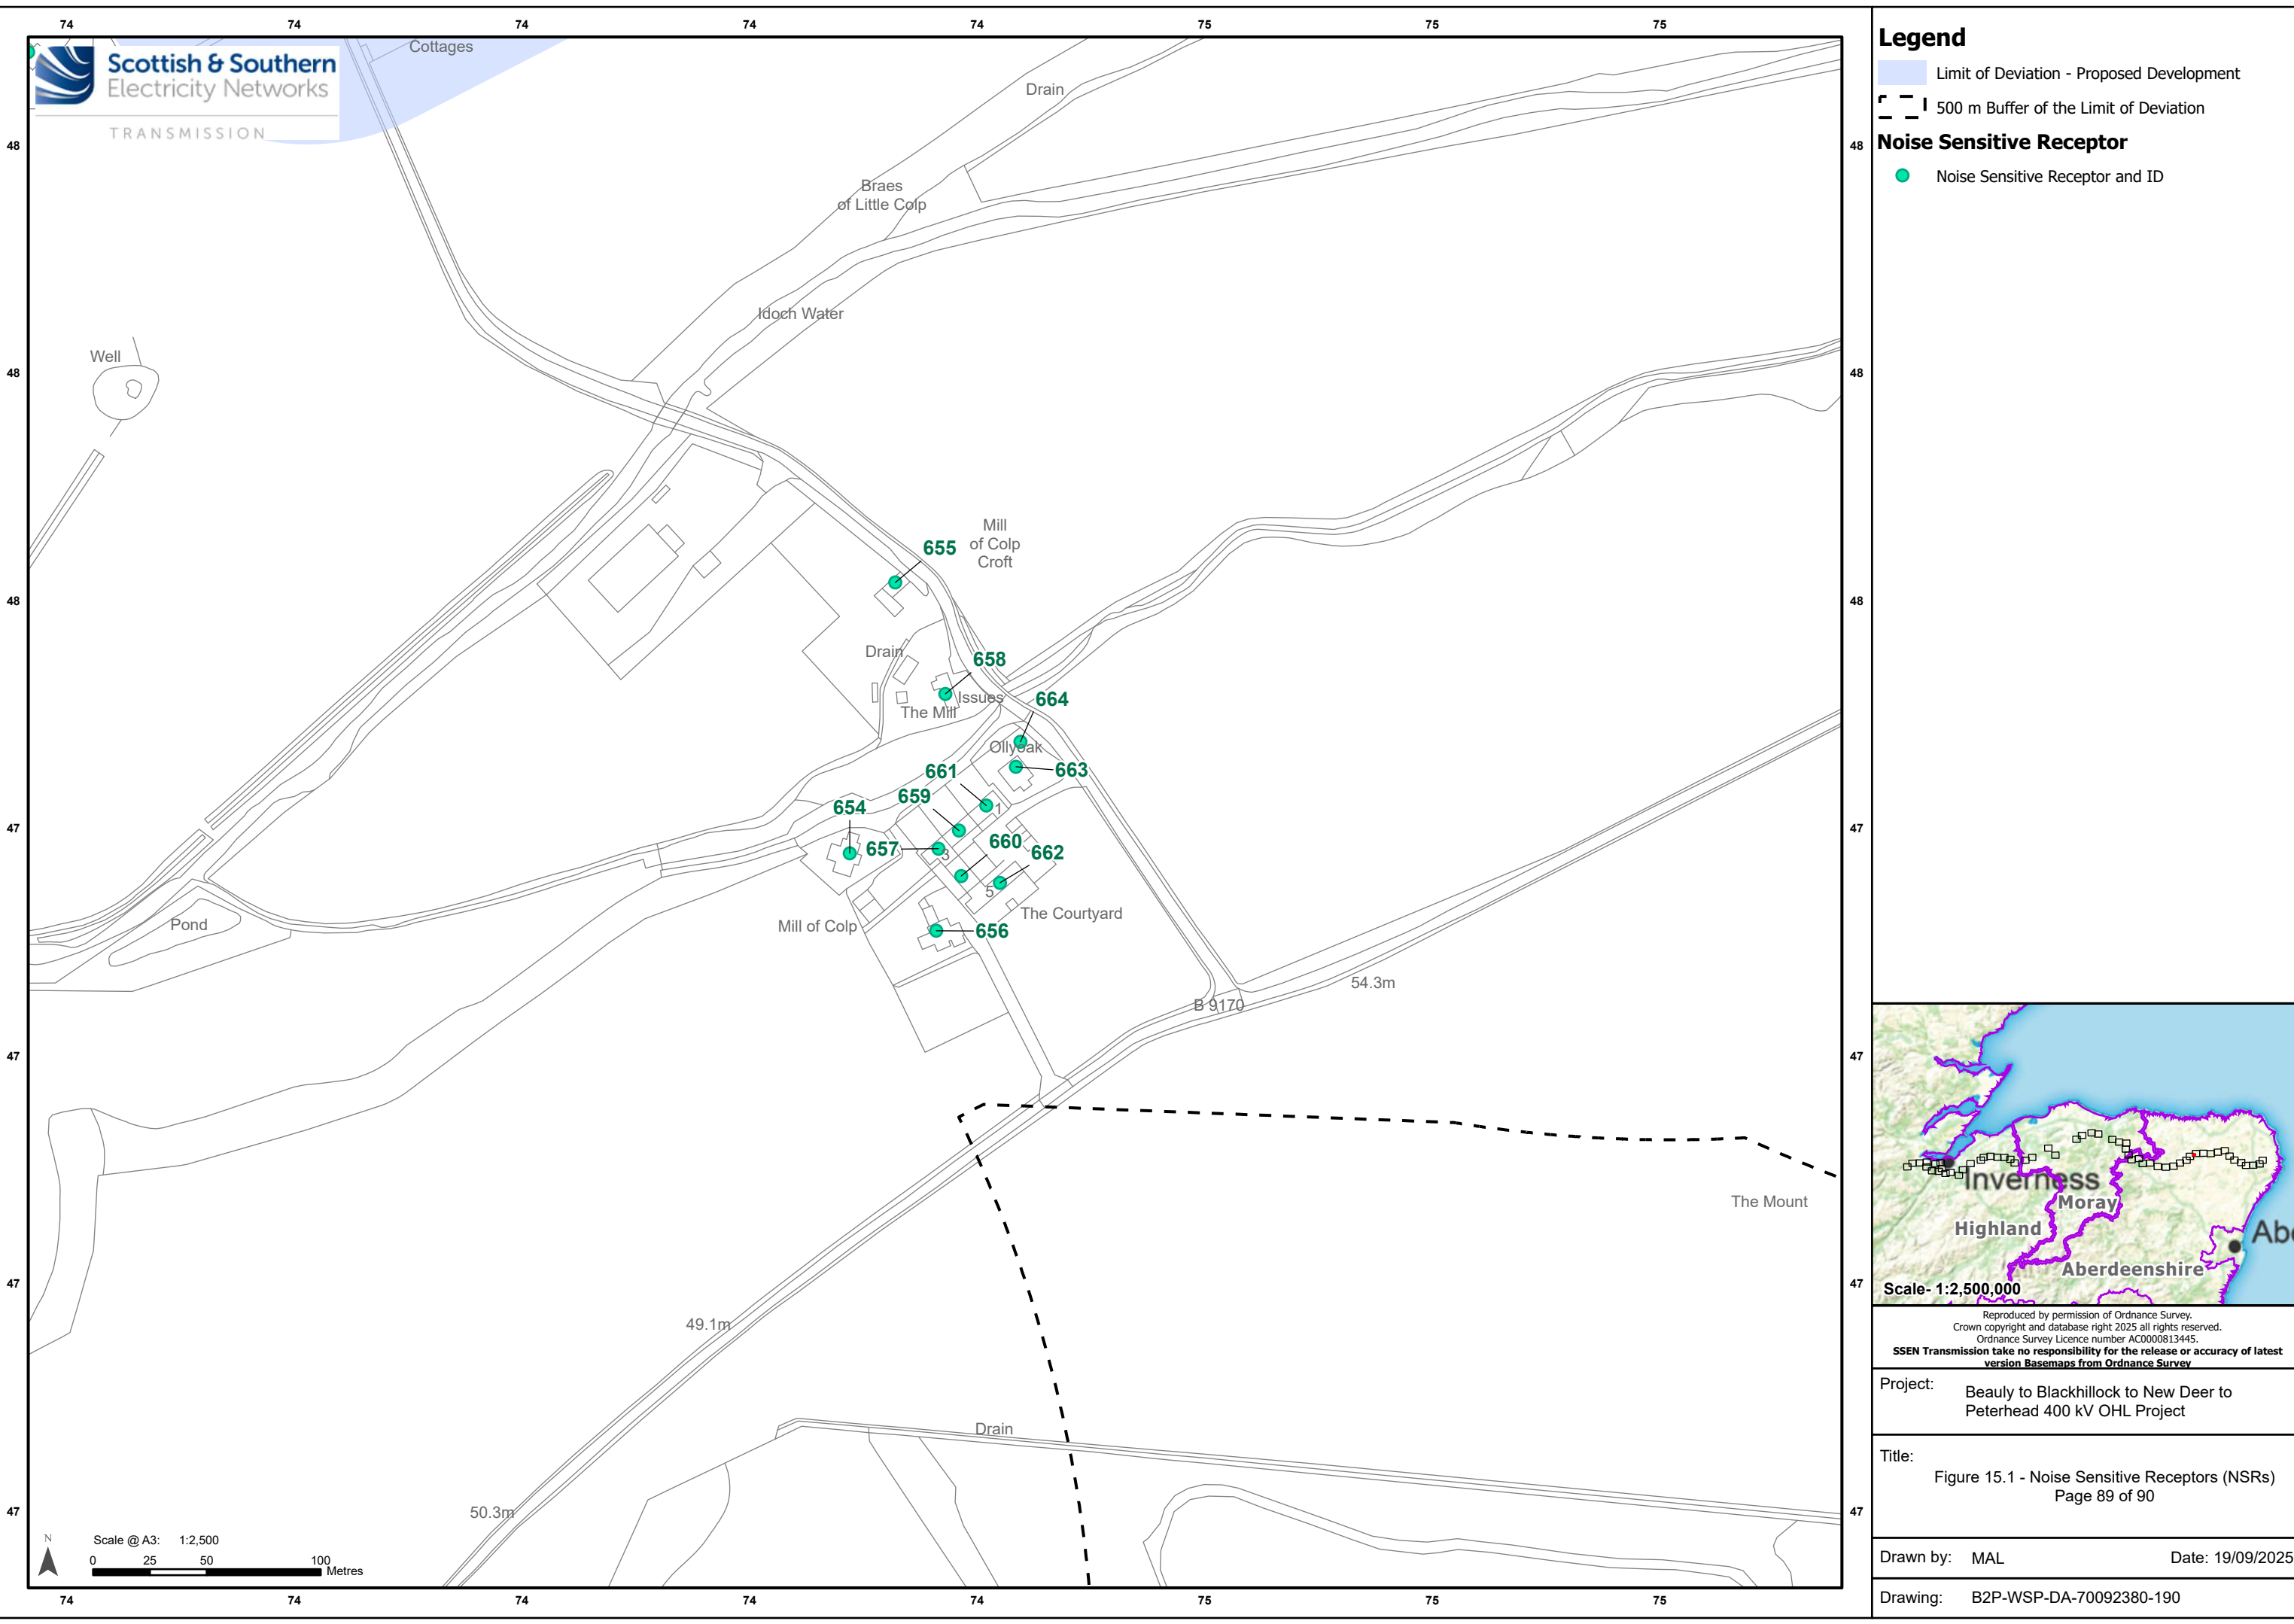


Legend

Limit of Deviation - Proposed Development


500 m Buffer of the Limit of Deviation

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

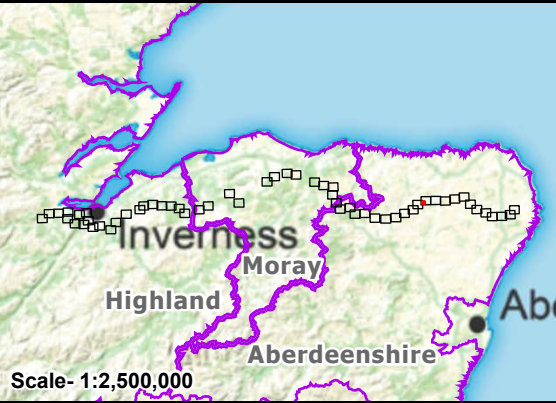

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure 15.1 - Noise Sensitive Receptors (NSRs) Page 89 of 90
Drawn by:	MAL
Date:	19/09/2025
Drawing:	B2P-WSP-DA-70092380-190

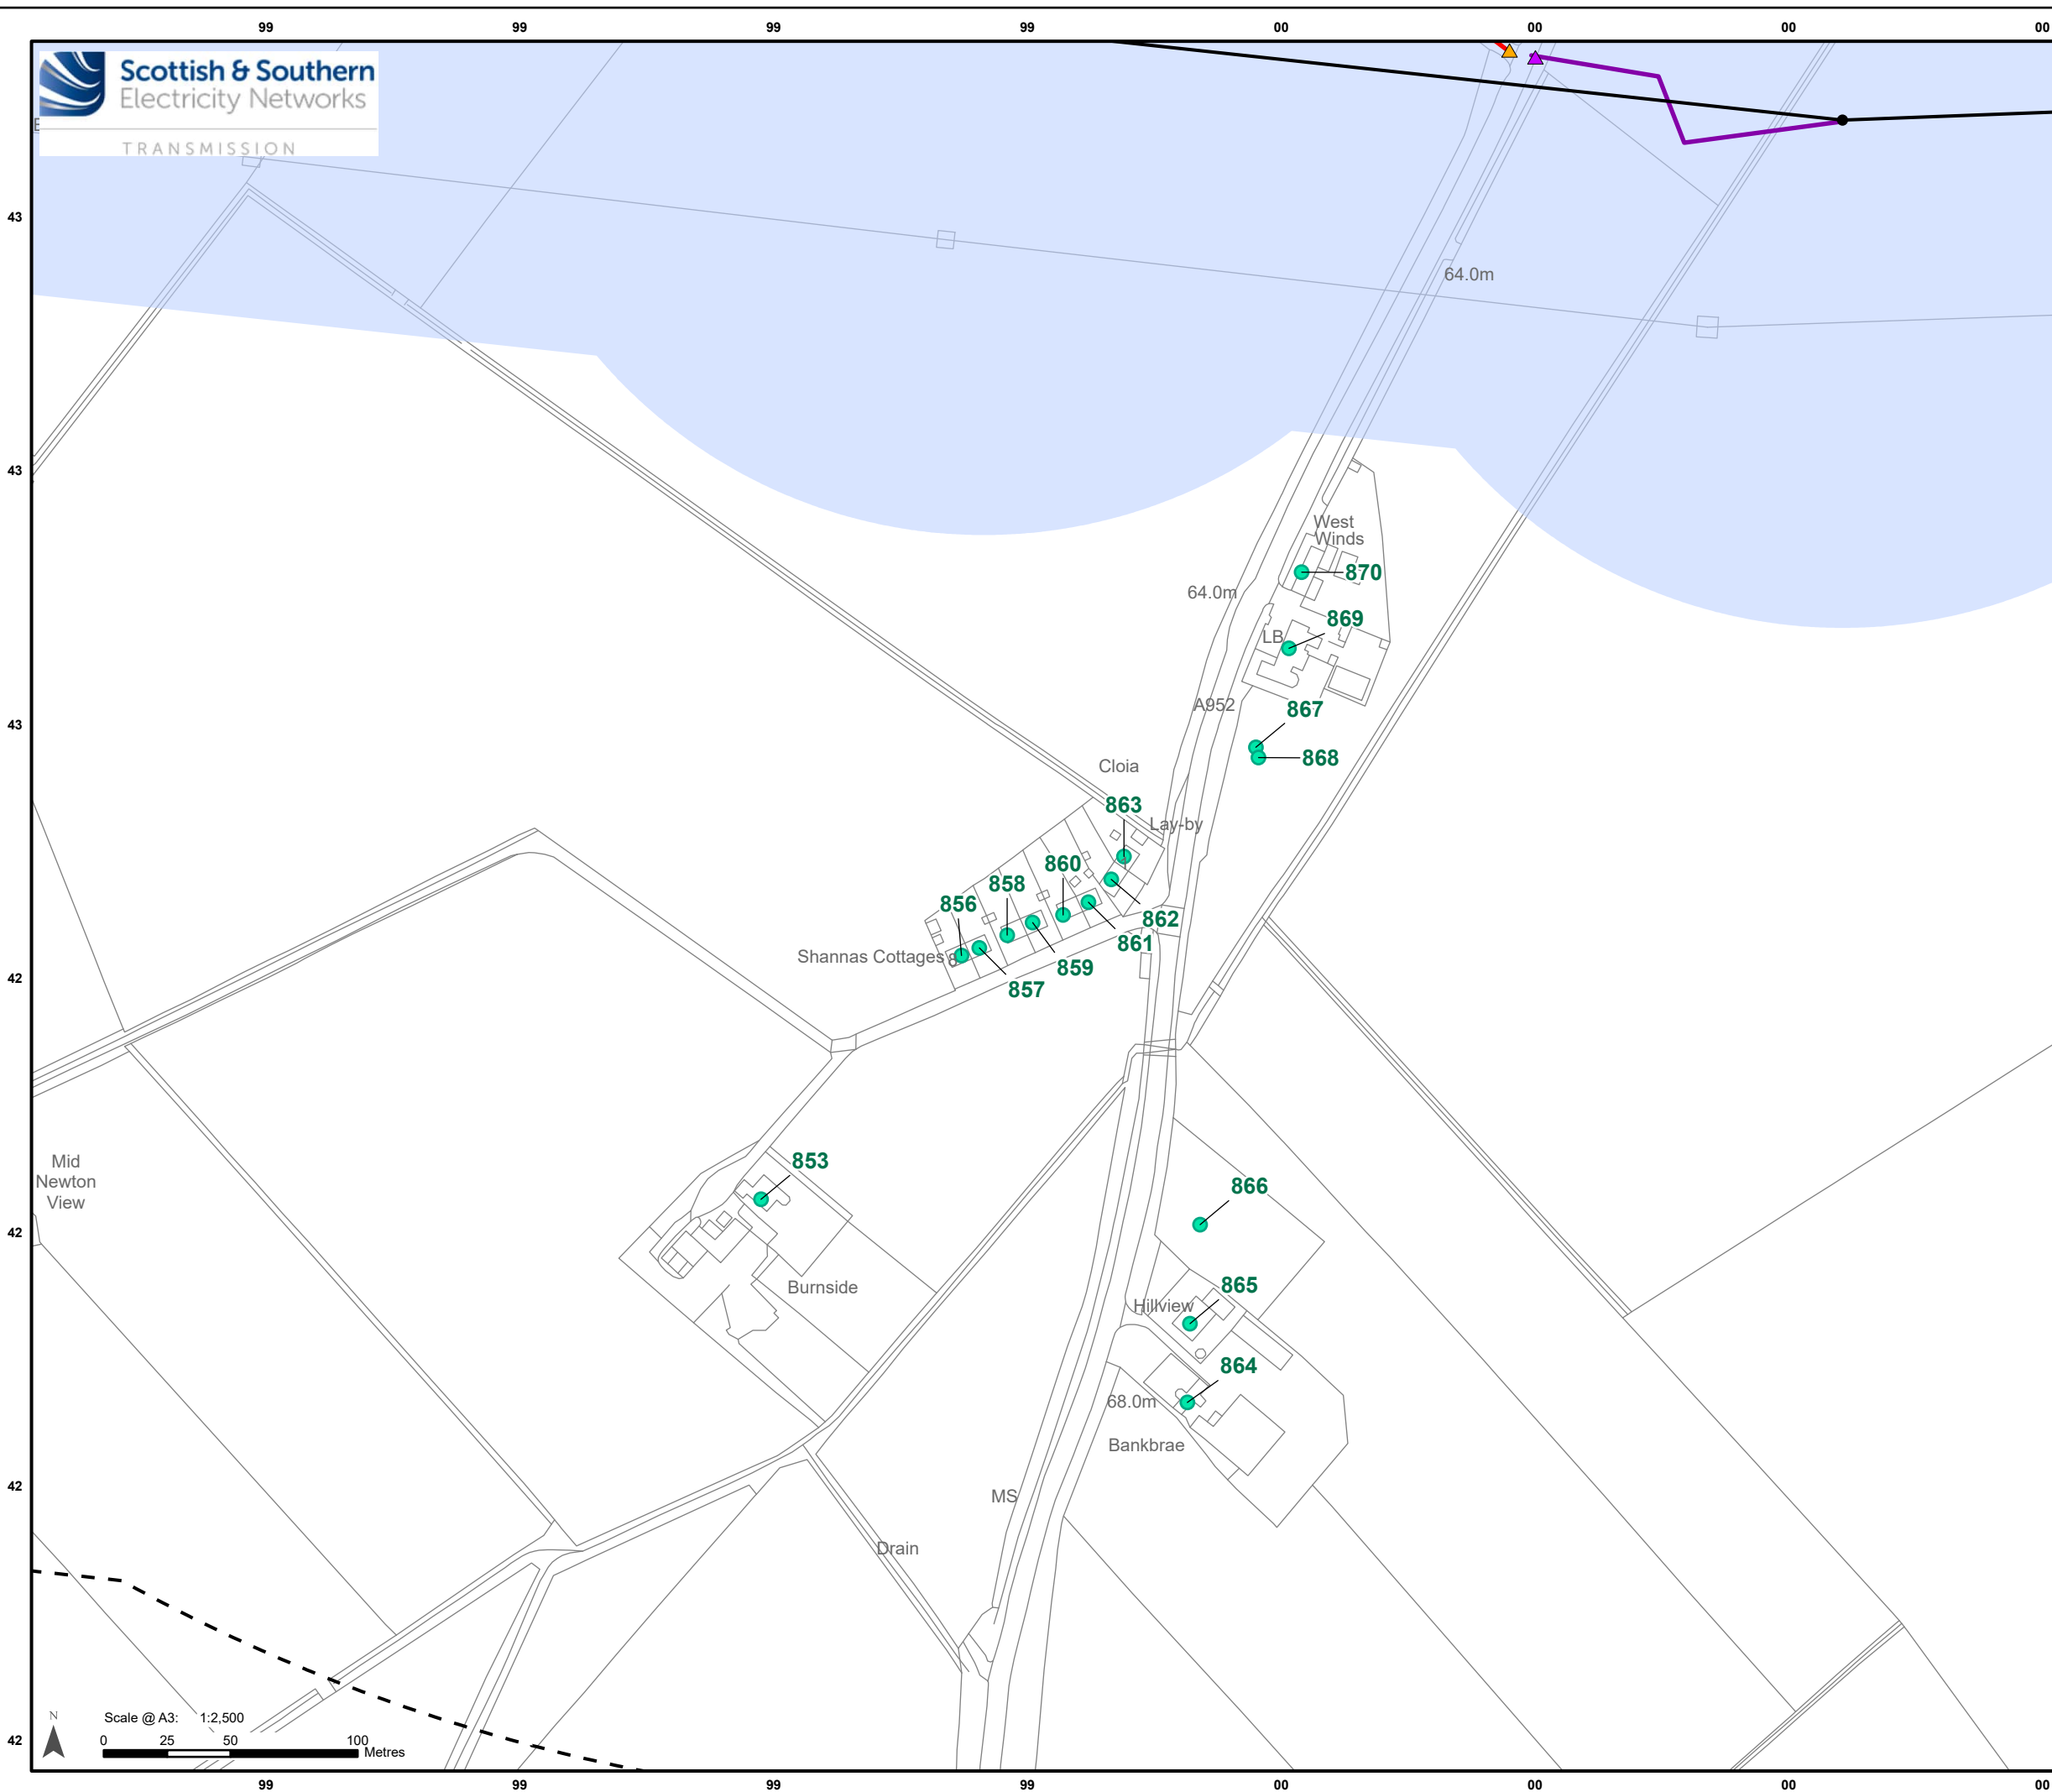

Legend

Limit of Deviation - Proposed Development

500 m Buffer of the Limit of Deviation

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Label

Proposed Tower - 400 kV

Ancillary Development

Proposed Bellmouth - Temporary


Proposed Bellmouth - Upgrade

Existing Access - Upgrade - Very Poor Condition

Proposed Access - Temporary

Noise Sensitive Receptor

Noise Sensitive Receptor and ID

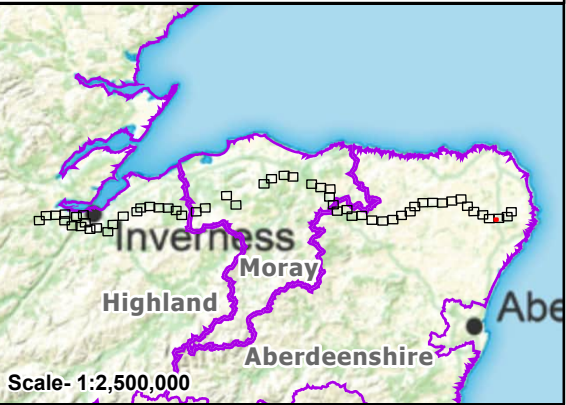

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400 kV OHL Project

Title: Figure 15.1 - Noise Sensitive Receptors (NSRs)
Page 90 of 90

Drawn by: MAL Date: 19/09/2025

Drawing: B2P-WSP-DA-70092380-190