


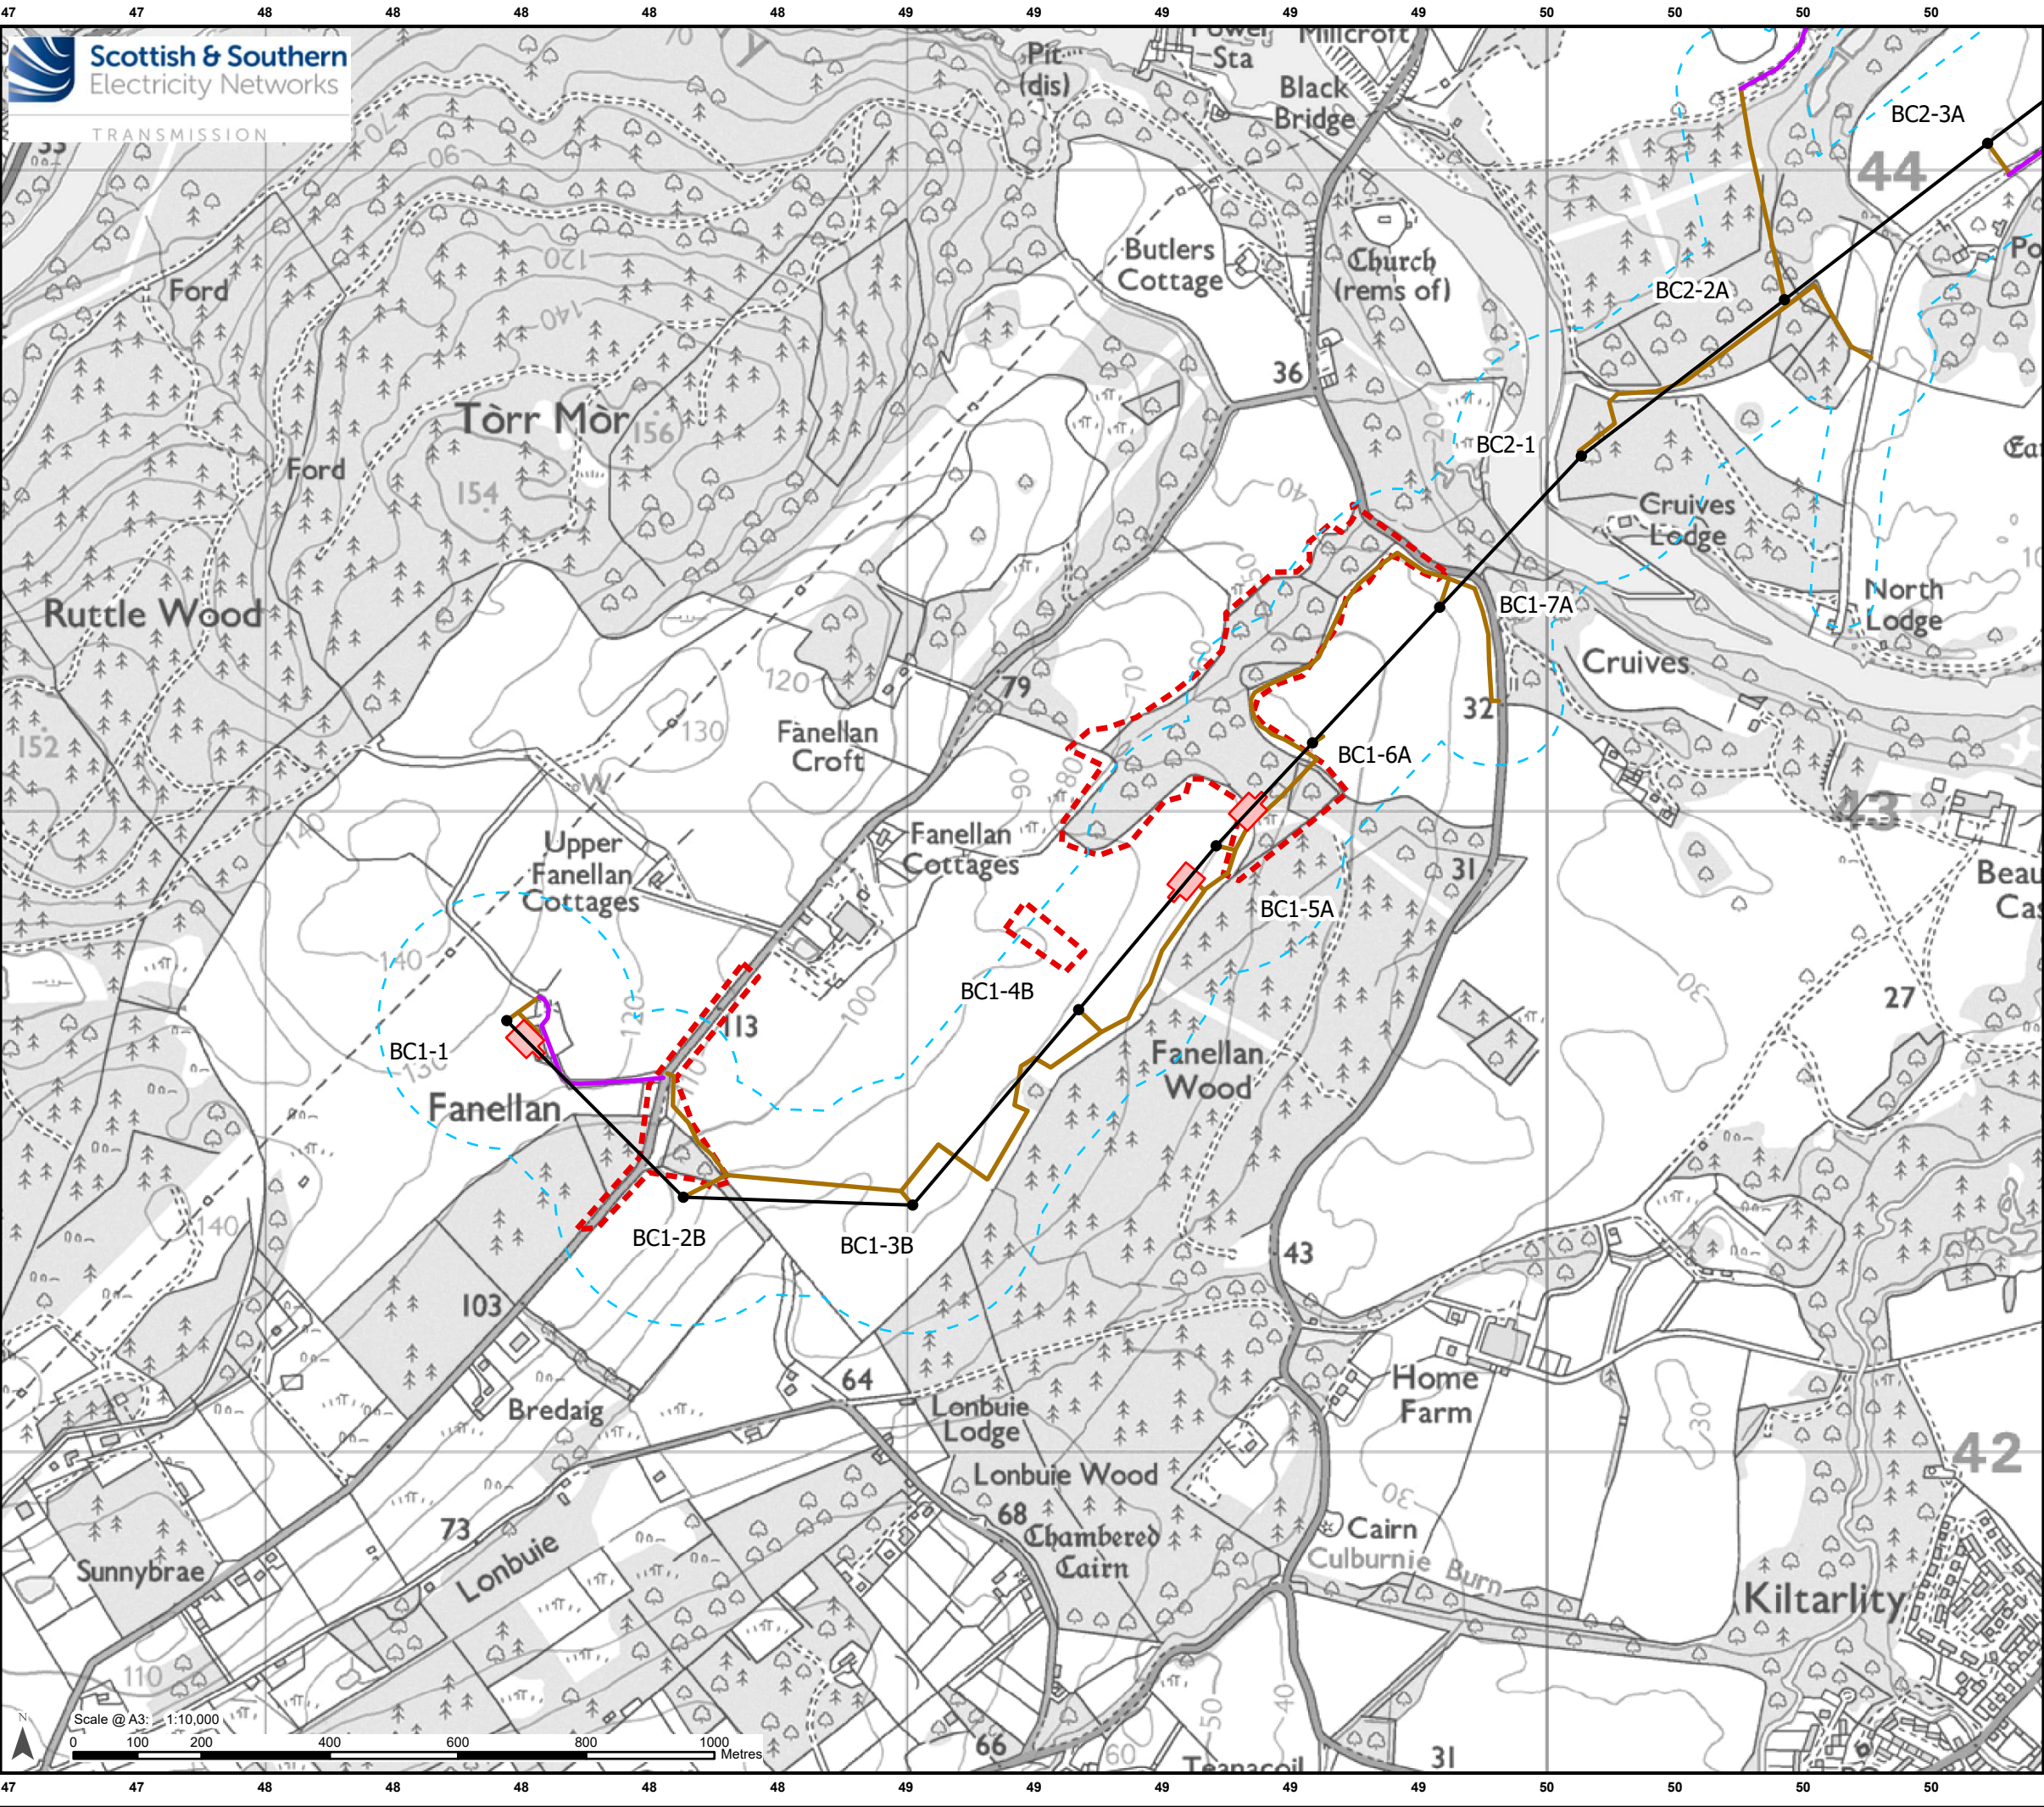

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

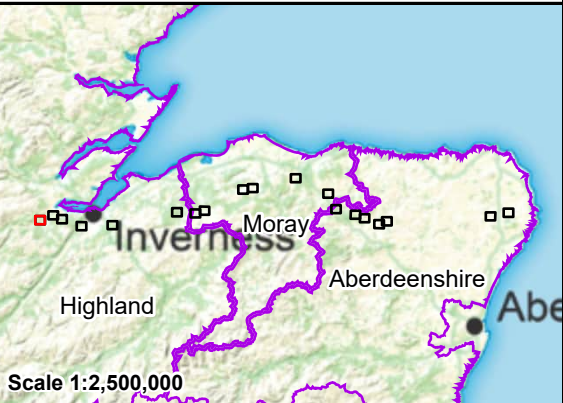


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 1 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

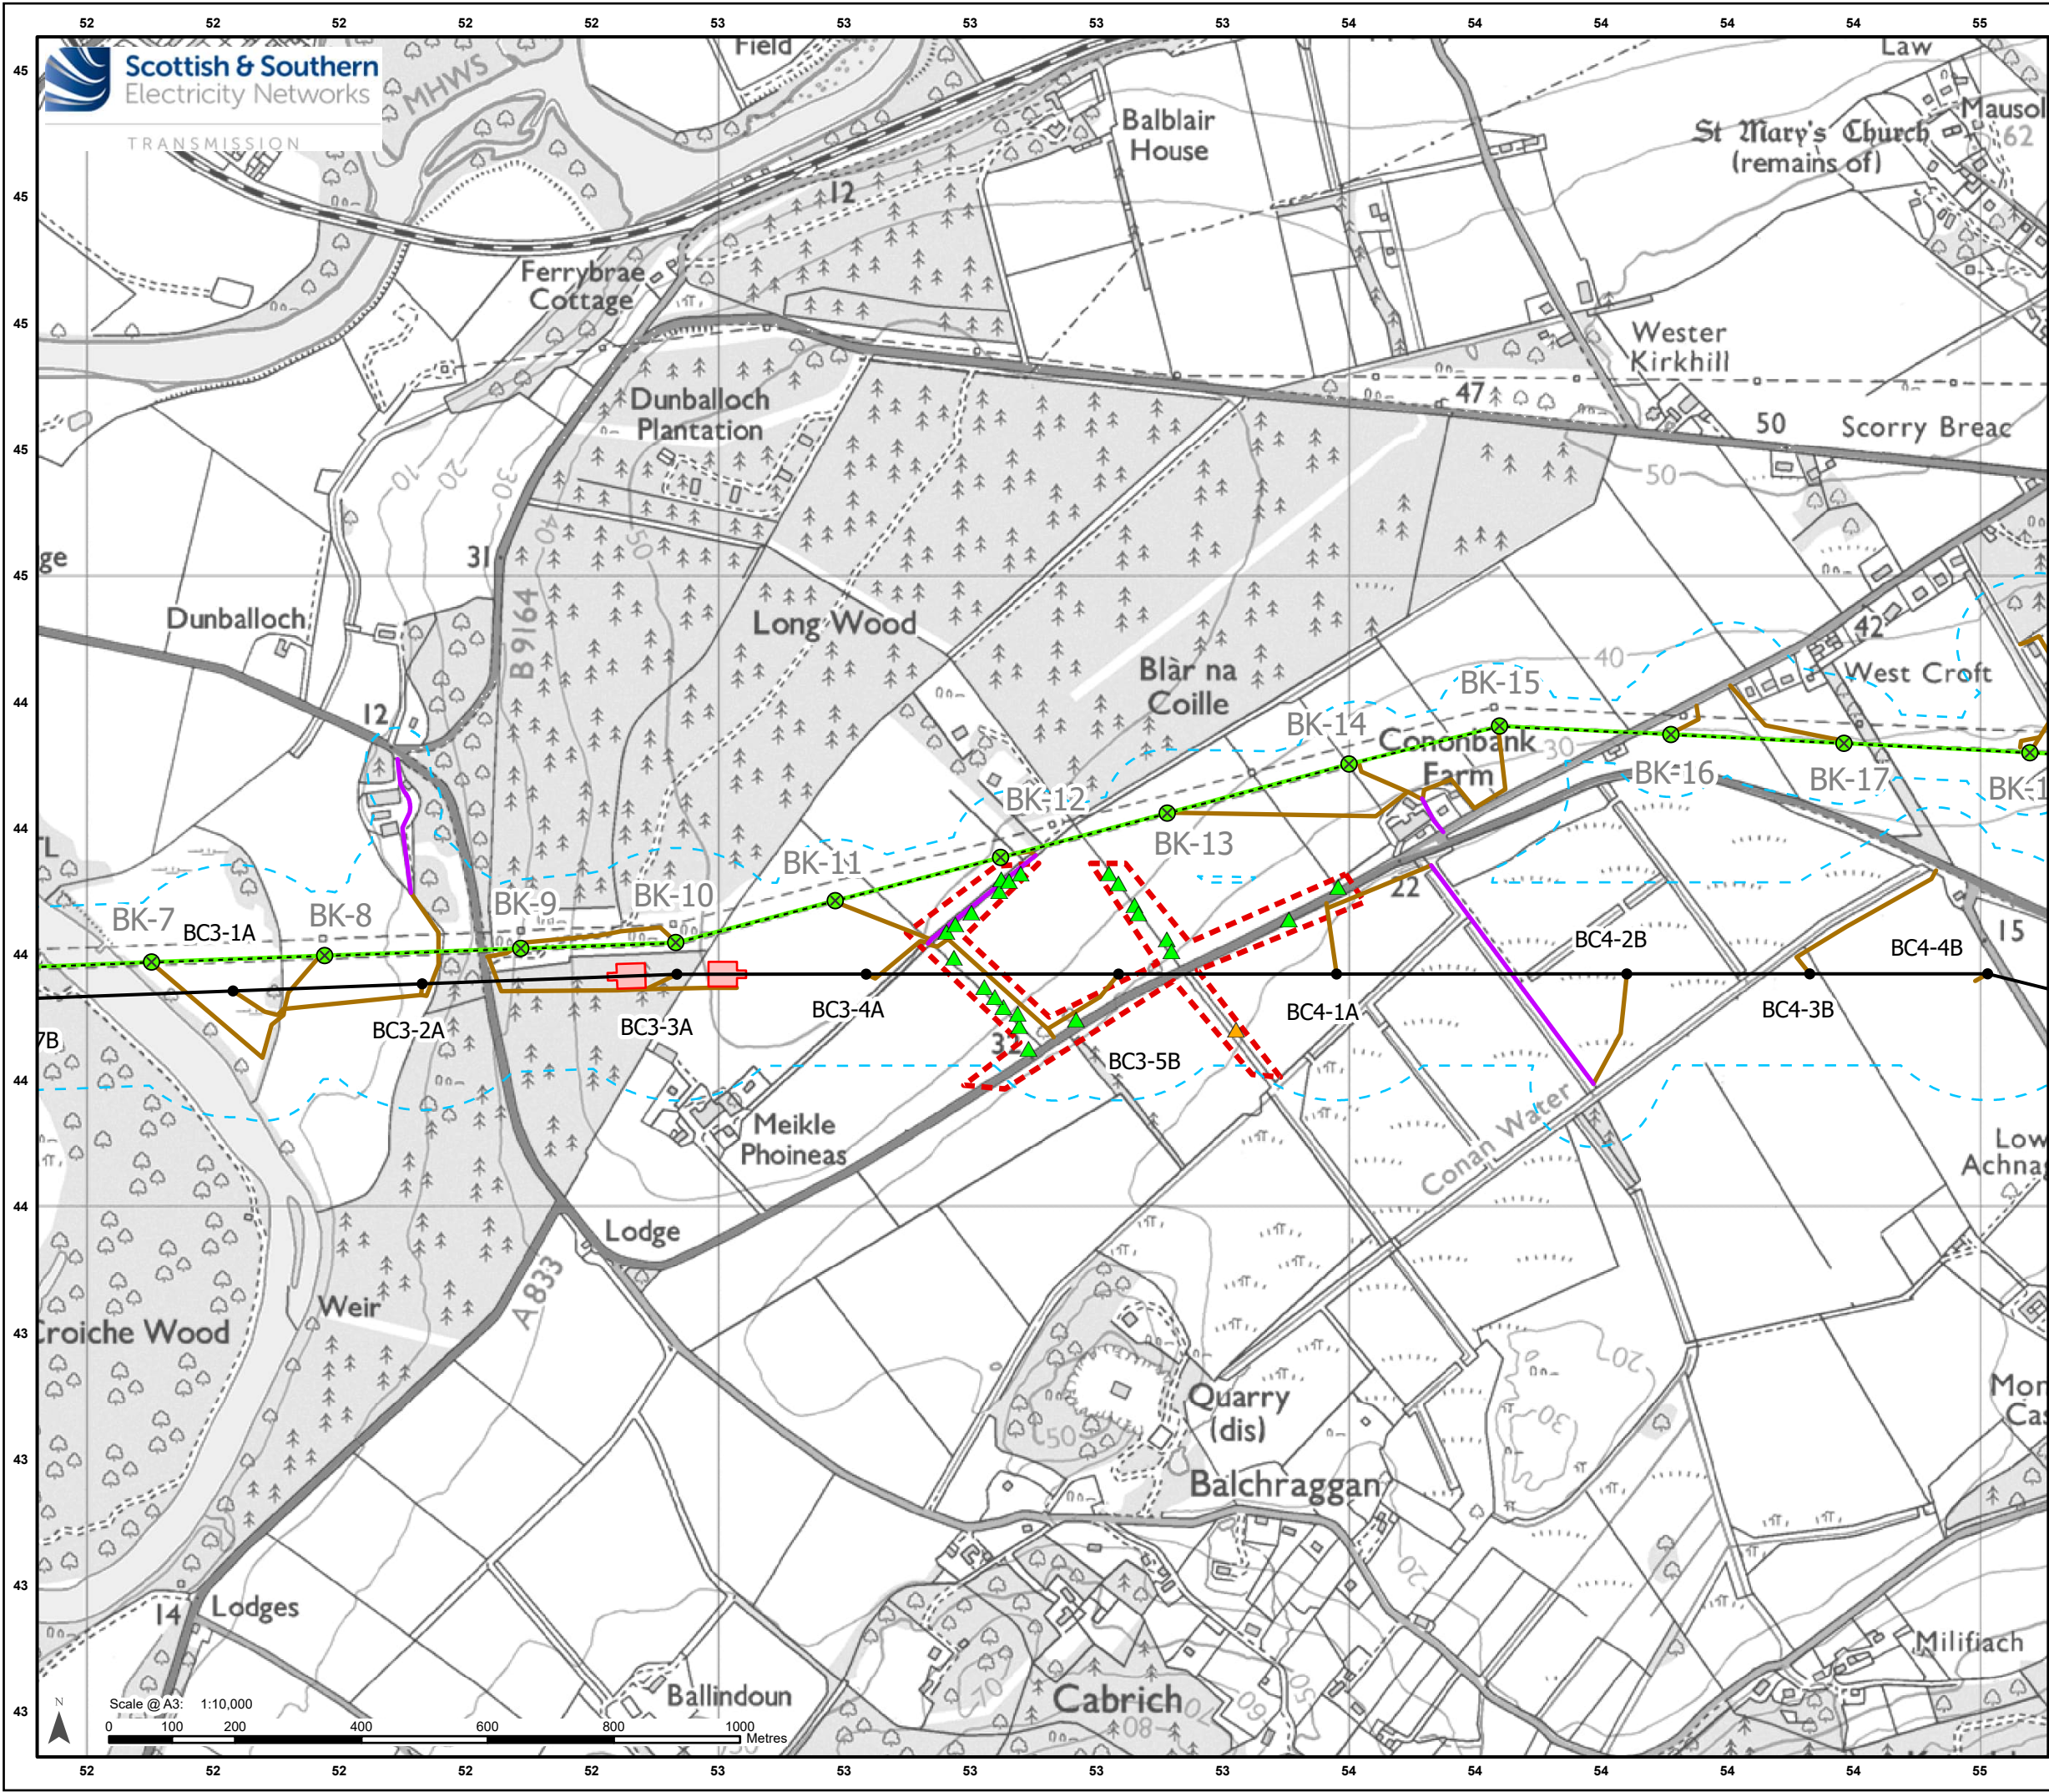

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/ Permanent)
- Existing Access Upgrade

Species Survey Area


- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree

Suitability

- Potential Roost Feature (PRF)
- Further Assessment Required (FAR)

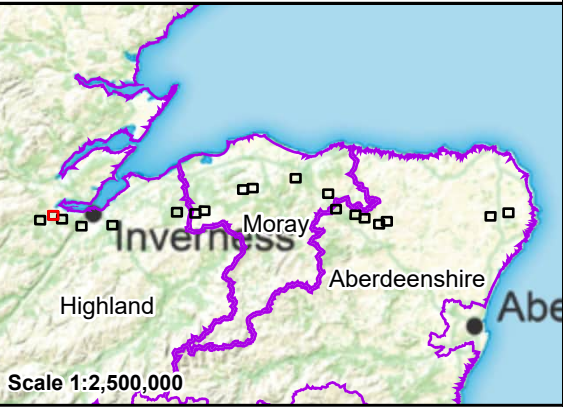


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 2 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

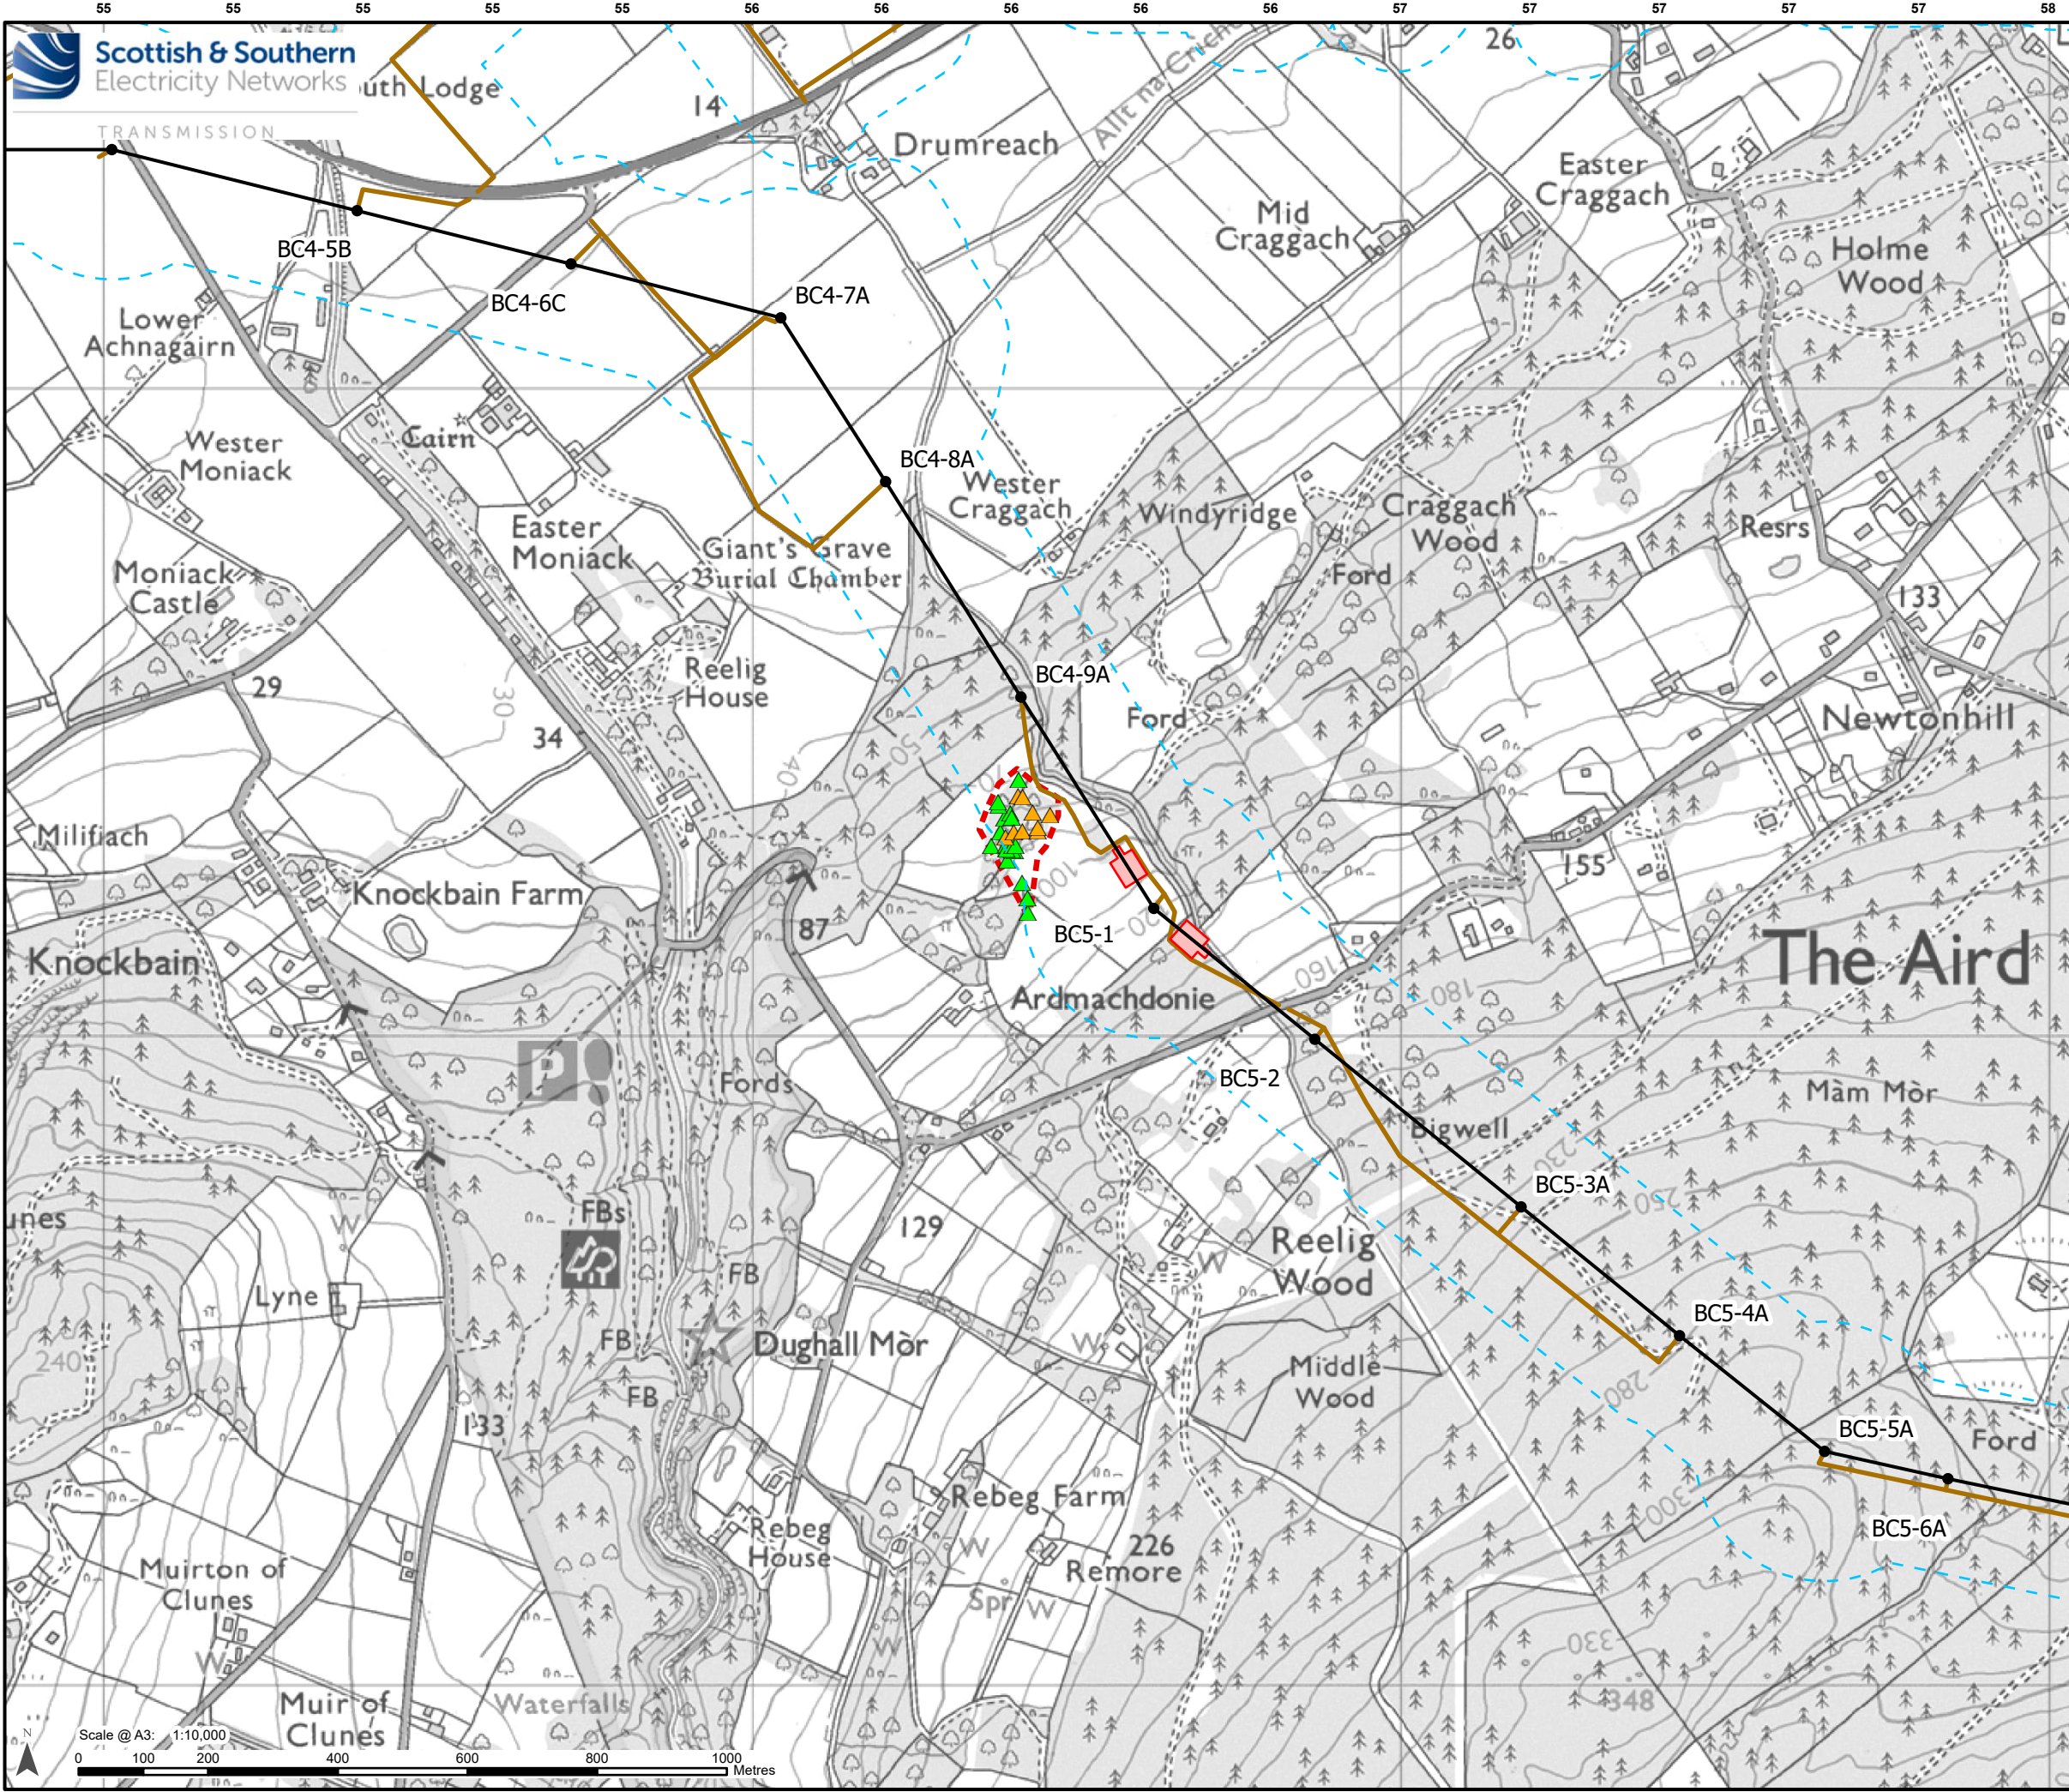

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree Suitability

- Potential Roost Feature (PRF)
- Further Assessment Required (FAR)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 3 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

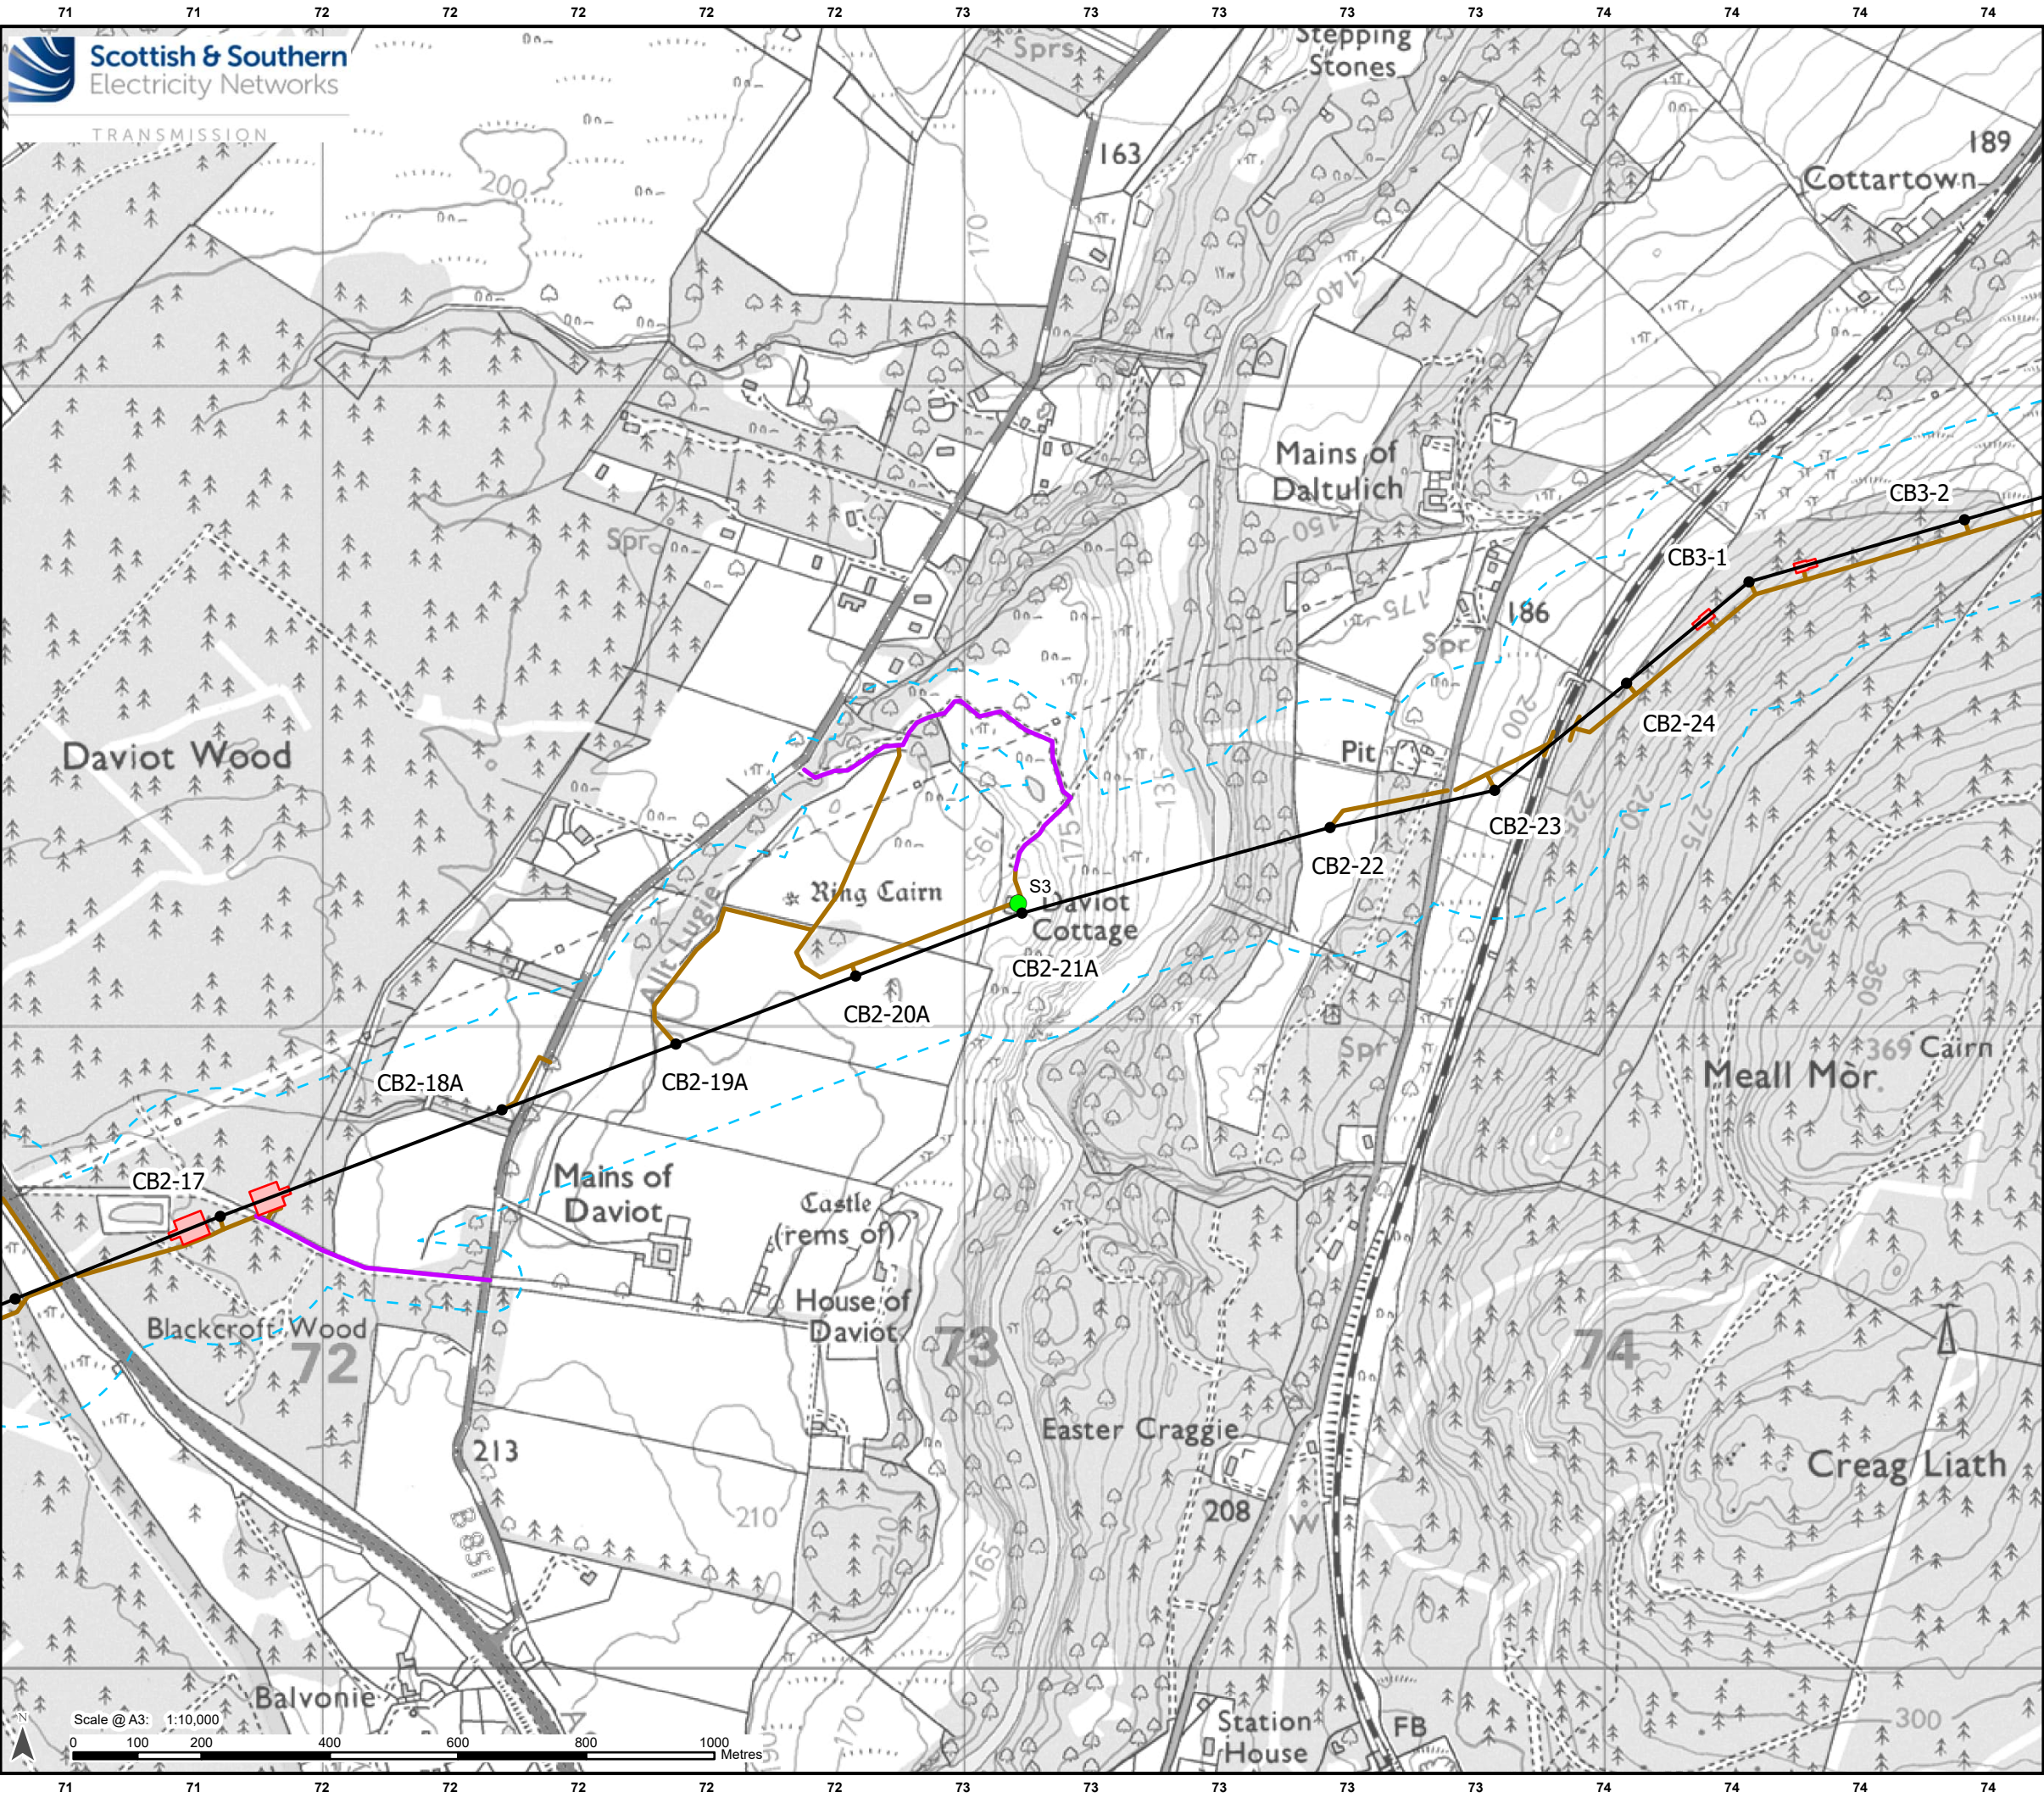

Legend
Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Daytime Bat Walkover (DBW) Result
Structure
PRF Suitability

- Moderate

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 5 of 19

Drawn by: MAL **Date:** 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

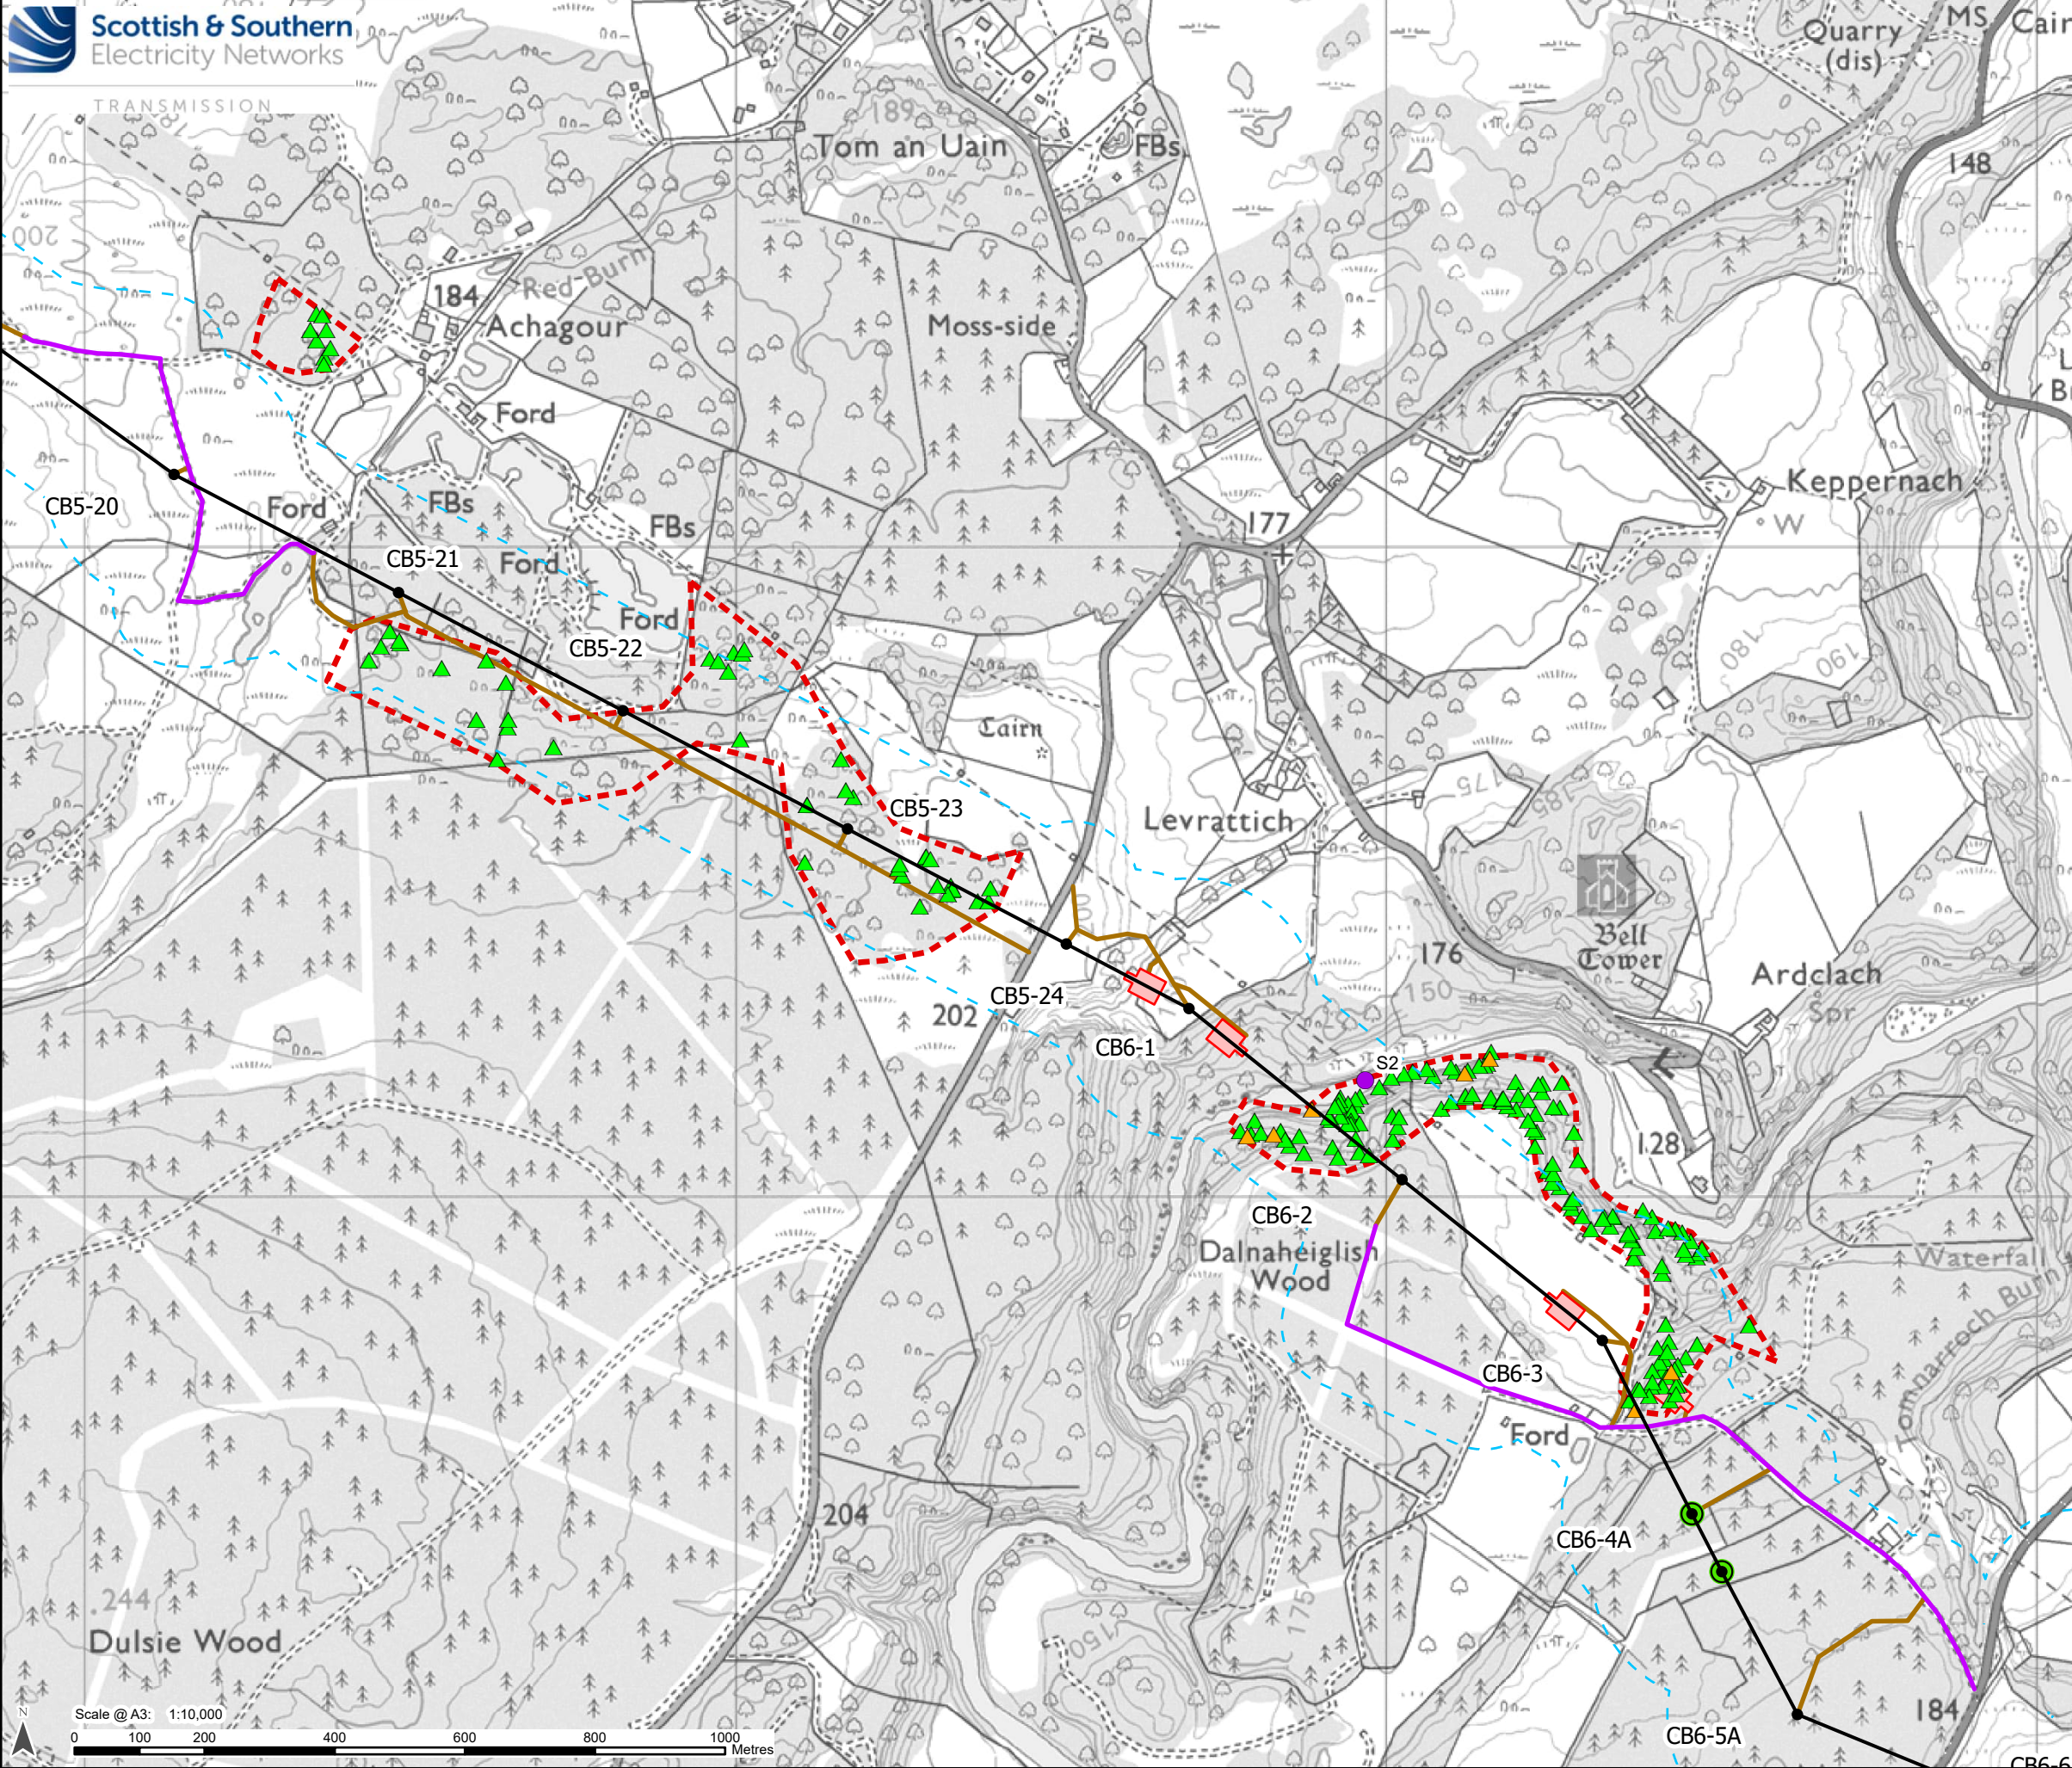

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Tower - 400 kV (with tower number)
- Transposition Towers
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Structure


PRF Suitability

- High

Tree

Suitability

- Potential Roost Feature (PRF)
- Further Assessment Required (FAR)

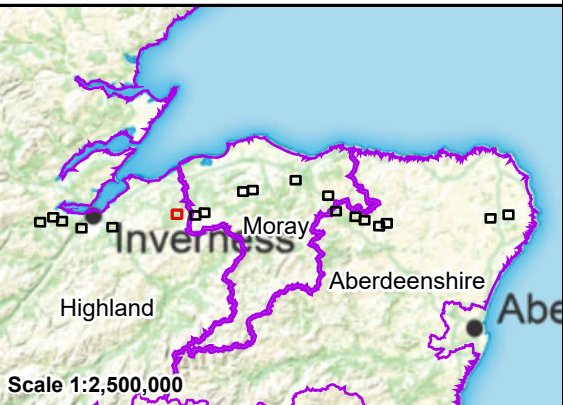


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 6 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

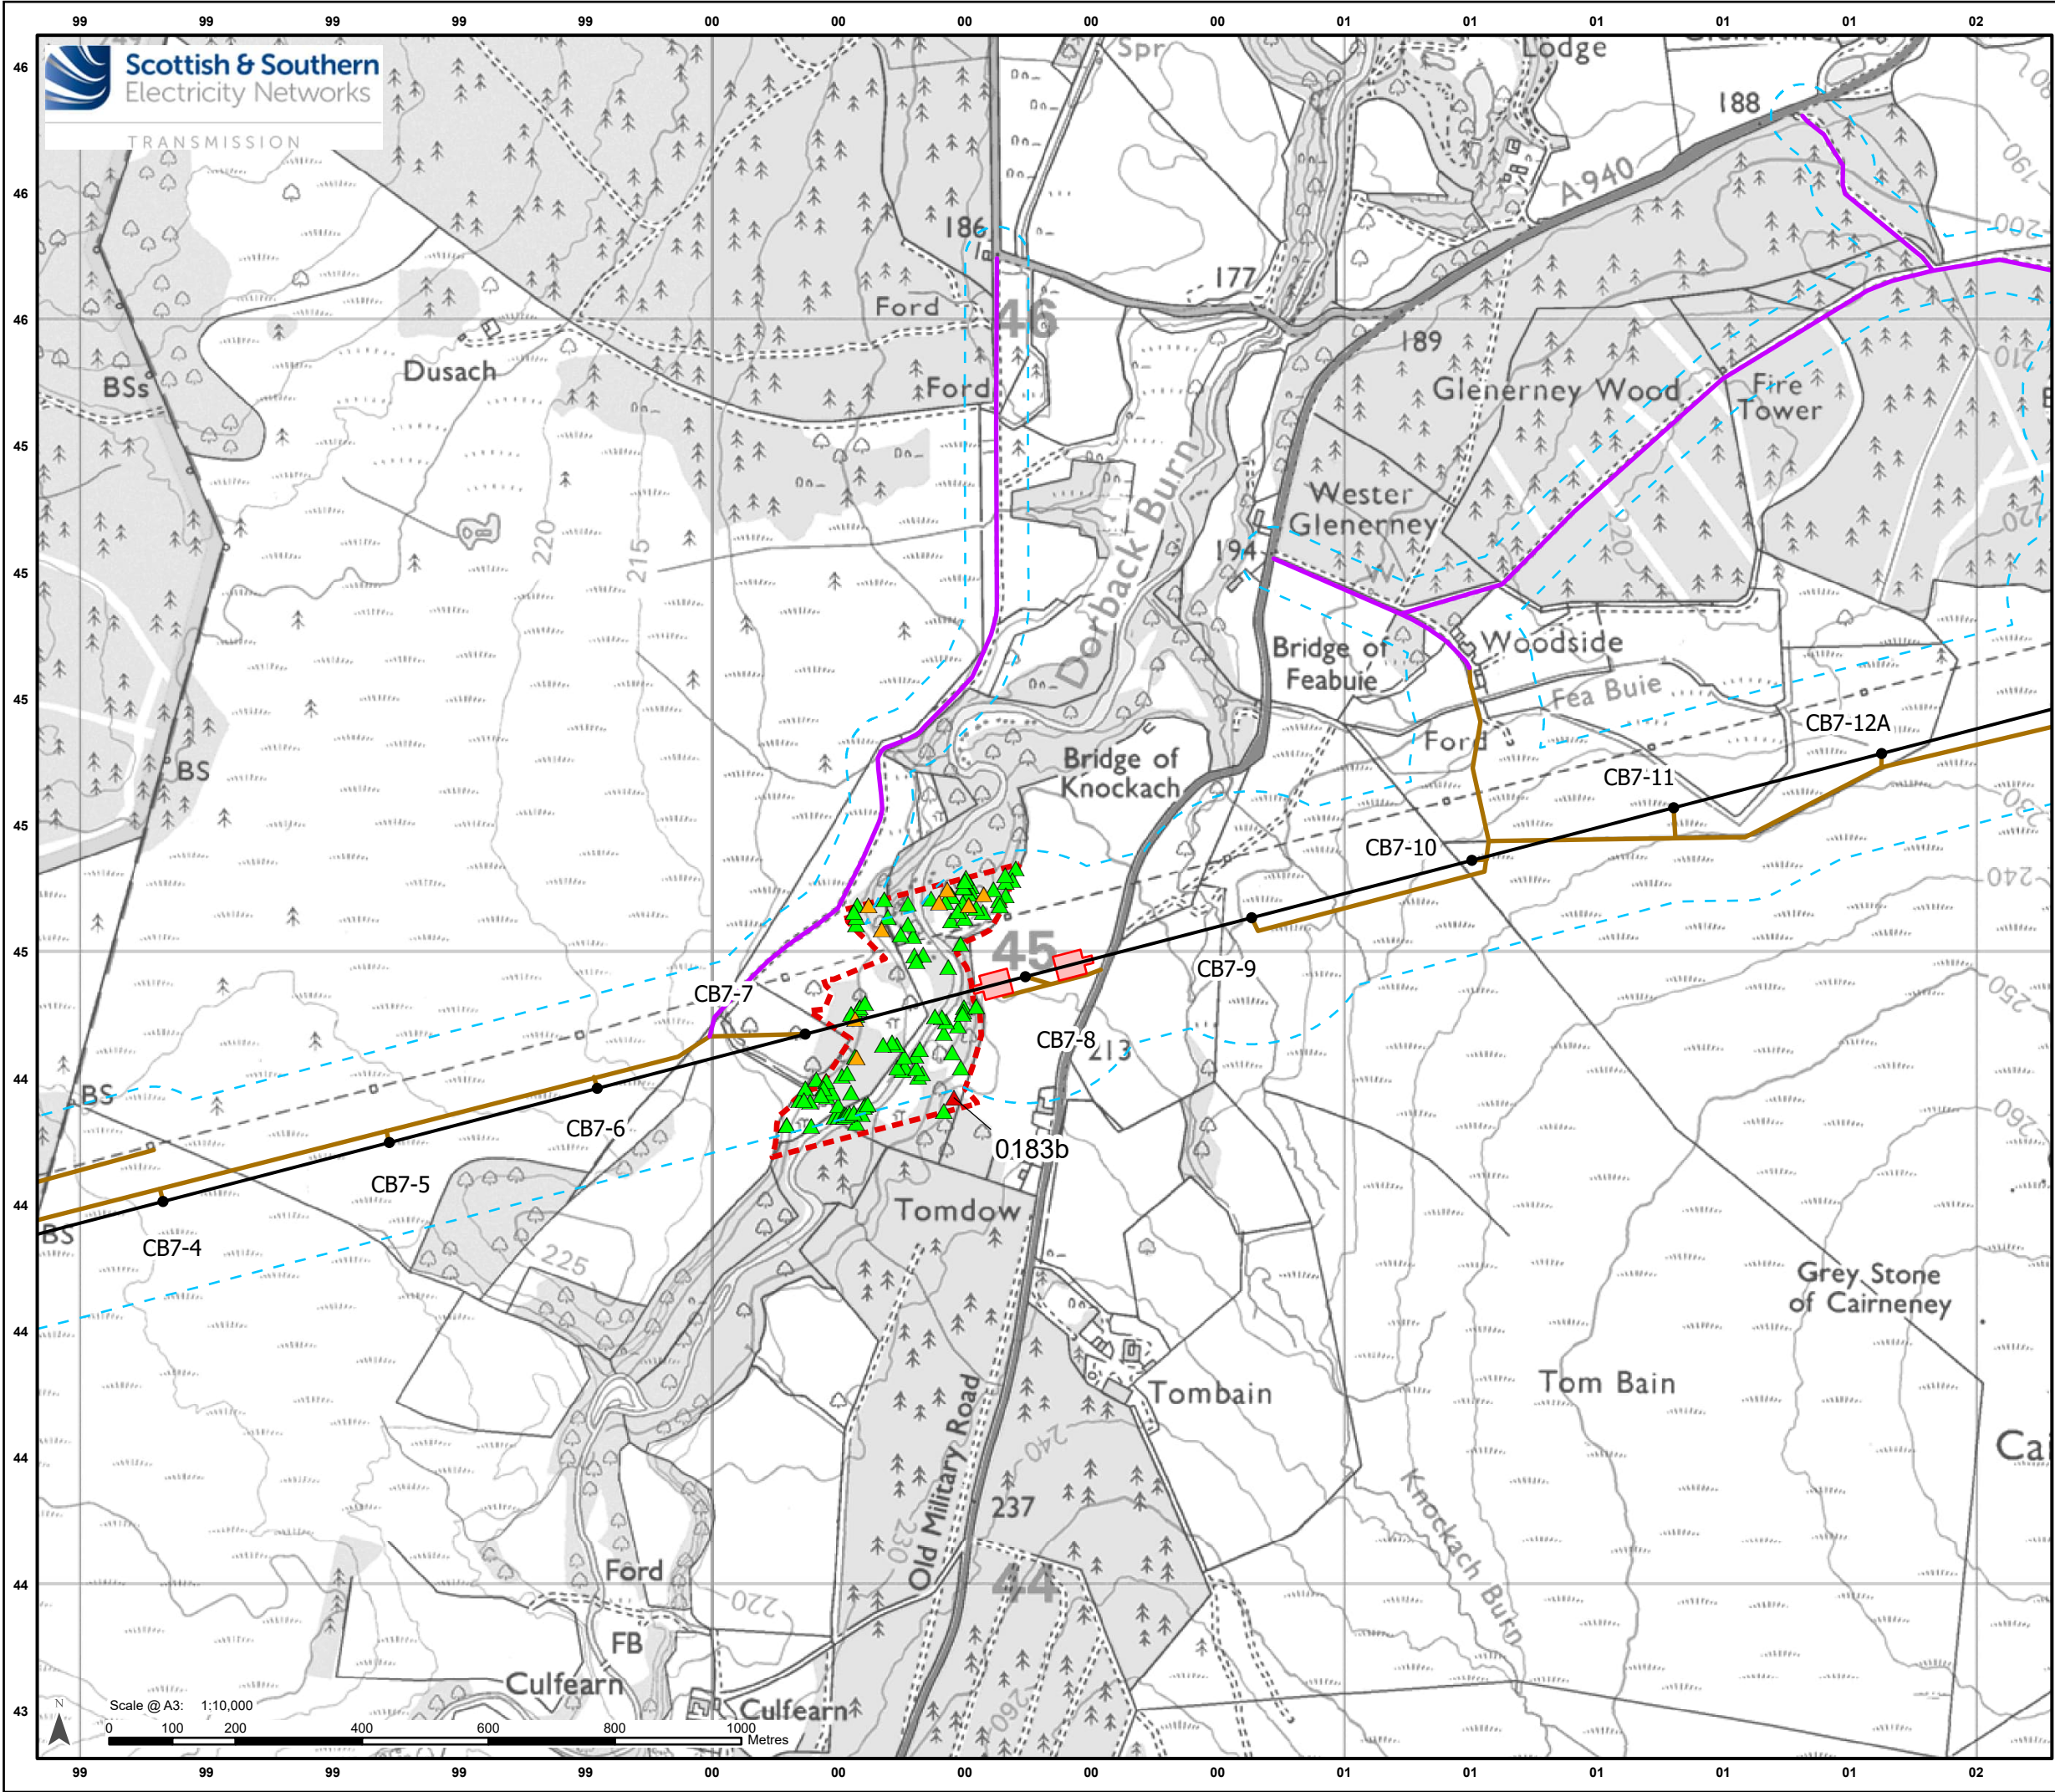

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree Suitability

- Confirmed
- Potential Roost Feature (PRF)
- Further Assessment Required (FAR)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 7 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

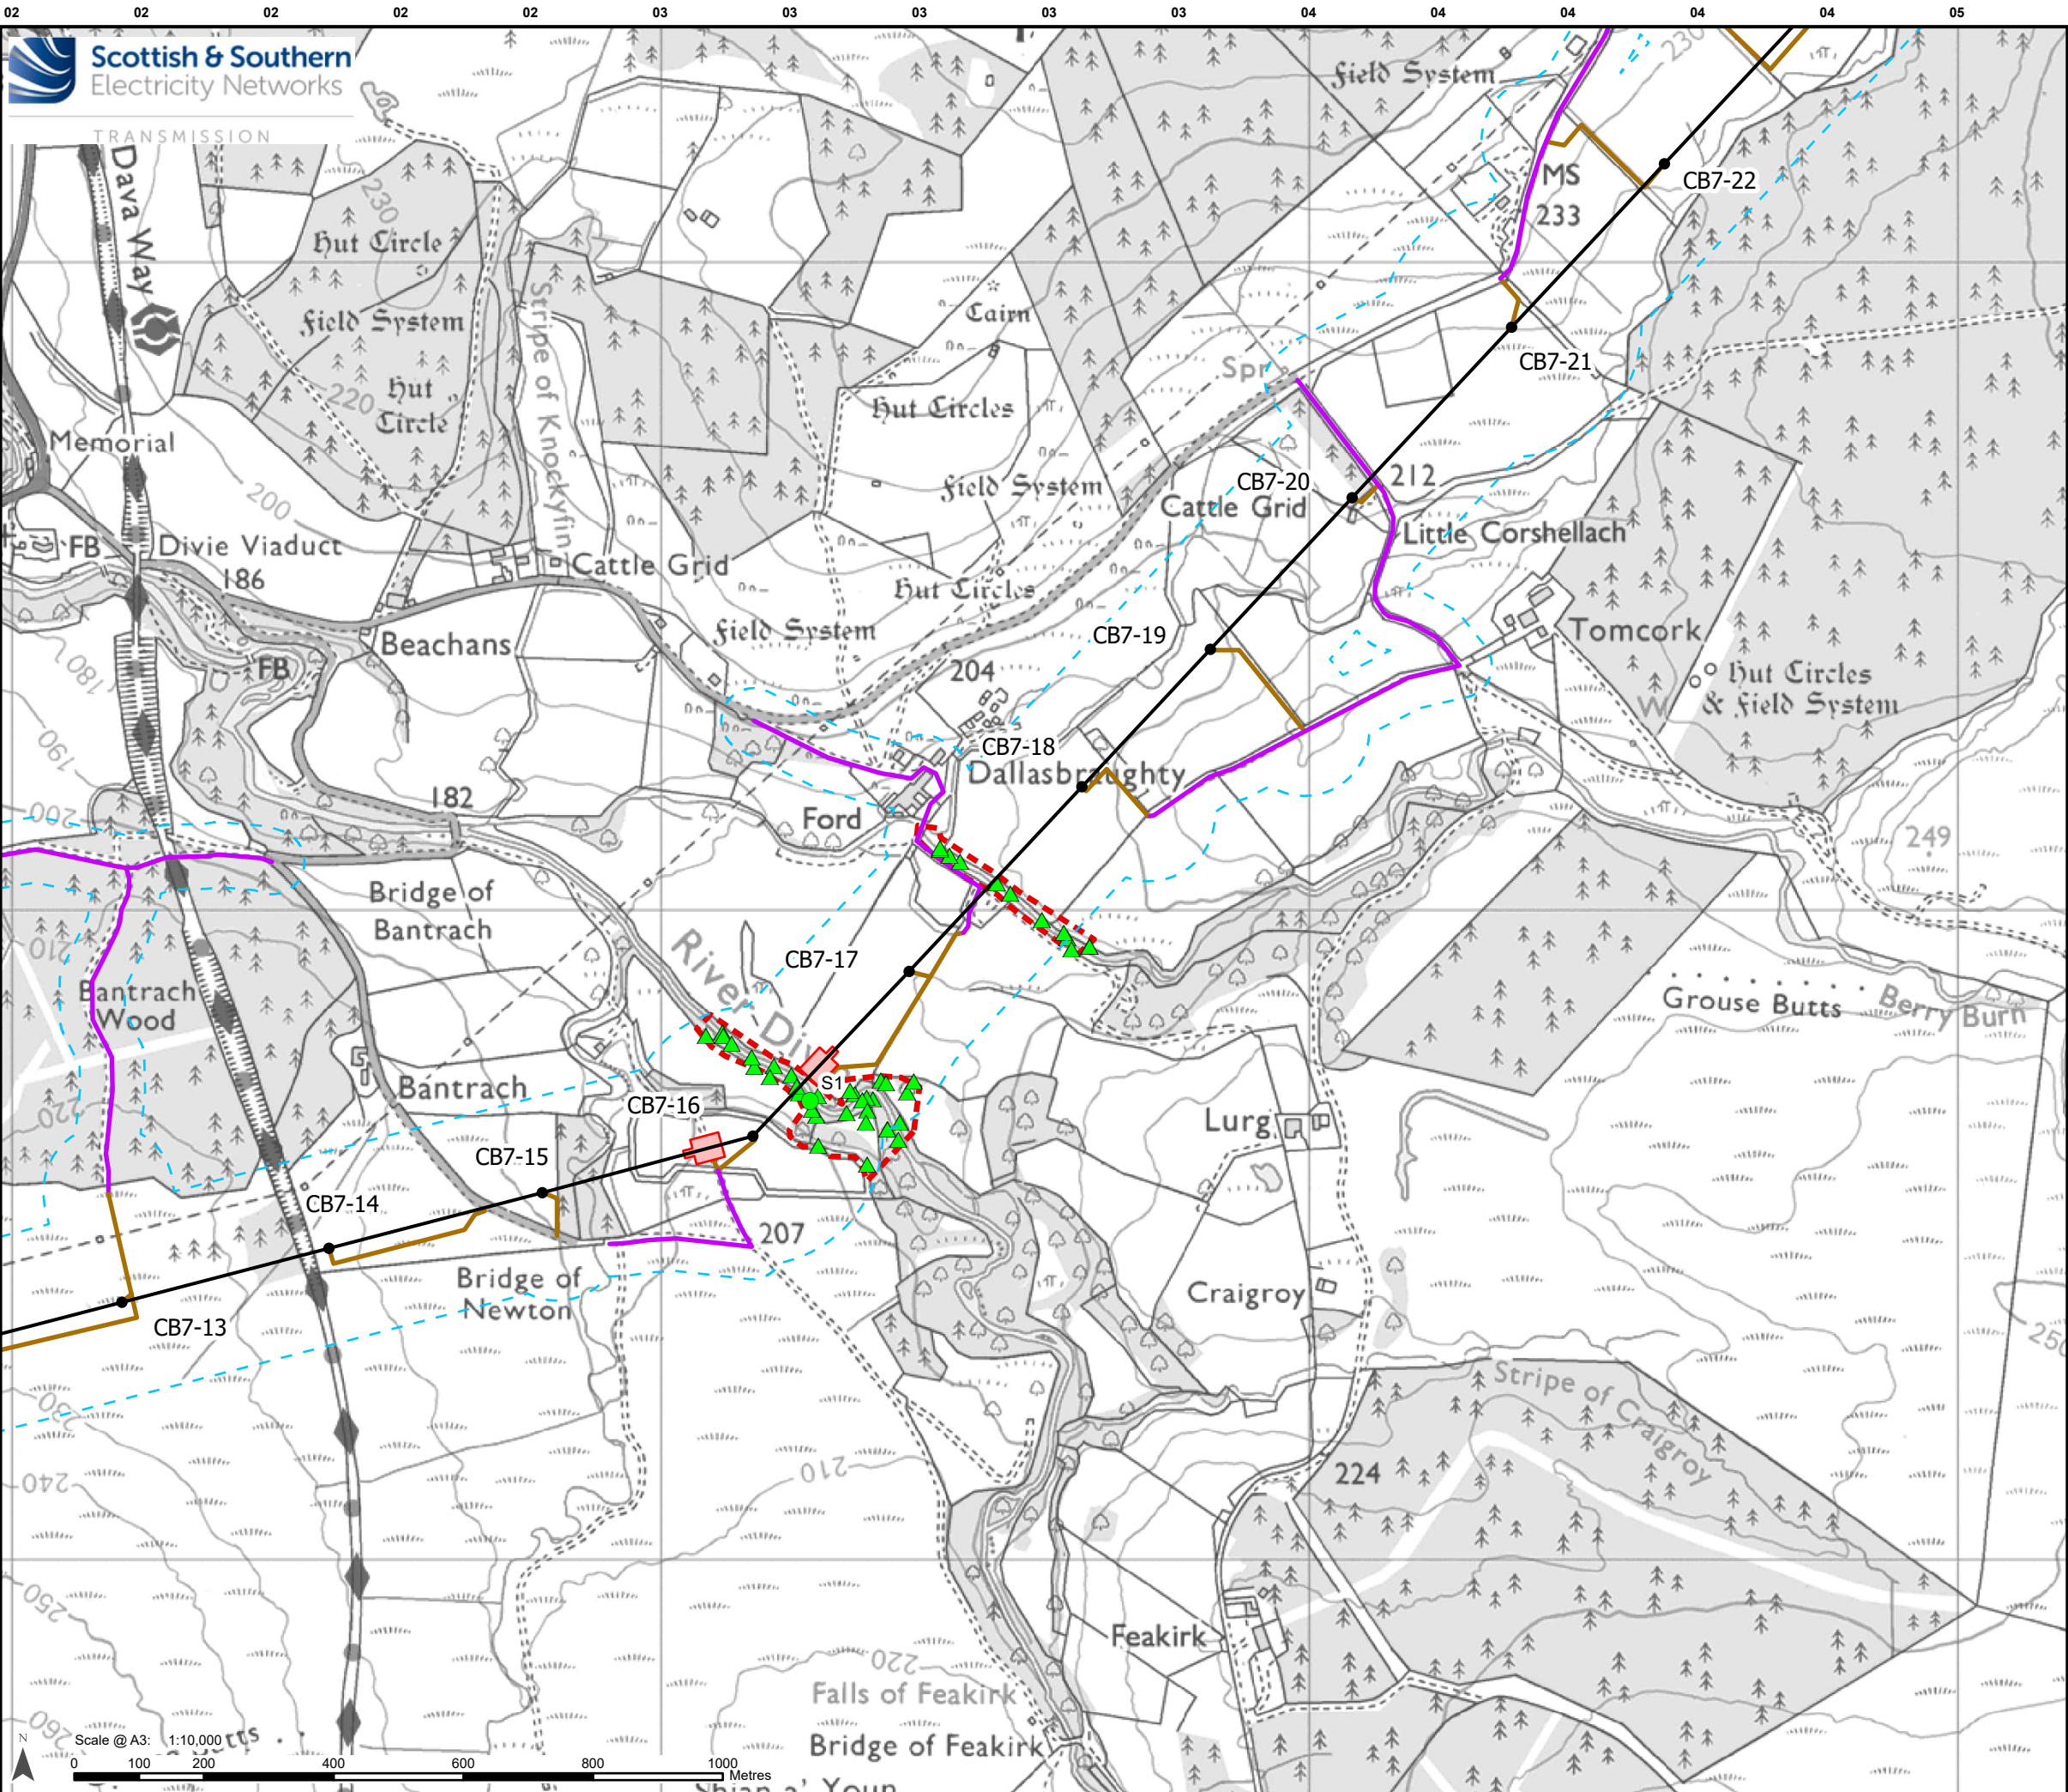

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Structure

PRF Suitability

- Moderate

Tree

Suitability

- Potential Roost Feature (PRF)

Scale 1:2,500,000



Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 8 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

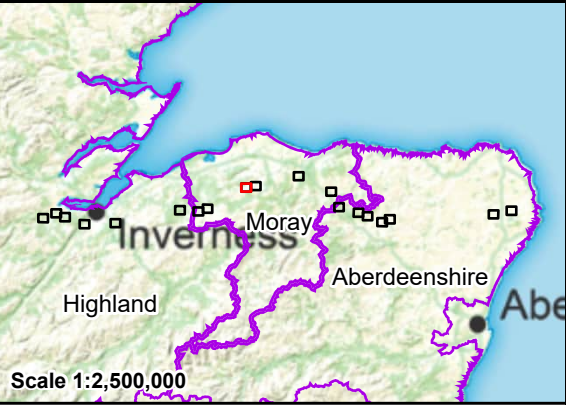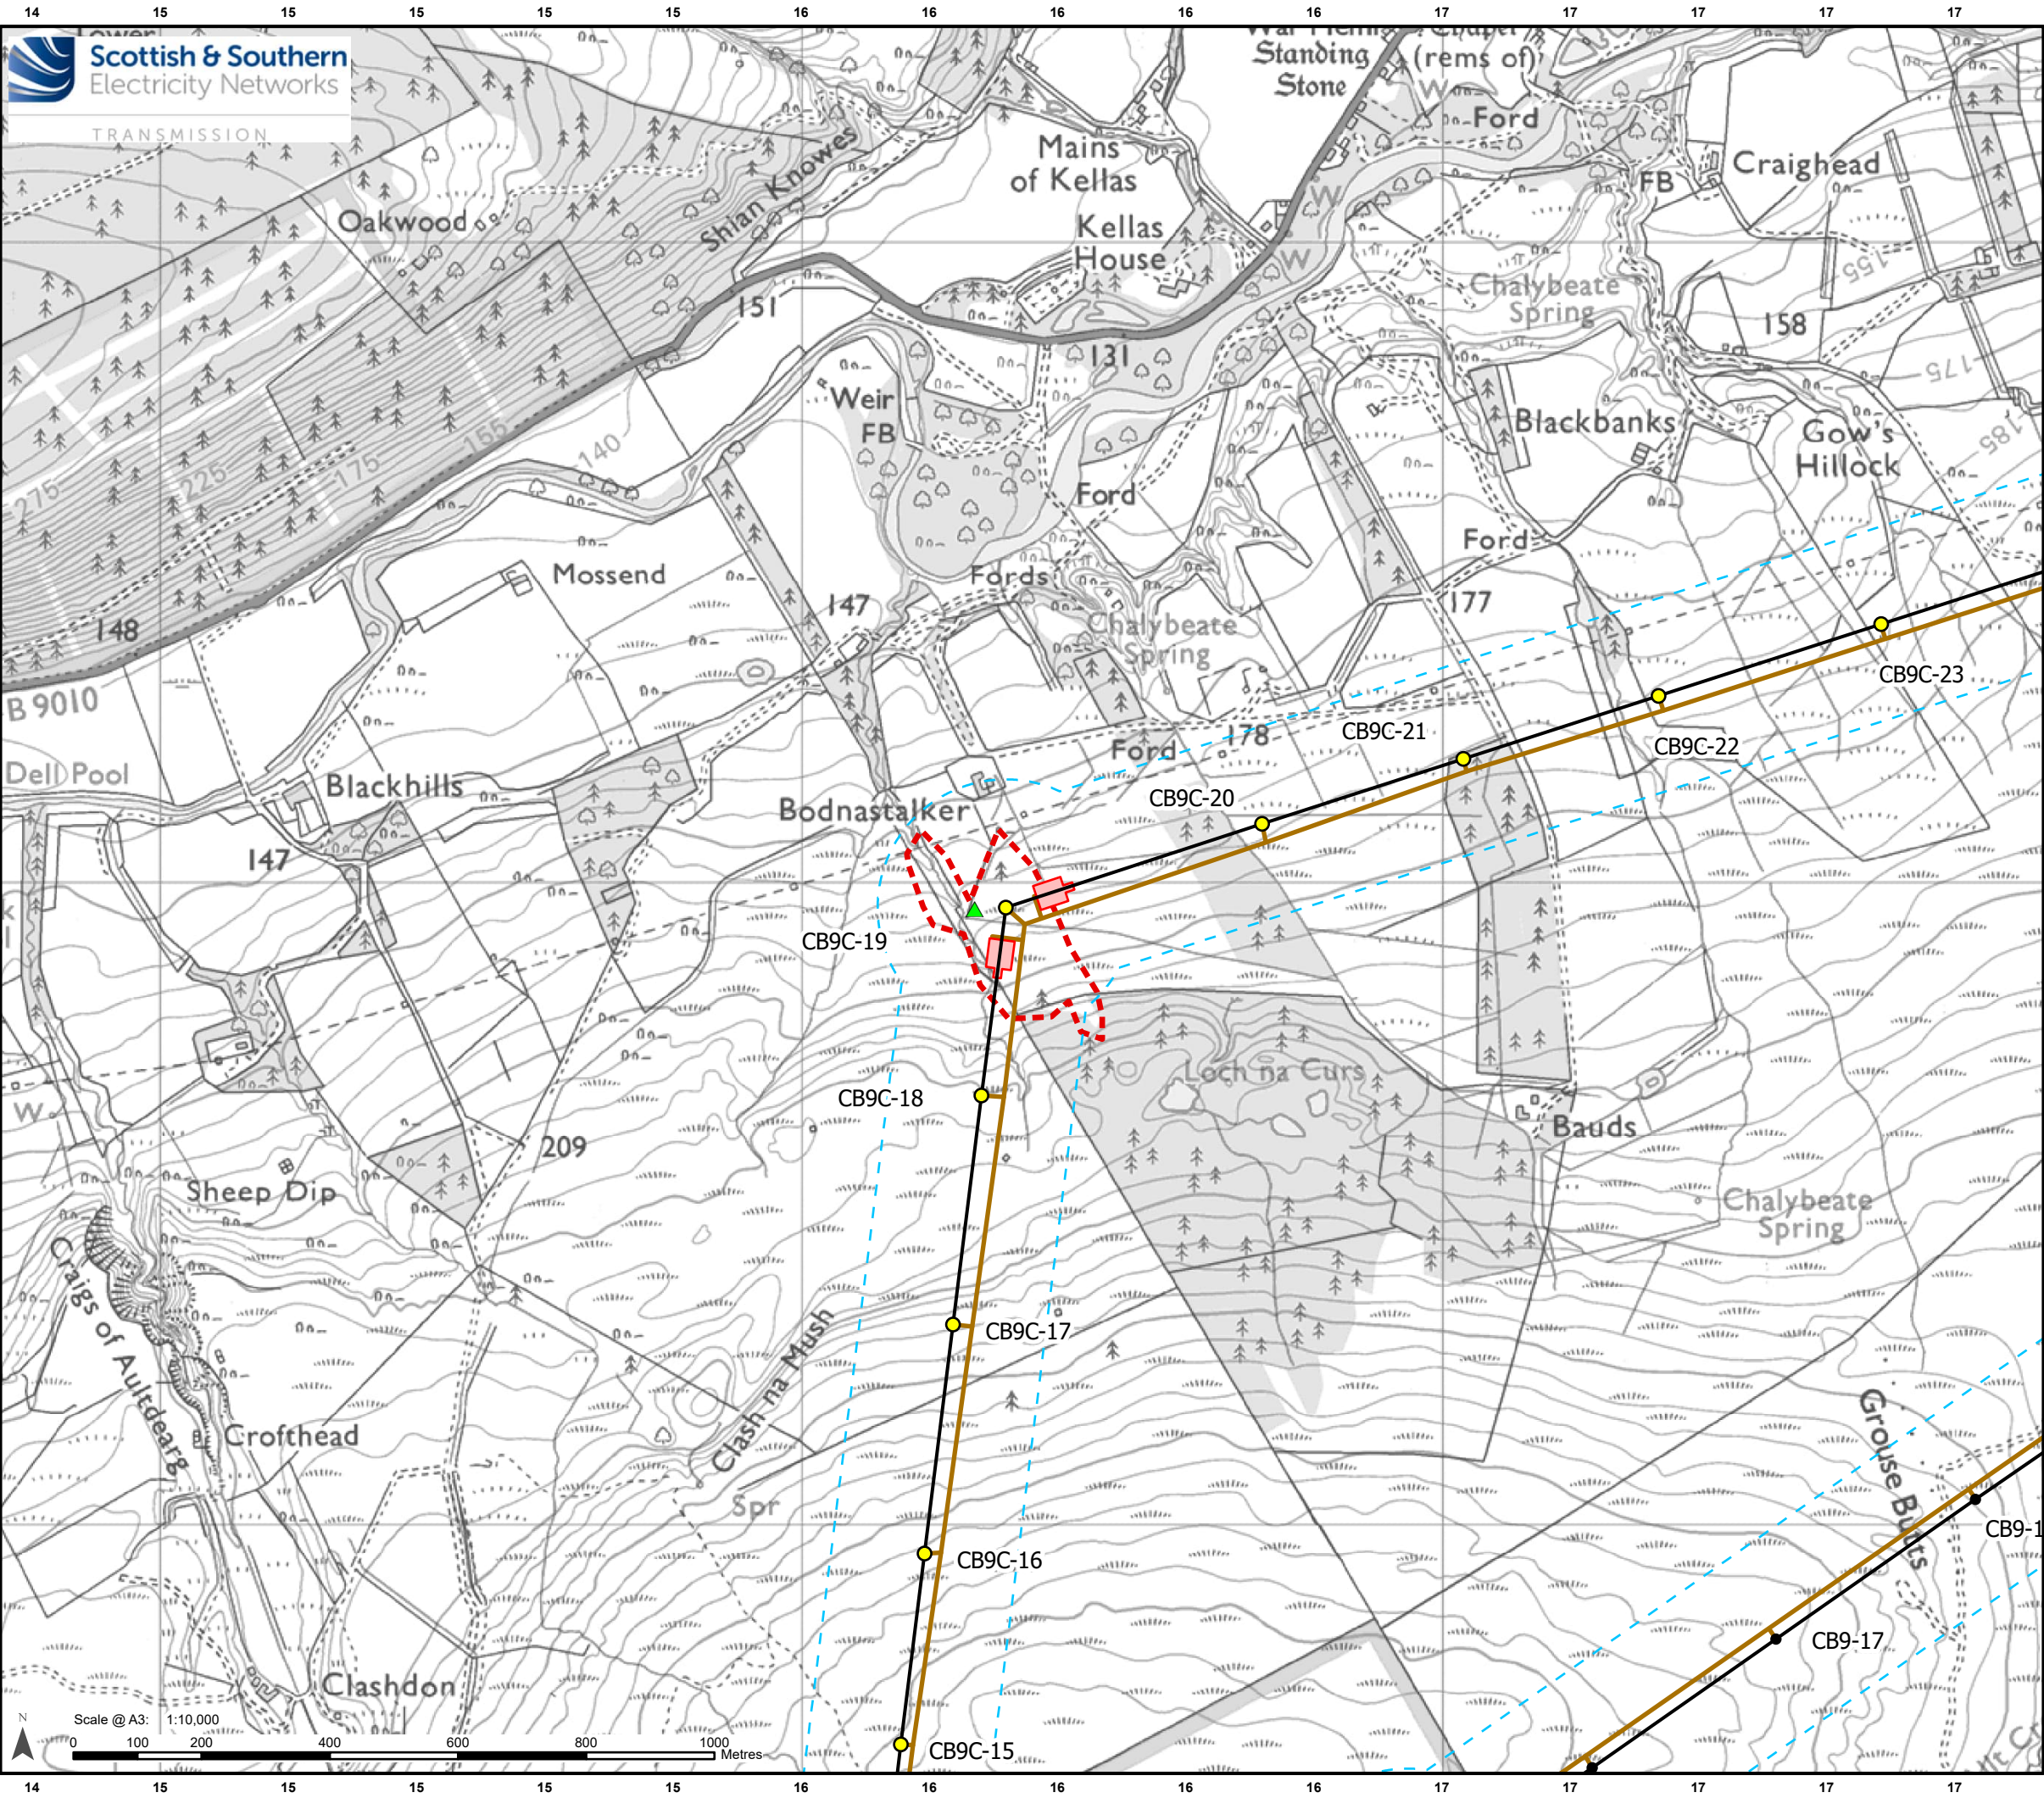

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey