

CB12-13A

CB12-14A

CB12-15A

CB12-16A

CB14-1B

CB14-2B

CB14-3A

CB14-4A

CB14-5

CB14-6A

Burnside
of Dipple

Eastertor
Cottage

Upper
Ordiquish

Castlehill
Farm

Castle
Hill

Ordiquish

FB

Burnside

Waterfall

Ford

Aultderg

Ordiequish
Hill

Tor Cast

Culfoldie

Craigs of
Culdell

Wood of

Scale @ A3: 1:10,000
0 100 200 400 600 800 1000 Metres

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area


- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree

Suitability

- Potential Roost Feature (PRF)
- Further Assessment Required (FAR)

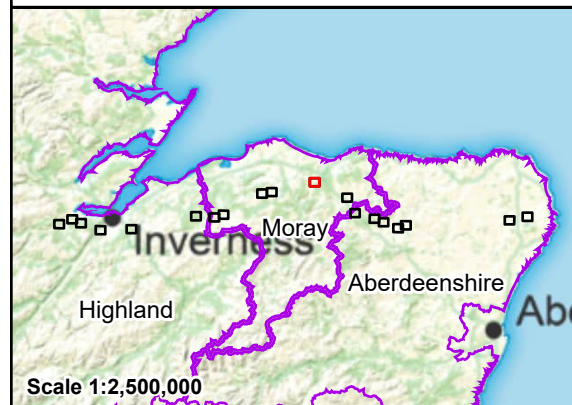


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 11 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

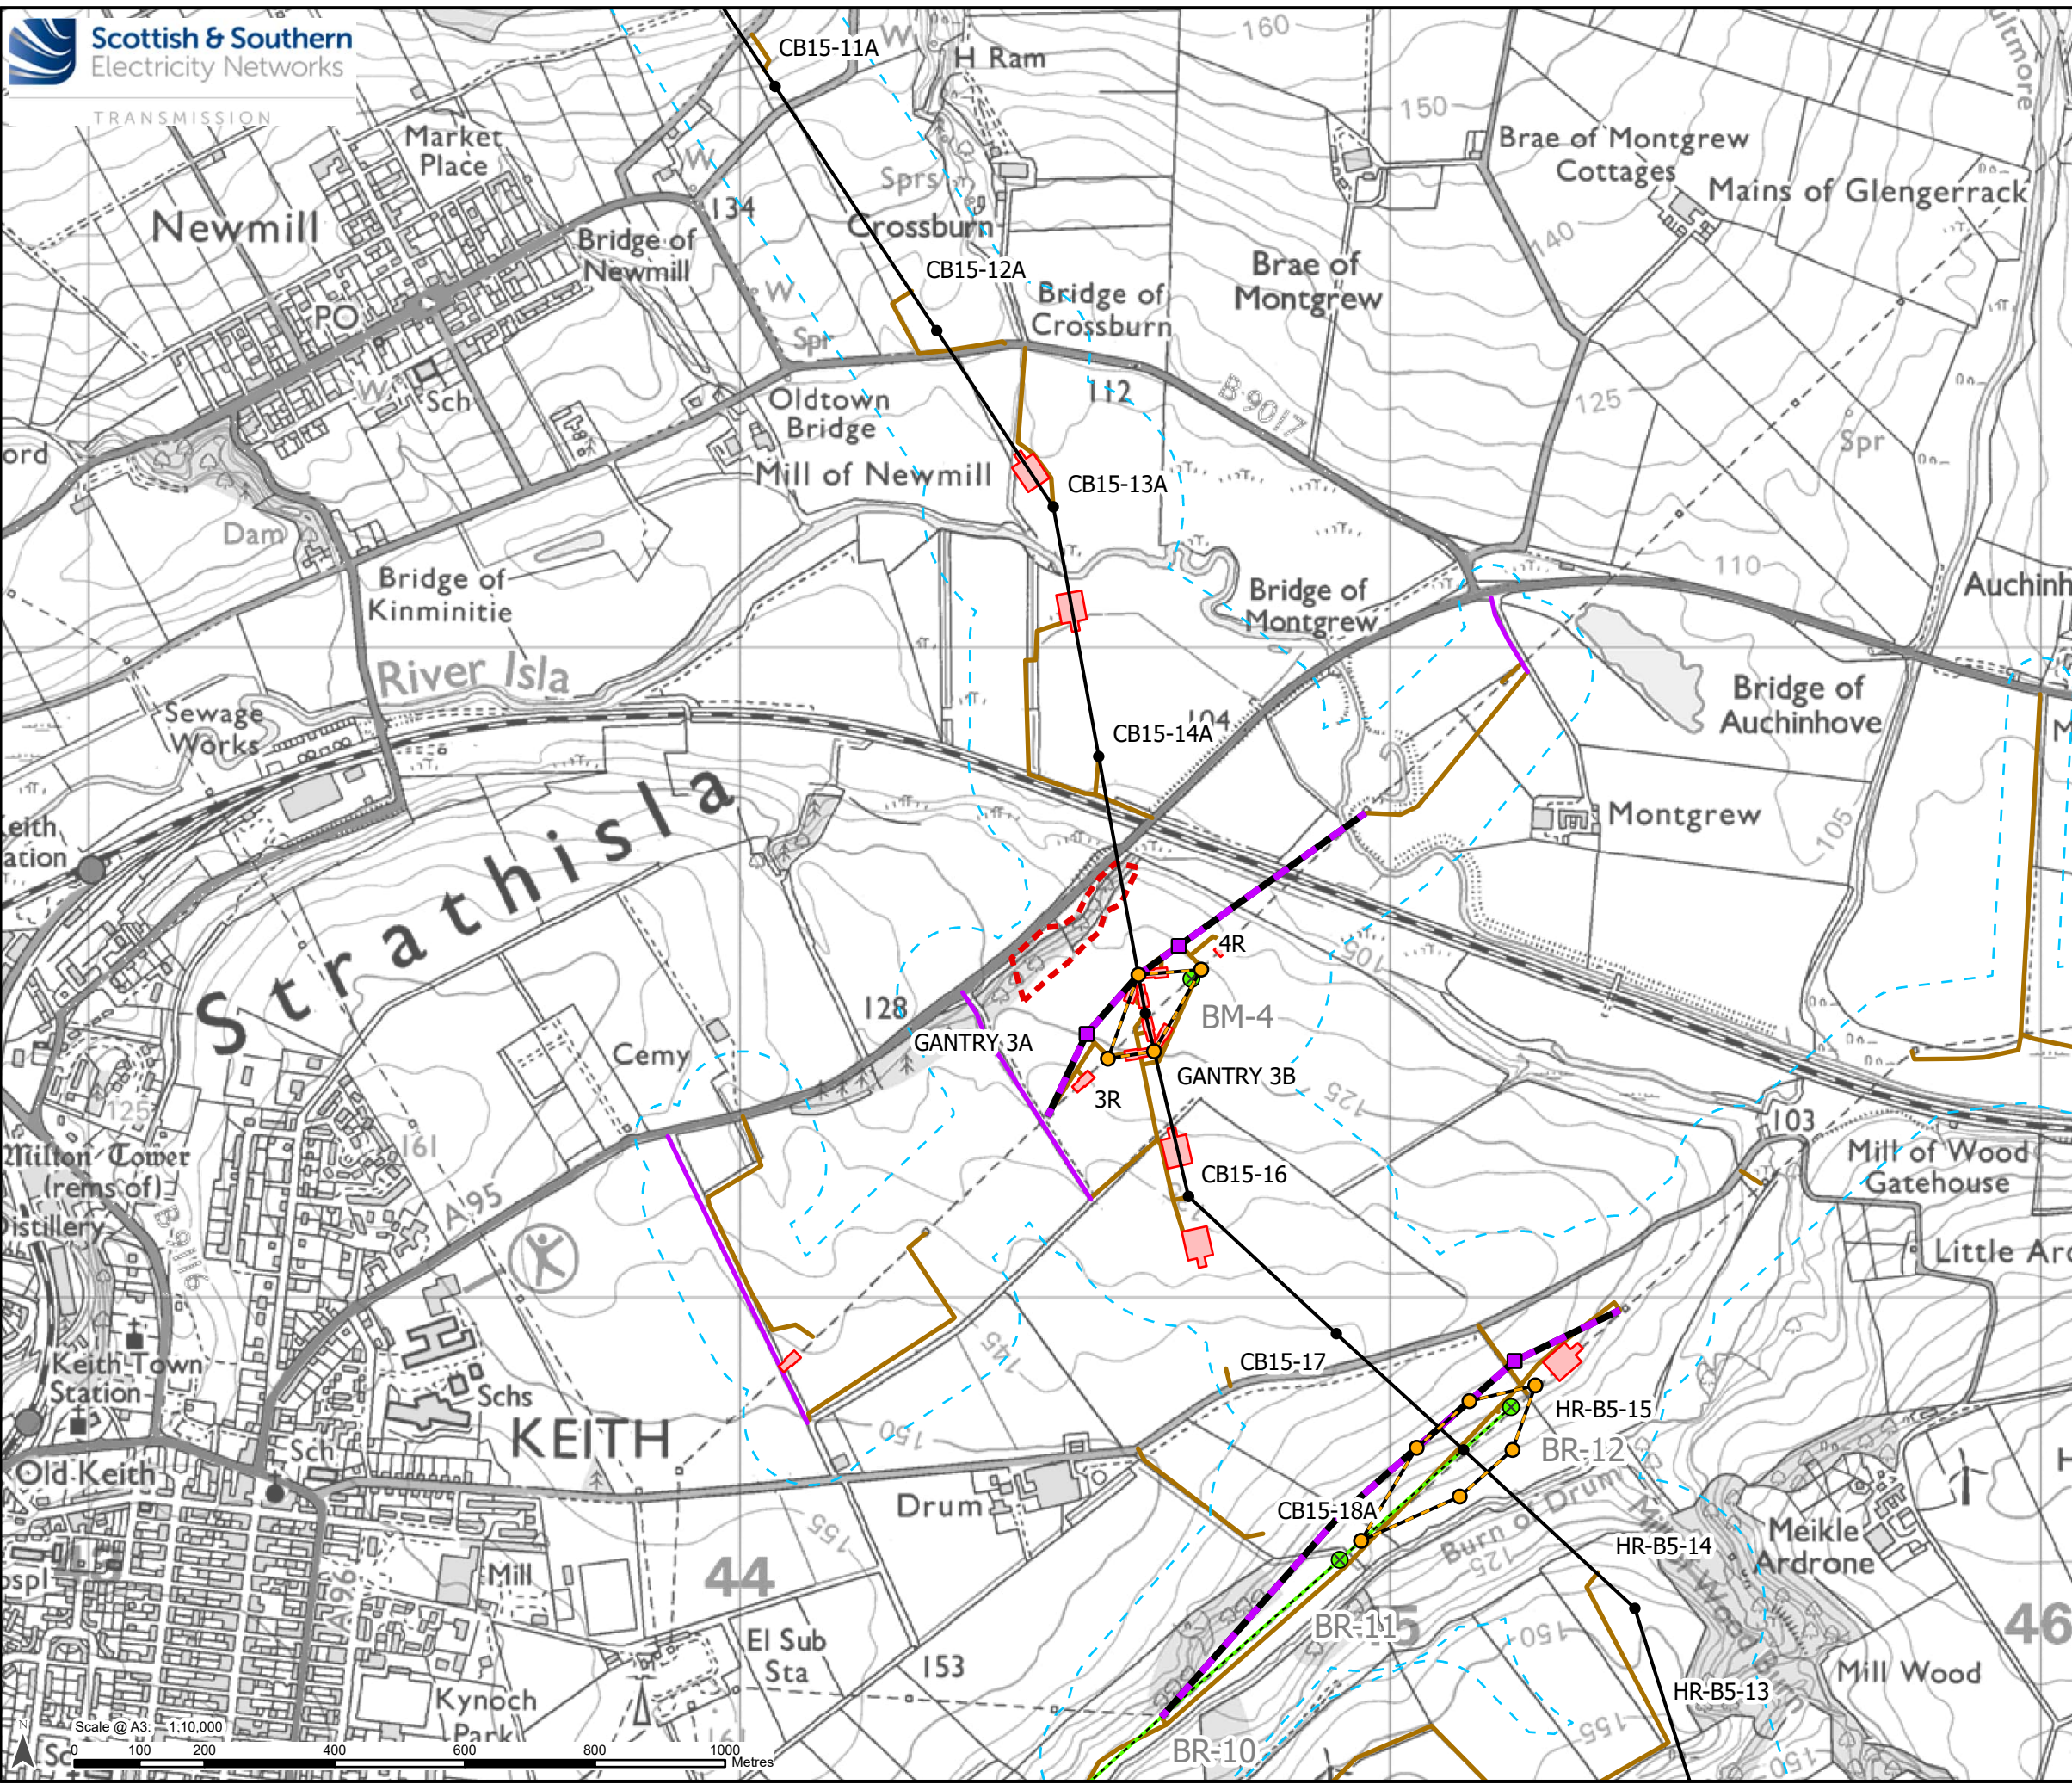

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary


Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/ Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

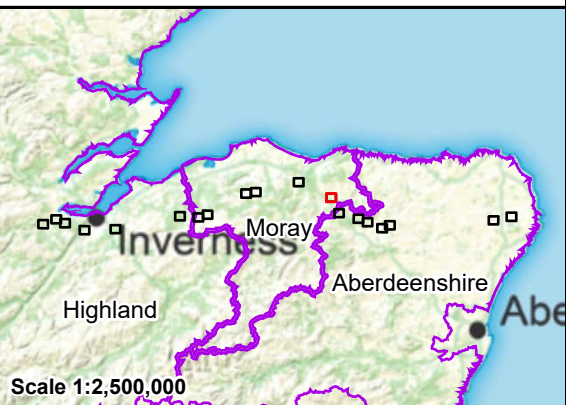

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 12 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

TRANSMISSION

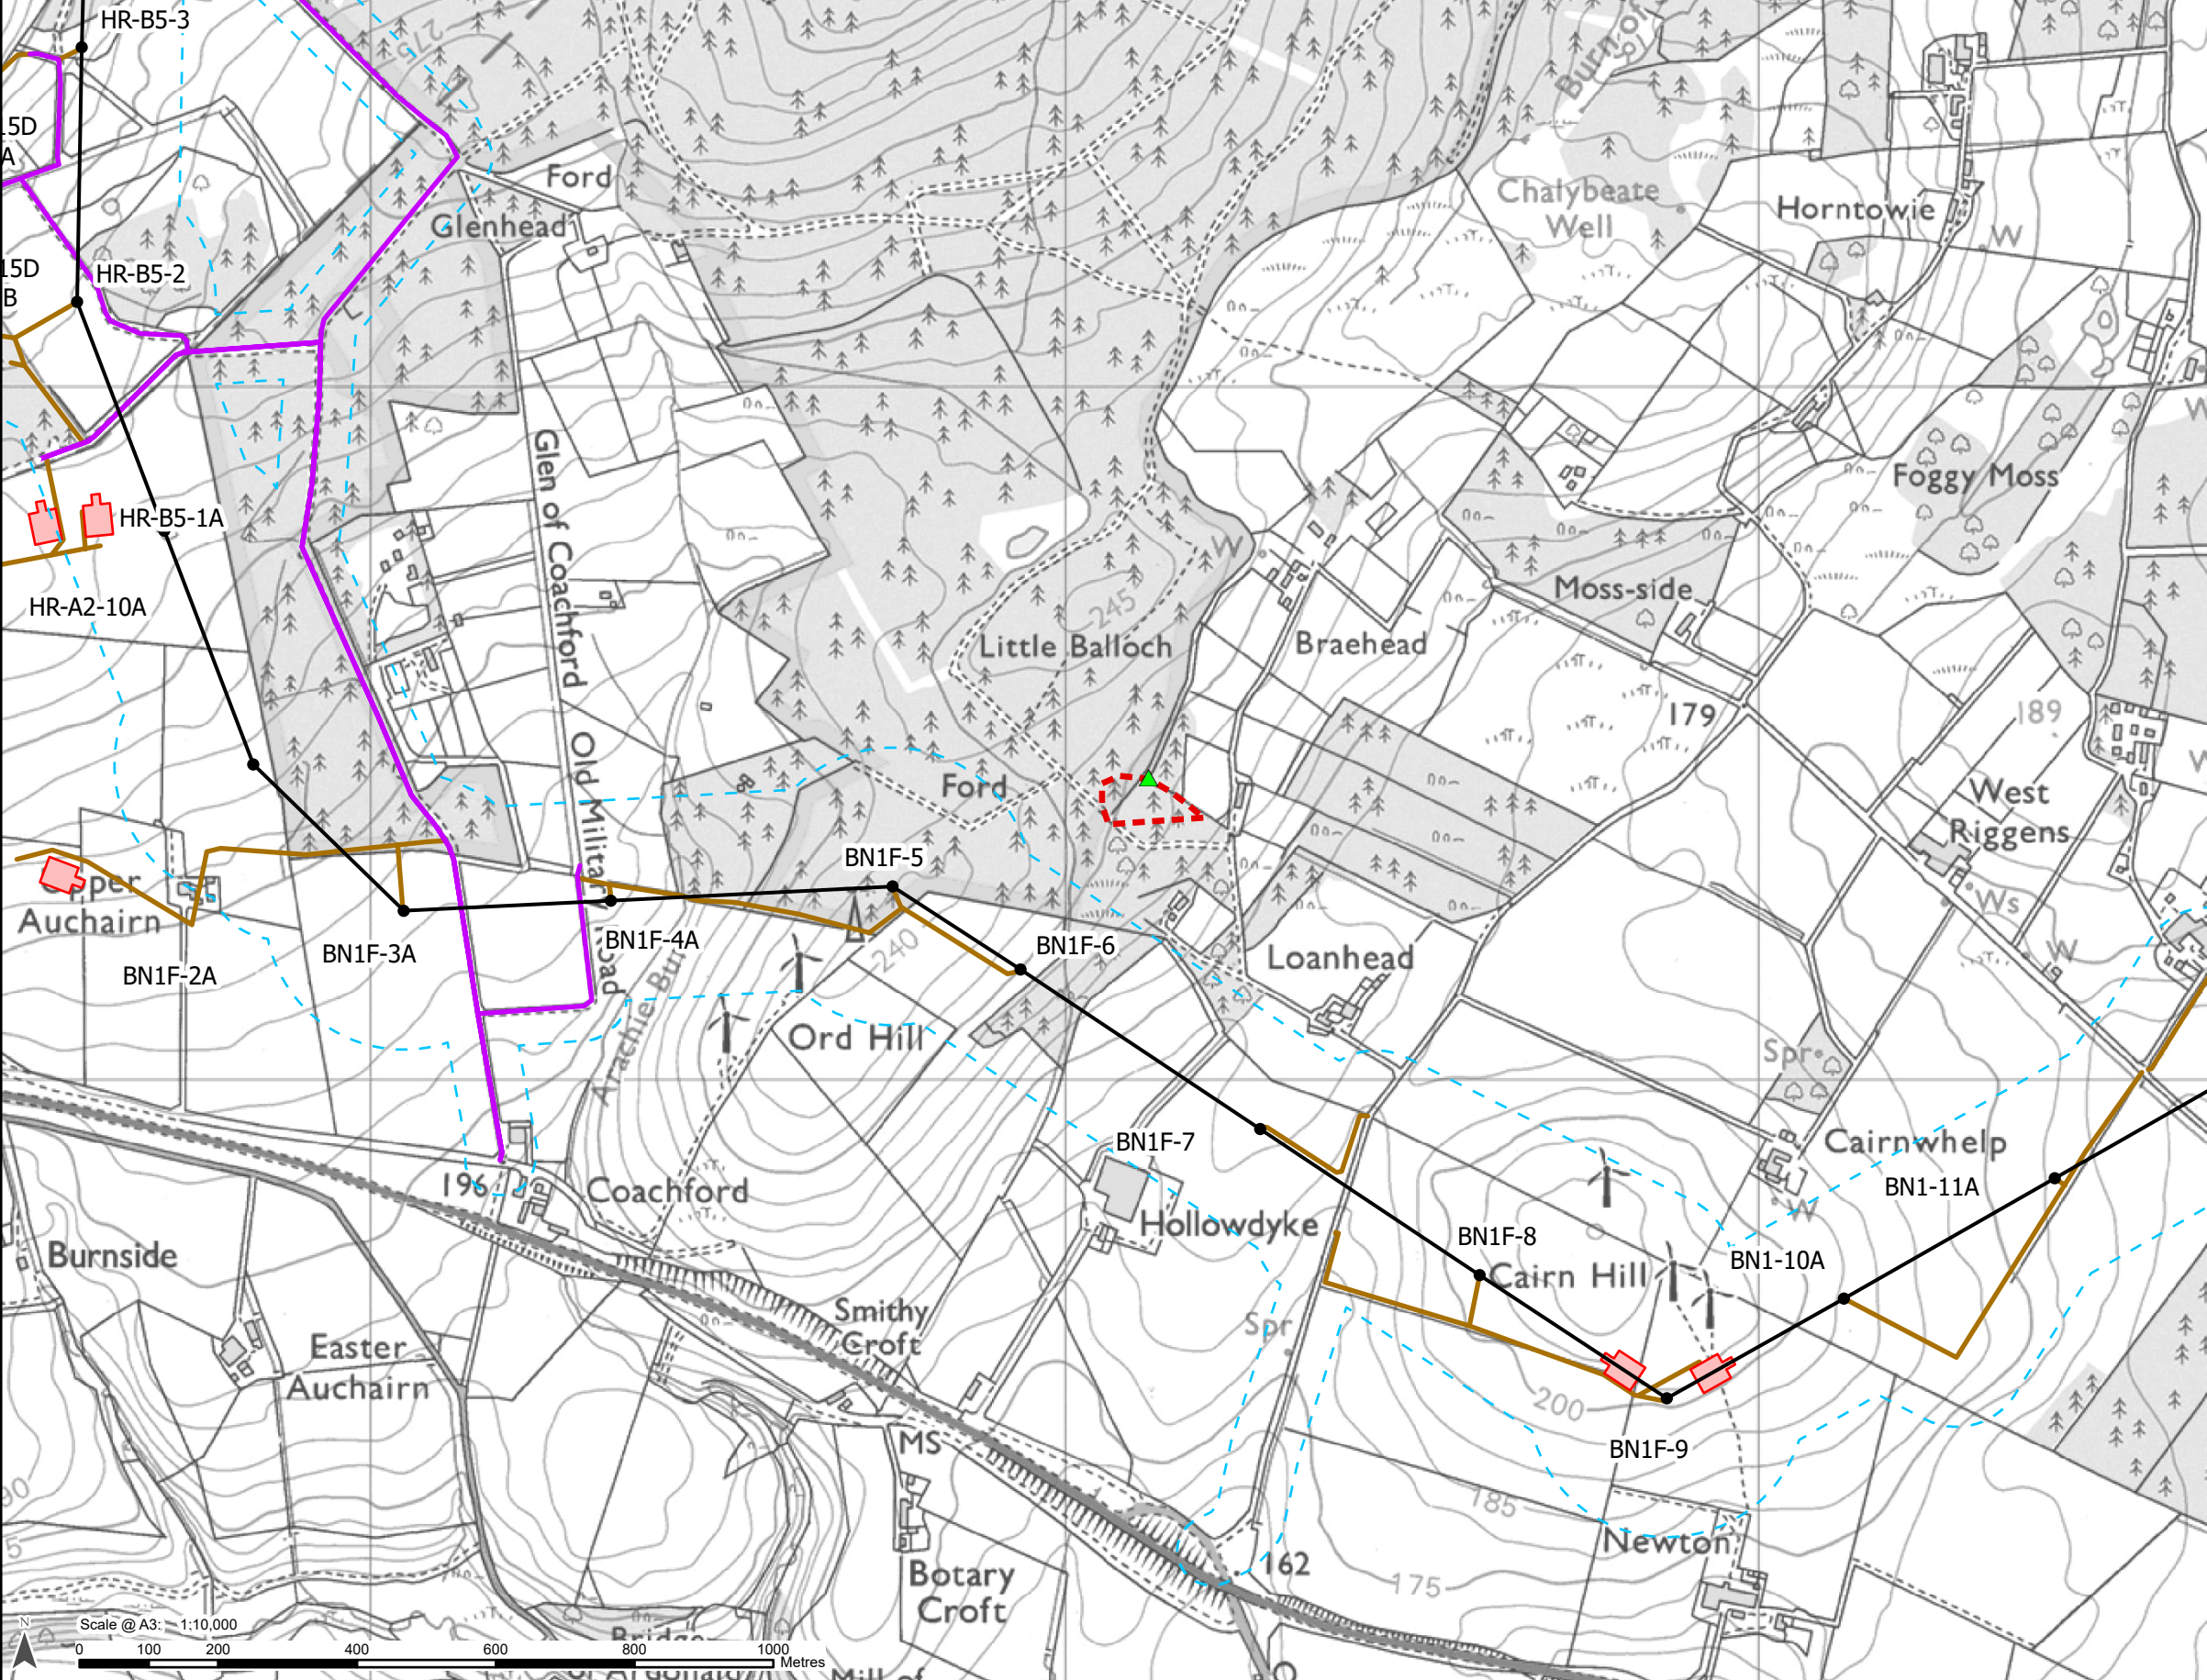

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/ Permanent)
- Existing Access Upgrade

Species Survey Area


- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree

Suitability

- Potential Roost Feature (PRF)

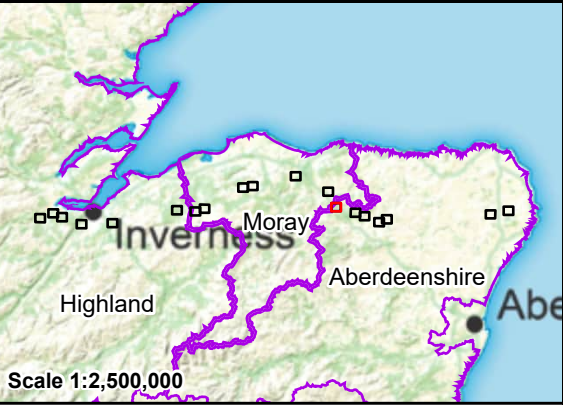


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 13 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

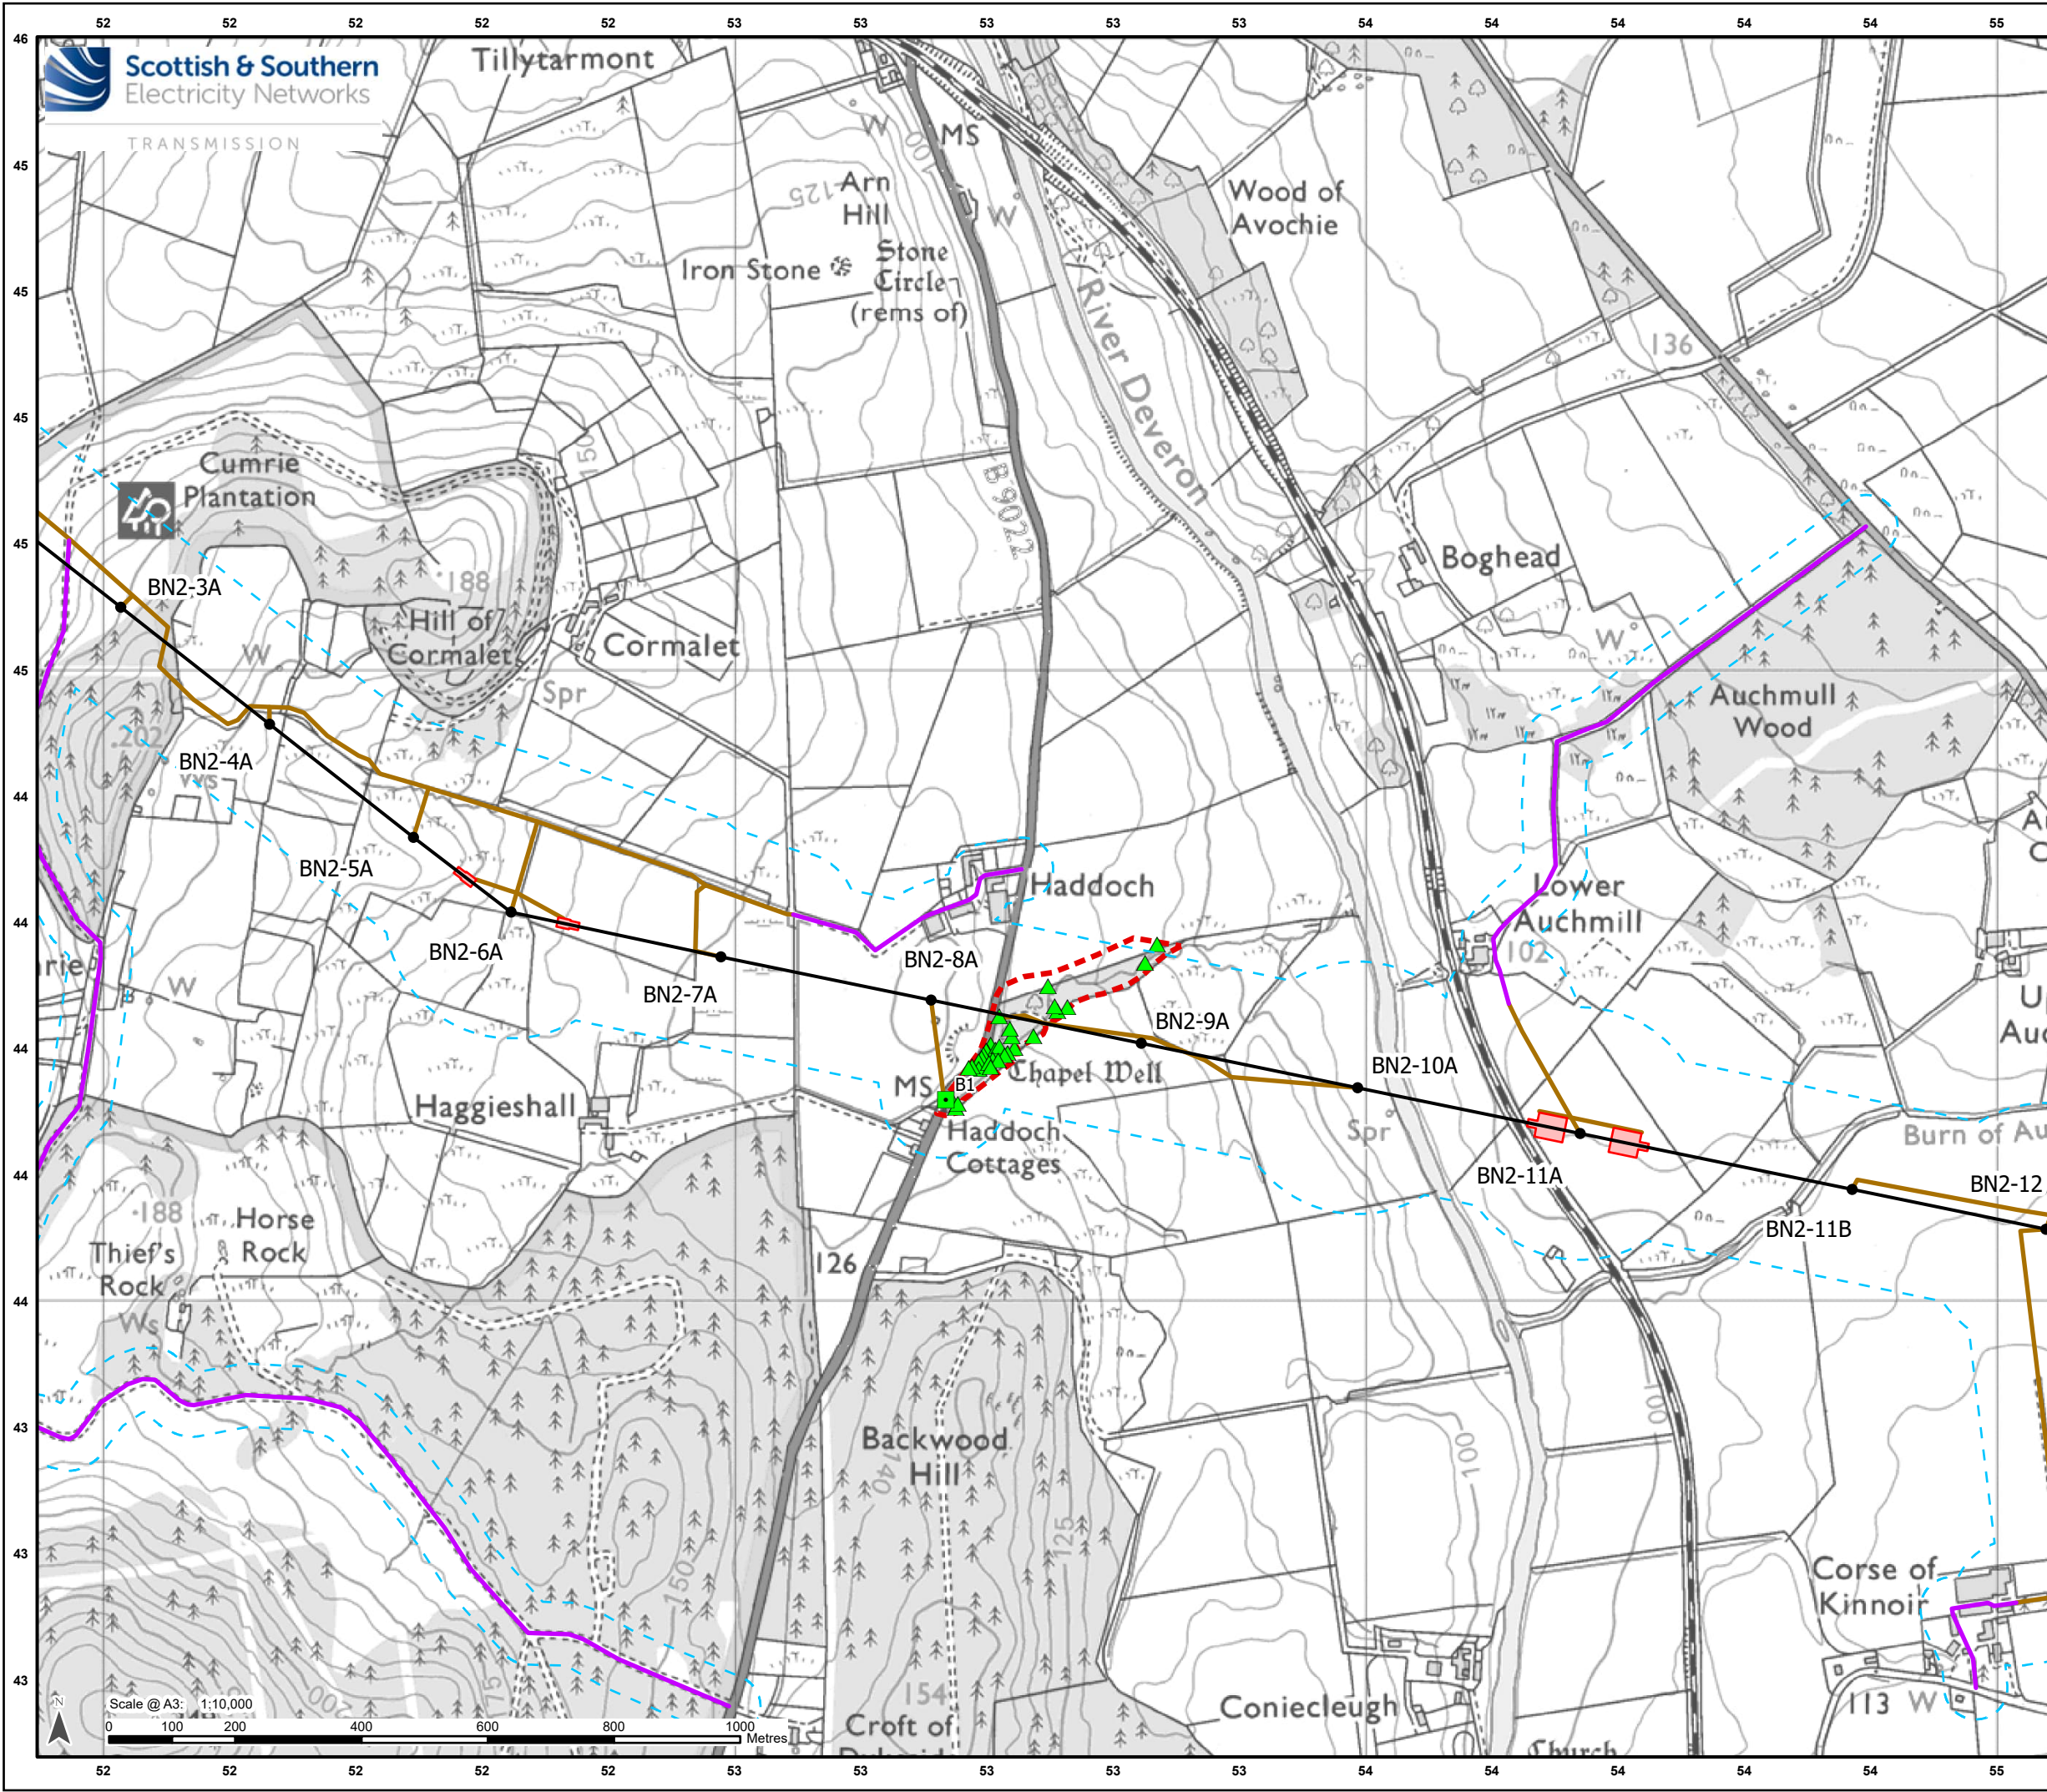

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Bridge

PRF Suitability

- Moderate

Tree

Suitability

- Potential Roost Feature (PRF)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 14 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

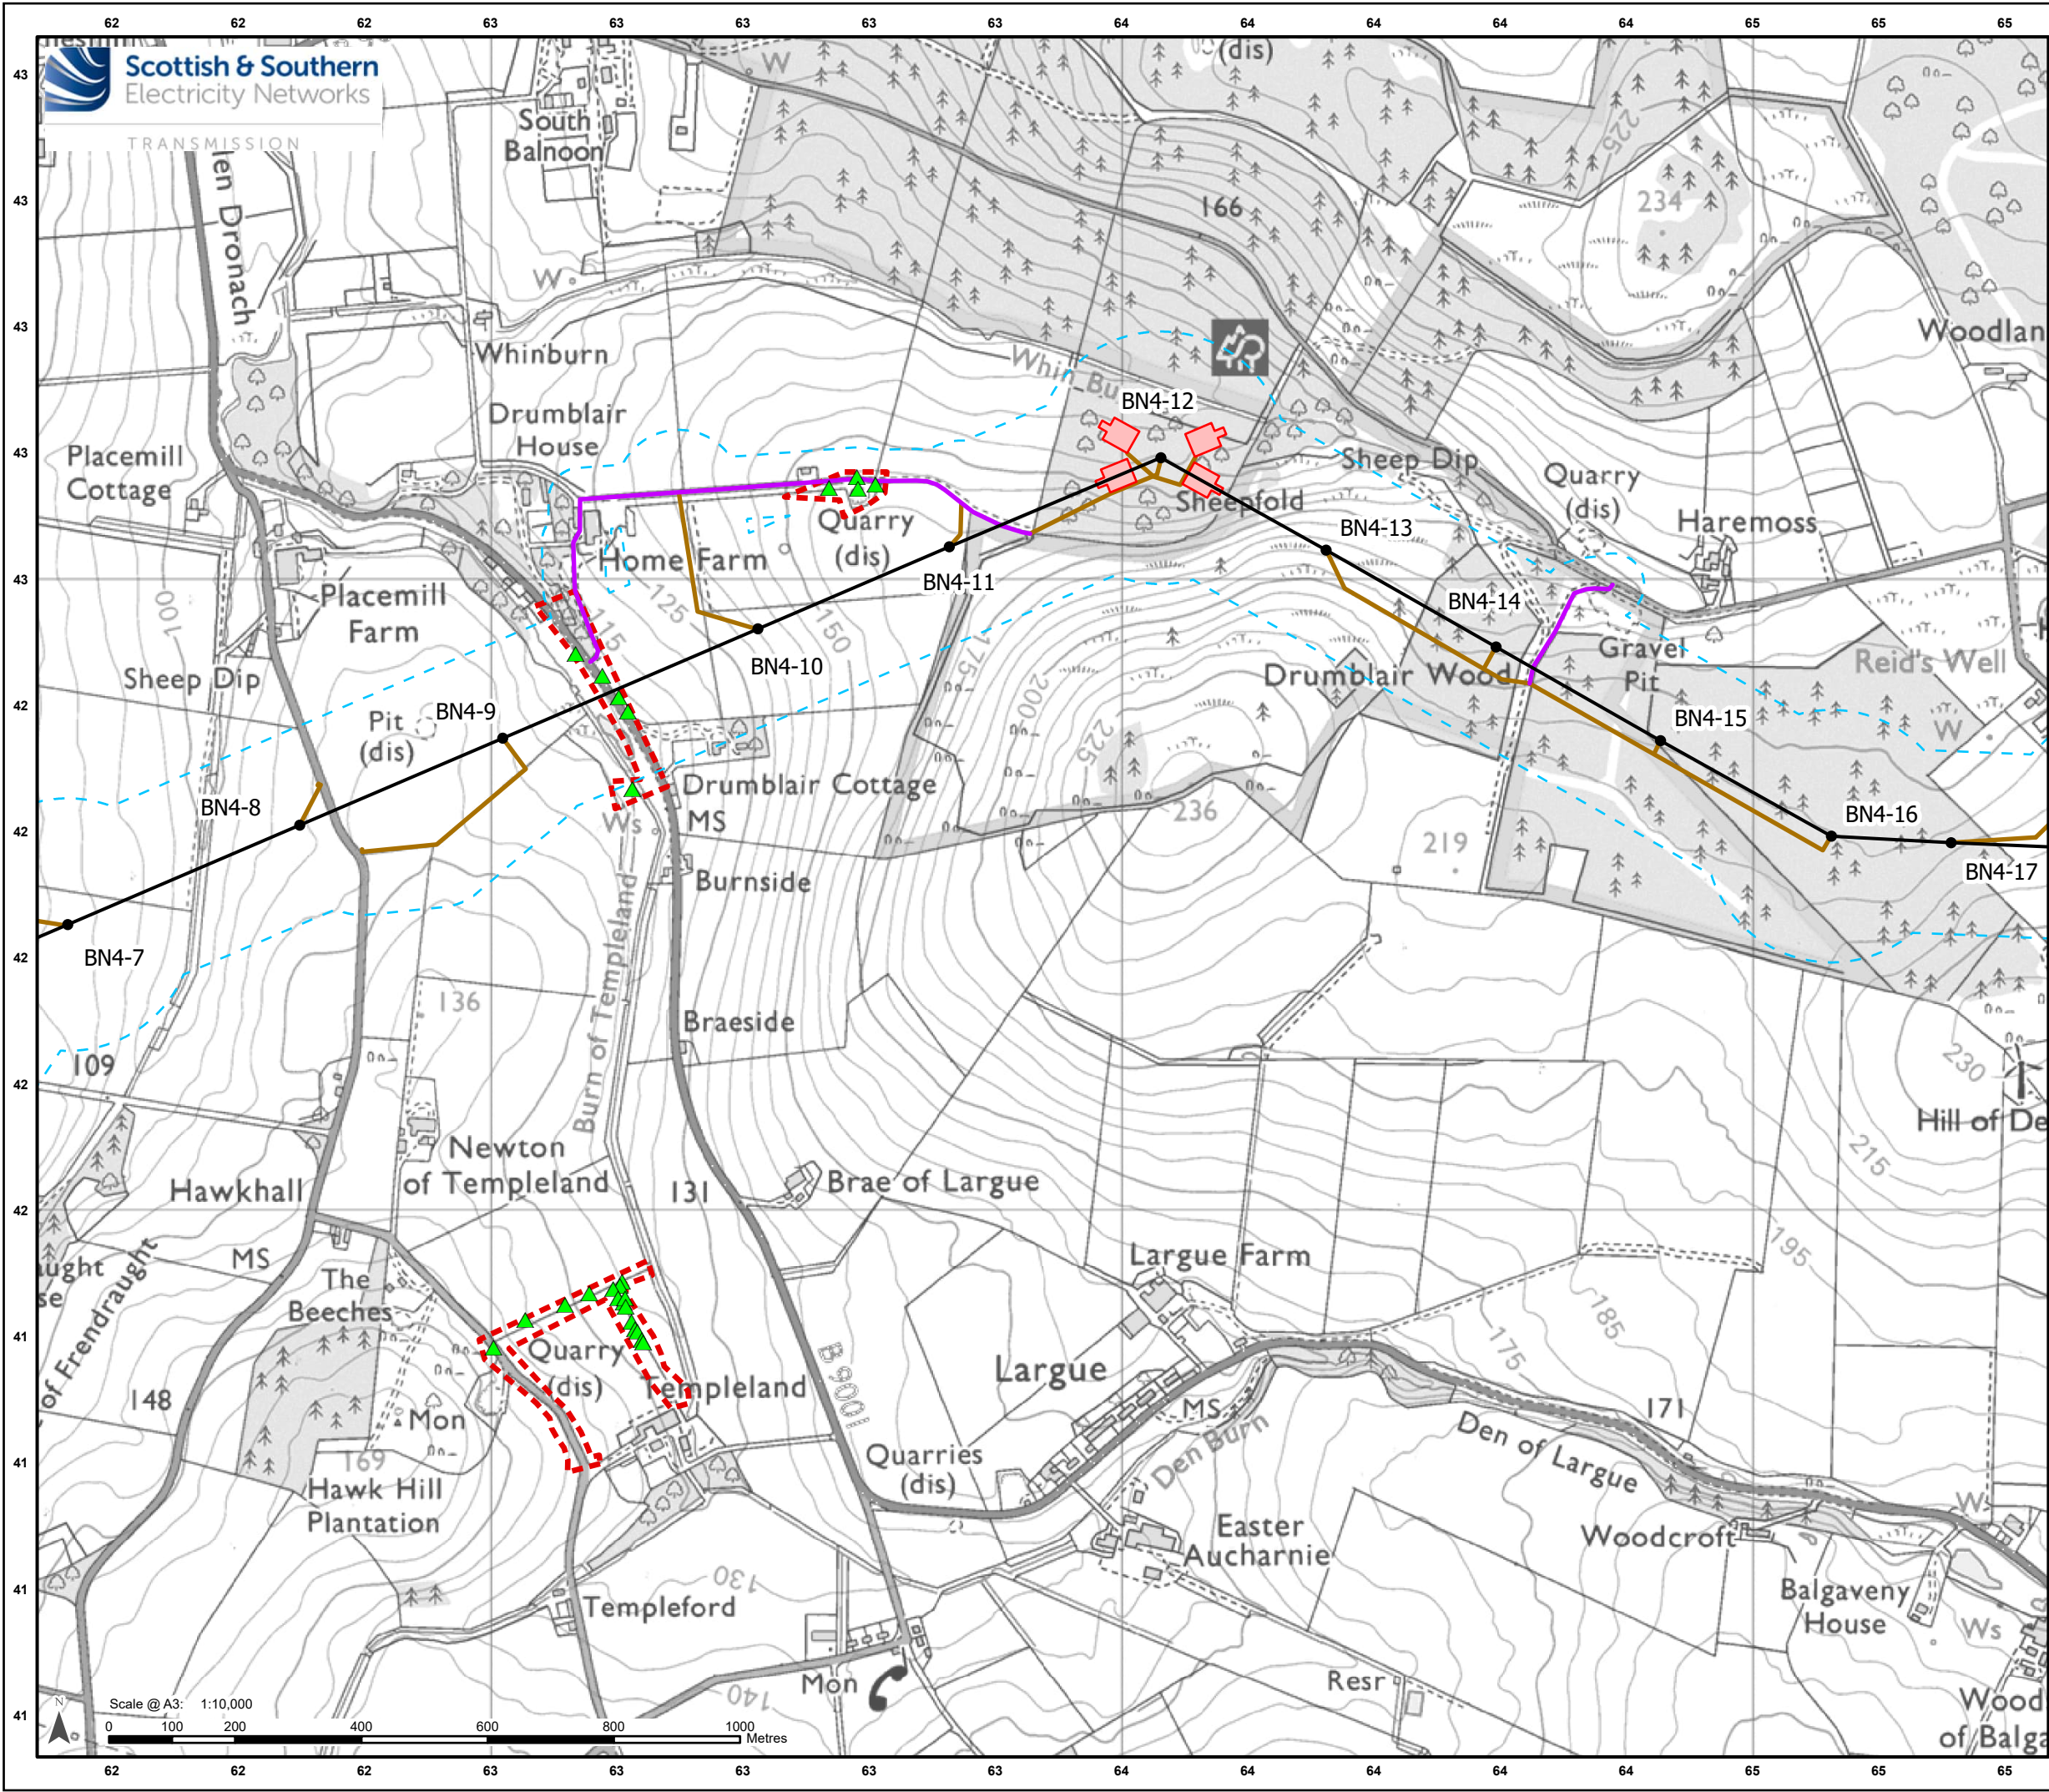

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Daytime Bat Walkover (DBW) Result

Tree Suitability

- Potential Roost Feature (PRF)

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.3 – Initial Bat Survey Results
Page 17 of 19

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-082

