




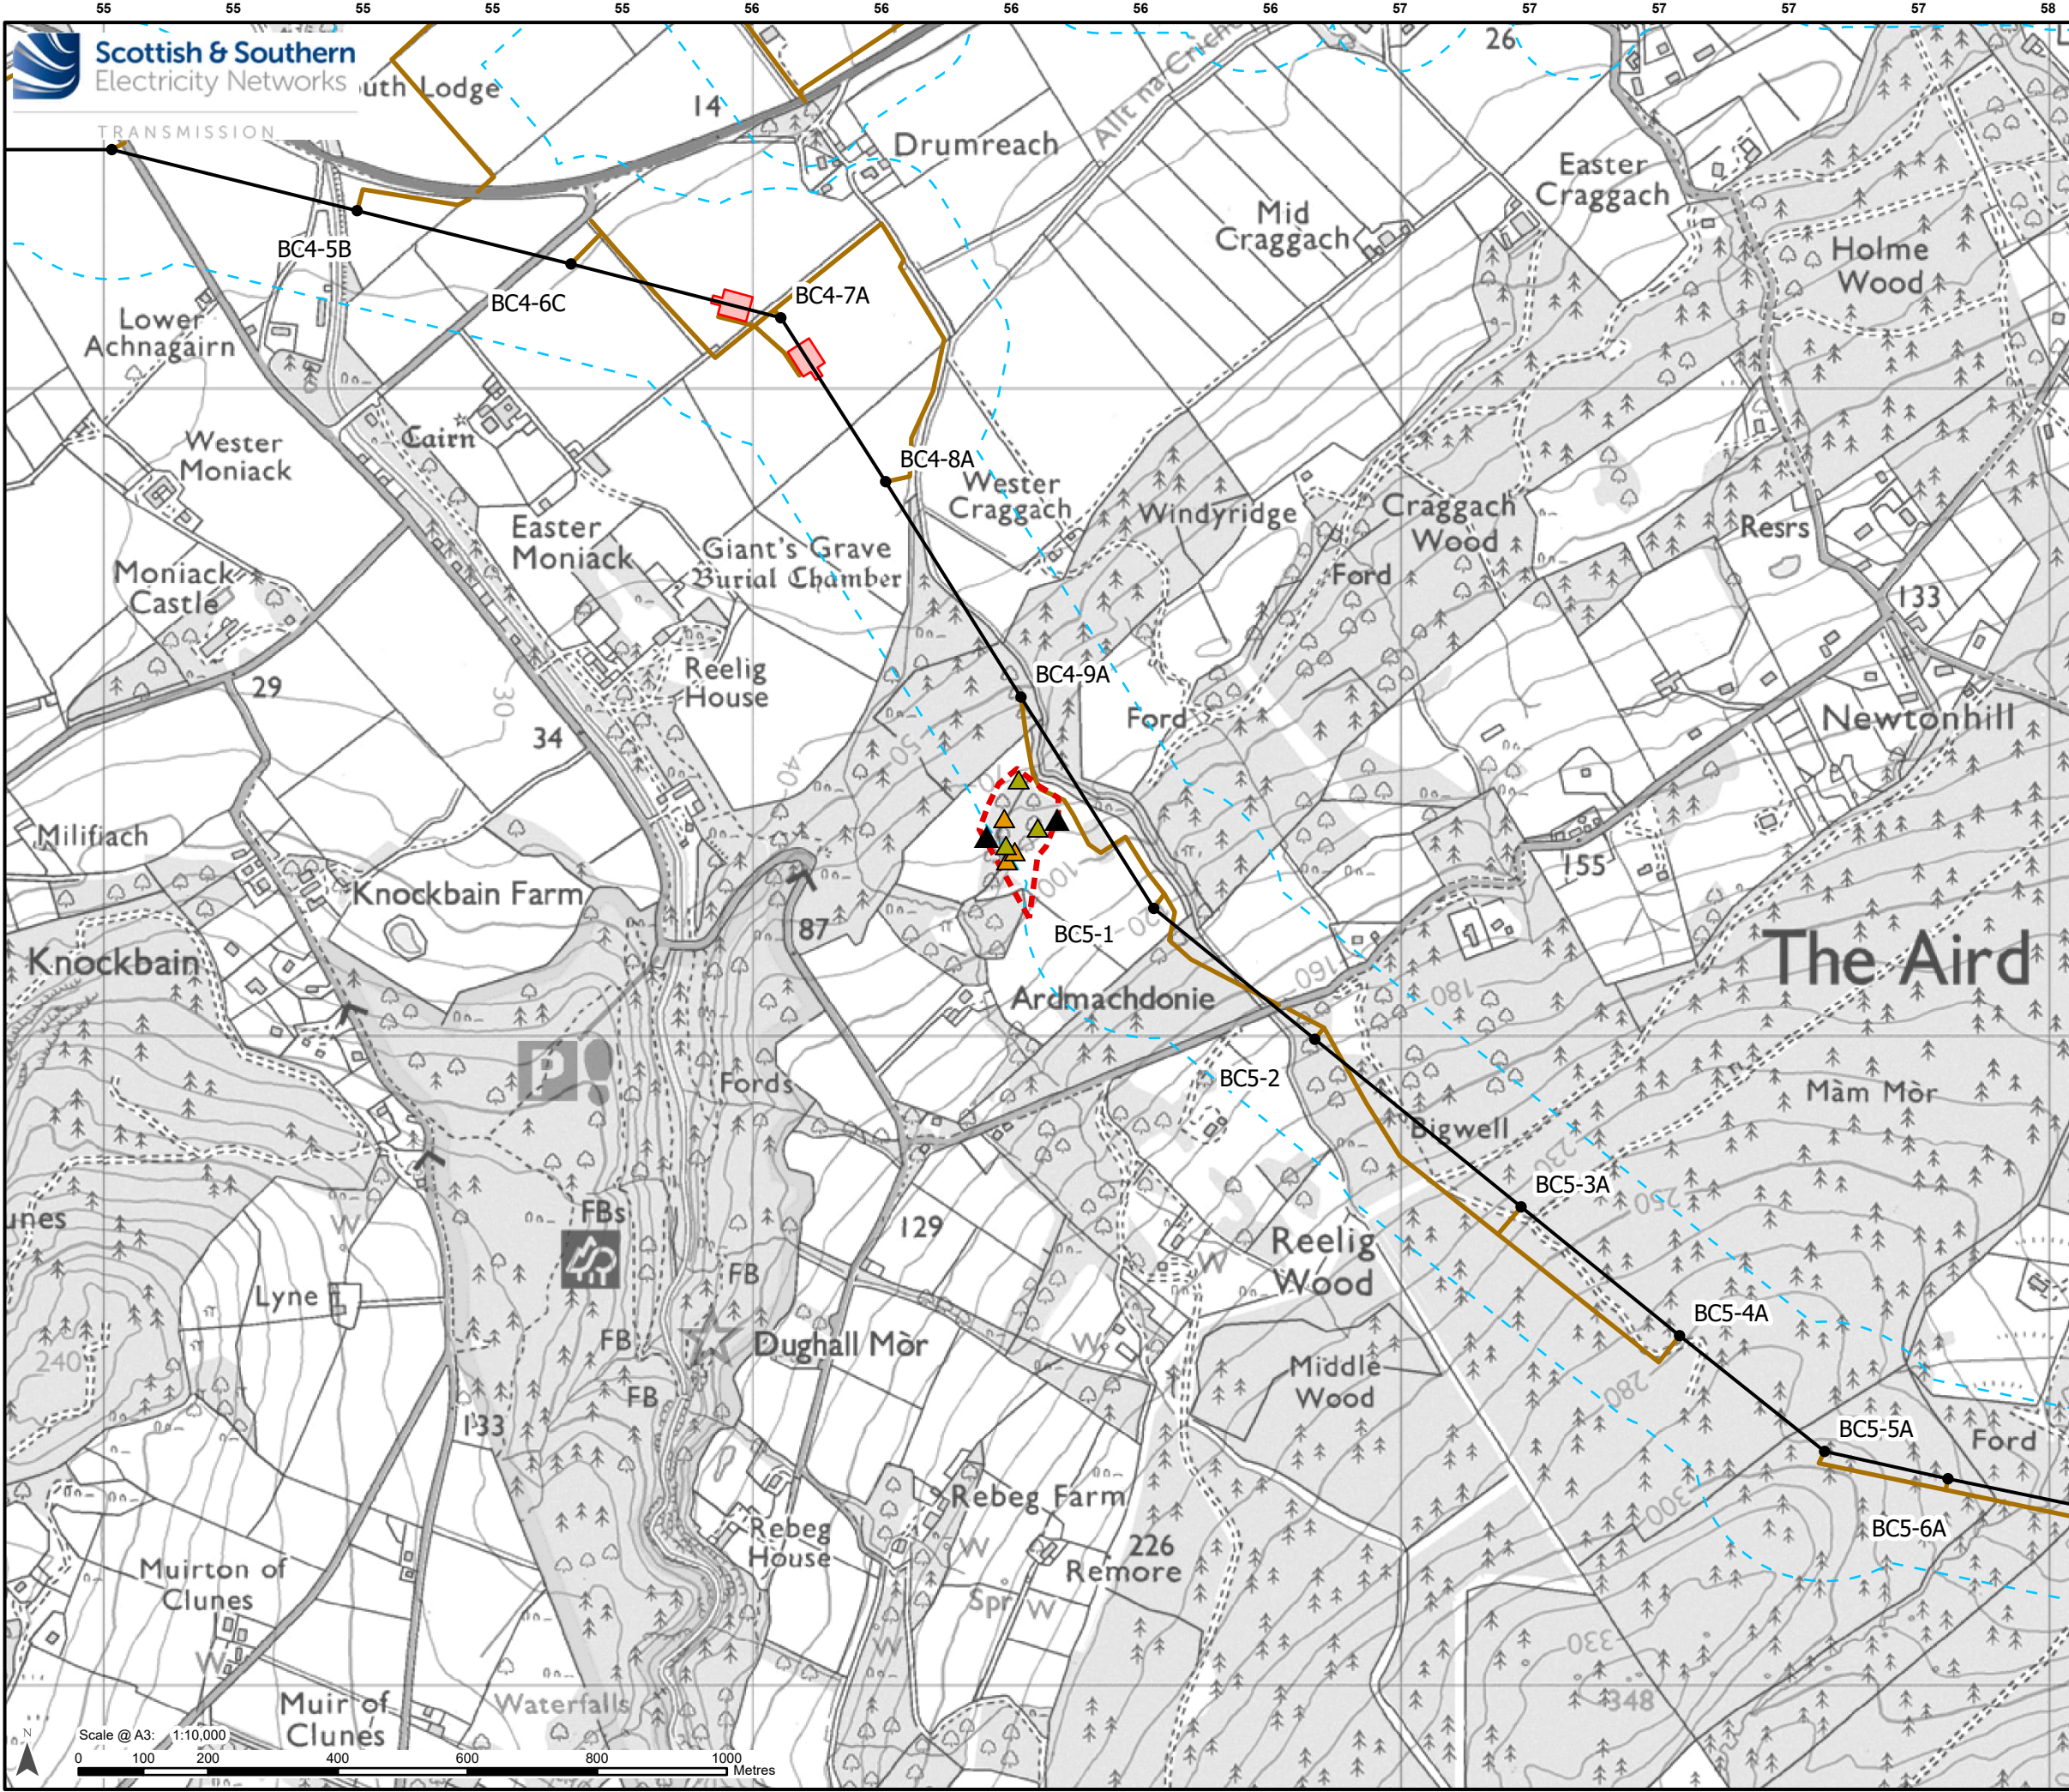

### Legend

**Development for which Section 37 Consent is Sought**

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

**Ancillary Development**

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)

**Species Survey Area**

- Bat Survey Area

**Further Bat Survey Result**

- Automated Static Detector Location

**Potential Roost Feature (PRF) Inspection Survey Result**

- None
- PRF - Individual

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                   |       |            |
|-----------|-------------------------------------------------------------------|-------|------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project |       |            |
| Title:    | Figure 8.1.4 - Further Bat Survey Results<br>Page 2 of 12         |       |            |
| Drawn by: | MAL                                                               | Date: | 31/07/2025 |
| Drawing:  | B2P-WSP-DA-70092380-083                                           |       |            |







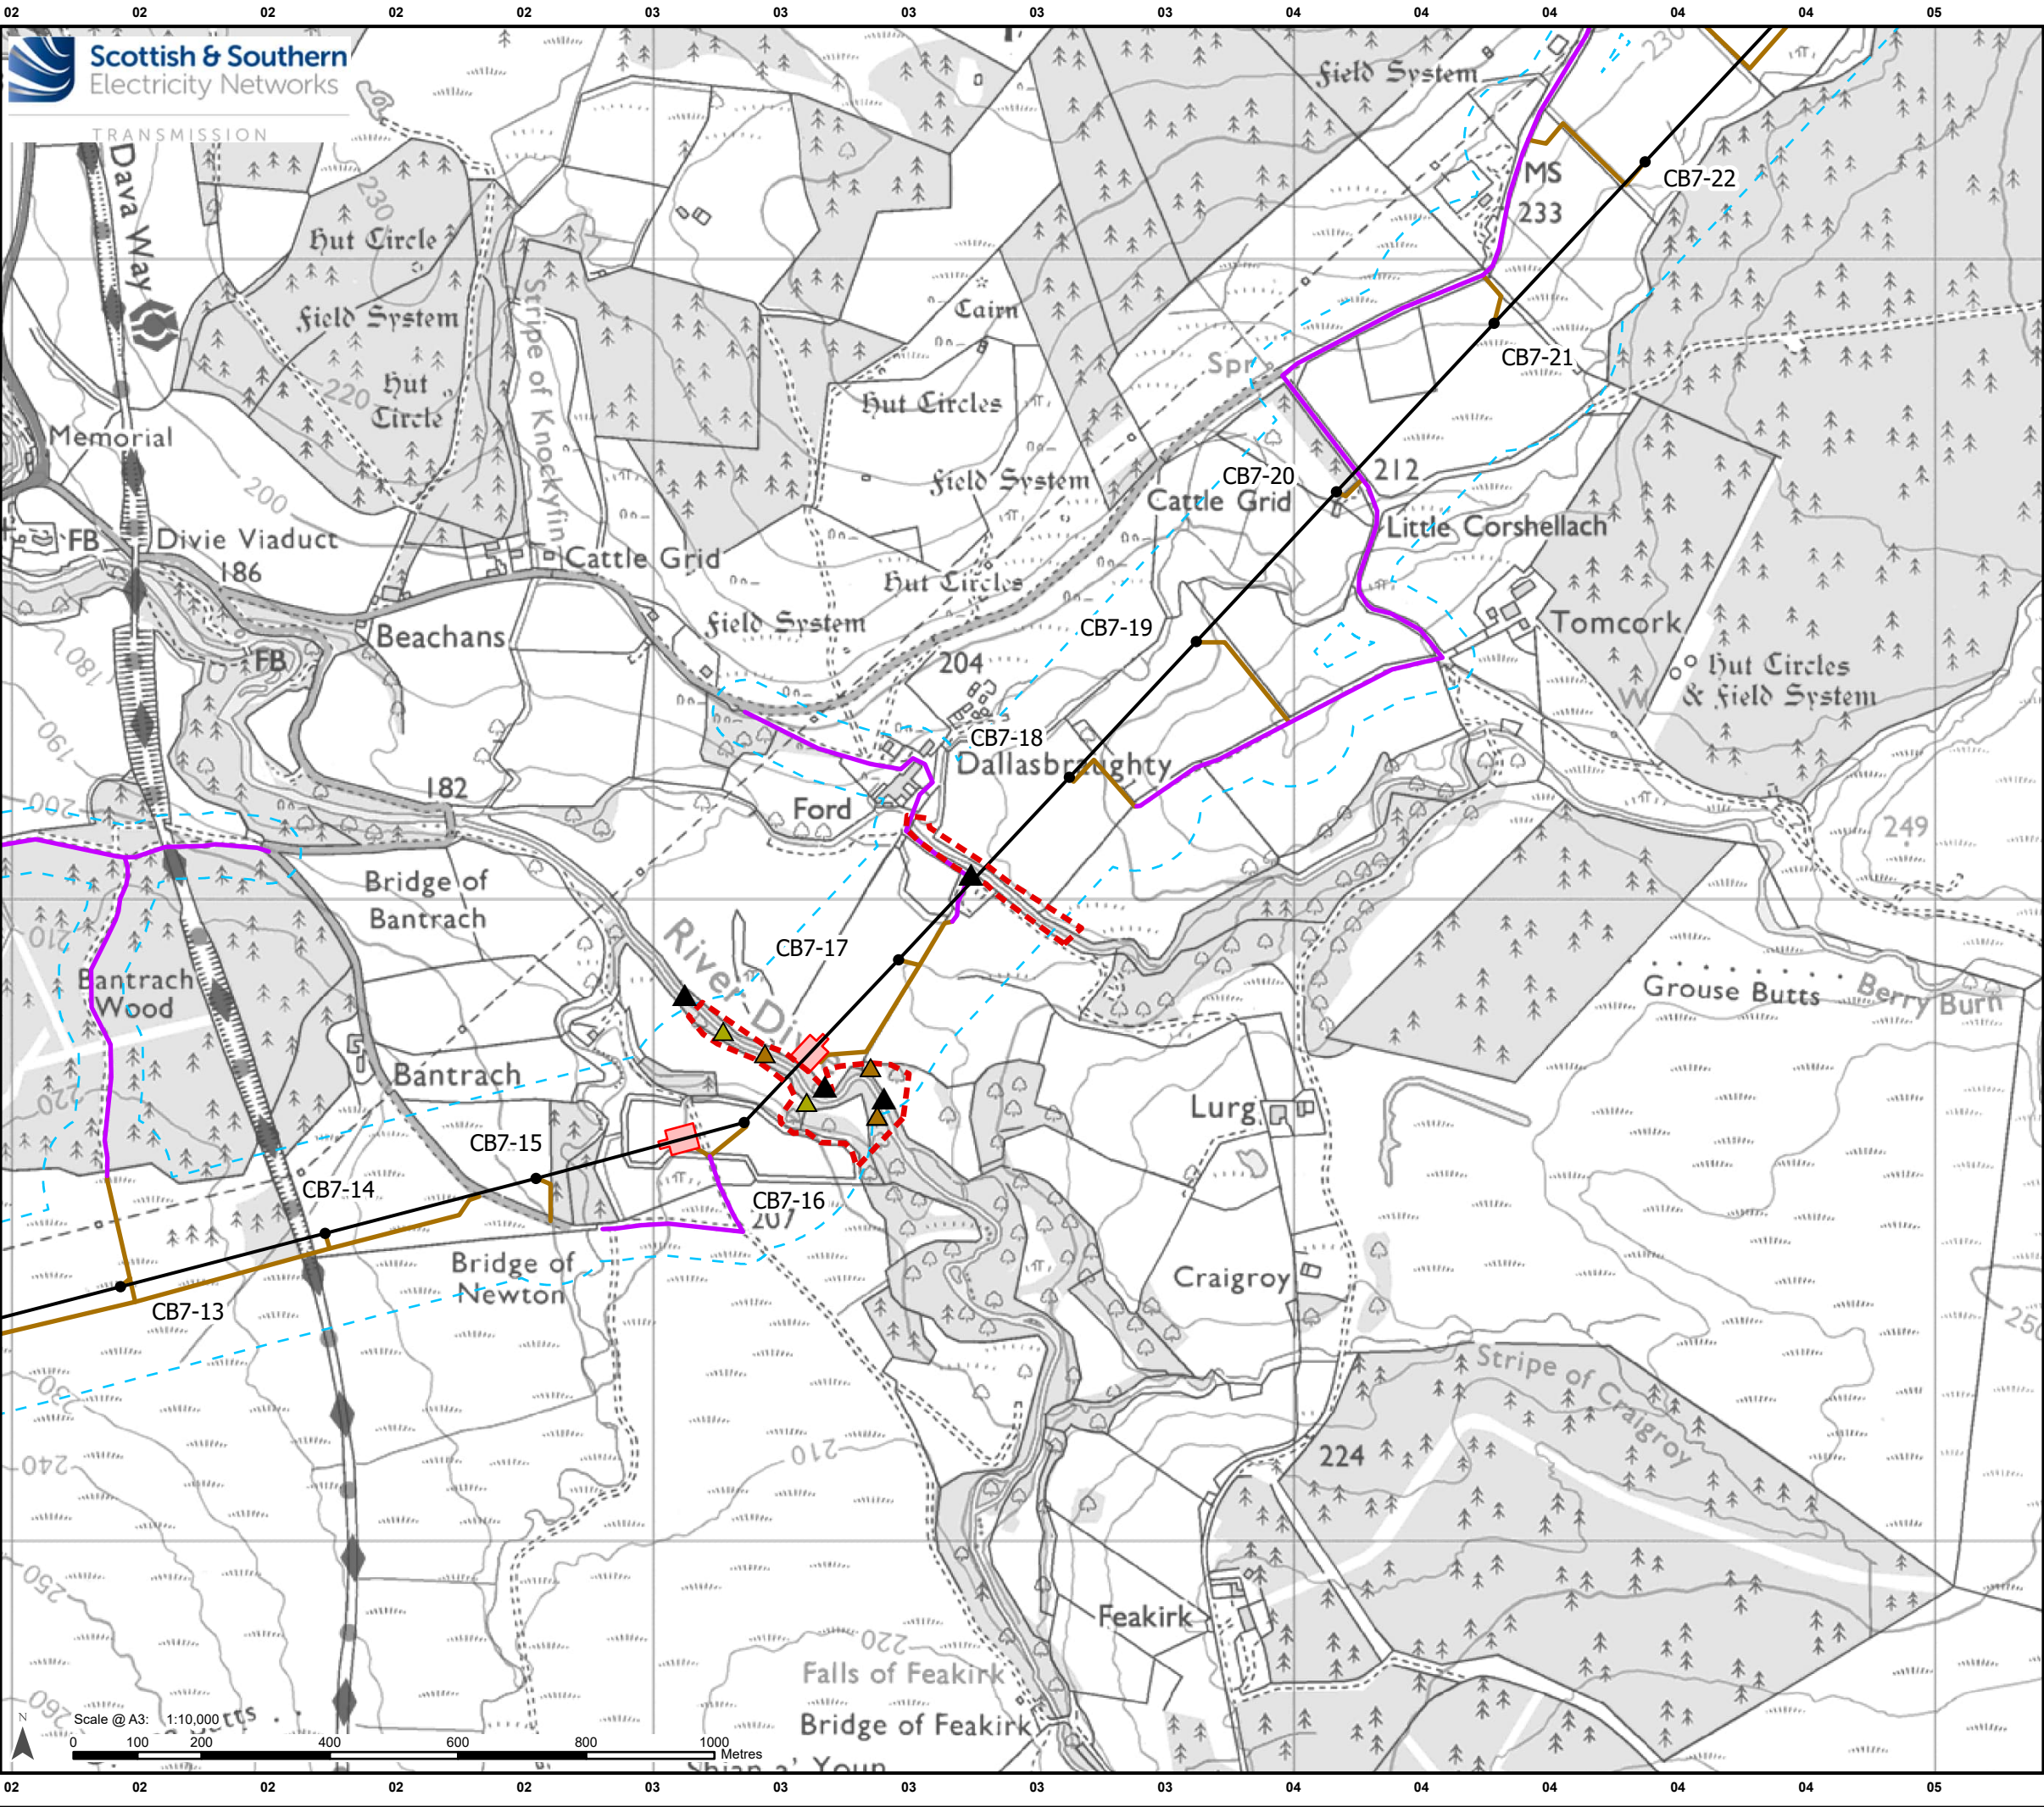

**Legend**  
**Development for which Section 37 Consent is Sought**

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

**Ancillary Development**

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

**Species Survey Area**

- Bat Survey Area

**Further Bat Survey Result**

- Automated Static Detector Location

**Potential Roost Feature (PRF) Inspection Survey Result**

- PRF - Individual
- PRF - Multiple

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                   |       |            |
|-----------|-------------------------------------------------------------------|-------|------------|
| Project:  | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project |       |            |
| Title:    | Figure 8.1.4 - Further Bat Survey Results<br>Page 6 of 12         |       |            |
| Drawn by: | MAL                                                               | Date: | 31/07/2025 |
| Drawing:  | B2P-WSP-DA-70092380-083                                           |       |            |



CB12-13A

CB12-14A

CB12-15A

CB12-16A

CB14-1B

Upper  
Ordiquish  
CB14-2B

CB14-3A

CB14-4A

CB14-5

CB14-6A

Burnside  
of Dipple

Eastertor  
Cottage

Waterfall

Ford

Aultderg

Culfoldie

Craigs of  
Culdell

Castlehill  
Farm

Castle  
Hill

Ordiquish

FB

Ordiequish  
Hill

Tor Cast

Wood of

Scale @ A3: 1:10,000  
0 100 200 400 600 800 1000 Metres

## Legend

### Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

### Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

### Species Survey Area


- Bat Survey Area

### Further Bat Survey Result

- Automated Static Detector Location

### Potential Roost Feature (PRF) Inspection Survey Result

- None
- PRF - Individual

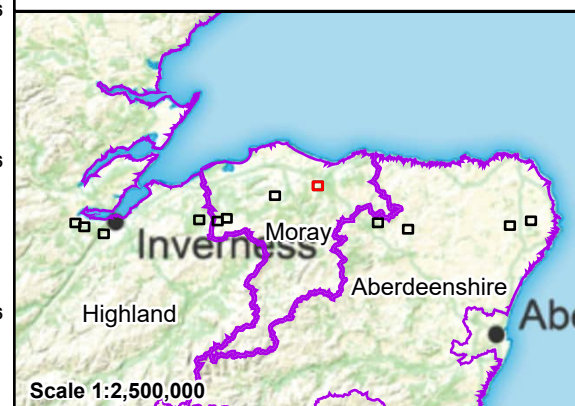


Reproduced by permission of Ordnance Survey.  
Crown copyright and database right 2025 all rights reserved.  
Ordnance Survey Licence number AC0000813445.  
SSEN Transmission take no responsibility for the release or accuracy of latest  
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to  
Peterhead 400kV OHL Project

Title: Figure 8.1.4 - Further Bat Survey Results  
Page 8 of 12

Drawn by: MAL Date: 31/07/2025

Drawing: B2P-WSP-DA-70092380-083

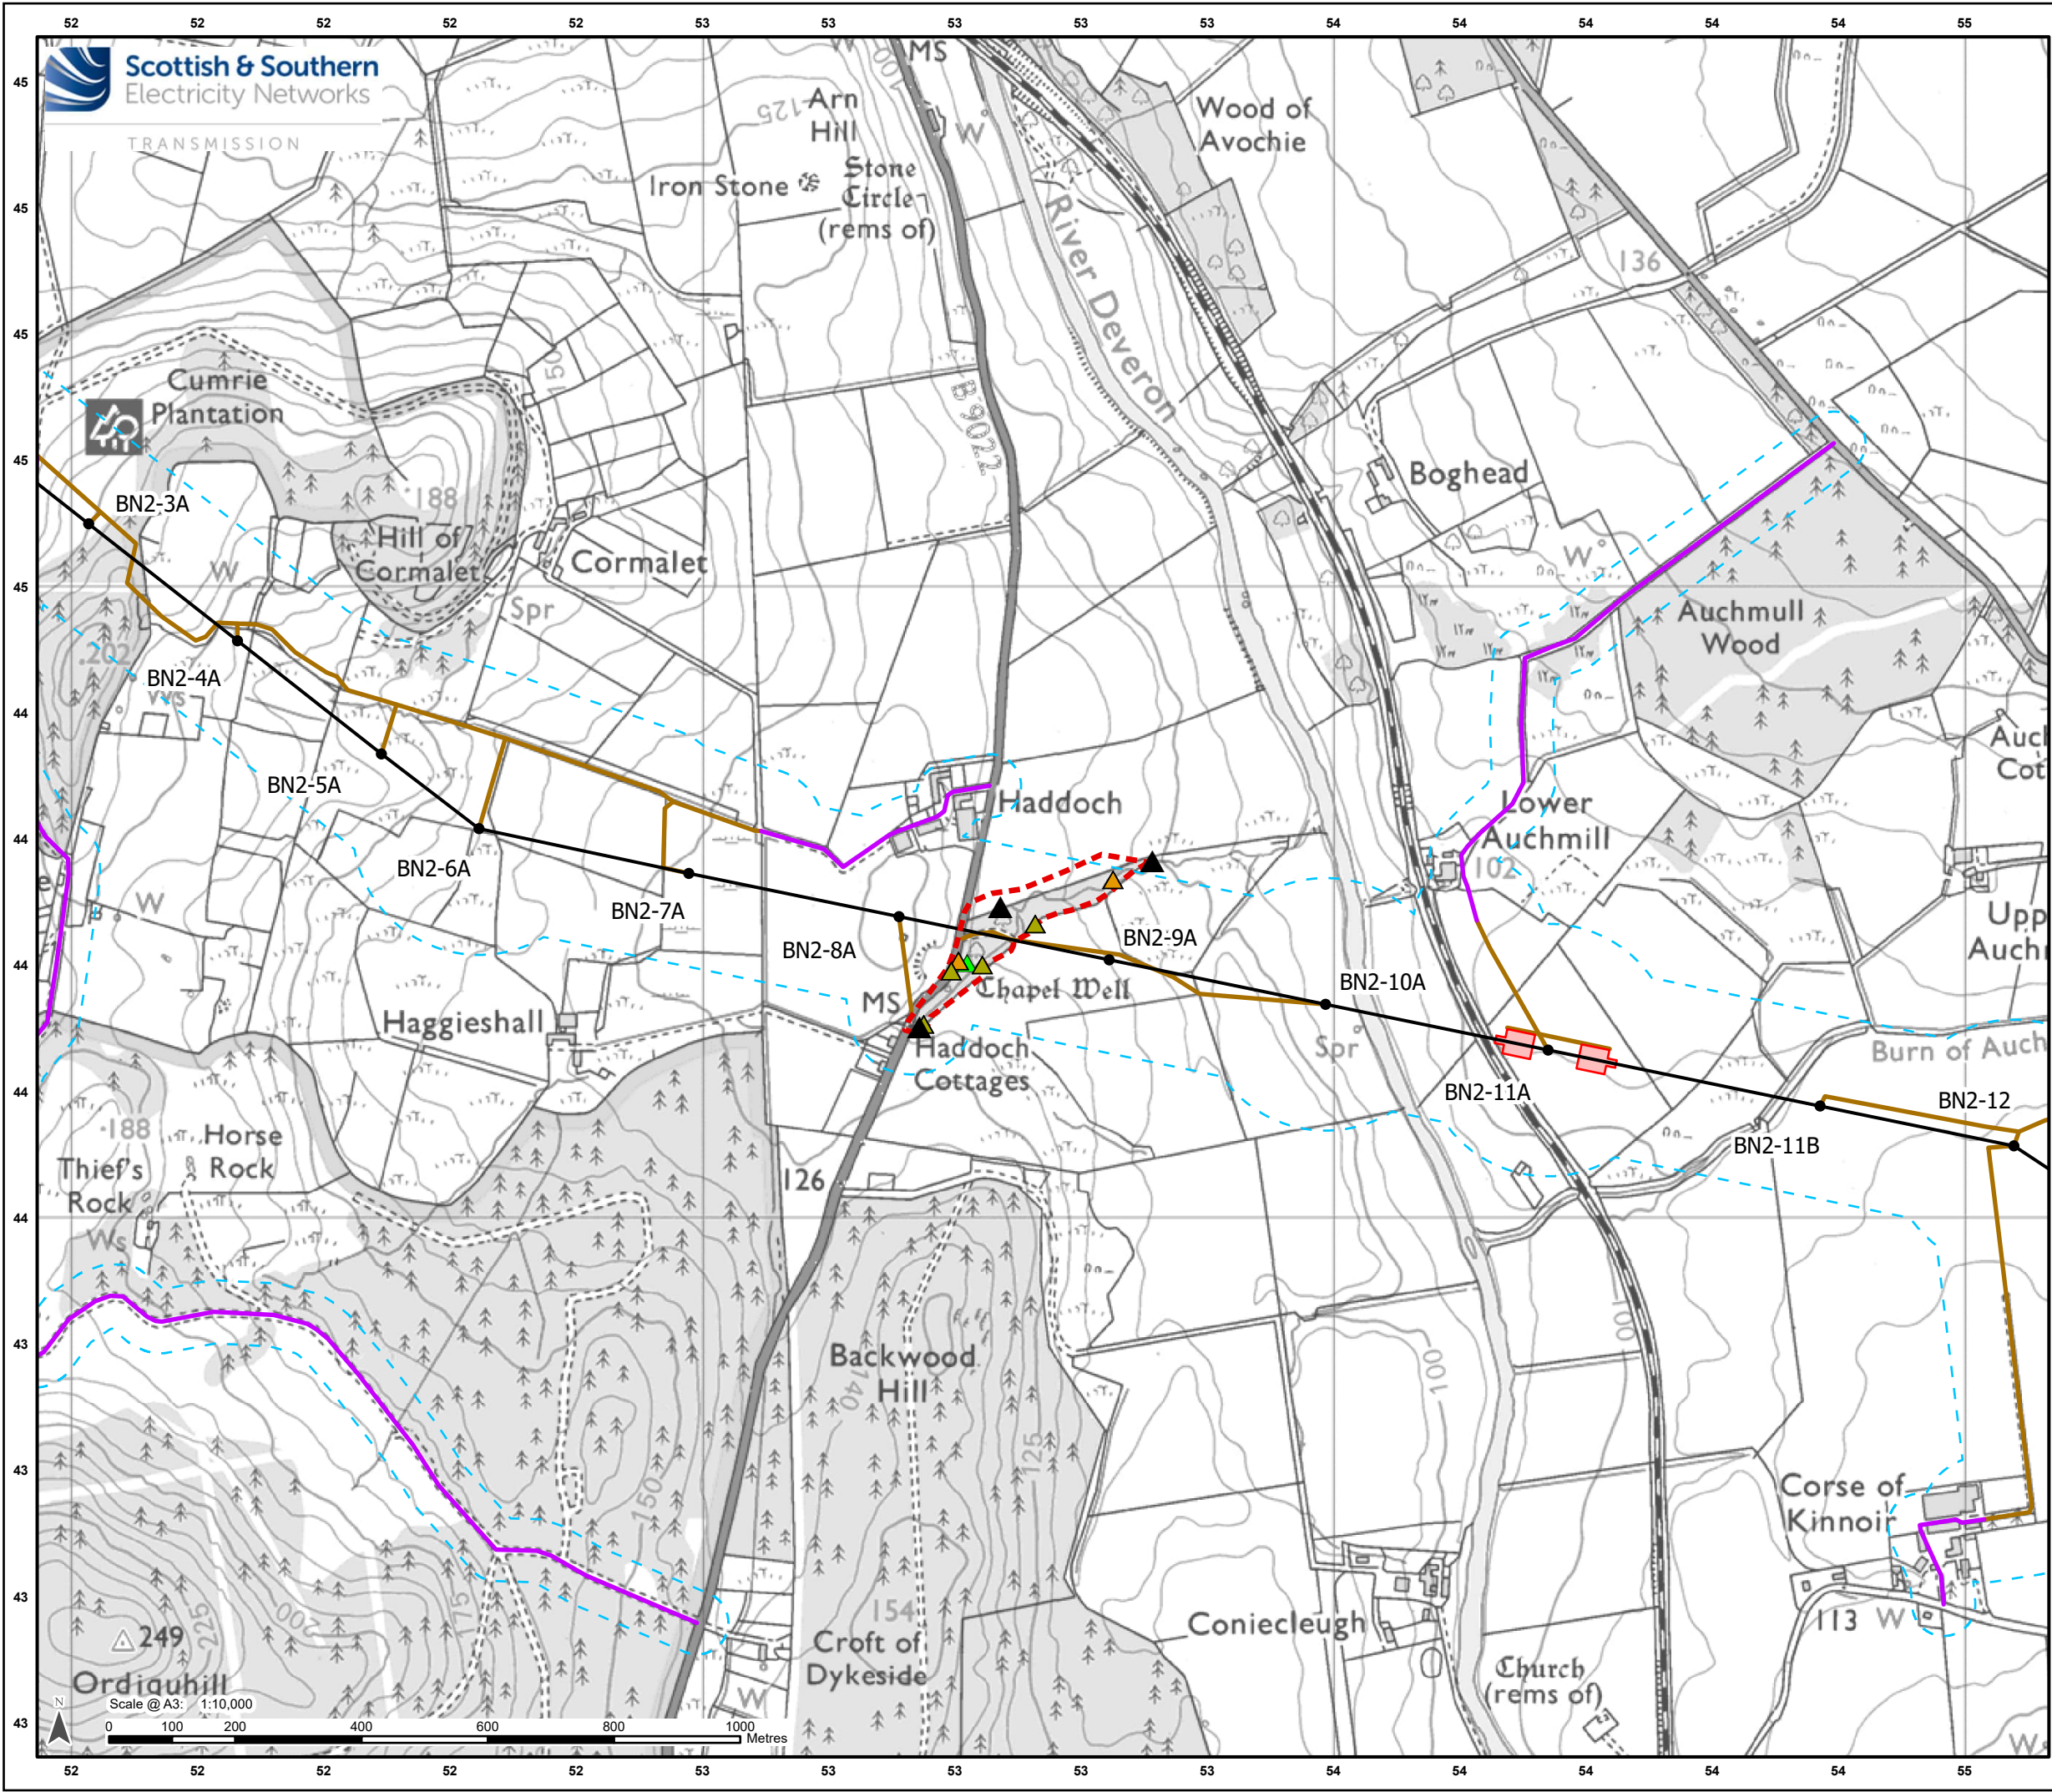

**Legend**

**Development for which Section 37 Consent is Sought**

—

Proposed OHL Alignment - 400 kV

●

Proposed Tower - 400 kV (with tower number)

---

Limit of Deviation

**Ancillary Development**

▭

Proposed Conductor Pulling Area (EPZ)

—

Proposed New Access (Temporary/Permanent)

—

Existing Access Upgrade

**Species Survey Area**

▭

Bat Survey Area

**Further Bat Survey Result**

▲

Automated Static Detector Location

**Potential Roost Feature (PRF) Inspection Survey Result**

▲

None


▲

PRF - Individual


**Dusk Emergence Survey Result**

▲

No Roost

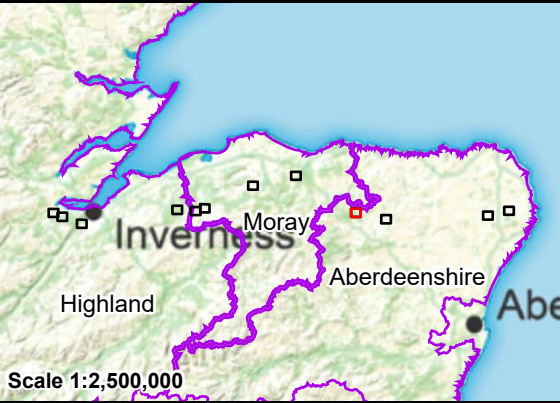

|                                                                                                                                                                                                                                                                                      |                                                                   |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------|
| Reproduced by permission of Ordnance Survey.<br>Crown copyright and database right 2025 all rights reserved.<br>Ordnance Survey Licence number AC0000813445.<br>SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey |                                                                   |
| Project:                                                                                                                                                                                                                                                                             | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project |
| Title:                                                                                                                                                                                                                                                                               | Figure 8.1.4 - Further Bat Survey Results<br>Page 9 of 12         |
| Drawn by:                                                                                                                                                                                                                                                                            | MAL                                                               |
| Date:                                                                                                                                                                                                                                                                                | 31/07/2025                                                        |
| Drawing:                                                                                                                                                                                                                                                                             | B2P-WSP-DA-70092380-083                                           |

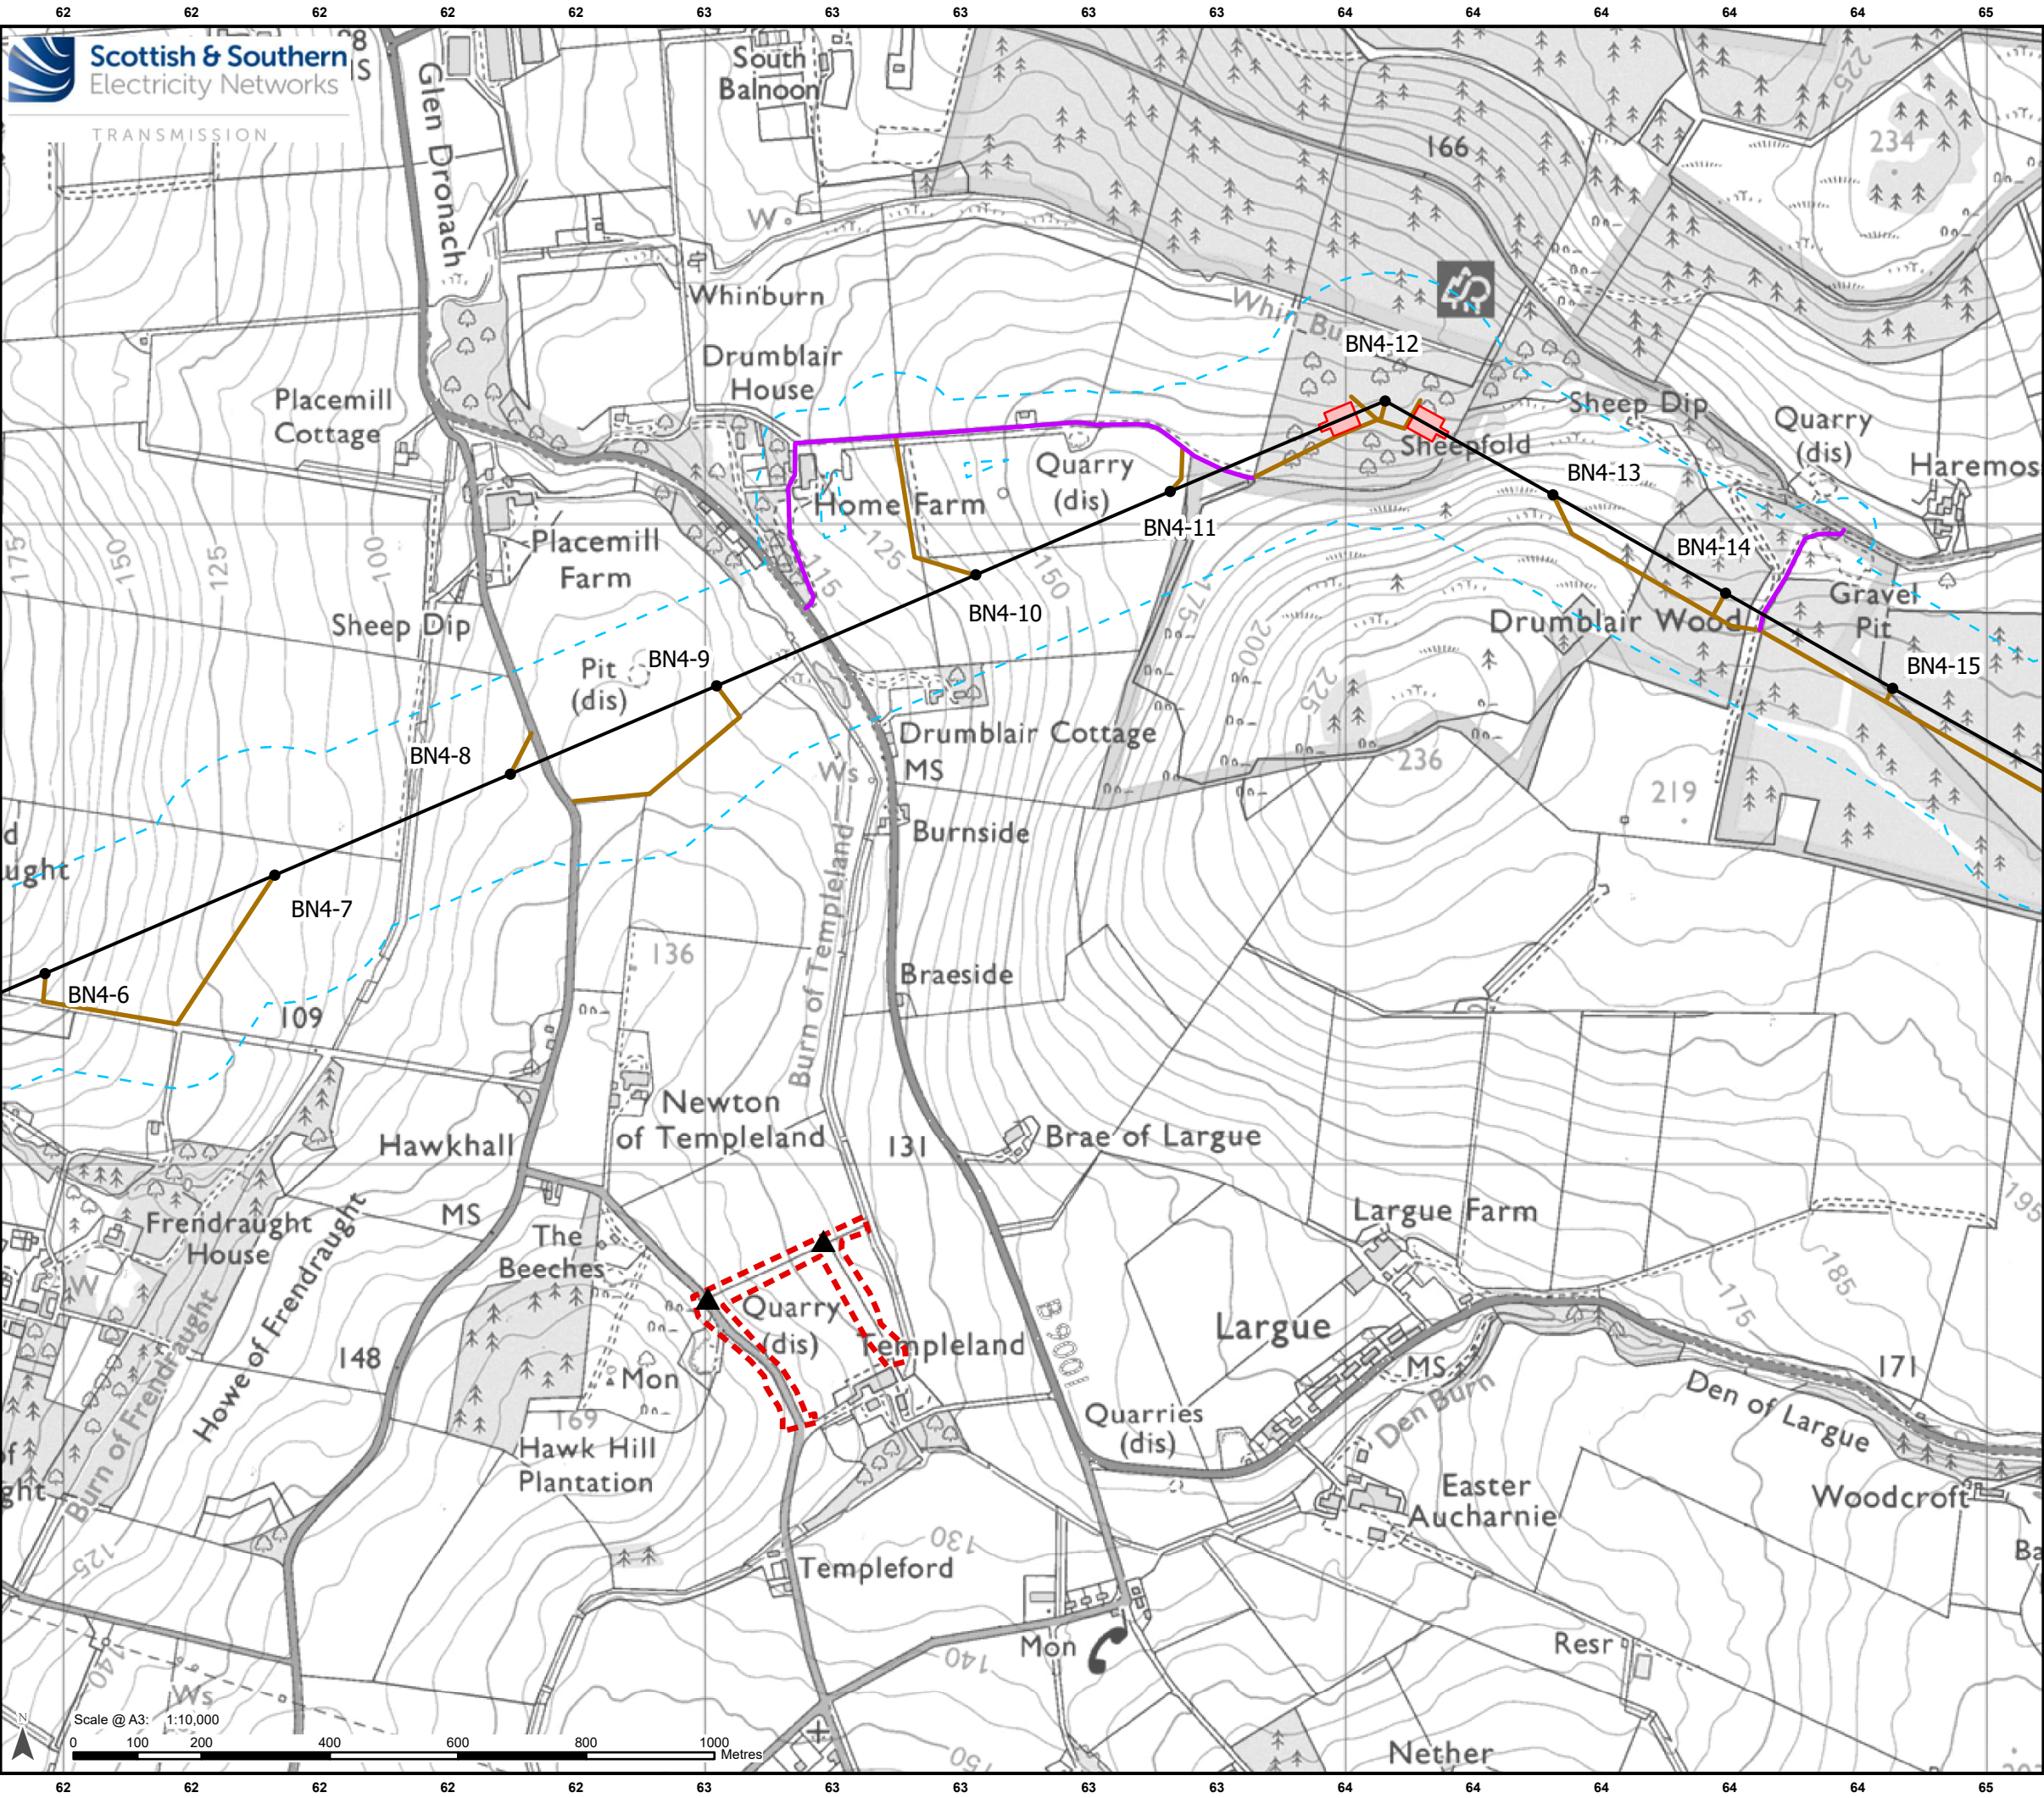

**Legend**

**Development for which Section 37 Consent is Sought**

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

**Ancillary Development**


- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

**Species Survey Area**

- Bat Survey Area

**Further Bat Survey Result**

- Automated Static Detector Location

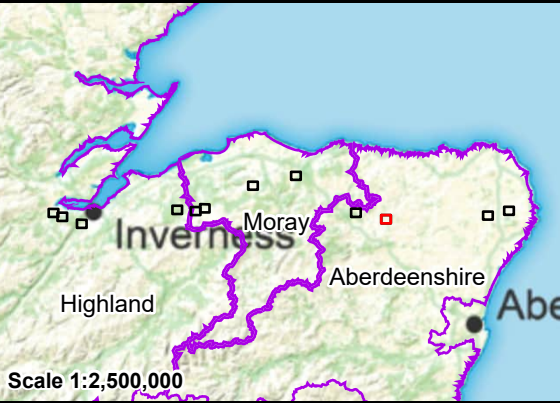

|                                                                                                                                                                                                                                                                                      |                                                                   |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------|
| Reproduced by permission of Ordnance Survey.<br>Crown copyright and database right 2025 all rights reserved.<br>Ordnance Survey Licence number AC0000813445.<br>SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey |                                                                   |
| Project:                                                                                                                                                                                                                                                                             | Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project |
| Title:                                                                                                                                                                                                                                                                               | Figure 8.1.4 - Further Bat Survey Results<br>Page 10 of 12        |
| Drawn by:                                                                                                                                                                                                                                                                            | MAL                                                               |
| Date:                                                                                                                                                                                                                                                                                | 31/07/2025                                                        |
| Drawing:                                                                                                                                                                                                                                                                             | B2P-WSP-DA-70092380-083                                           |