


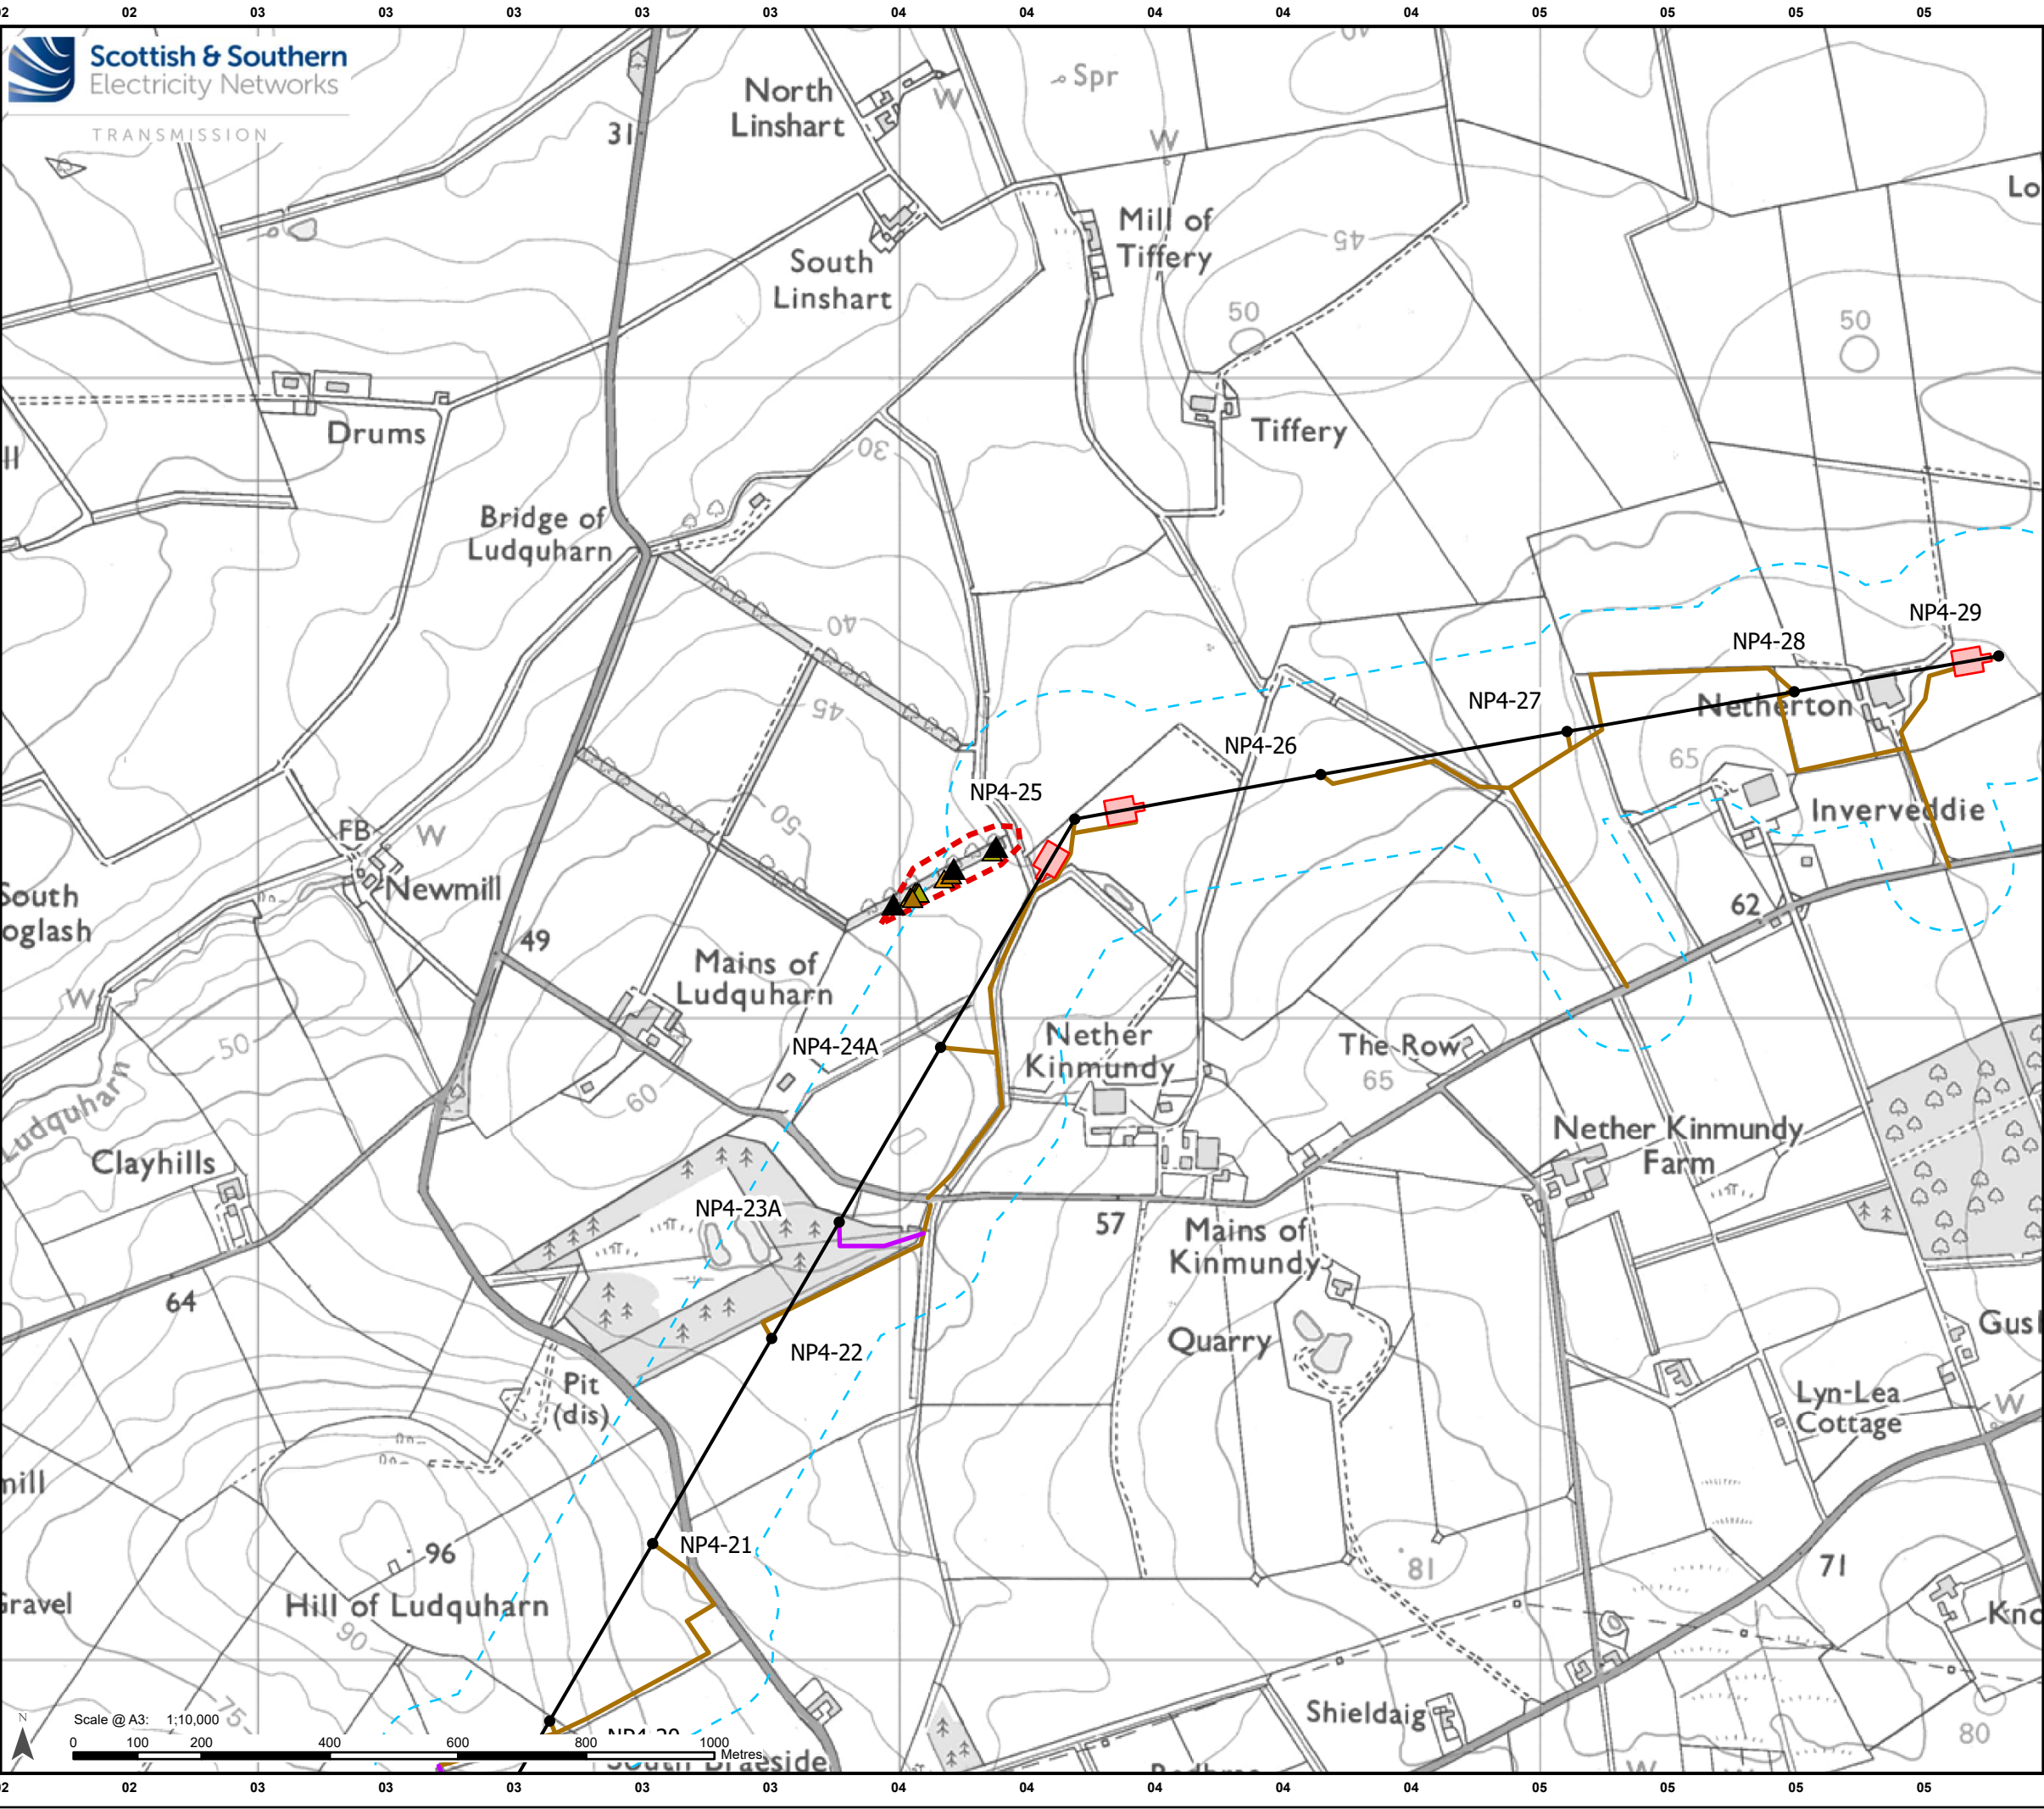

Legend
Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Species Survey Area

- Bat Survey Area

Further Bat Survey Result

- Automated Static Detector Location

Potential Roost Feature (PRF) Inspection Survey Result

- None
- PRF - Individual
- PRF - Multiple

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 8.1.4 - Further Bat Survey Results Page 12 of 12		
Drawn by:	MAL	Date:	31/07/2025
Drawing:	B2P-WSP-DA-70092380-083		