


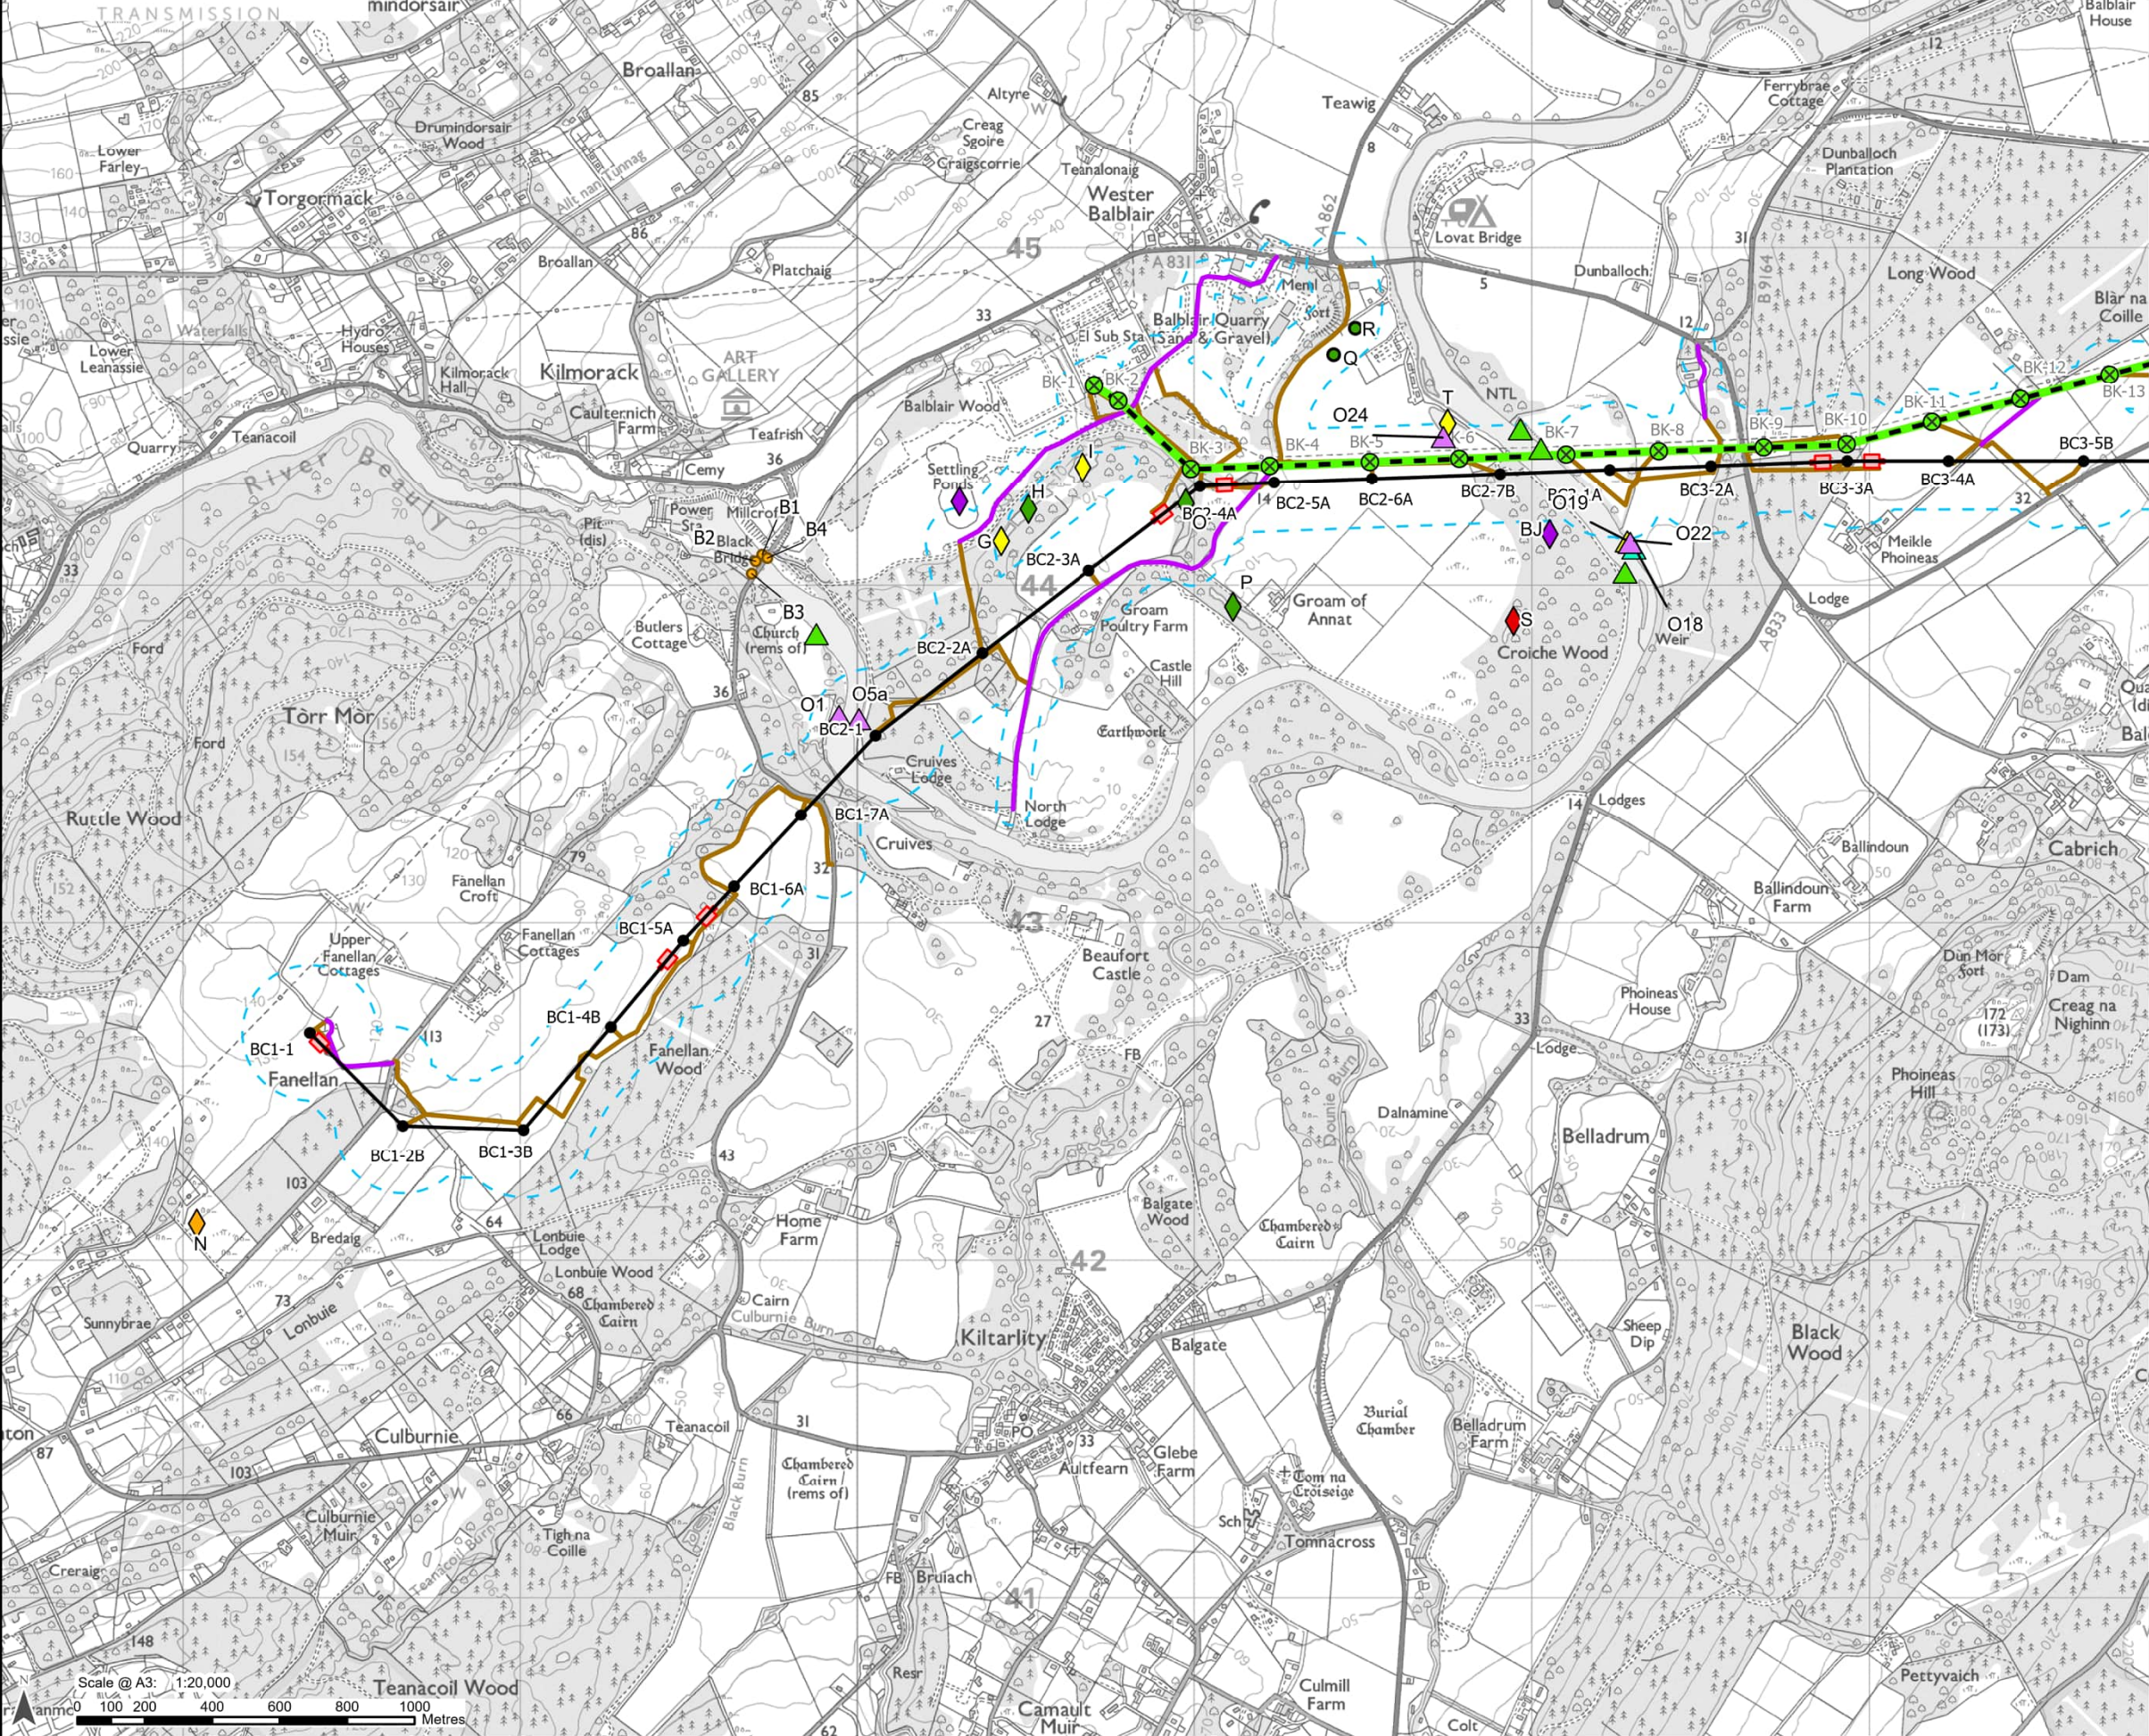

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Otter Survey Result (O)

- Confirmed Holt
- Confirmed Couch
- Feeding Remains
- Spraint - not individually labelled


Great Crested Newt Survey Result

Habitat Suitability Index Result

- Excellent
- Good
- Average
- Below Average
- Poor
- N/A - No Access

Species Survey Result

- Beaver Survey Result (B)

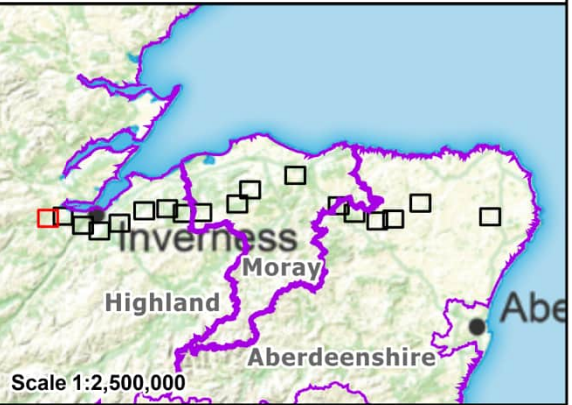


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 8.1.6 – Other Protected and Notable Species Survey Results
Page 1 of 18

Drawn by: MAL Date: 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

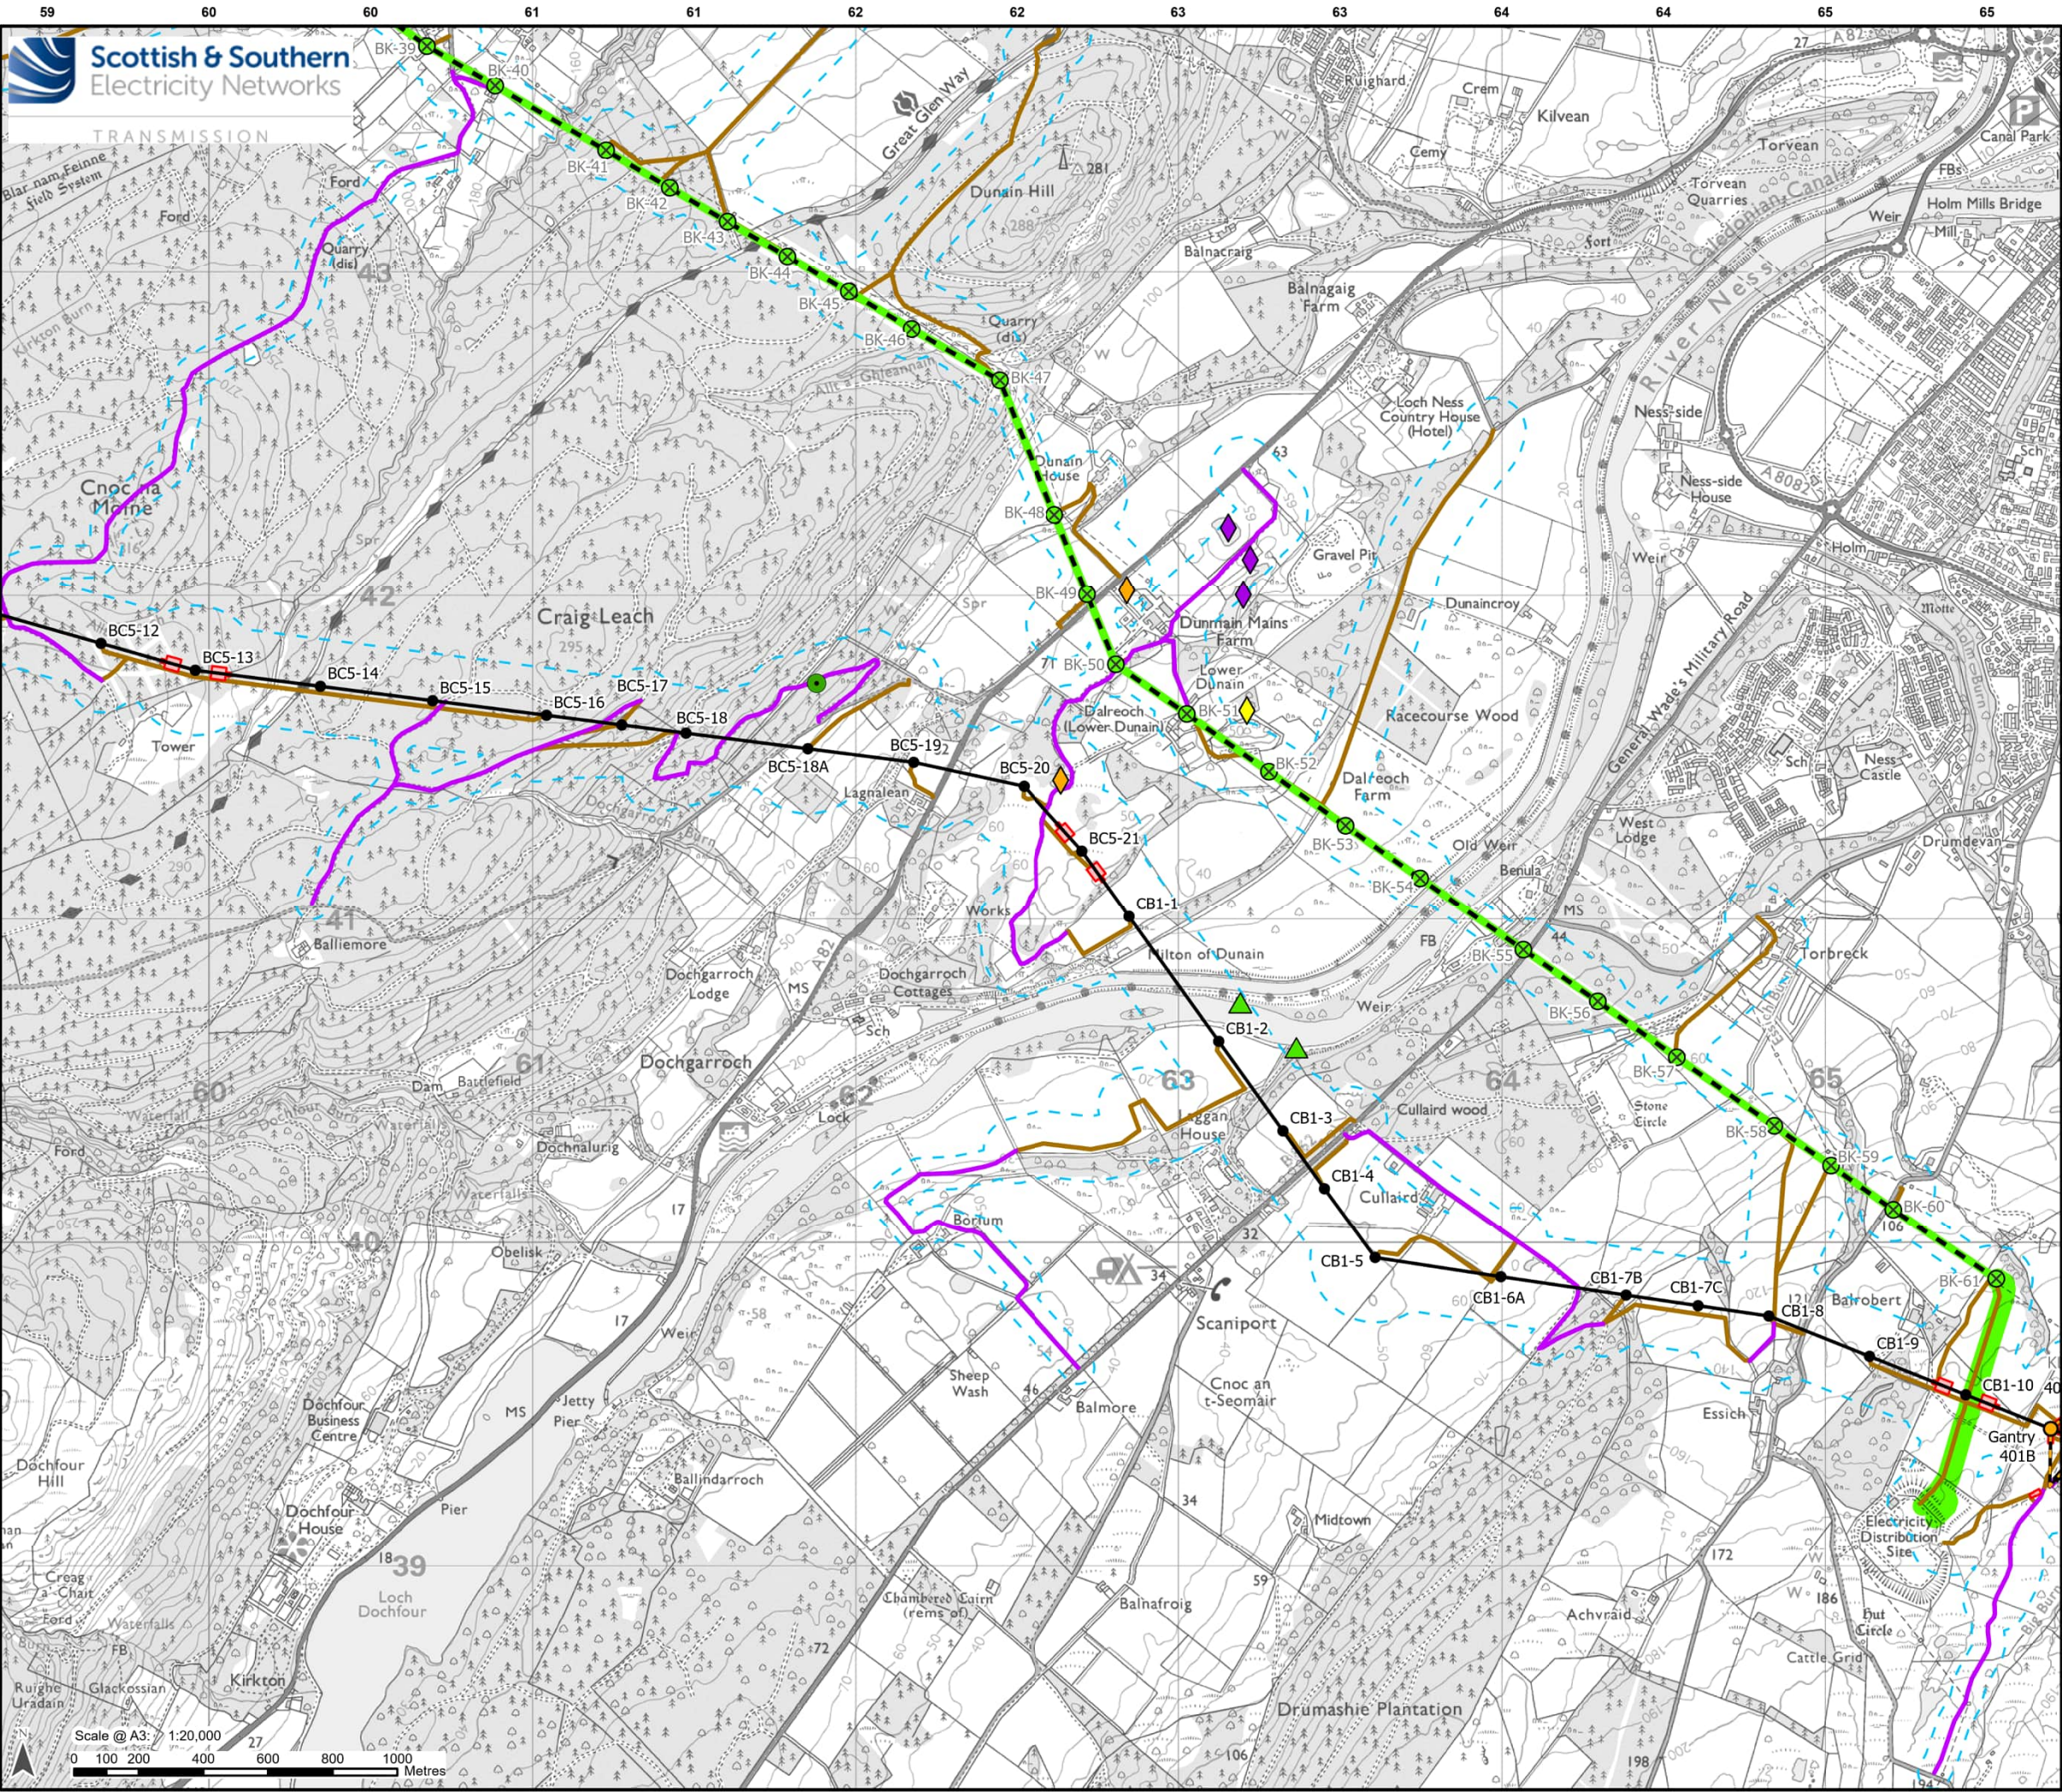

Legend

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Temporary OHL Diversion

Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)

Proposed Tower - 400 kV (with tower number)

Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)

Limit of Deviation

Ancillary Development

Tower to be Removed

OHL to be Removed

Cable to be Removed

Proposed Conductor Pulling Area (EPZ)

Proposed New Access (Temporary/Permanent)

Existing Access Upgrade

Red Squirrel Squirrel Result (RS)

Sighting

Otter Survey Result (O)

Spraint - not individually labelled


Great Crested Newt Survey Result

Habitat Suitability Index Result


Good

Average

Poor

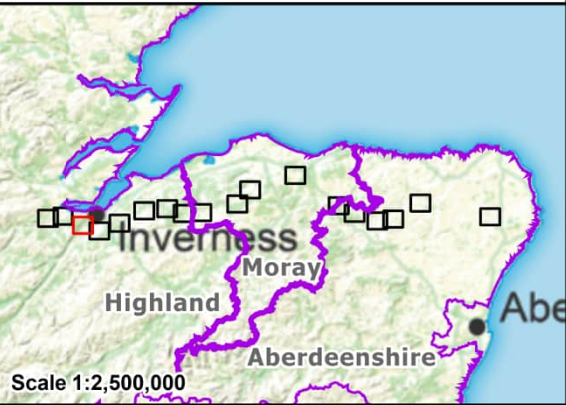

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project
Title:	Figure: 8.1.6 – Other Protected and Notable Species Survey Results Page 3 of 18
Drawn by:	MAL
Date:	01/10/2025
Drawing:	B2P-WSP-DA-70092380-084

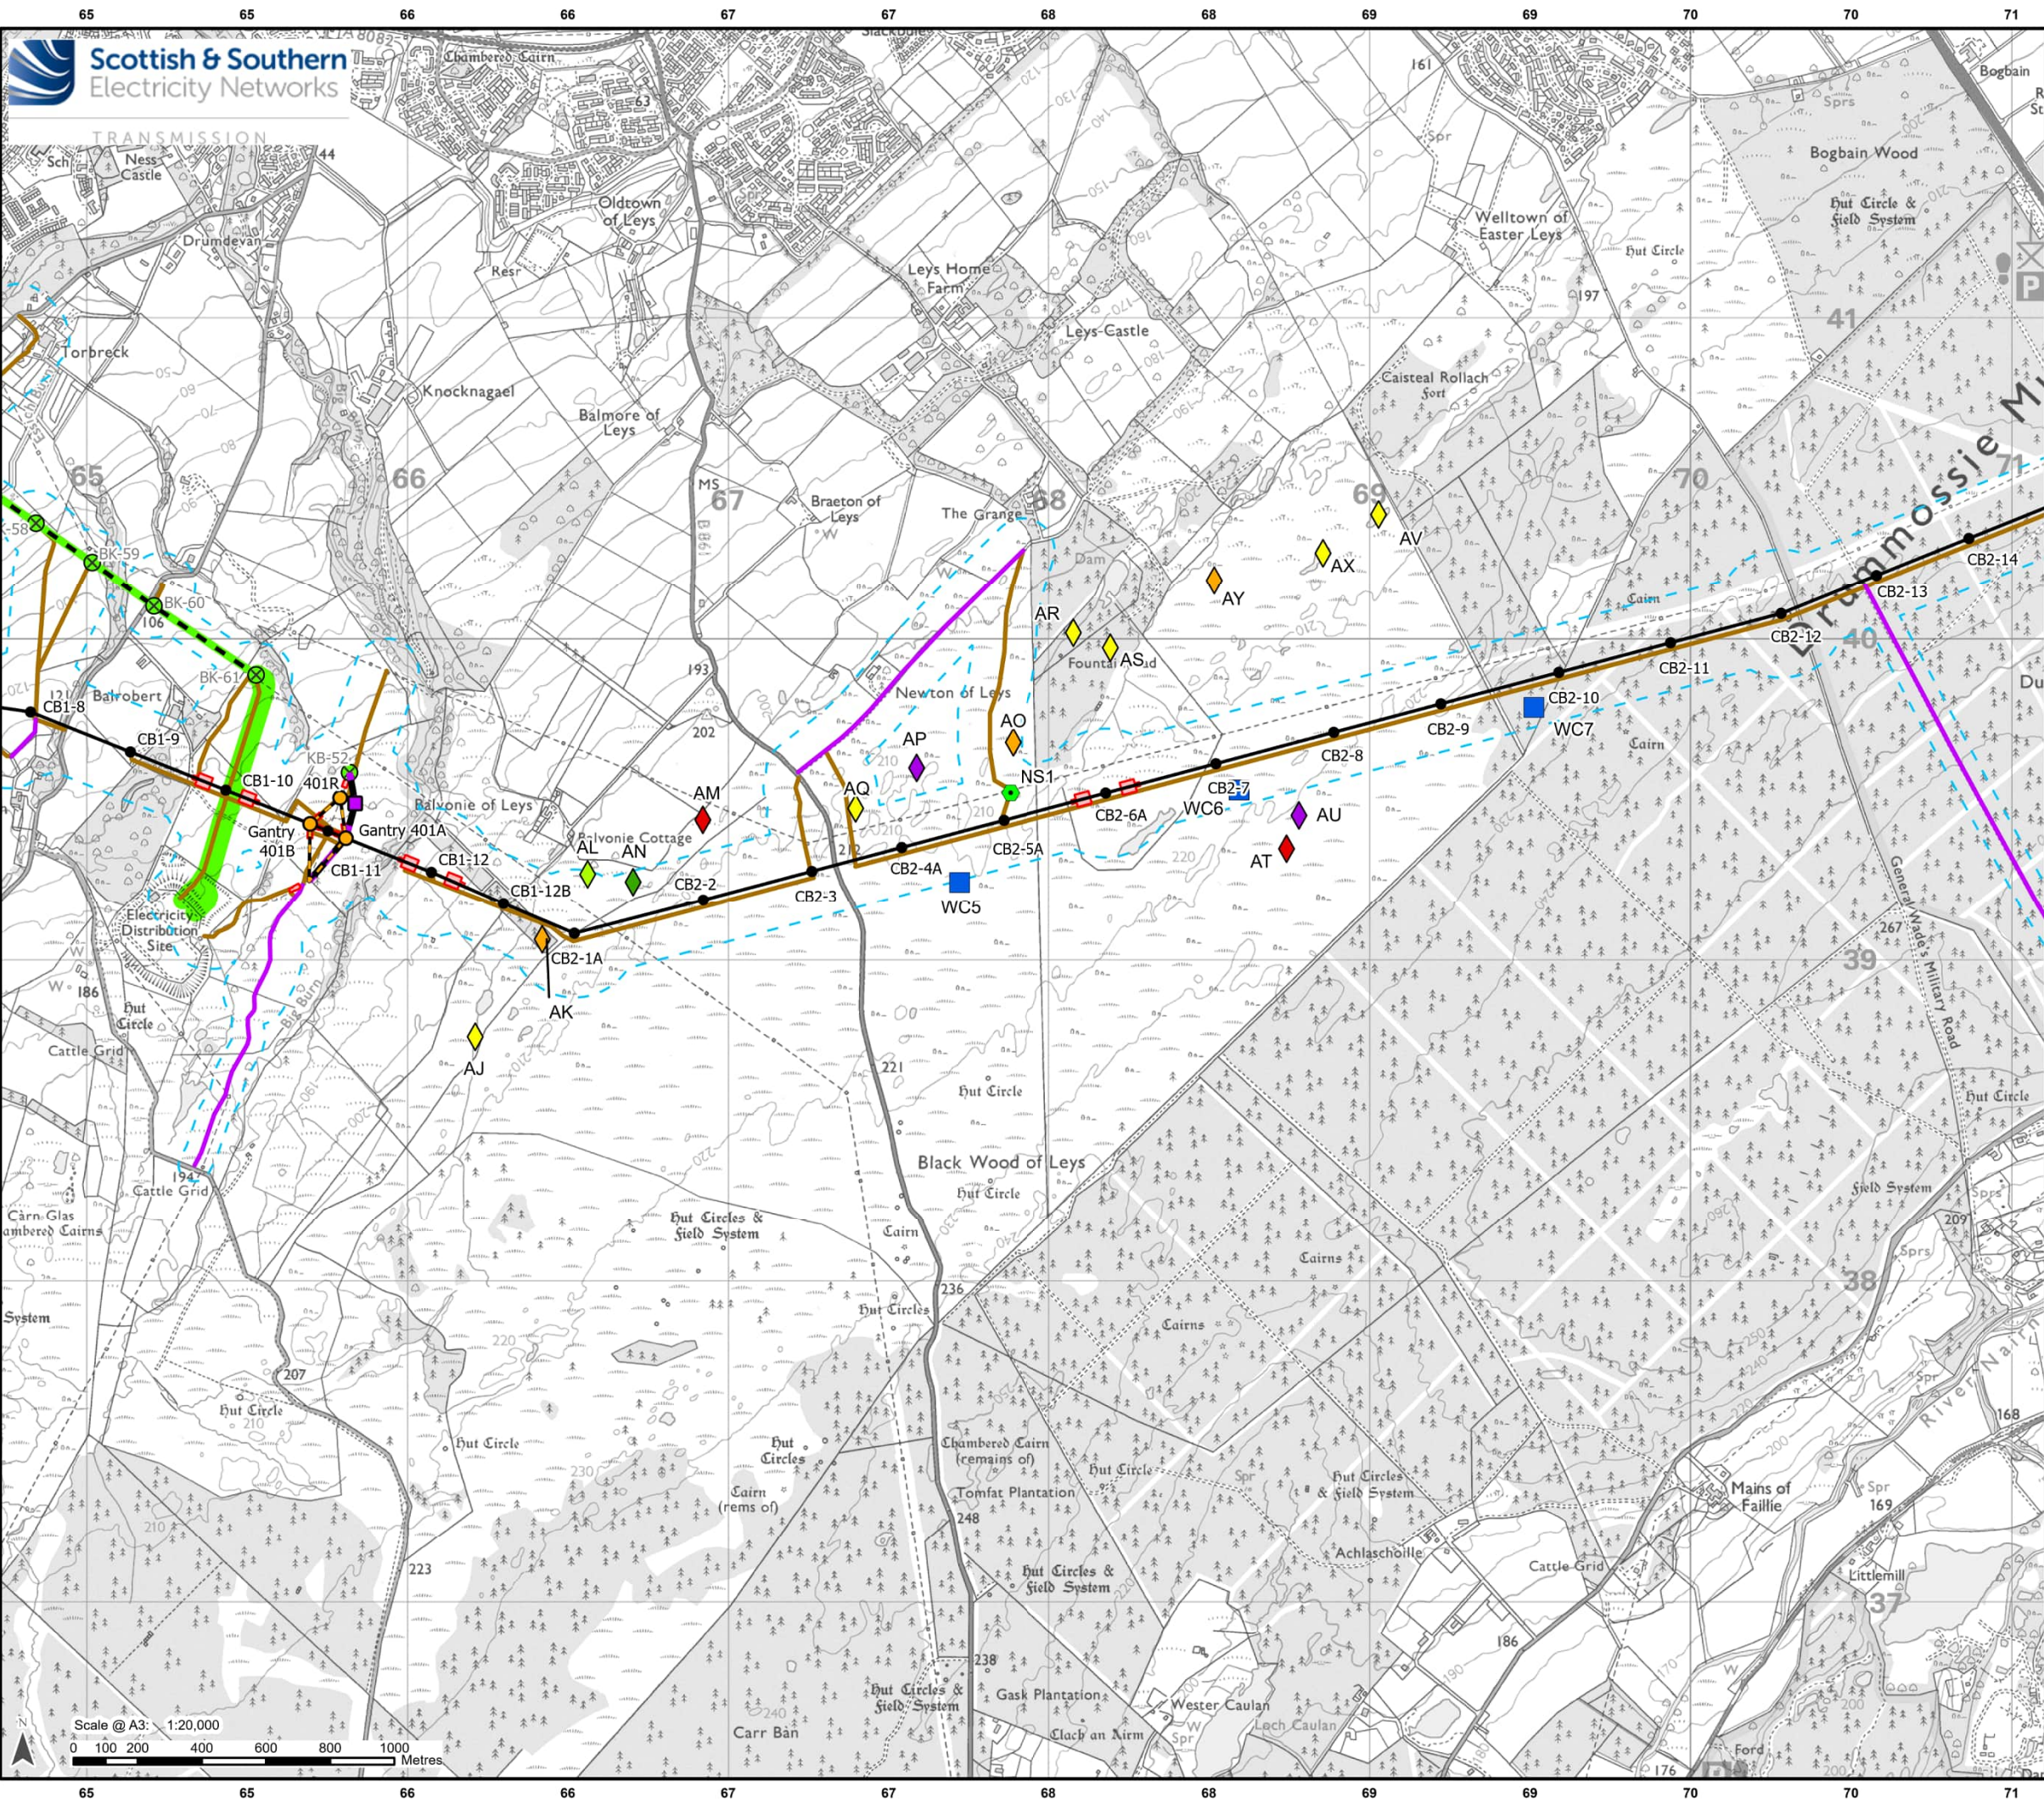

Legend
Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary
- Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Cable to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Wildcat Survey Result (WC)

- Potential Resting Site


Great Crested Newt Survey Result

Habitat Suitability Index Result

- Excellent
- Good - Positive
- Good
- Average
- Below Average
- Poor

Other Notable Species (NS)

- Brown Hare

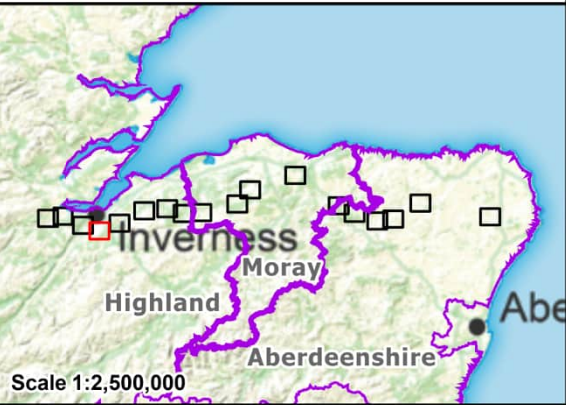


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 8.1.6 – Other Protected and Notable Species Survey Results
Page 4 of 18

Drawn by: MAL Date: 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

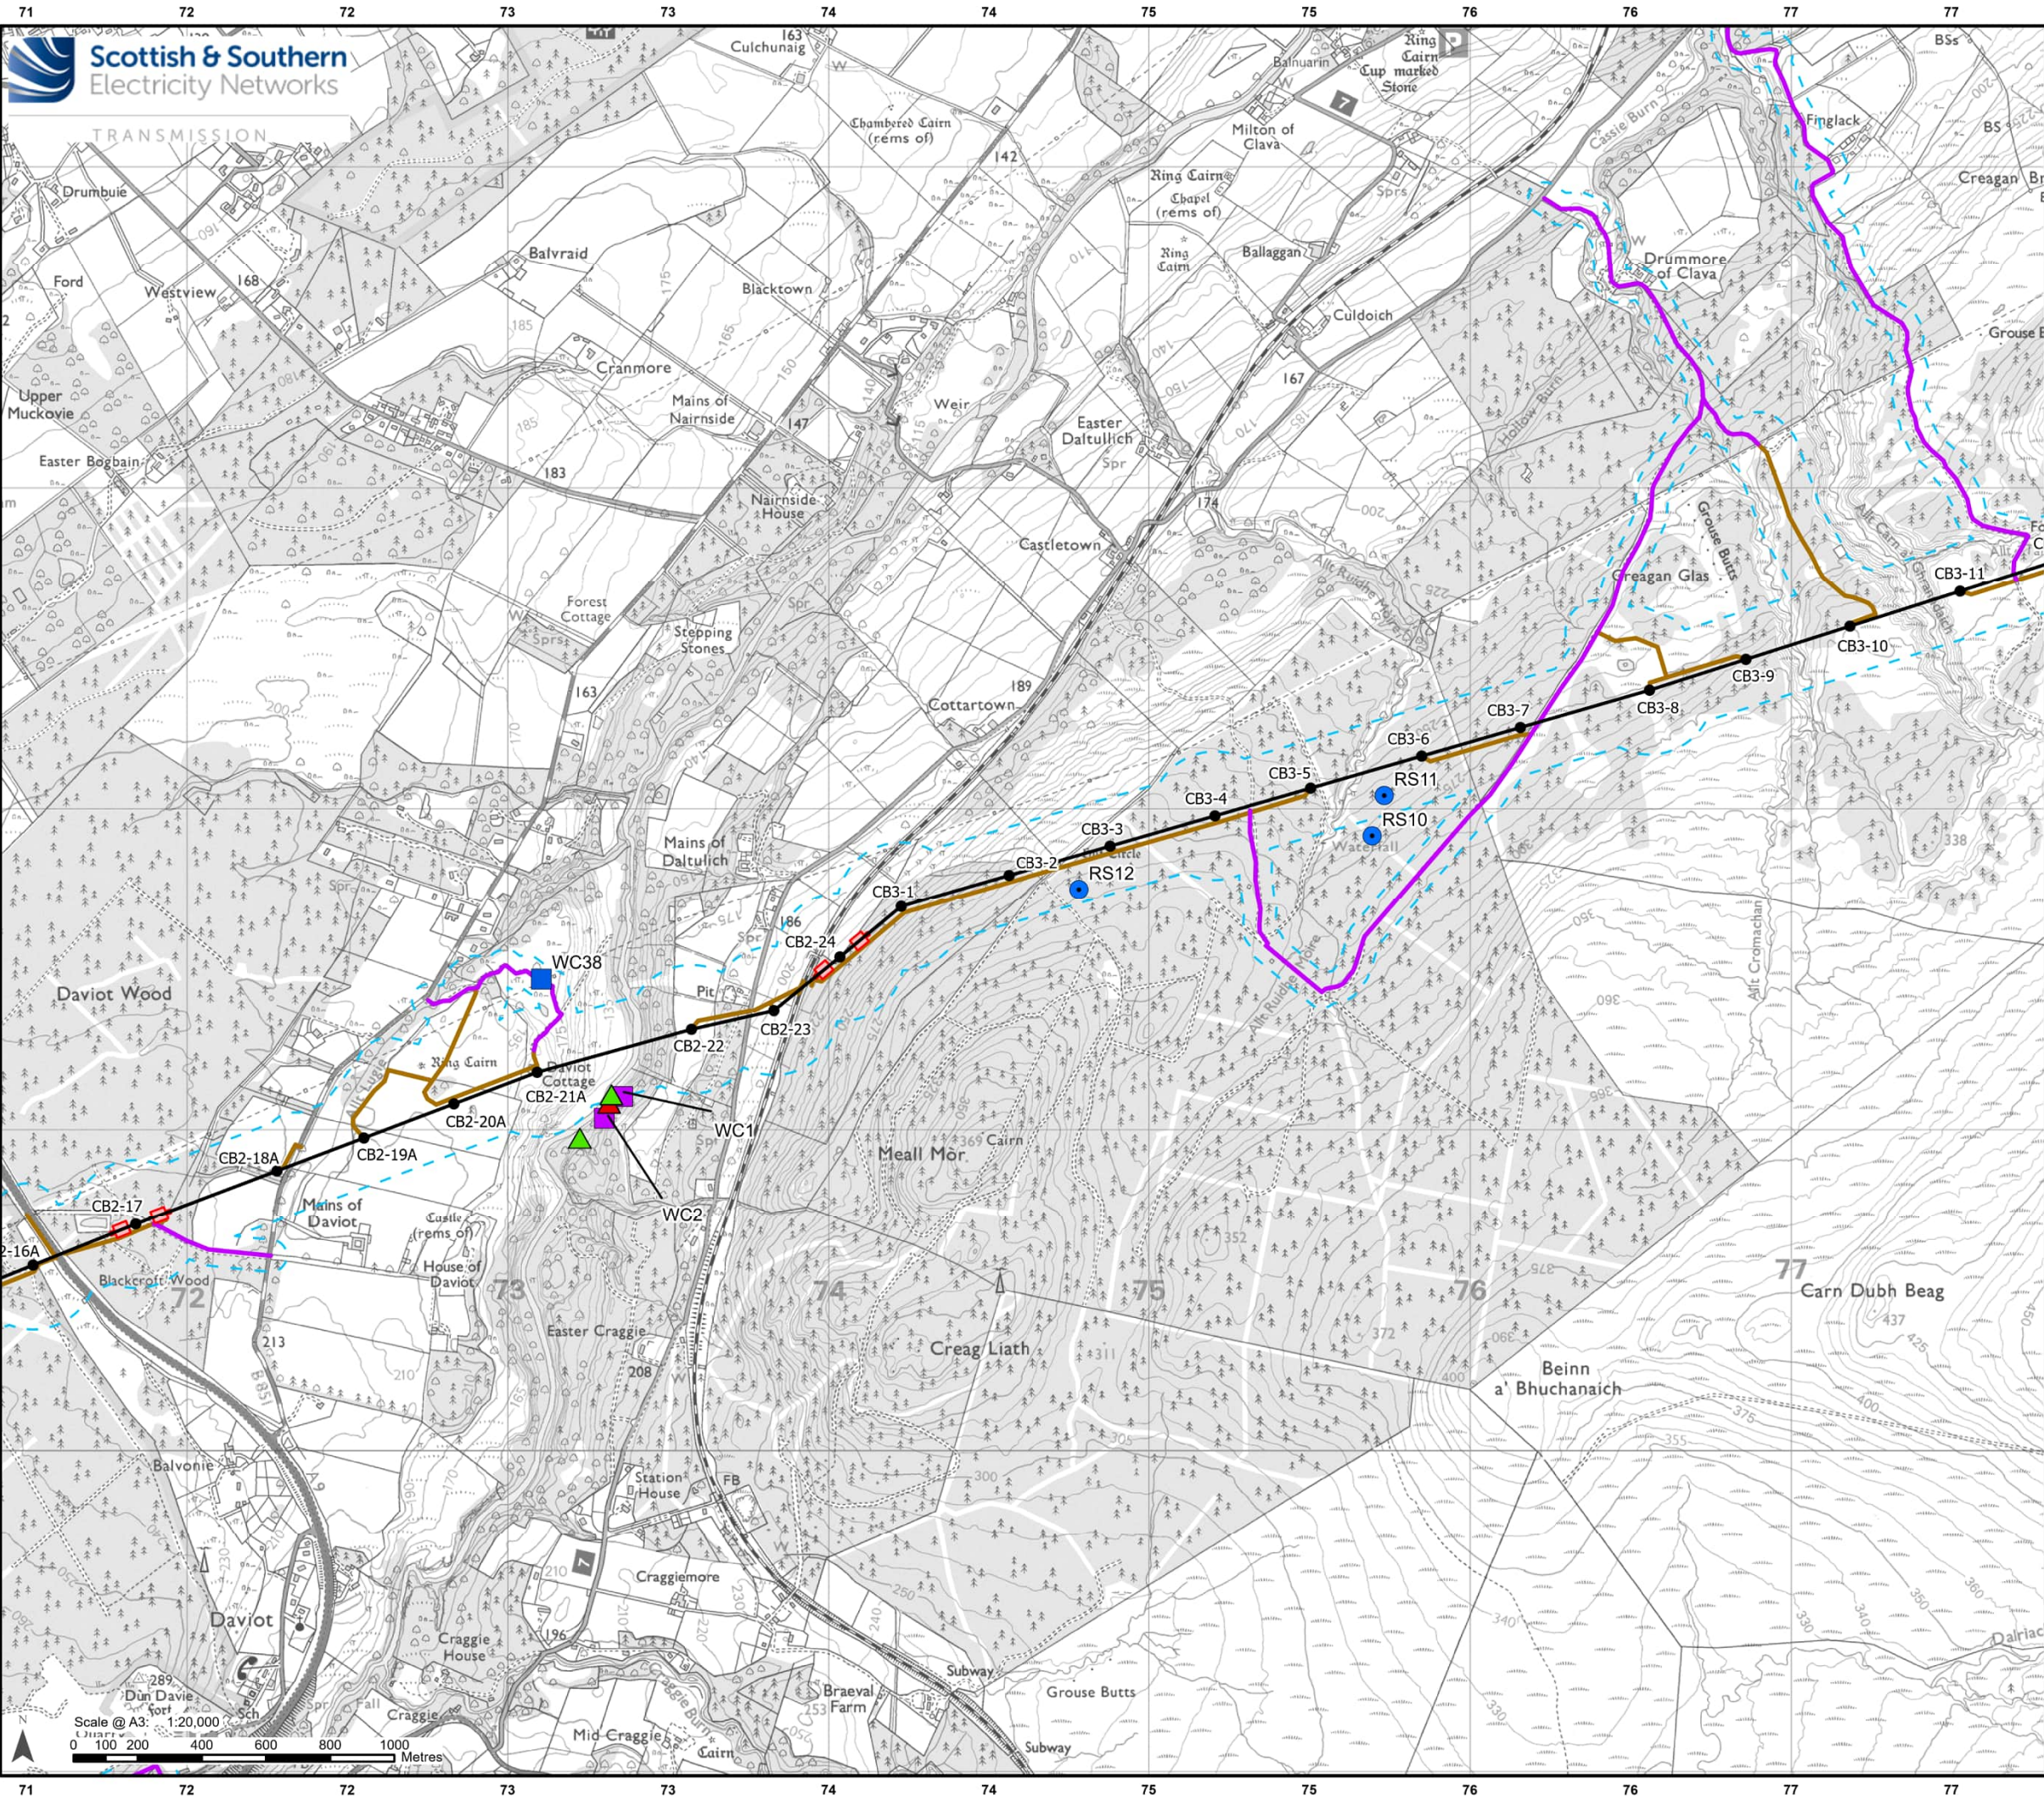

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Red Squirrel Squirrel Result (RS)

- Potential Drey

Otter Survey Result (O)

- Anal Jelly
- Spraint - not individually labelled

Wildcat Survey Result (WC)

- Potential Denning Site
- Potential Resting Site

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 8.1.6 – Other Protected and Notable Species Survey Results
Page 5 of 18

Drawn by: MAL Date: 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

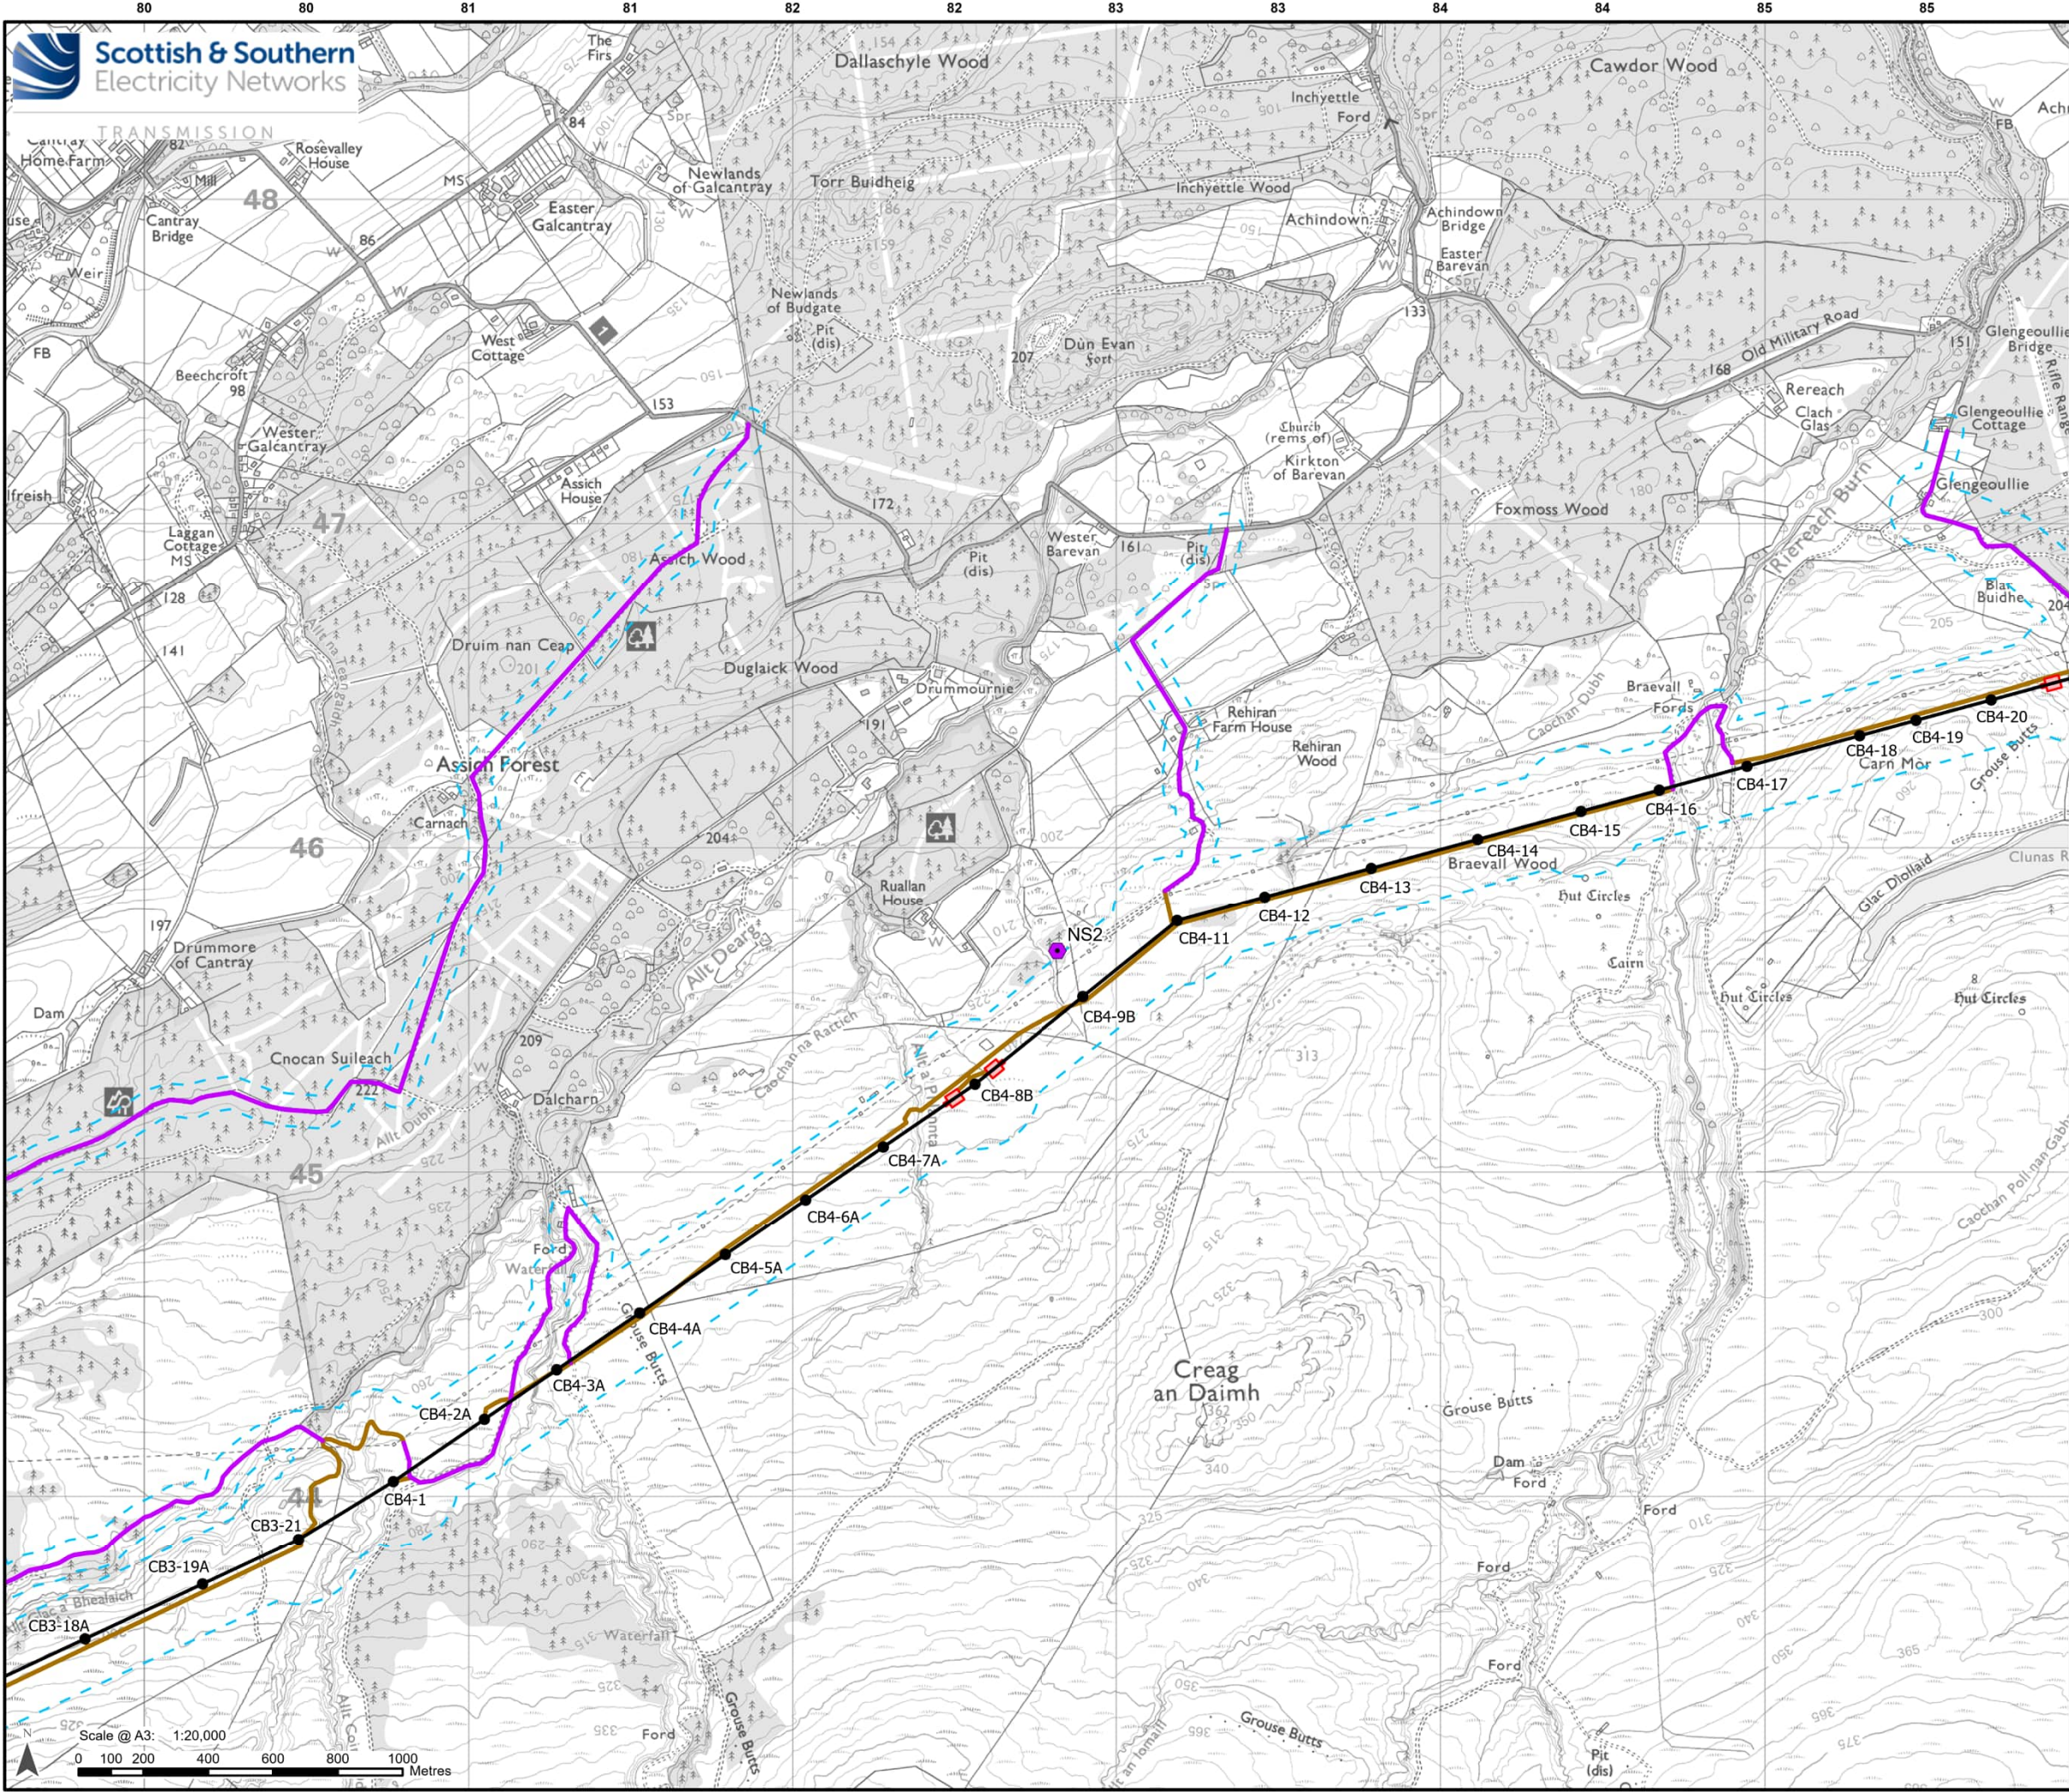

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Other Notable Species (NS)

- Common Lizard

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure: 8.1.6 – Other Protected and Notable Species Survey Results
Page 6 of 18

Drawn by: MAL **Date:** 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

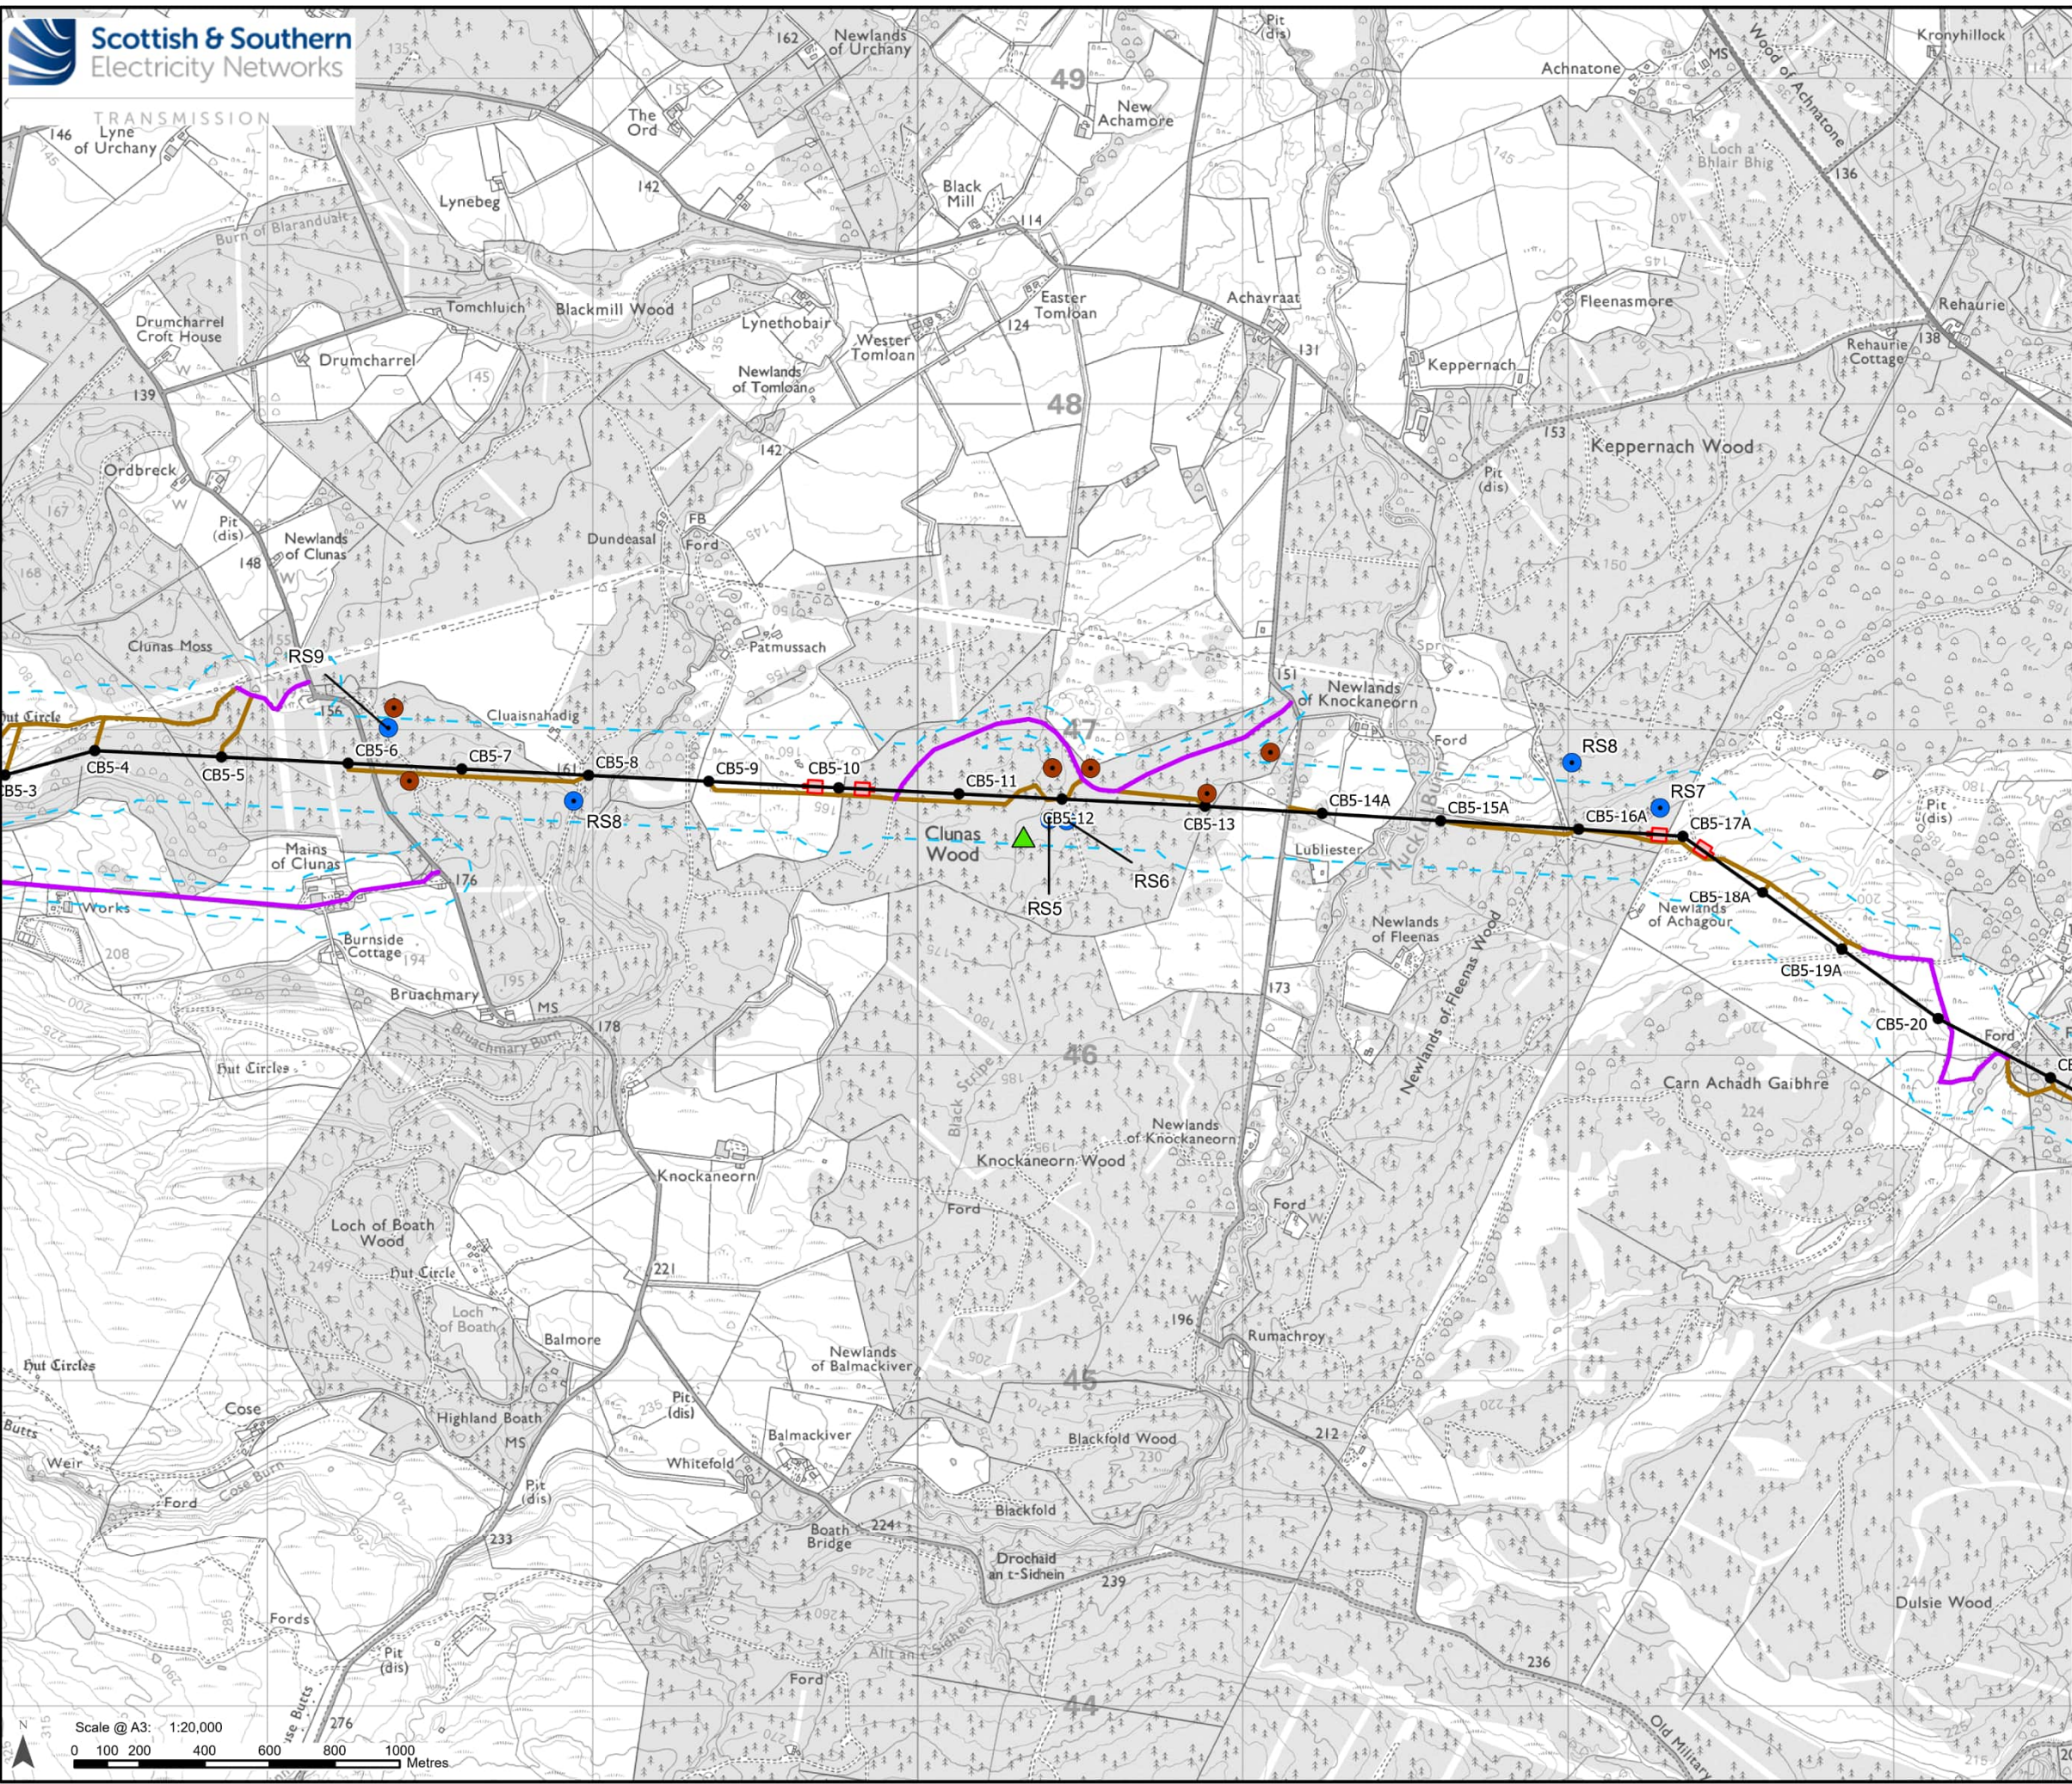

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Red Squirrel Squirrel Result (RS)

- Feeding Sign
- Potential Drey

Otter Survey Result (O)

- Spraint - not individually labelled

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 8.1.6 – Other Protected and Notable Species Survey Results
Page 7 of 18

Drawn by: MAL **Date:** 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

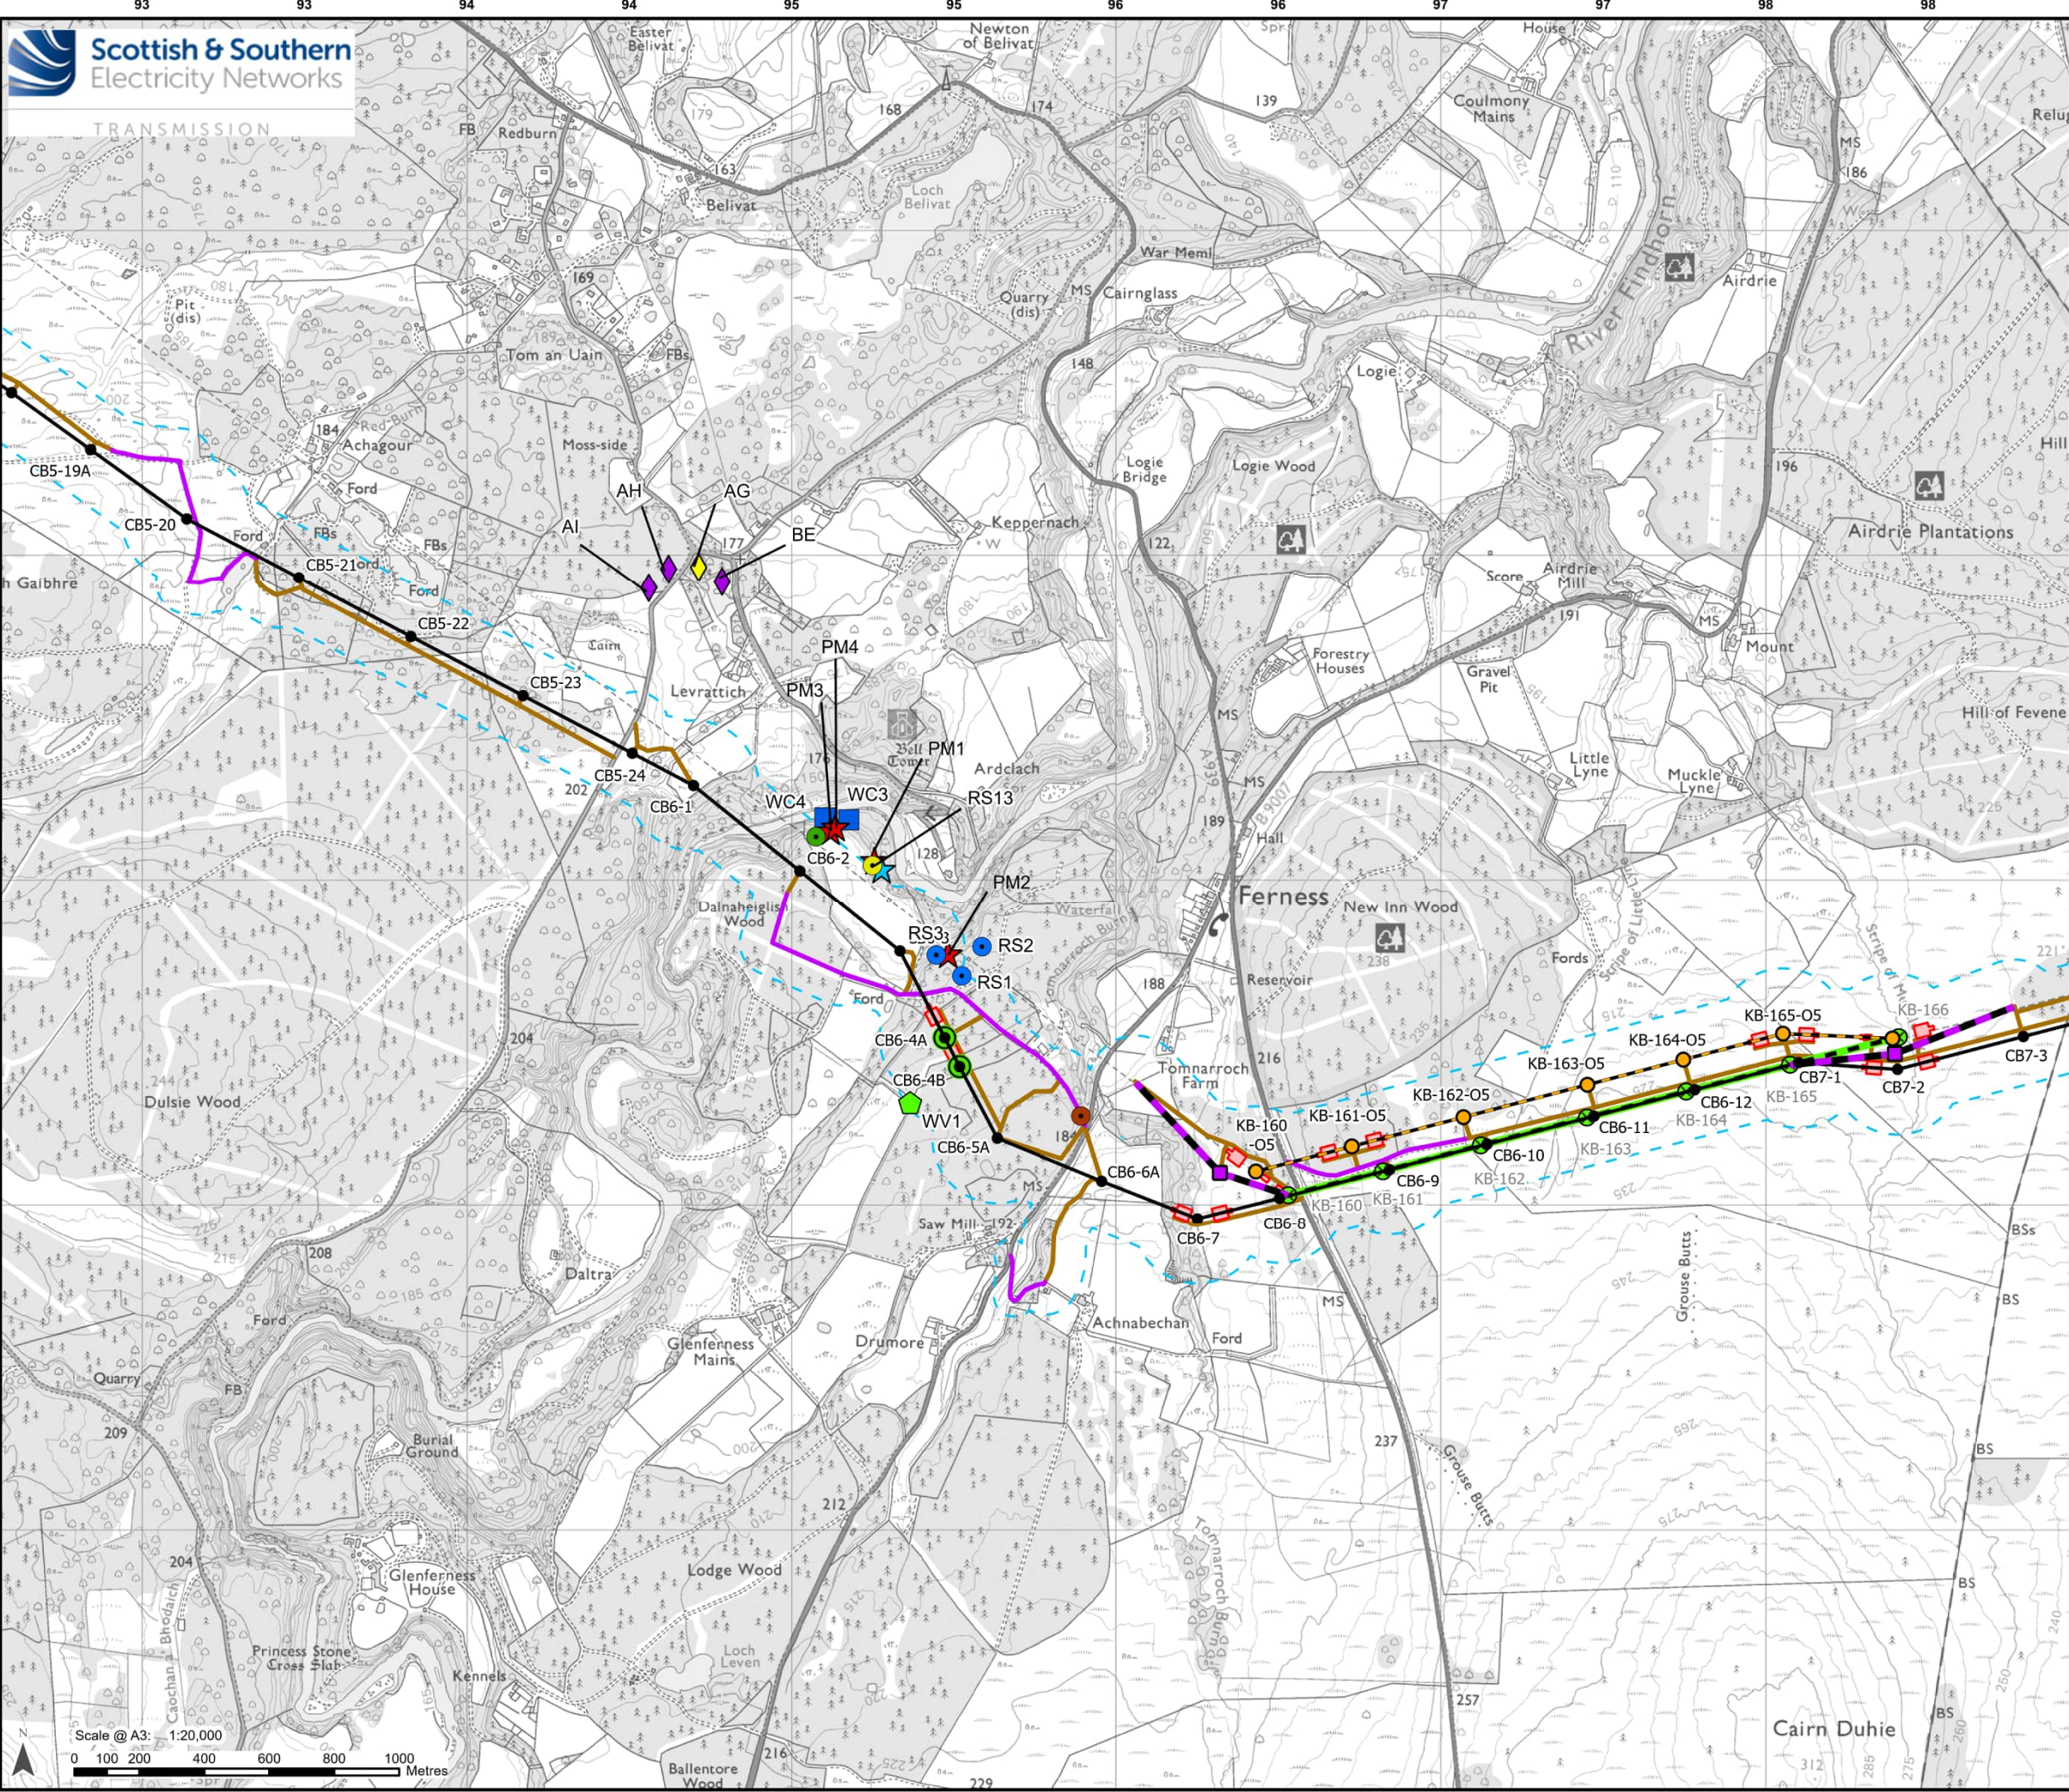

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary
- Transposition Towers
- Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Watervole Survey Result (WV)

- Potential Burrow

Red Squirrel Squirrel Result (RS)

- Feeding Sign
- Feeding Station
- Potential Drey
- Sighting

Pine Marten Survey Result (PM)

- Denning Habitat
- Potential Scat

Wildcat Survey Result (WC)

- Potential Resting Site

Great Crested Newt Survey Result

Habitat Suitability Index Result

- Good
- Poor

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 8.1.6 – Other Protected and Notable Species Survey Results
Page 8 of 18

Drawn by: MAL Date: 01/10/2025

Drawing: B2P-WSP-DA-70092380-084