


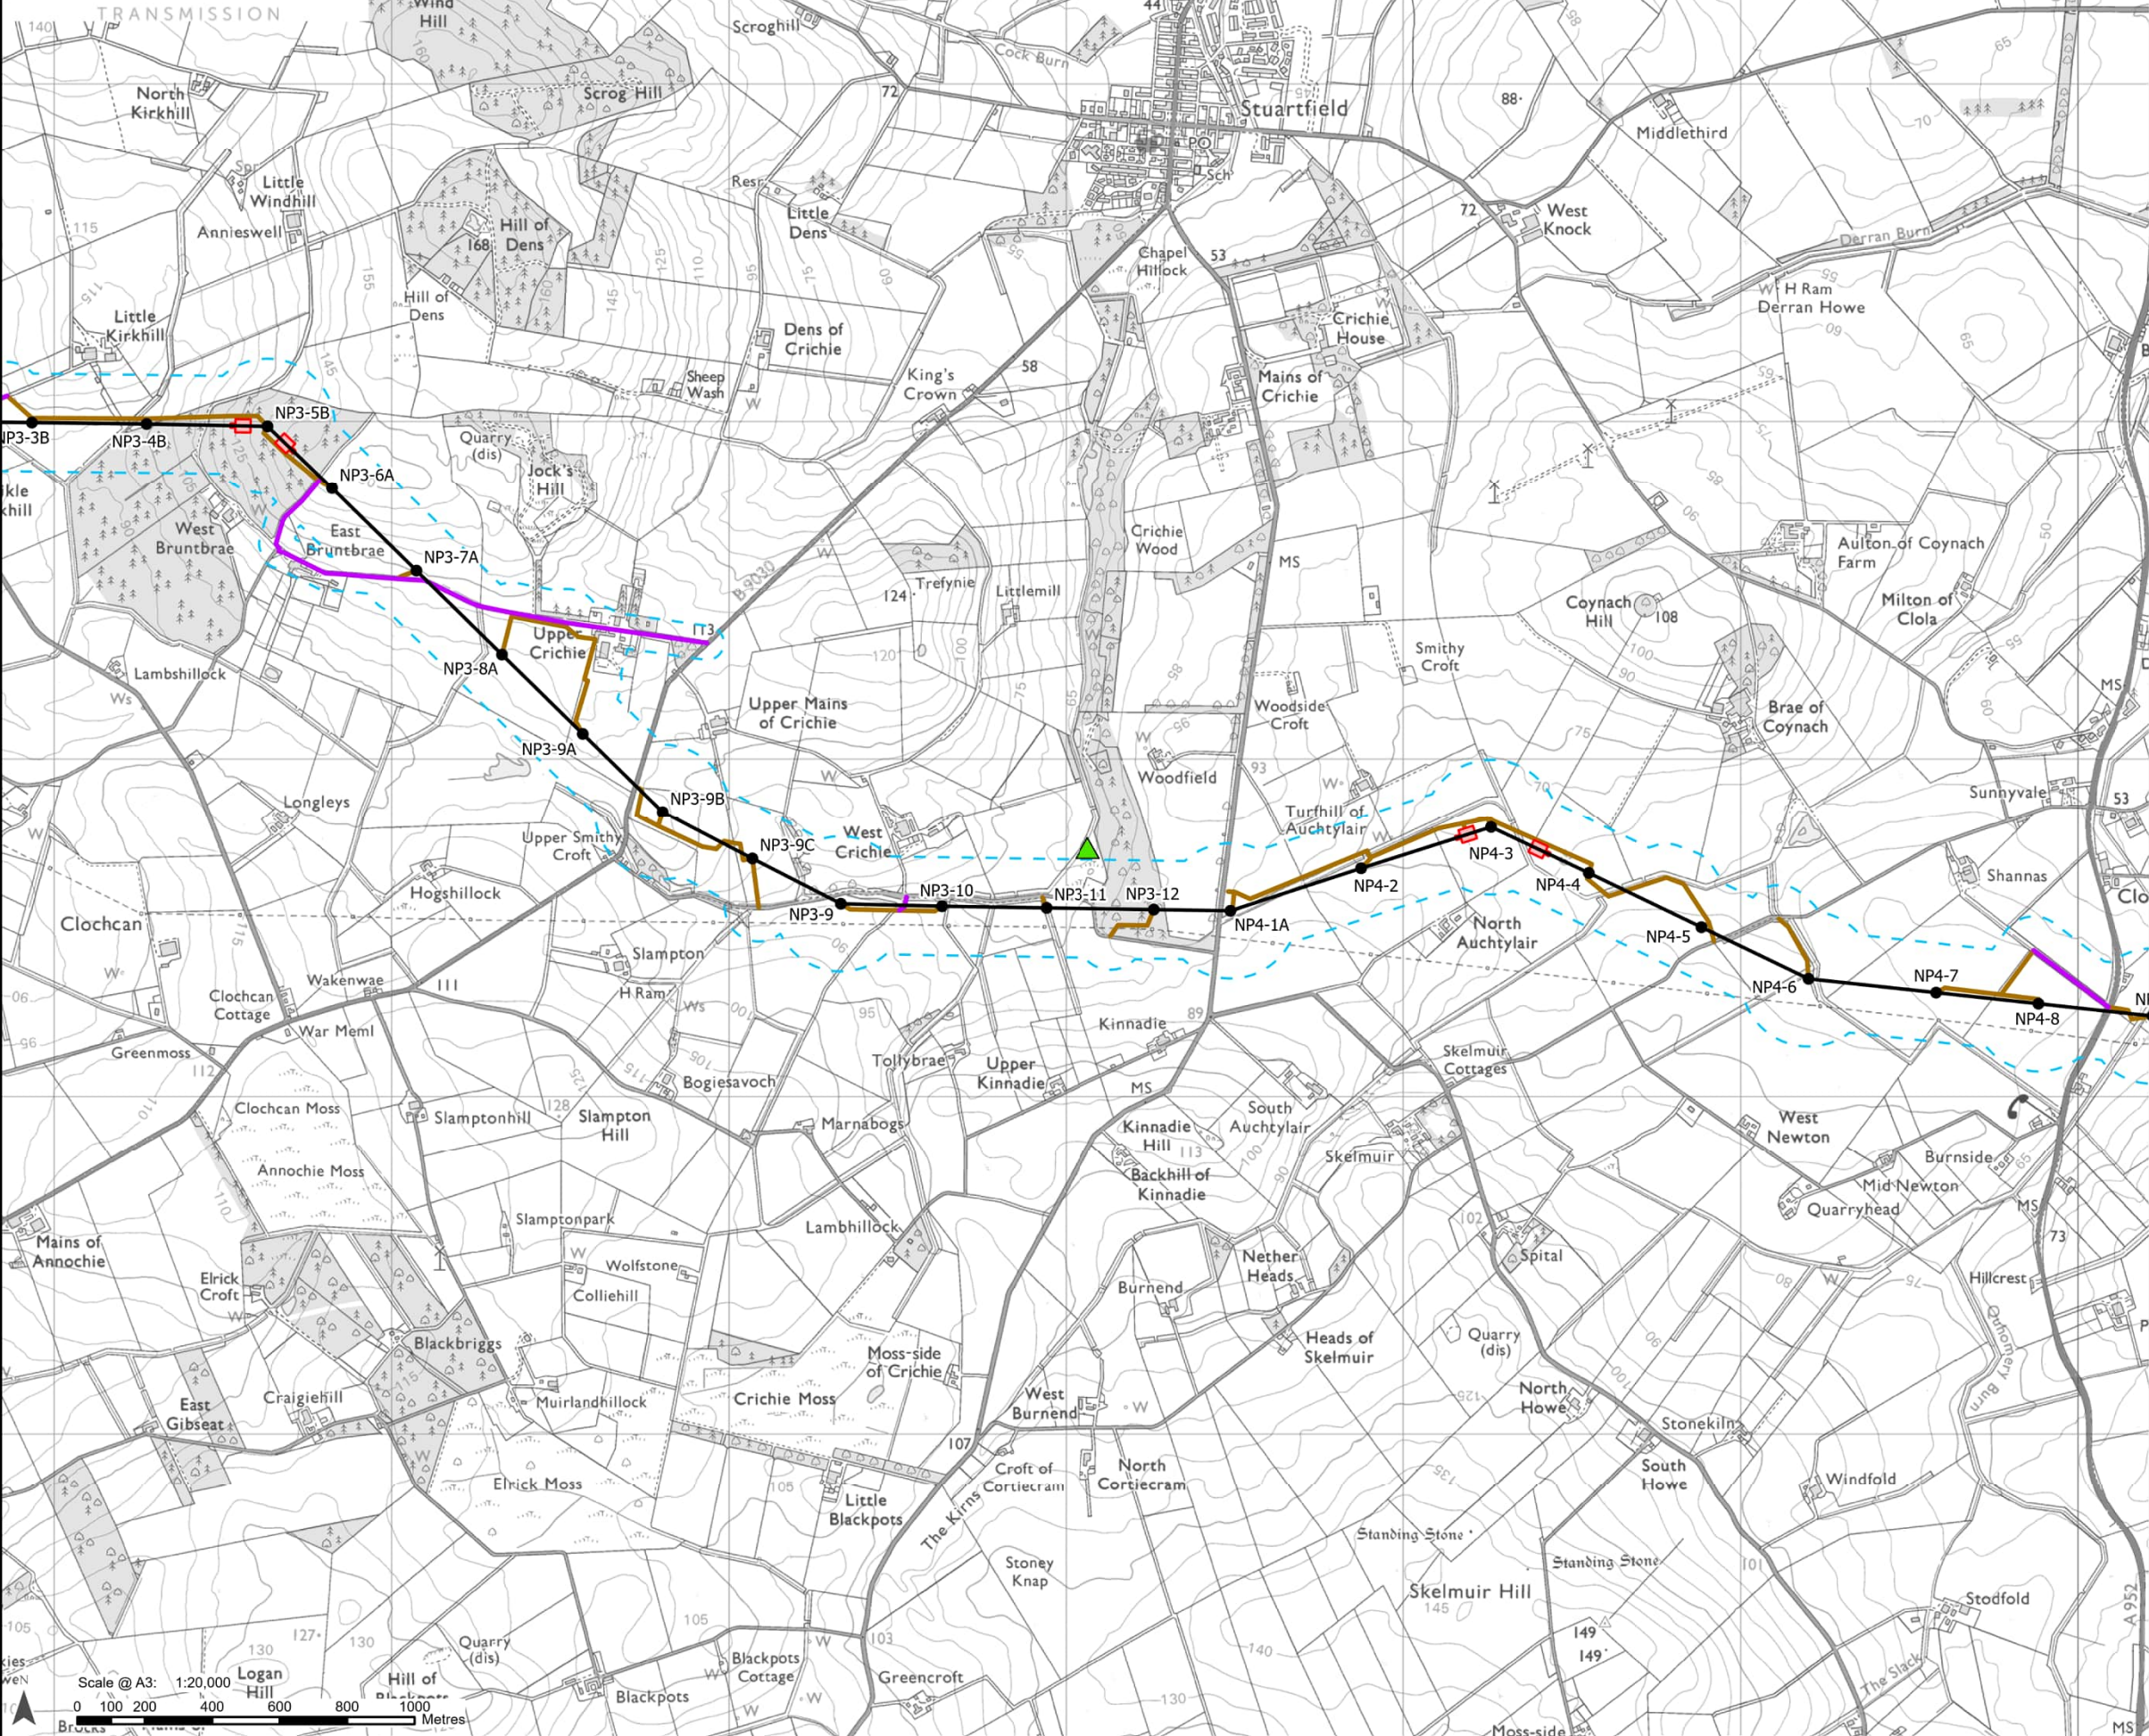

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Other Survey Result (O)

- Spraint - not individually labelled

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhilllock to New Deer to Peterhead 400 kV OHL Project

Title: Figure: 8.1.6 – Other Protected and Notable Species Survey Results
Page 18 of 18

Drawn by: MAL Date: 01/10/2025

Drawing: B2P-WSP-DA-70092380-084

