


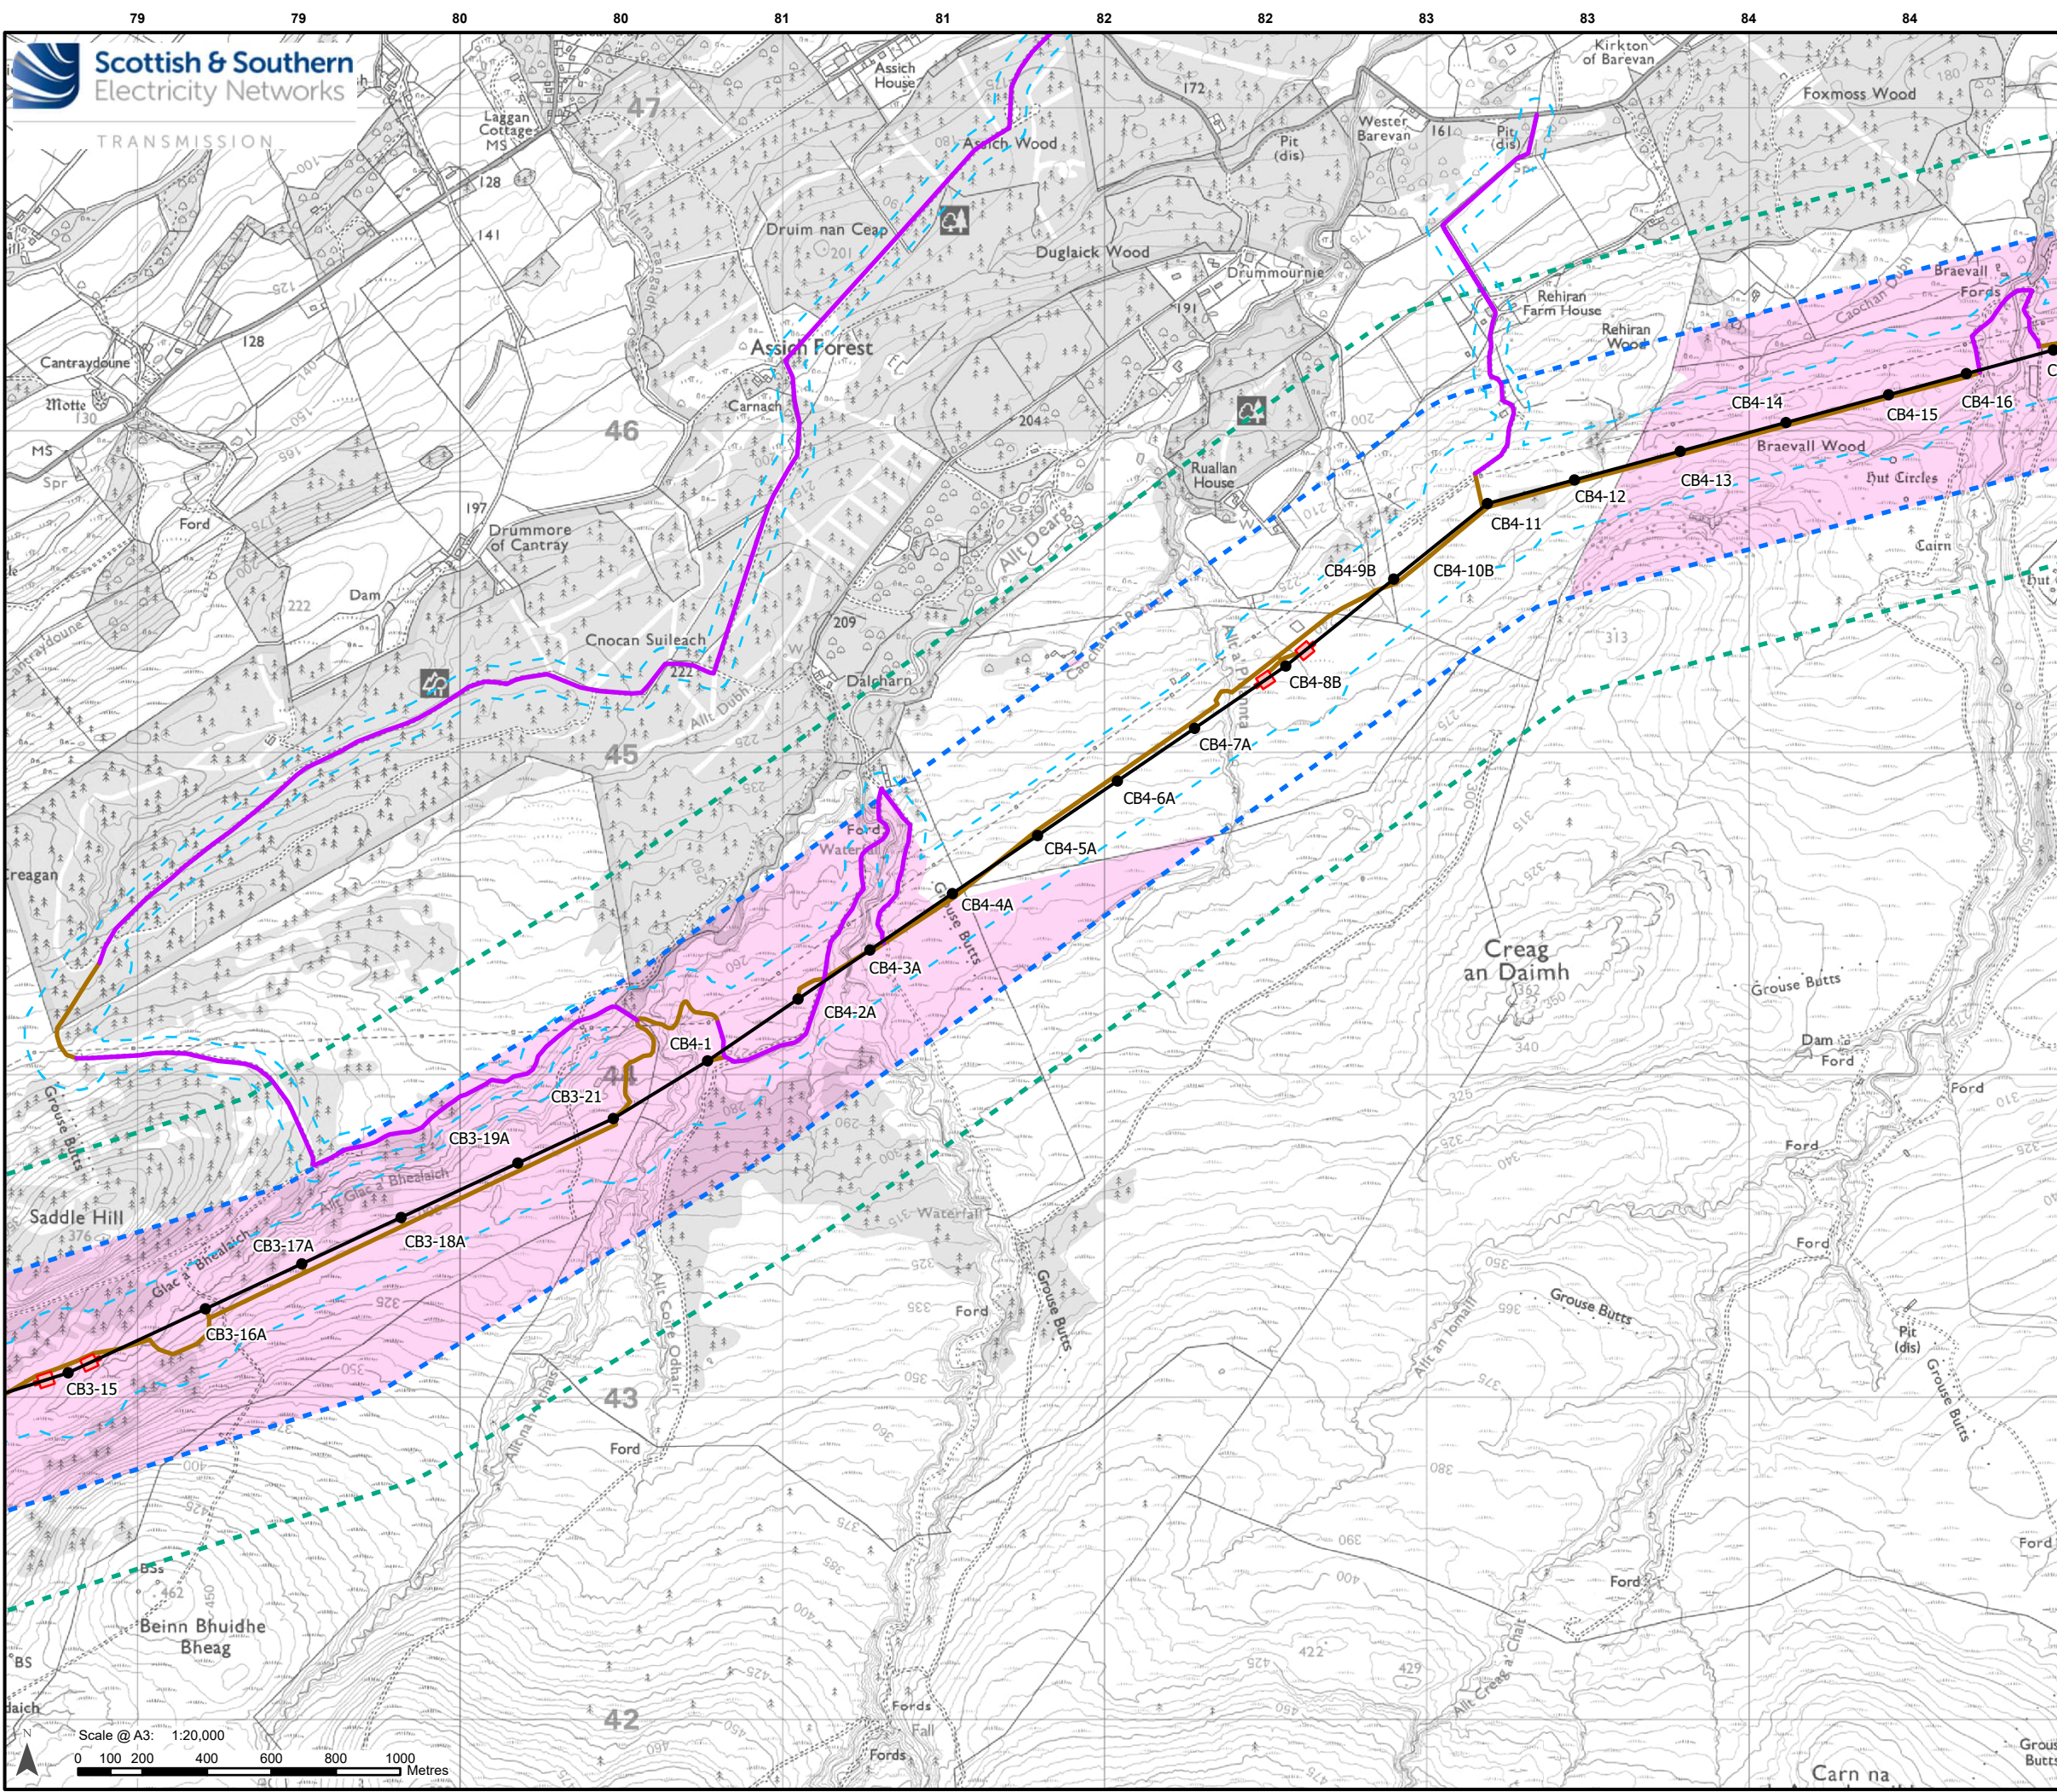

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*

Species Study Area

- Great Crested Newt Suitability Survey Area*

Access Constraint

- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.1 - Survey Areas and Access Constraints
Page 7 of 29

Drawn by: MAL Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-080

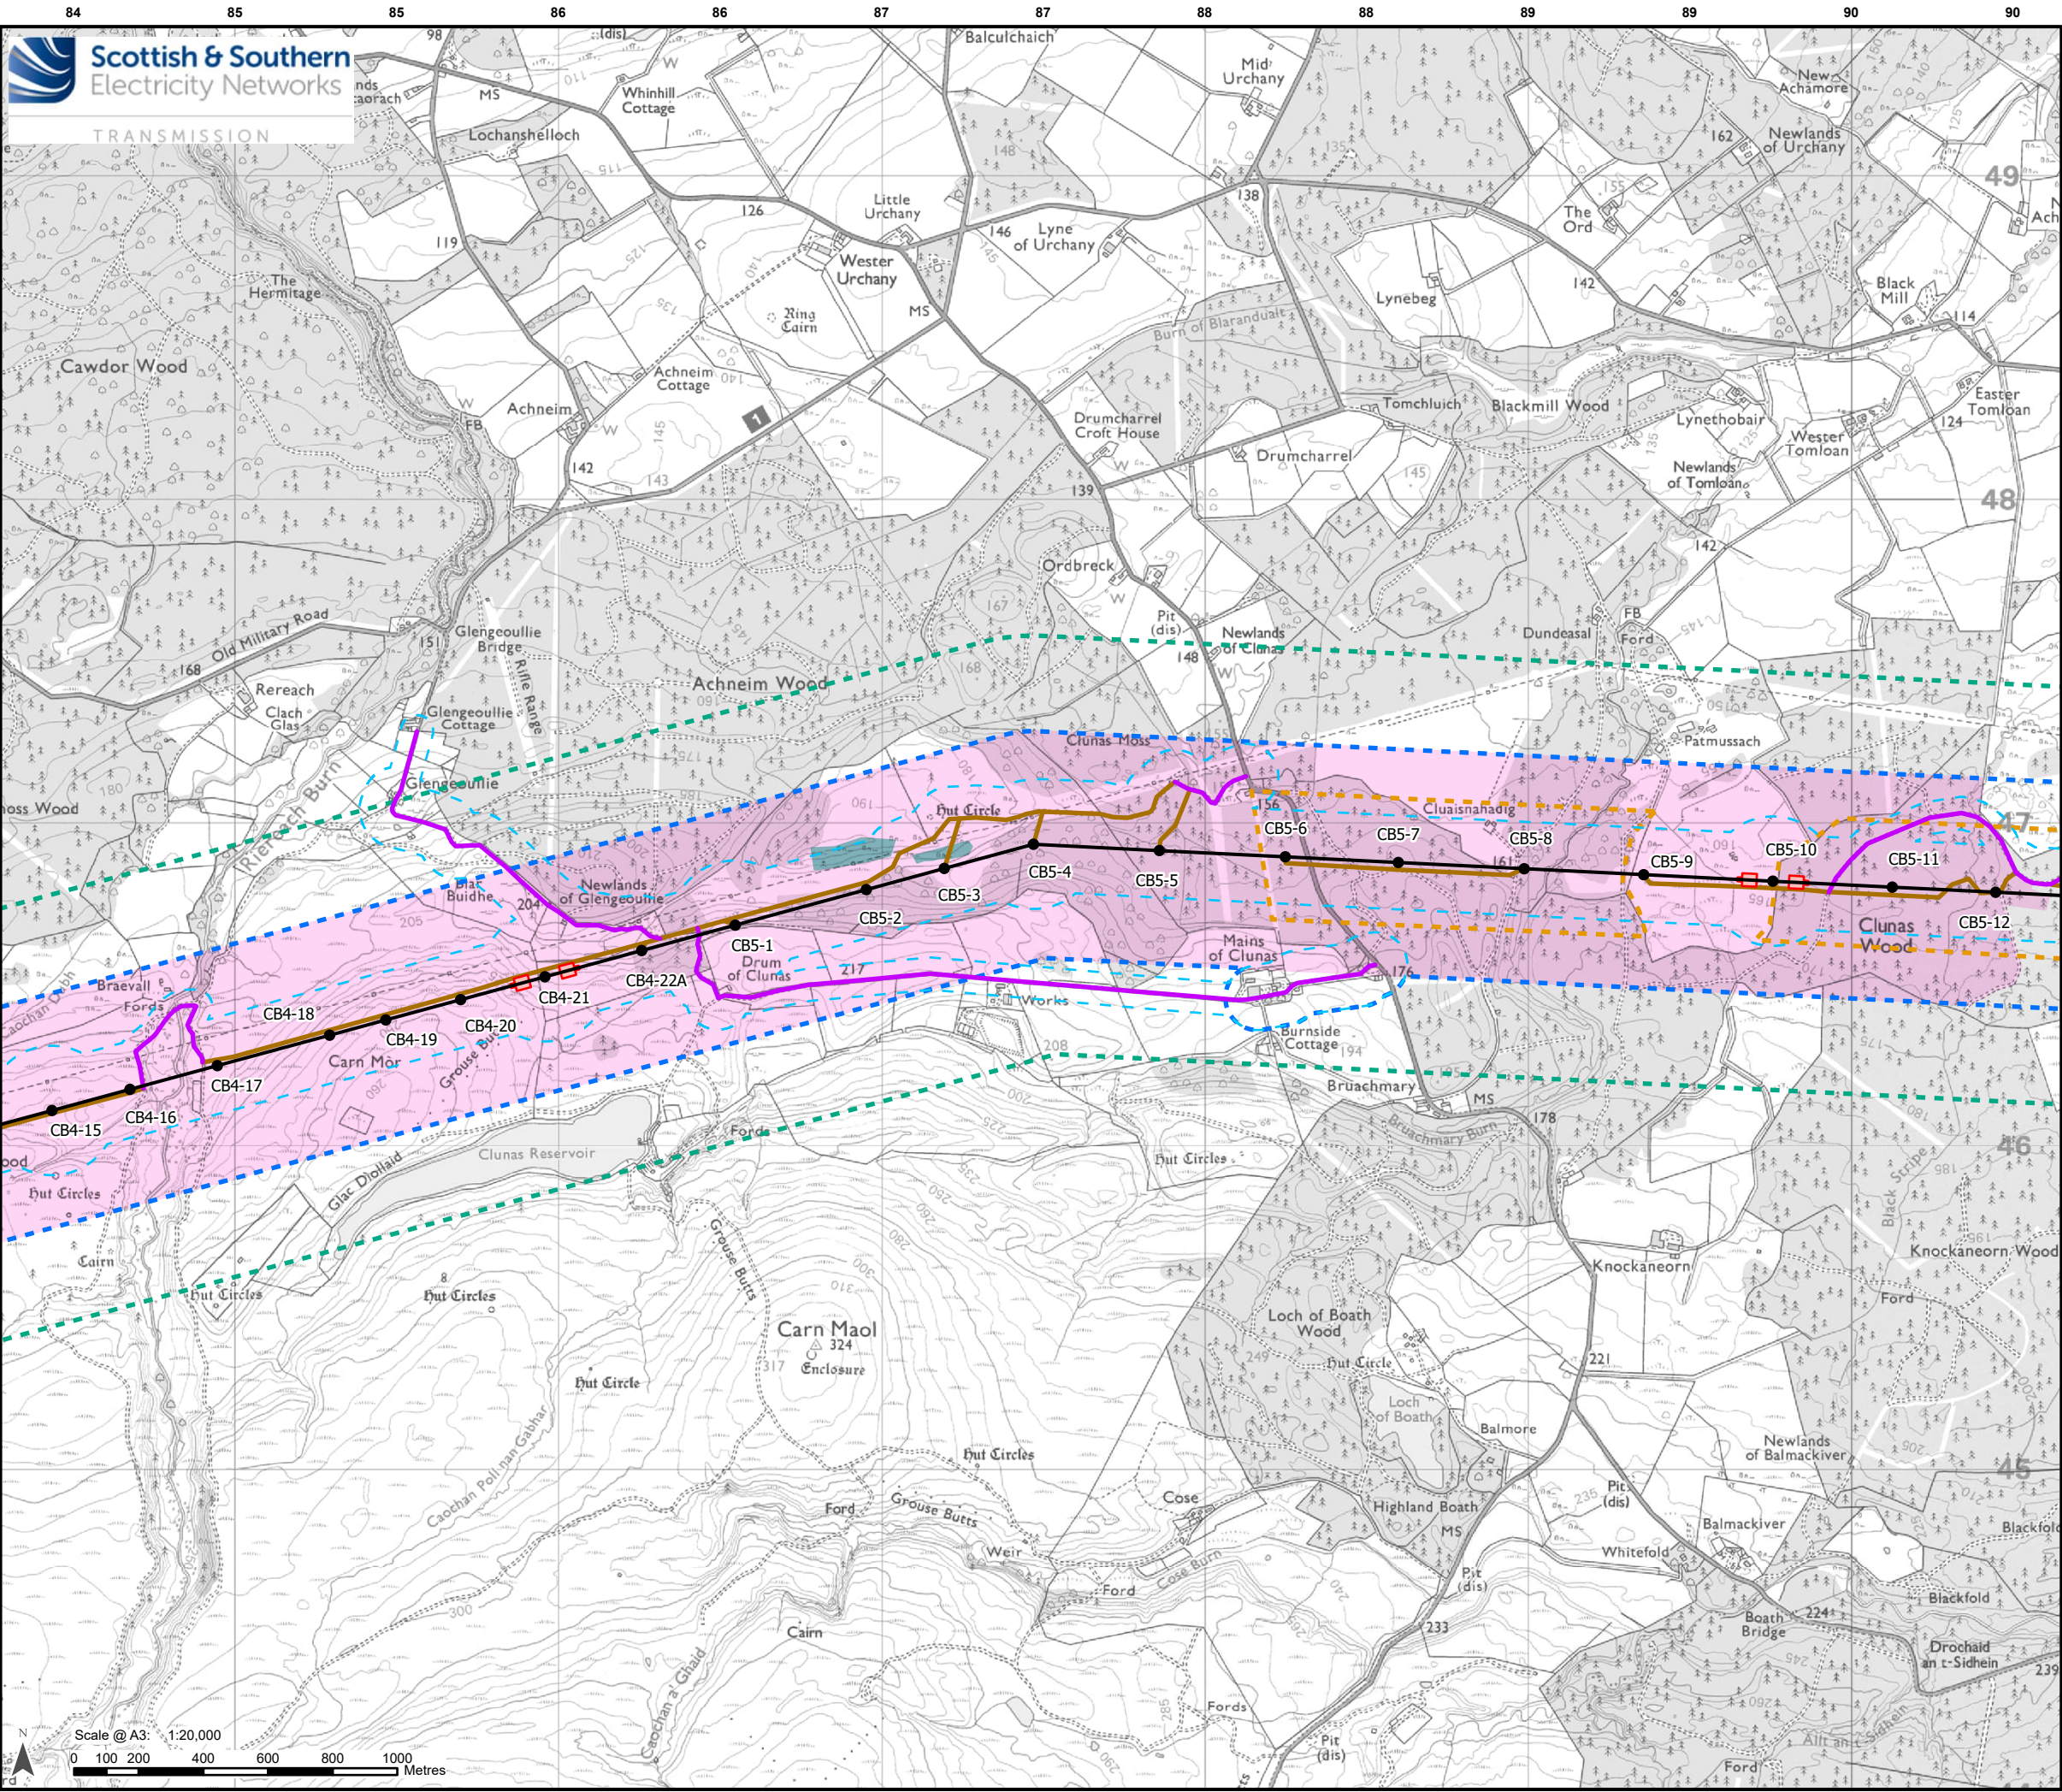

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*

Species Study Area

- Red Squirrel Survey Area
- Great Crested Newt Suitability Survey Area*

Access Constraint


- Protected Species Access Constraint
- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 8.1.1 - Survey Areas and Access Constraints Page 8 of 29		
Drawn by:	MAL	Date:	01/09/2025
Drawing:	B2P-WSP-DA-70092380-080		

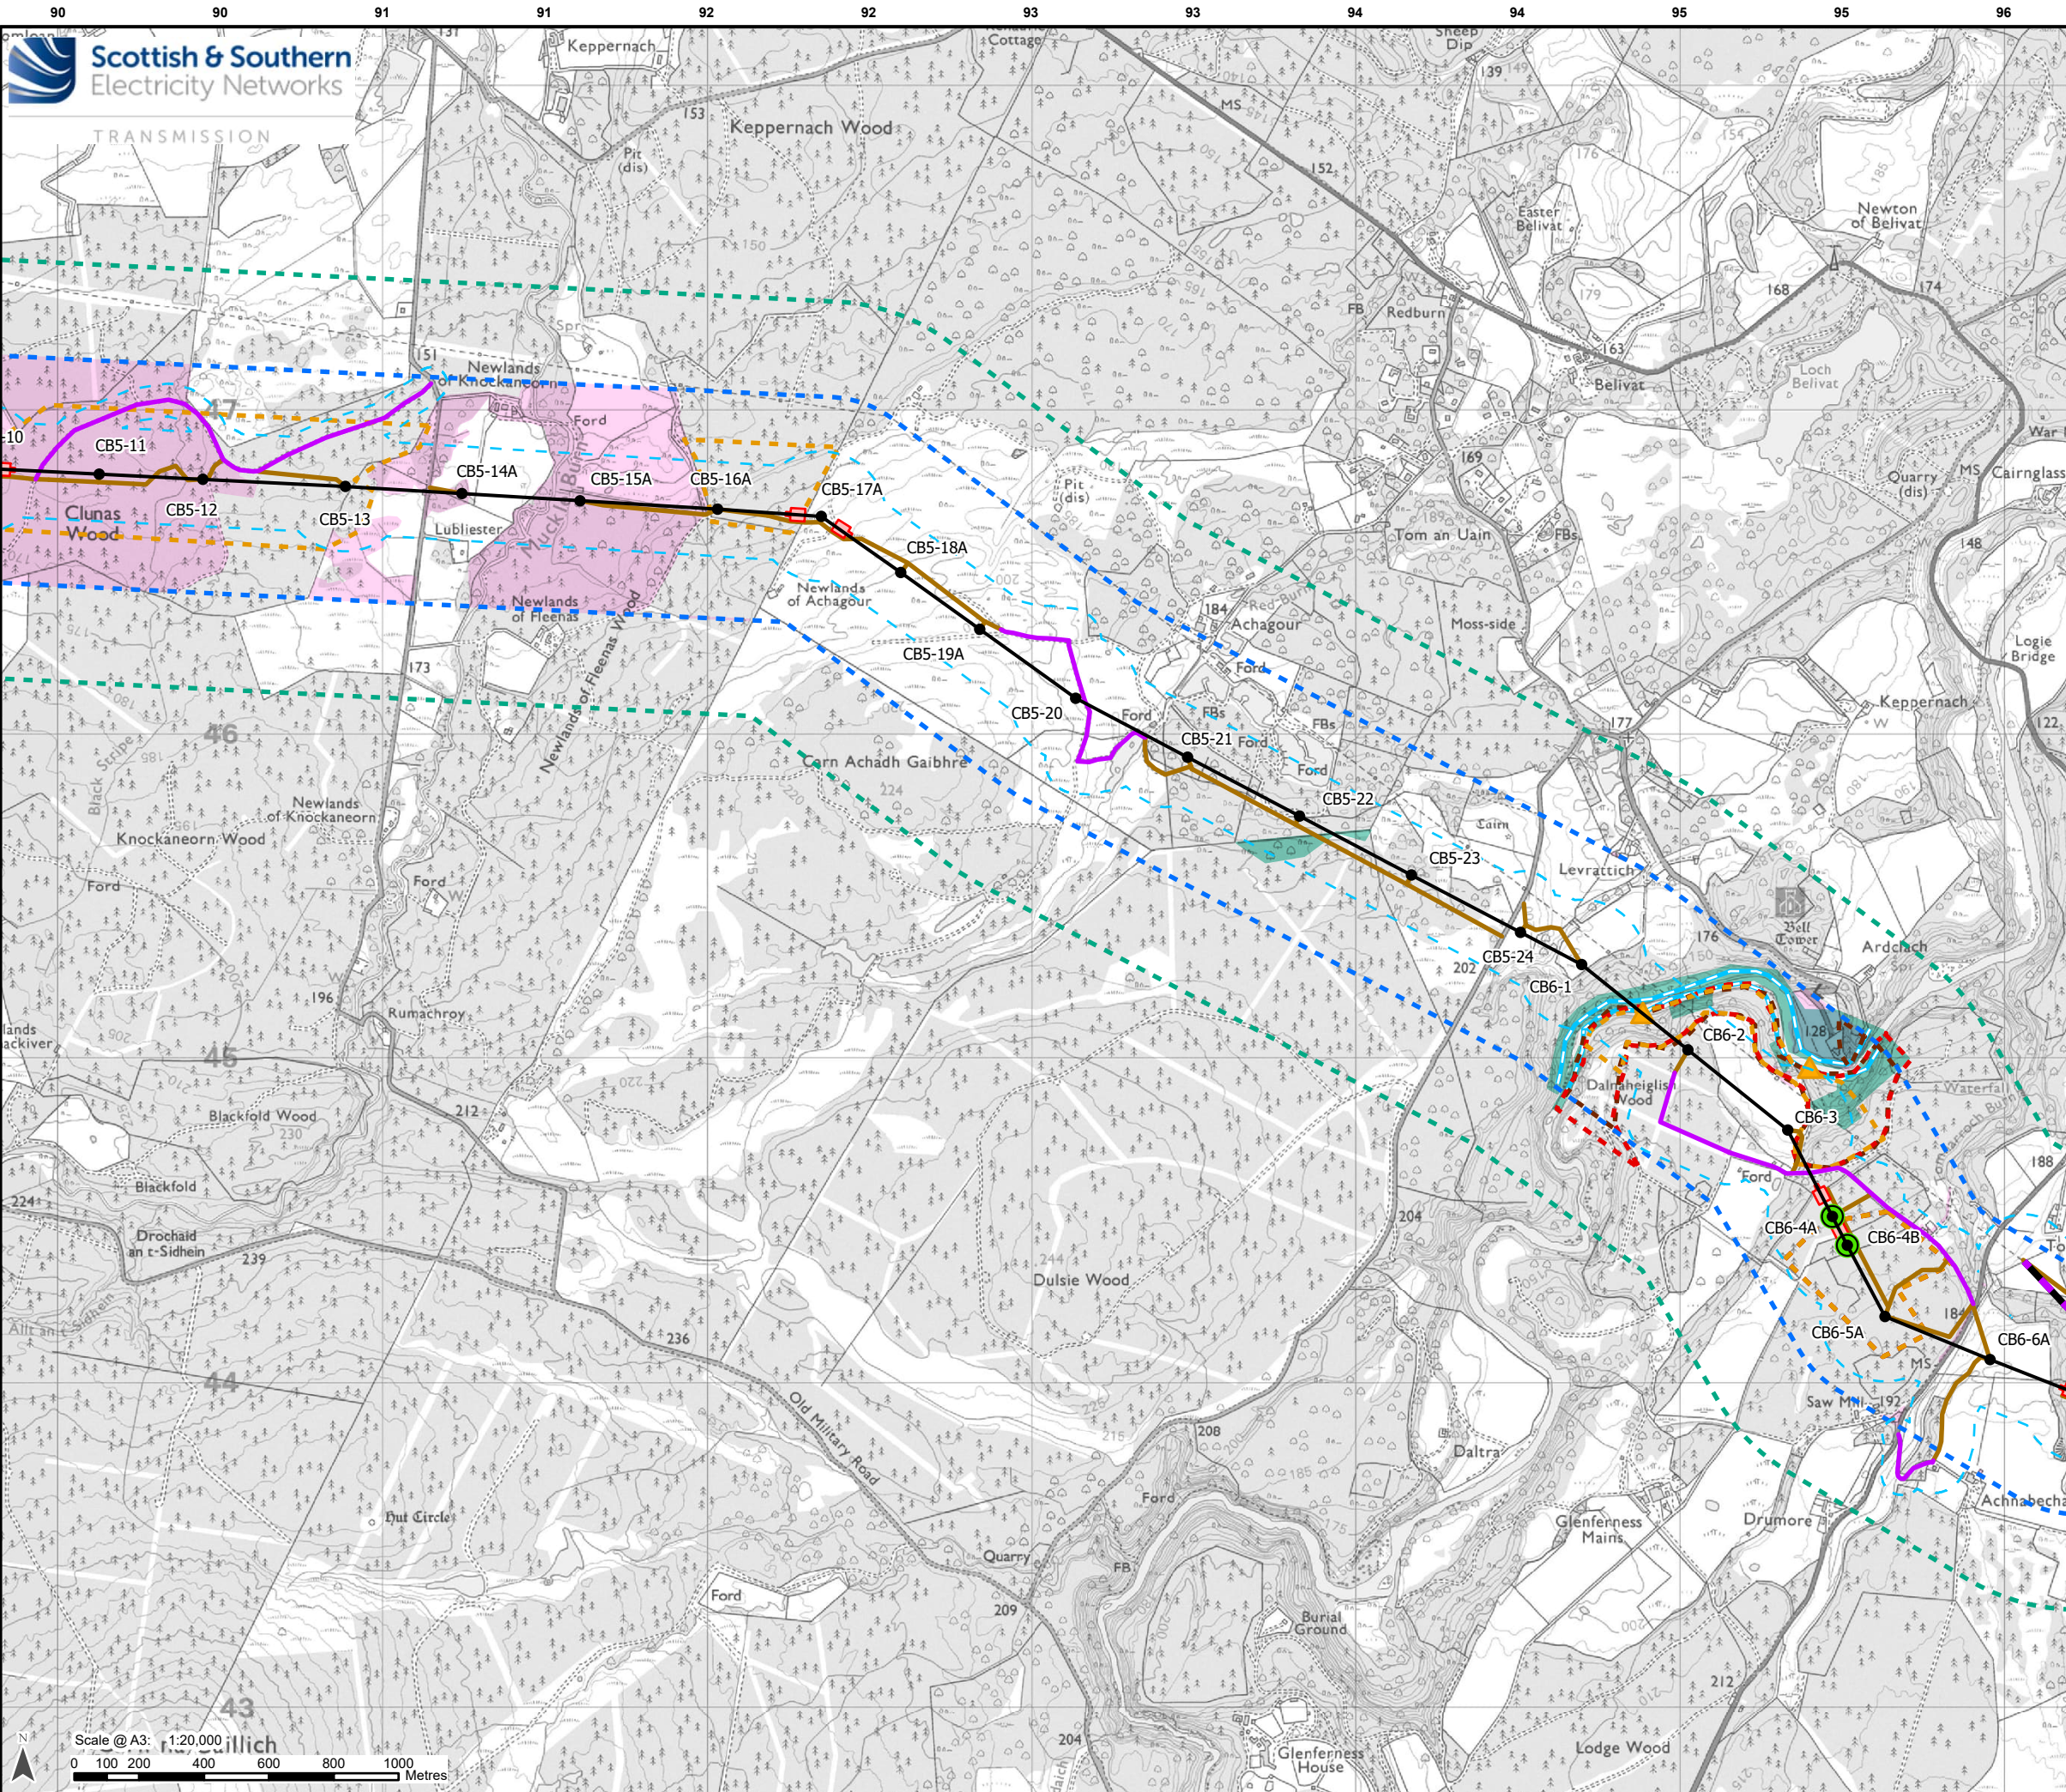

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Transposition Towers
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*
- Fish Survey Area

Species Study Area

- Red Squirrel Survey Area
- Pine Marten Survey Area
- Wildcat Survey Area
- Otter and Water Vole Survey Area
- Great Crested Newt Suitability Survey Area*

Access Constraint

- Protected Species Access Constraint
- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.1 - Survey Areas and Access Constraints
Page 9 of 29

Drawn by: MAL Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-080

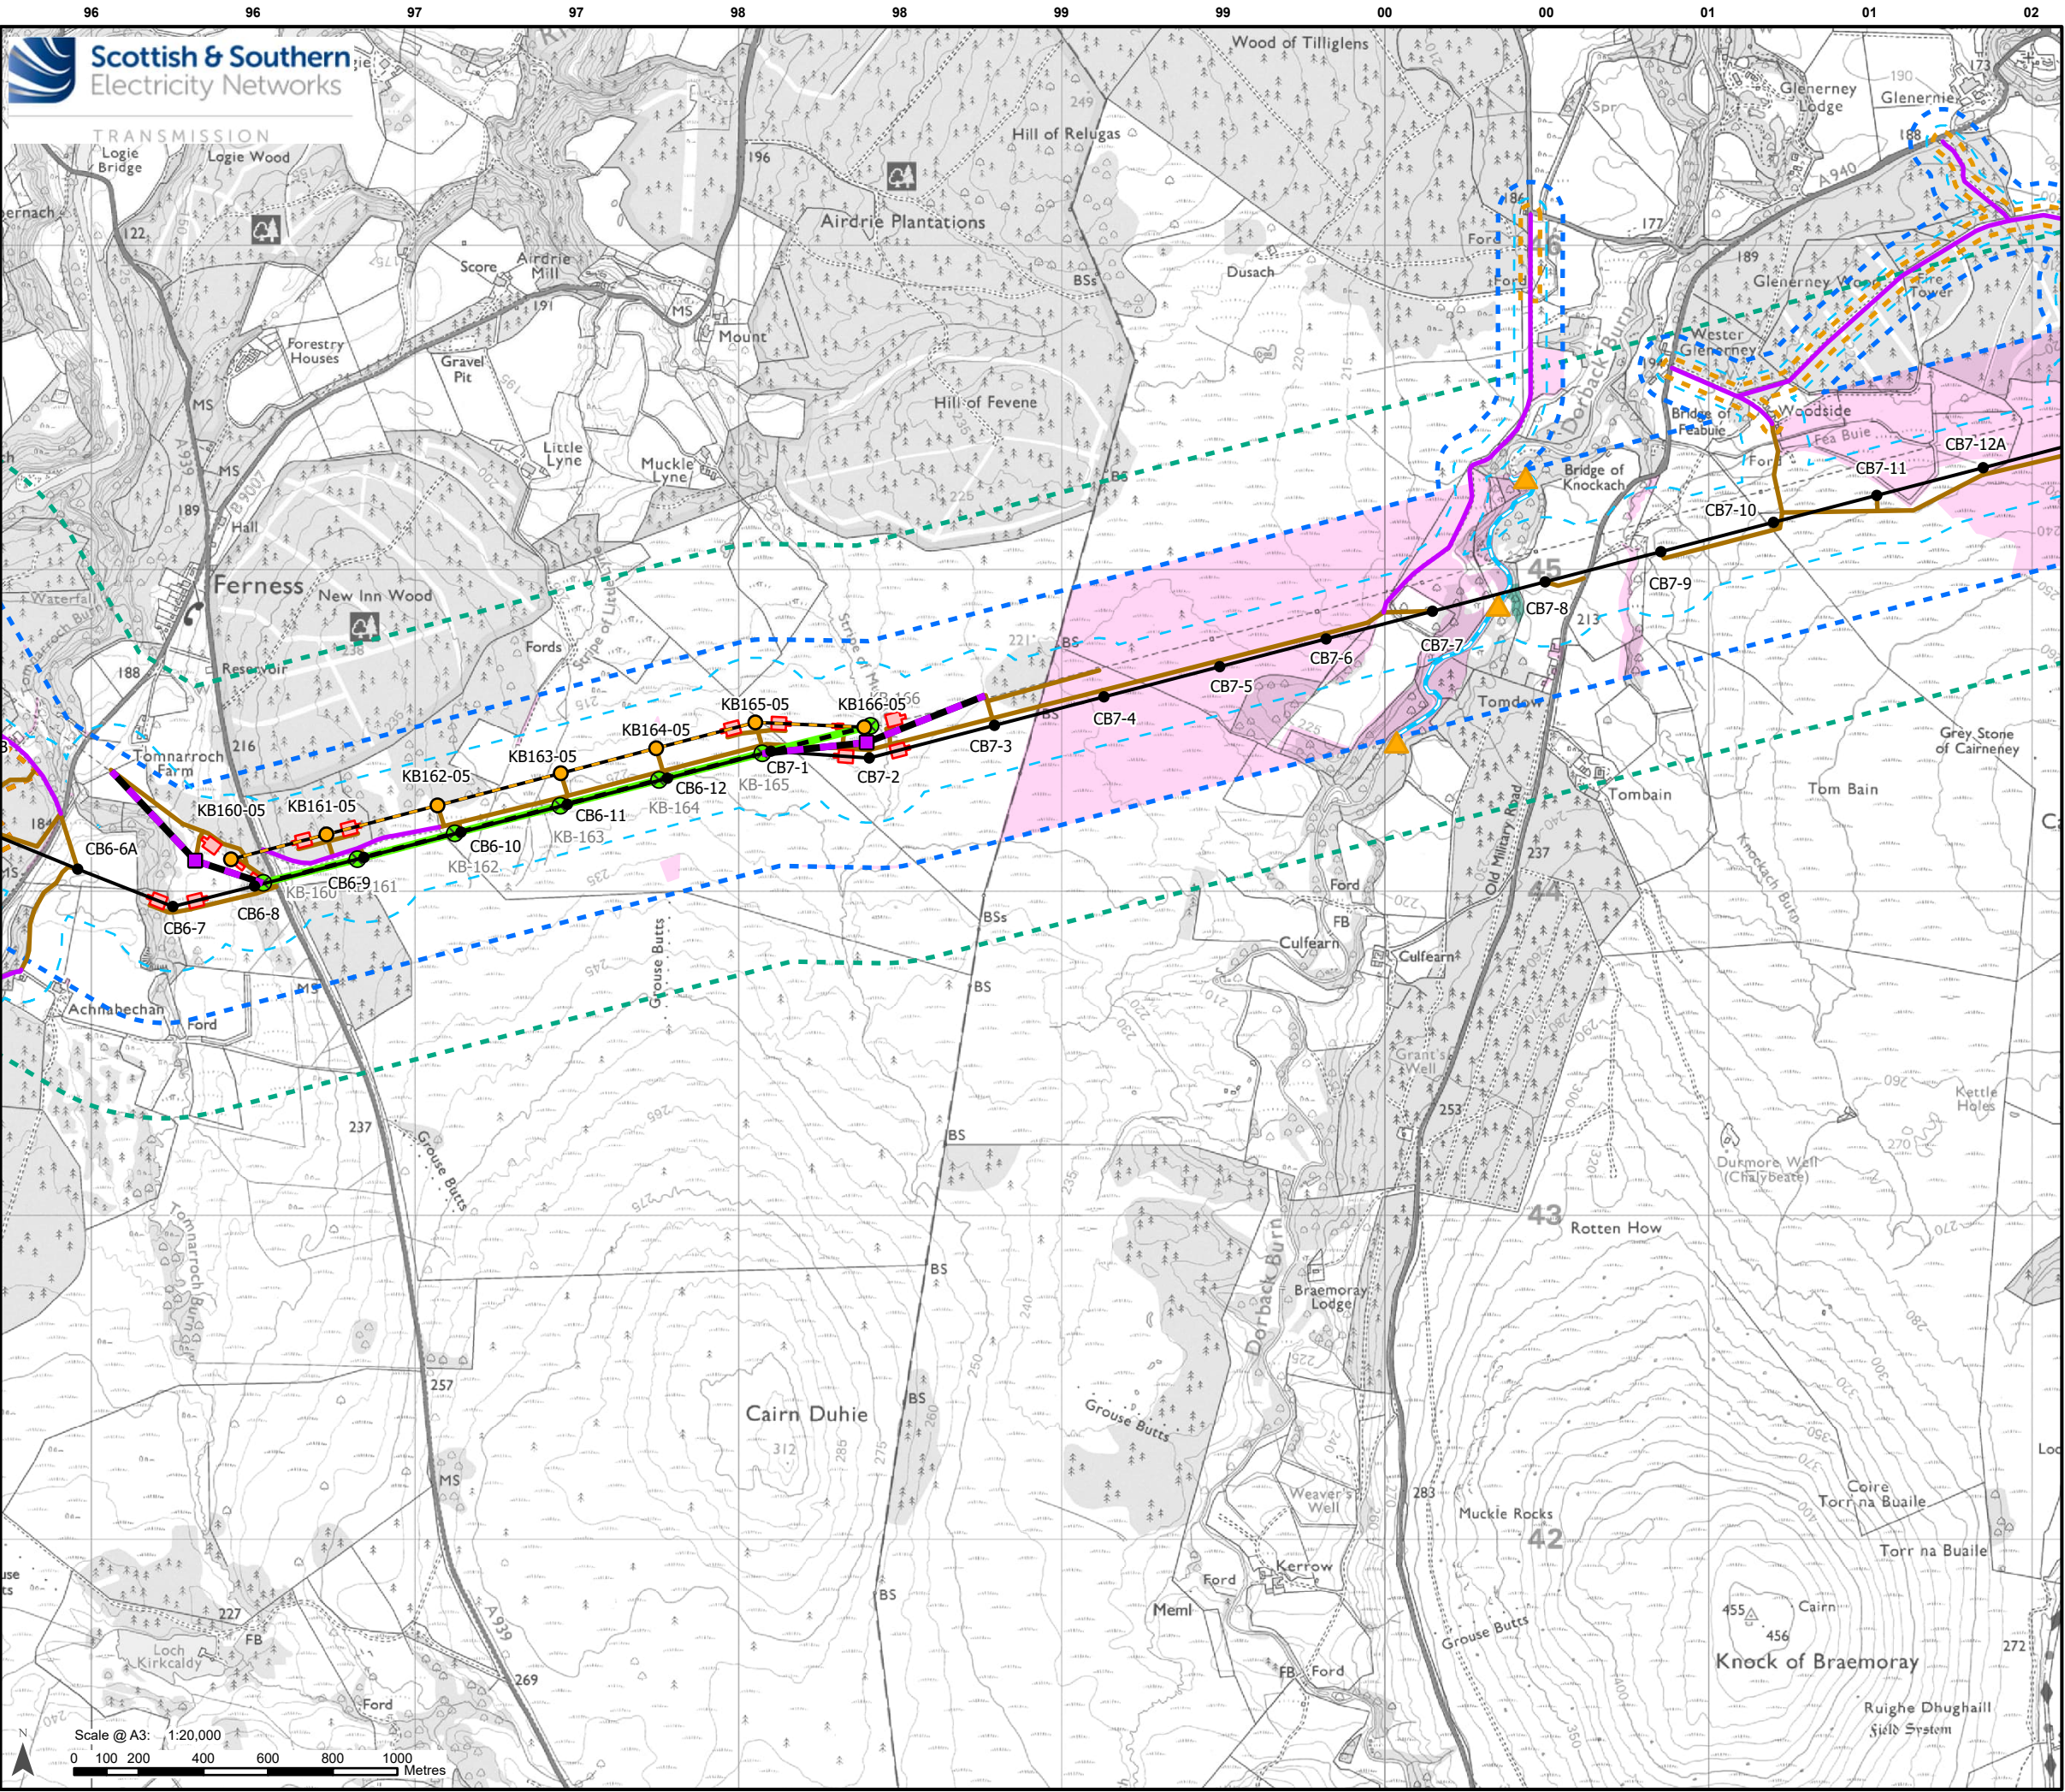

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary
- Limit of Deviation

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*
- Fish Survey Area

Species Study Area

- Red Squirrel Survey Area
- Pine Marten Survey Area
- Wildcat Survey Area
- Otter and Water Vole Survey Area
- Great Crested Newt Suitability Survey Area*

Access Constraint

- Protected Species Access Constraint
- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.1 - Survey Areas and Access Constraints
Page 10 of 29

Drawn by: MAL Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-080

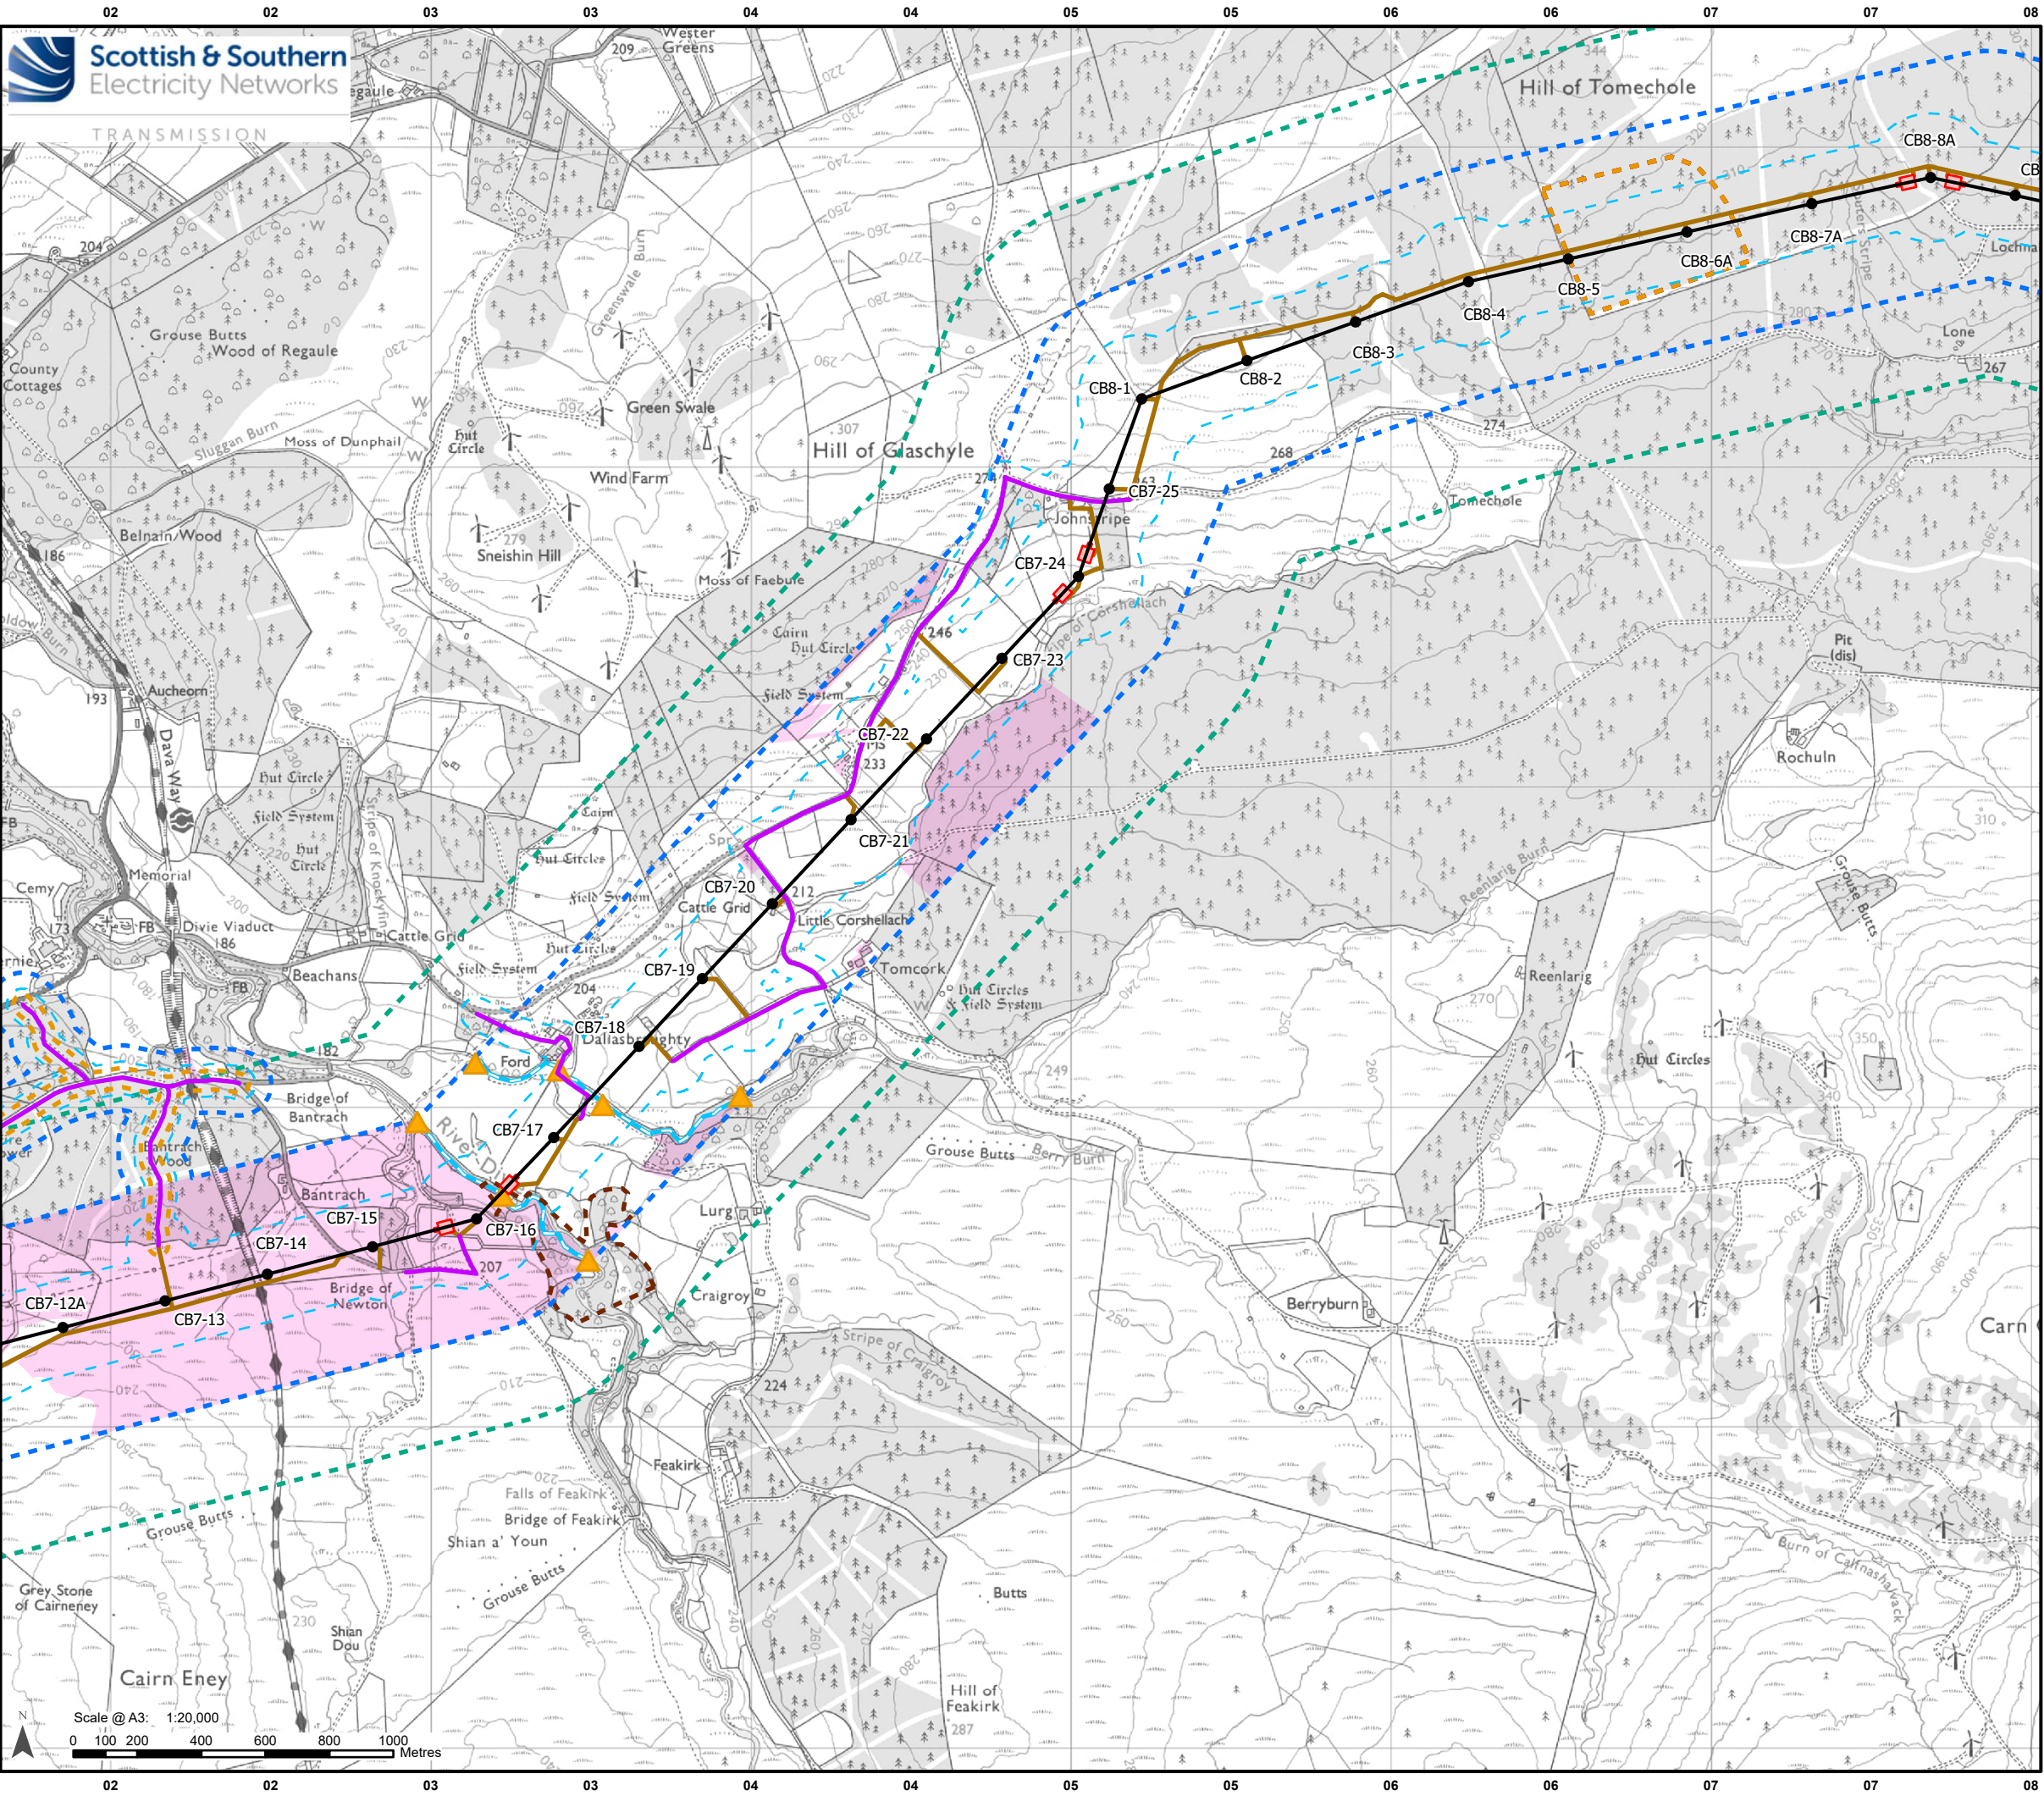

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*
- Fish Survey Area

Species Study Area

- Red Squirrel Survey Area
- Pine Marten Survey Area
- Wildcat Survey Area
- Otter and Water Vole Survey Area
- Great Crested Newt Suitability Survey Area*

Access Constraint


- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 8.1.1 - Survey Areas and Access Constraints Page 11 of 29		
Drawn by:	MAL	Date:	01/09/2025
Drawing:	B2P-WSP-DA-70092380-080		

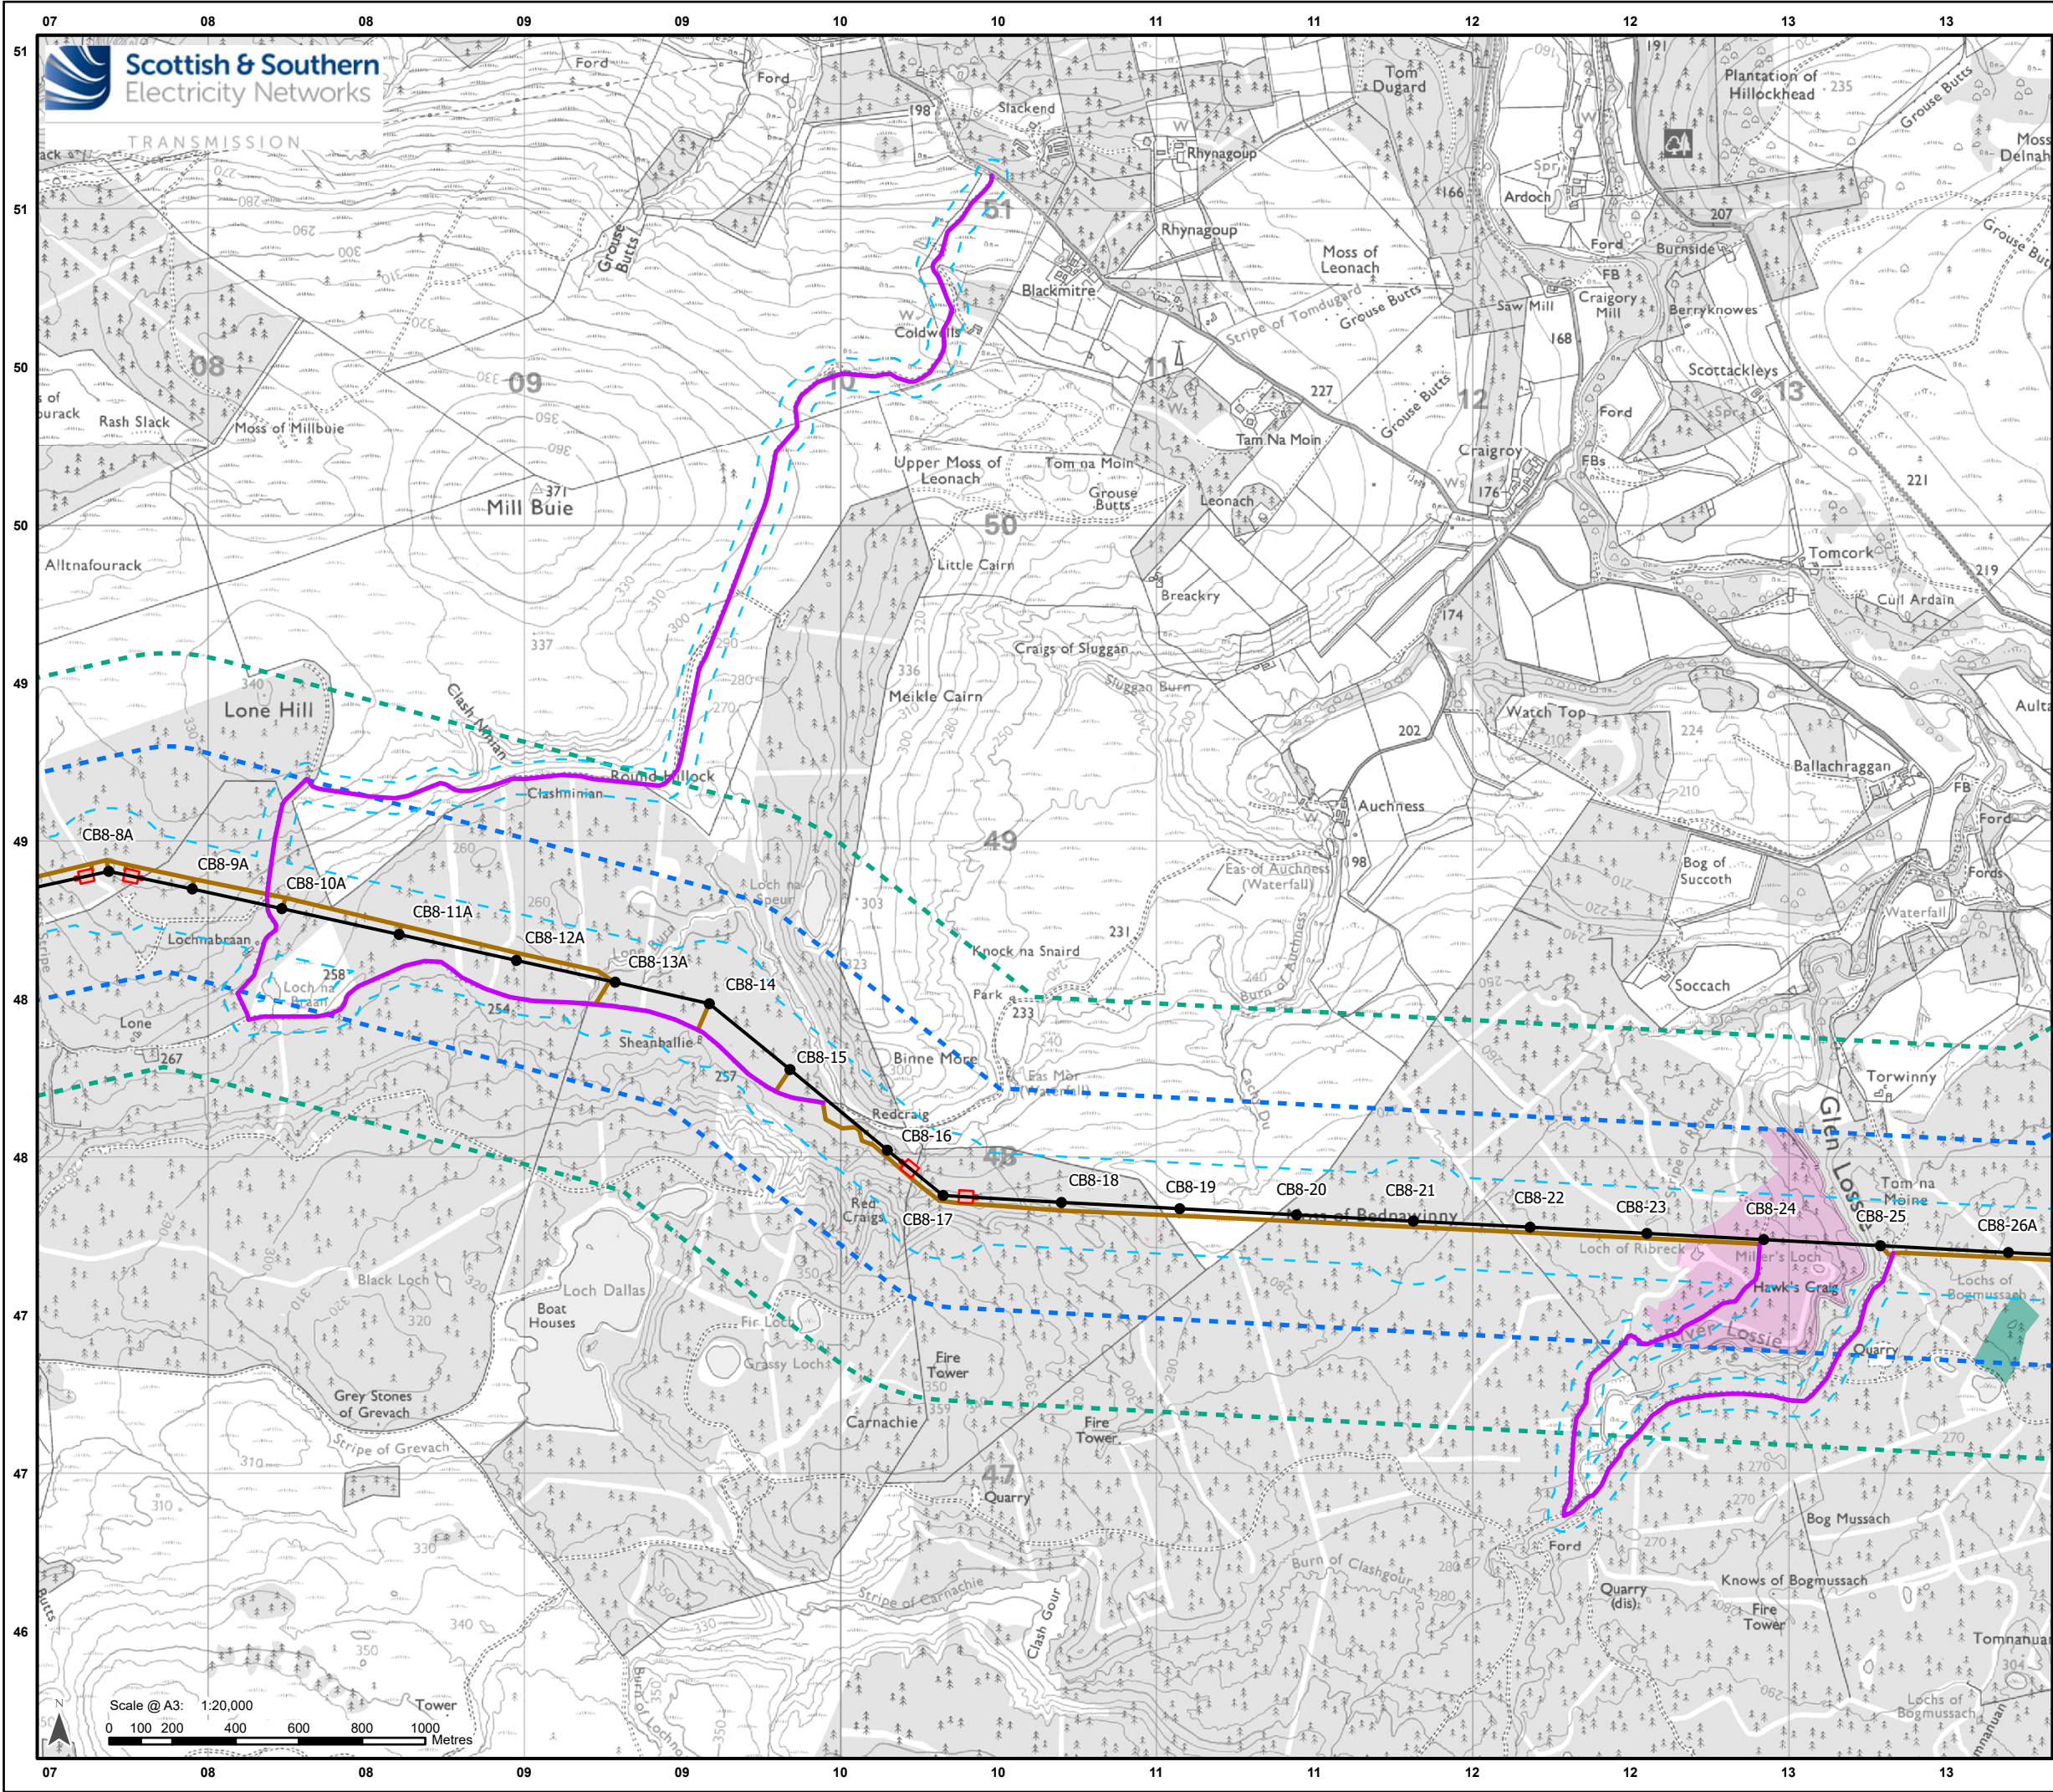

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*

Species Study Area

- Great Crested Newt Suitability Survey Area*

Access Constraint

- Protected Species Access Constraint
- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.1 - Survey Areas and Access Constraints
Page 12 of 29

Drawn by: MAL Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-080

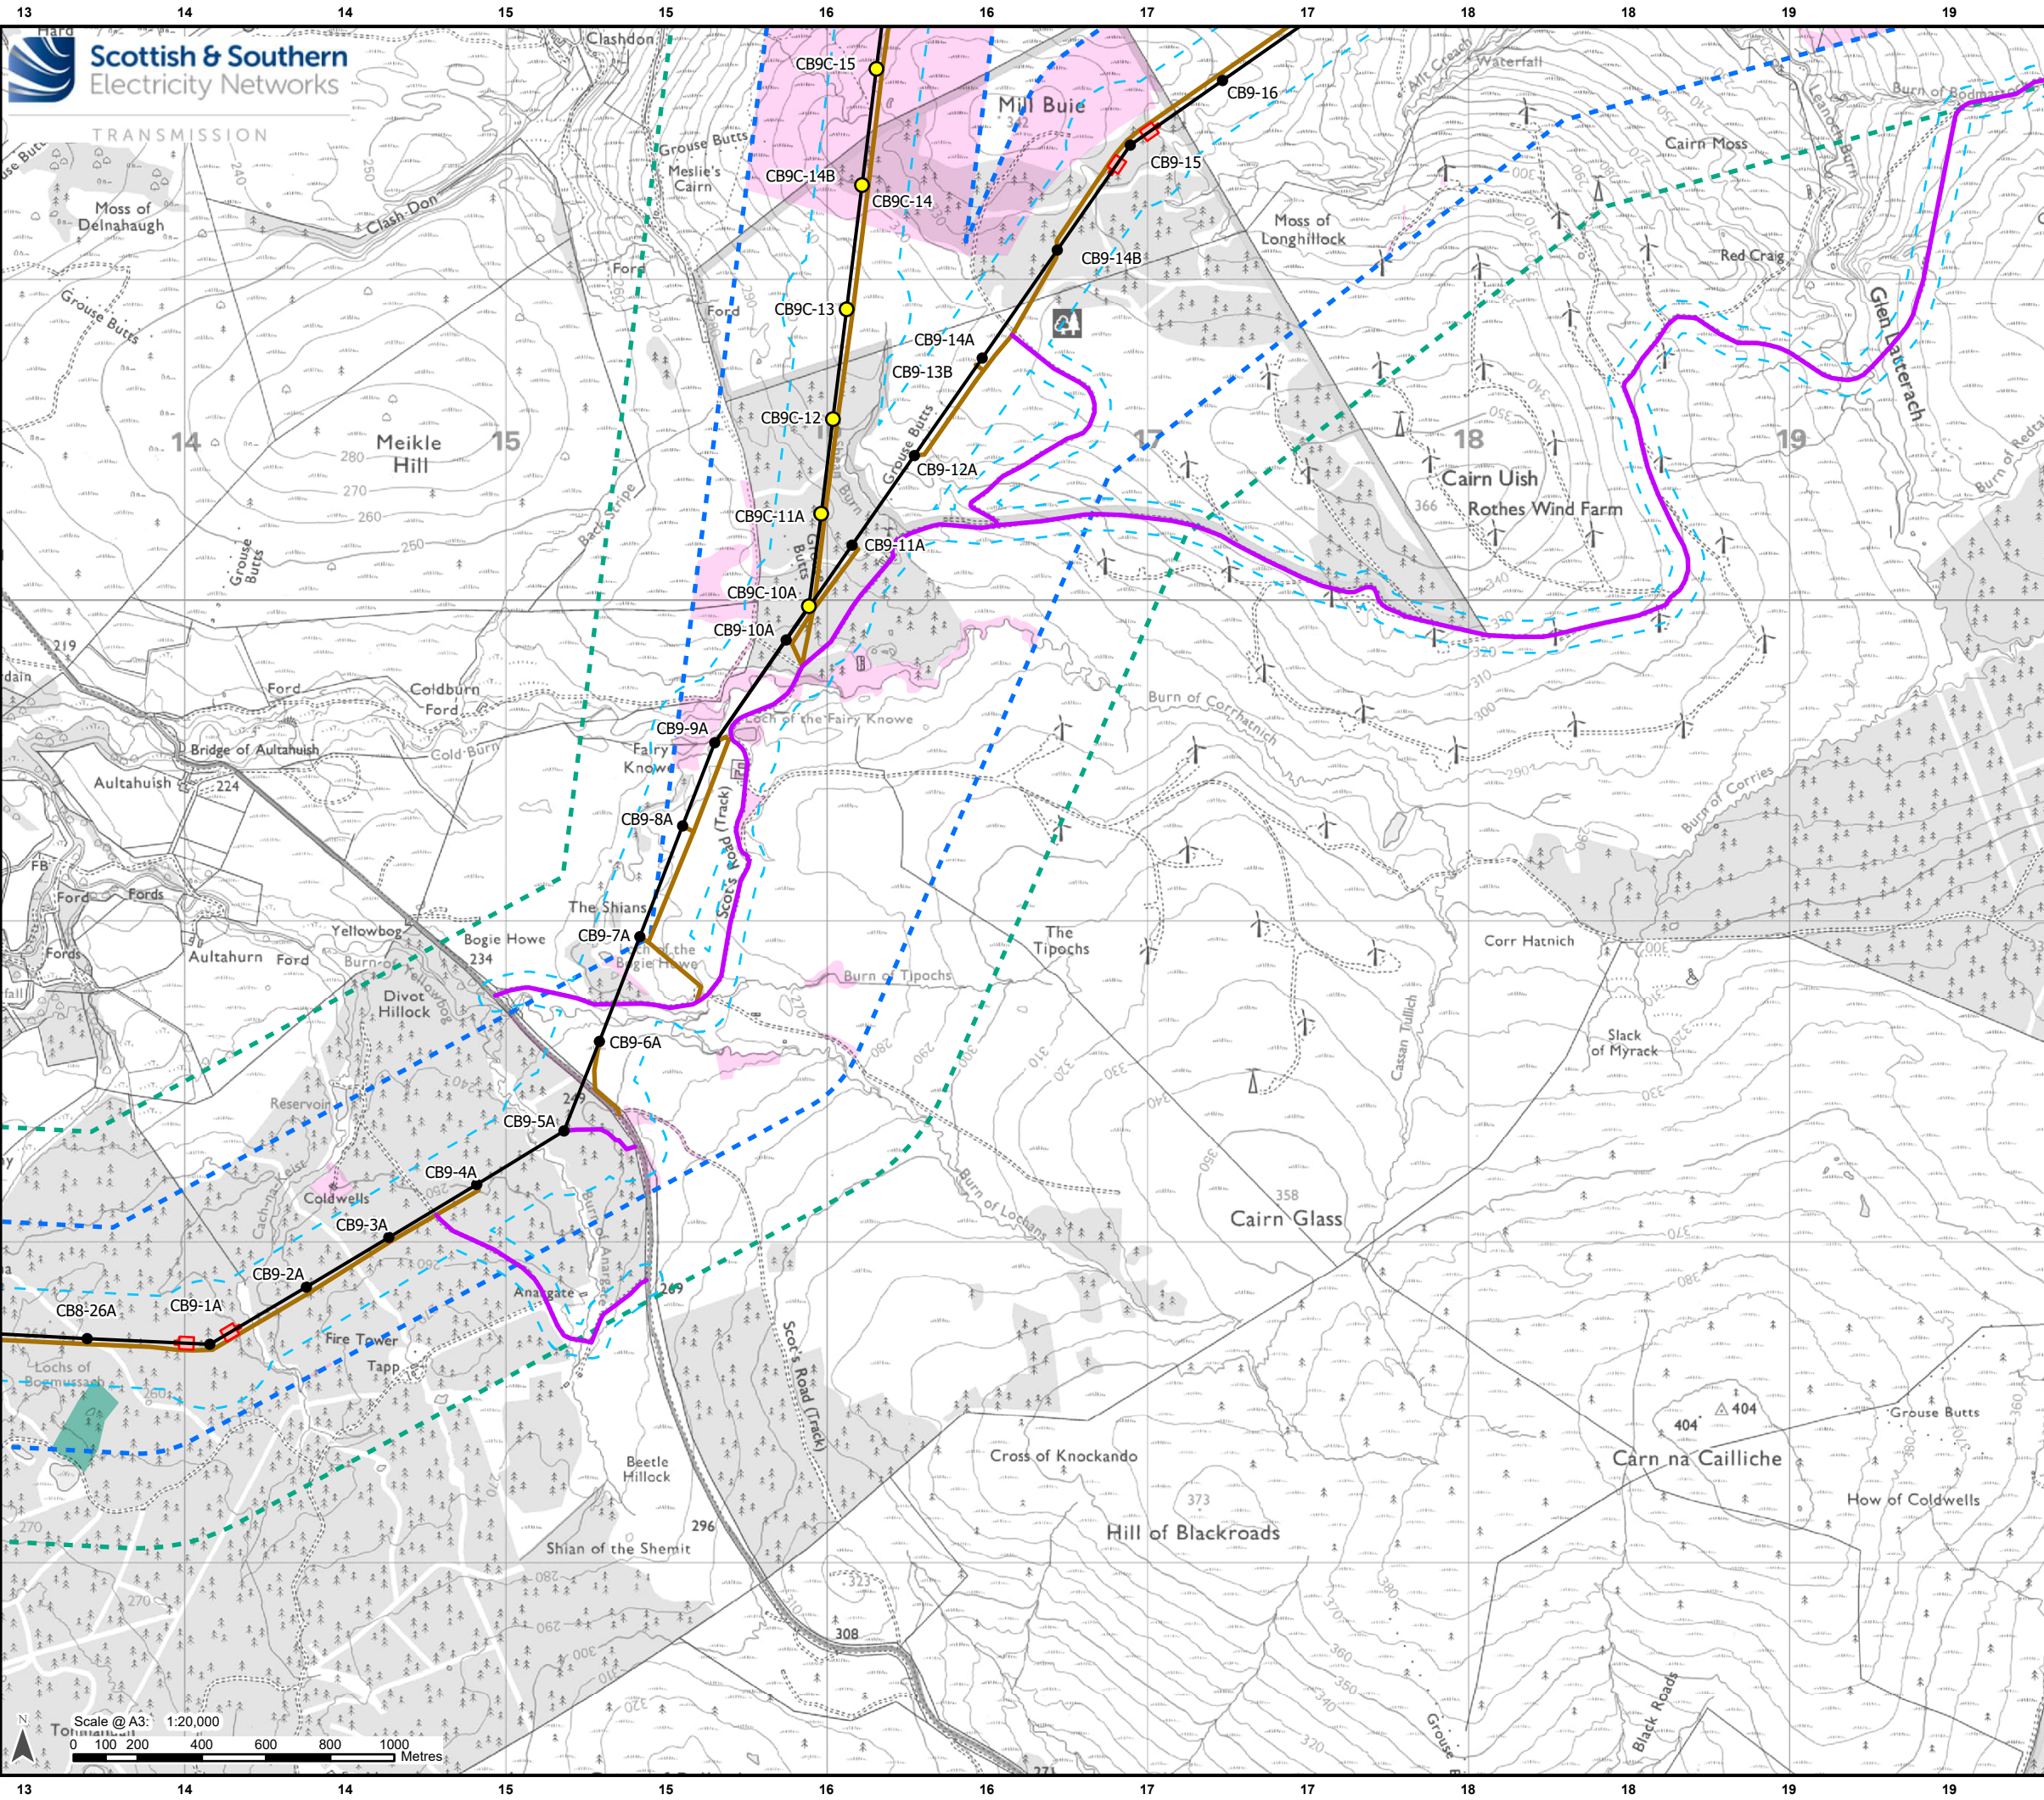

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV (with tower number)
- Proposed Tower - Kellas Alternative Alignment
- Limit of Deviation

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Proposed New Access (Temporary/Permanent)
- Existing Access Upgrade

Survey Area

- UKHab Survey Area*

Species Study Area

- Great Crested Newt Suitability Survey Area*

Access Constraint

- Protected Species Access Constraint
- Habitat Access Constraint

Note 1 - This buffer (*) uses a previous version of the design that was current when surveys were carried out.
Note 2 - Bat survey areas are shown separately.

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813945. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 8.1.1 - Survey Areas and Access Constraints
Page 13 of 29

Drawn by: MAL Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-080