


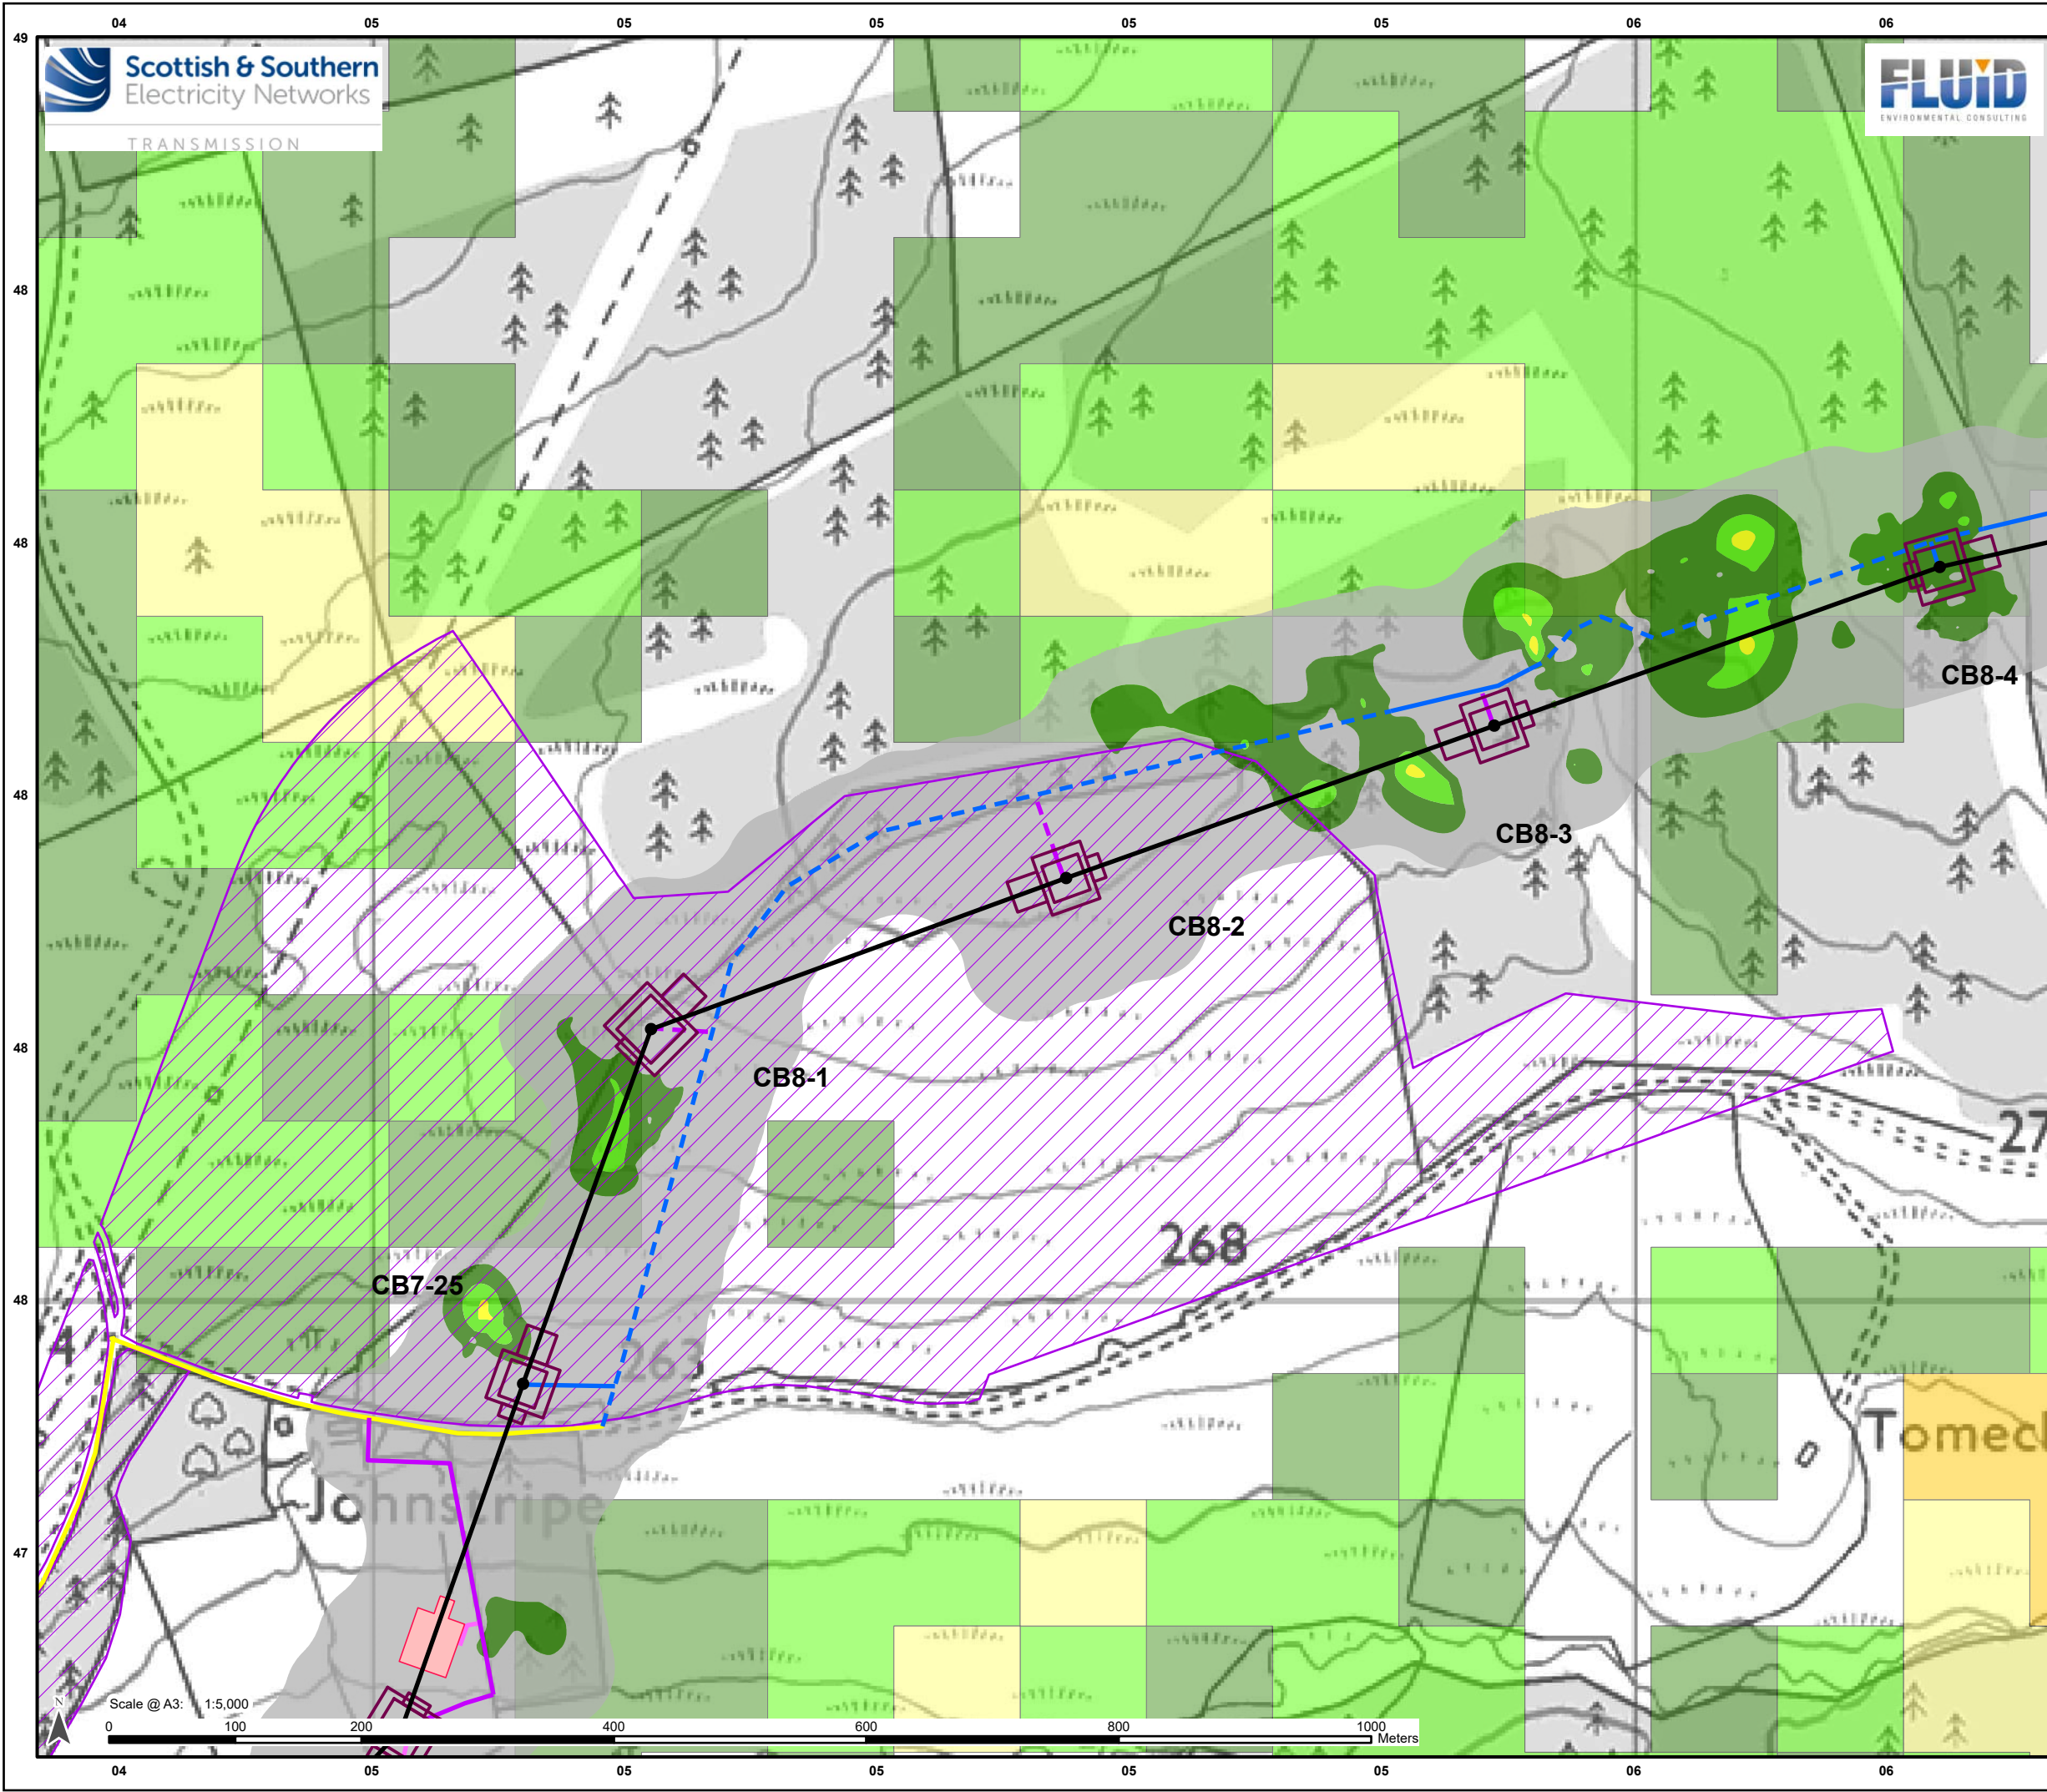

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 43 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

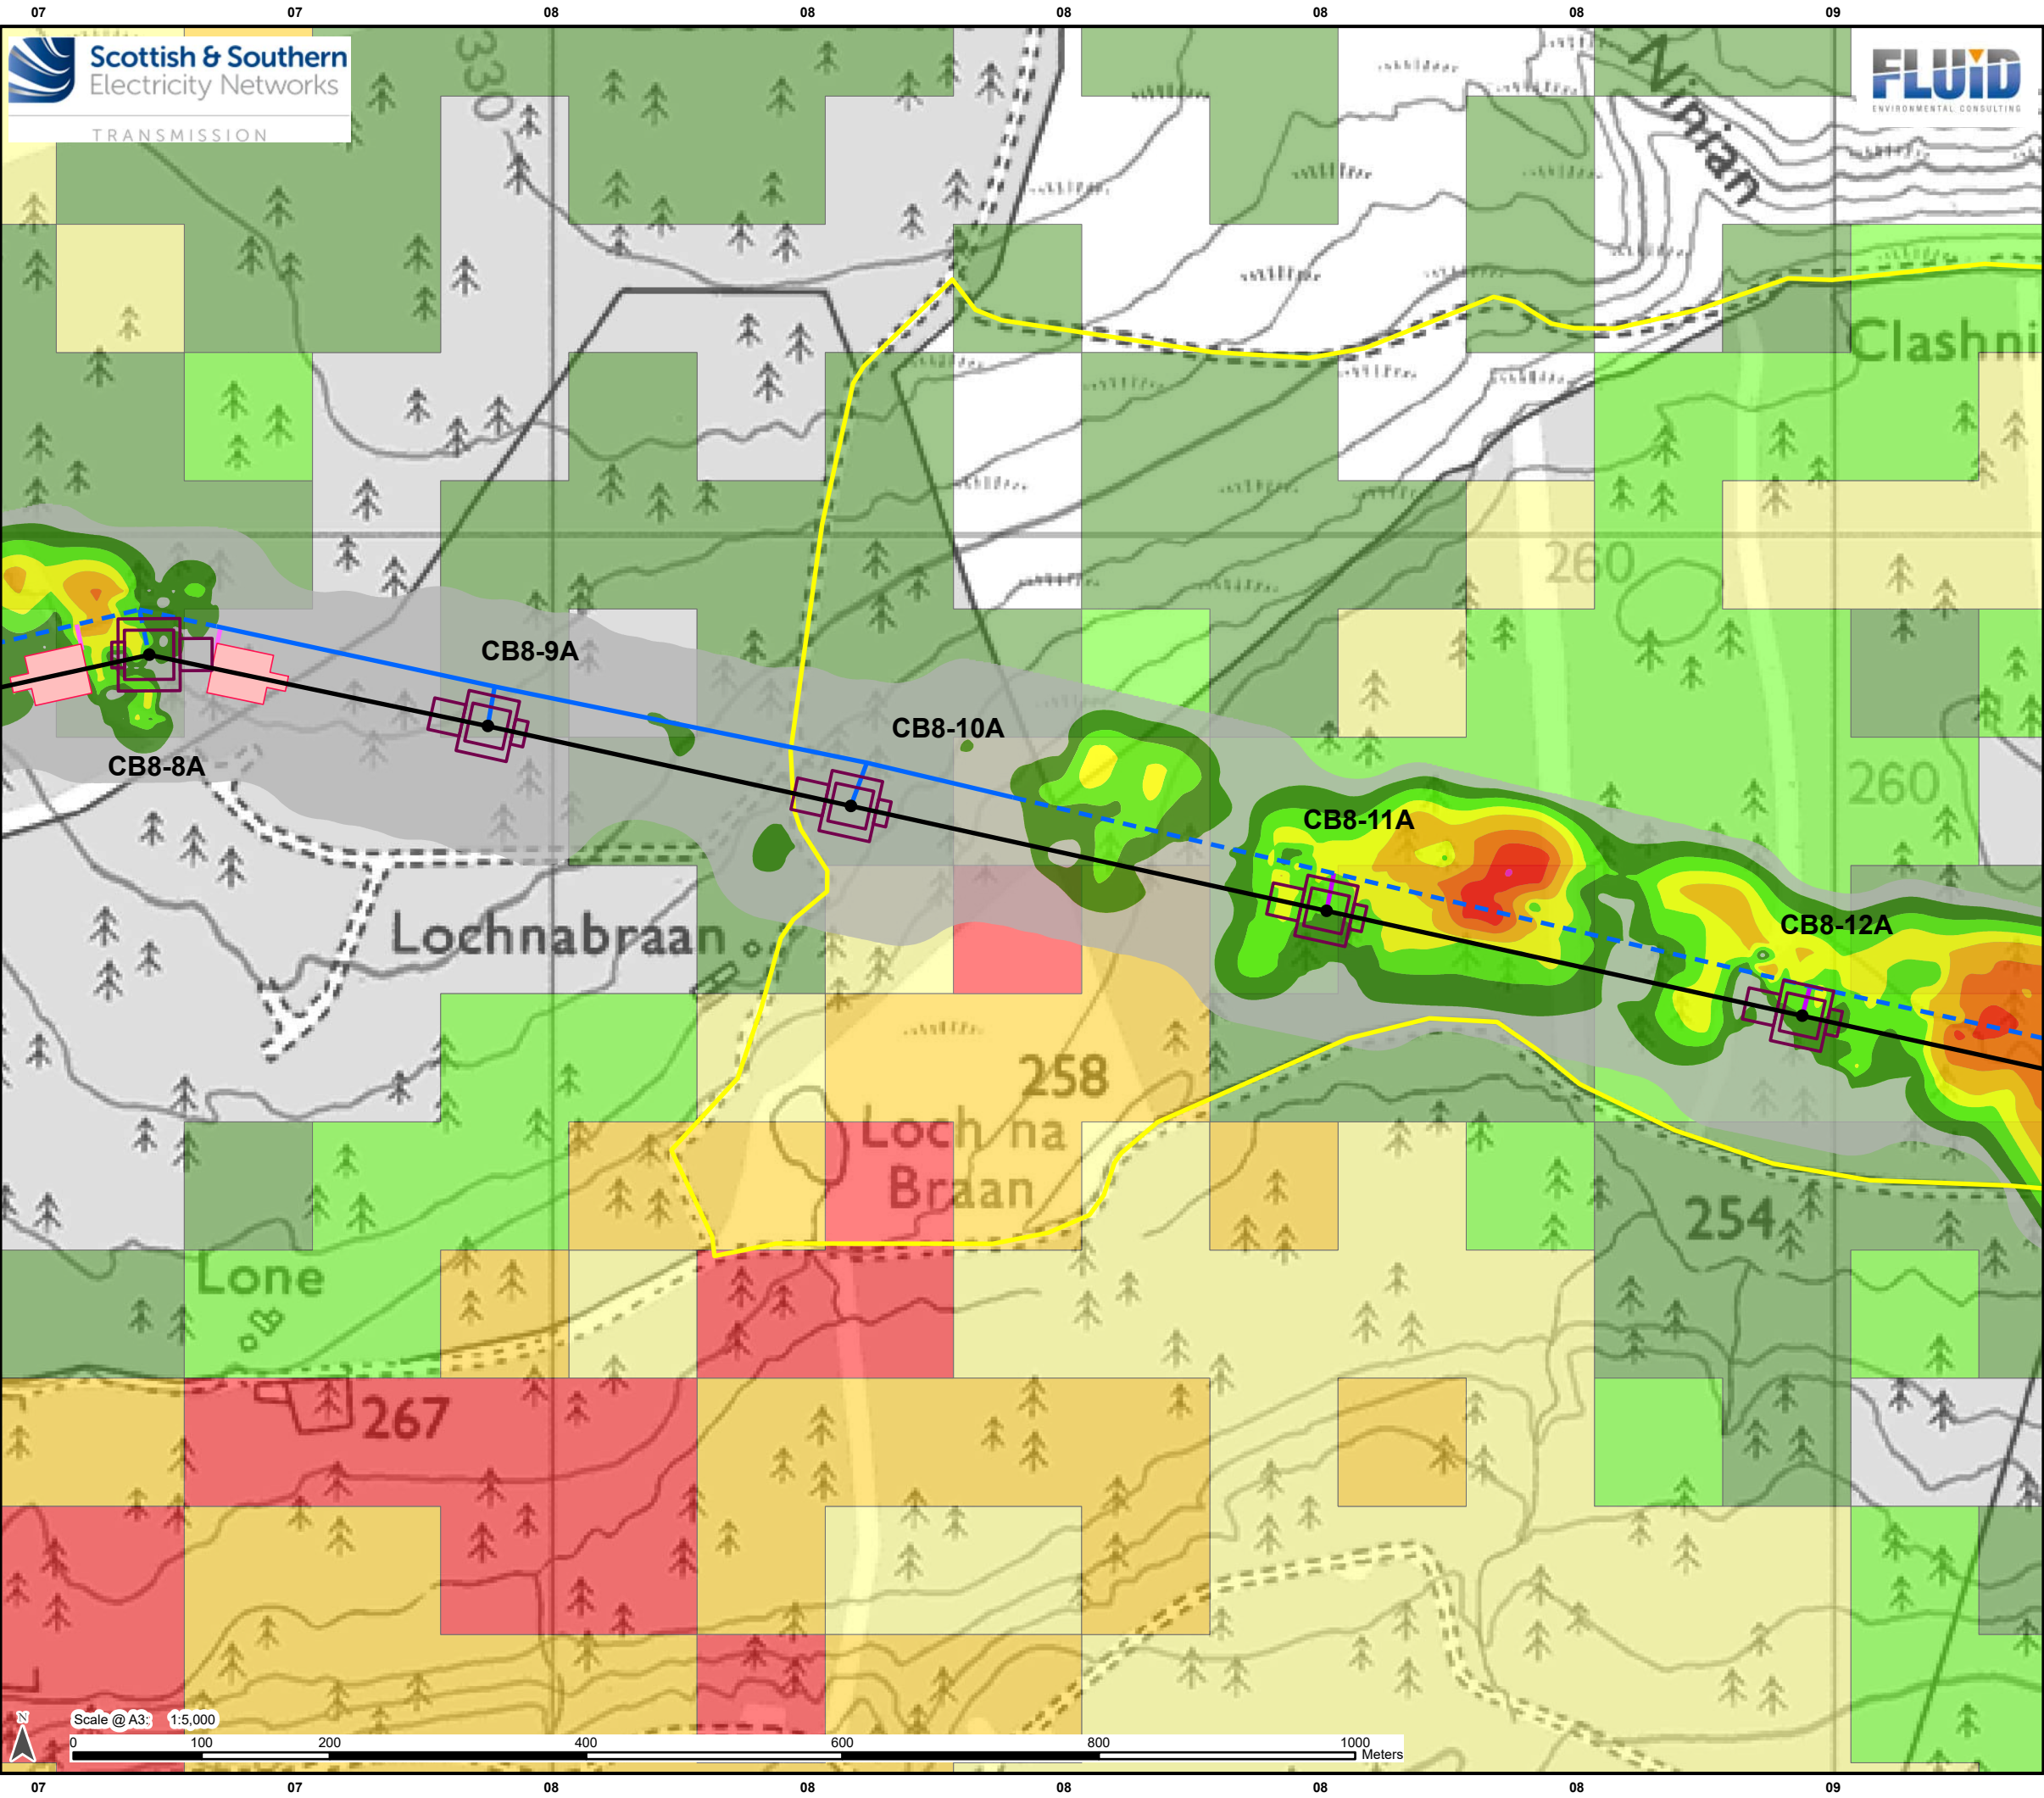

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-400kV (with tower number)

Working Areas *

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good/Fair Condition

Proposed Access – ATV or Temporary Trackway

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 45 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

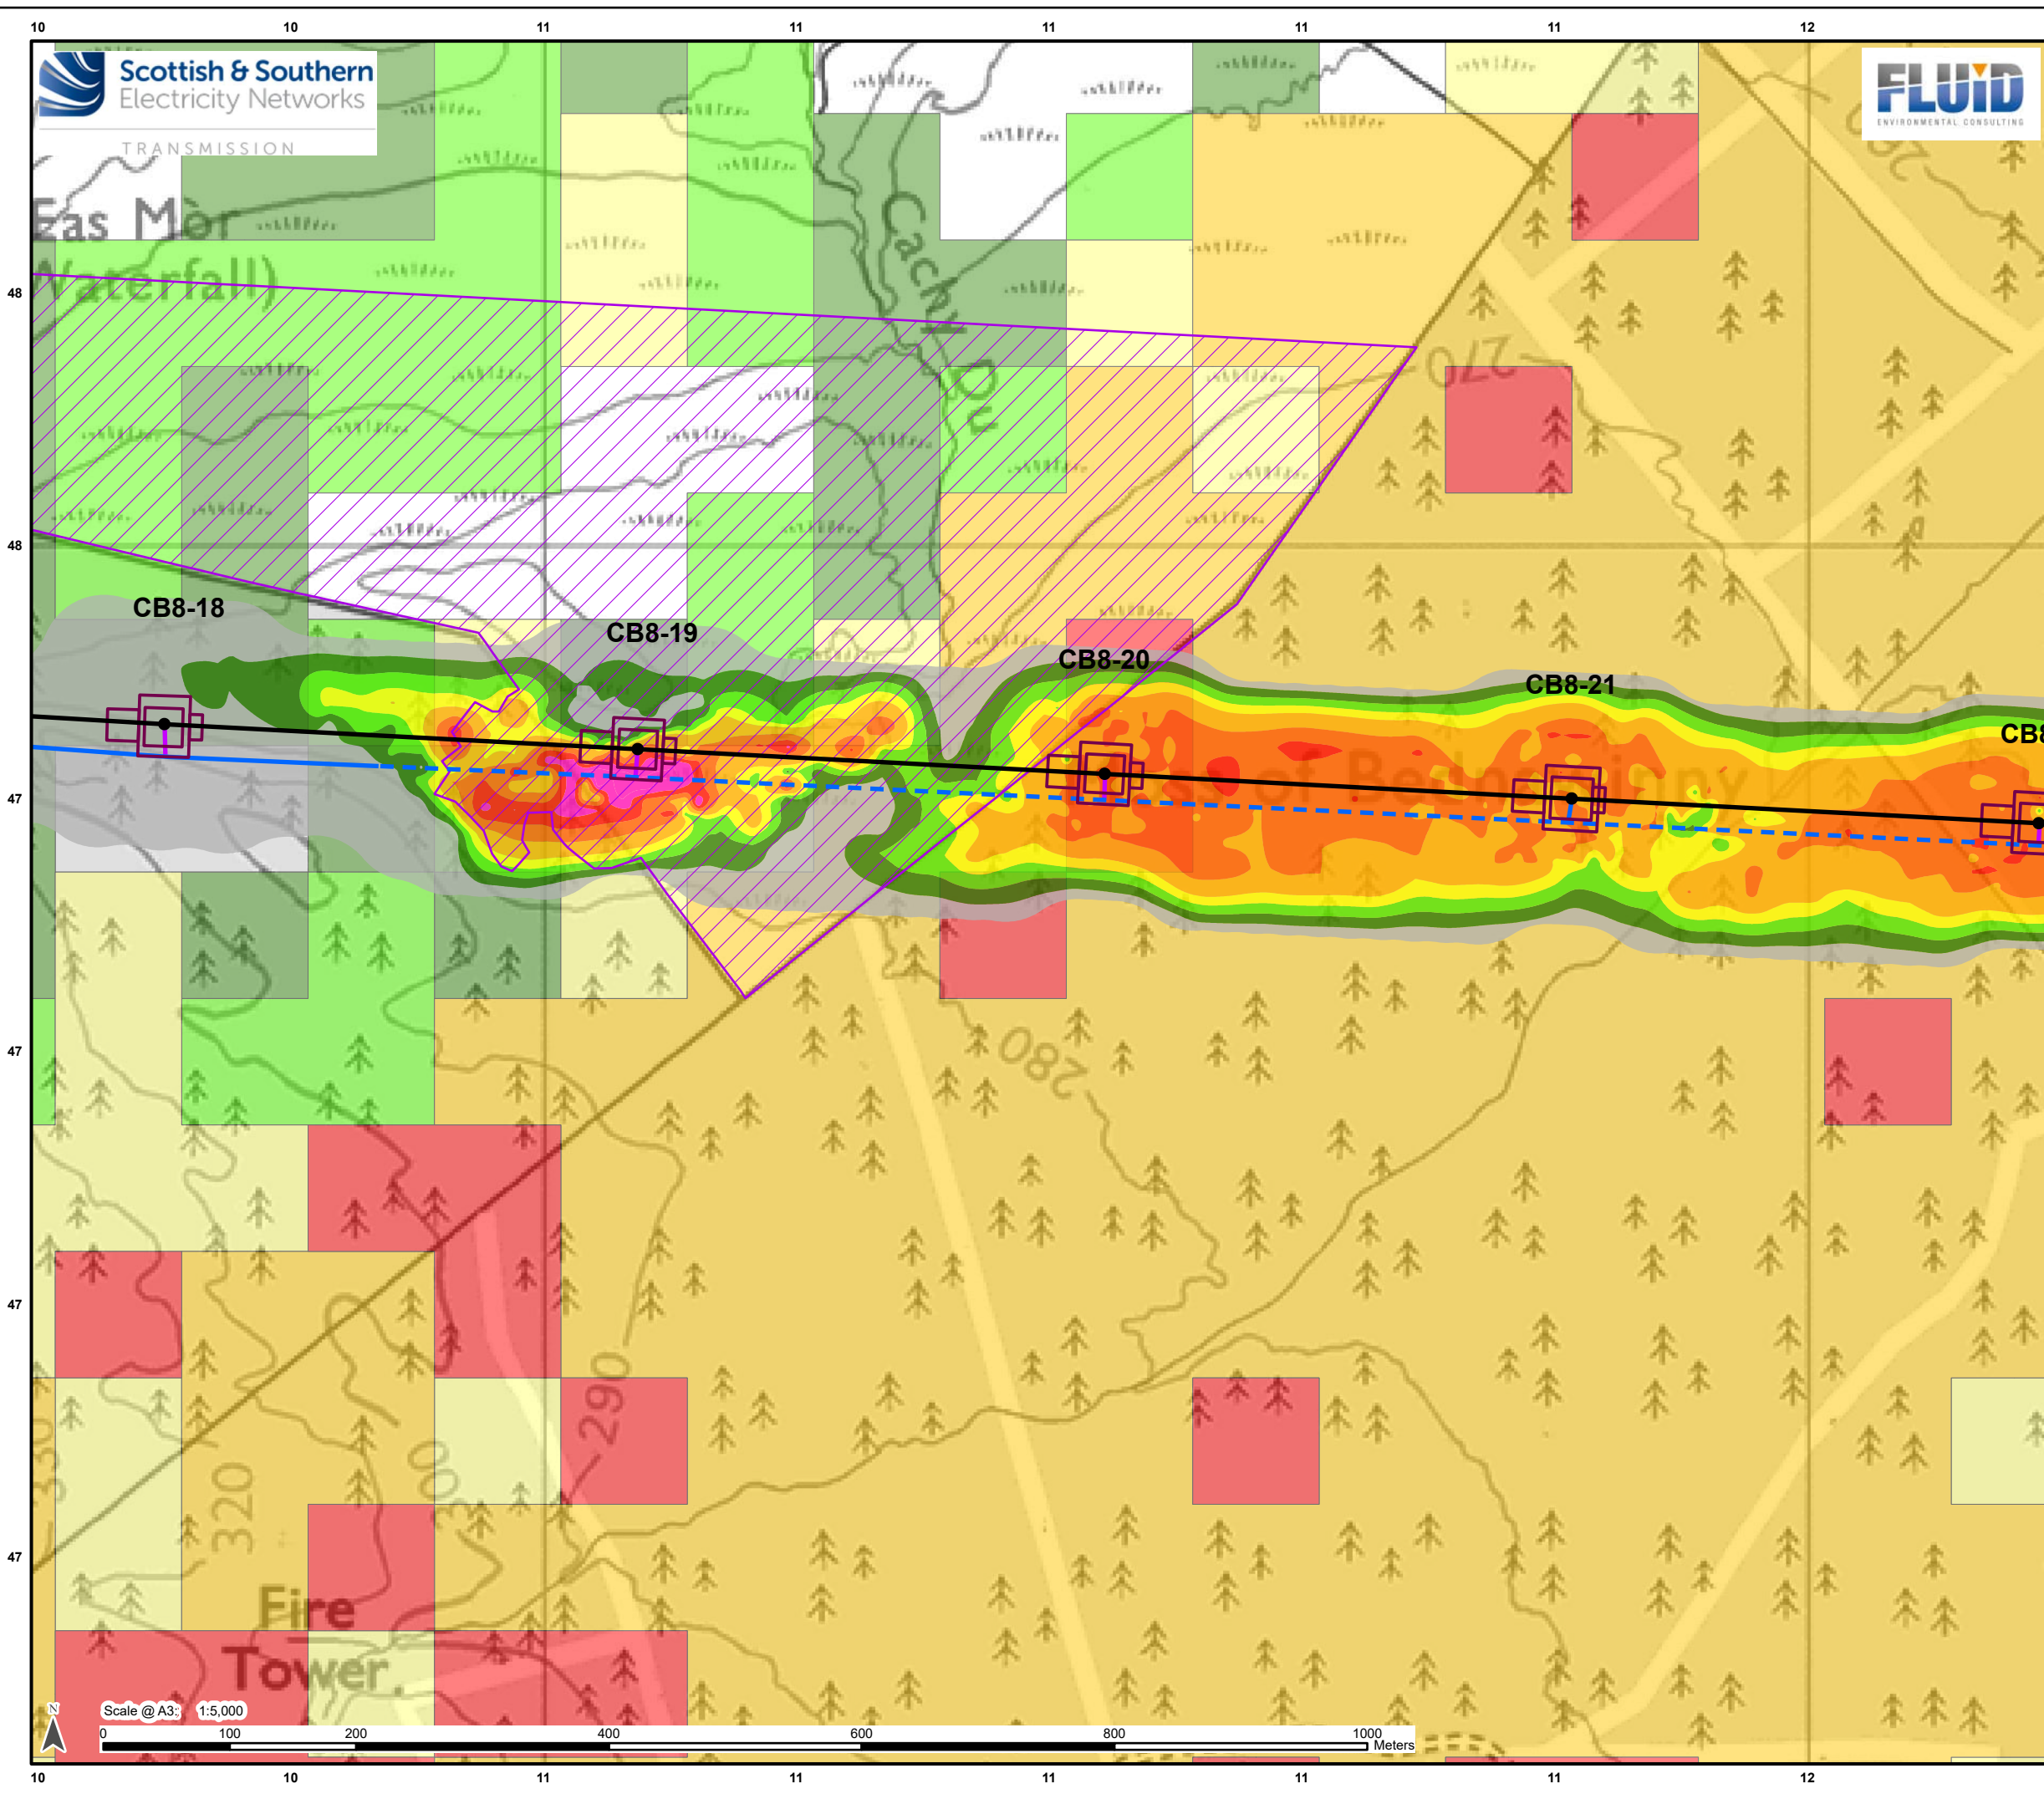

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number AC0000813445.
 SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 47 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

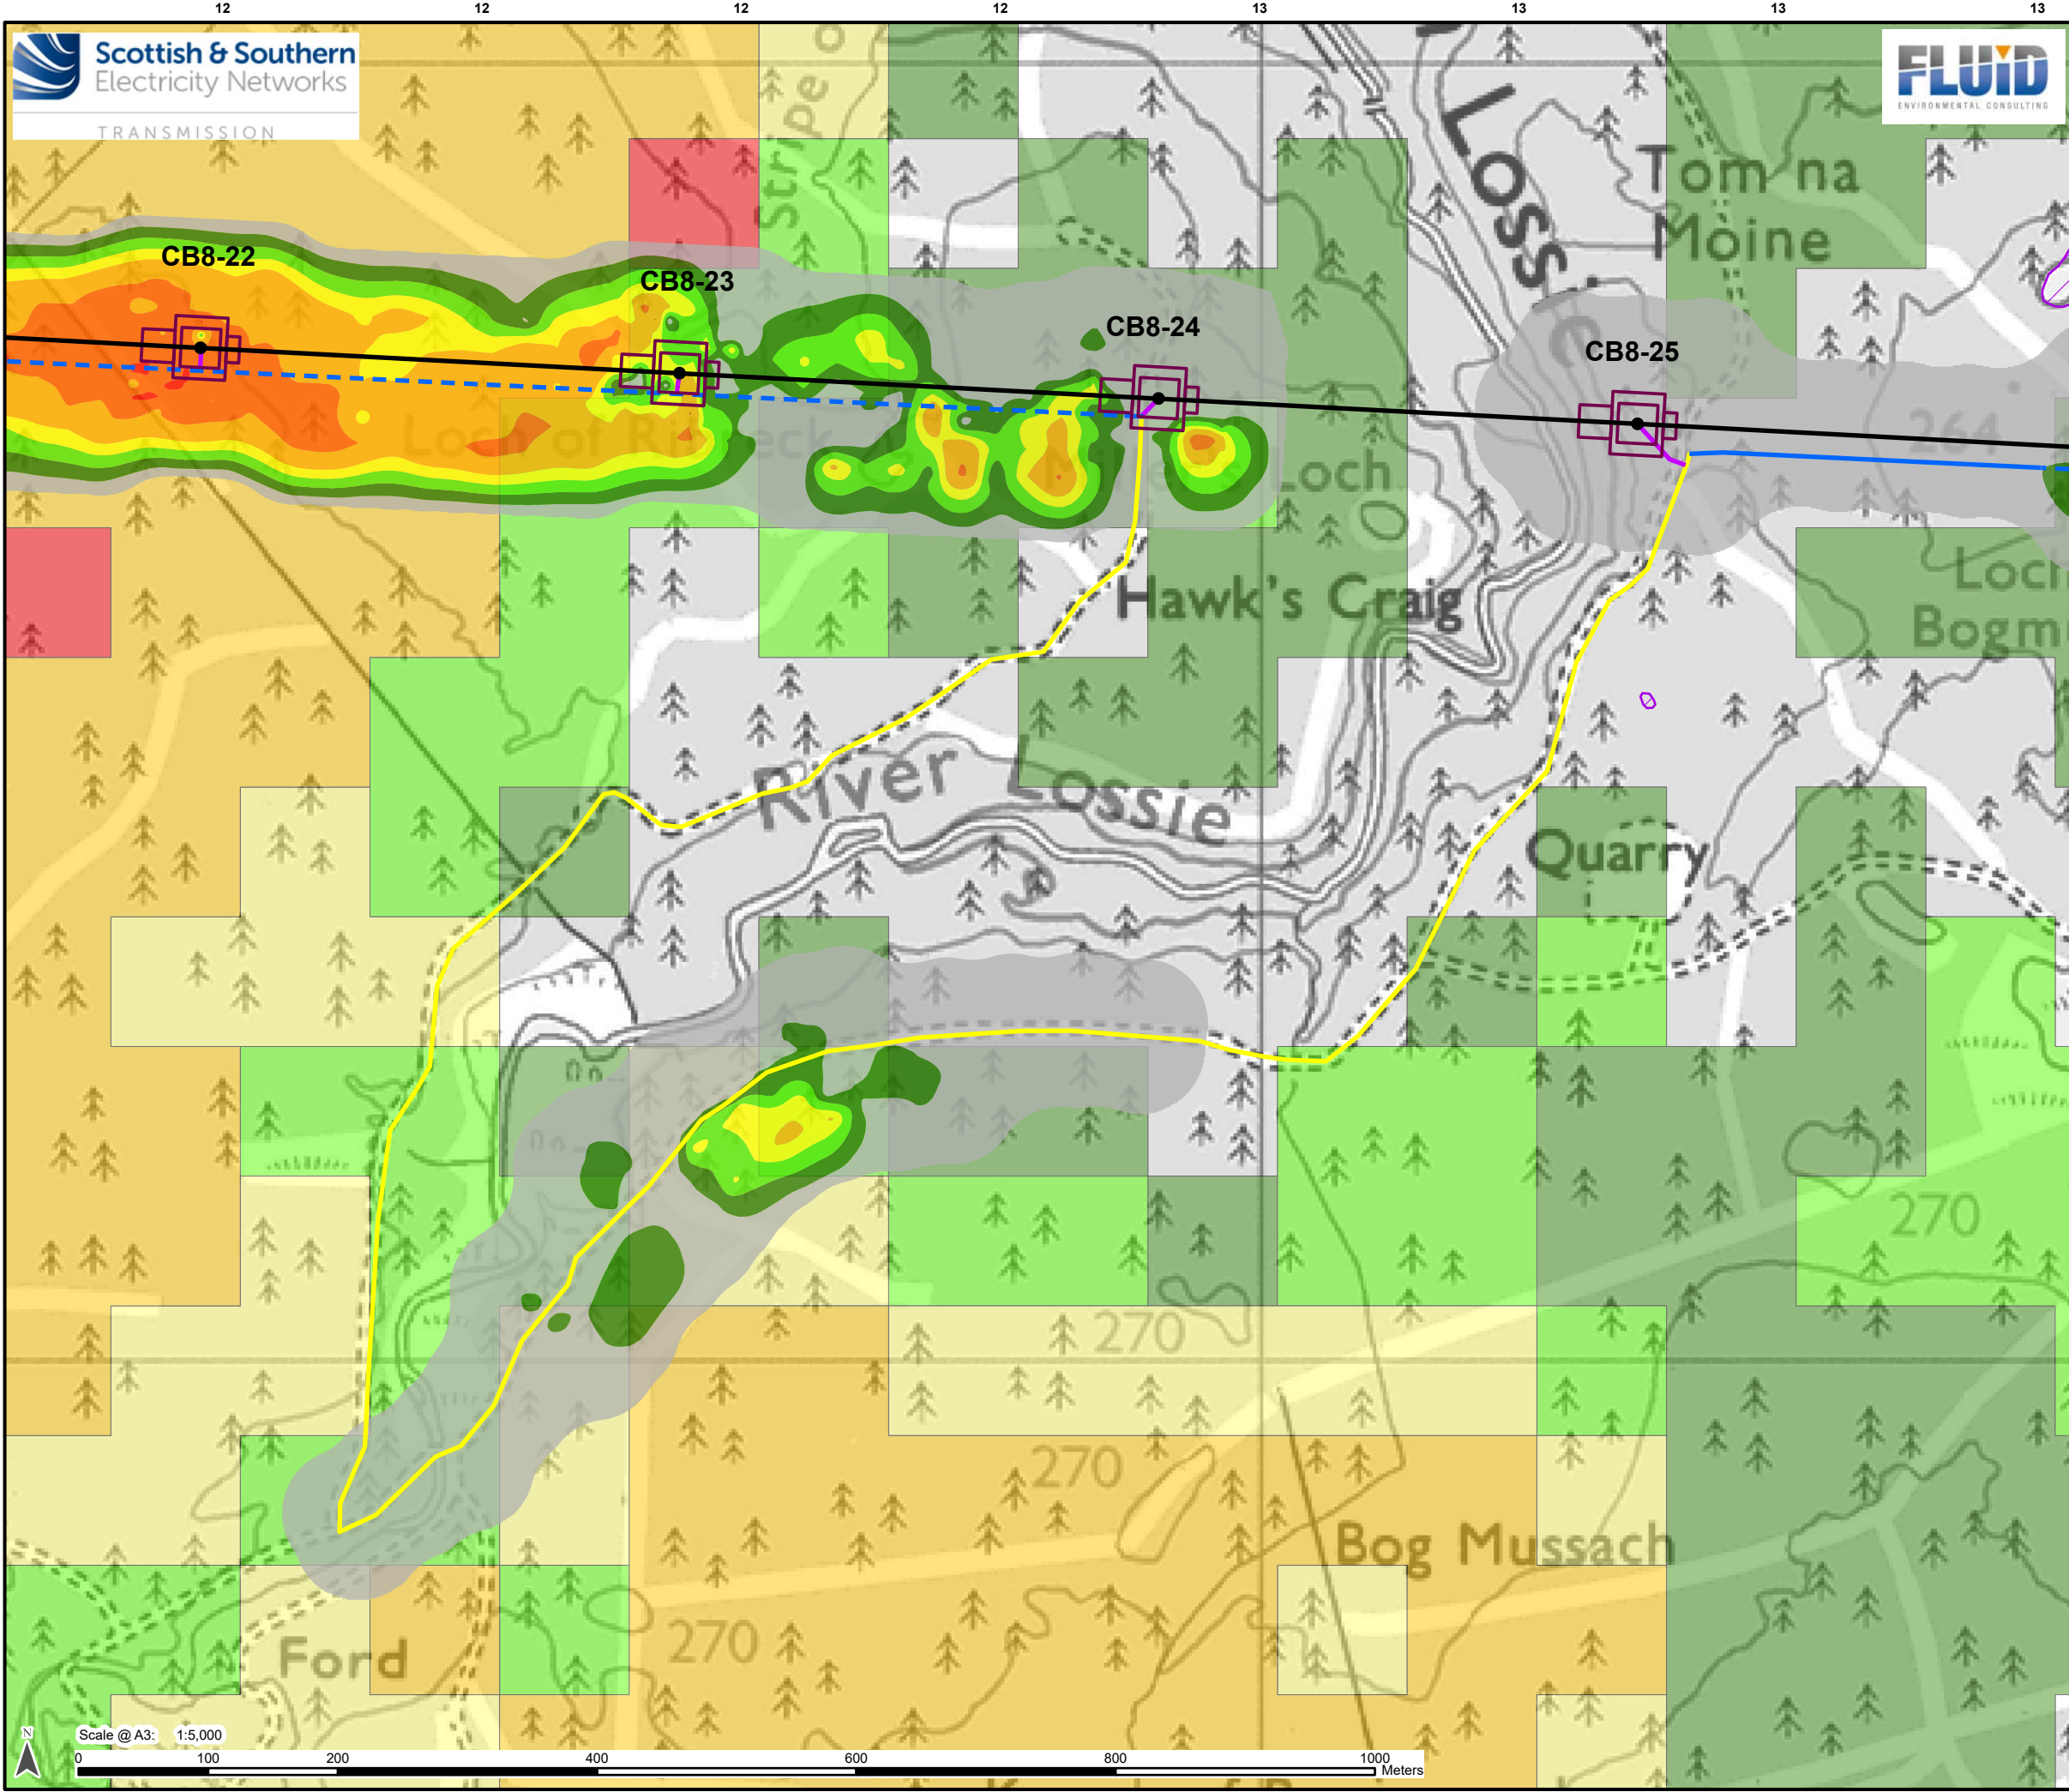

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 48 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

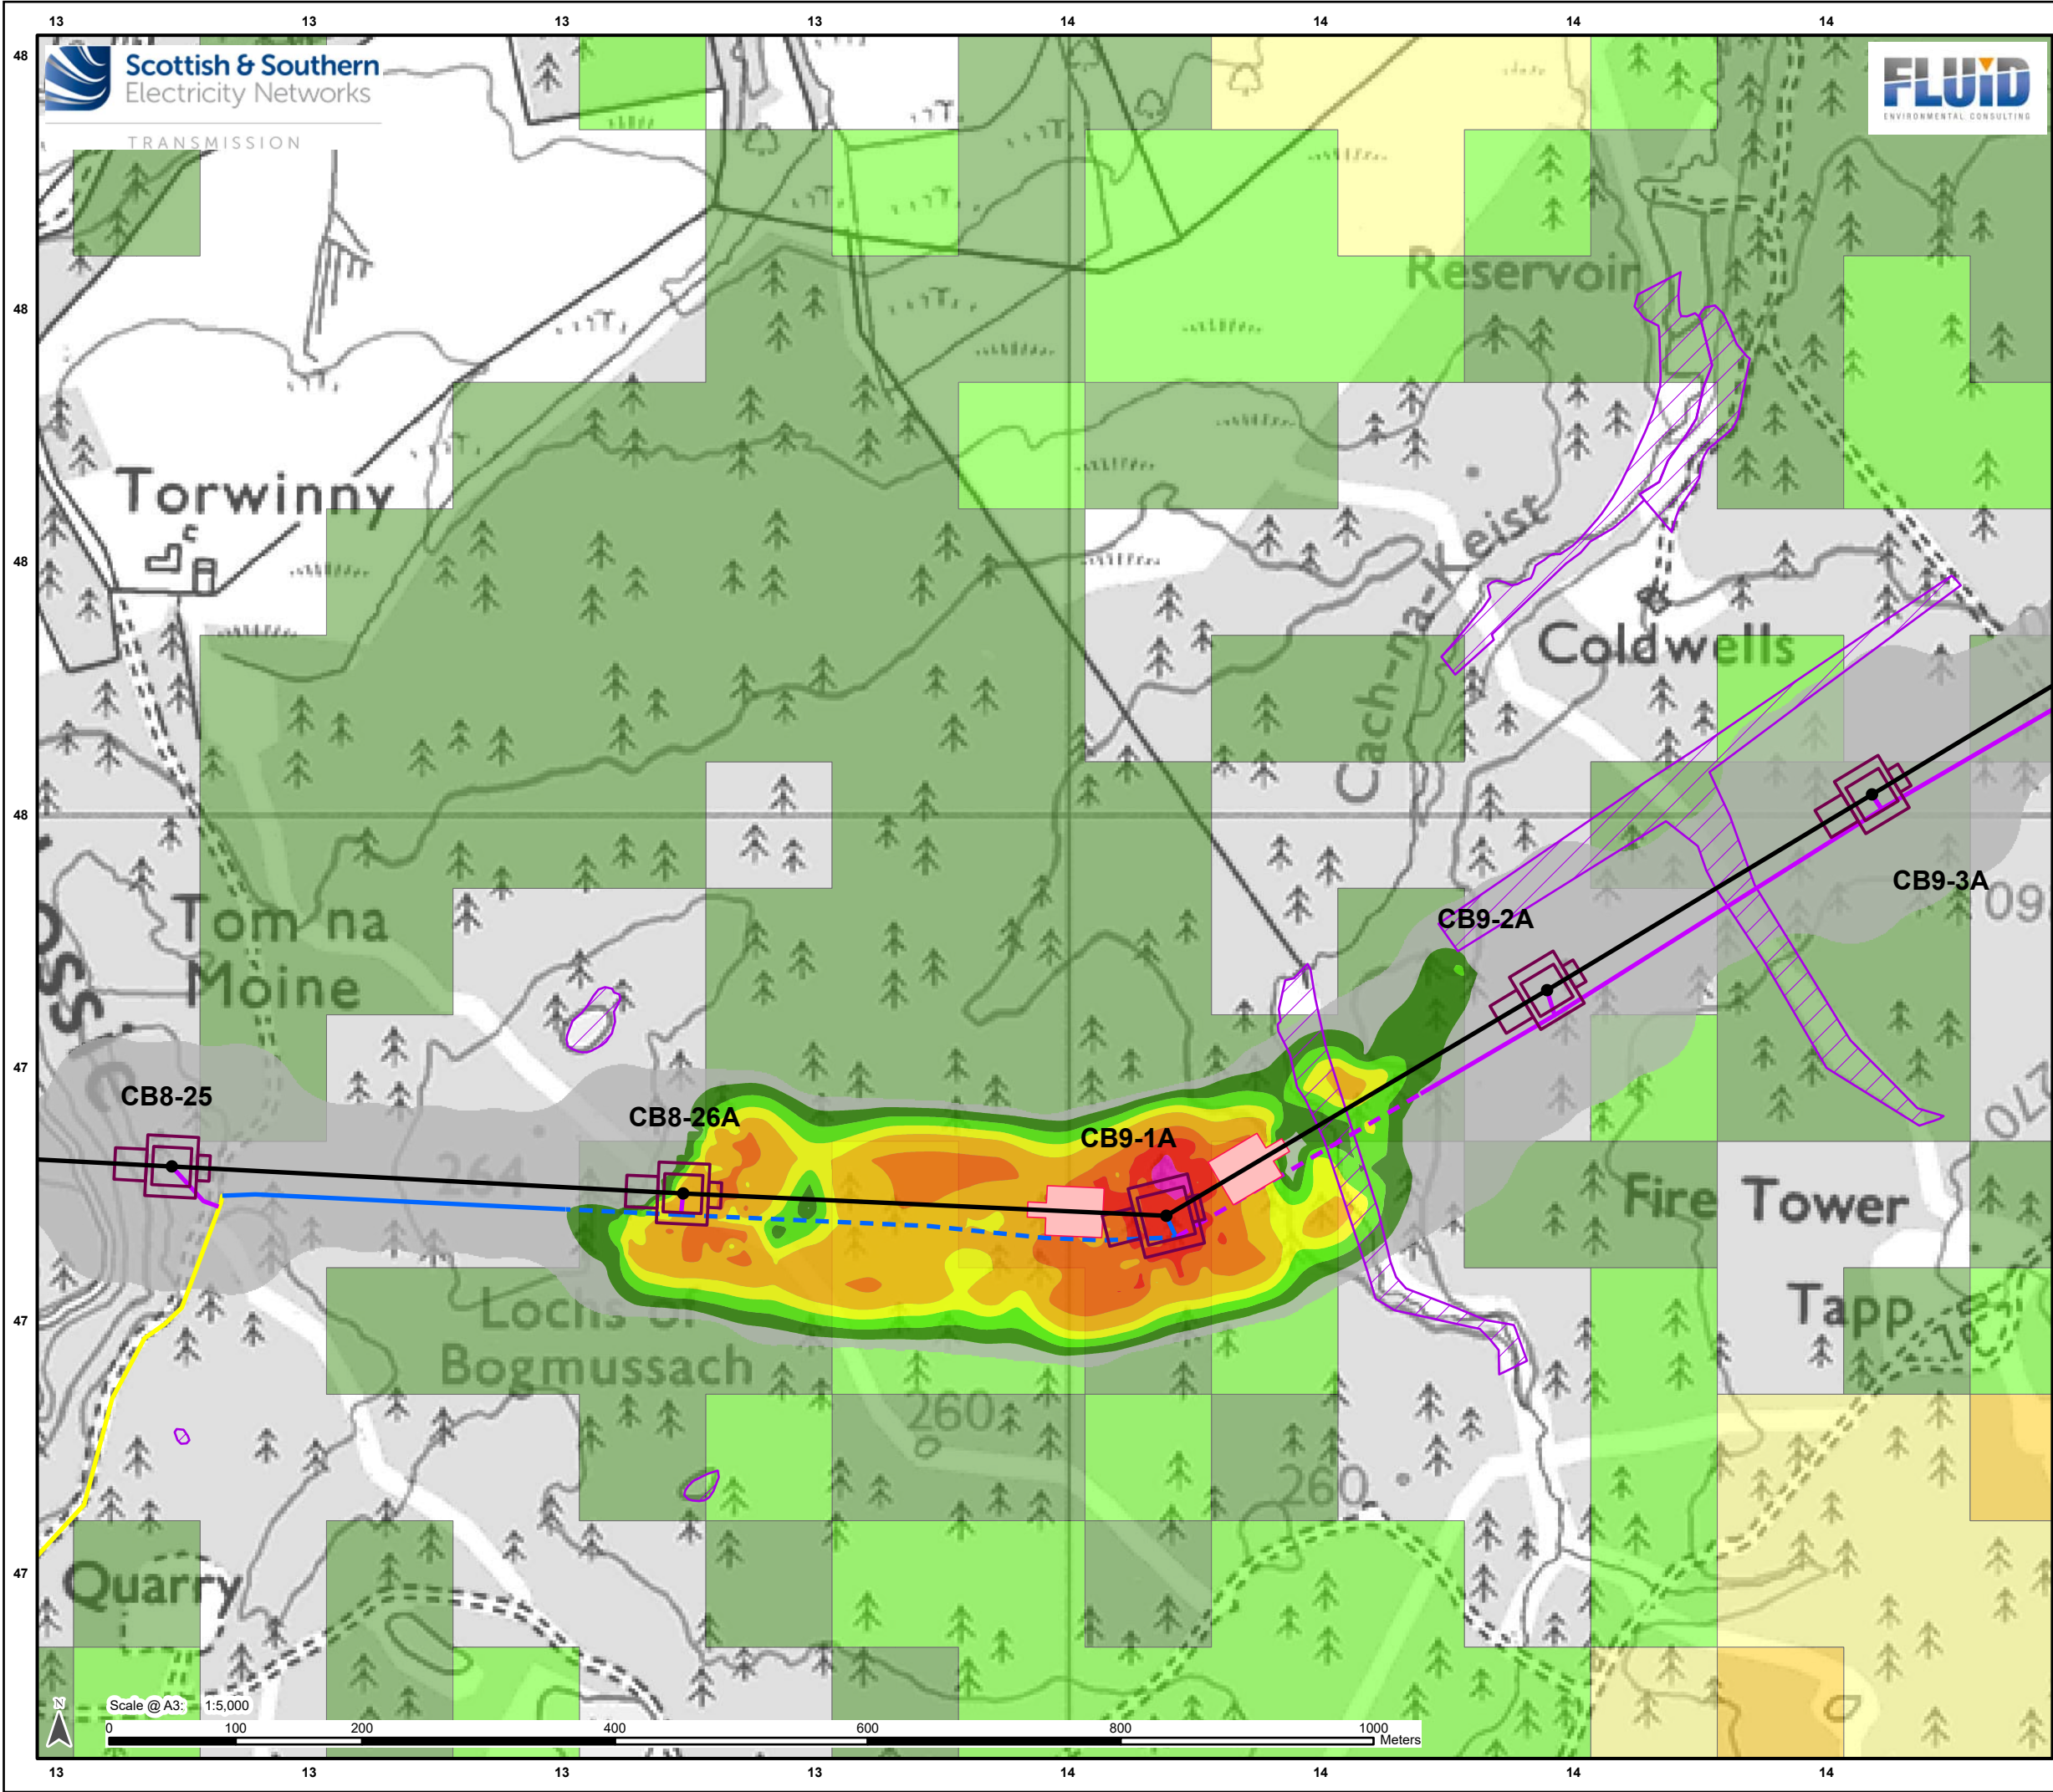

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-400kV (with tower number)

Working Areas *

Proposed Conductor Pulling Area (EPZ)

Existing Access – Upgrade – Good/Fair Condition

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 49 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

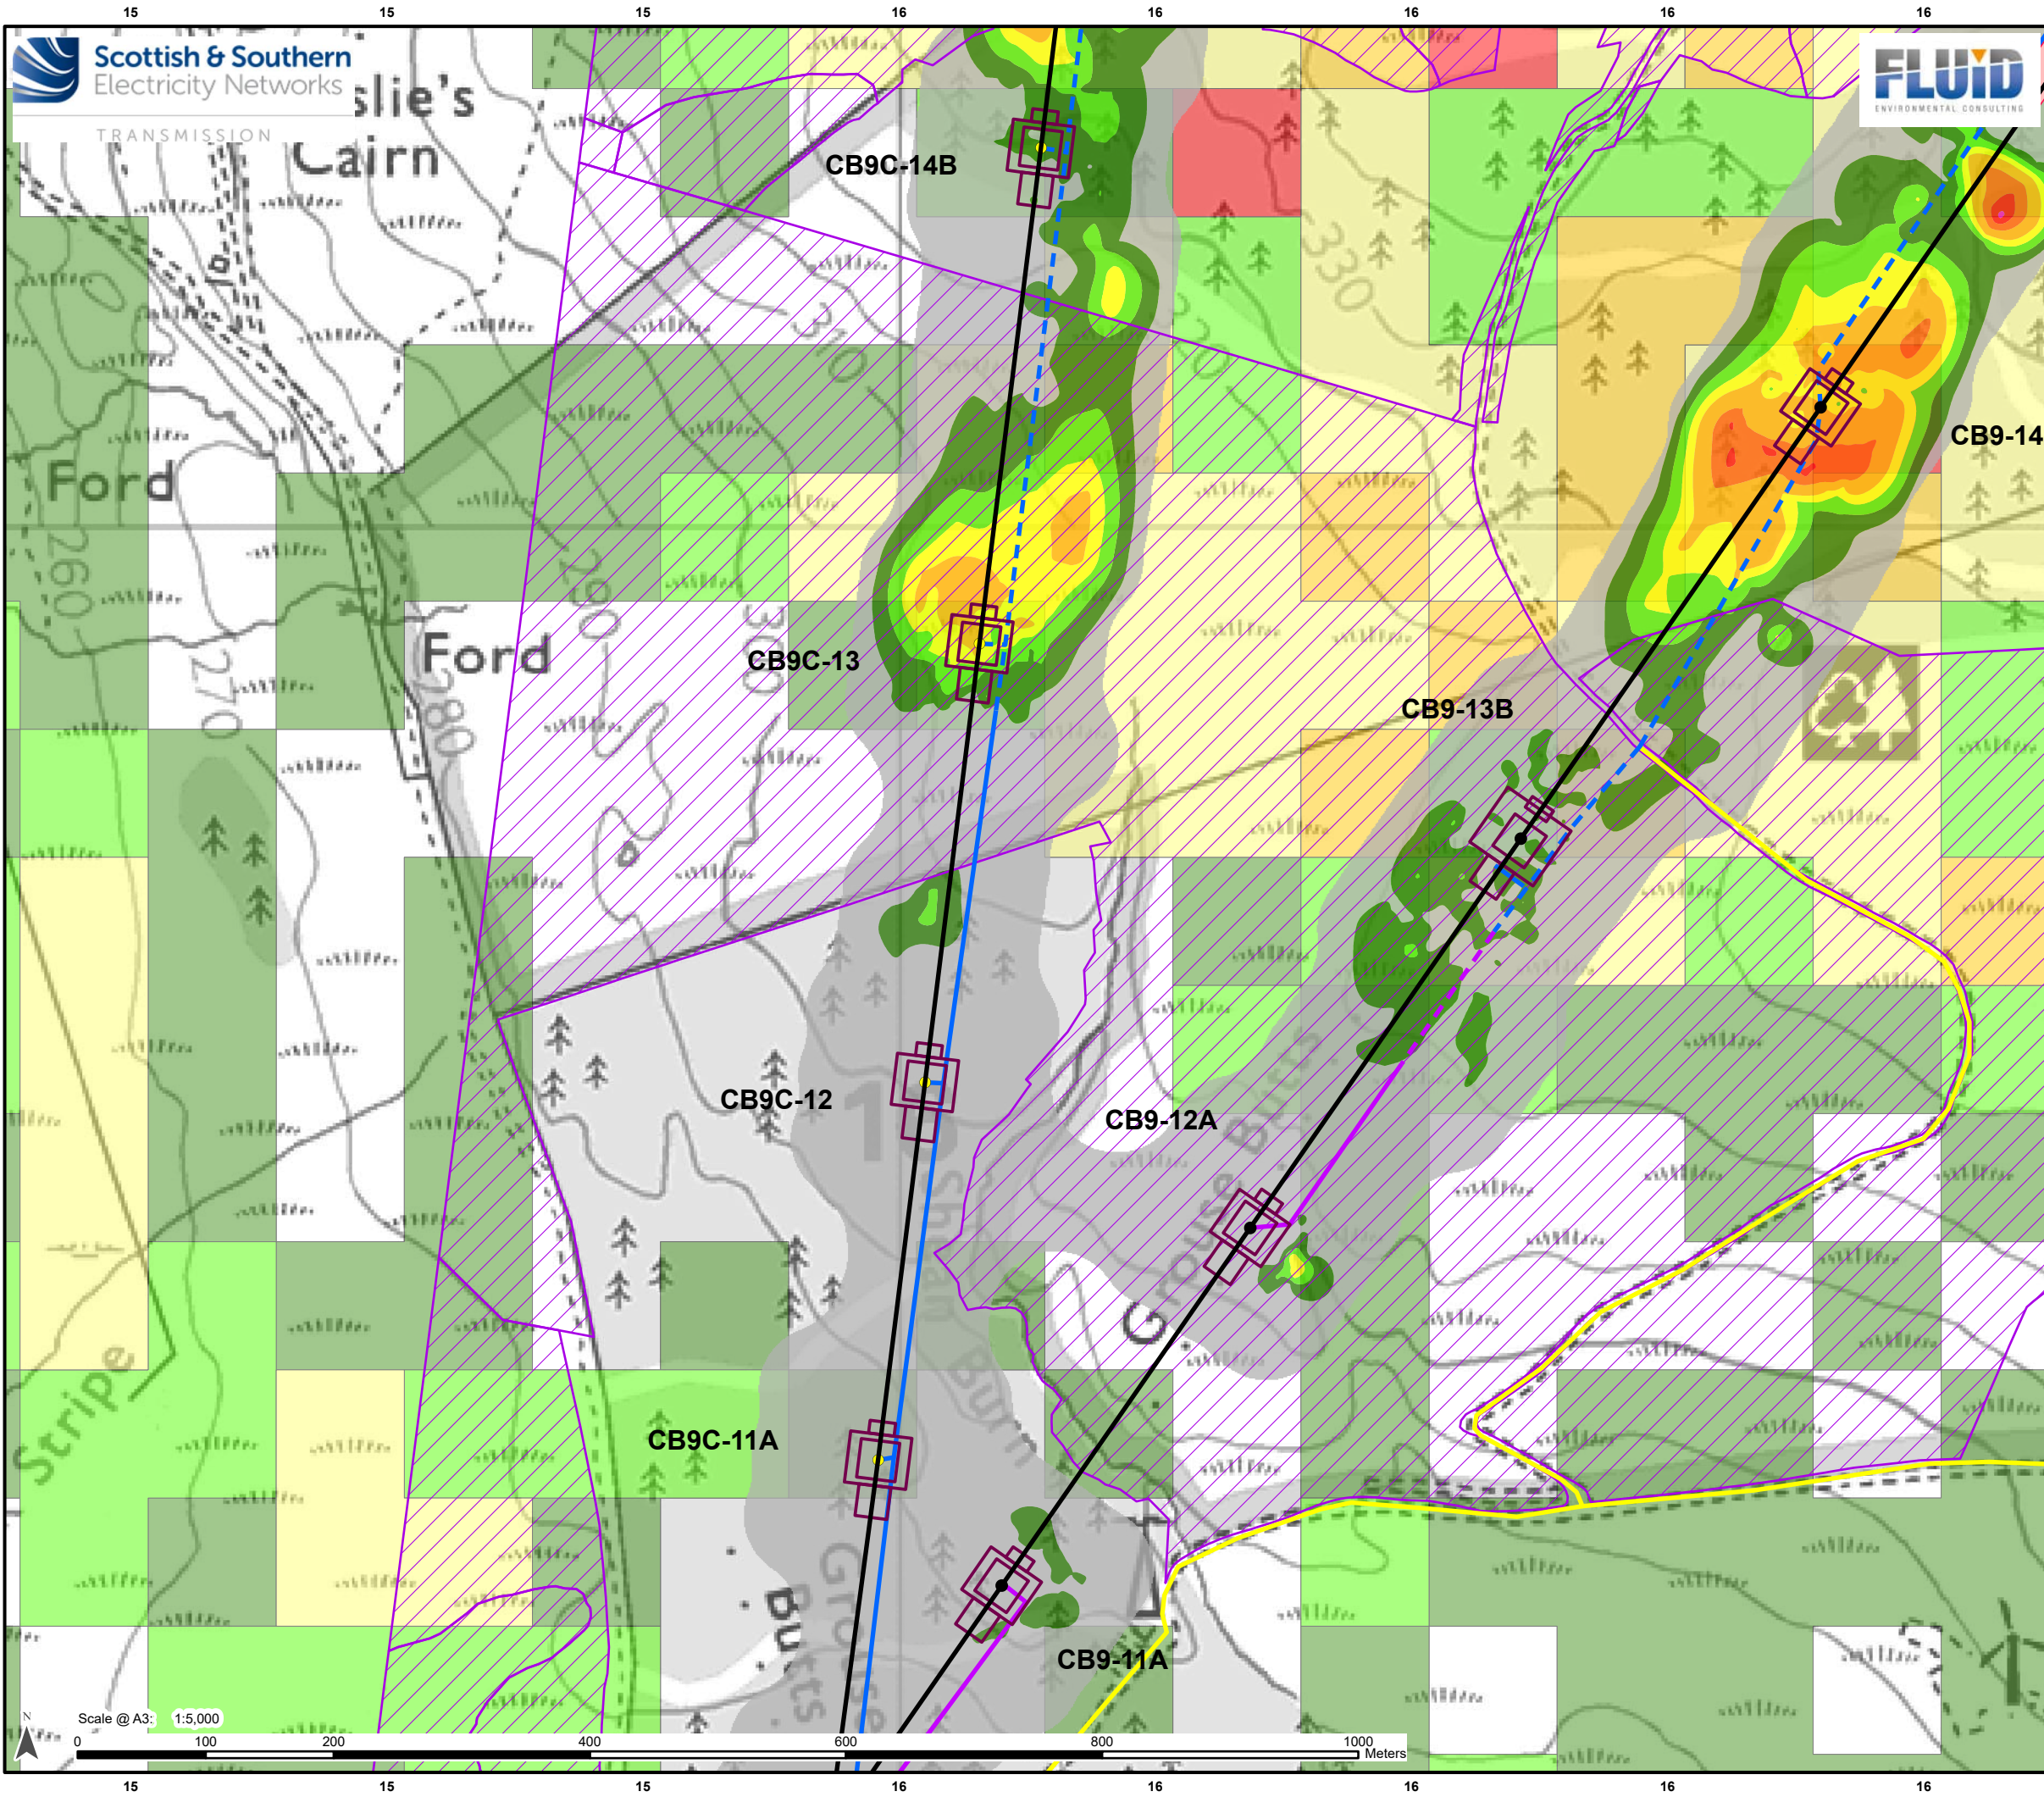

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Proposed Tower-Kellas Alternative Alignment
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats


- Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement



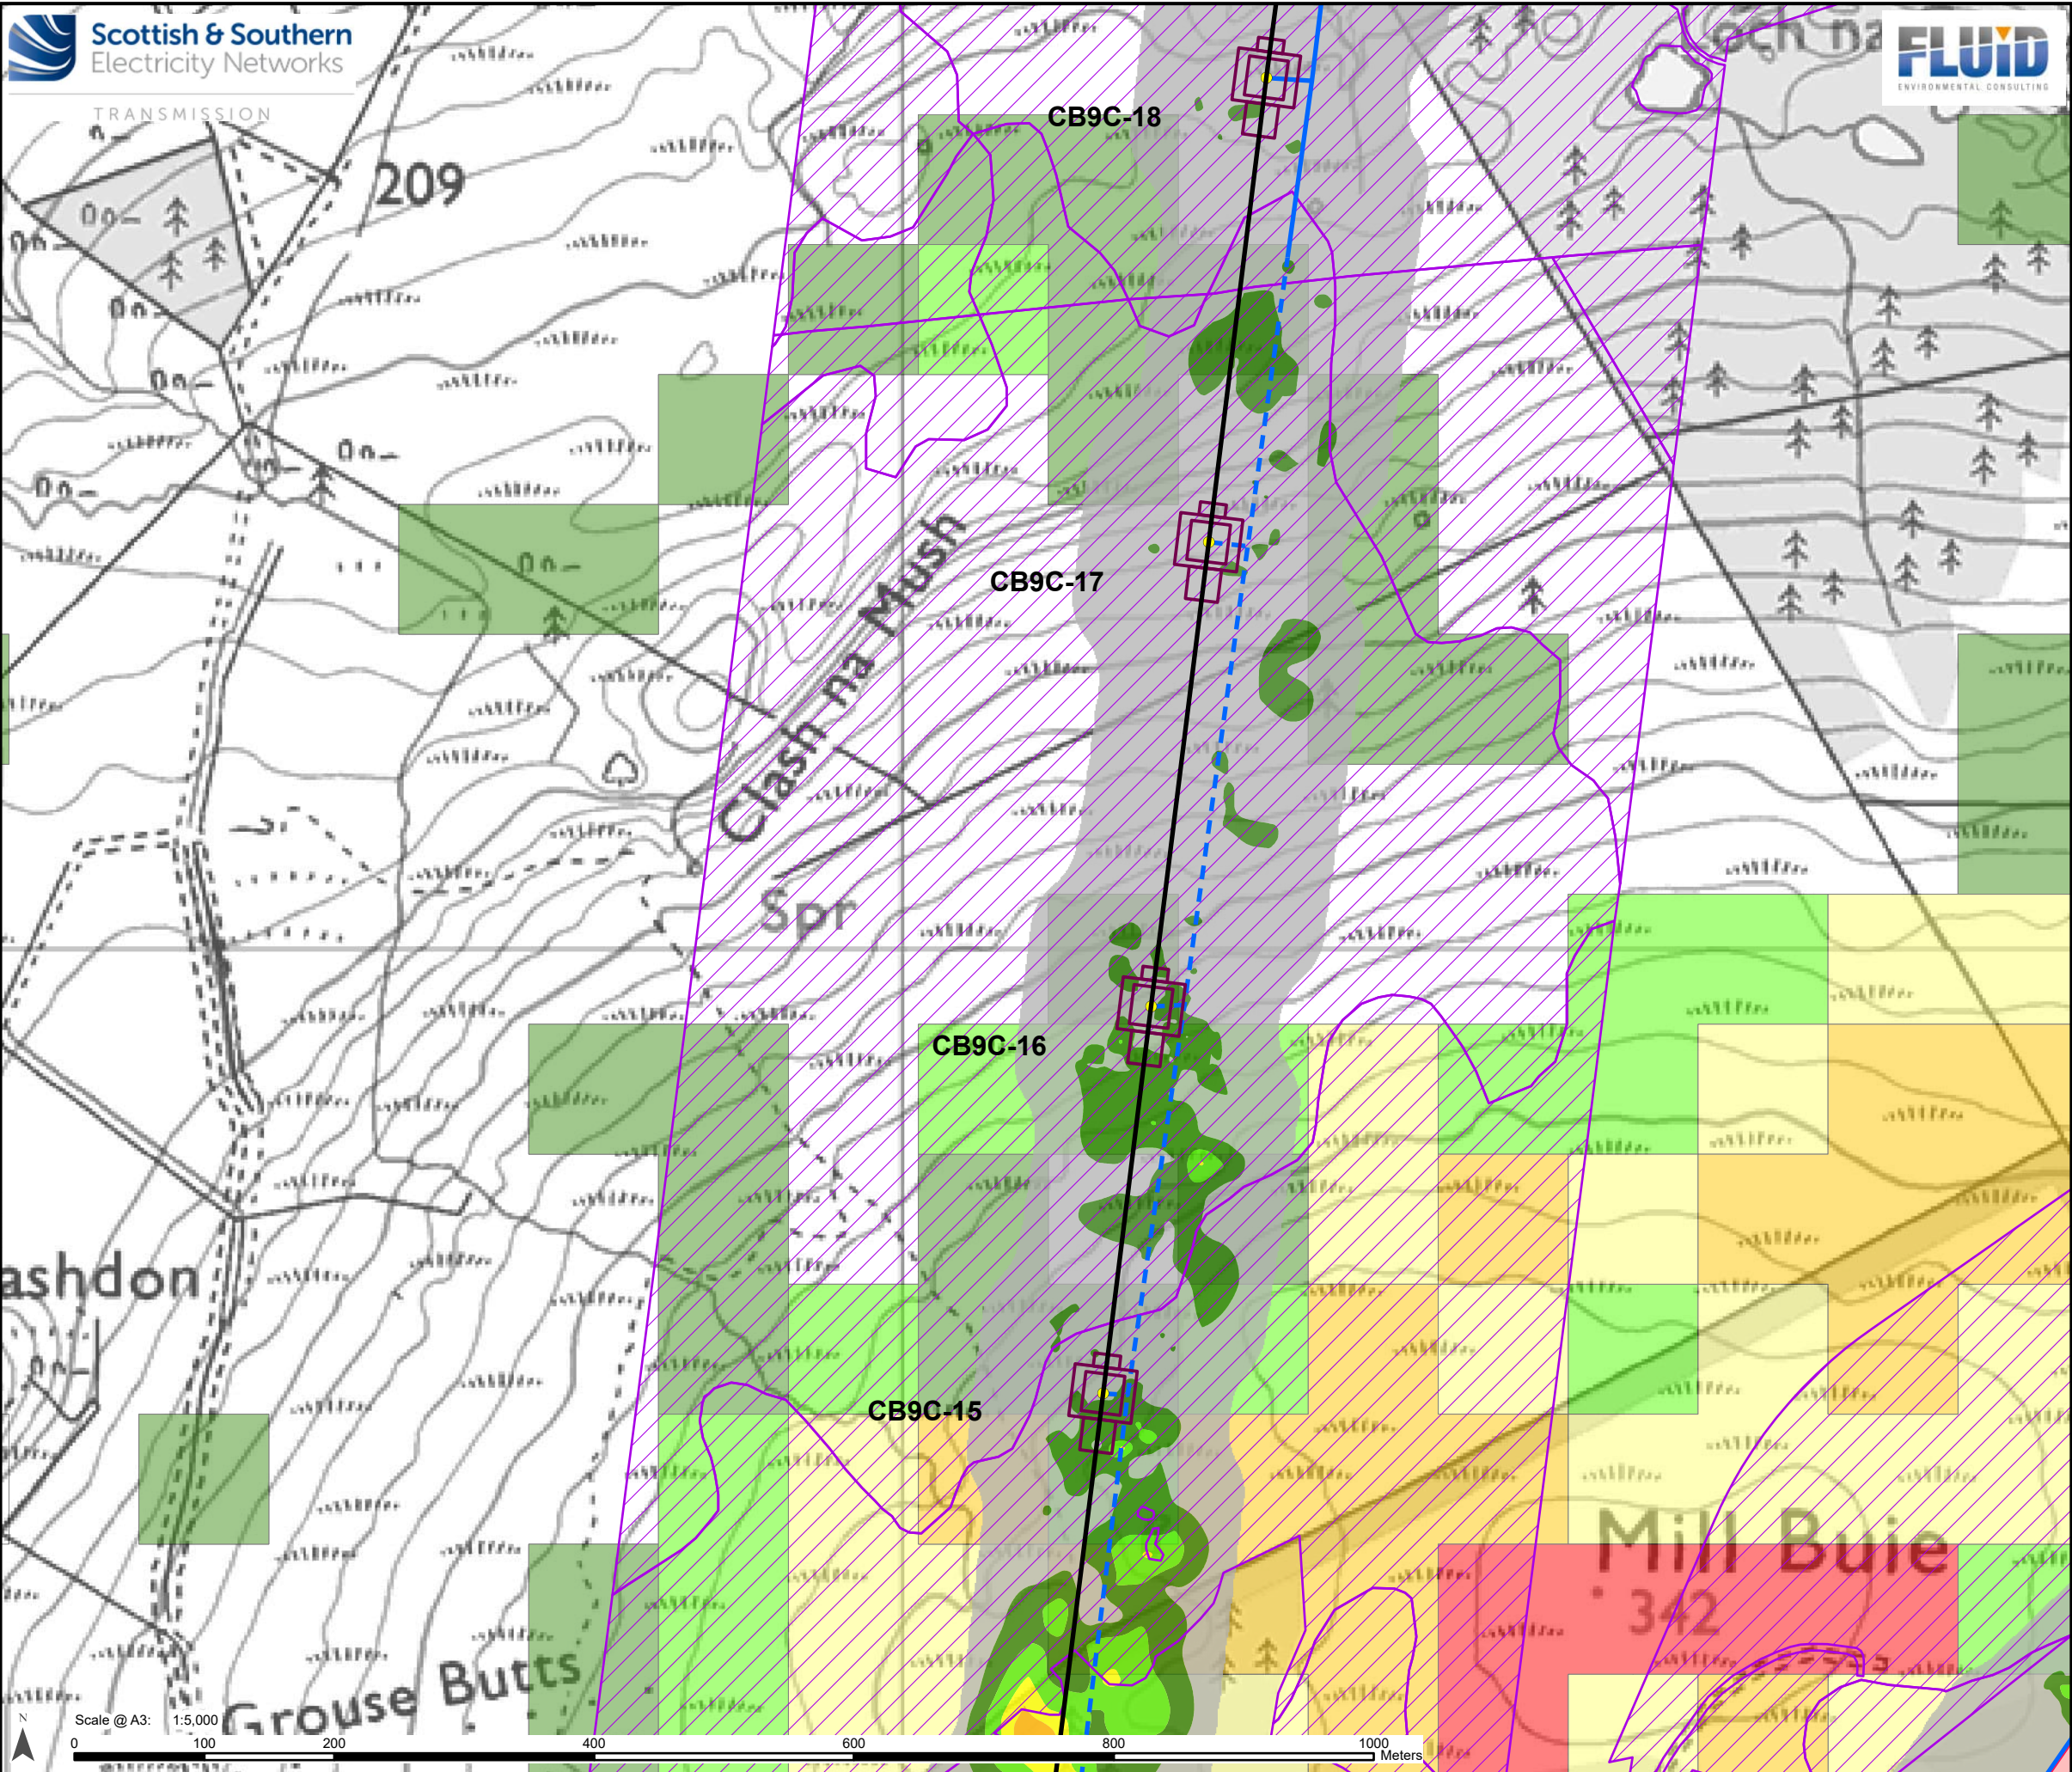

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-Kellas Alternative Alignment

Working Areas *

Proposed Conductor Pulling Area (EPZ)

Proposed Access – Permanent

Proposed Access – Permanent Floated

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 53 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

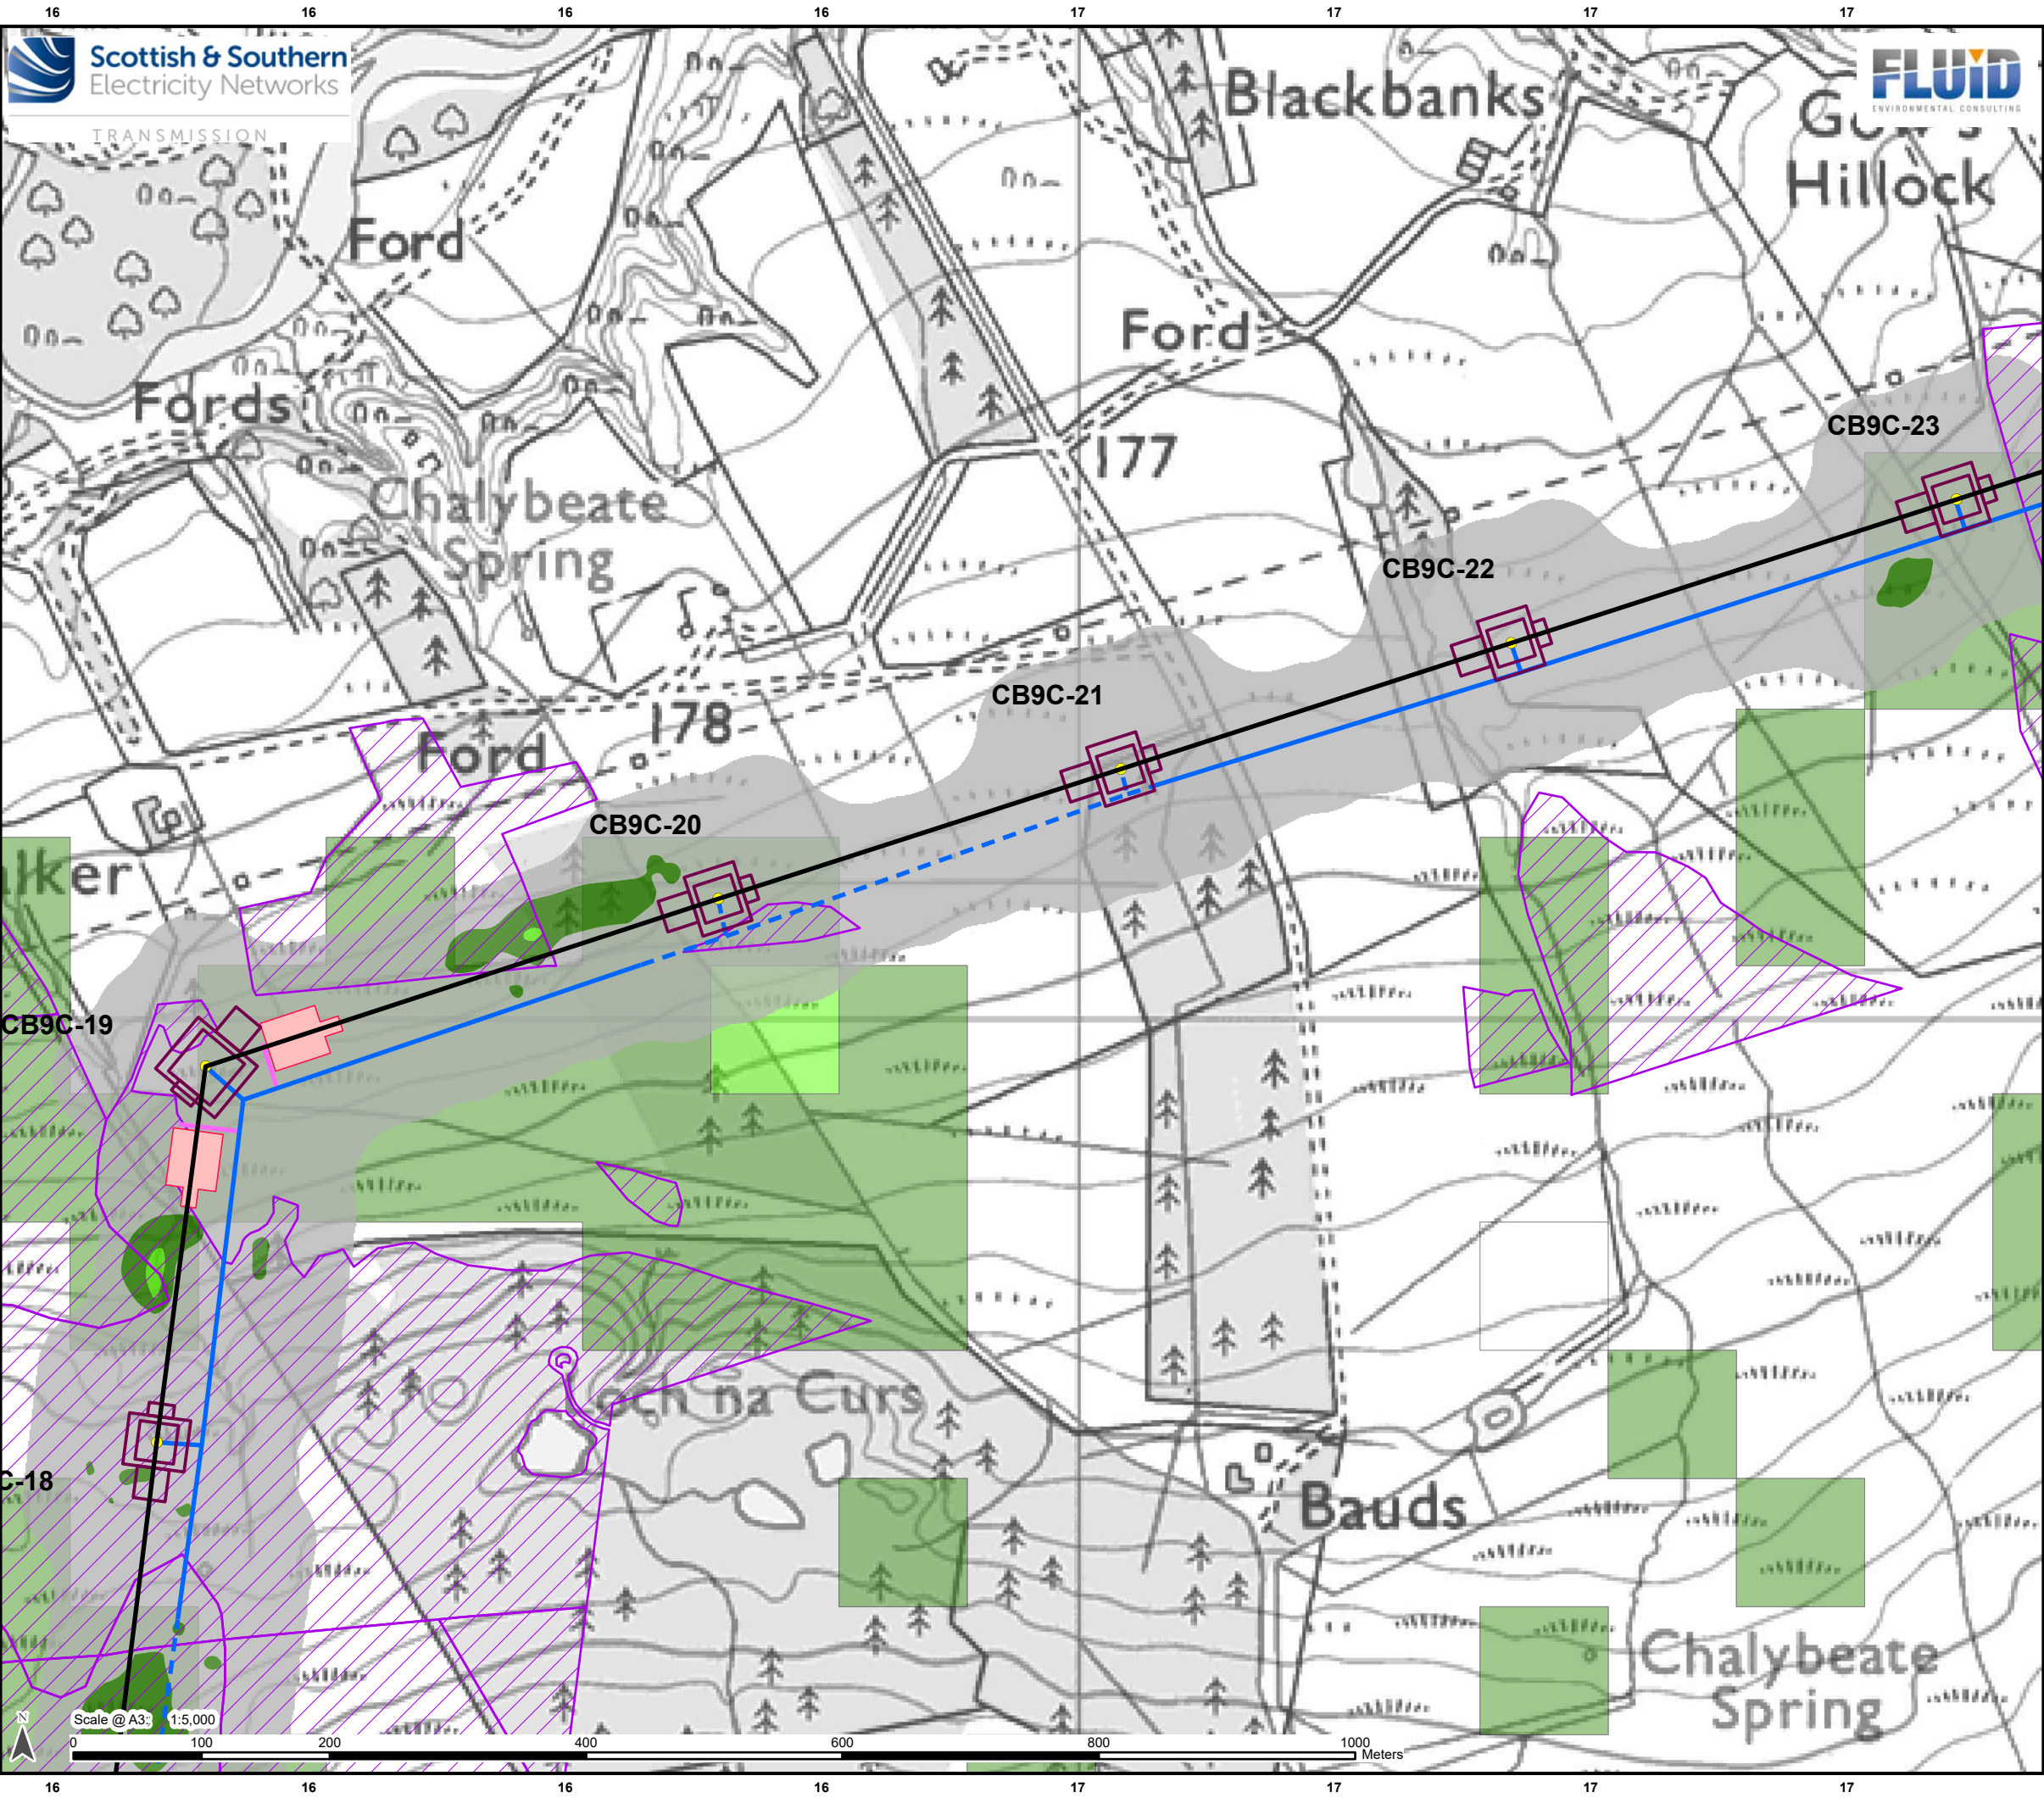

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-Kellas Alternative Alignment

Working Areas *

Proposed Conductor Pulling Area (EPZ)

Proposed Access – ATV or Temporary Trackway

Proposed Access – Permanent

Proposed Access – Permanent Floated

JHI Peat Presence Score

012345

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 54 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

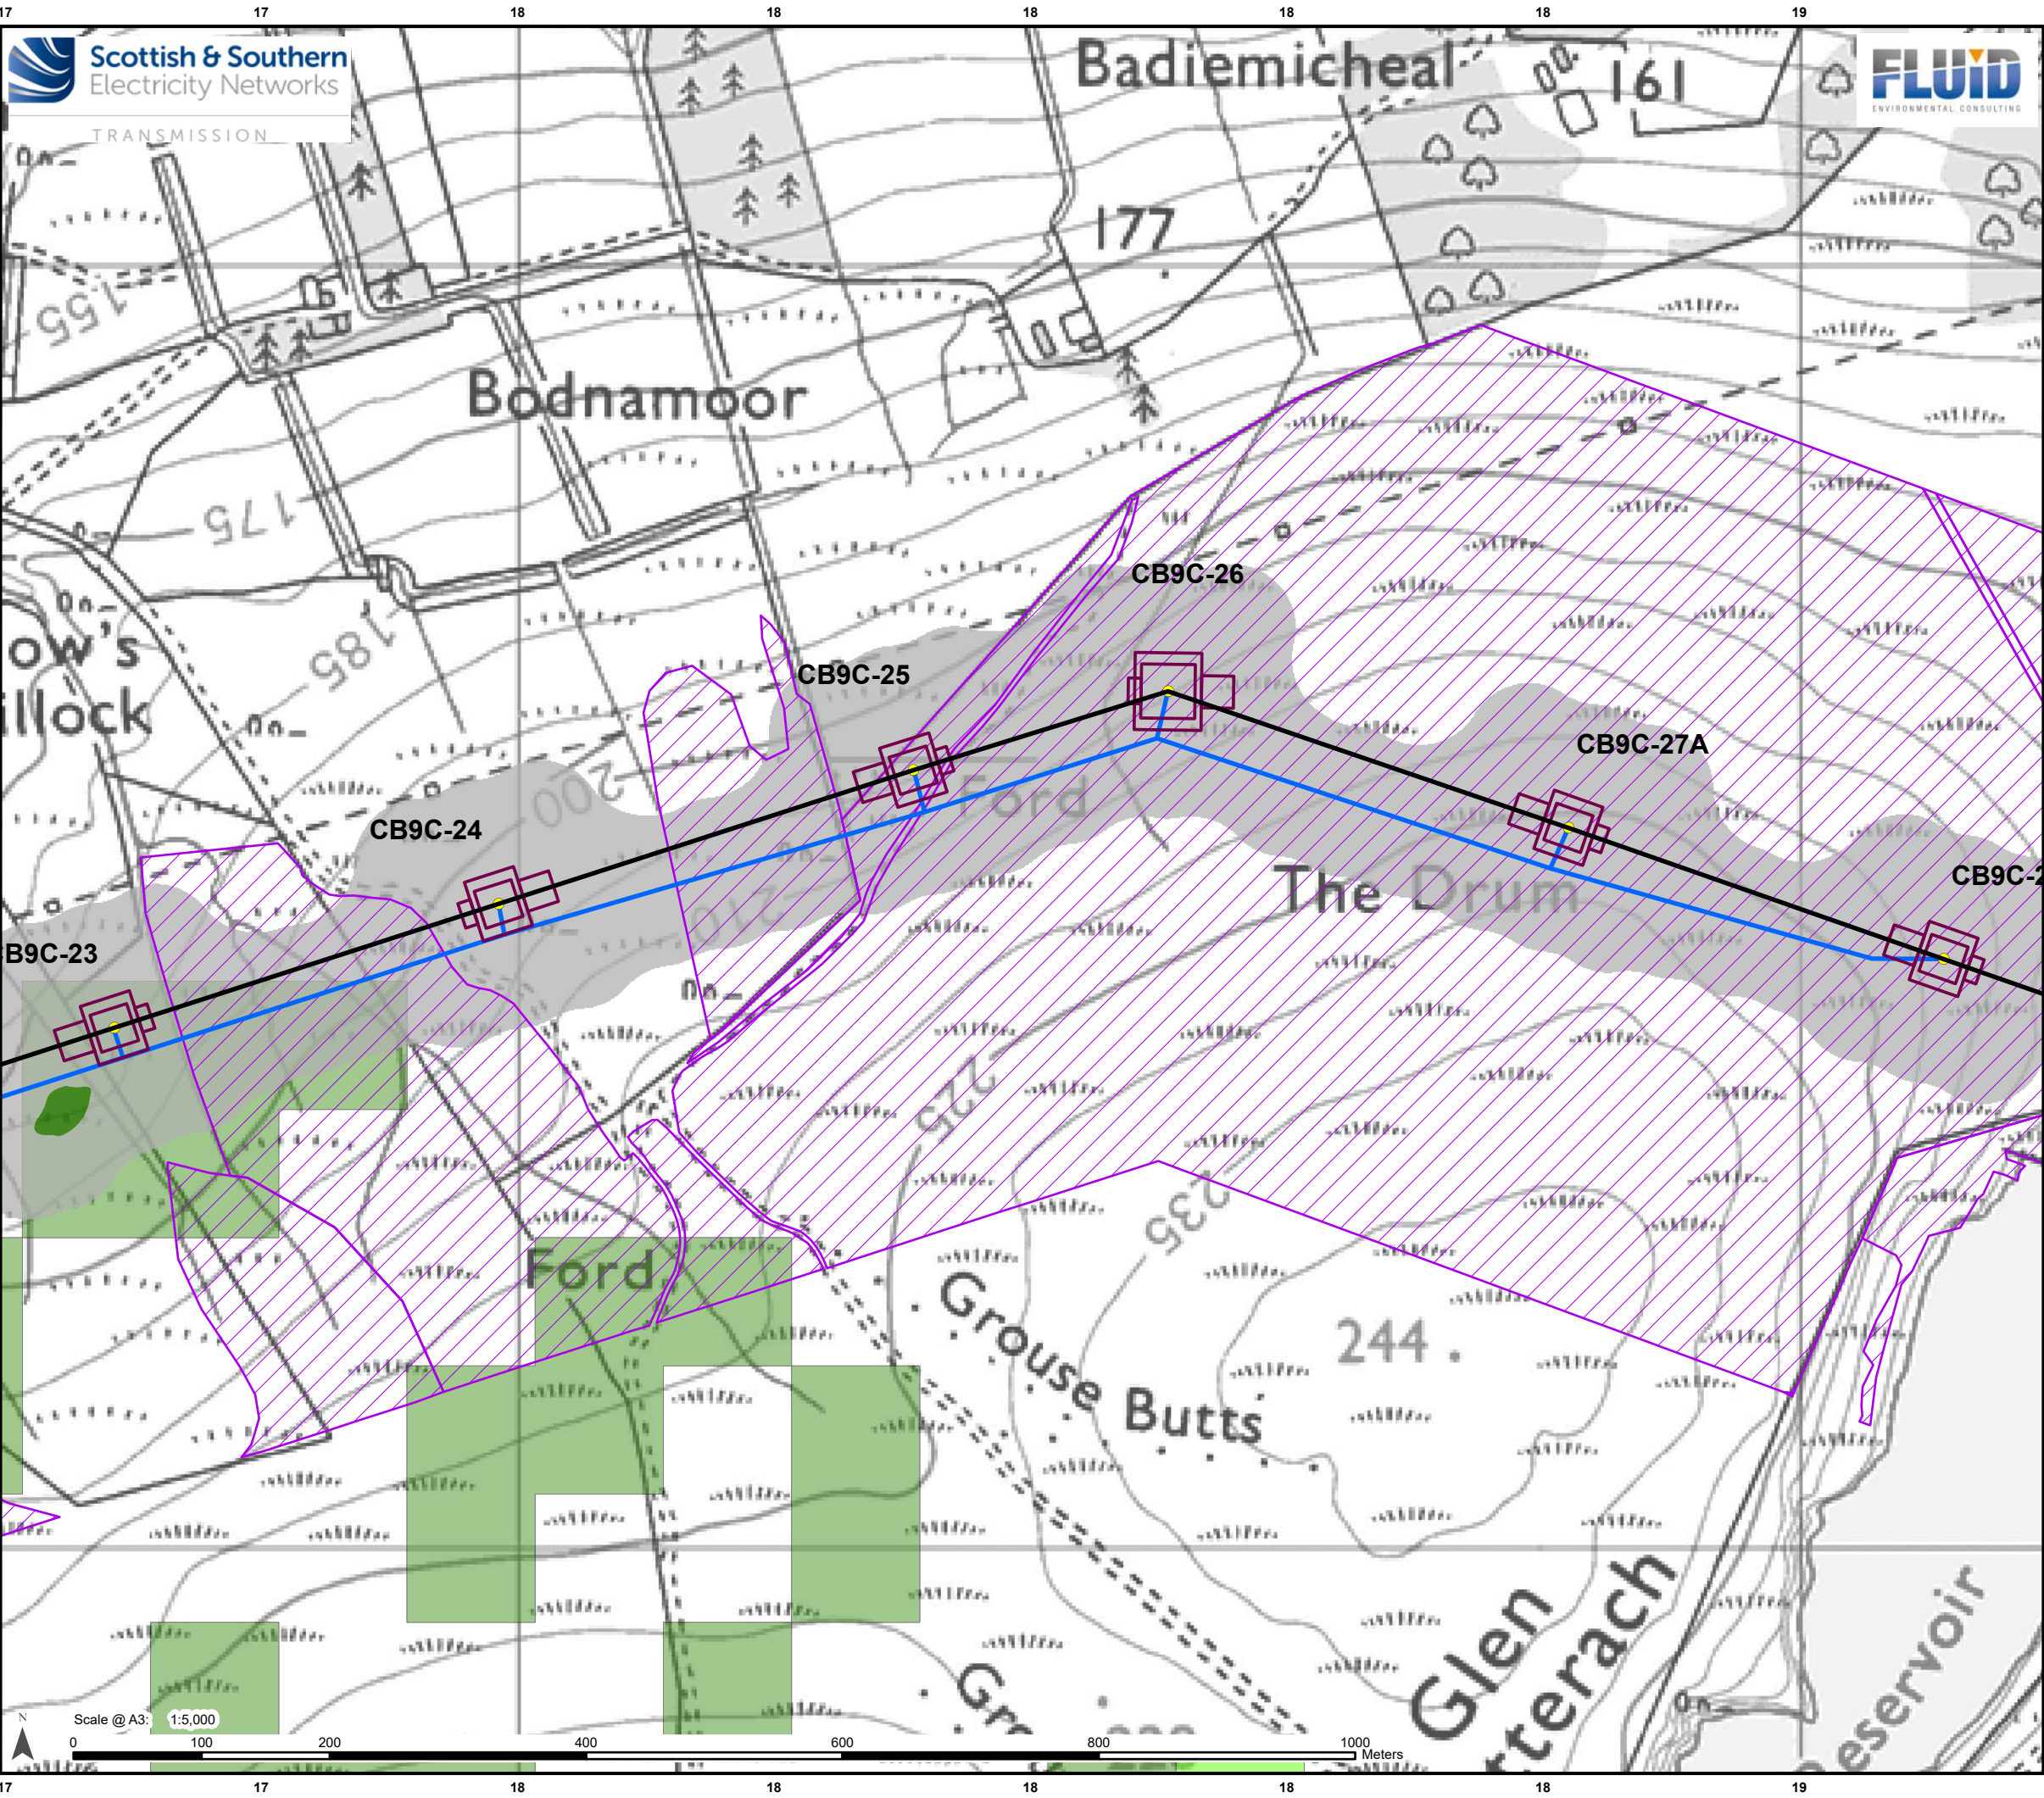

TRANSMISSION

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-Kellas Alternative Alignment

Working Areas *

Proposed Access – Permanent

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:

Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title:

Figure 10.1.2 - Estimated Peat Depth
Page 56 of 128

Drawn by: JM

Date: 01/09/2025

Drawing:

B2P-WSP-DA-70092380-074

