


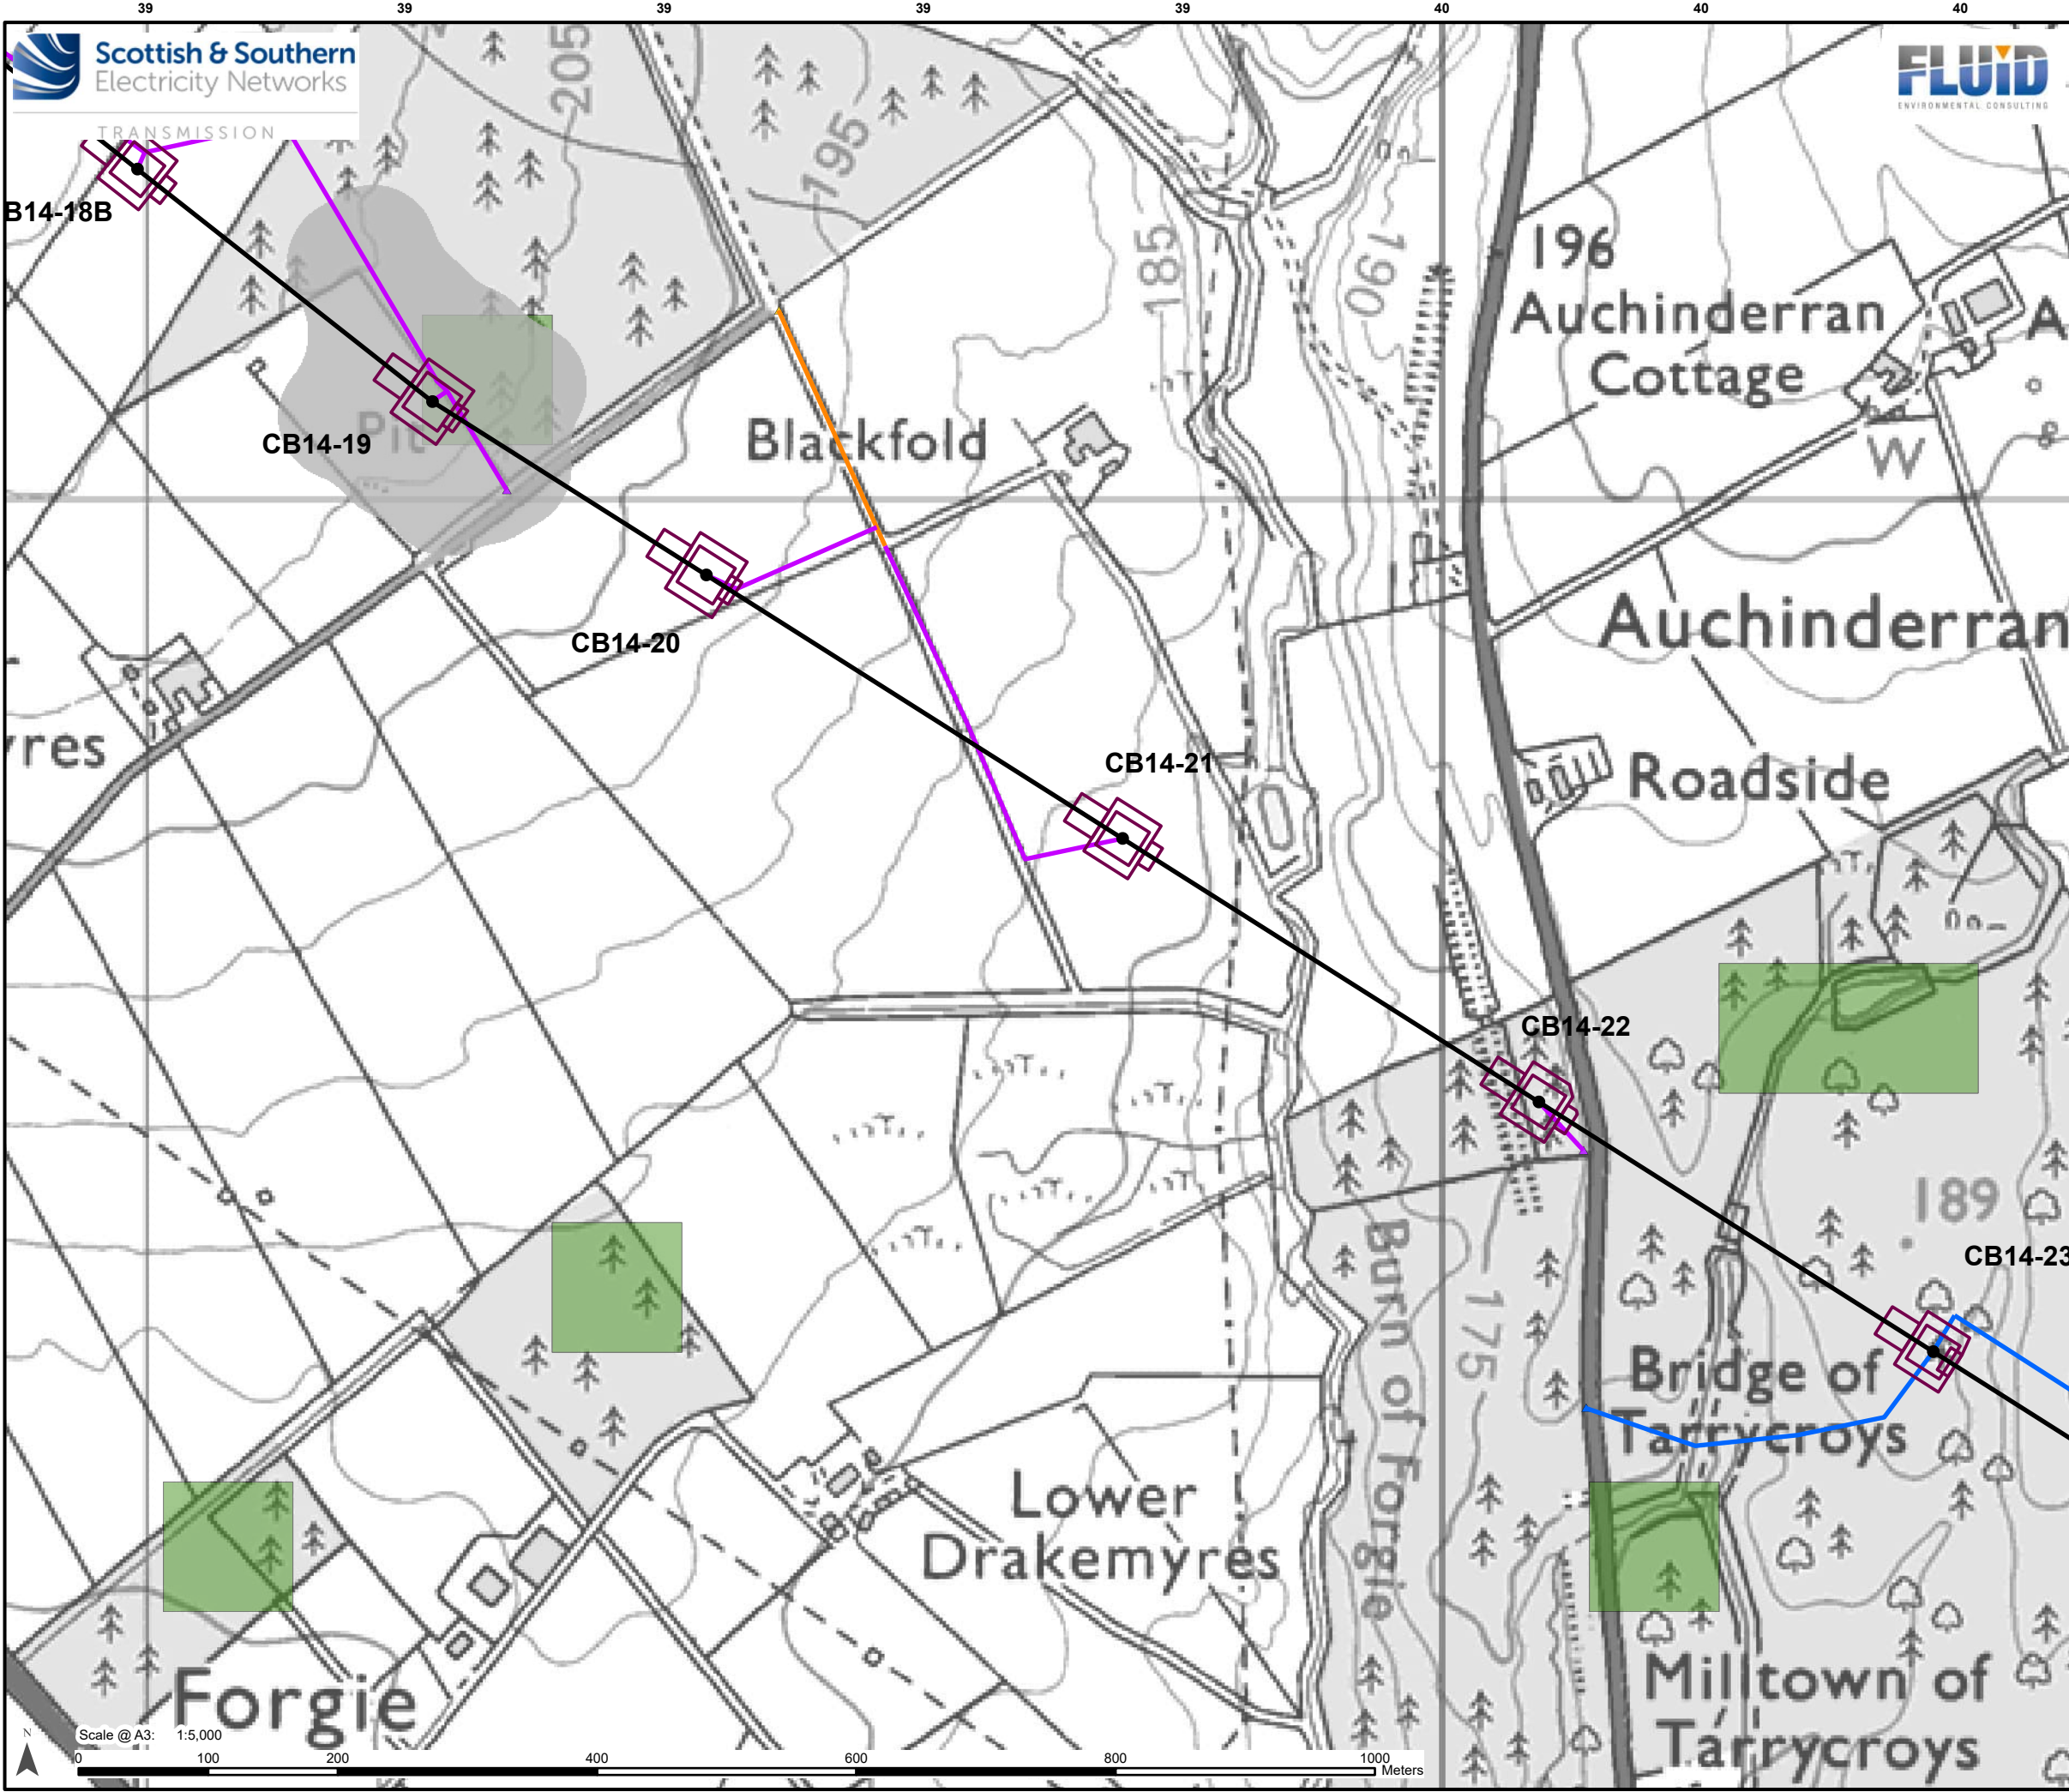

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Existing Access – Upgrade – Poor Condition
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 73 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074



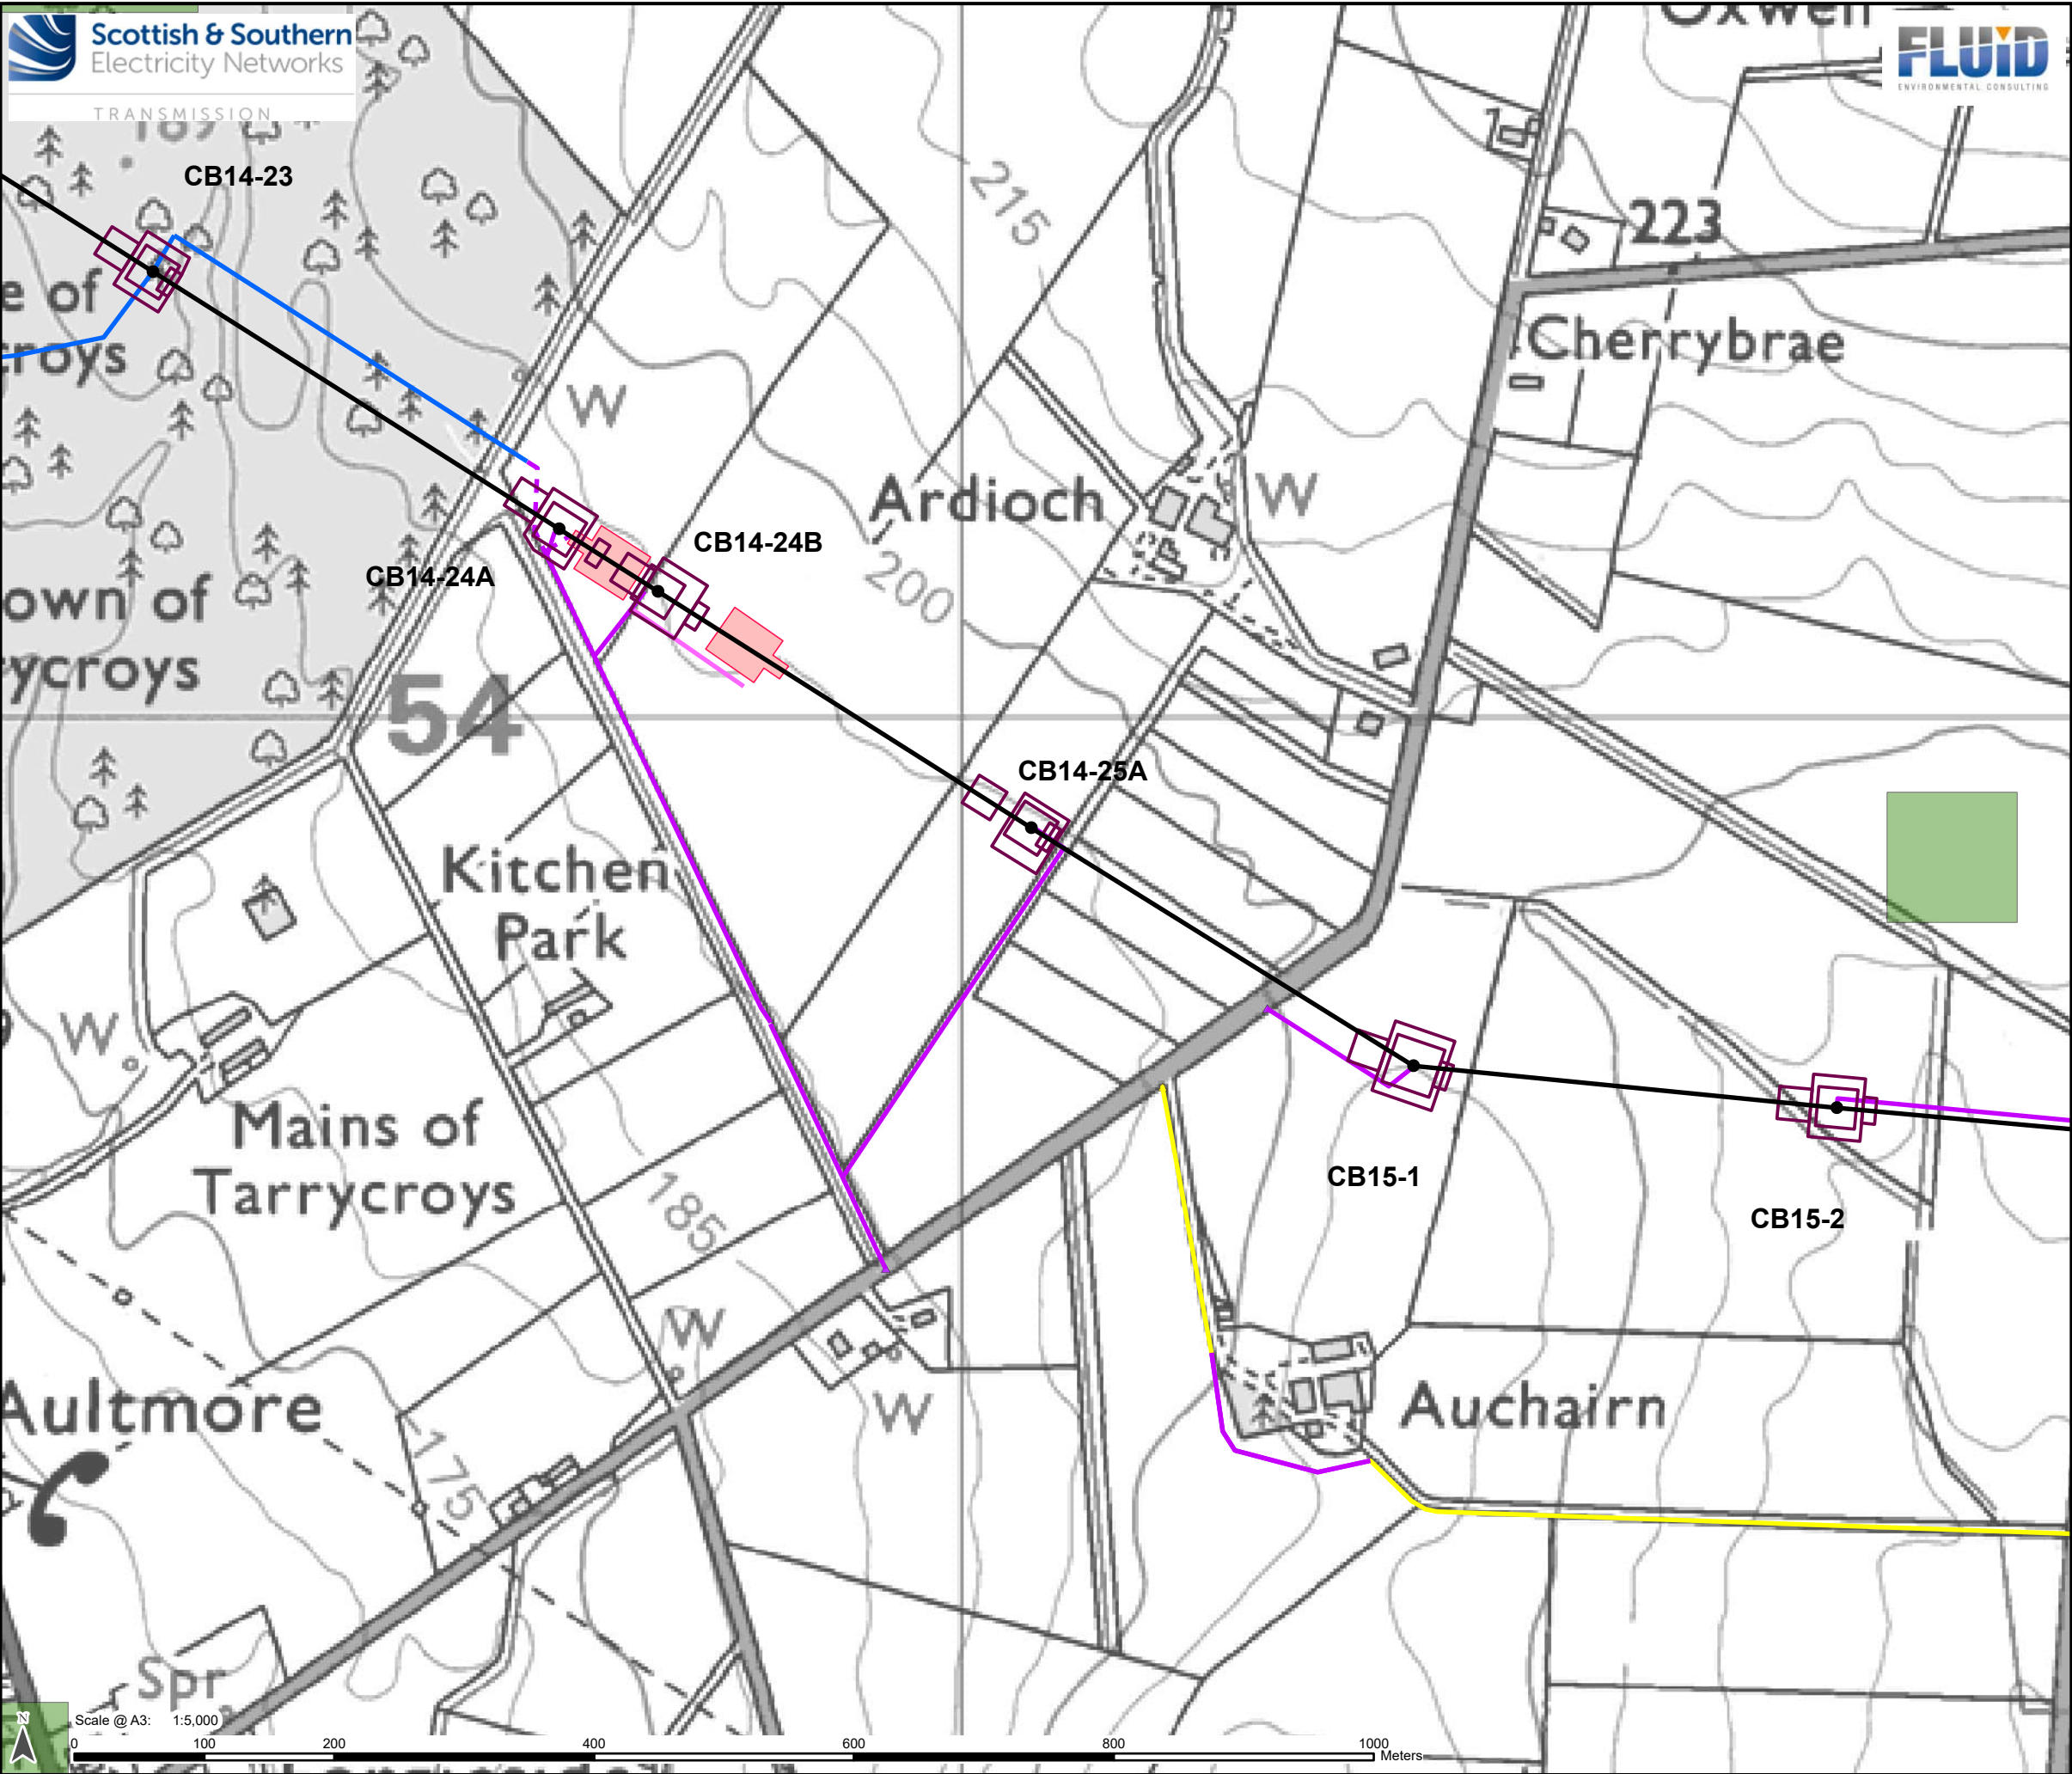

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 74 of 128


Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 75 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074


TRANSMISSION

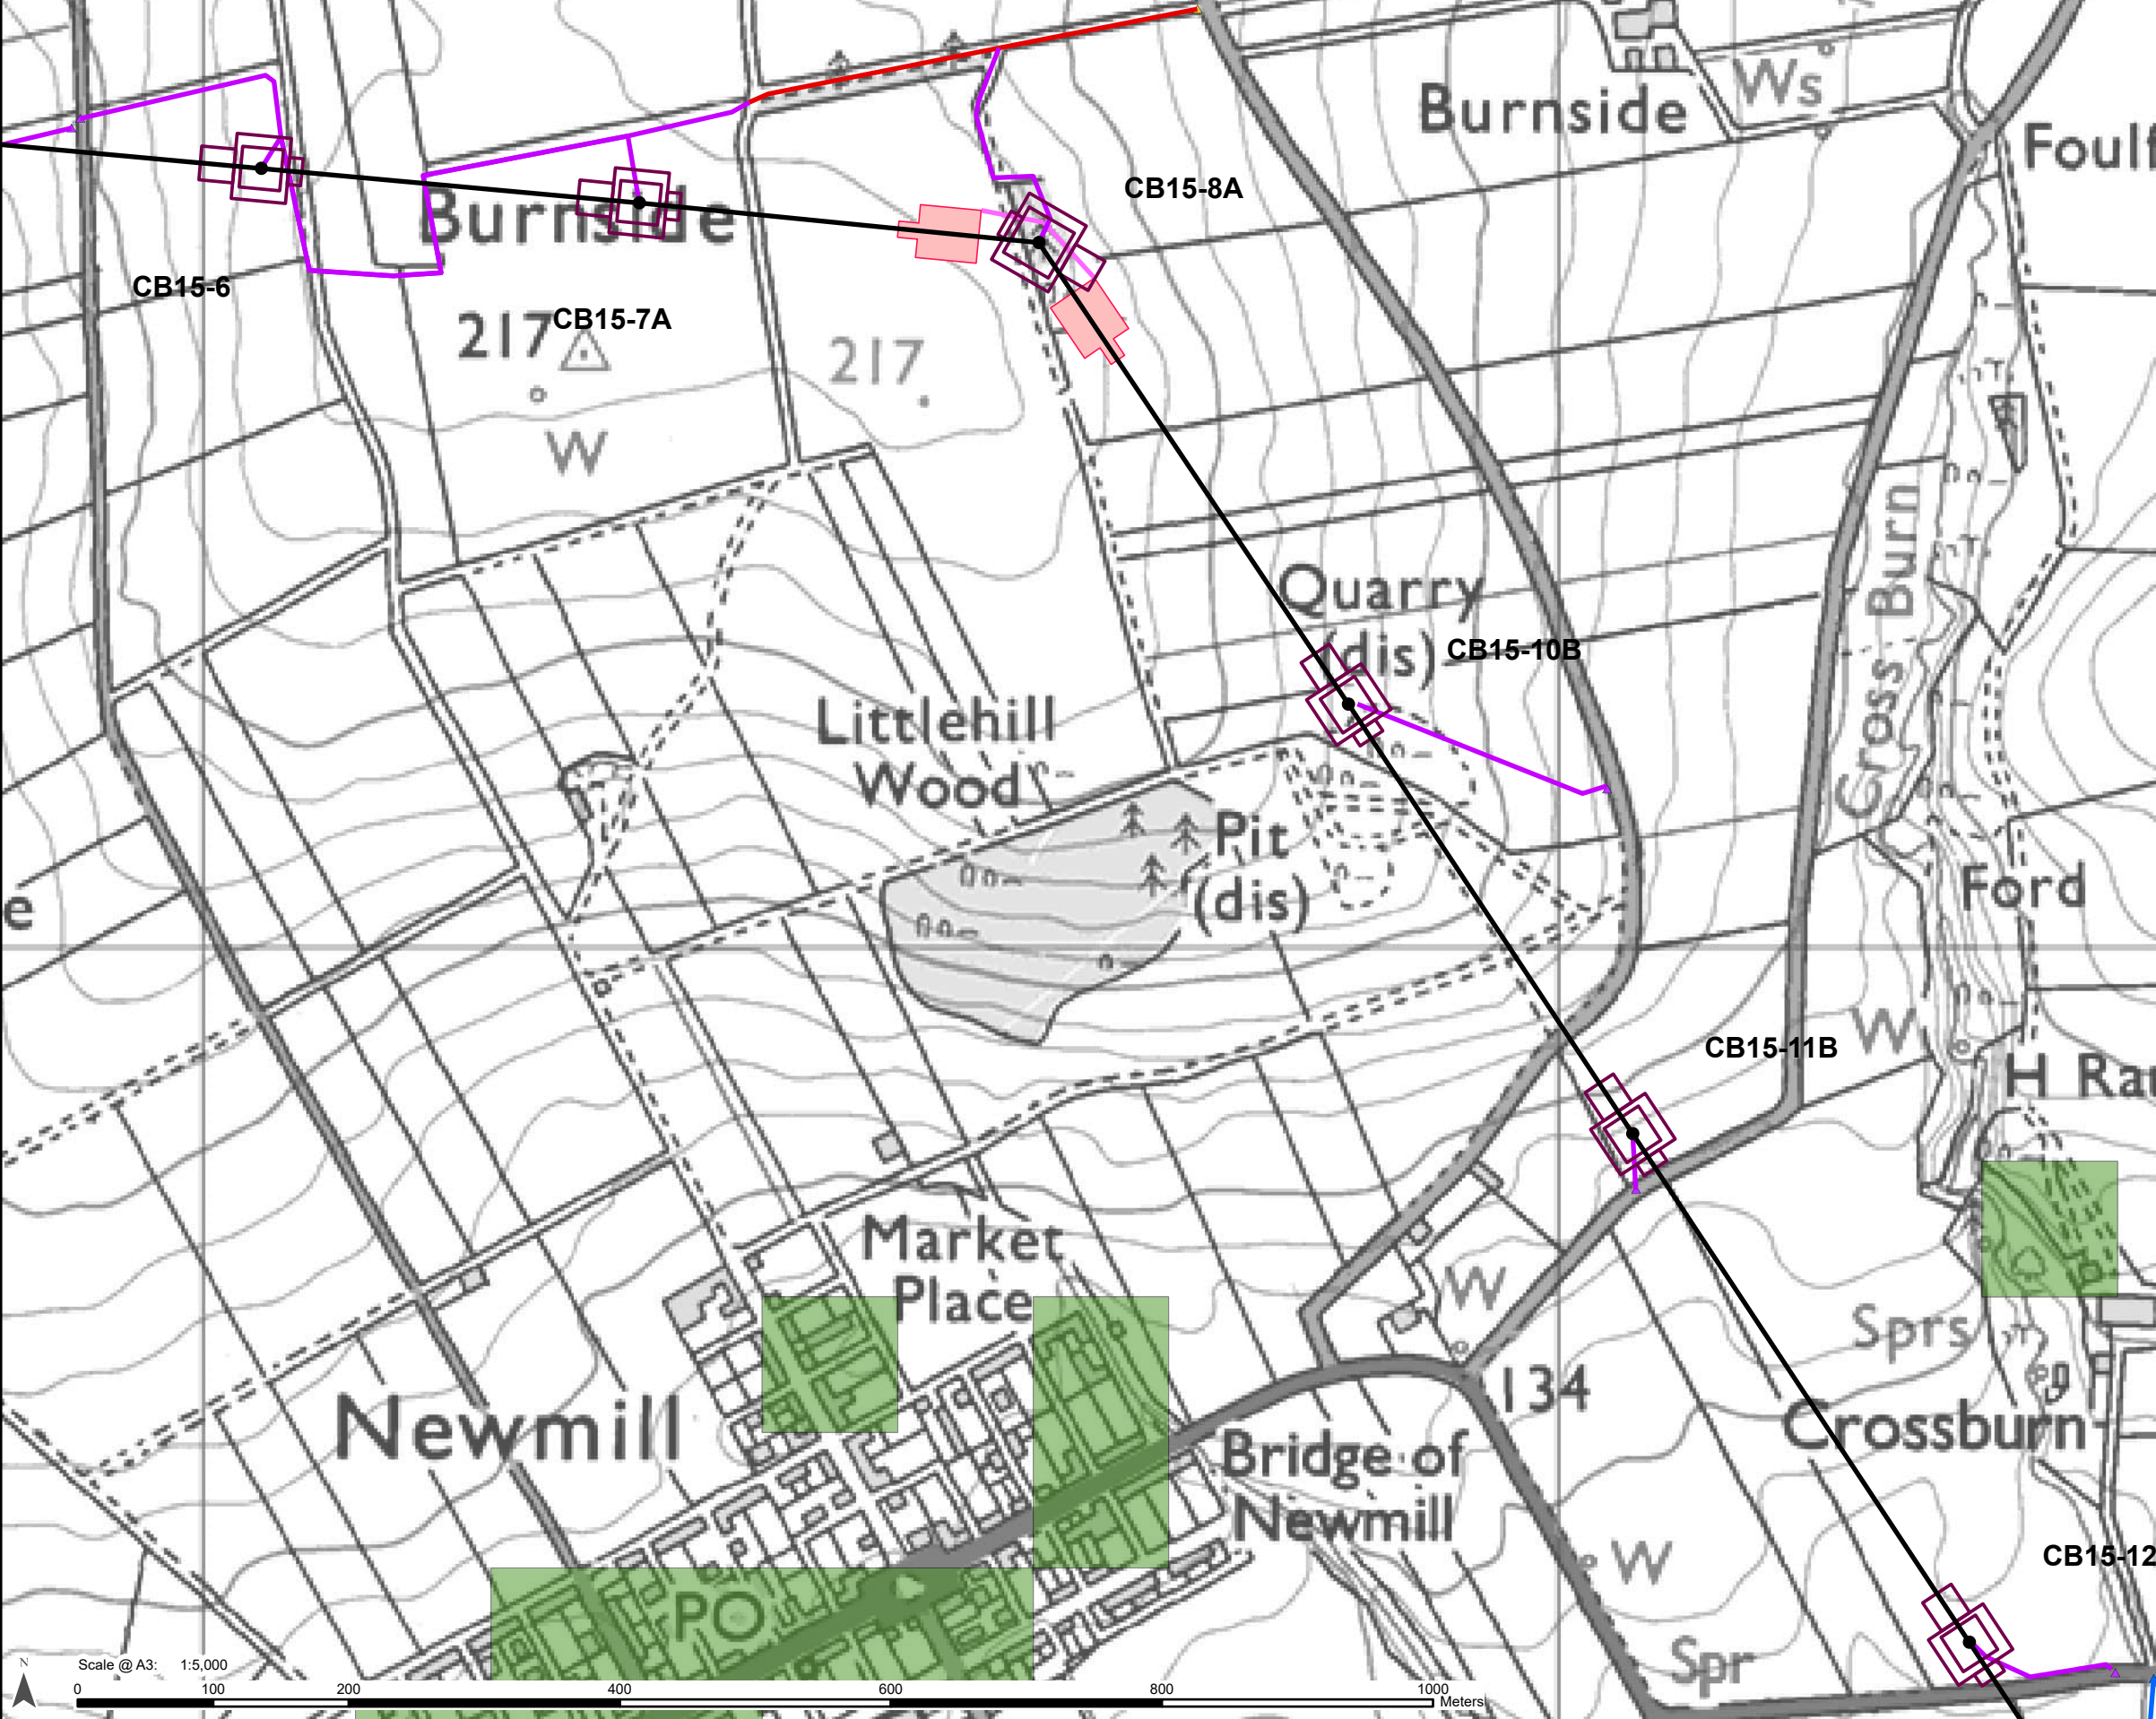

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 76 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

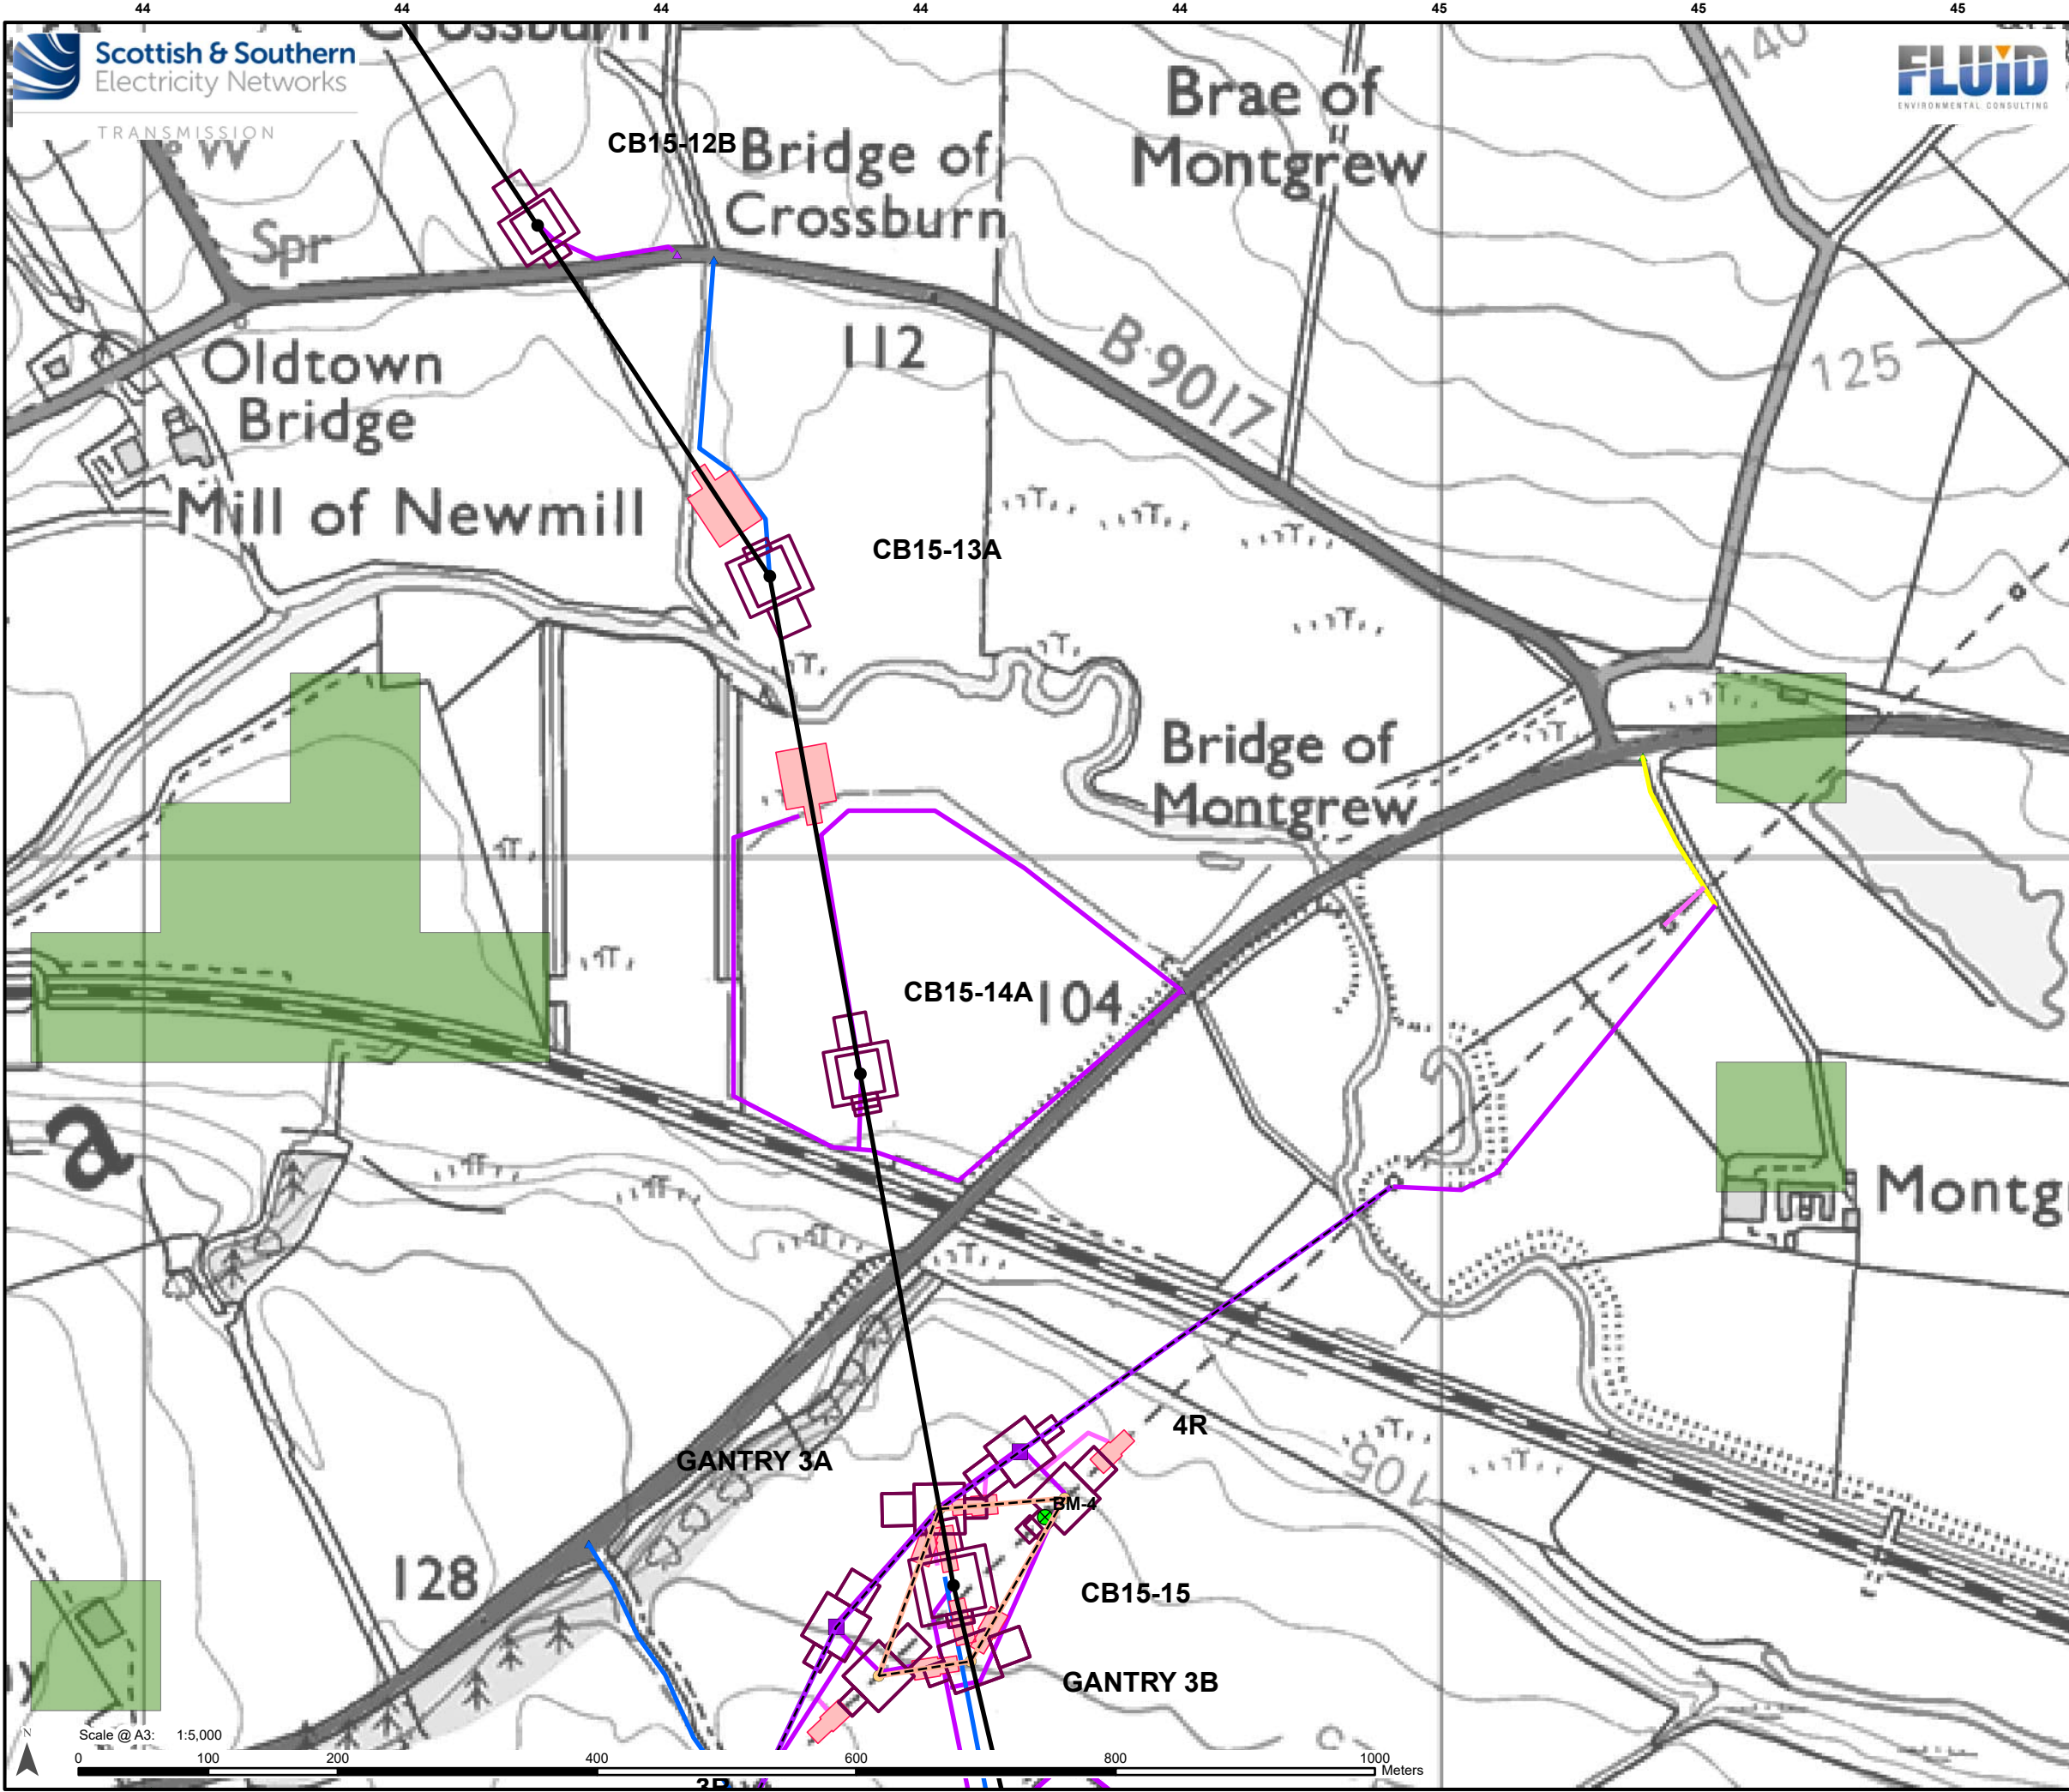

Legend

- Proposed OHL Alignment - 400kV
- Proposed Alignment - Existing OHL Works (275kV Realignment and Crossings)
- Temporary OHL Diversion
- Proposed Tower - Temporary
- Proposed Tower-400kV (with tower number)
- Proposed Tower-Existing OHL Works (275kV Realignment and Crossing)
- Tower to be Removed
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Access Only/ATV
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 77 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074


TRANSMISSION

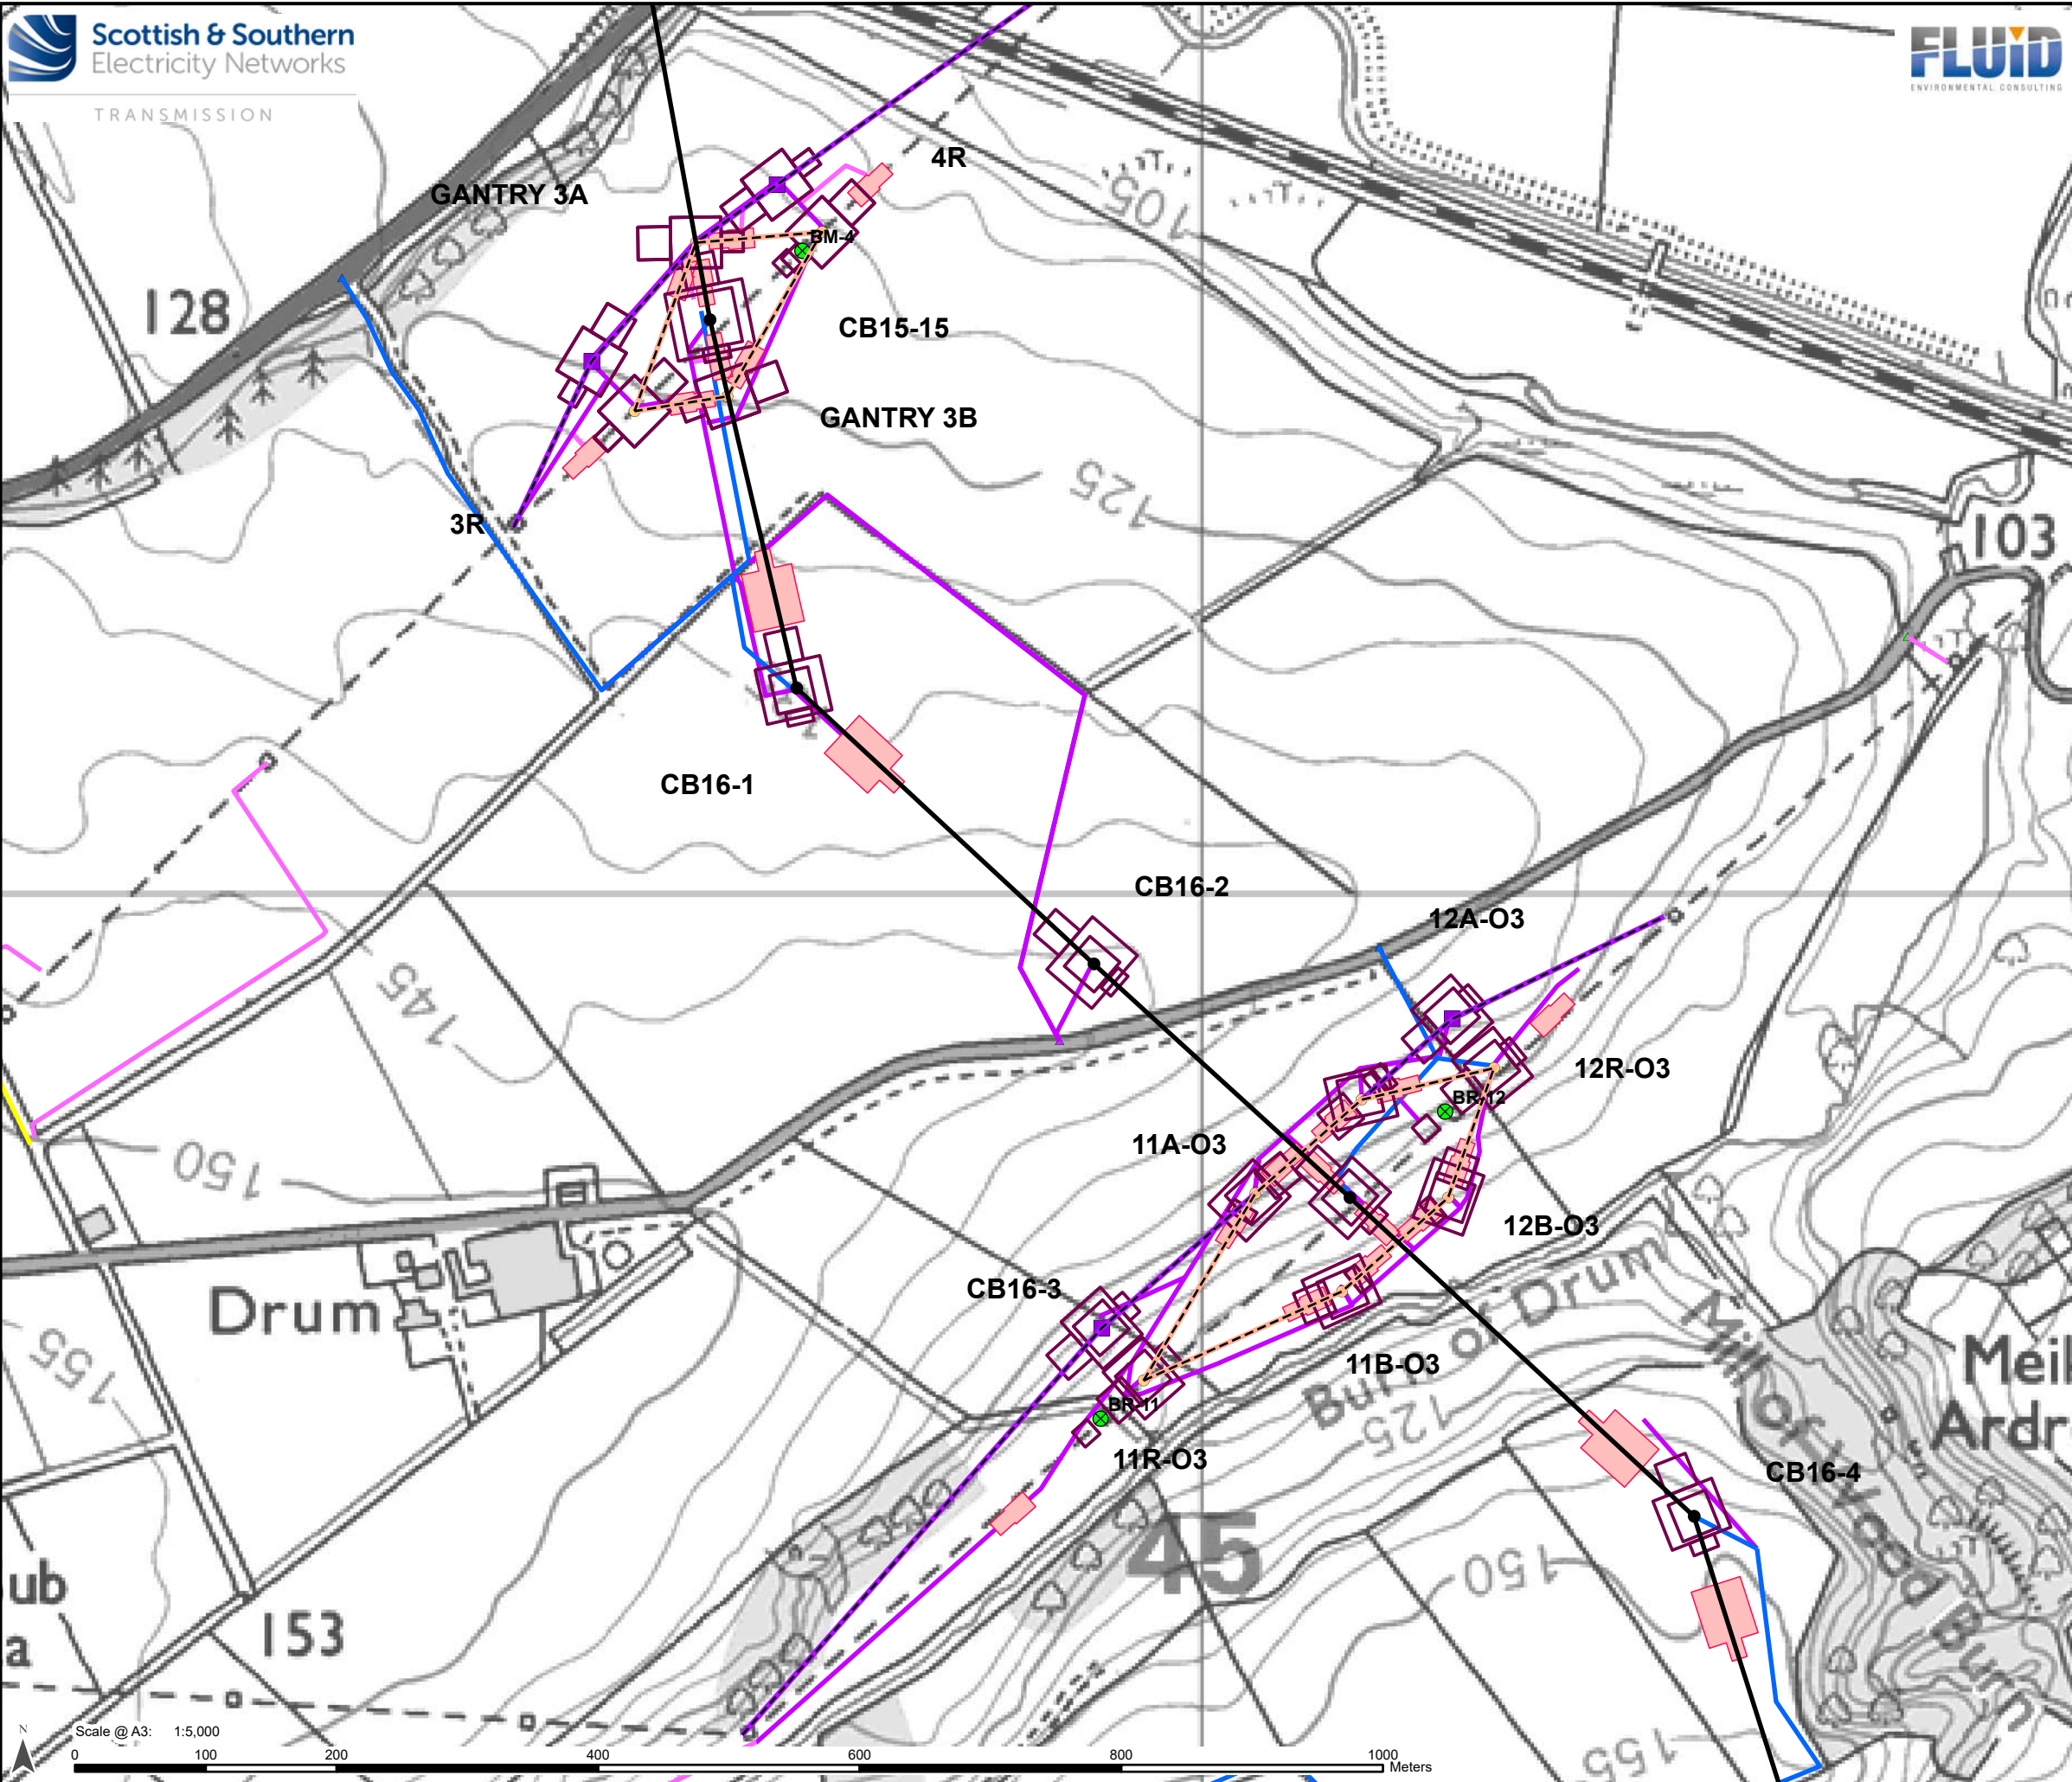

Legend

- Proposed OHL Alignment - 400kV
- Proposed Alignment - Existing OHL Works (275kV Realignment and Crossings)
- Temporary OHL Diversion
- Proposed Tower - Temporary
- Proposed Tower-400kV (with tower number)
- Proposed Tower-Existing OHL Works (275kV Realignment and Crossing)
- Tower to be Removed
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Access Only/ATV
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 78 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

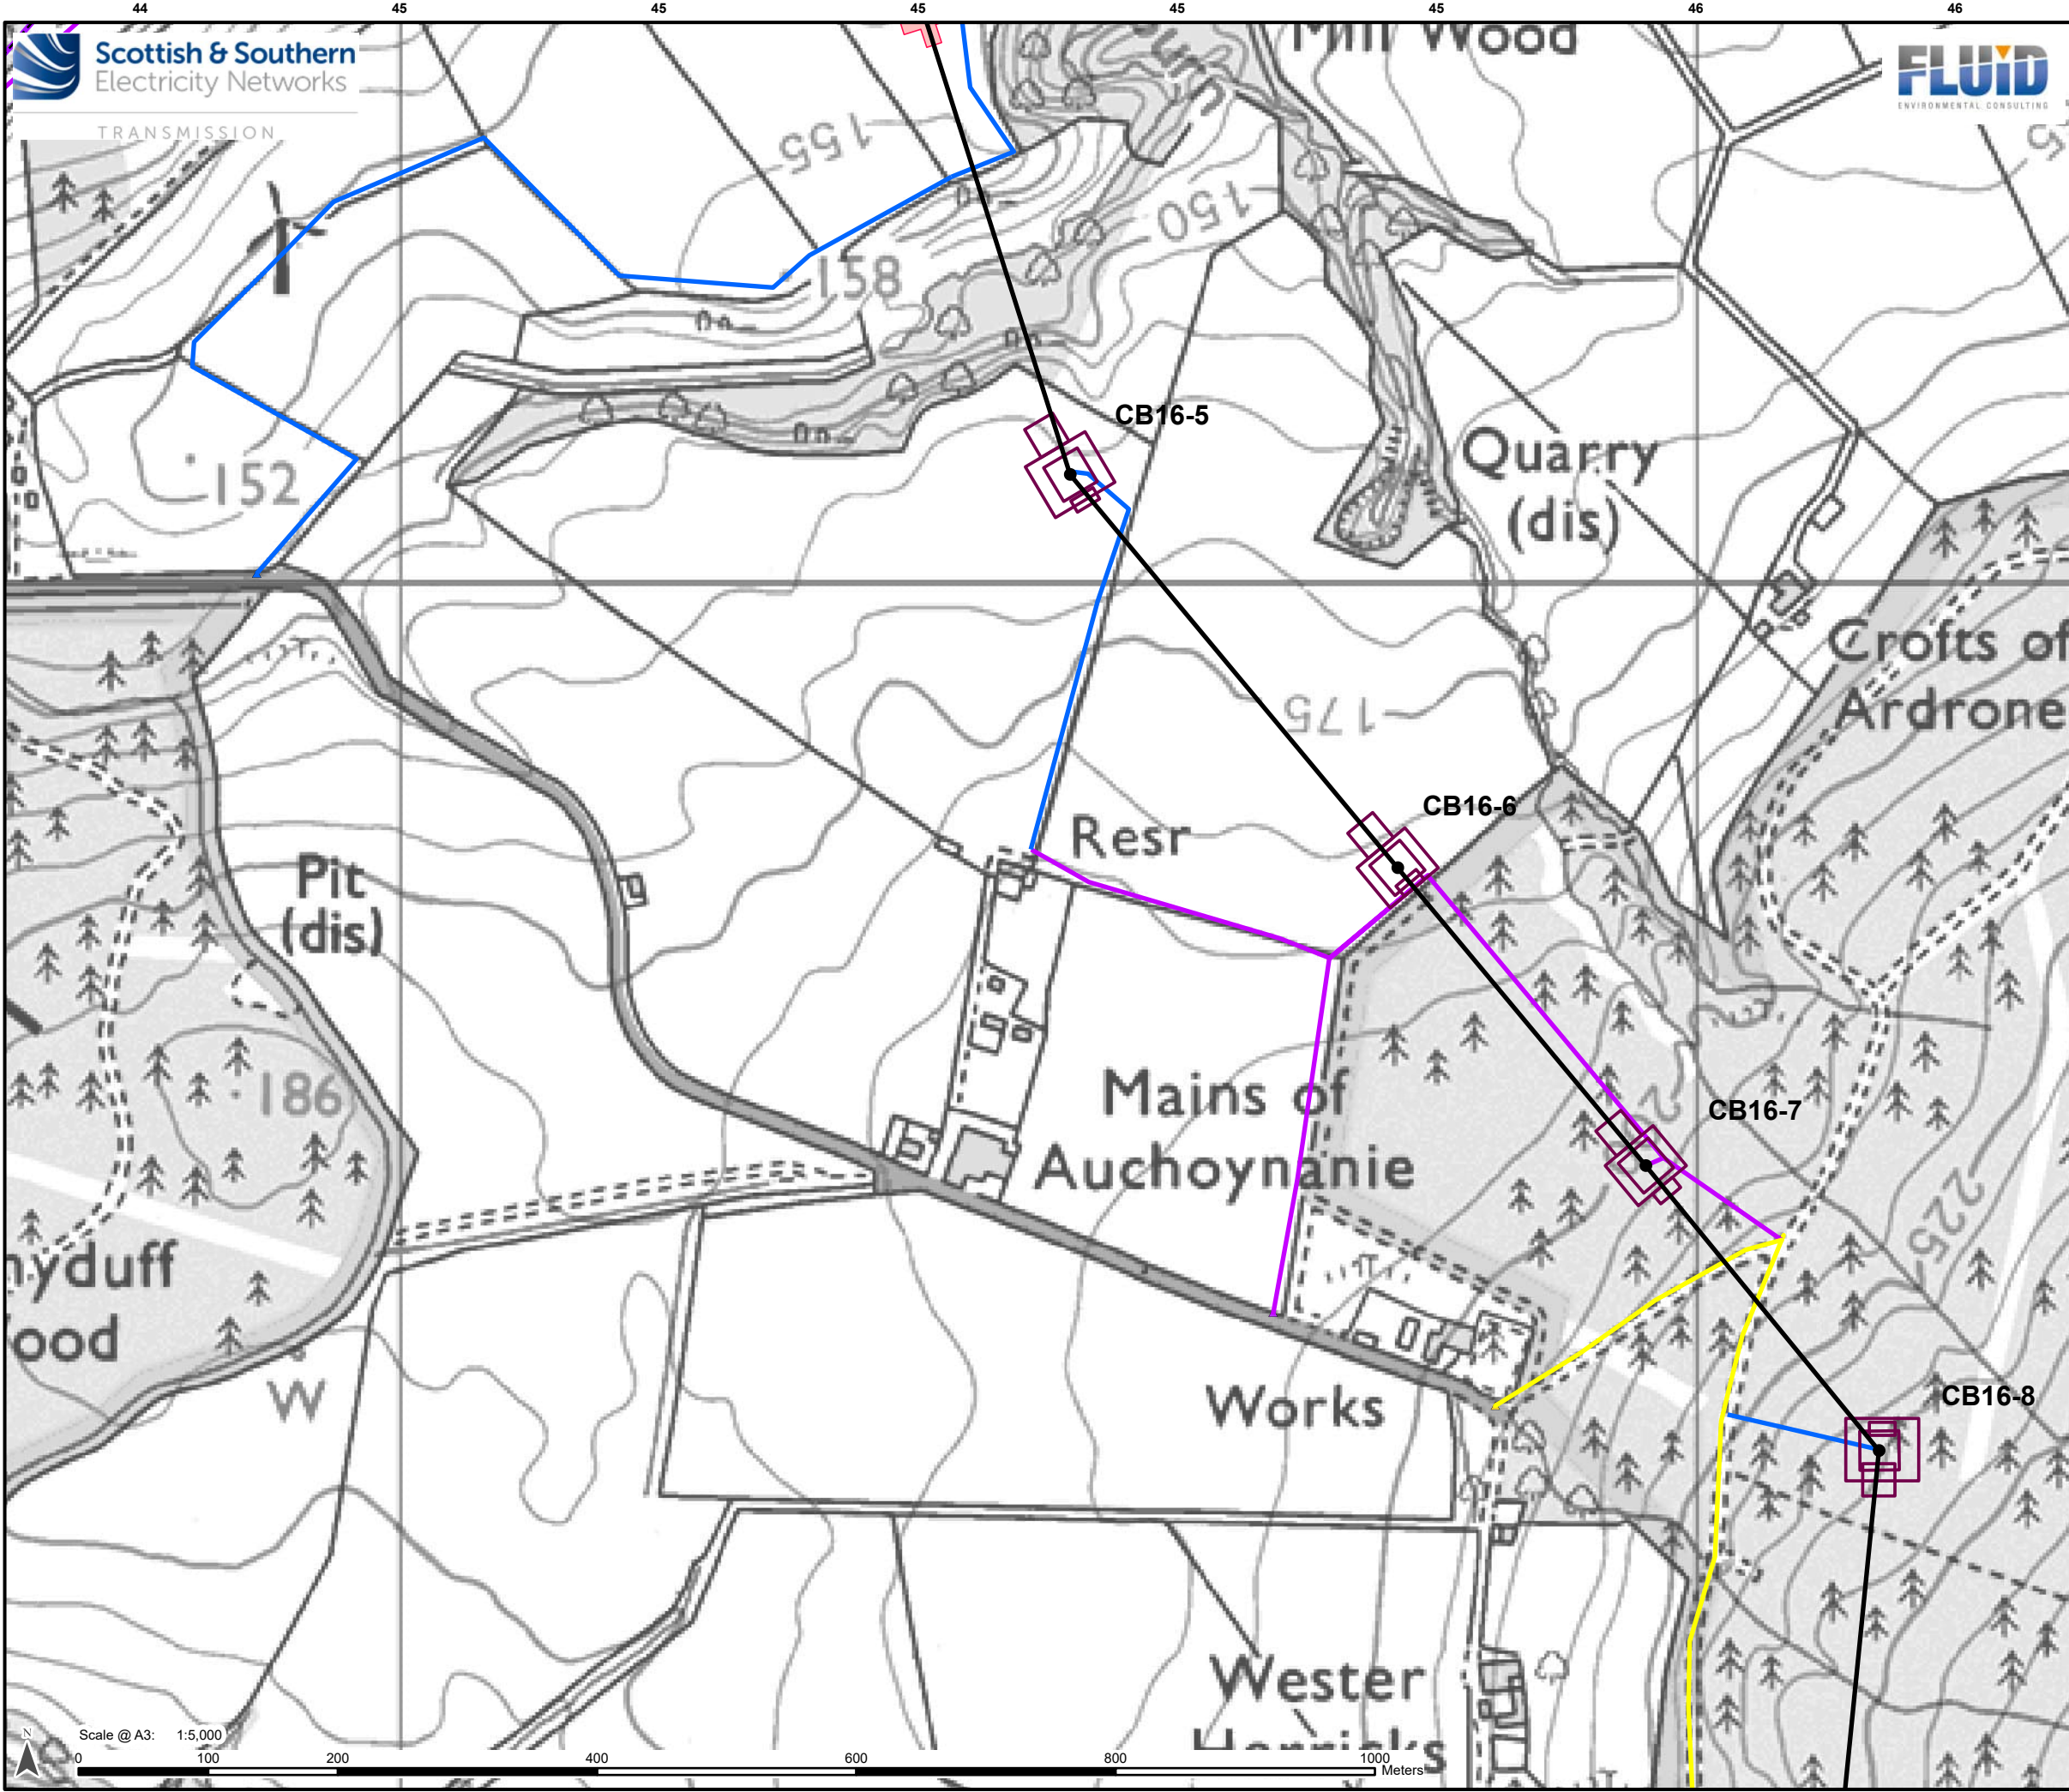

Legend

- Proposed OHL Alignment - 400kV
- Temporary OHL Diversion
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 79 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

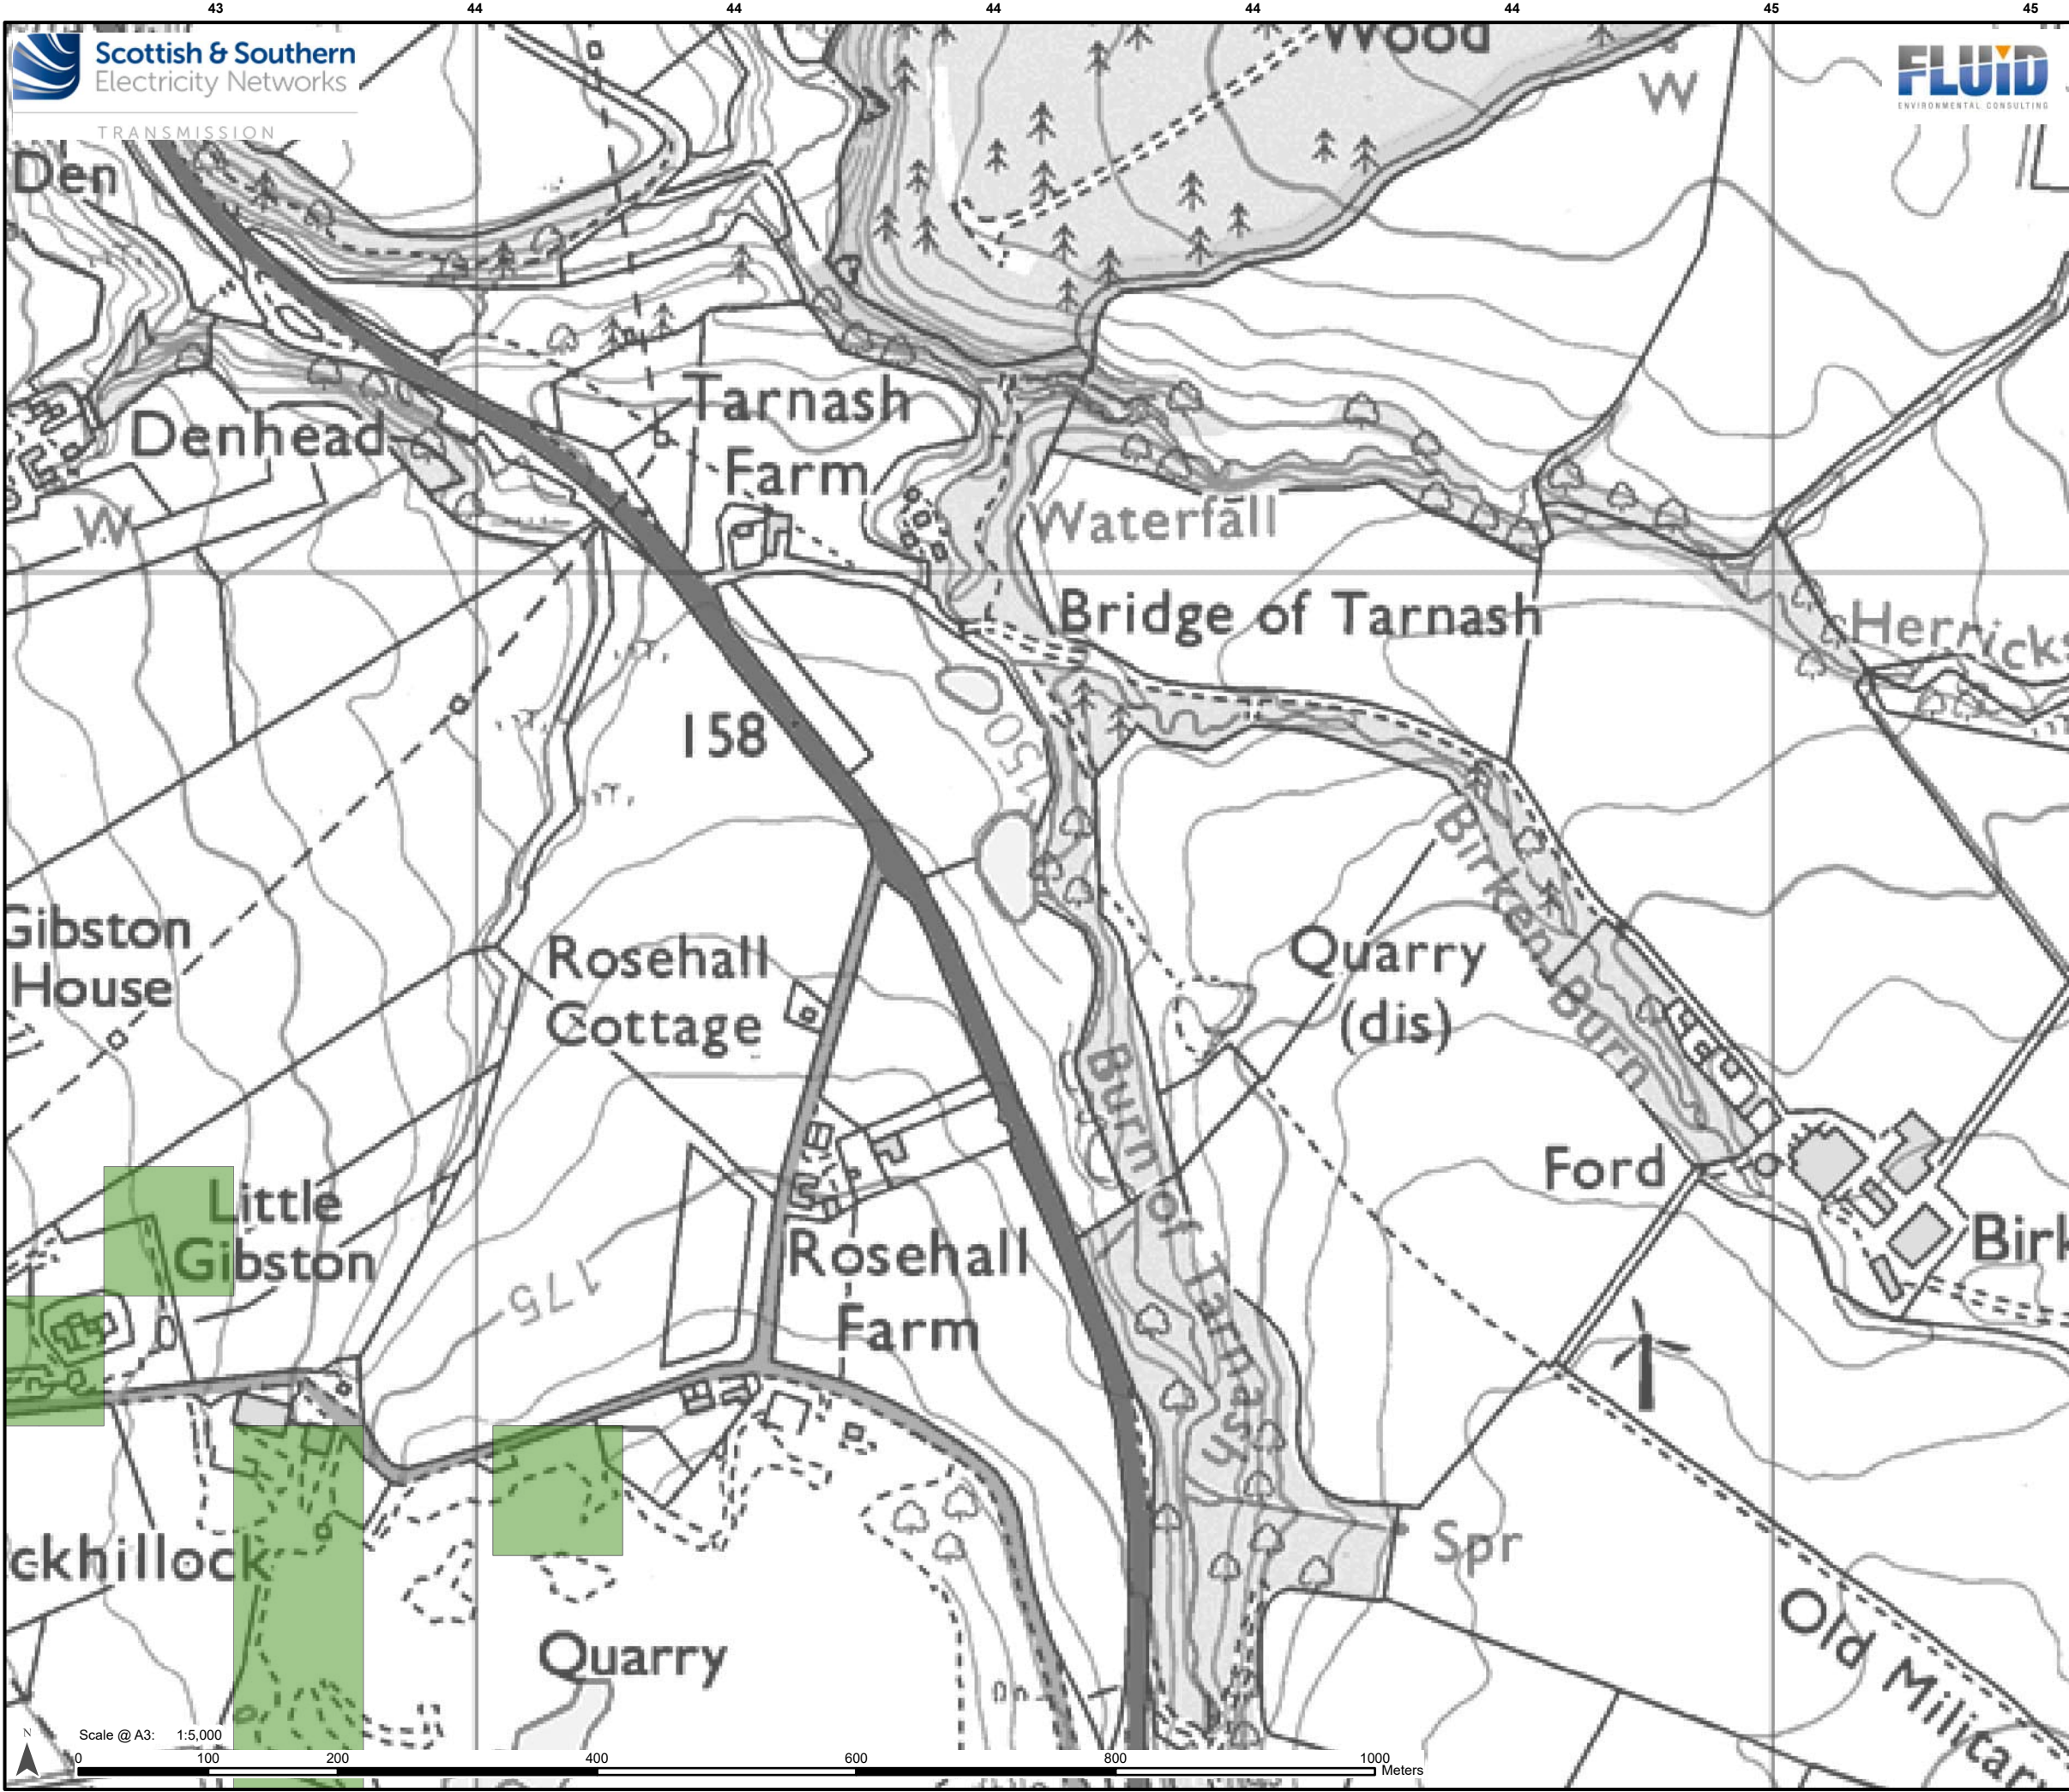

Legend

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 80 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074




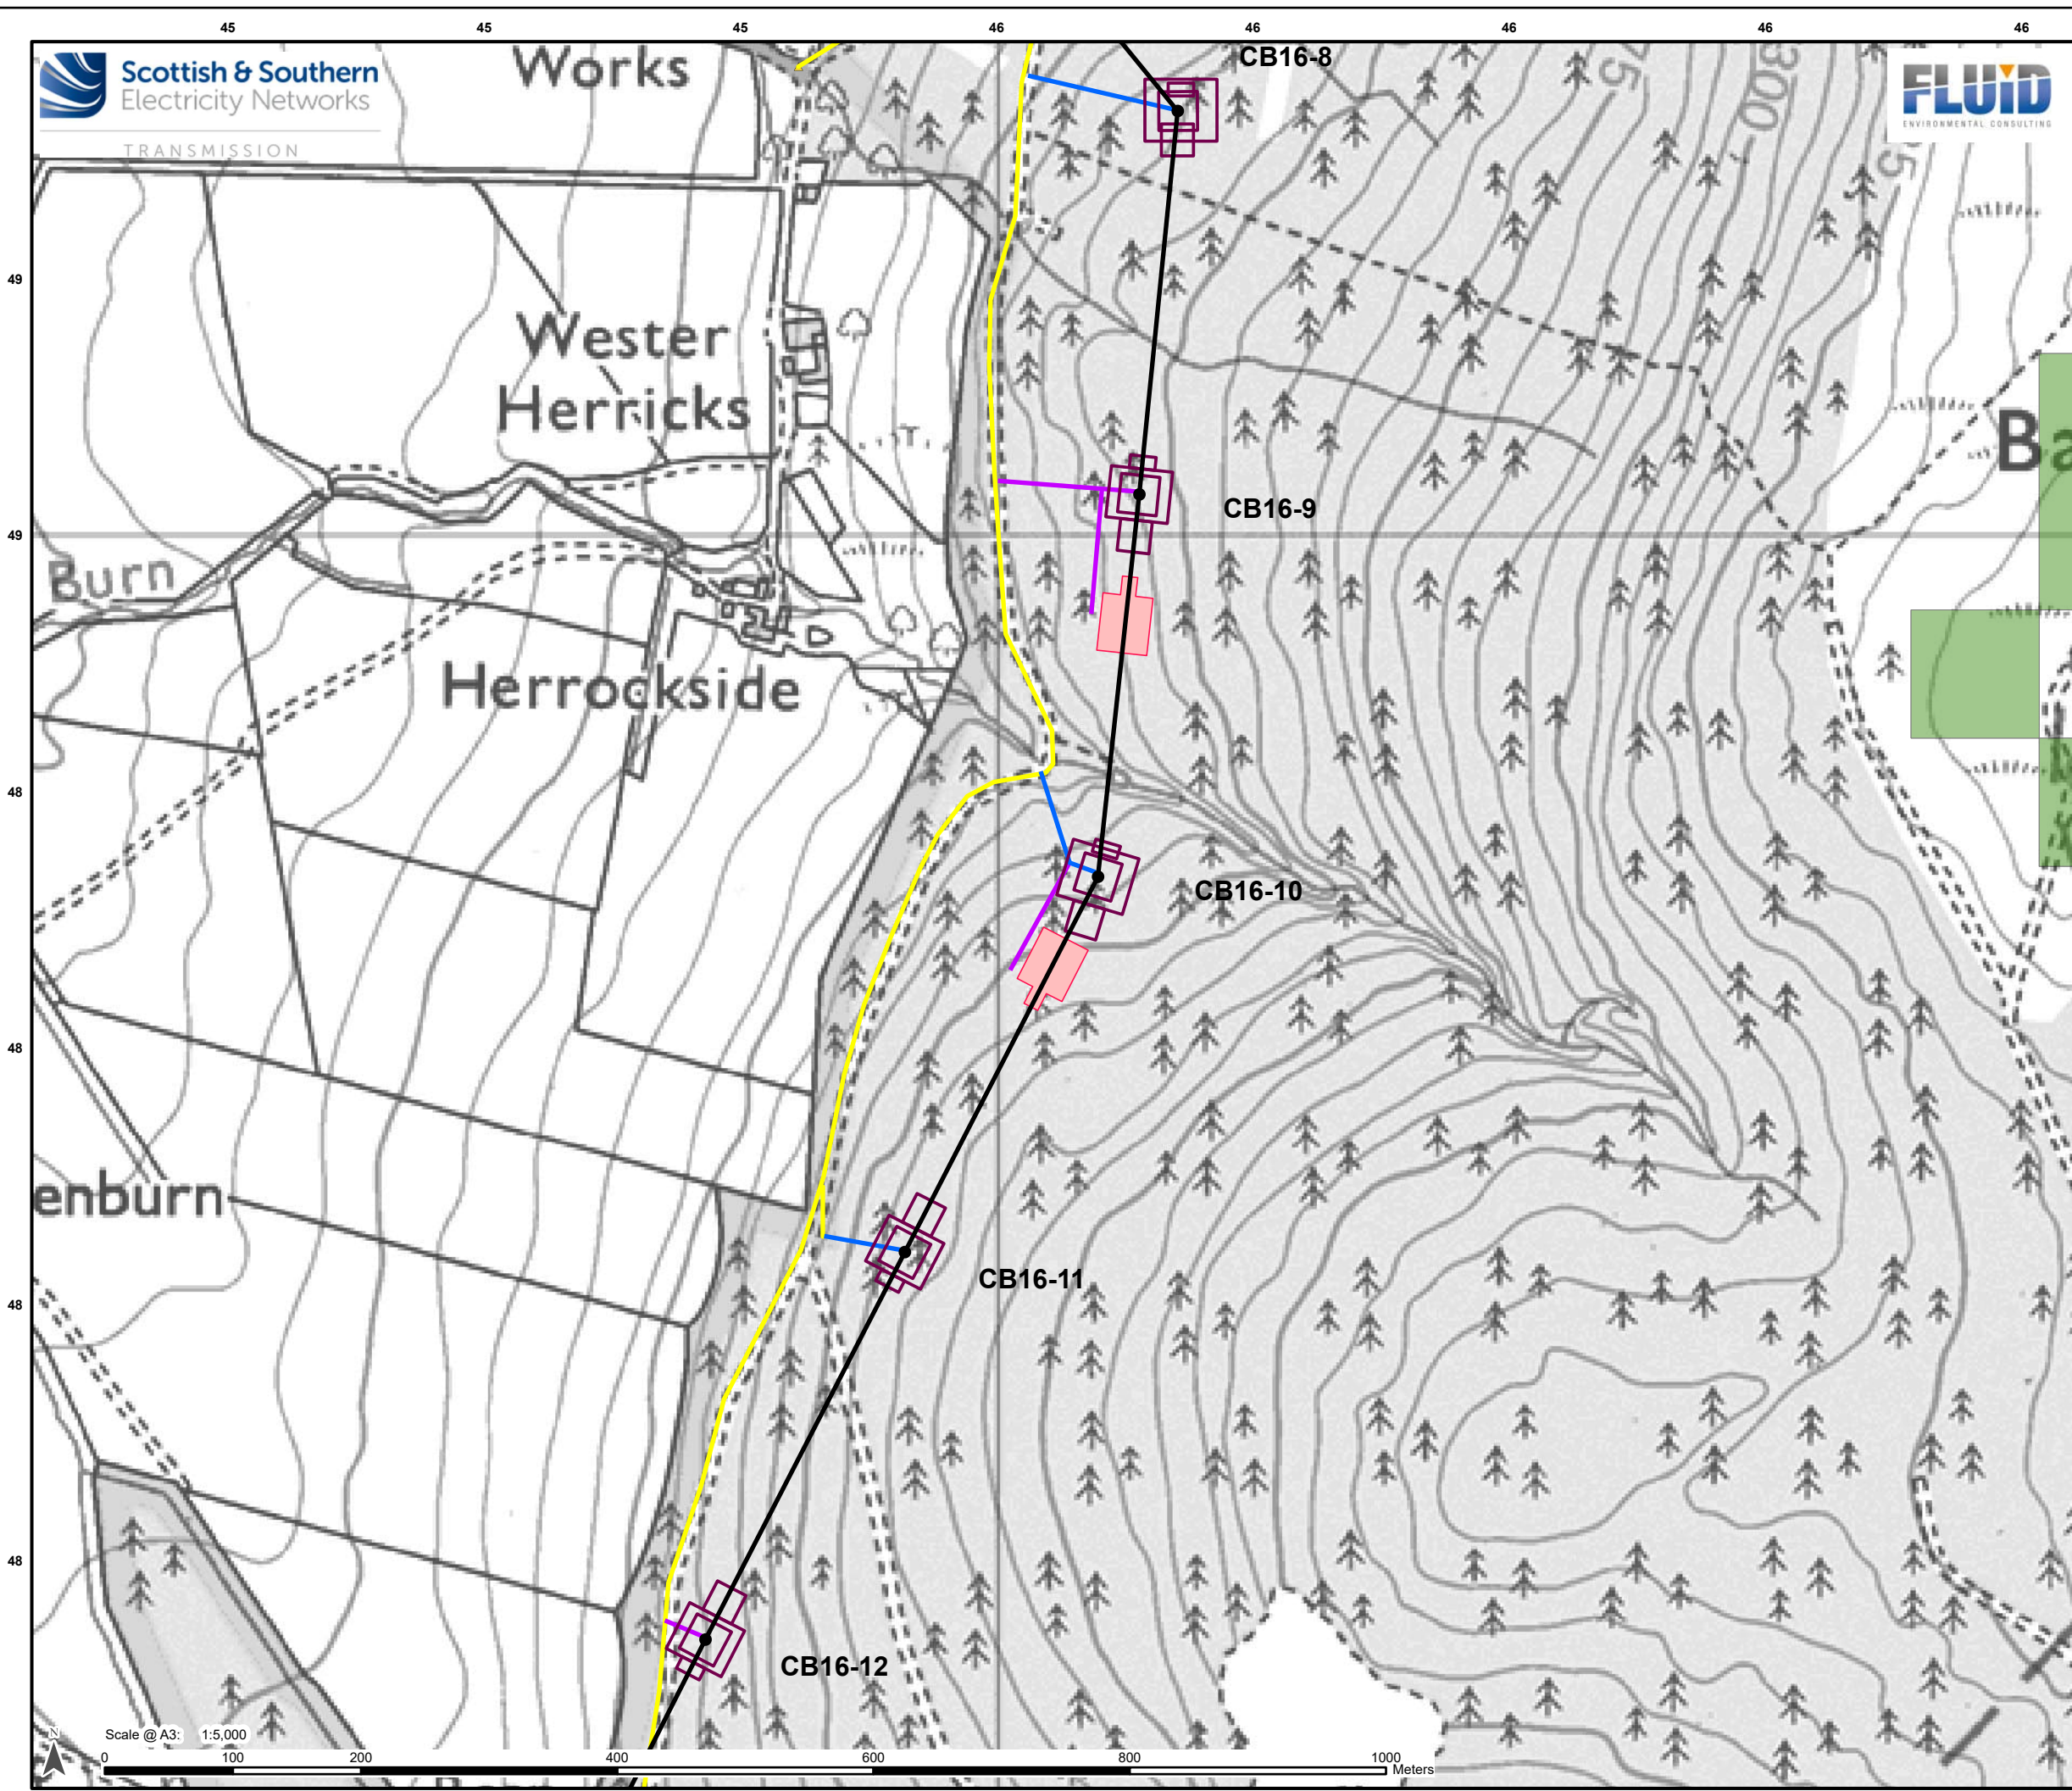

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 81 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

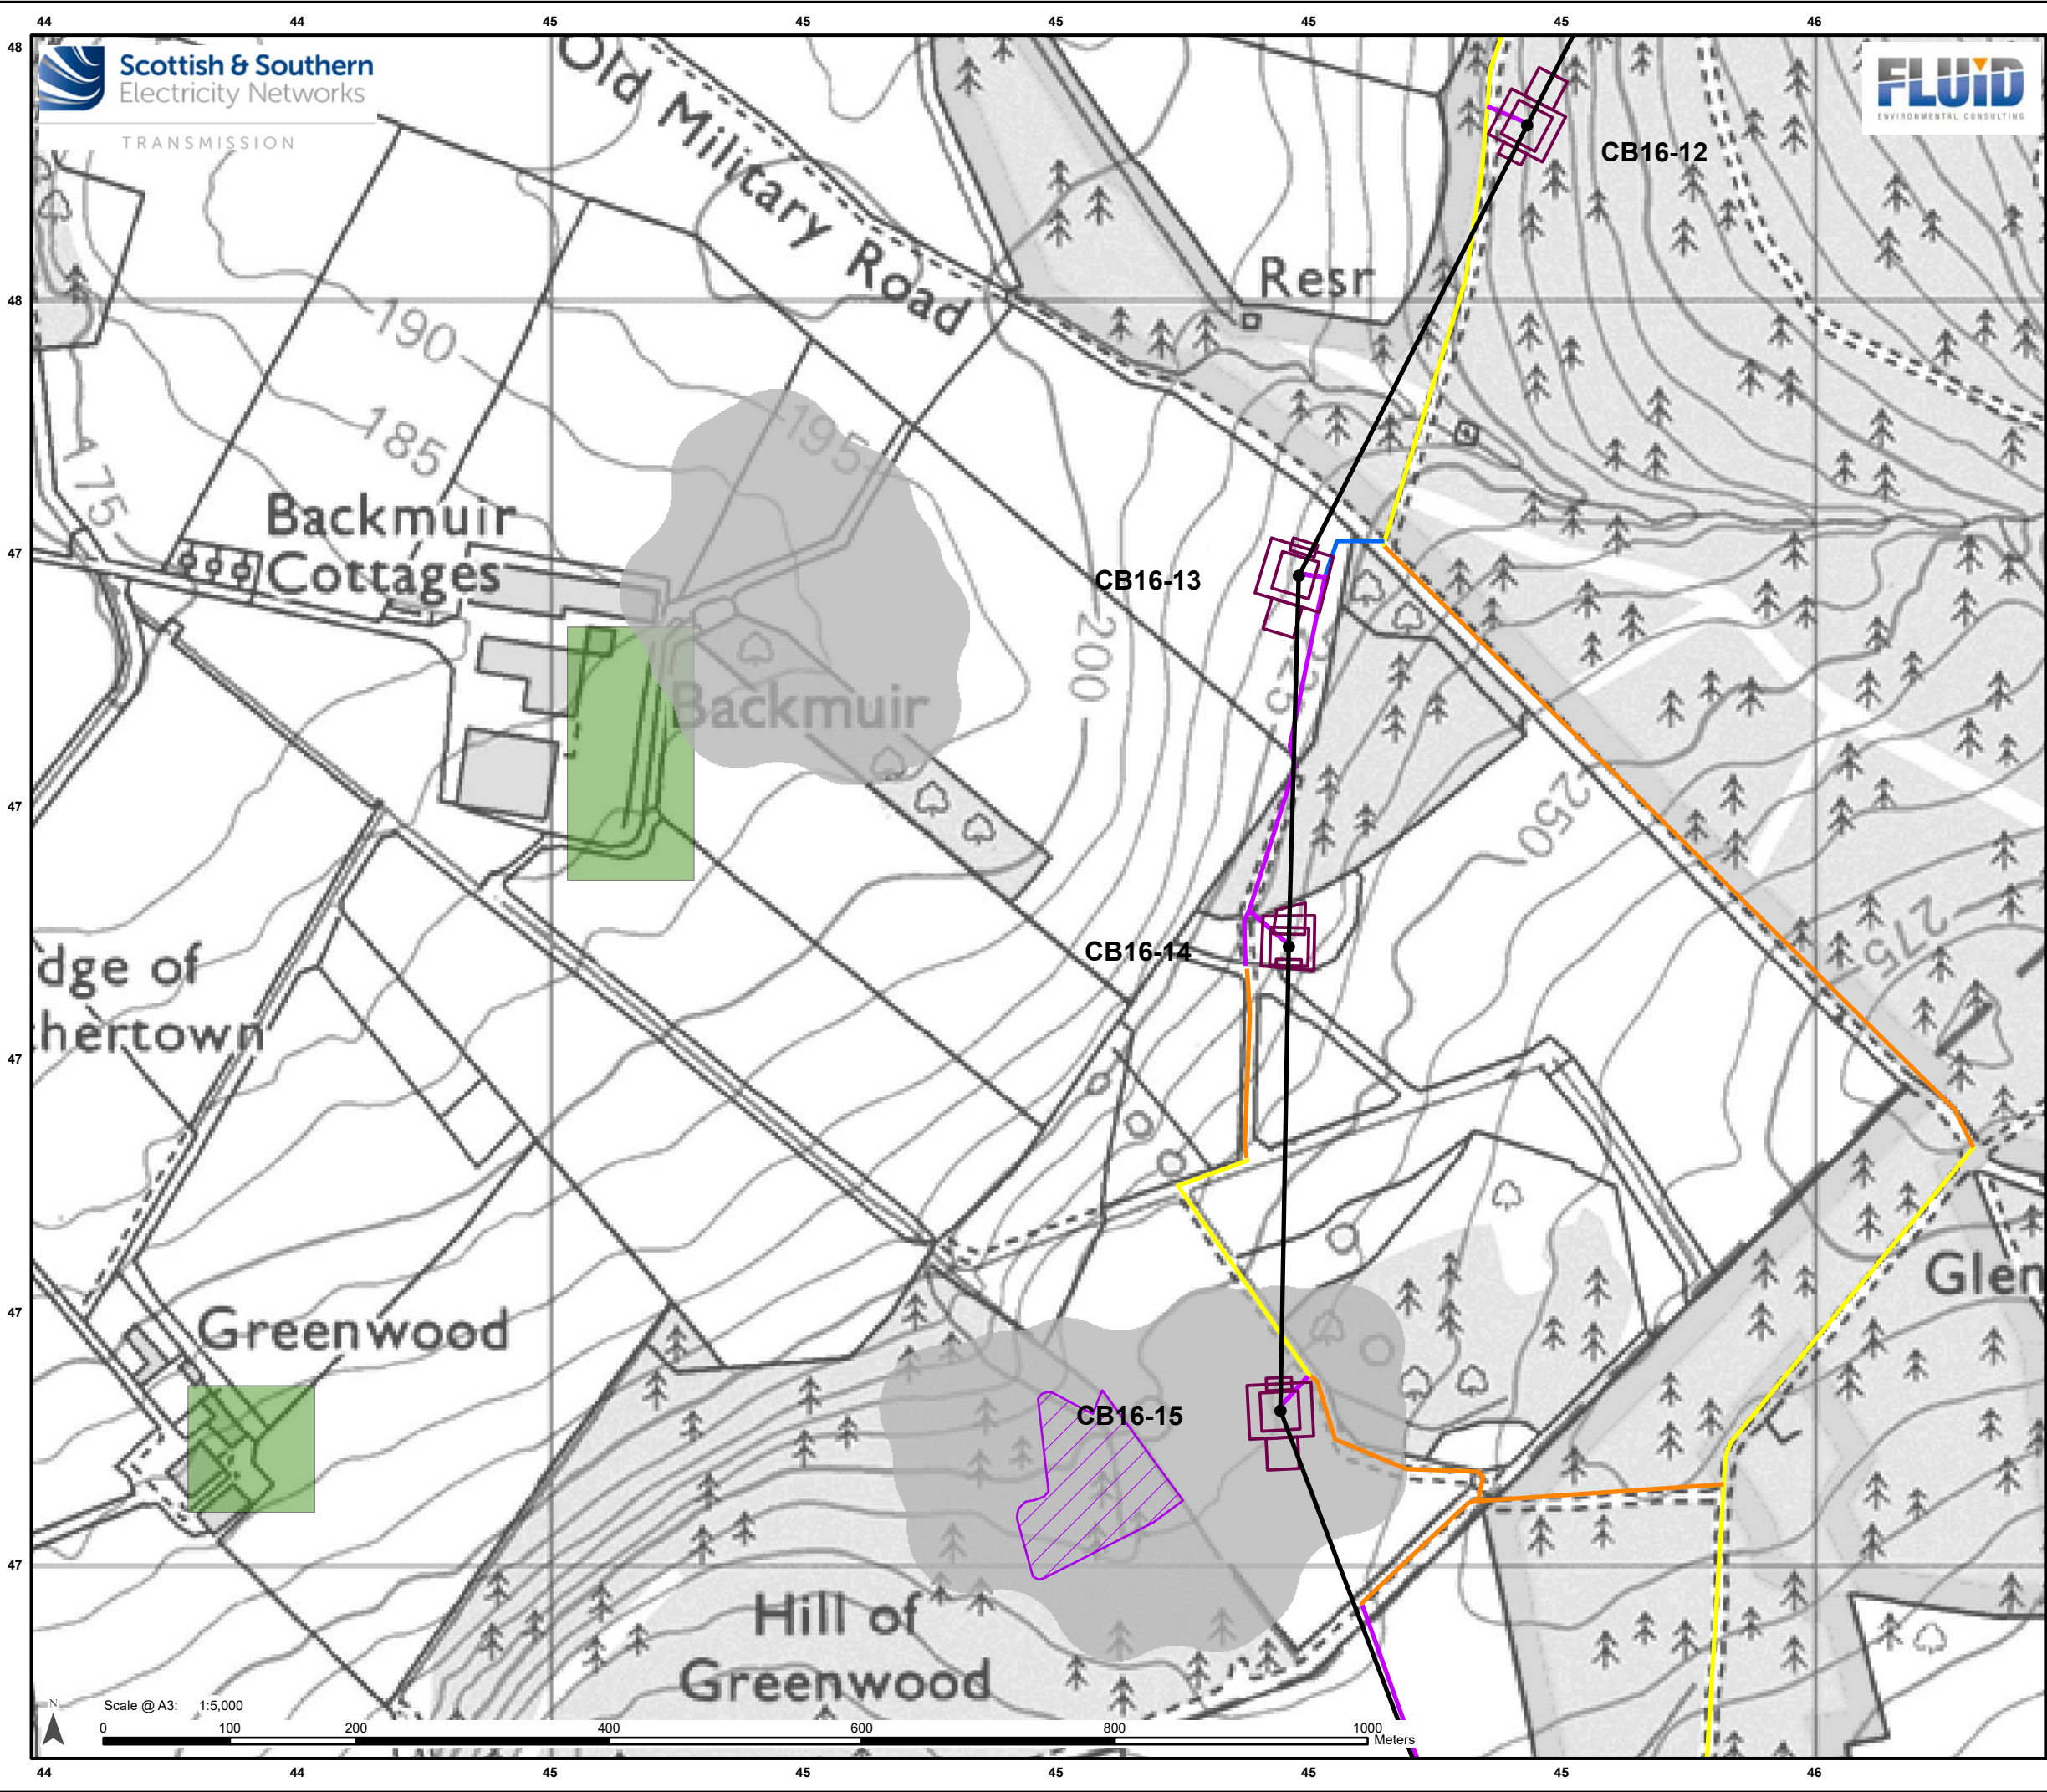

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-400kV (with tower number)

Working Areas *

Existing Access – Upgrade – Good/Fair Condition

Existing Access – Upgrade – Poor Condition

Proposed Access – Permanent

Proposed Access – Temporary

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m


> 2.0 - 3.0 m


> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

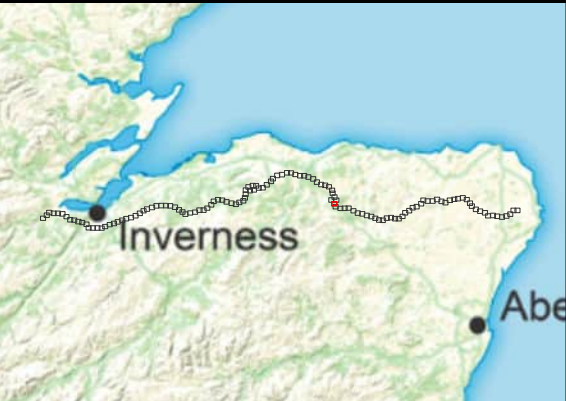


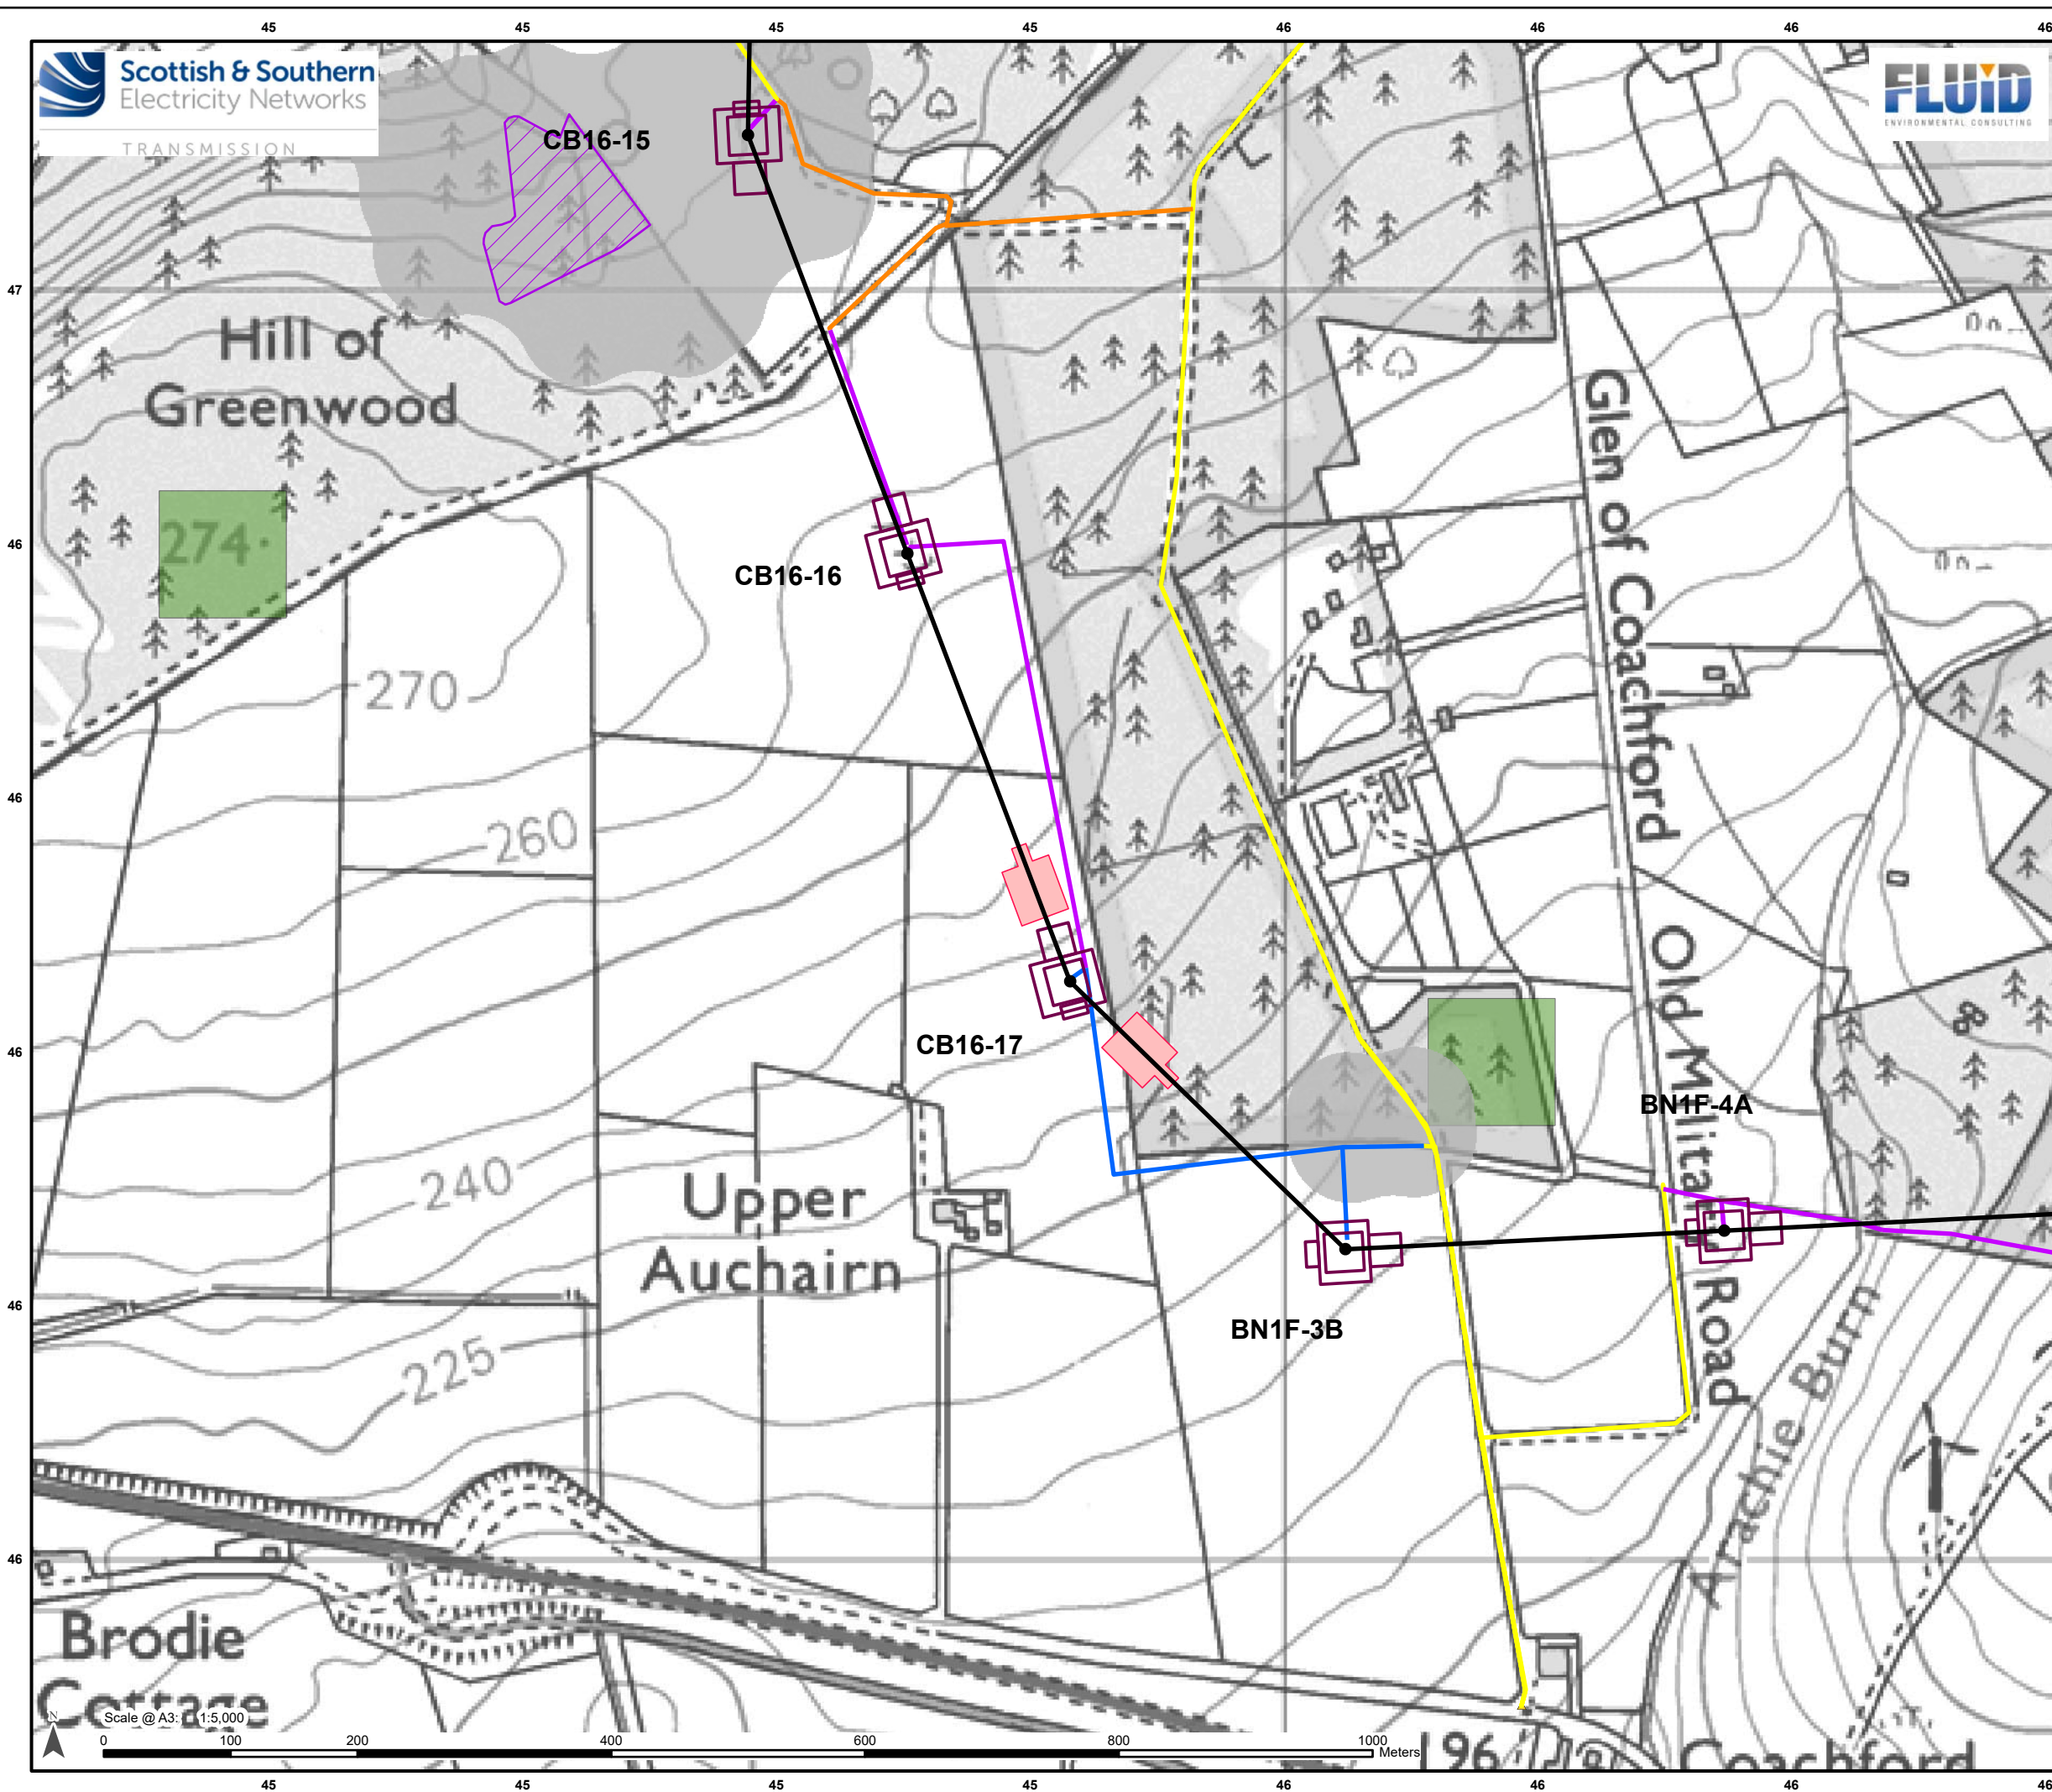

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 83 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

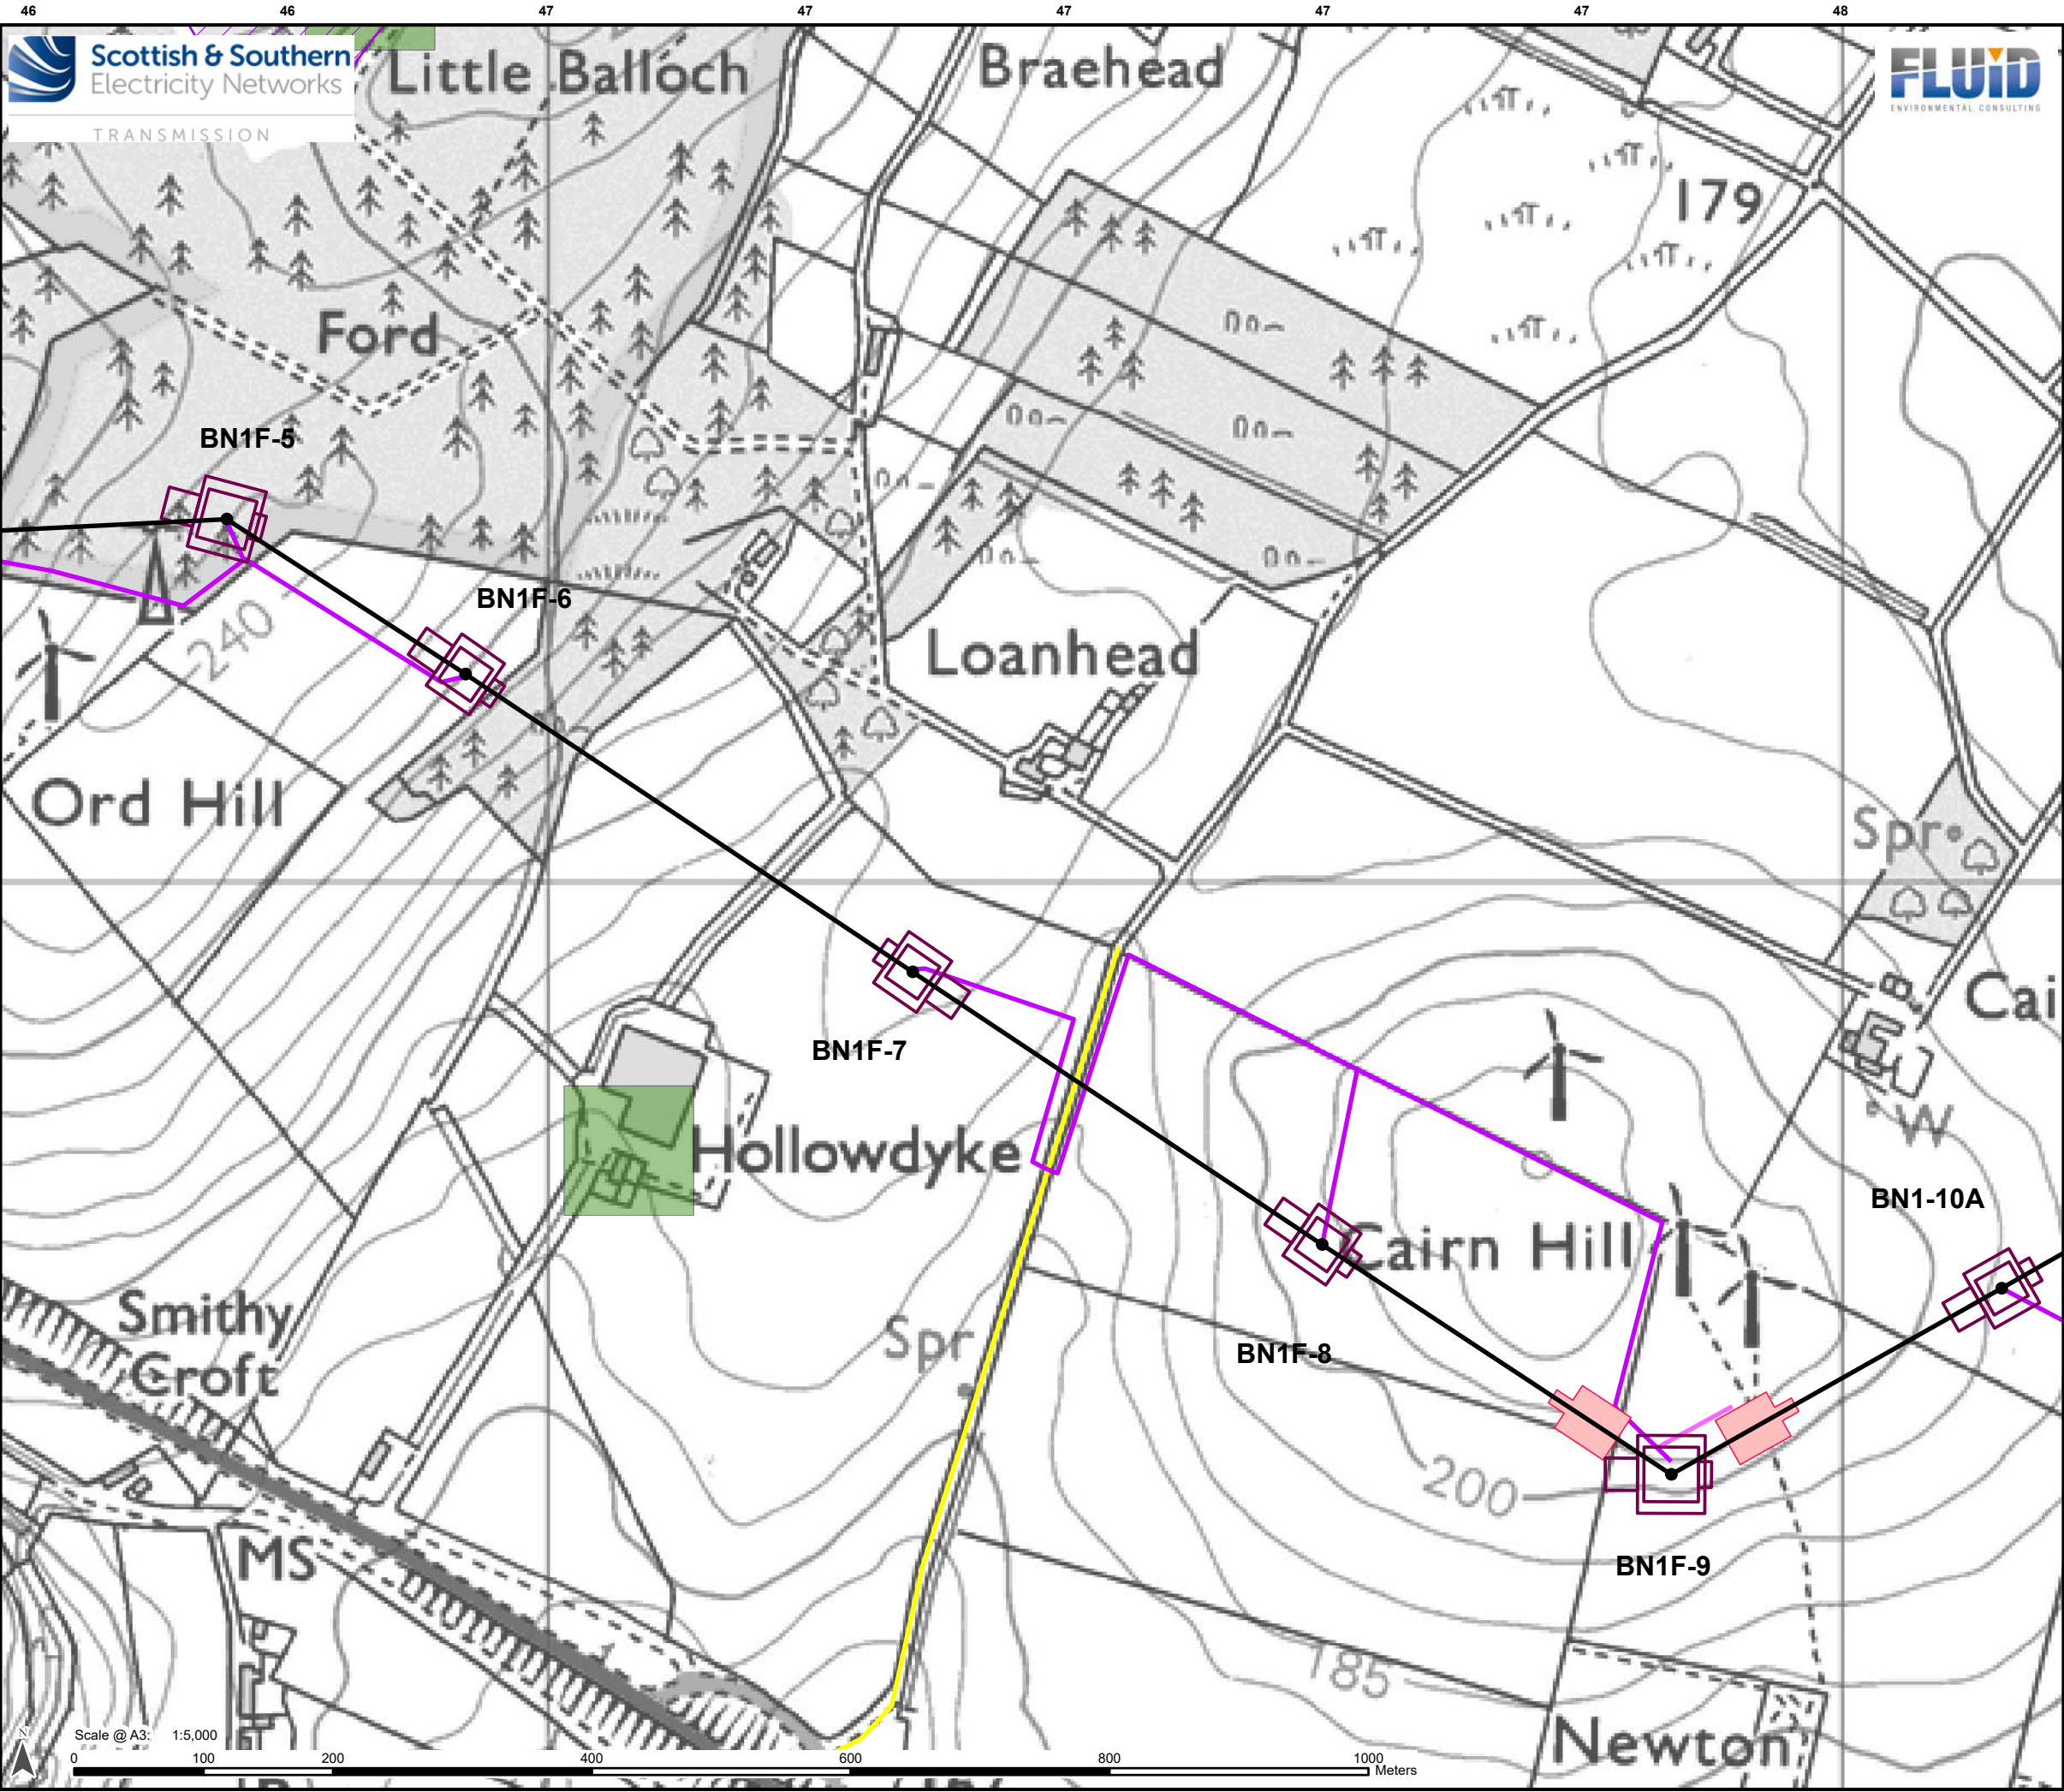



TRANSMISSION



Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- Proposed Bellmouth - Upgrade

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:

Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title:

Figure 10.1.2 - Estimated Peat Depth
Page 84 of 128

Drawn by:


JM

Date:

01/09/2025

Drawing:


B2P-WSP-DA-70092380-074

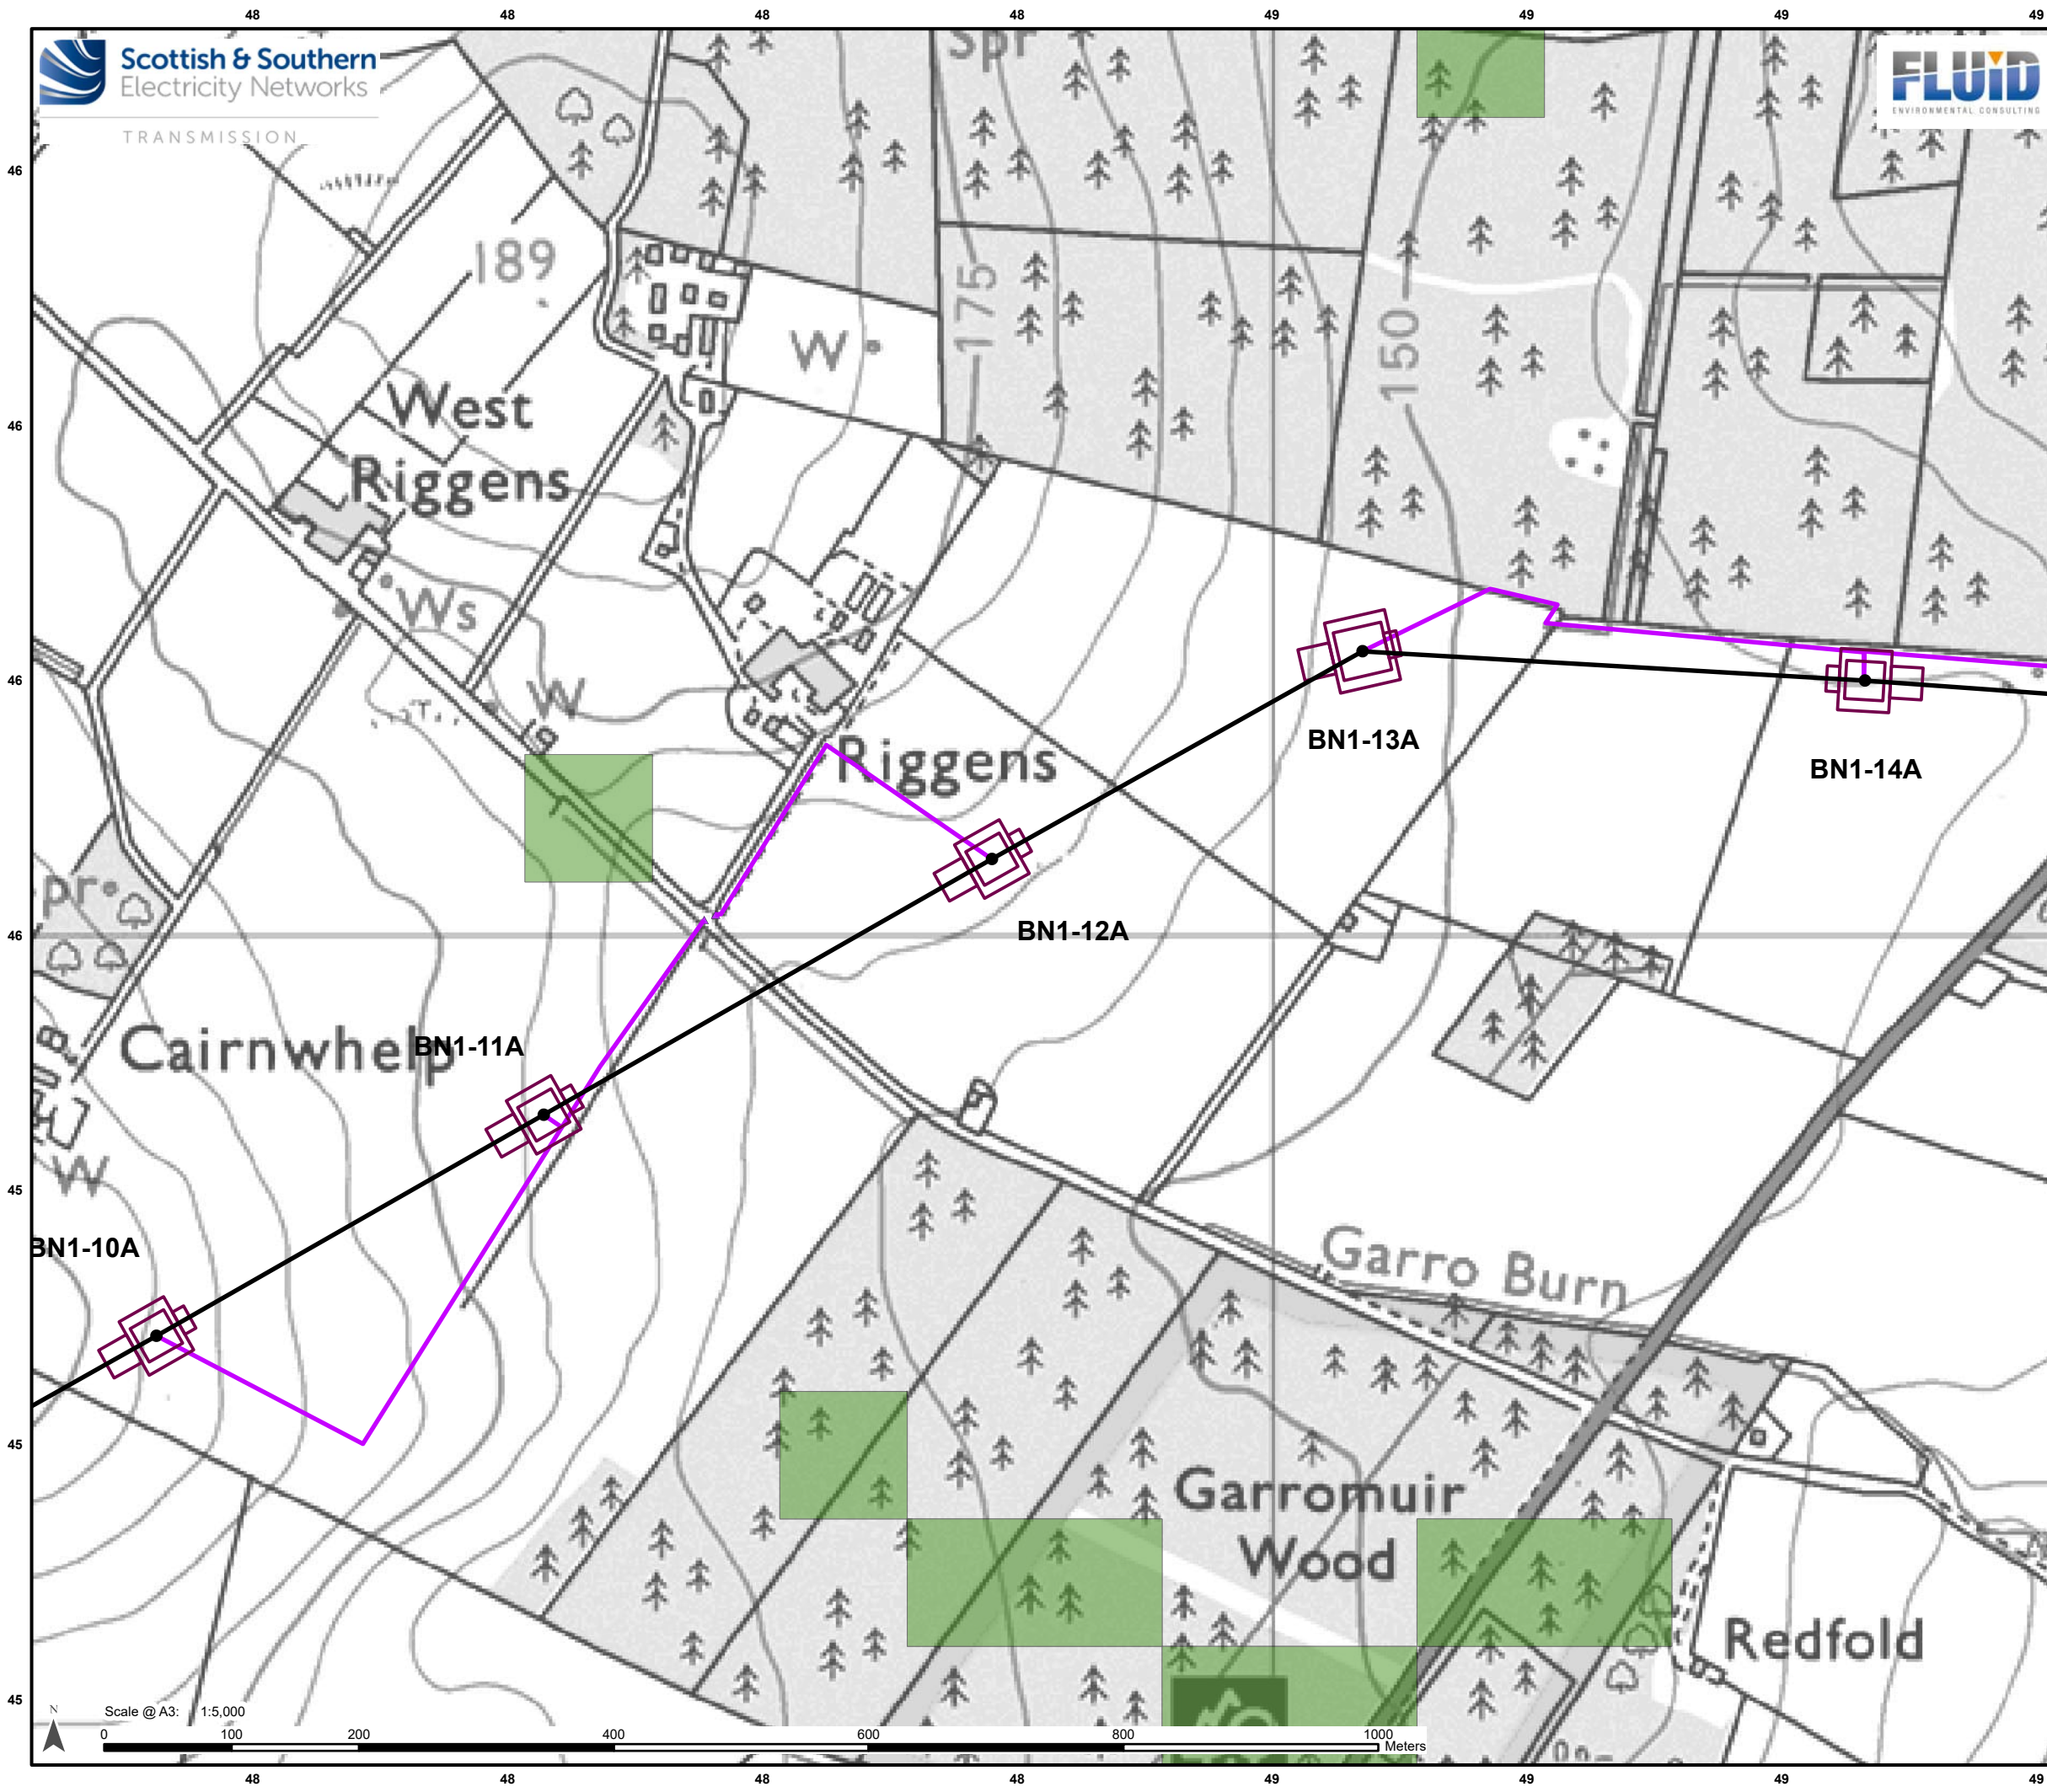

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title:
Figure 10.1.2 - Estimated Peat Depth
Page 85 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

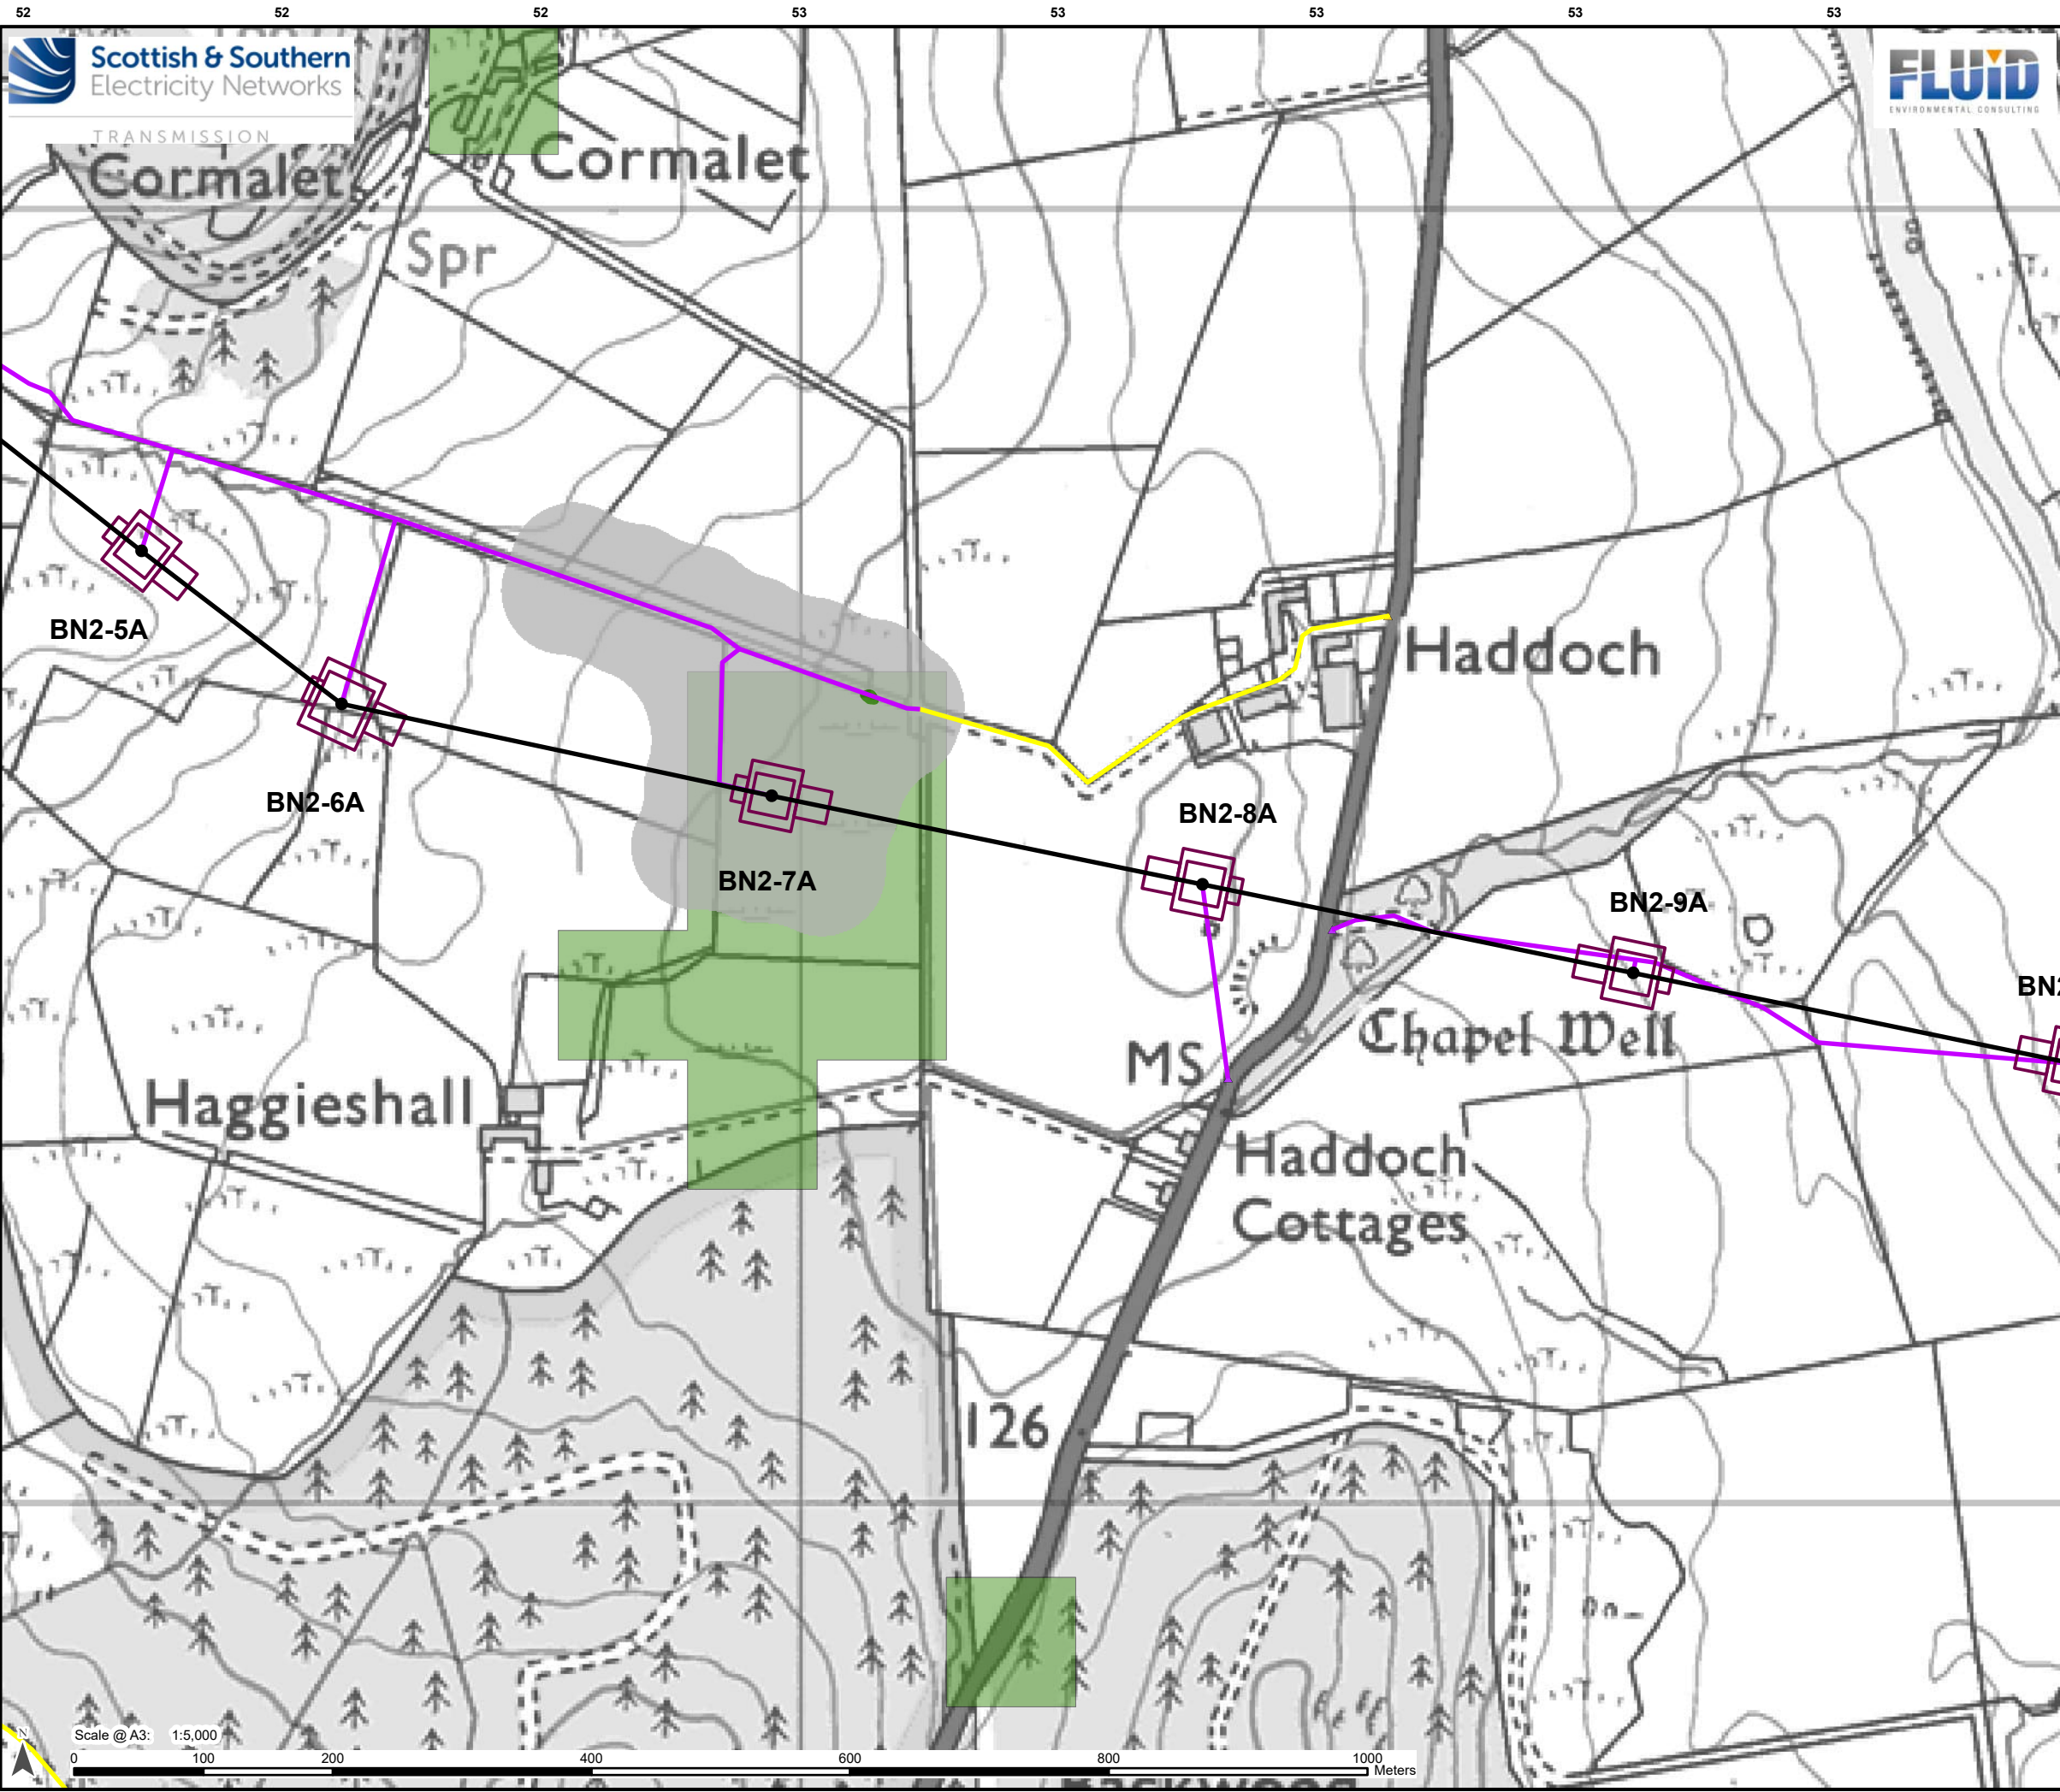

Legend

— Proposed OHL Alignment - 400kV

● Proposed Tower-400kV (with tower number)

□ Working Areas *

— Existing Access – Upgrade – Good/Fair Condition

— Proposed Access – Temporary

▲ Proposed Bellmouth - Temporary

▲ Proposed Bellmouth - Upgrade

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

□ Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 88 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074