



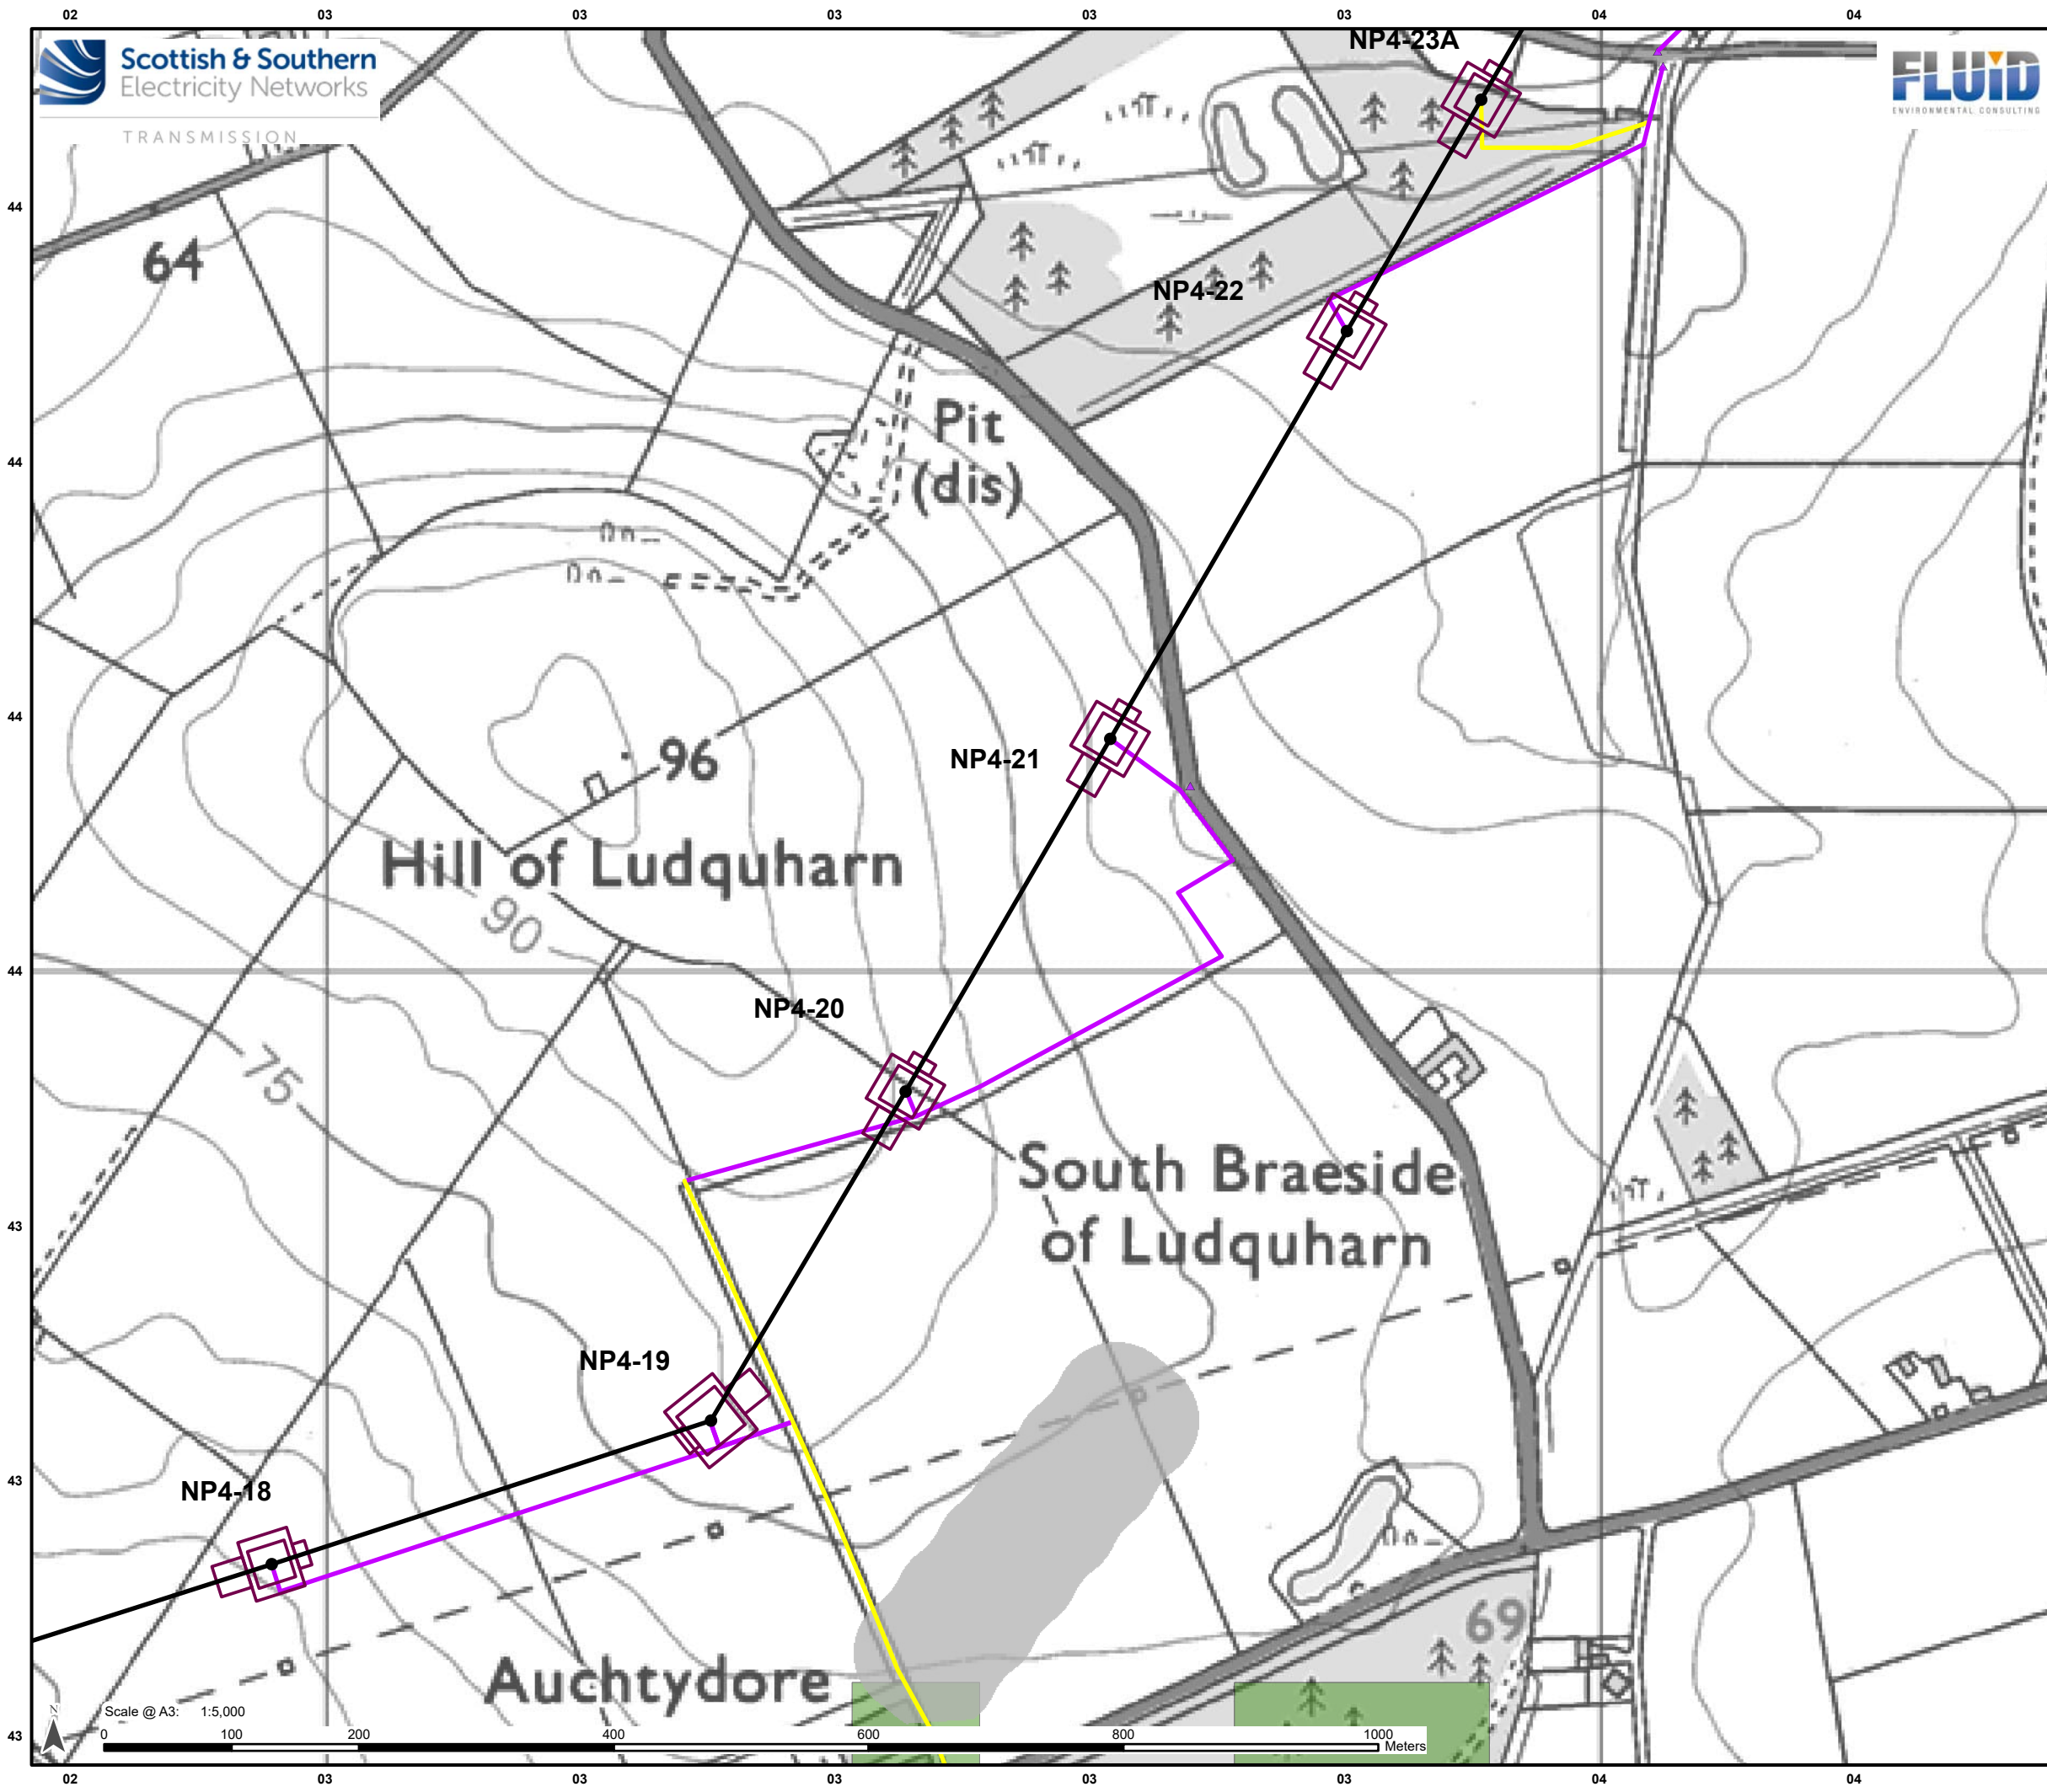

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 126 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

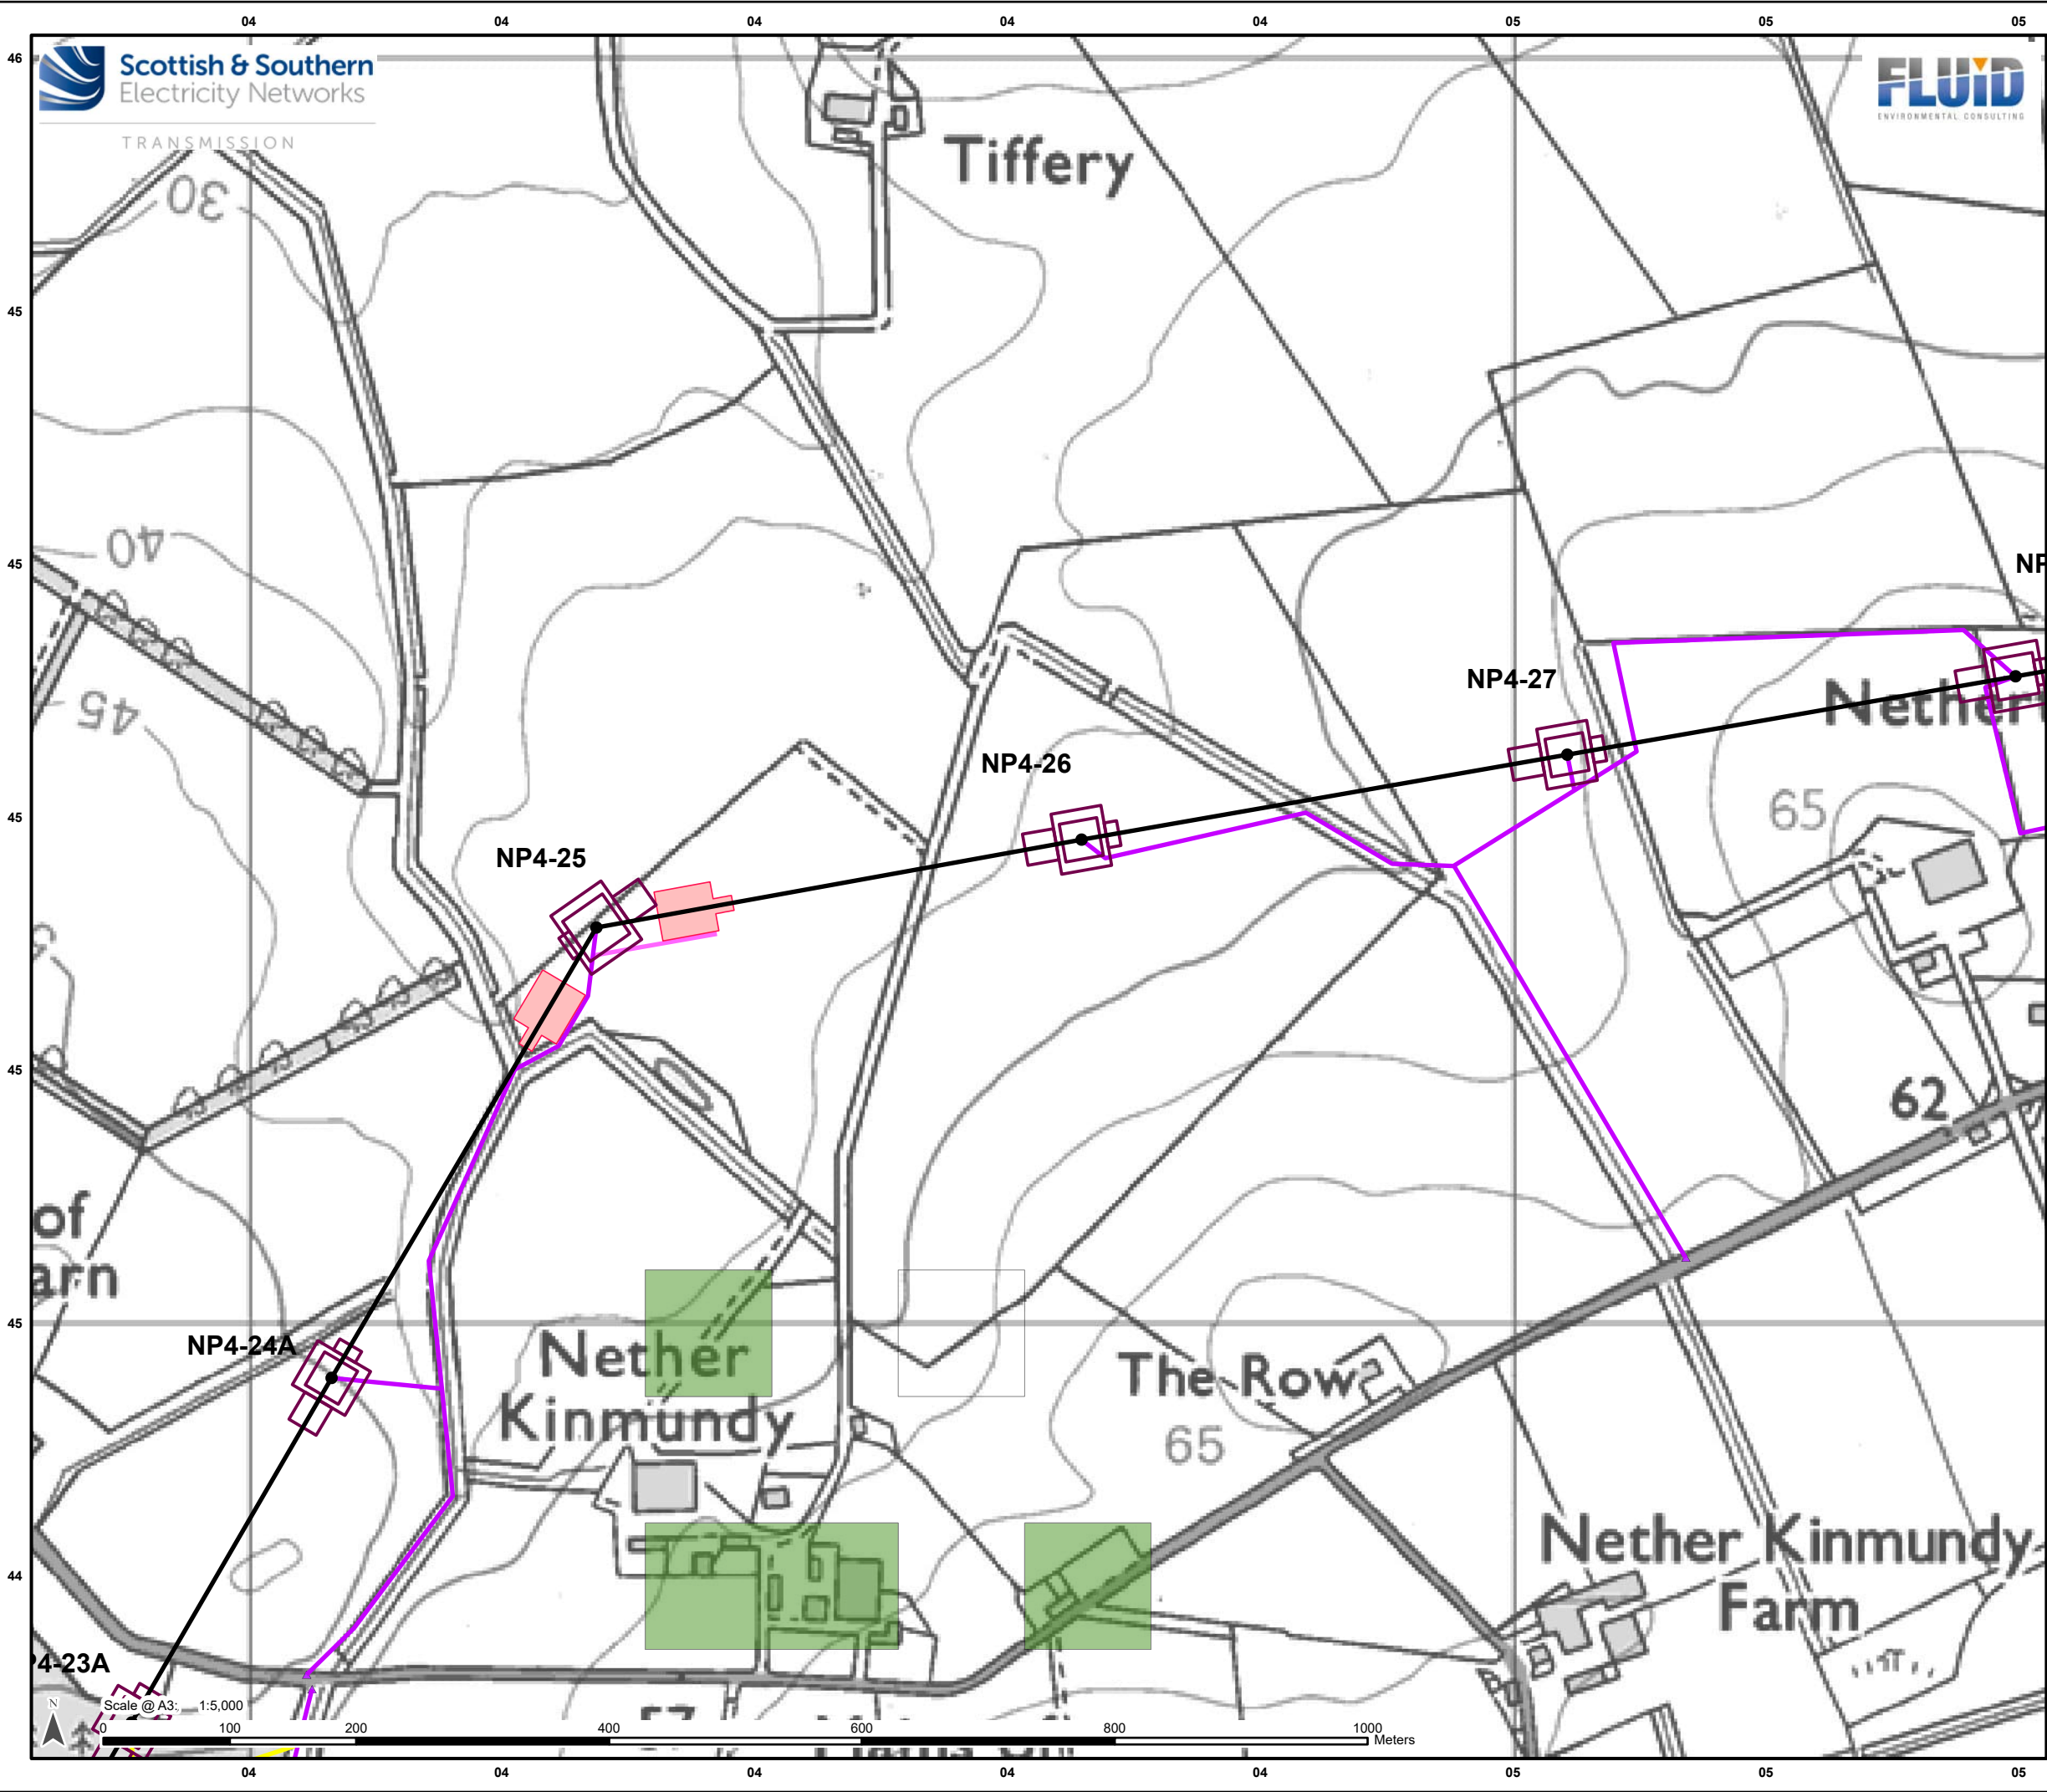

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary

JHI Peat Presence Score

0 1 2 3 4 5

Priority Peatland Habitats

Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 127 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

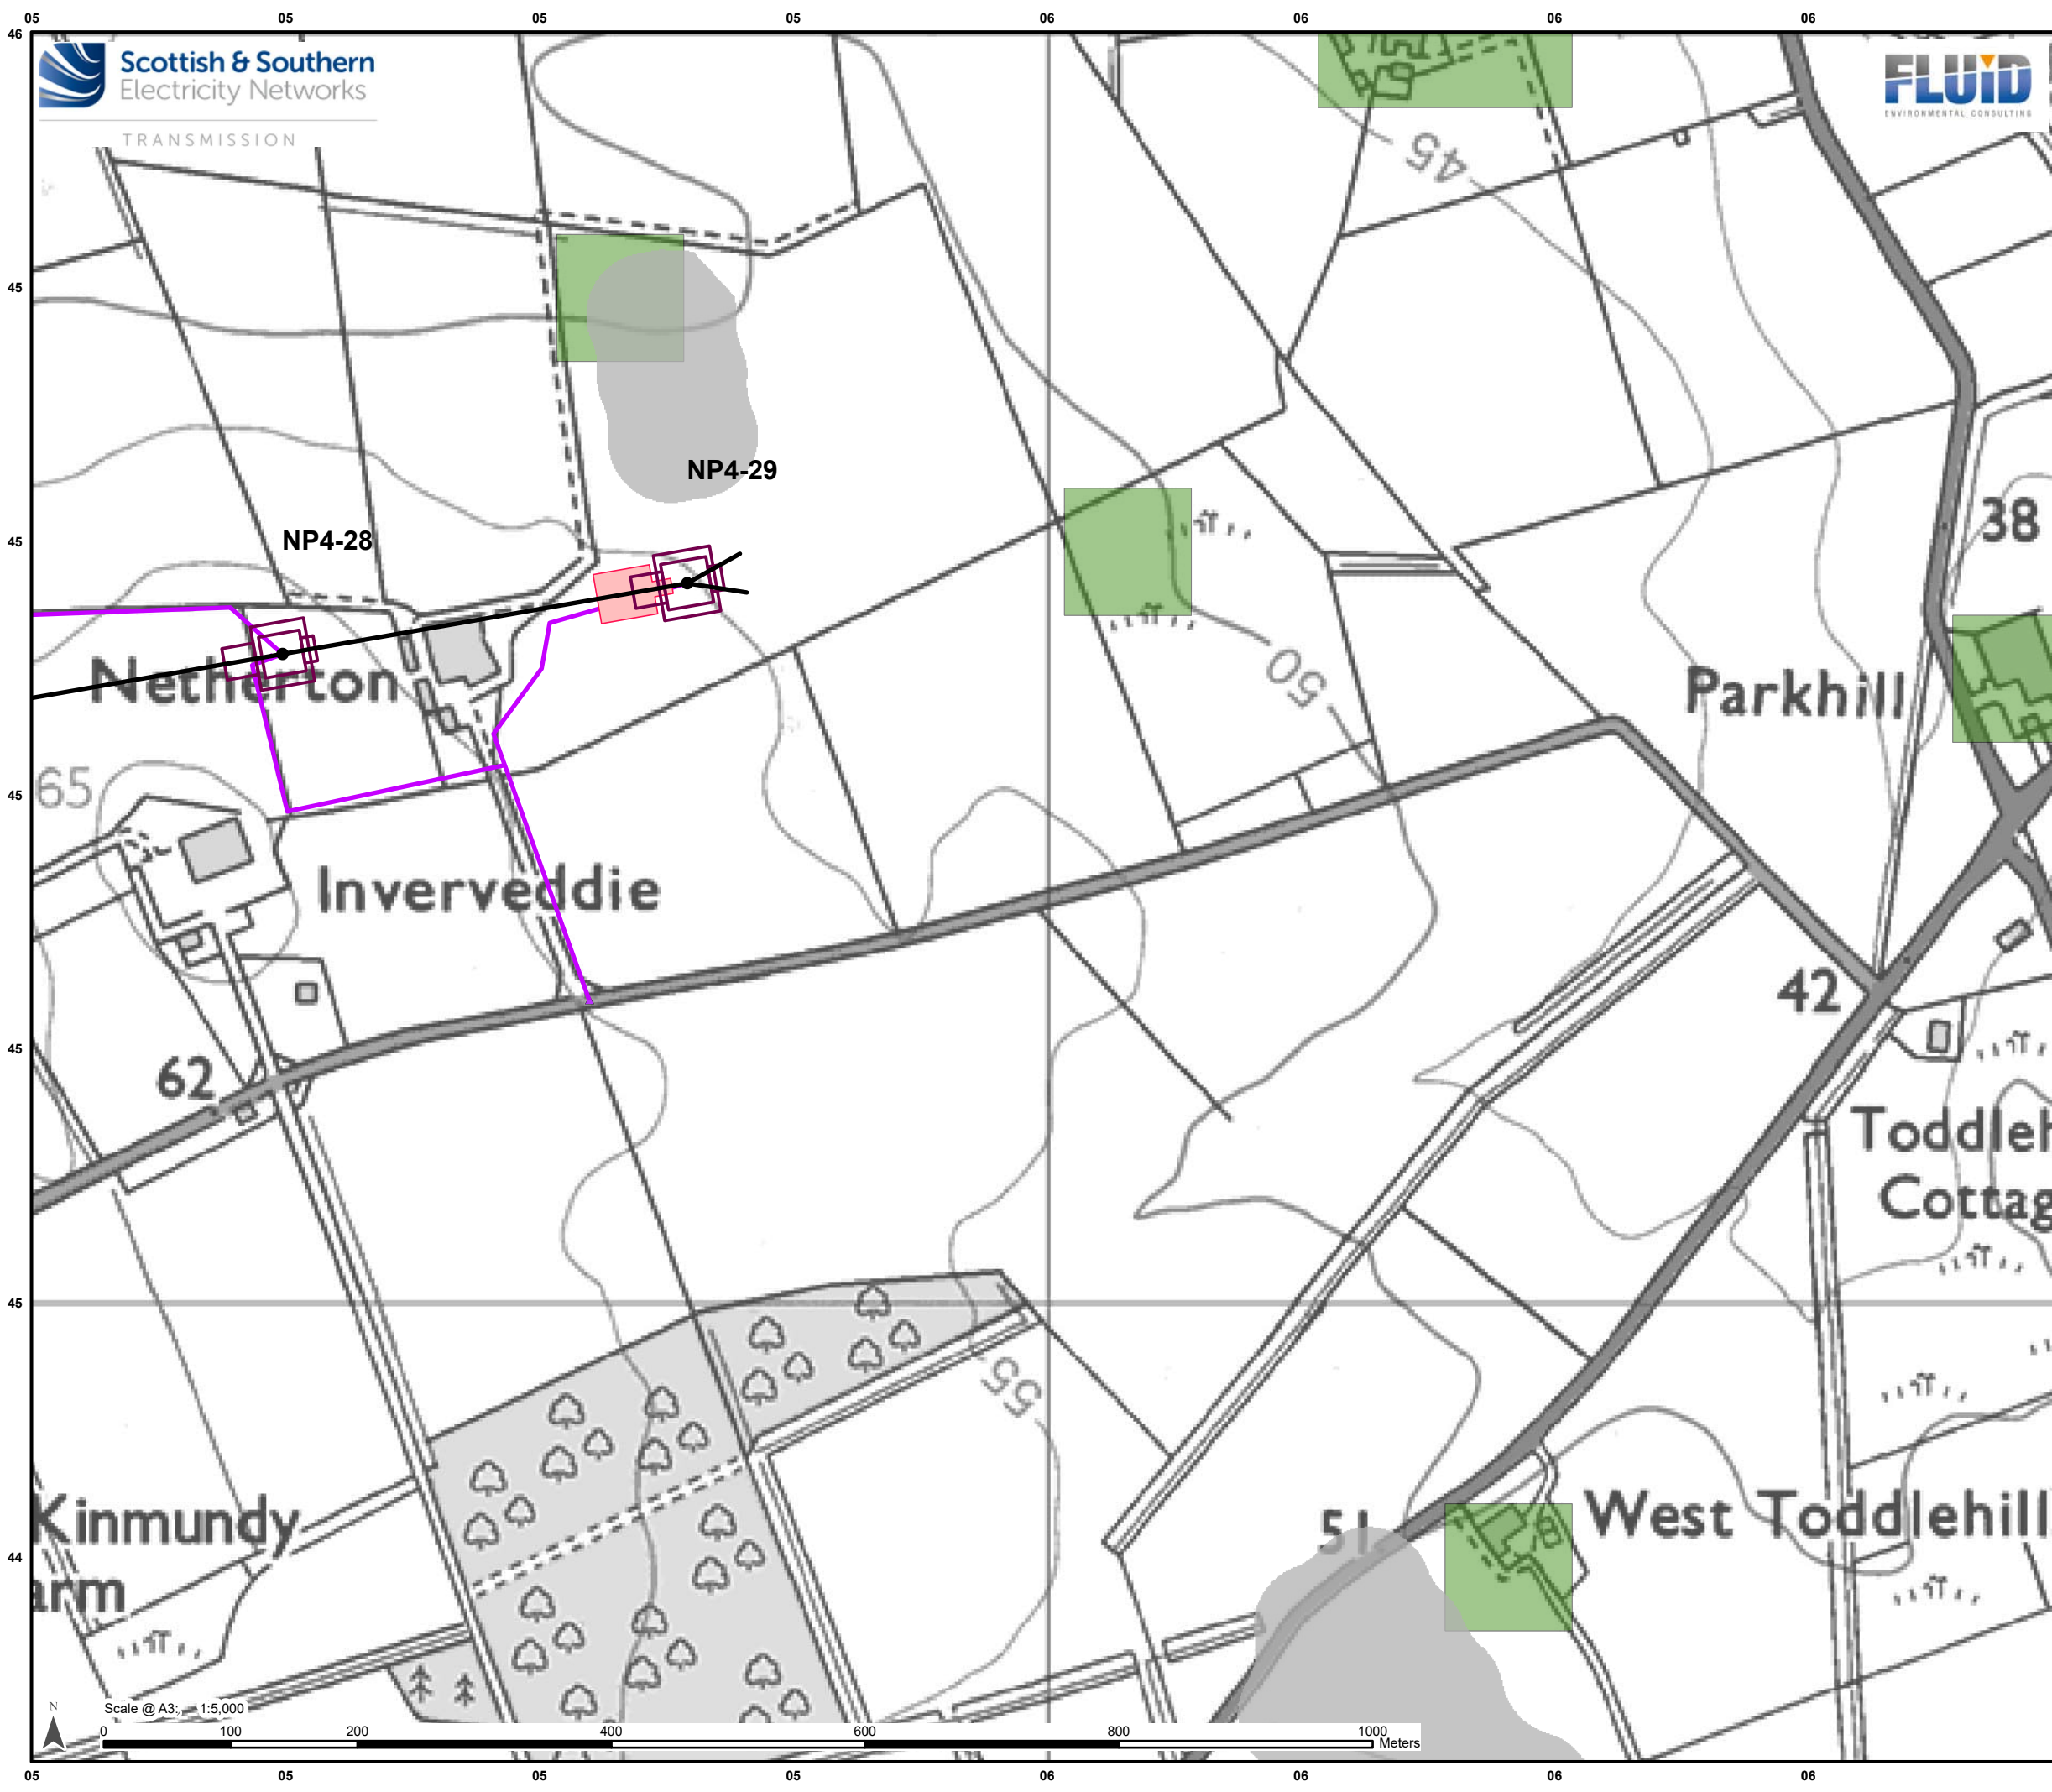

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats

- Priority Peatland Habitats

Estimated Peat Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.2 - Estimated Peat Depth
Page 128 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074