


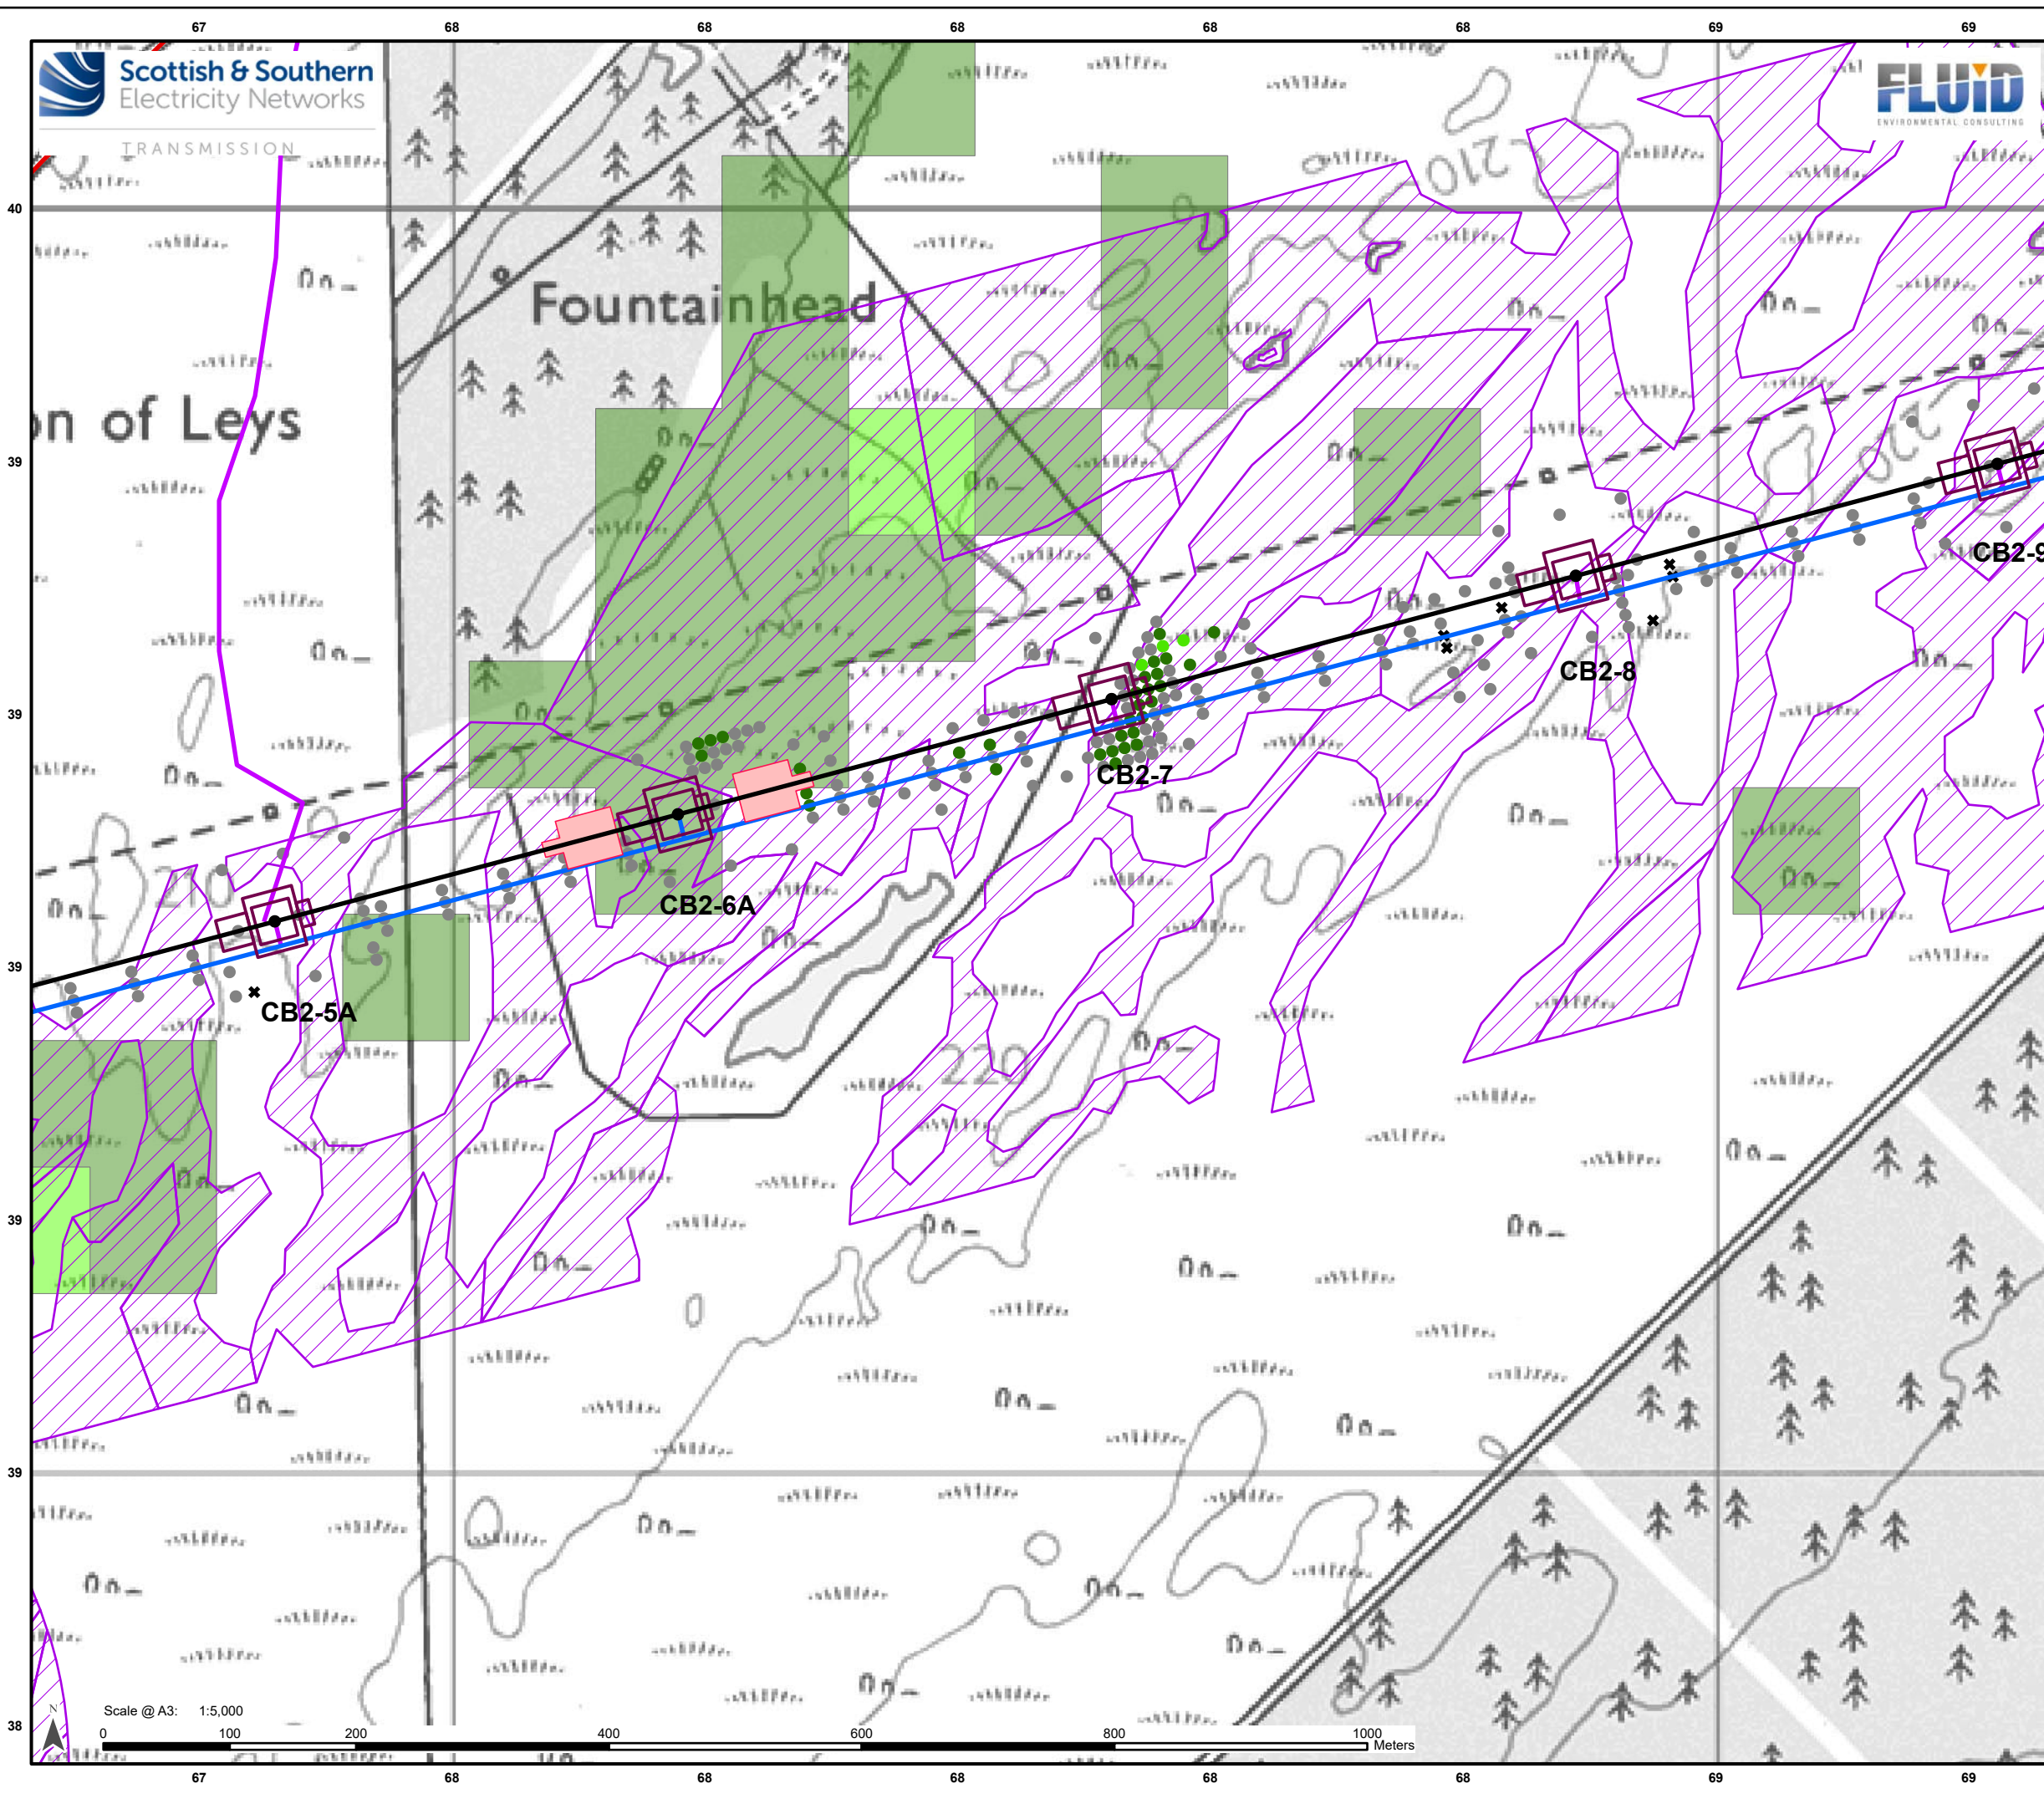

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – Permanent
- Proposed Access – Temporary

JHI Peat Presence Score

0	1	2	3	4	5

* Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration Depth

0 - 0.5 m
> 0.5 - 1.0 m
> 1.0 - 1.5 m
> 1.5 - 2.0 m
> 2.0 - 3.0 m
> 3.0 - 4.0 m
> 4.0 - 5.0 m
> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 16 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

TRANSMISSION

Scale @ A3: 1:5,000
0 100 200 400 600 800 1000 Meters

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Access – Permanent
- Proposed Access – Temporary
- JHI Peat Presence Score**
 - 0
 - 1
 - 2
 - 3
 - 4
 - 5

* Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 17 of 128


Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary

JHI Peat Presence Score



- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration

Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project


Title: Figure 10.1.1 - Peat Depth of Penetration
Page 18 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

Scale @ A3: 1:5,000


0 100 200 400 600 800 1000 Meters

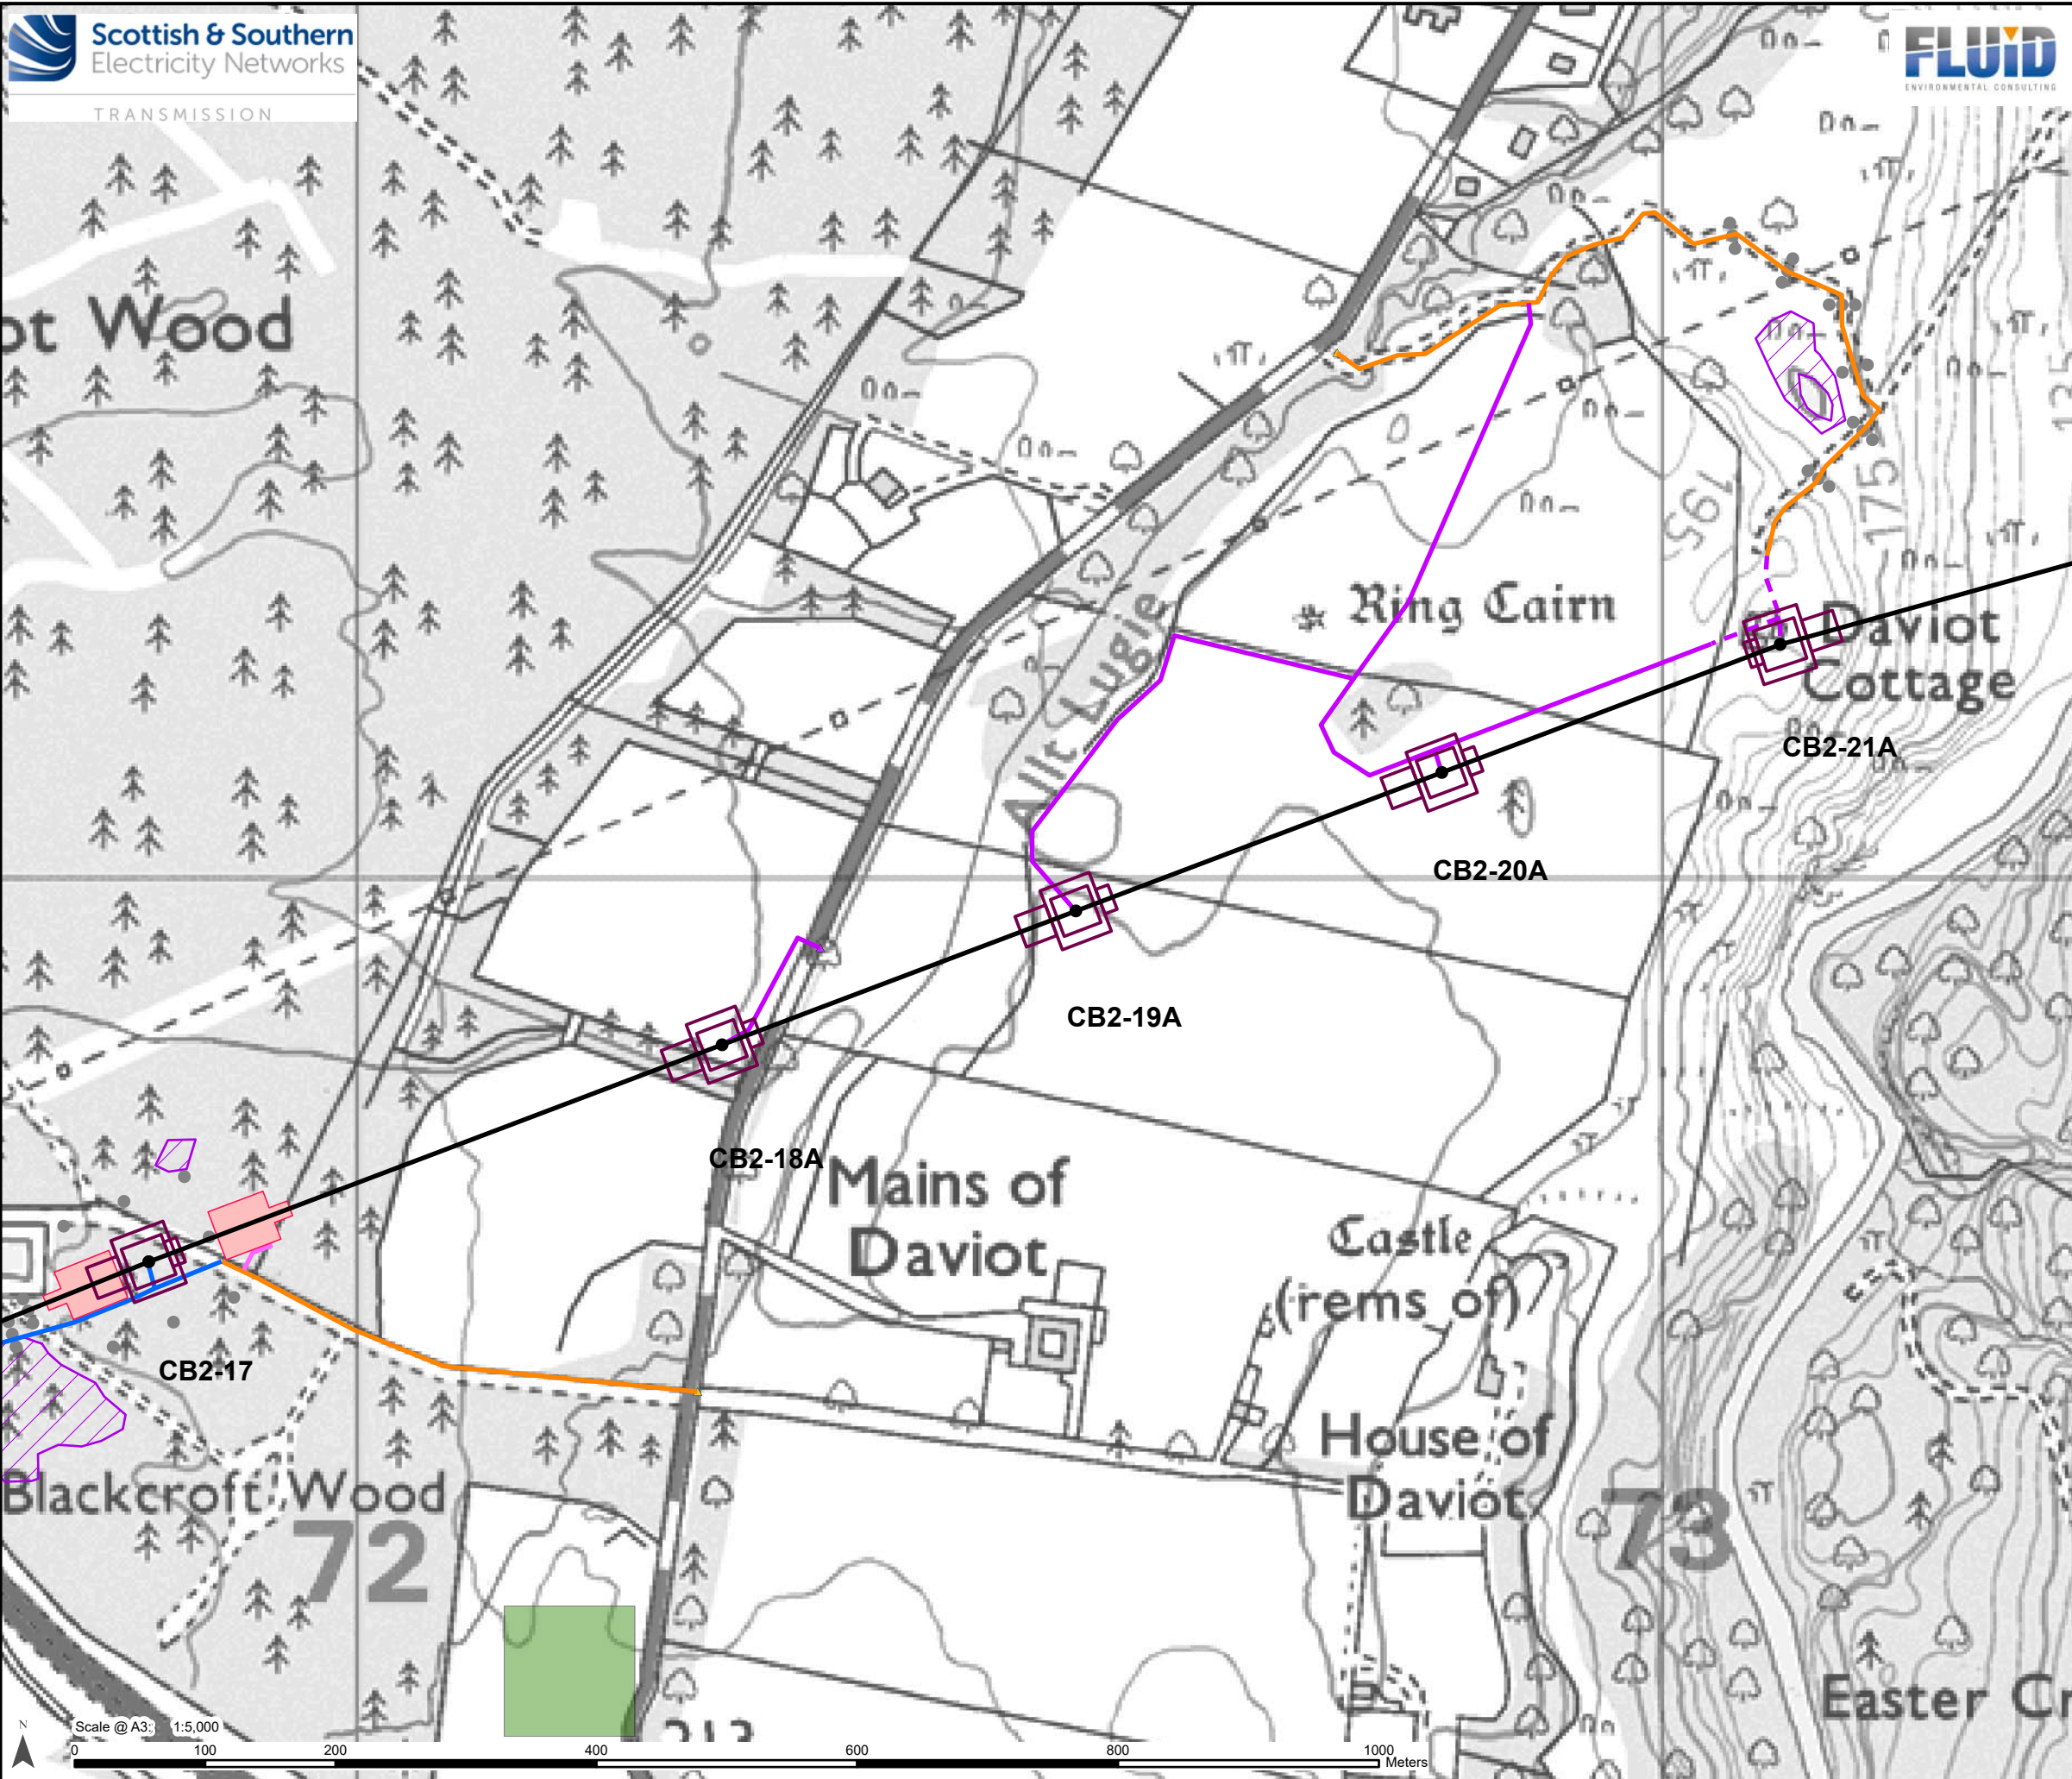

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score



- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration

Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement




Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 19 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

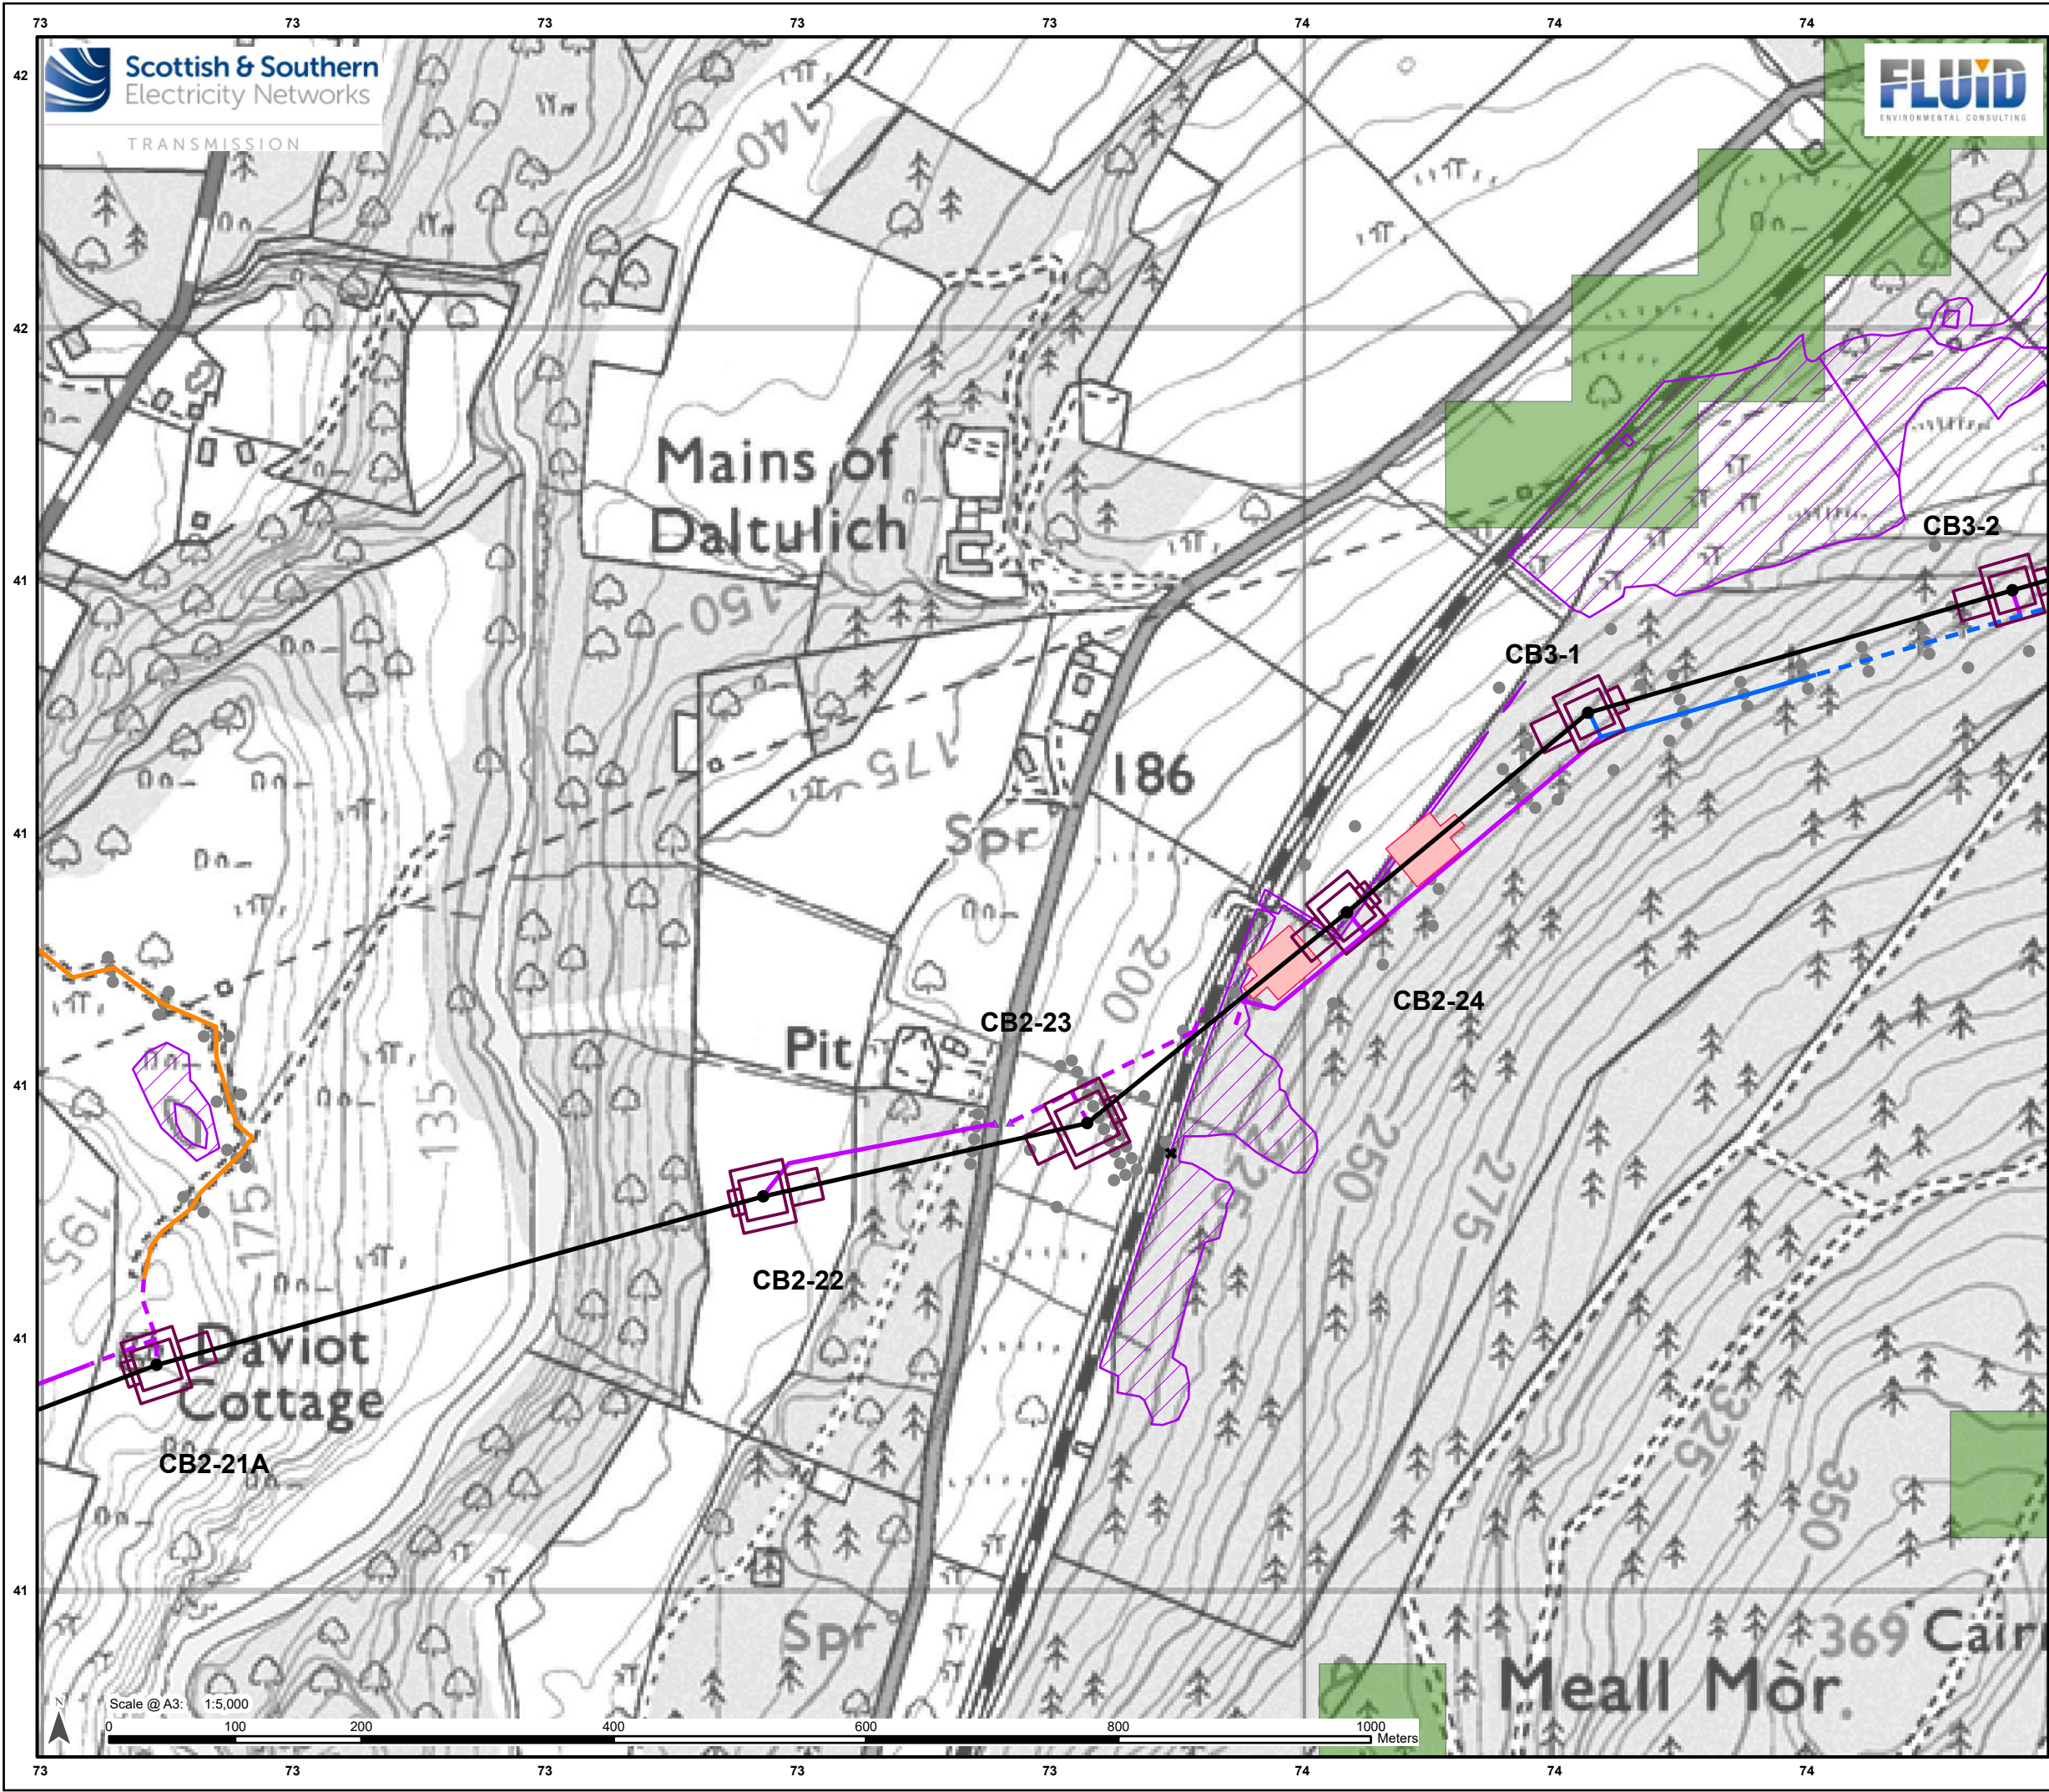

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Poor Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score

0	1	2	3	4	5

- Proposed Bellmouth - Temporary
- Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 20 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

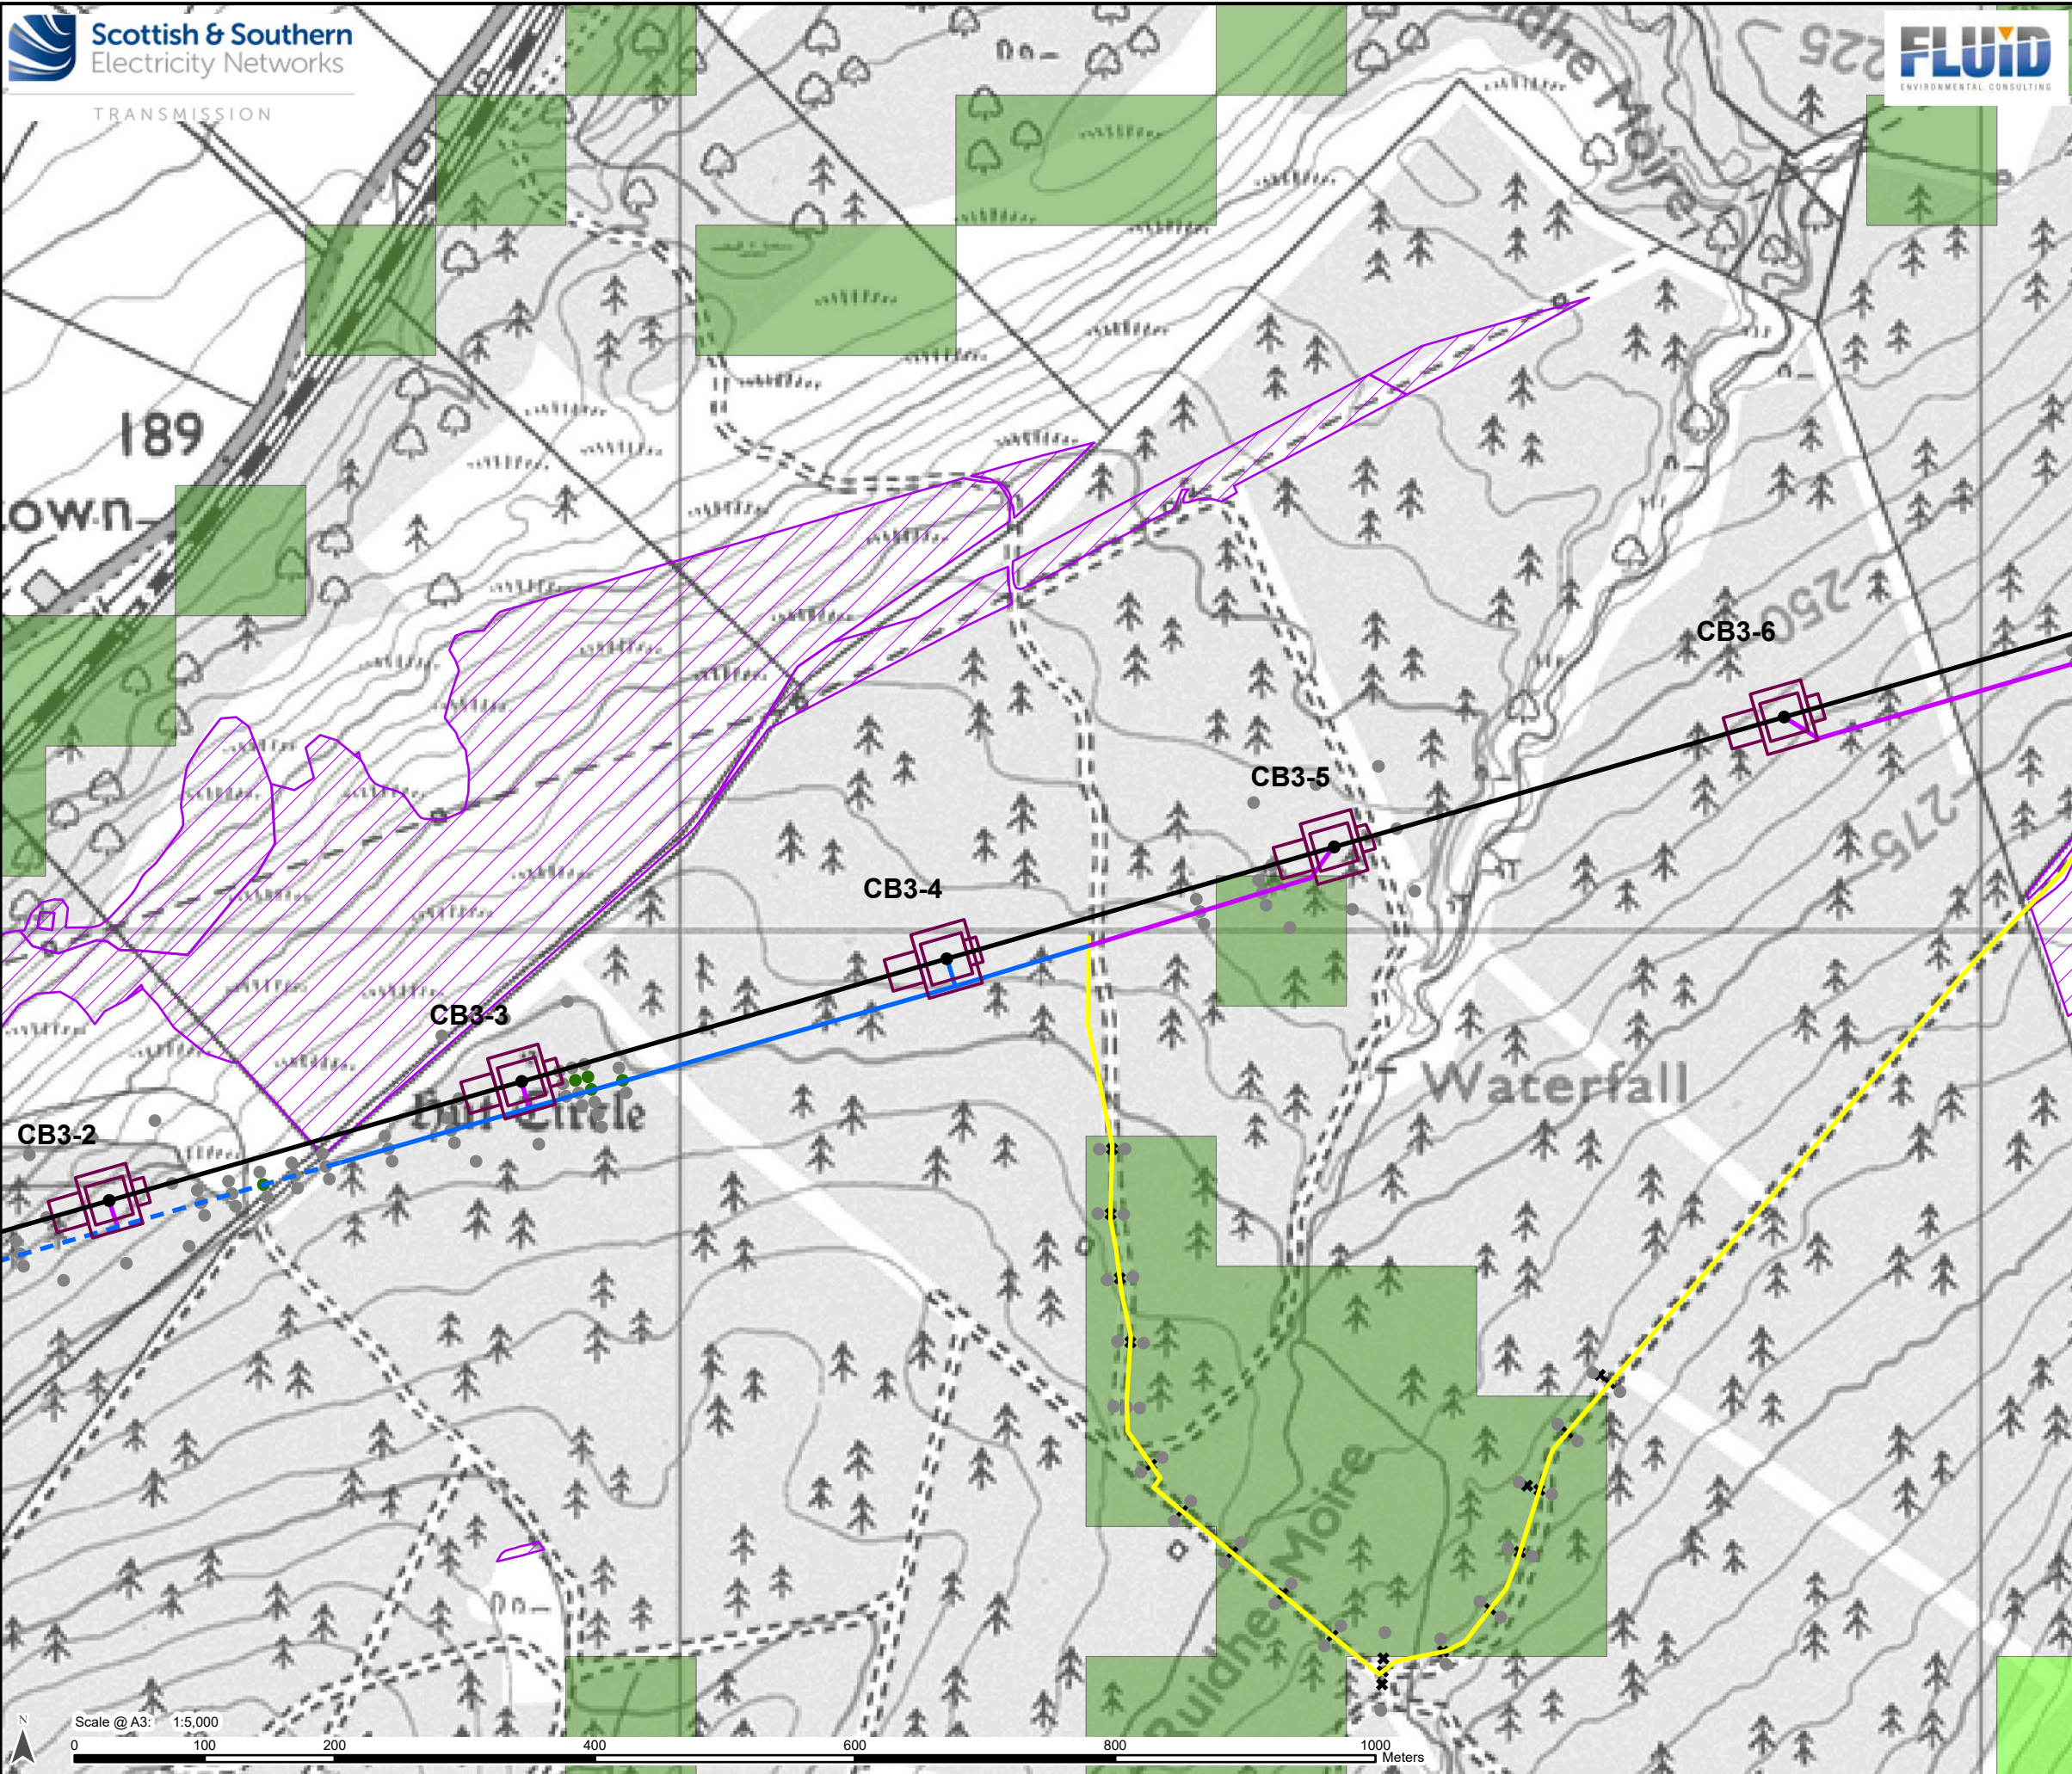

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary

JHI Peat Presence Score

0	1	2	3	4	5

* Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats


Peat Depth of Penetration Depth

	0 - 0.5 m
	> 0.5 - 1.0 m
	> 1.0 - 1.5 m
	> 1.5 - 2.0 m
	> 2.0 - 3.0 m
	> 3.0 - 4.0 m
	> 4.0 - 5.0 m
	> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 10.1.1 - Peat Depth of Penetration Page 21 of 128		
Drawn by:	JM	Date:	01/09/2025
Drawing:	B2P-WSP-DA-70092380-074		

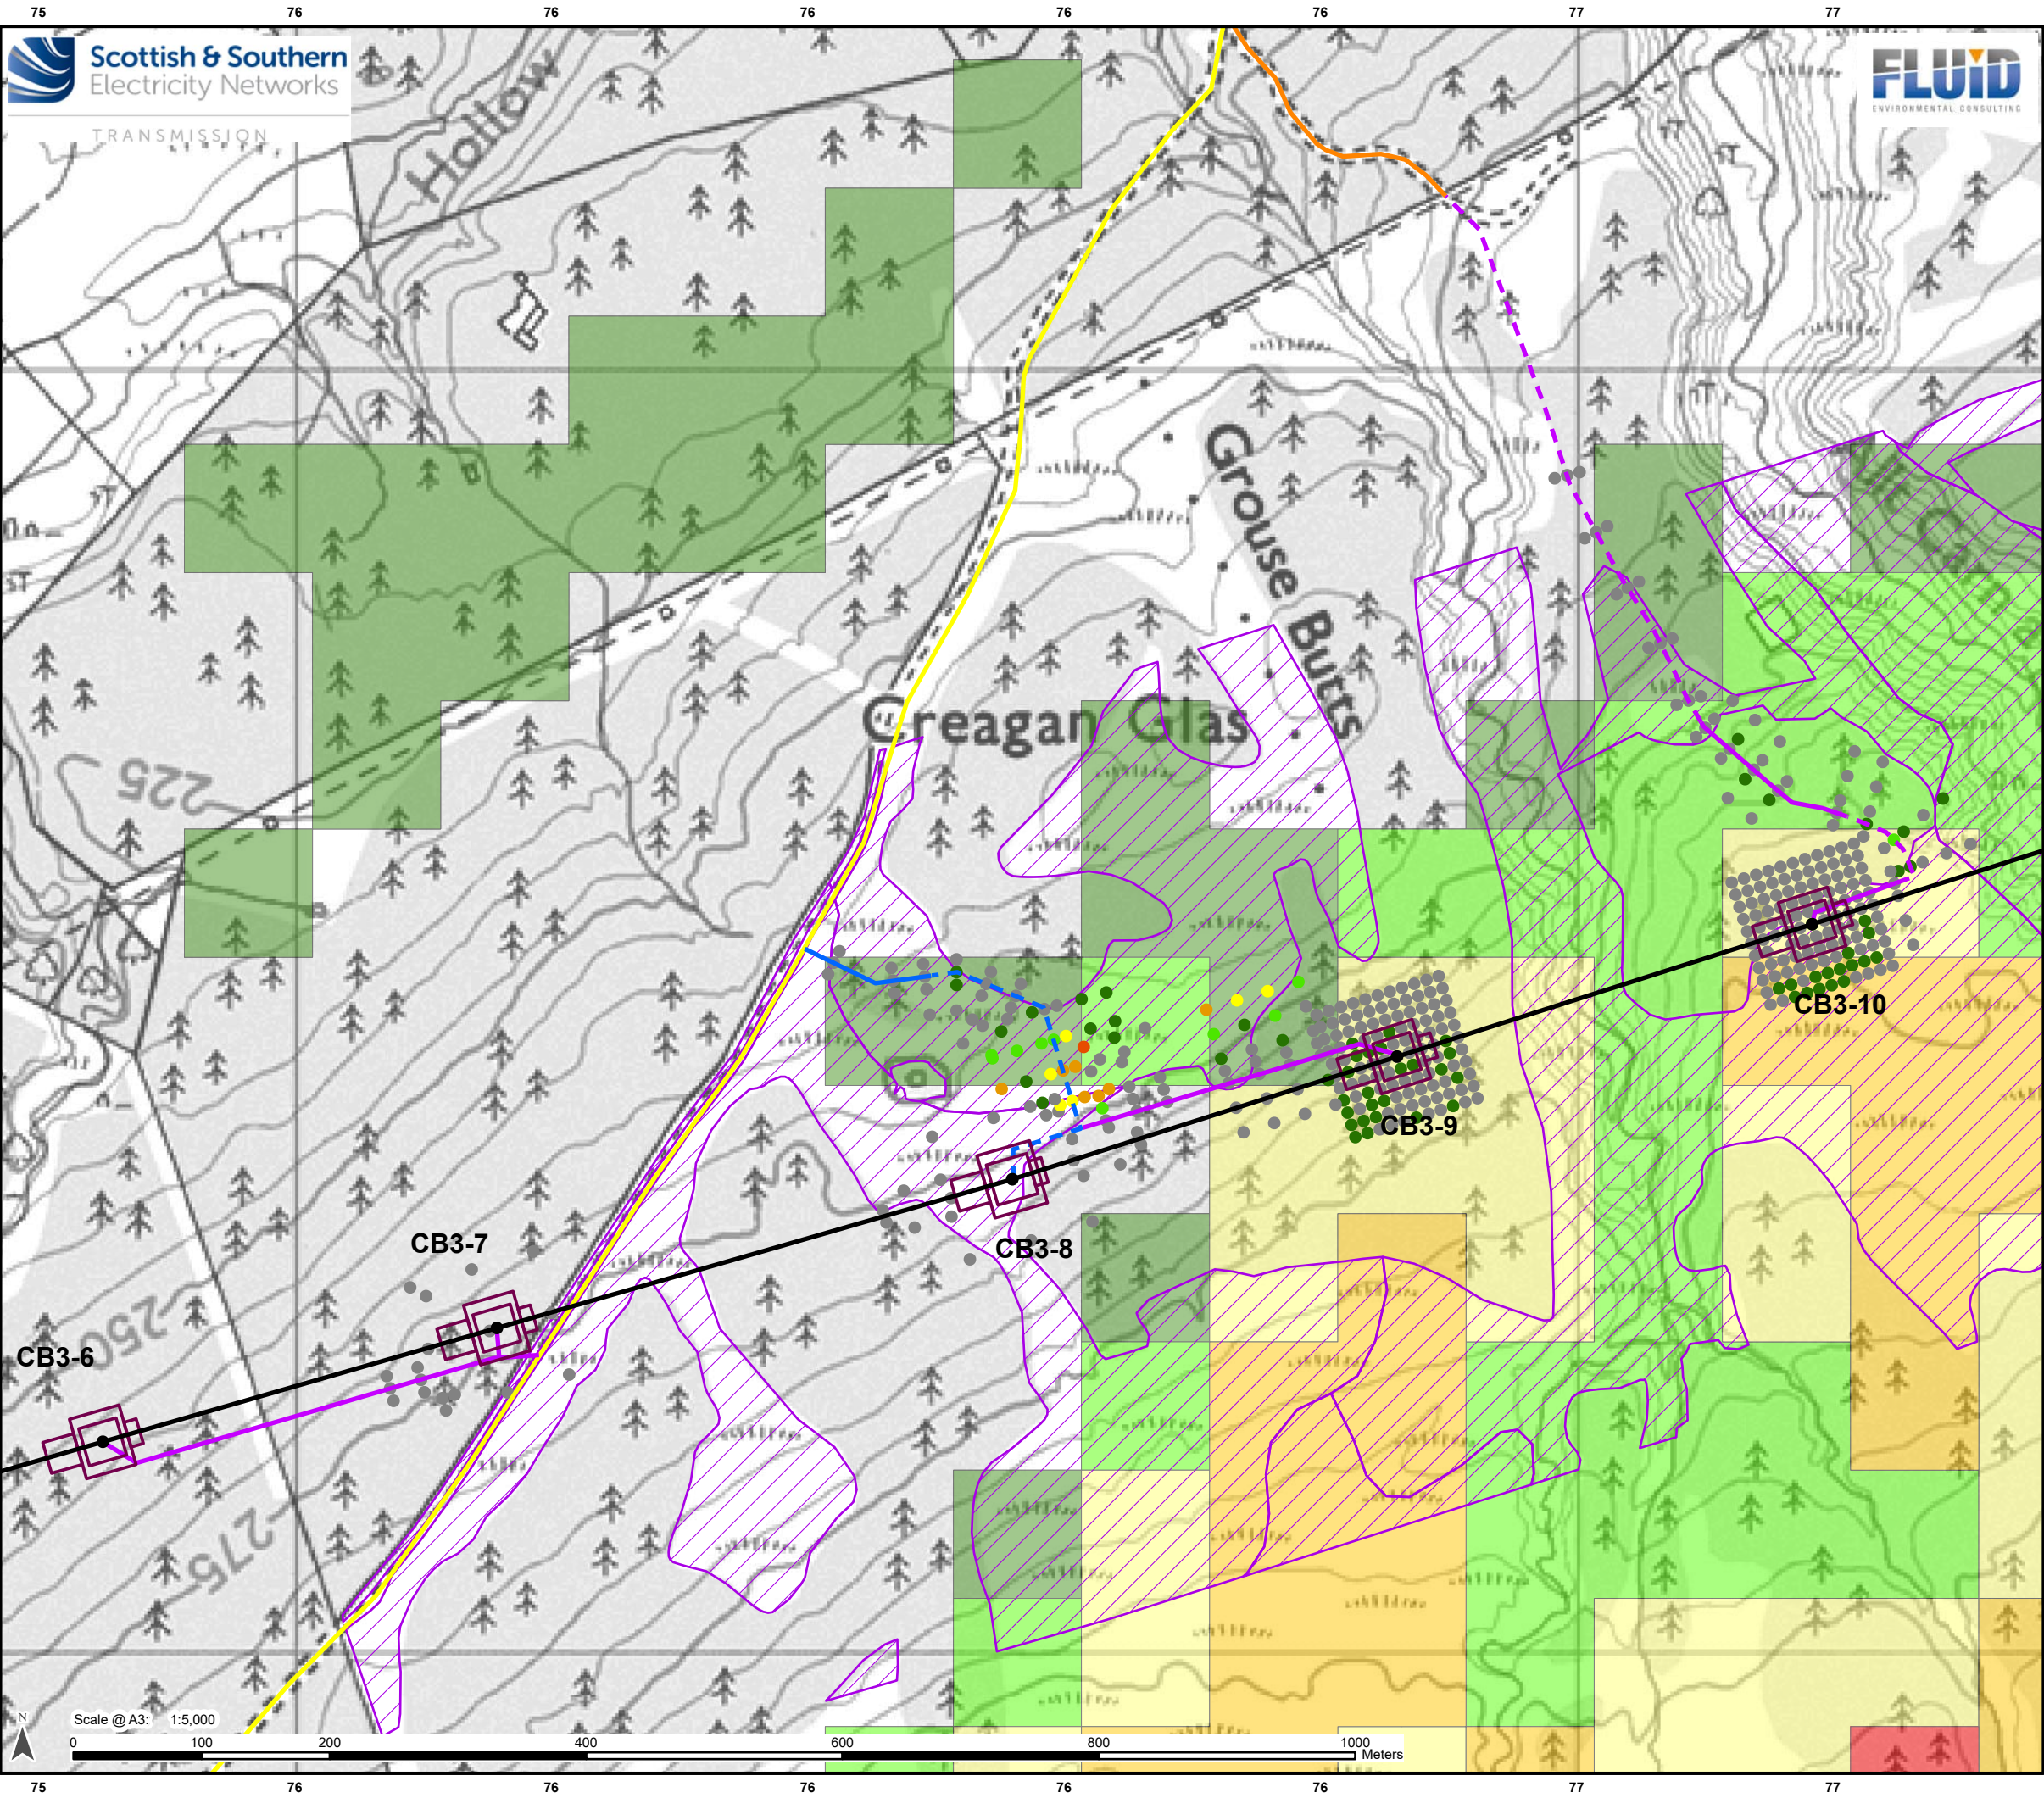

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-400kV (with tower number)

Working Areas *

Existing Access – Upgrade – Good/Fair Condition

Existing Access – Upgrade – Poor Condition

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

JHI Peat Presence Score

0

1

2

3

4

5

Priority Peatland Habitats

Priority Peatland Habitats

Peat Depth of Penetration

Depth

0 - 0.5 m

> 0.5 - 1.0 m

> 1.0 - 1.5 m

> 1.5 - 2.0 m

> 2.0 - 3.0 m

> 3.0 - 4.0 m

> 4.0 - 5.0 m

> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 22 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

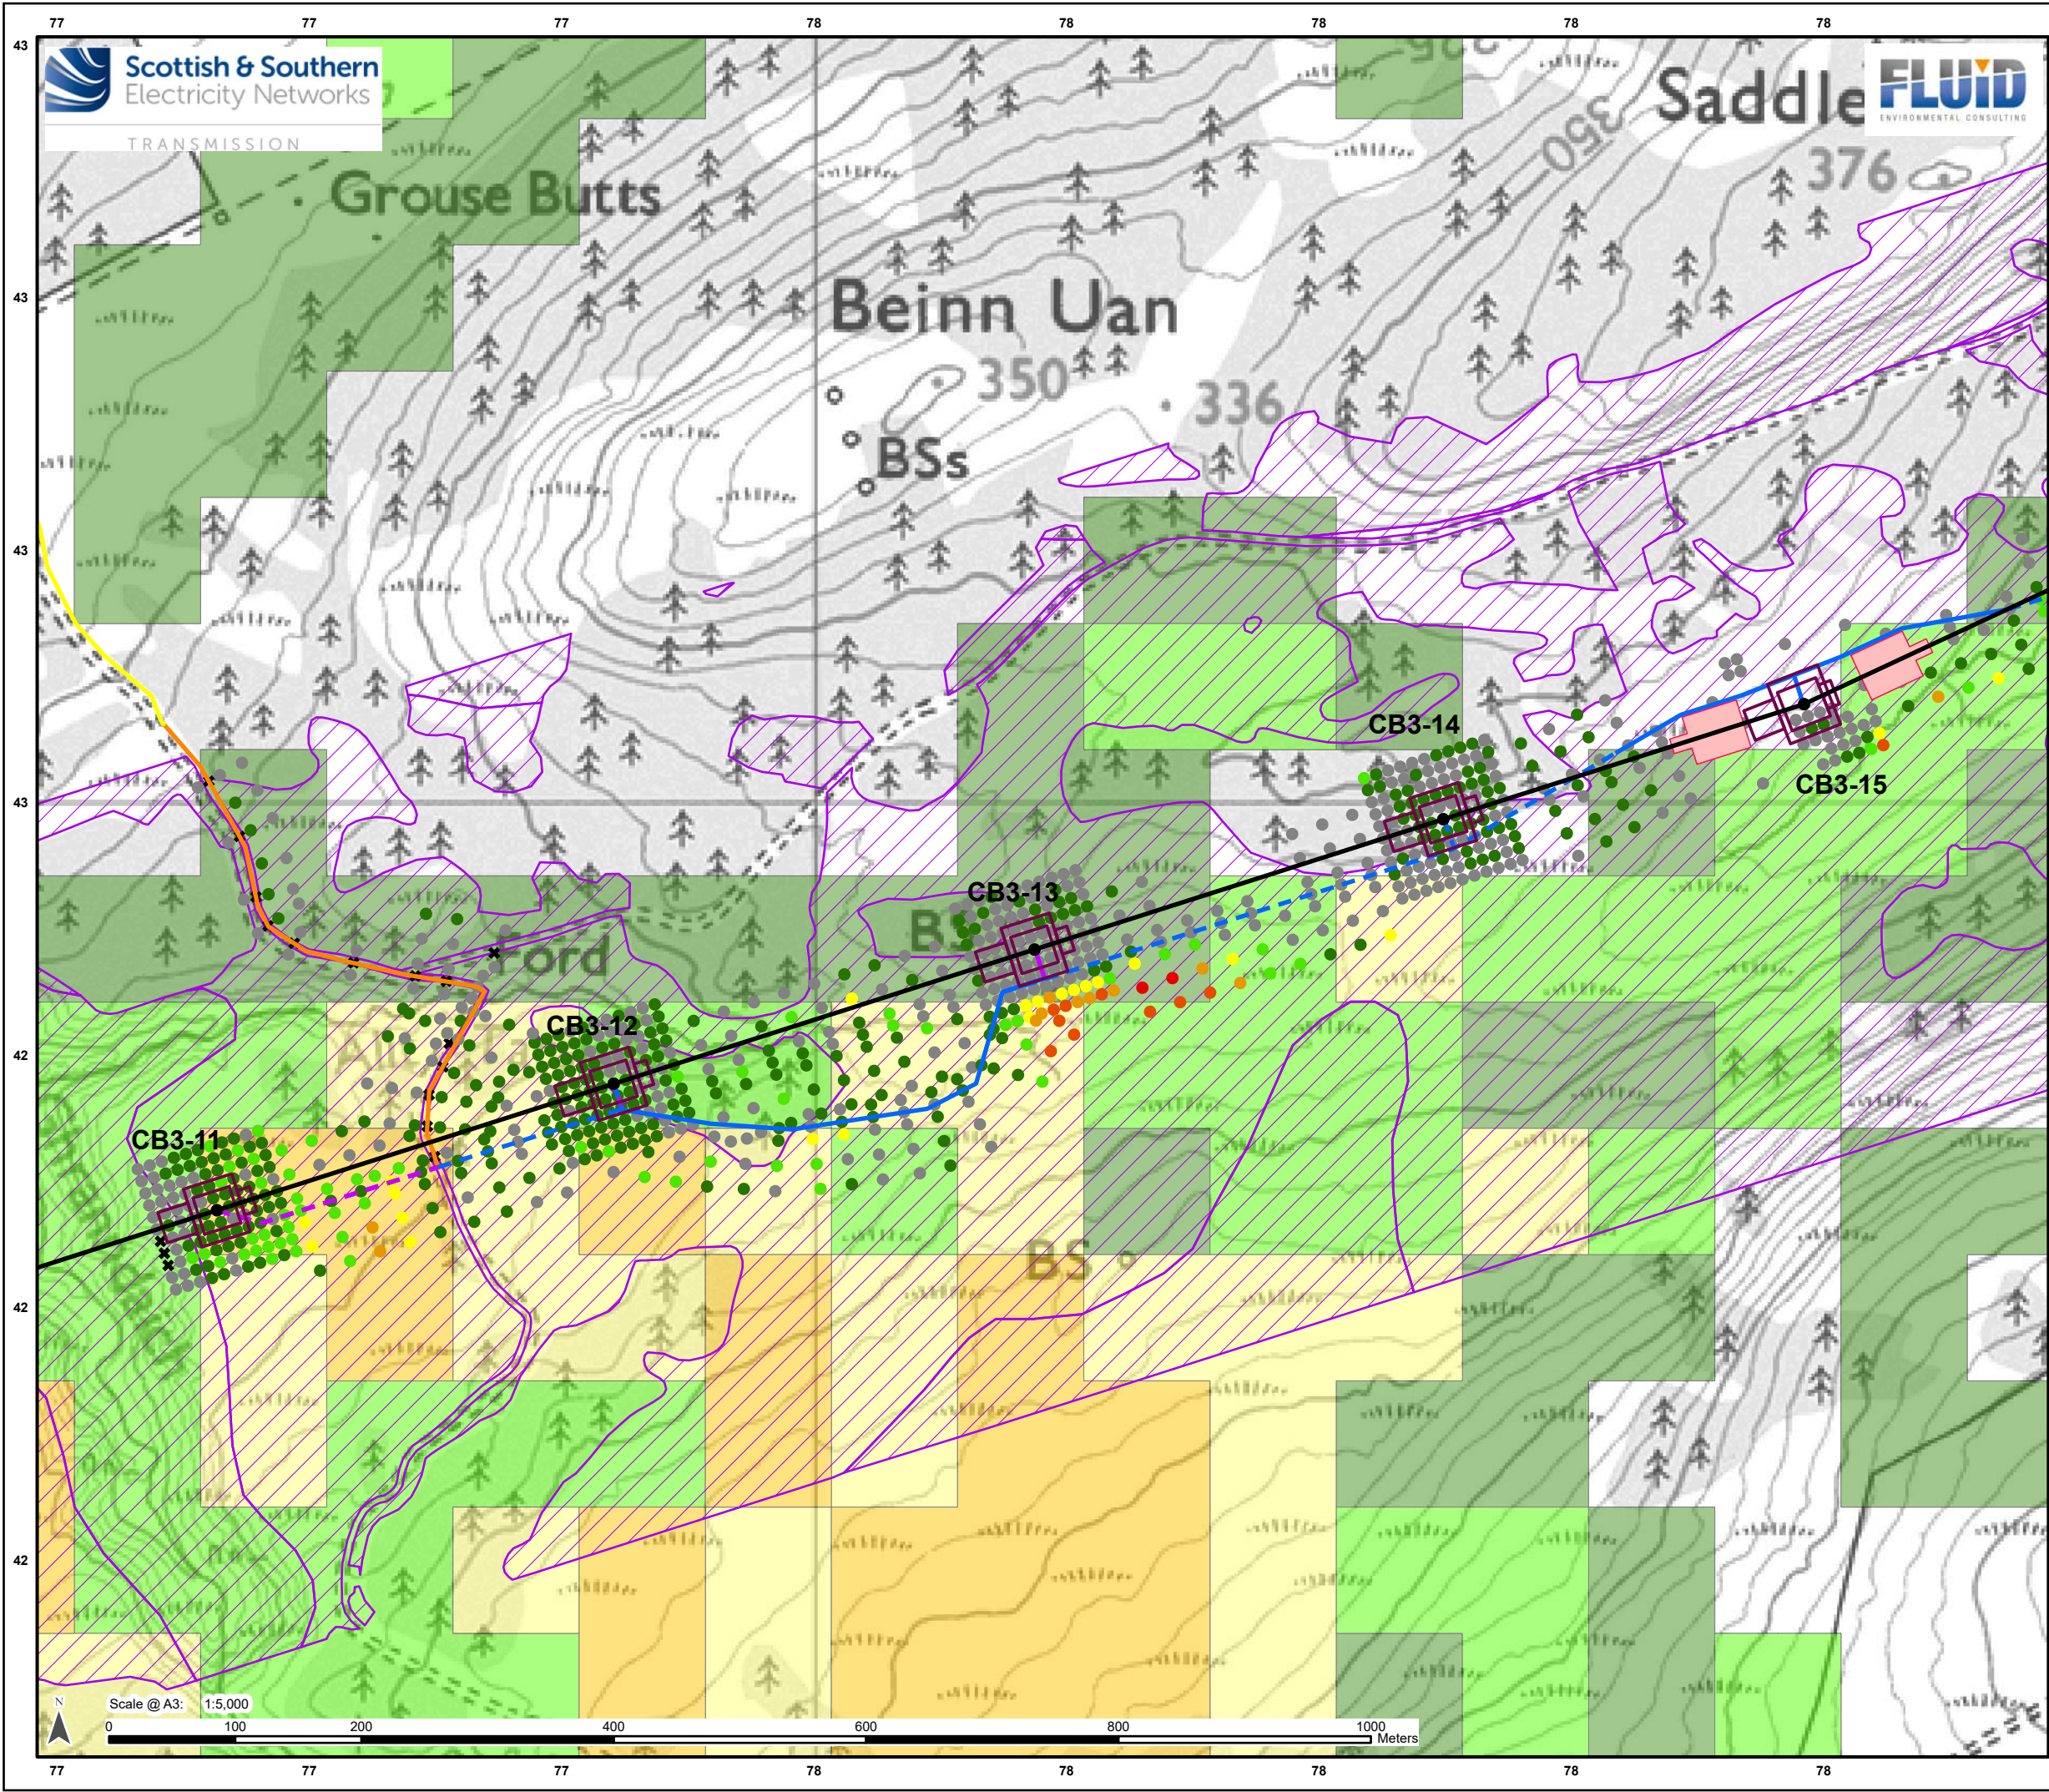

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score

0	1	2	3	4	5

* Survey (No Results)

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration

Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 23 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

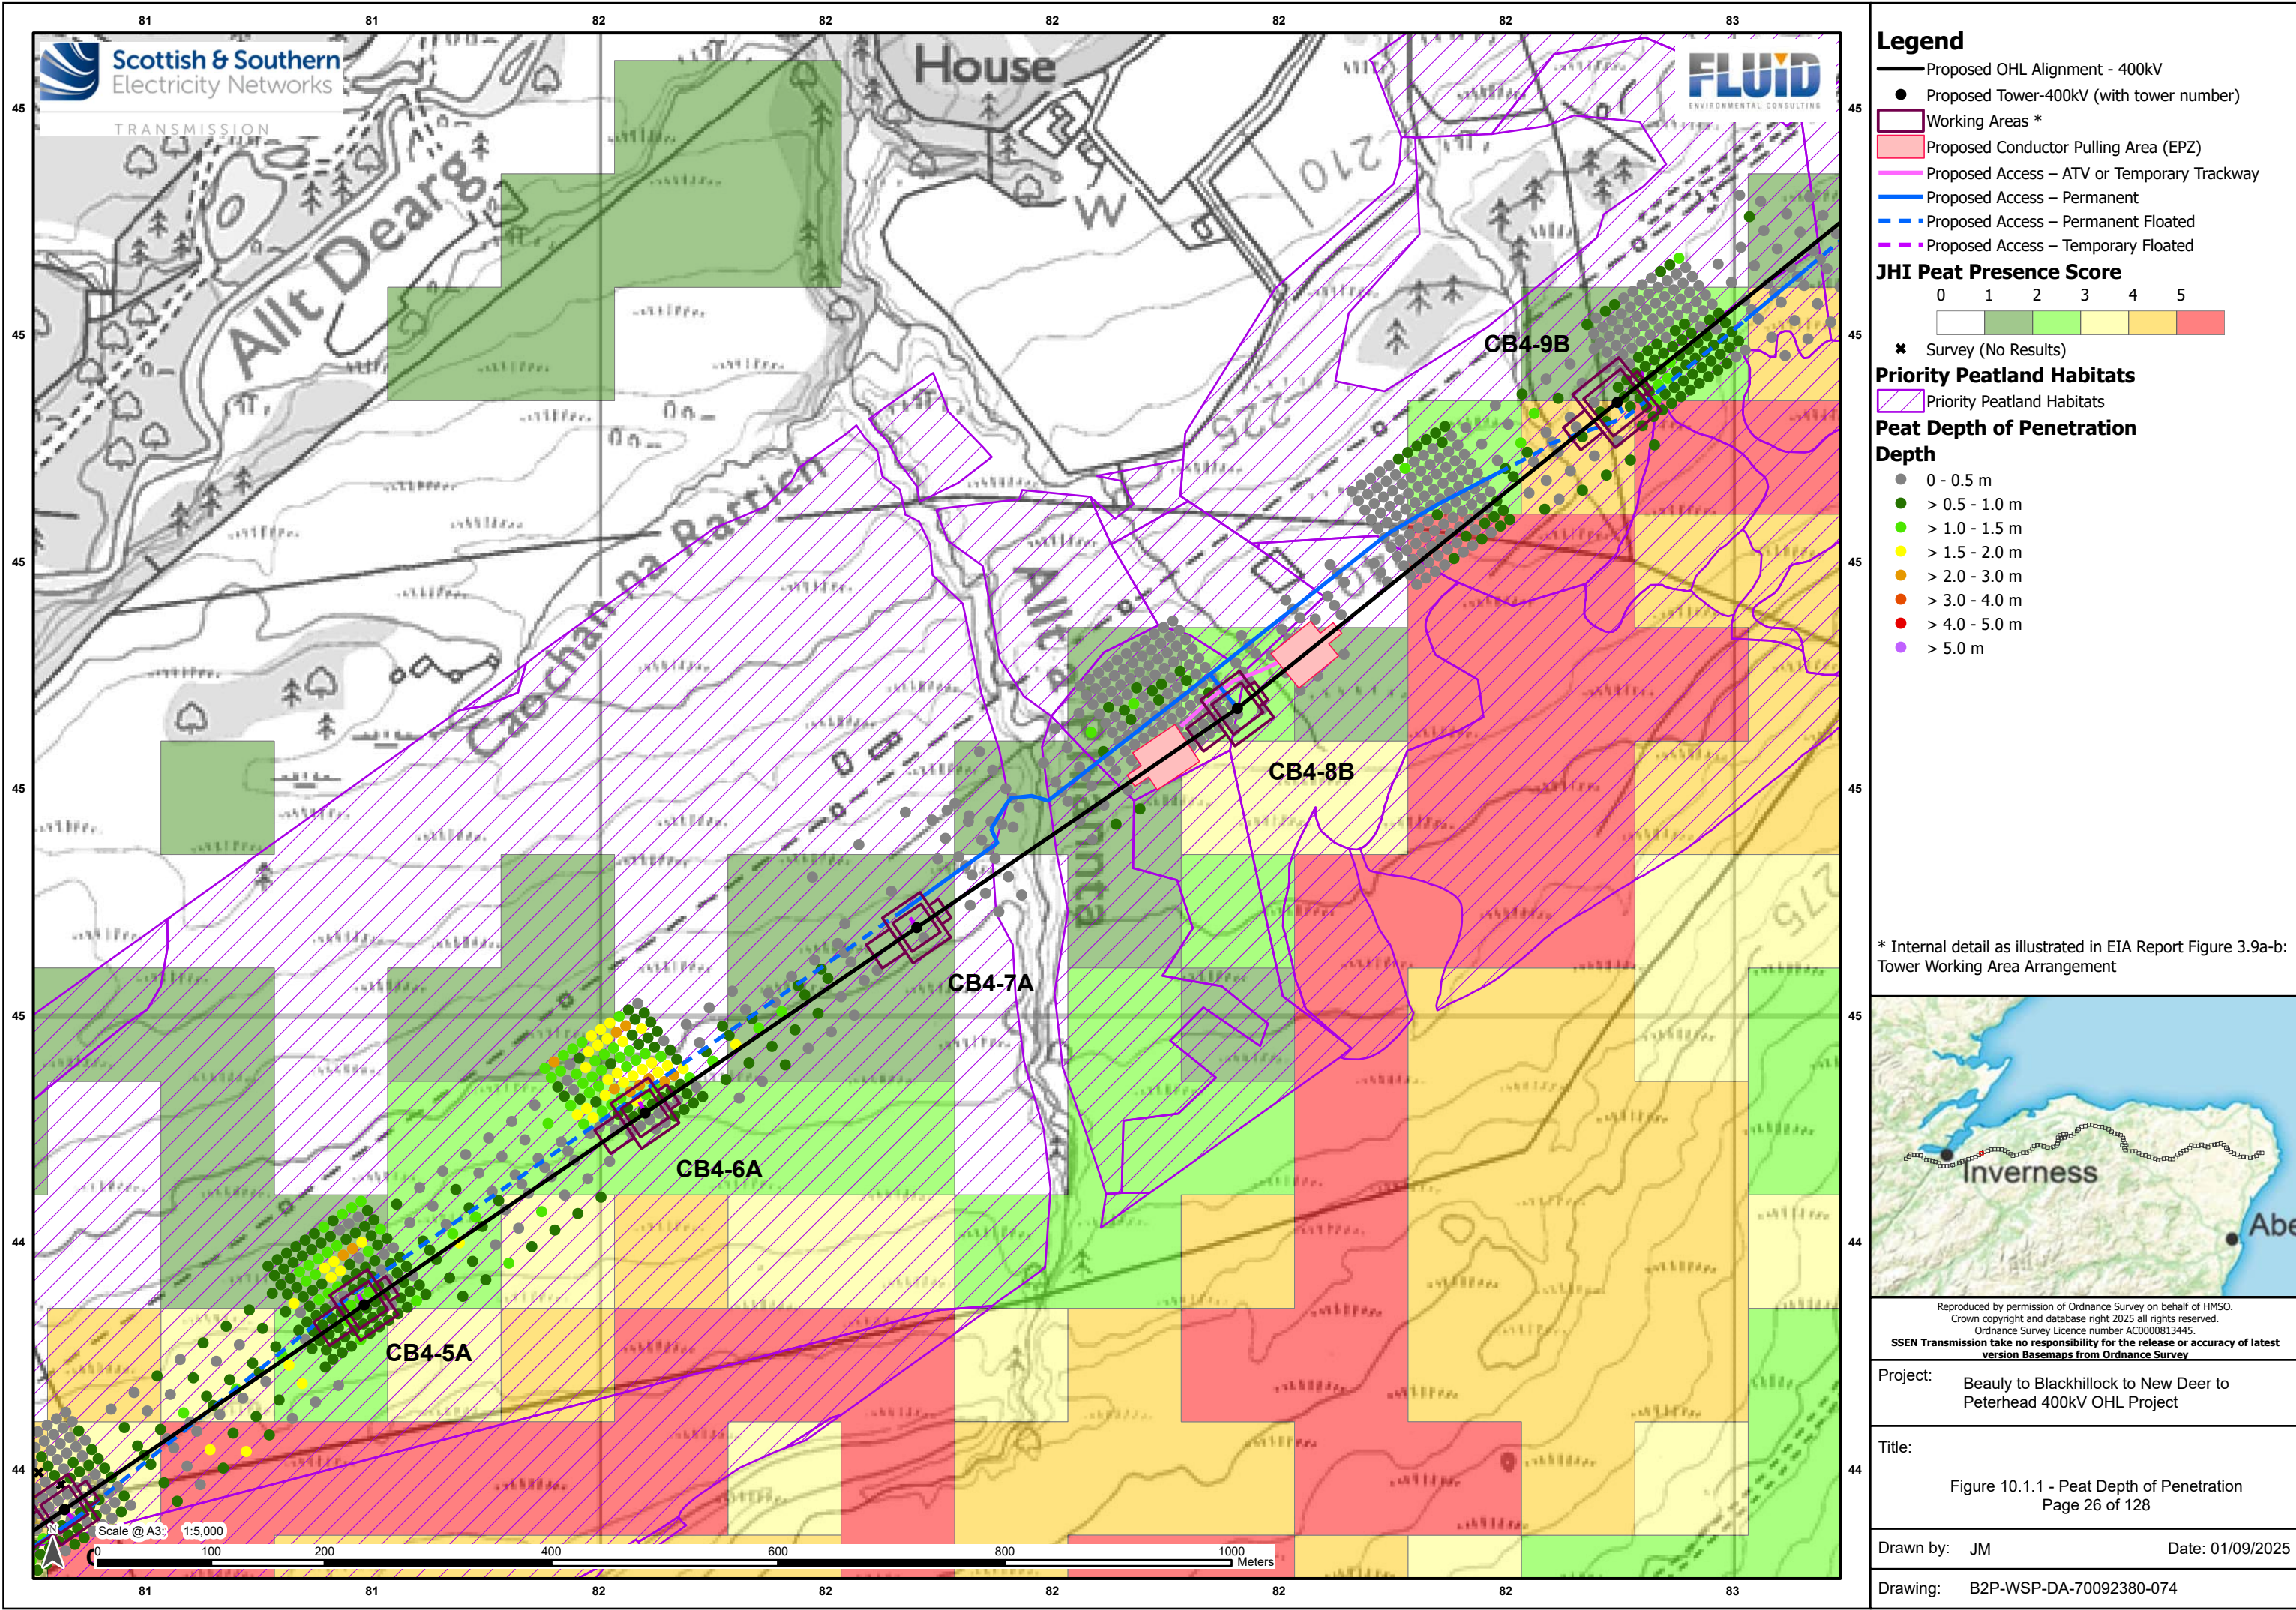

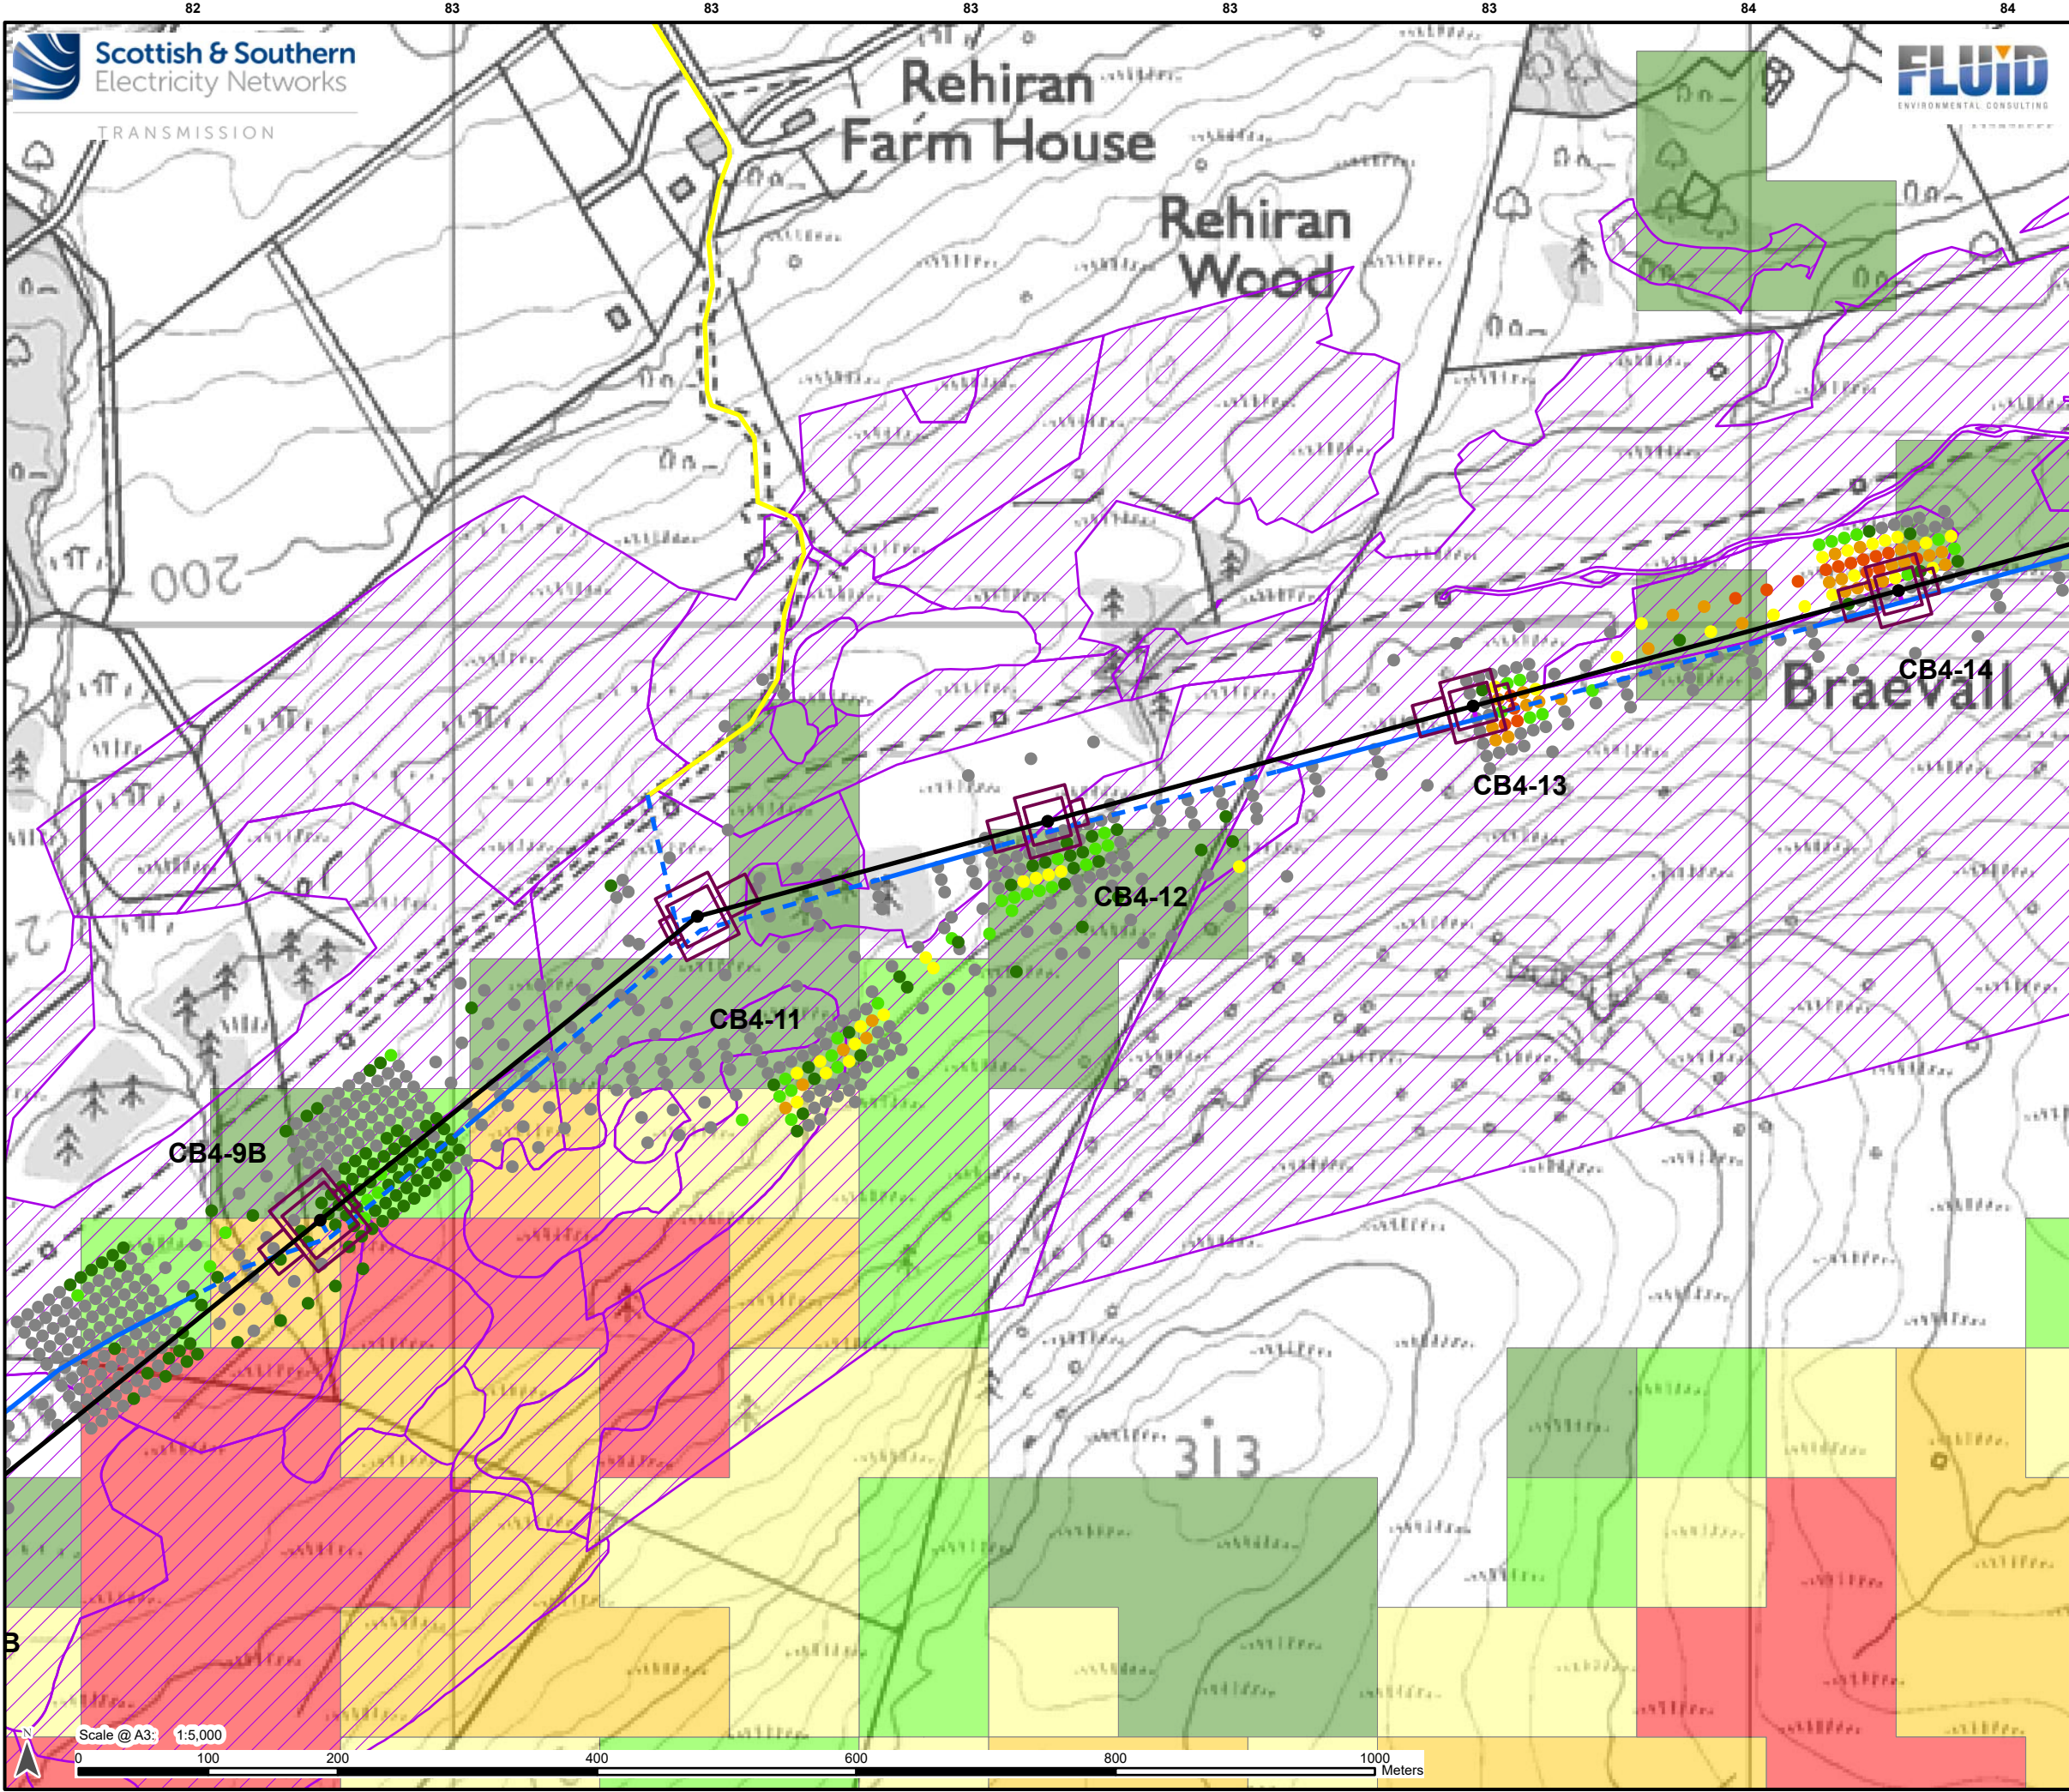

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good/Fair Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary

JHI Peat Presence Score

0	1	2	3	4	5

Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 27 of 128


Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074

Legend

- Proposed OHL Alignment - 400kV
- Proposed Tower-400kV (with tower number)
- Working Areas *
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated

JHI Peat Presence Score



Priority Peatland Habitats

- Priority Peatland Habitats

Peat Depth of Penetration

Depth

- 0 - 0.5 m
- > 0.5 - 1.0 m
- > 1.0 - 1.5 m
- > 1.5 - 2.0 m
- > 2.0 - 3.0 m
- > 3.0 - 4.0 m
- > 4.0 - 5.0 m
- > 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b:
Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey


Project: Beauly to Blackhillock to New Deer to
Peterhead 400kV OHL Project

Title: Figure 10.1.1 - Peat Depth of Penetration
Page 28 of 128

Drawn by: JM Date: 01/09/2025

Drawing: B2P-WSP-DA-70092380-074



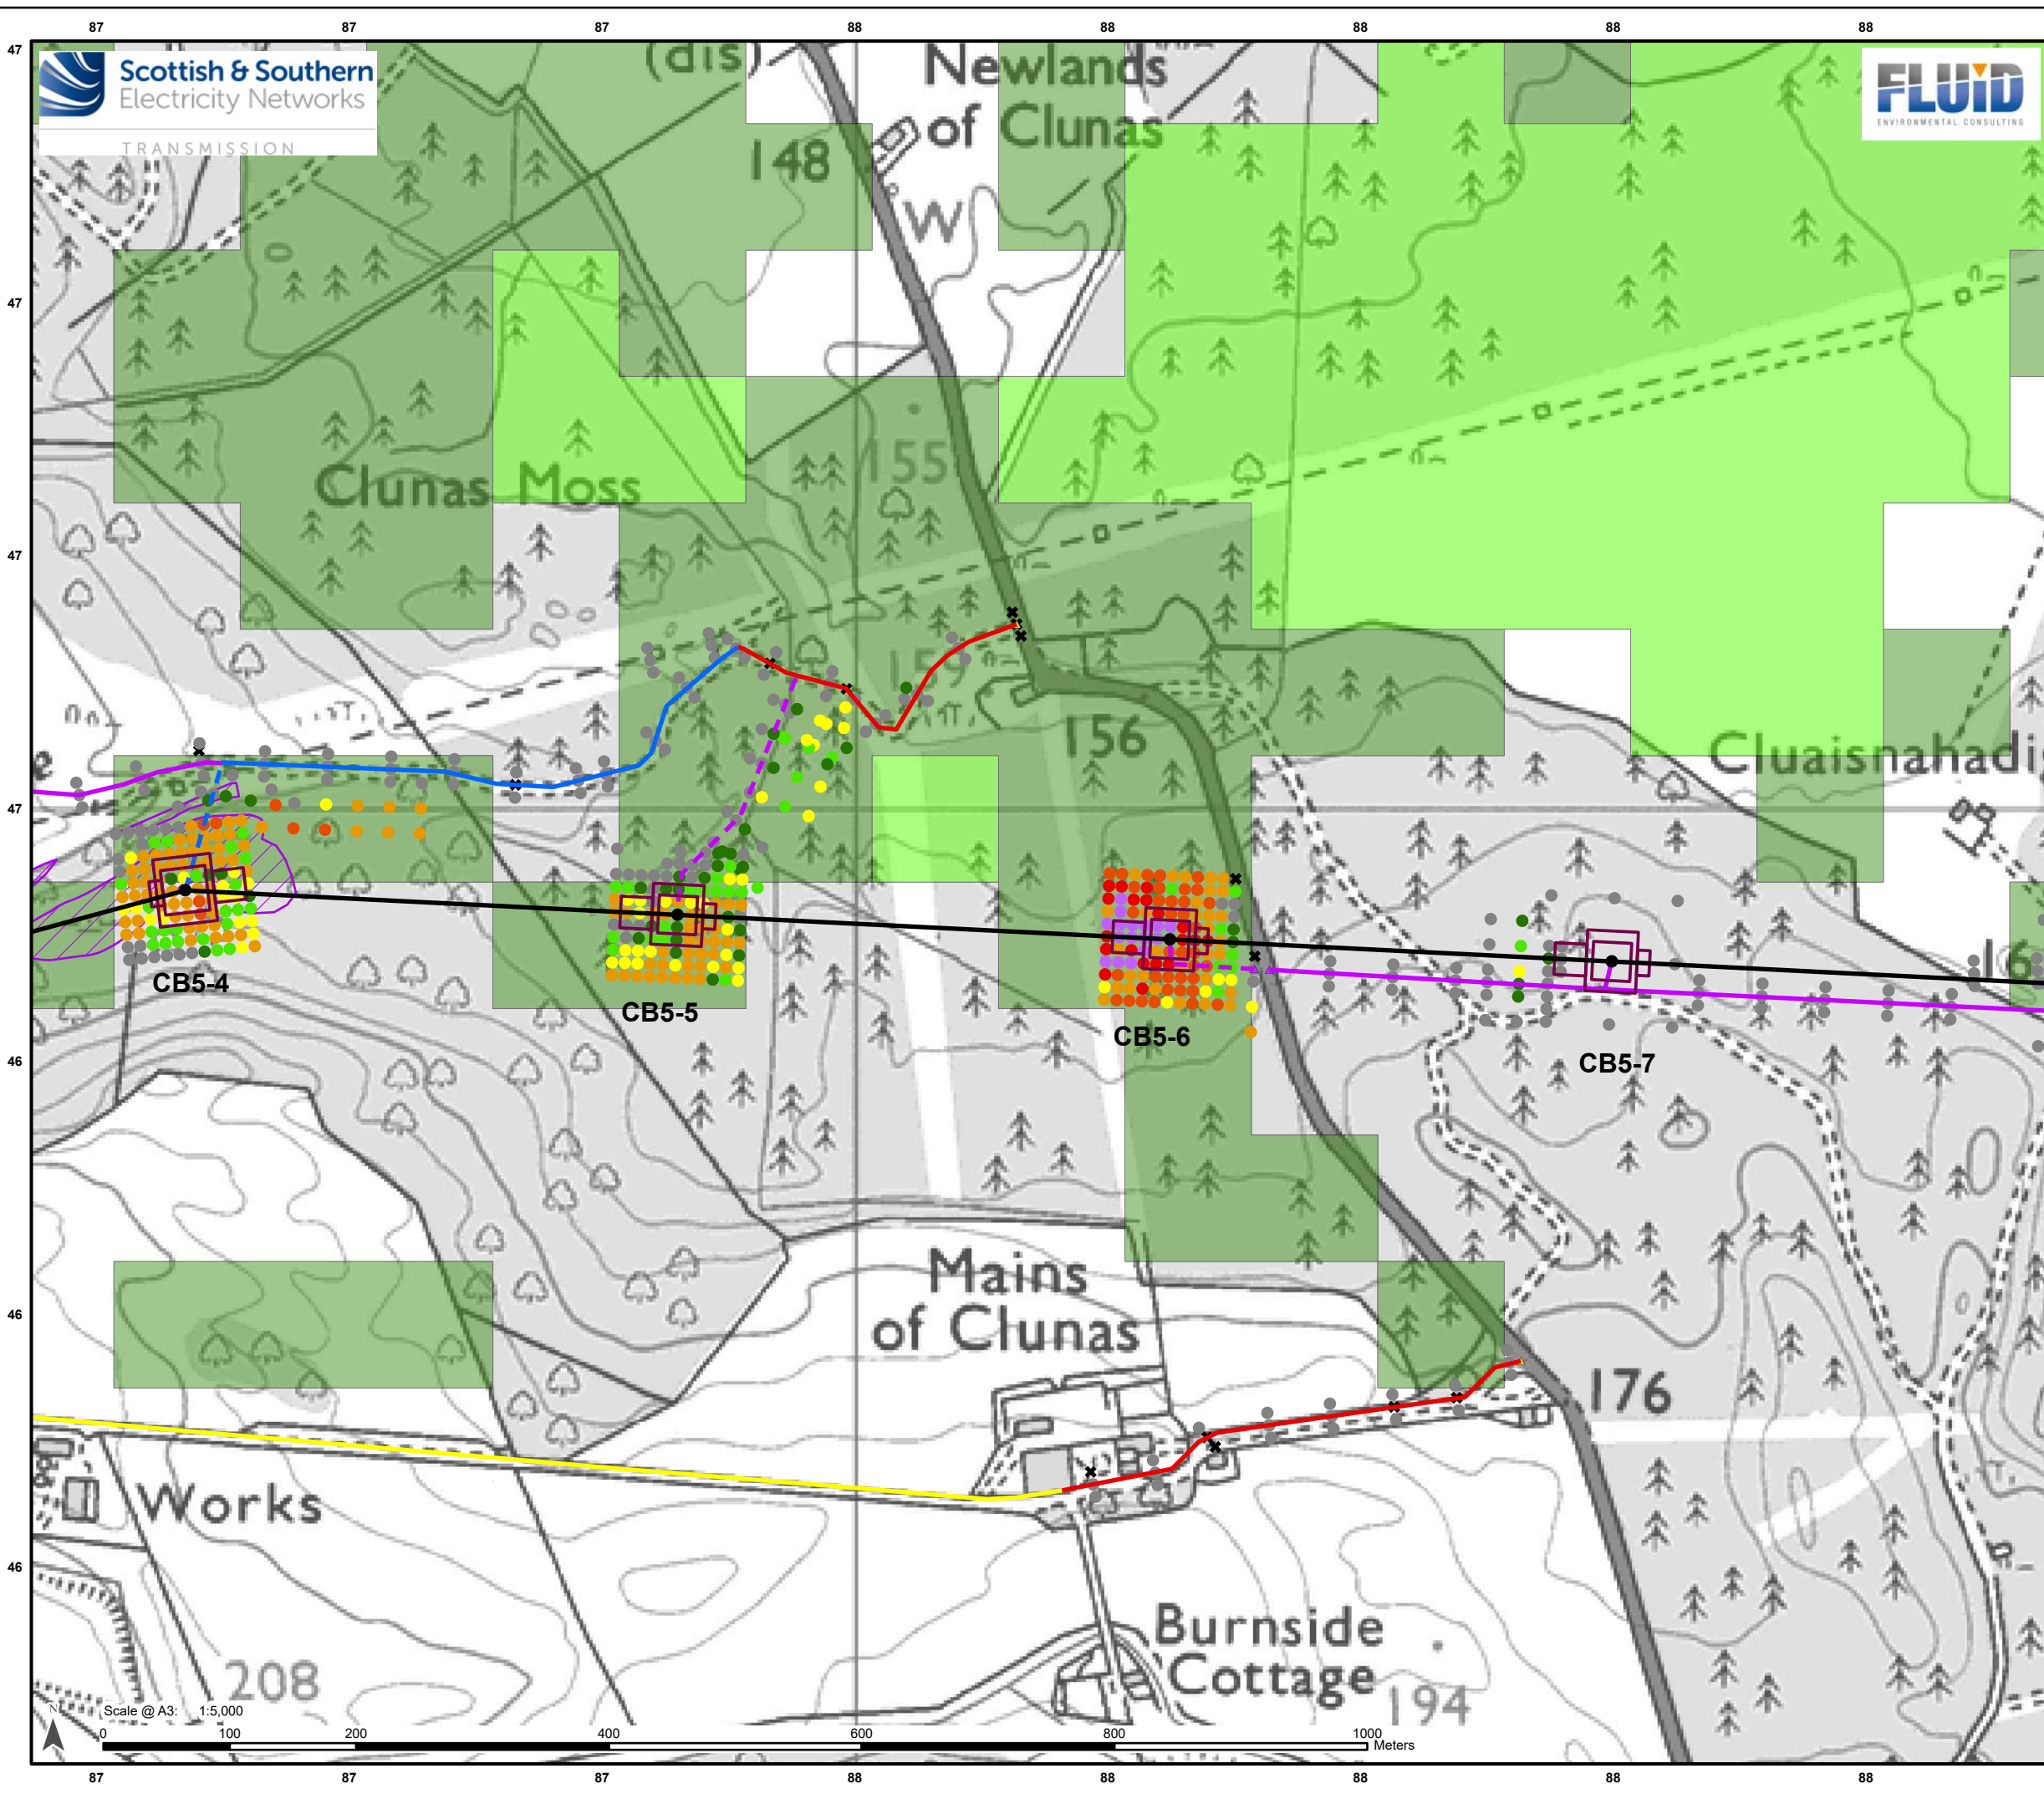

Legend

Proposed OHL Alignment - 400kV

Proposed Tower-400kV (with tower number)

Working Areas *

Existing Access – Upgrade – Good/Fair Condition

Existing Access – Upgrade – Very Poor Condition

Proposed Access – Permanent

Proposed Access – Permanent Floated

Proposed Access – Temporary

Proposed Access – Temporary Floated

JHI Peat Presence Score

0

1

2

3

4

5

Proposed Bellmouth - Temporary

Proposed Bellmouth - Upgrade

Survey (No Results)

Priority Peatland HabitatsPriority Peatland Habitats**Peat Depth of Penetration****Depth**0 - 0.5 m> 0.5 - 1.0 m> 1.0 - 1.5 m> 1.5 - 2.0 m> 2.0 - 3.0 m> 3.0 - 4.0 m> 4.0 - 5.0 m> 5.0 m

* Internal detail as illustrated in EIA Report Figure 3.9a-b: Tower Working Area Arrangement



Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project:	Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project
Title:	Figure 10.1.1 - Peat Depth of Penetration Page 30 of 128
Drawn by:	JM
Date:	01/09/2025
Drawing:	B2P-WSP-DA-70092380-074