


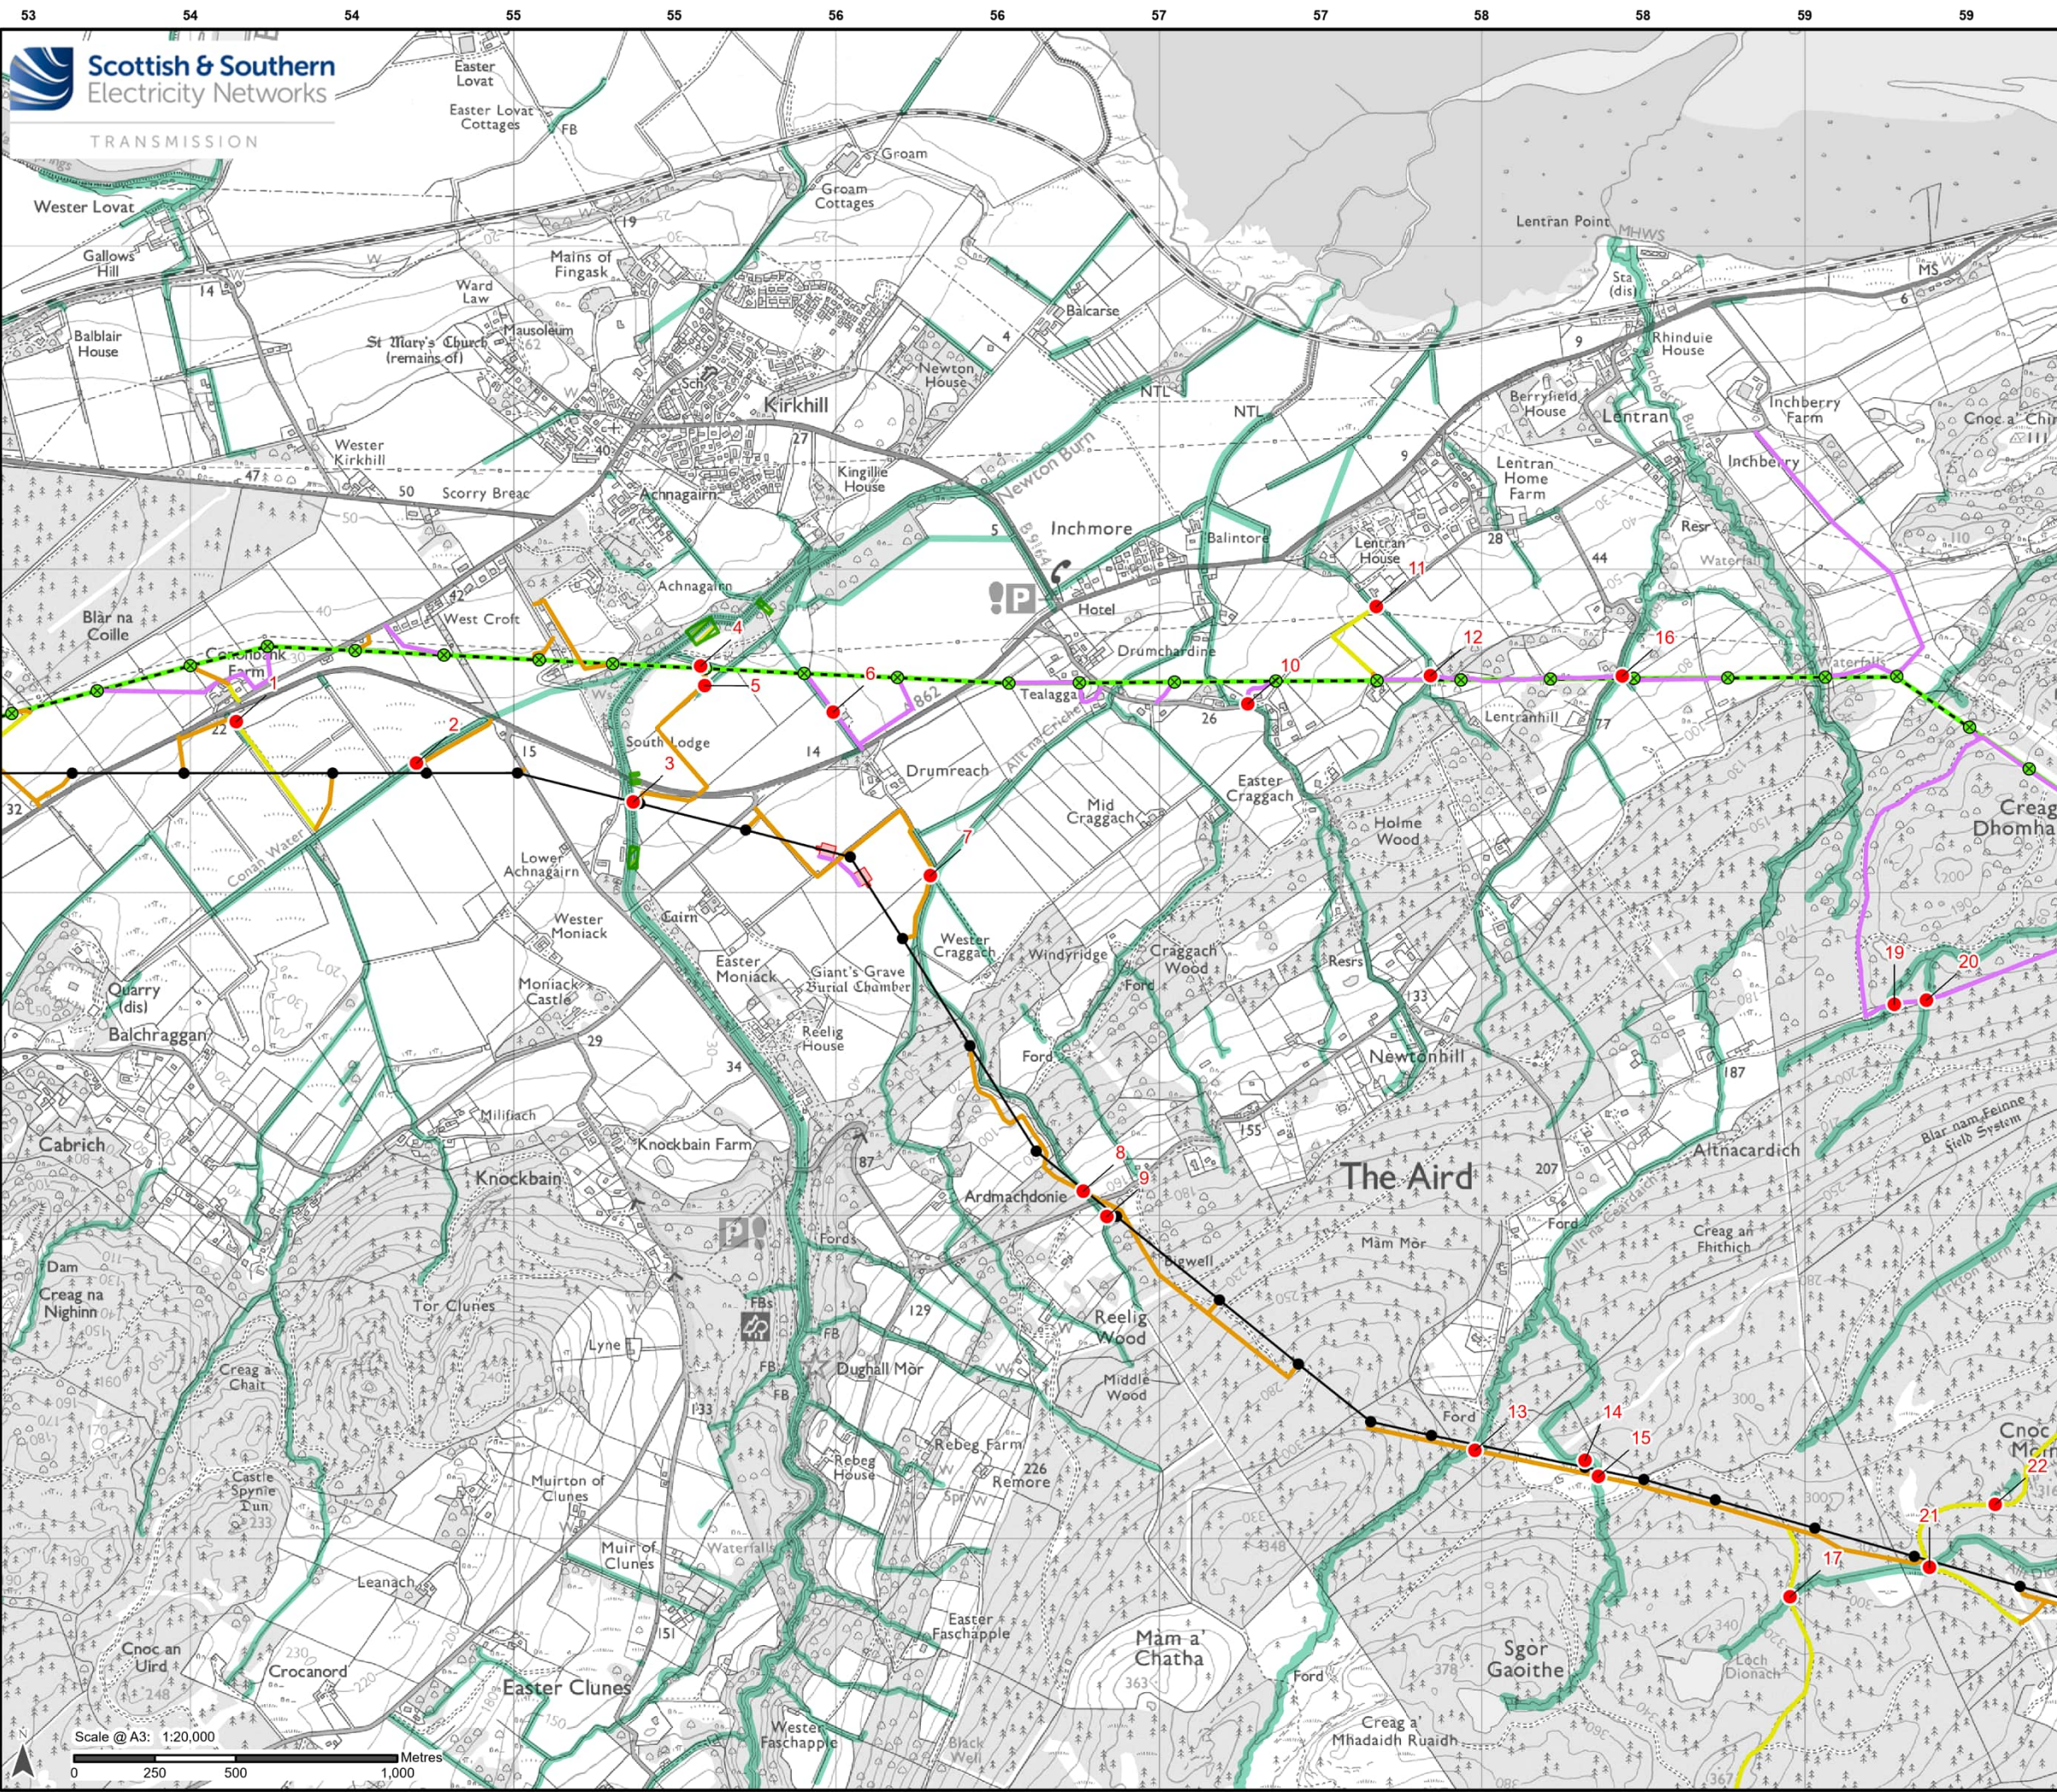

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

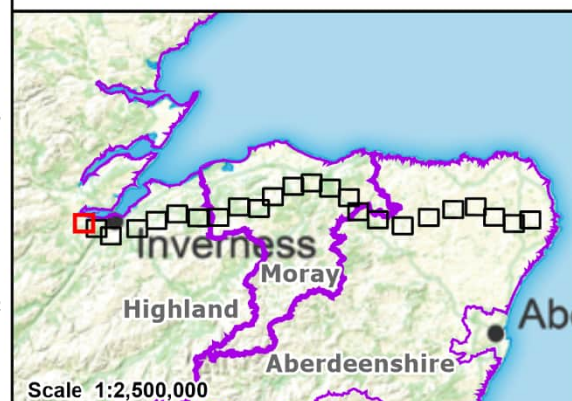


Scale 1:2,500,000
Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SEEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 1 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

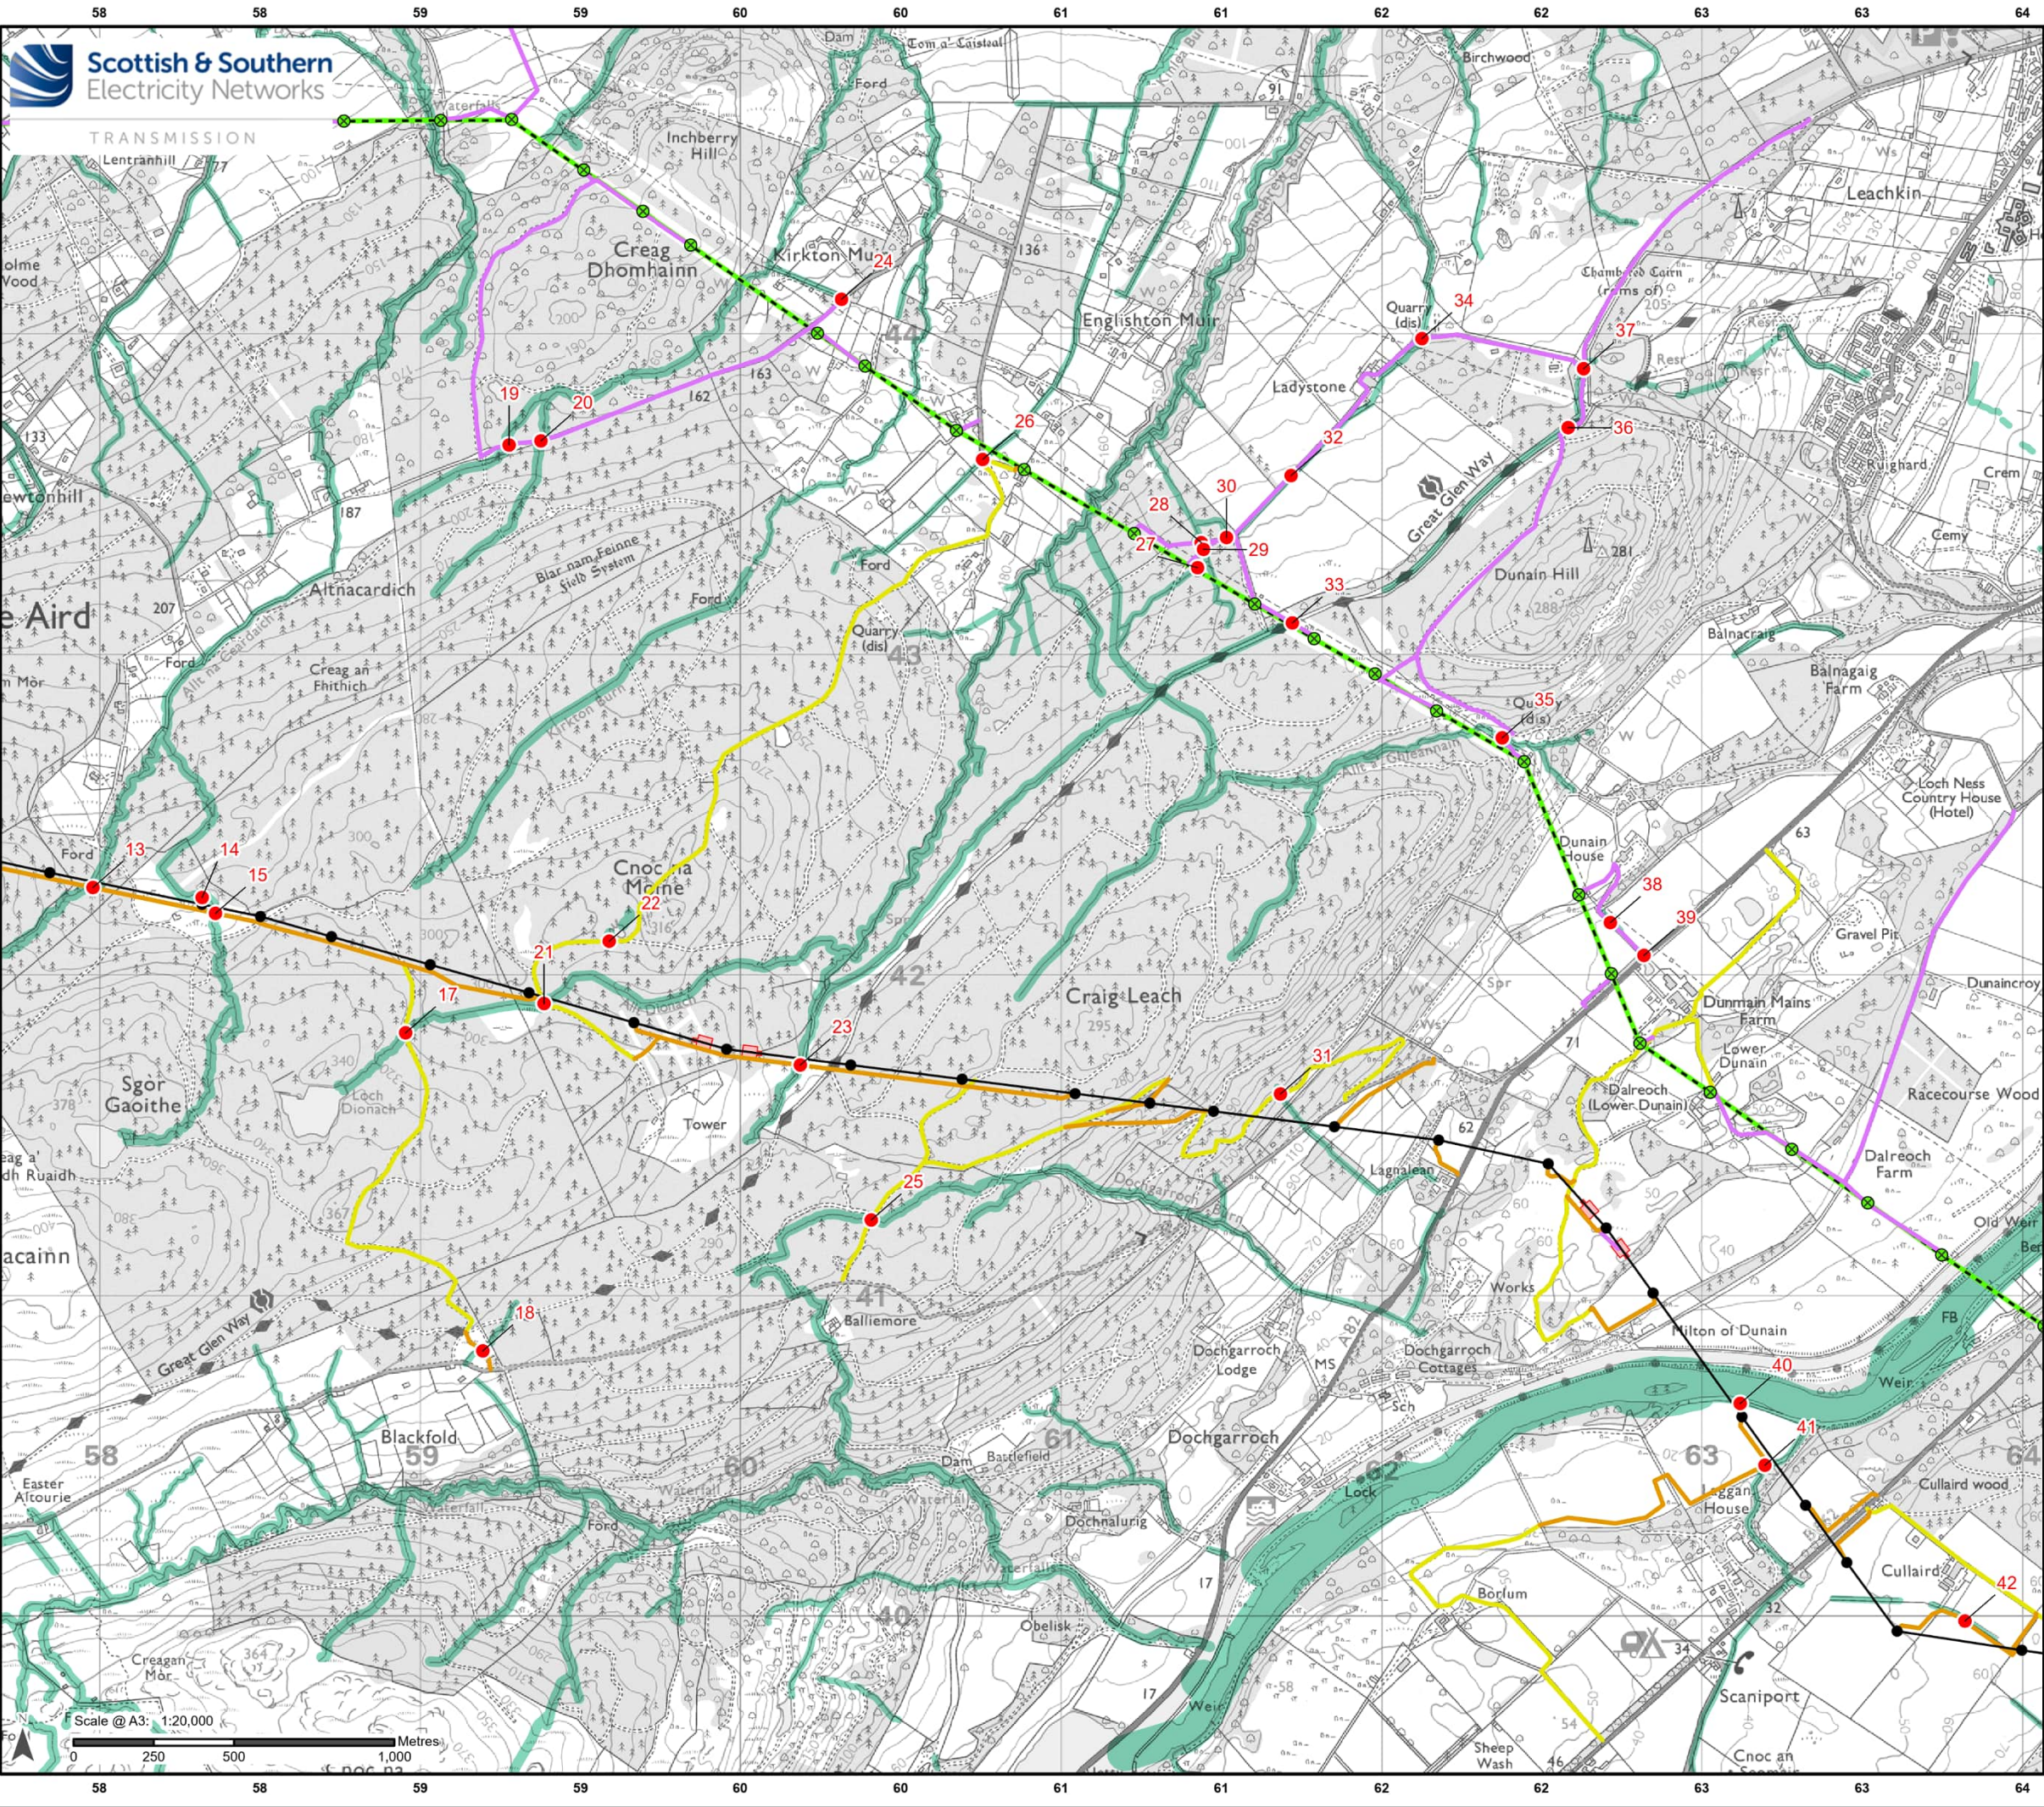

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Recommended Riparian Corridor

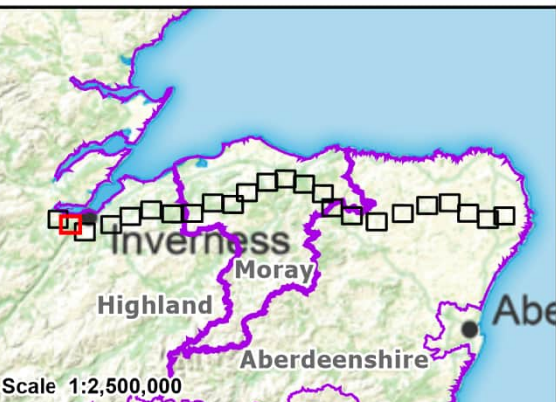


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 2 of 24

Drawn by: MAL **Date:** 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

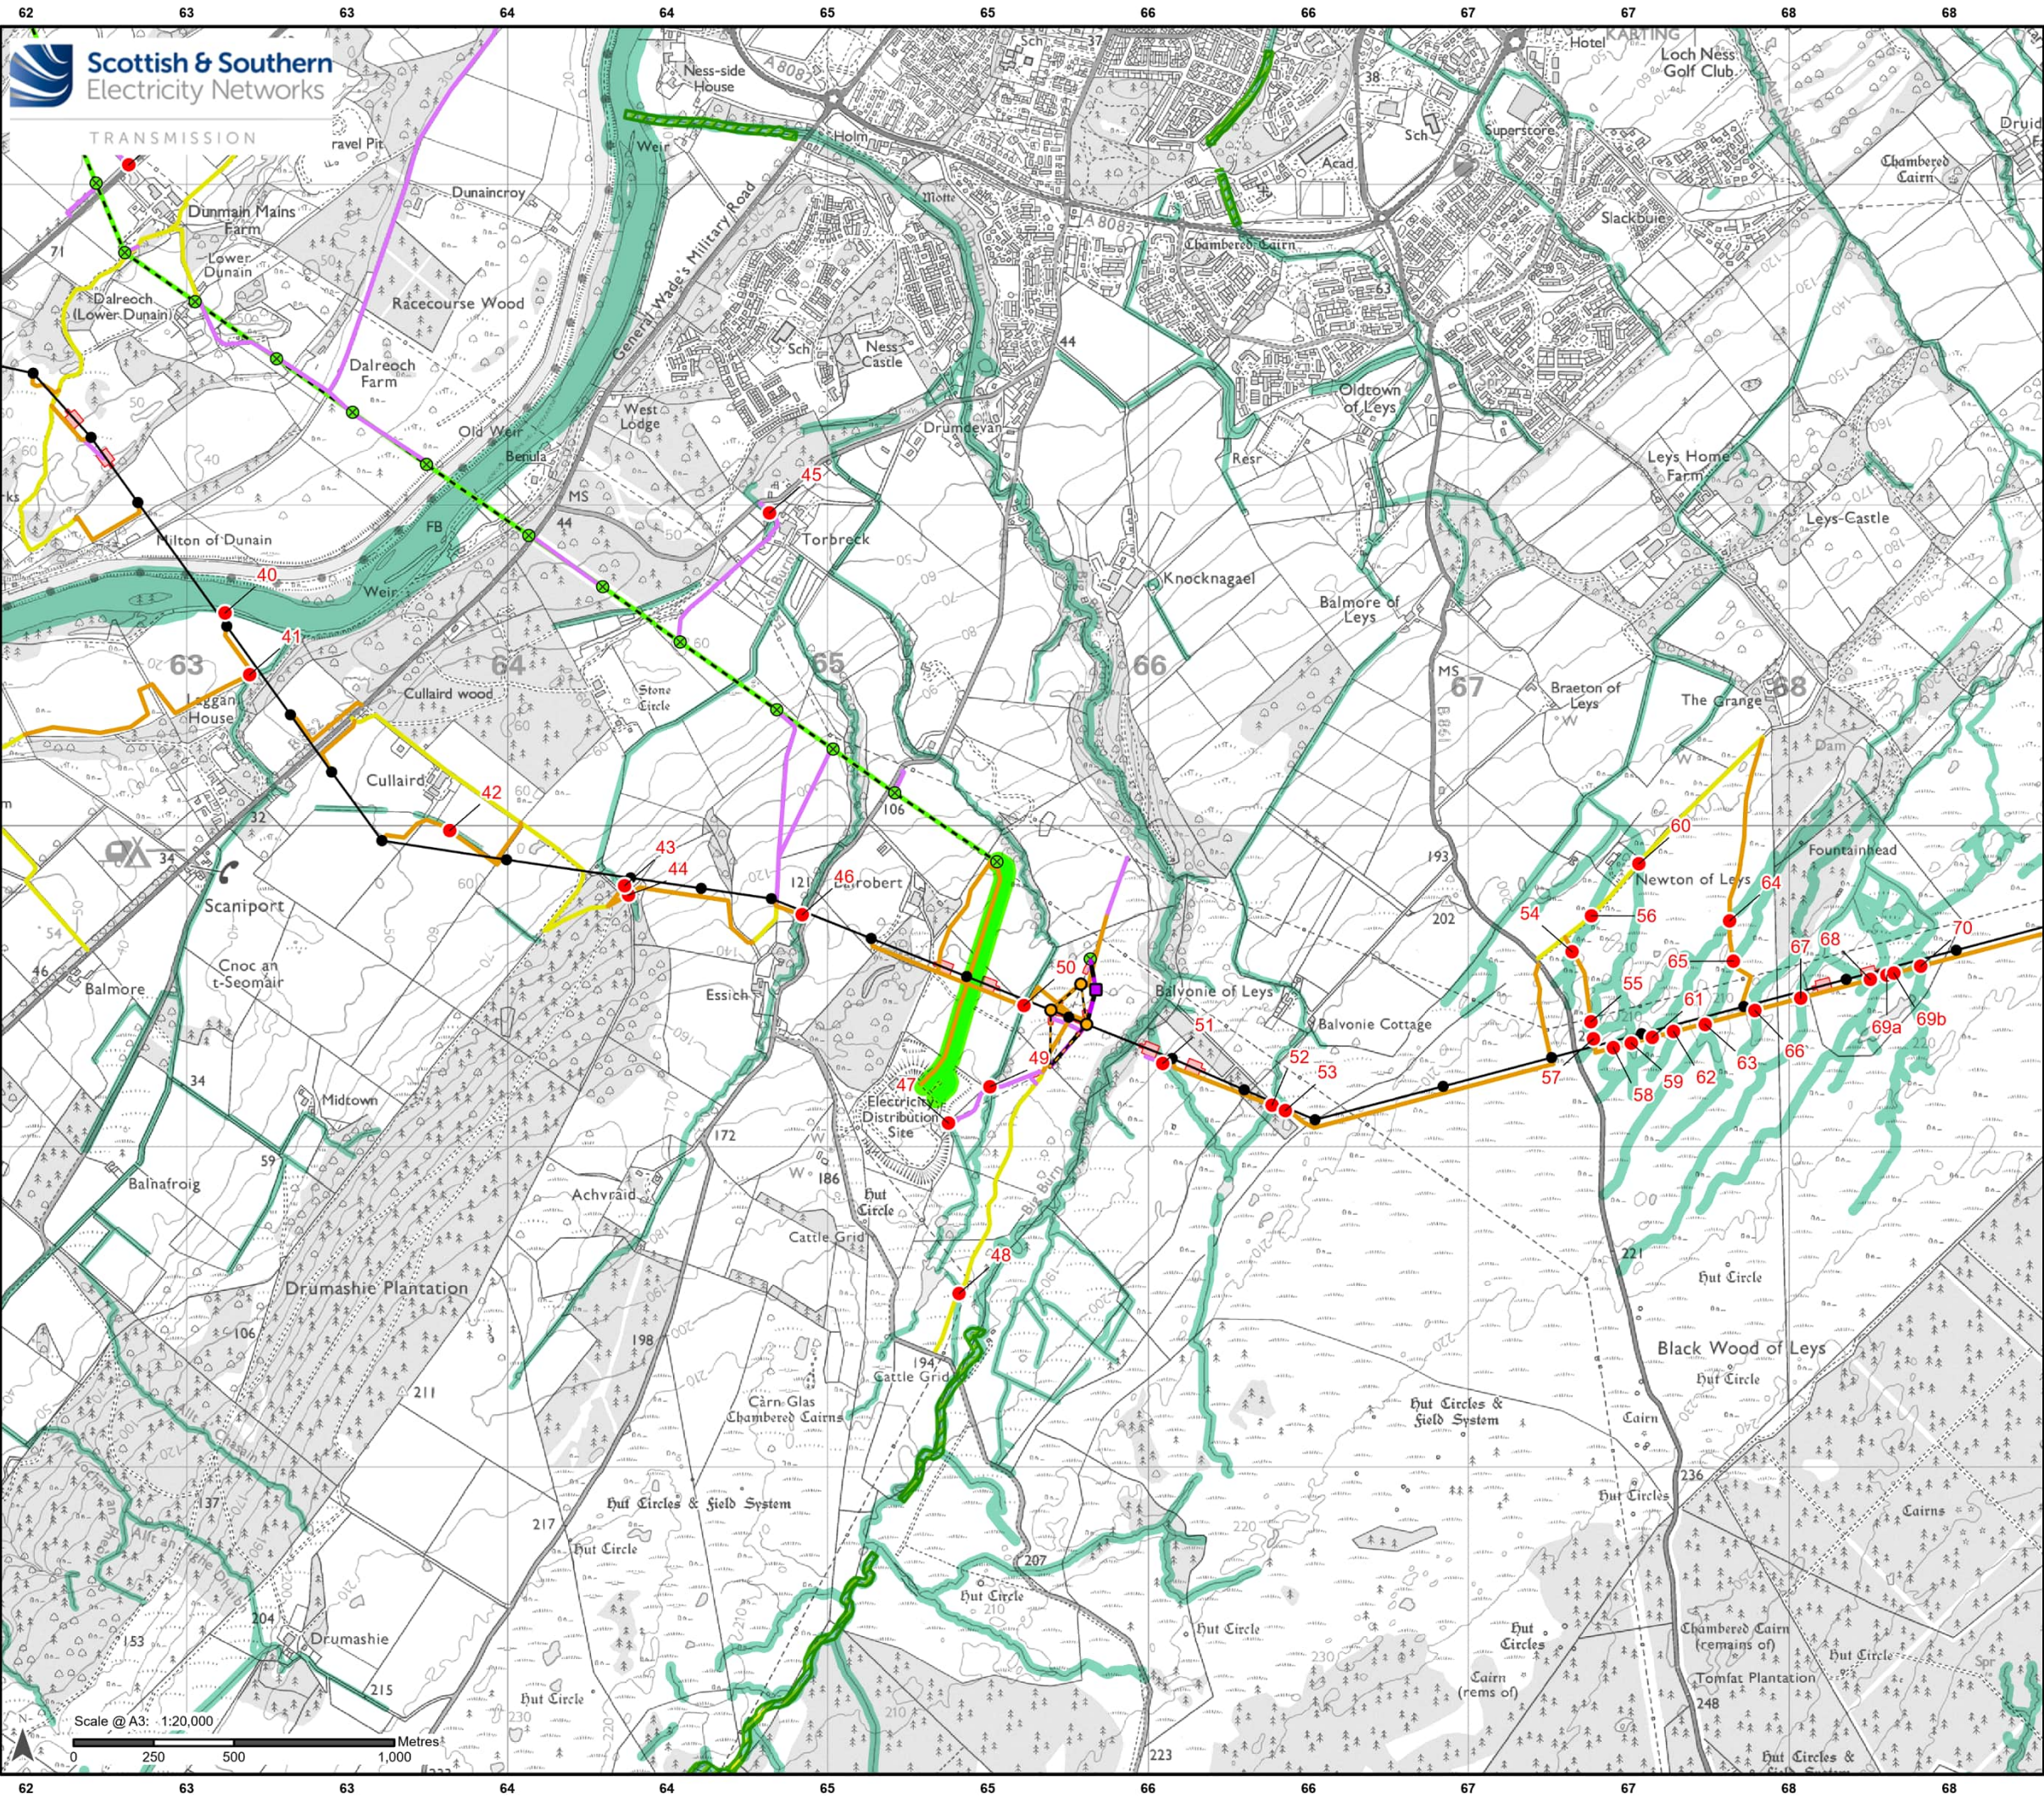

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL
- Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Cable to be Removed
- Existing Access Upgrade
- Proposed Access - ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

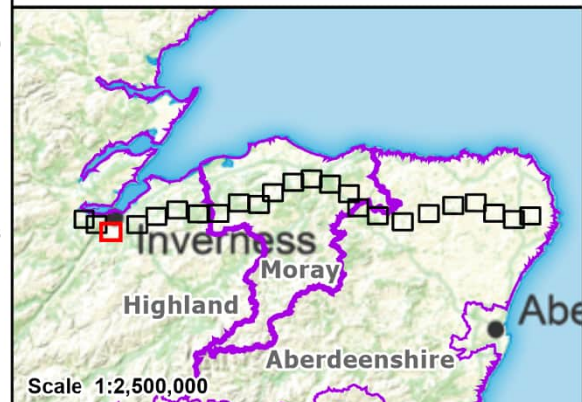


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 3 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

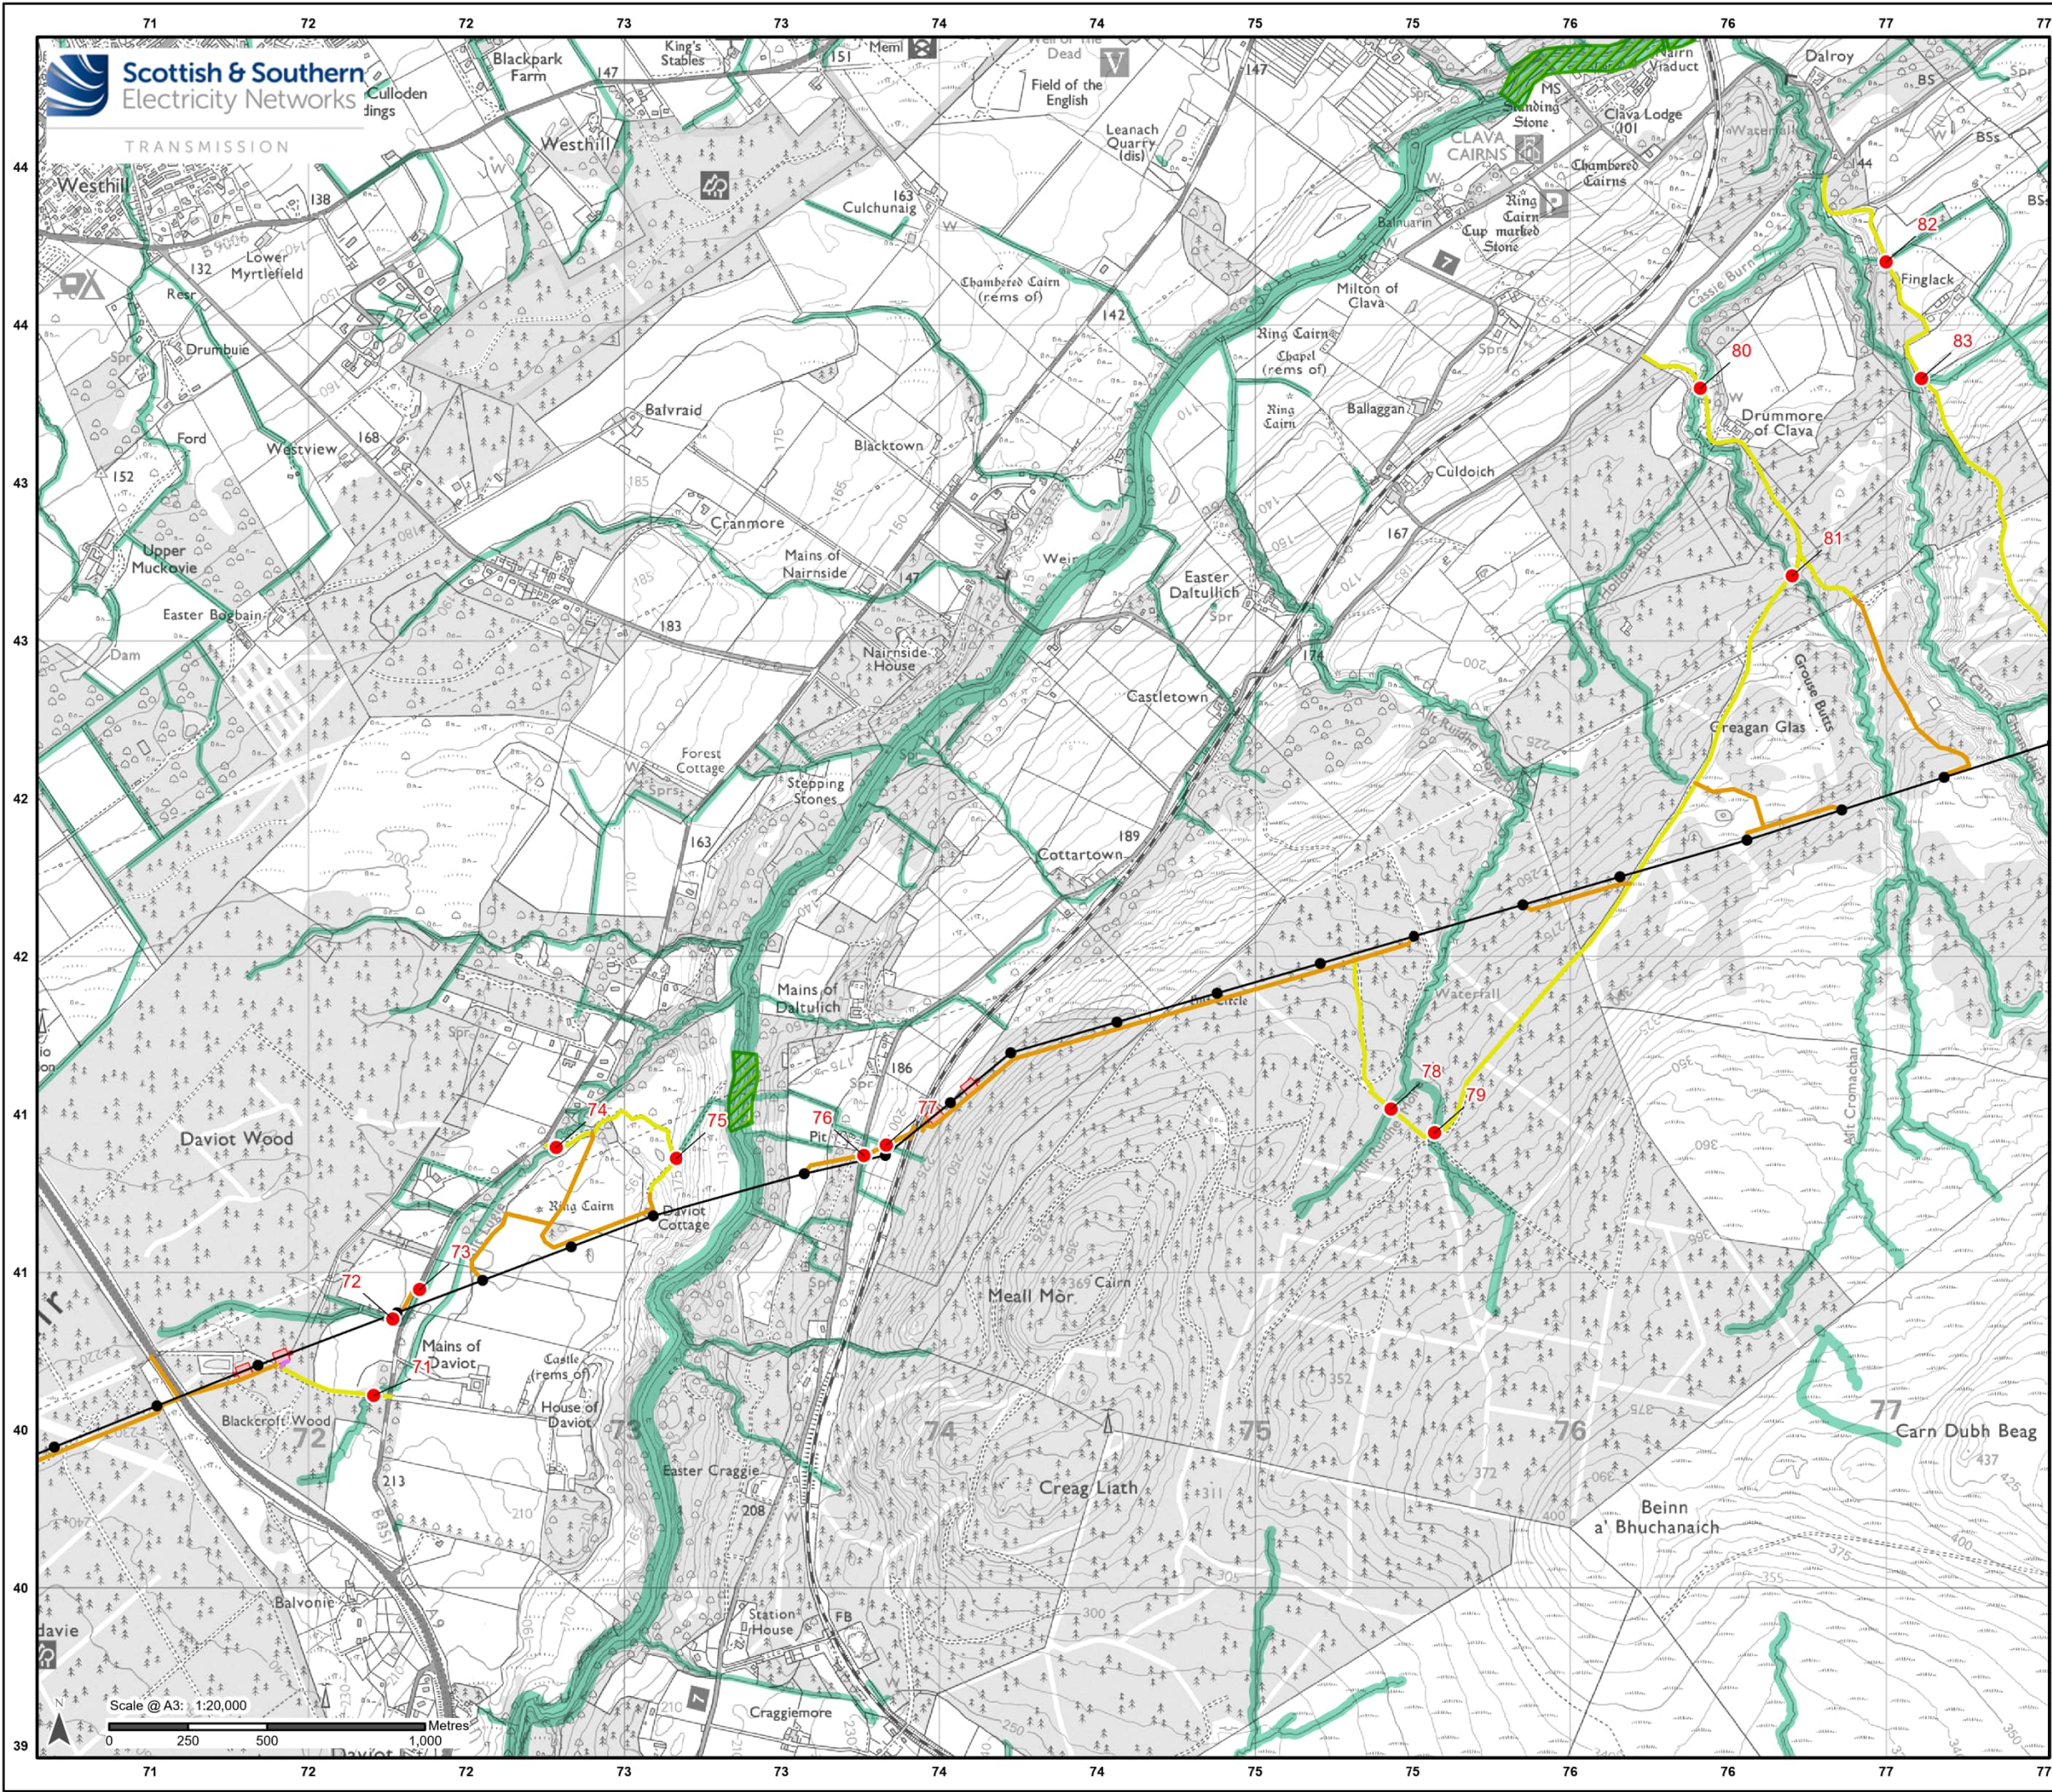

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/ Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

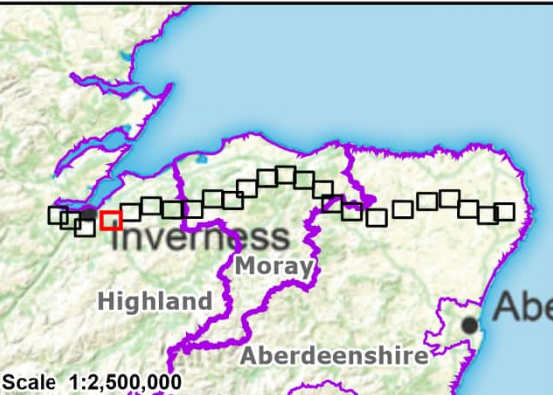


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauty to Blackhilllock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 4 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

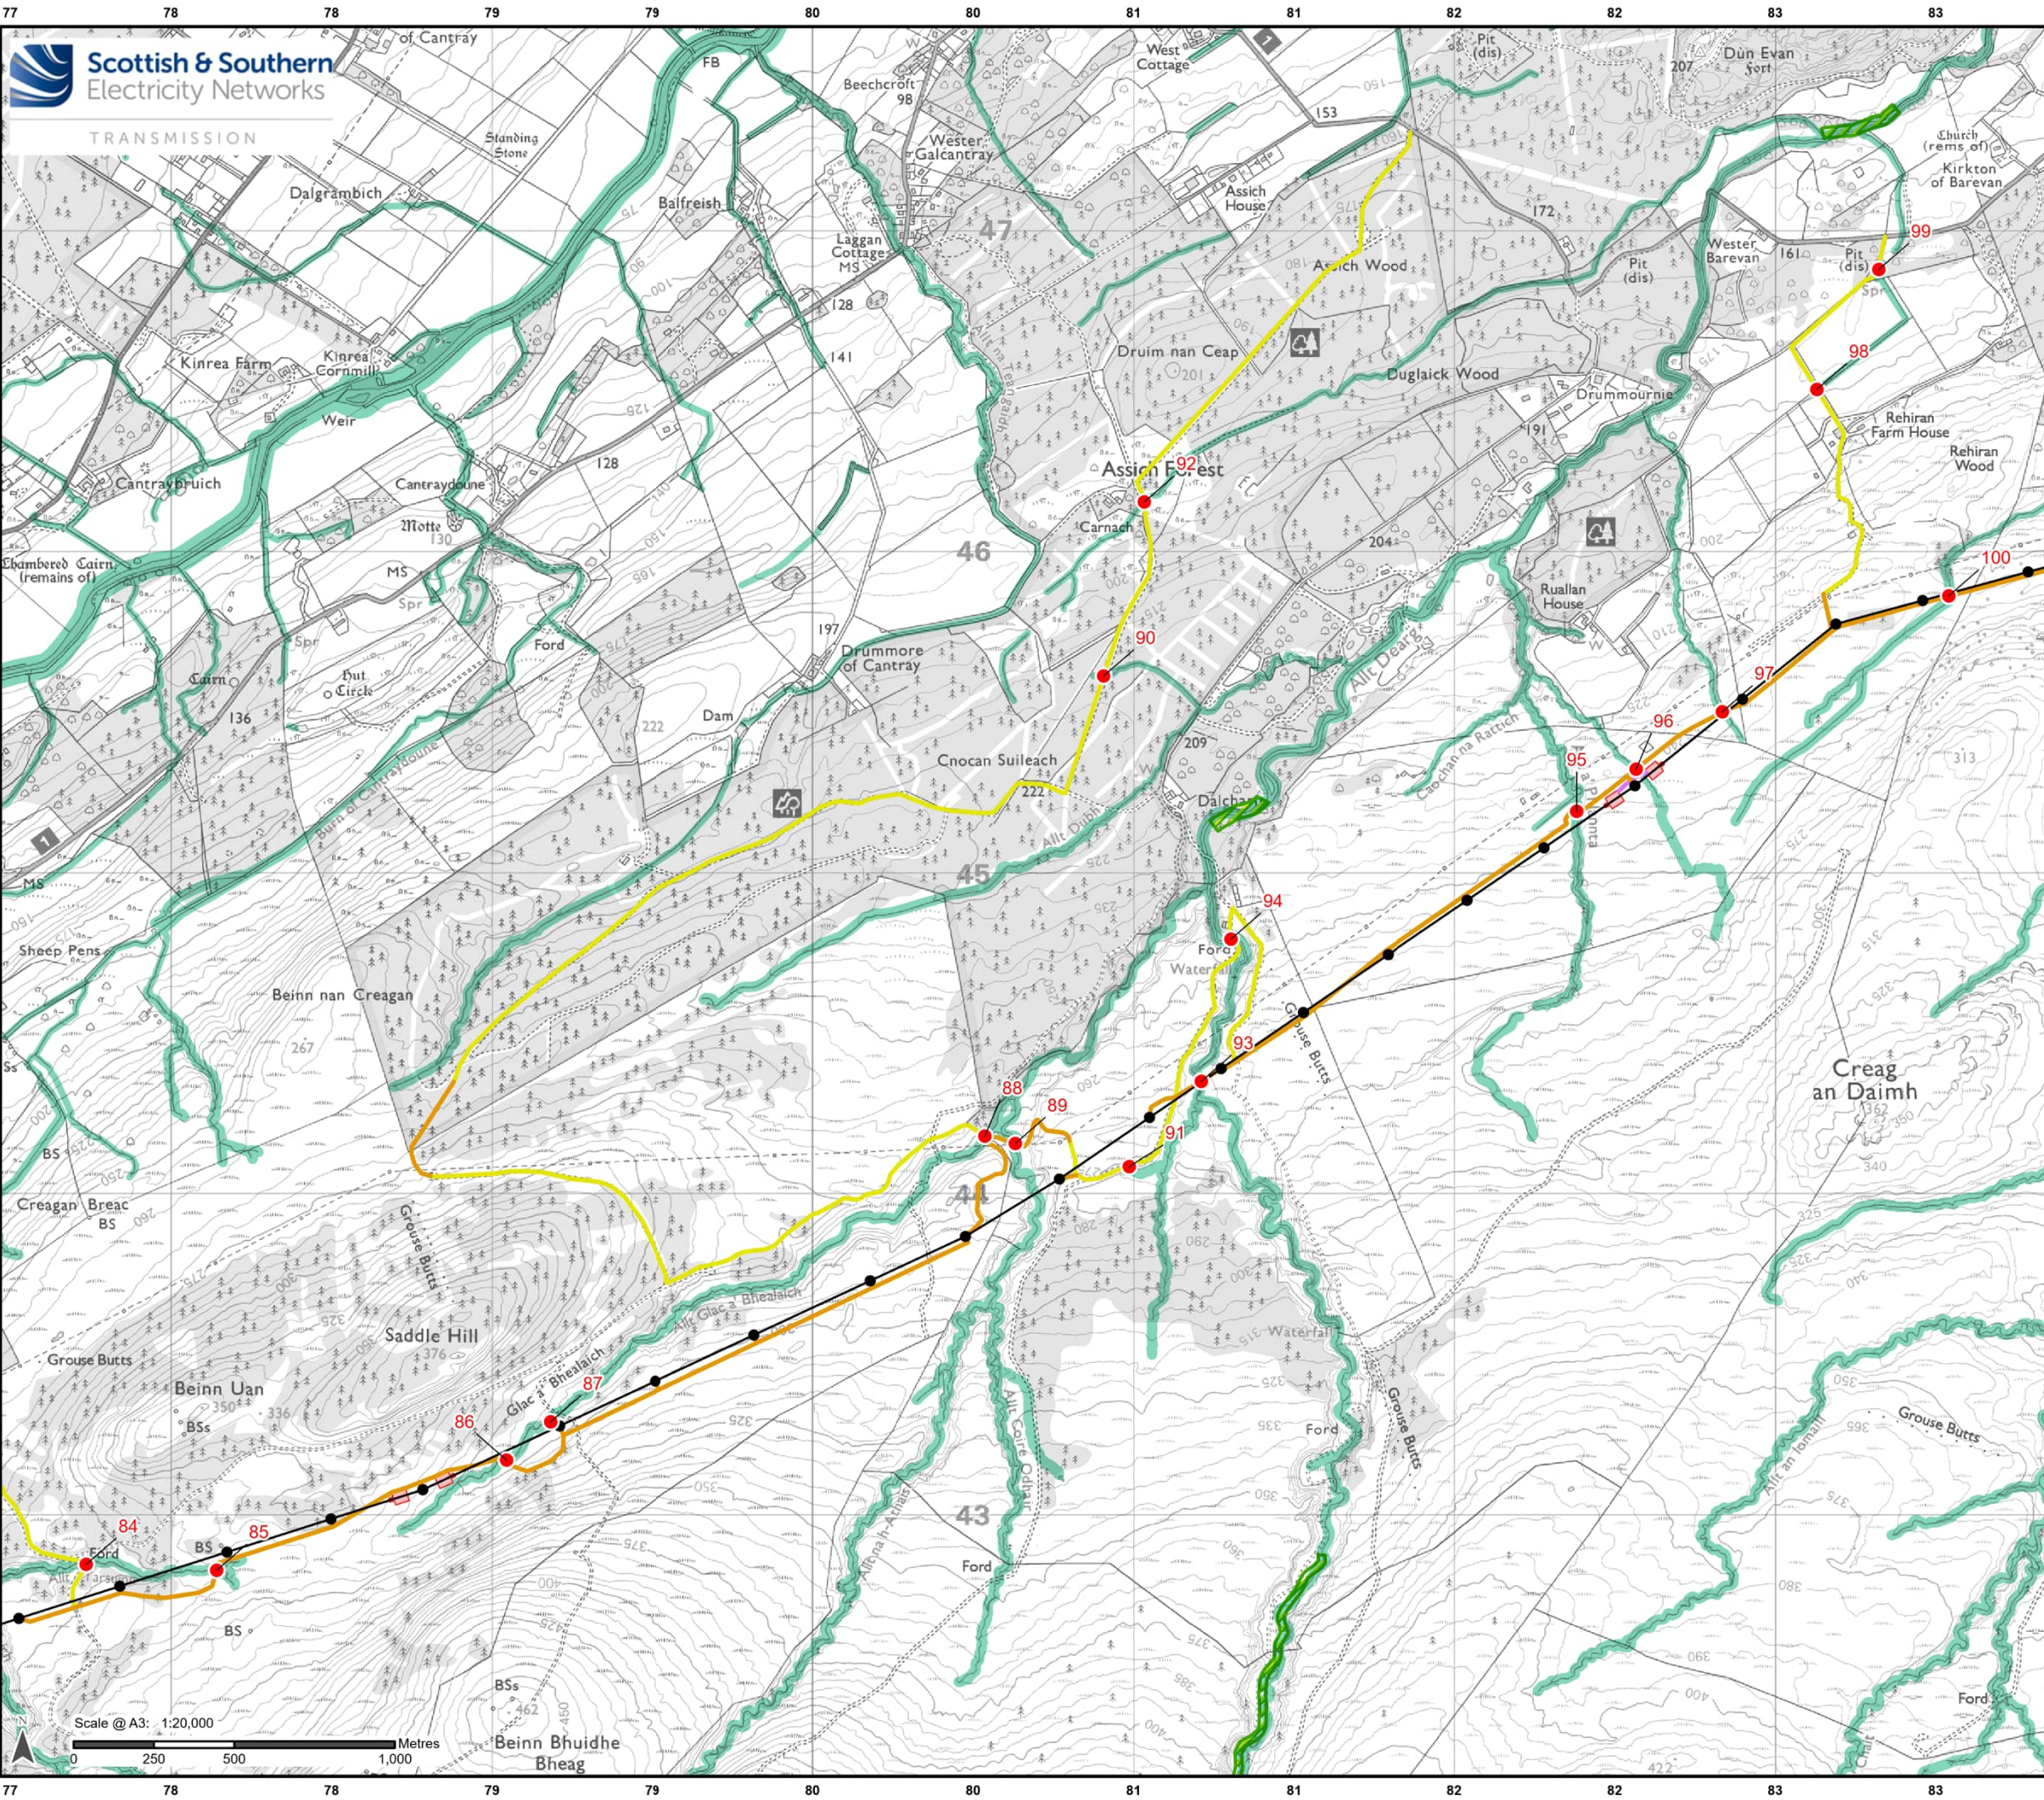

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 5 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

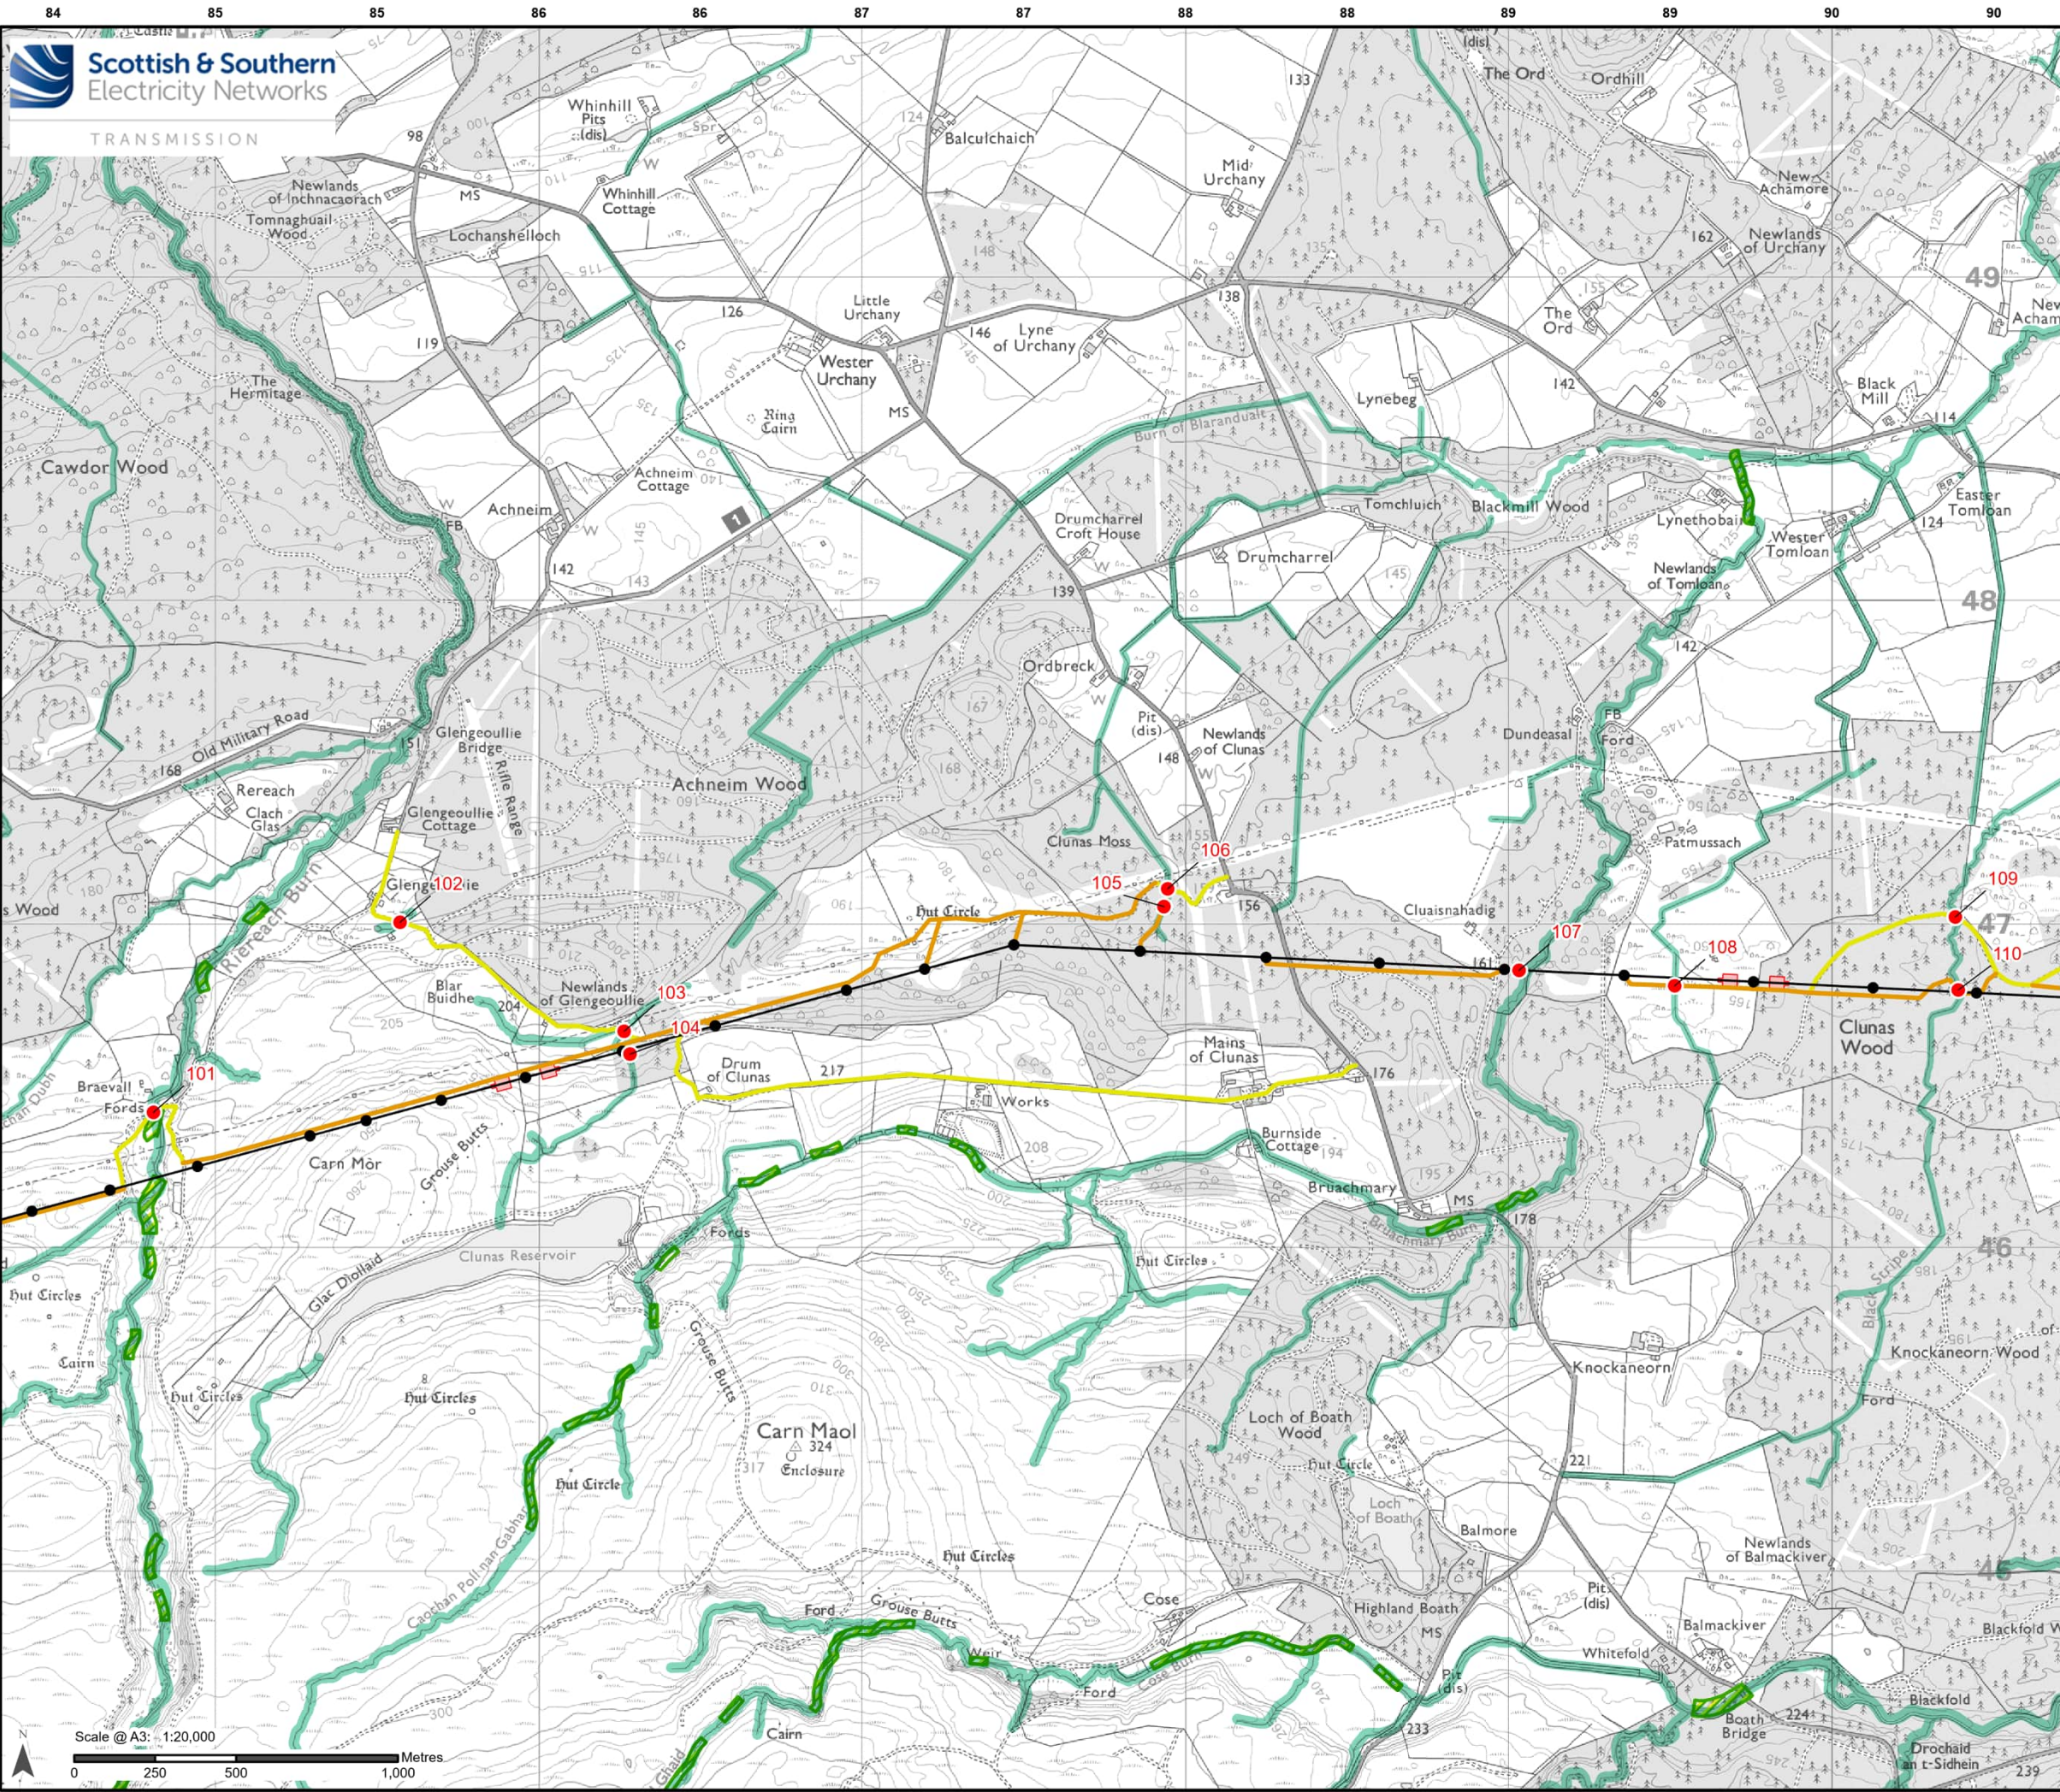

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

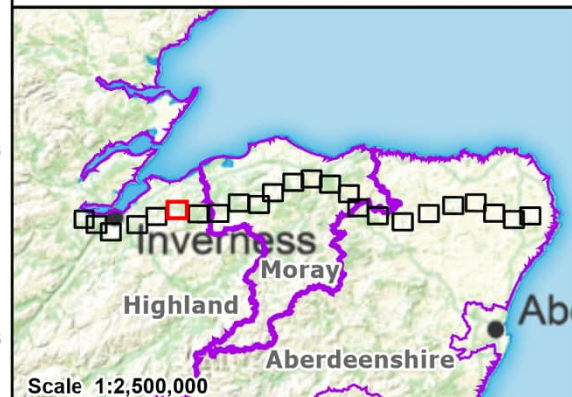


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauty to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 6 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

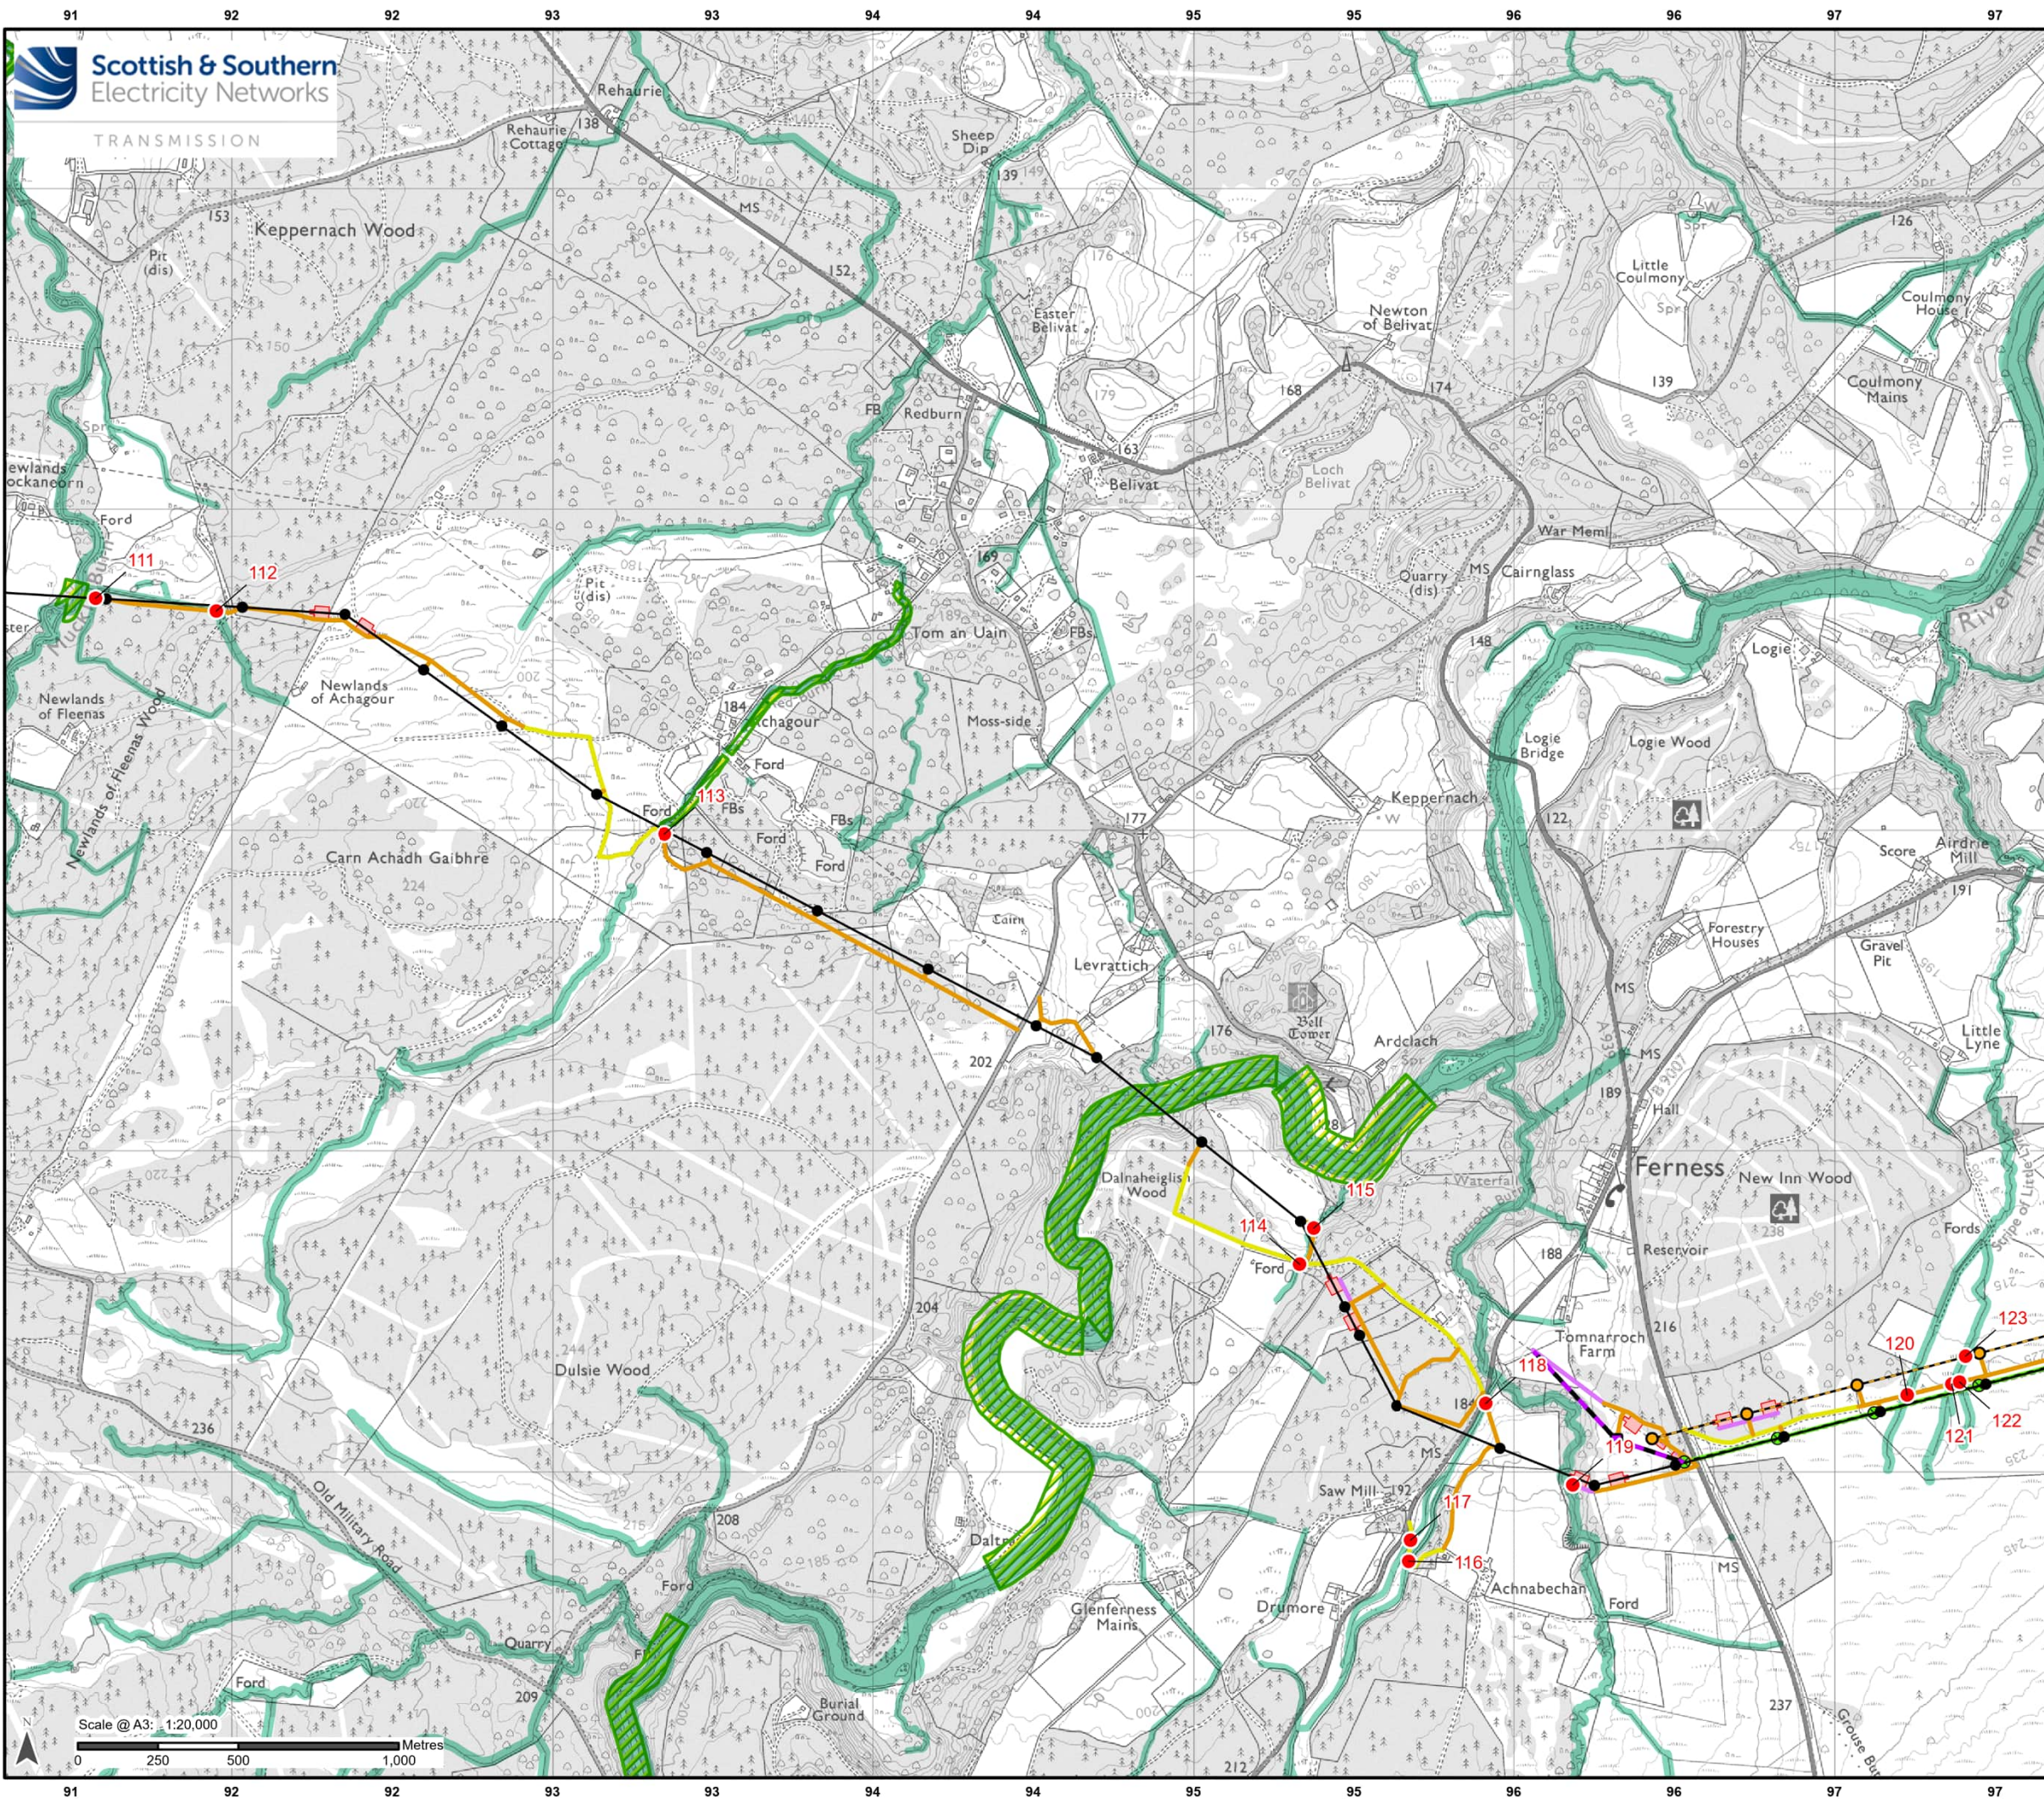

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL
- Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Existing Access Upgrade
- Proposed Access - ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

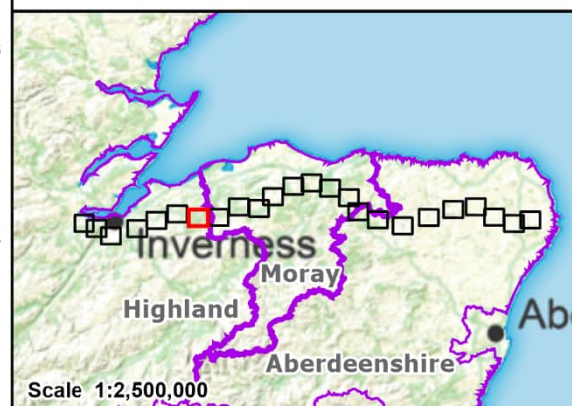


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 7 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

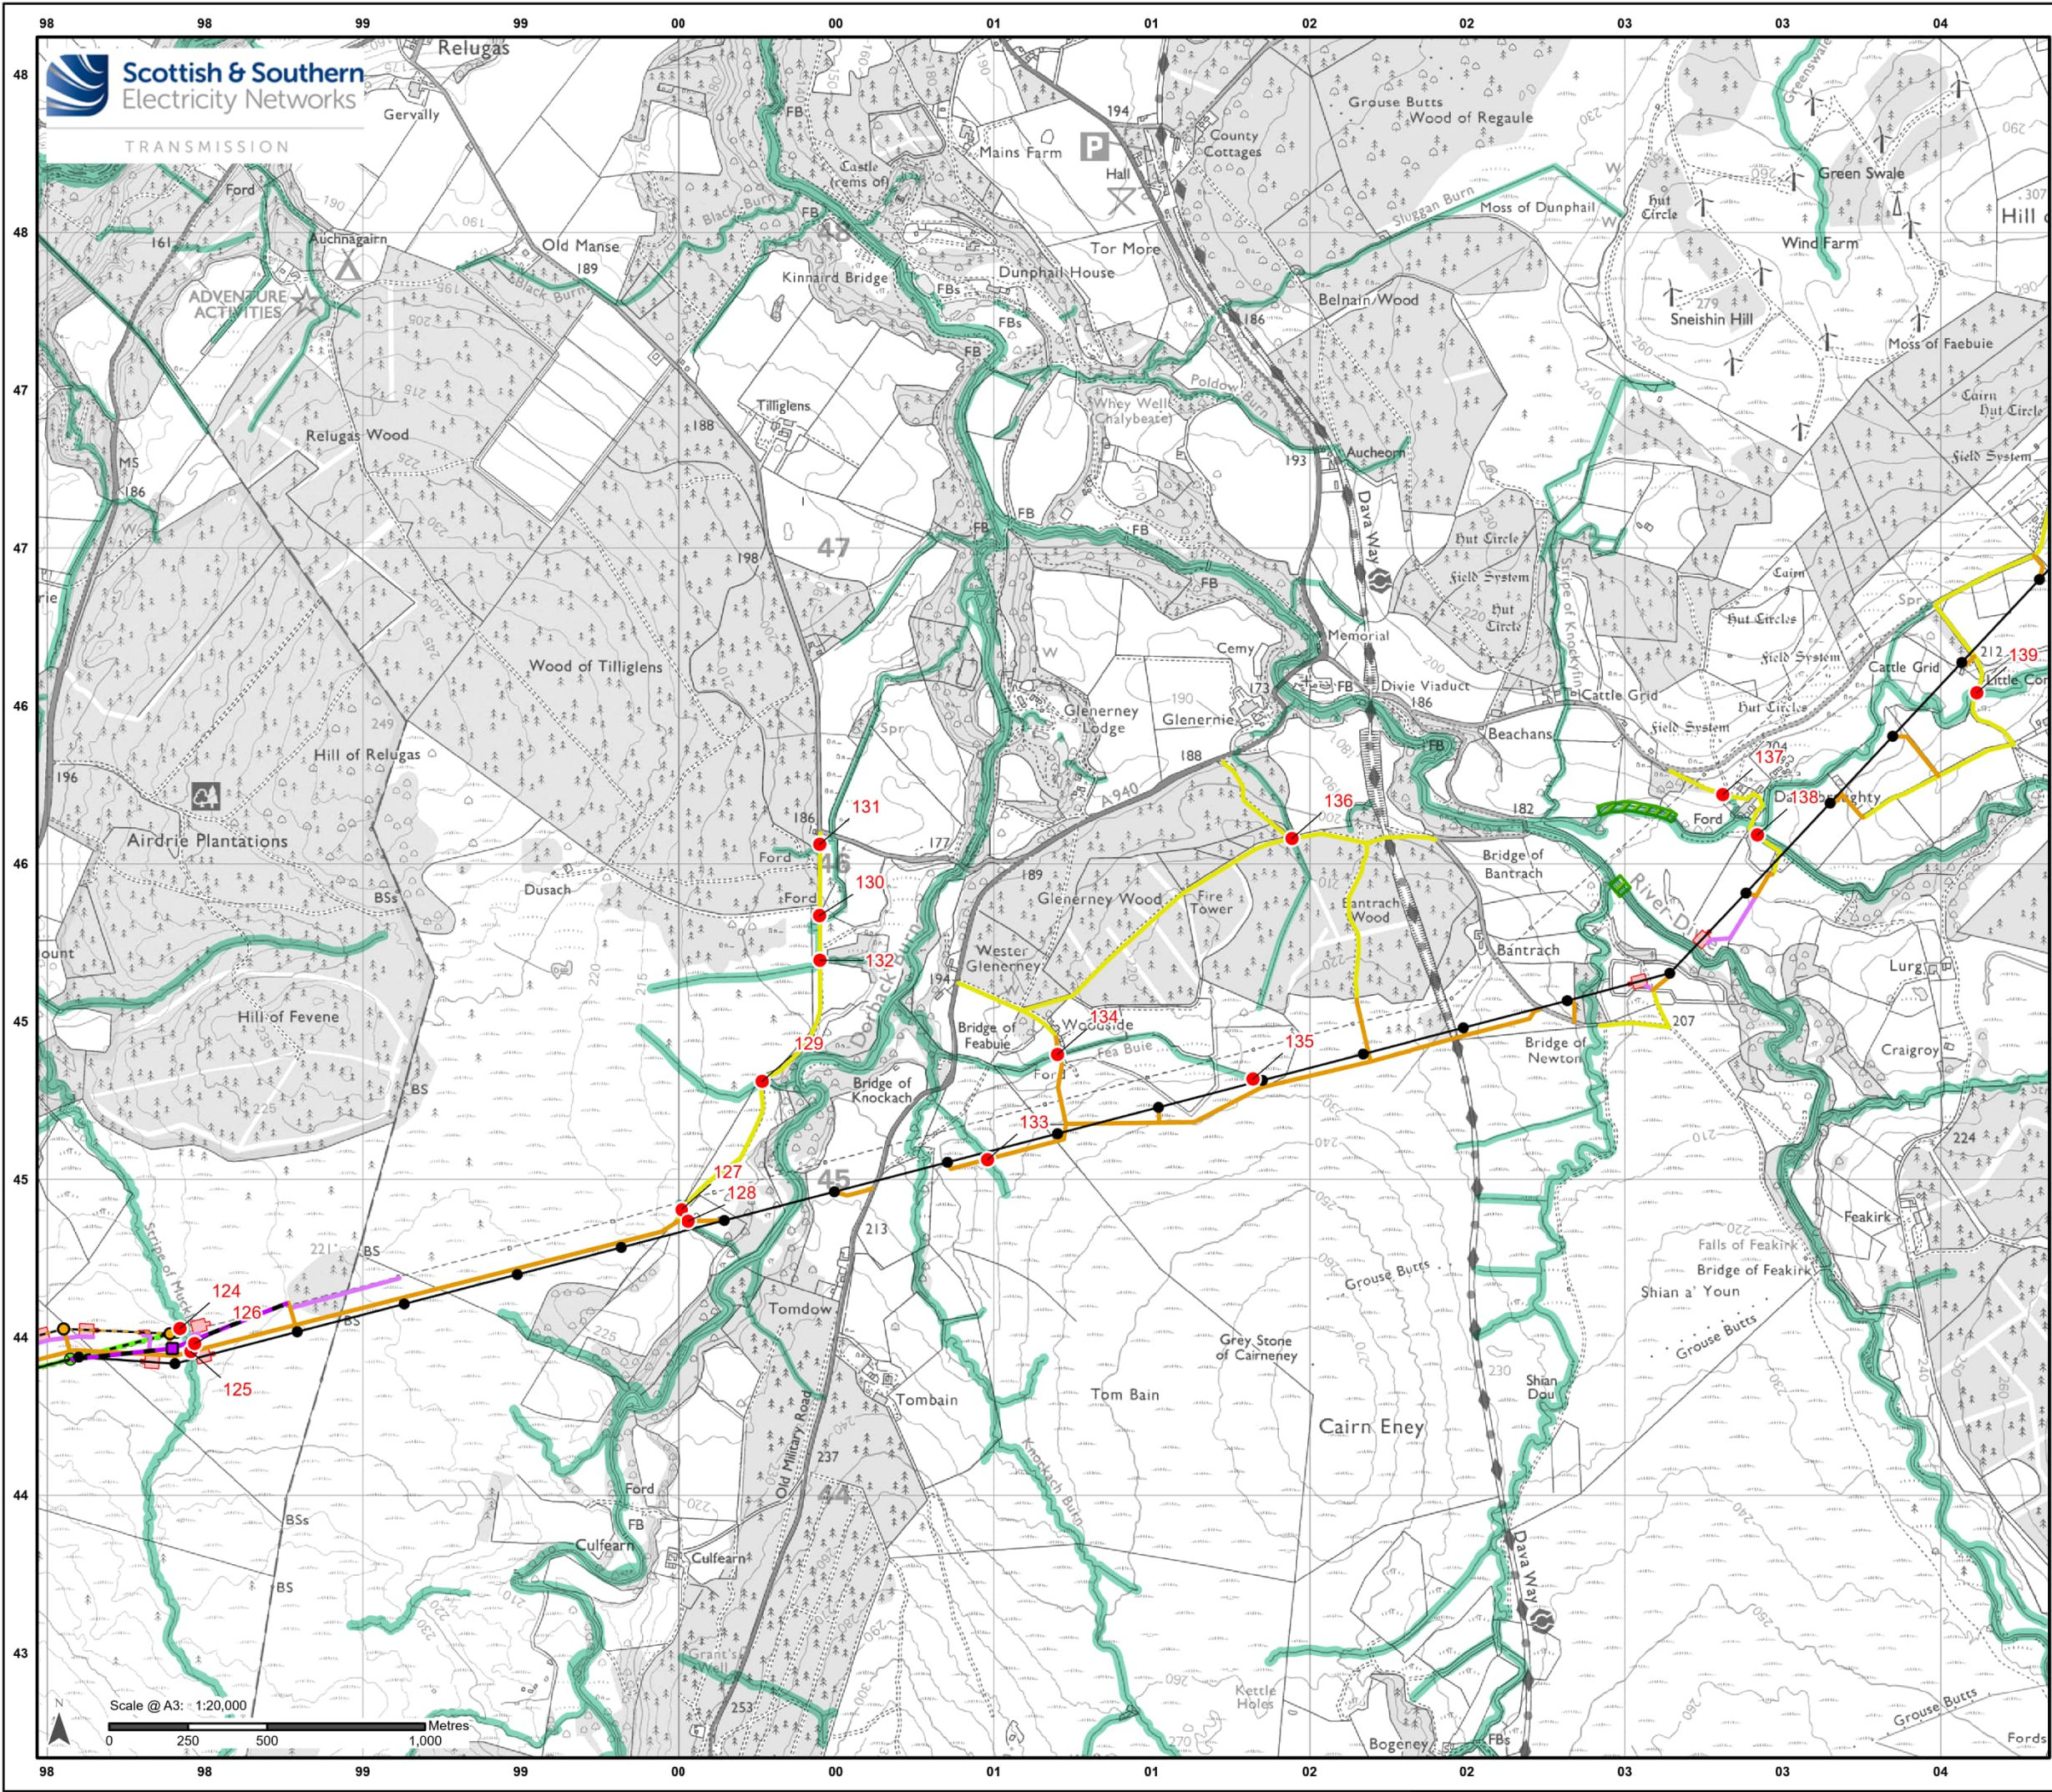

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL
- Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary

Ancillary Development

- Tower to be Removed
- OHL to be Removed
- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SEEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 8 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184