


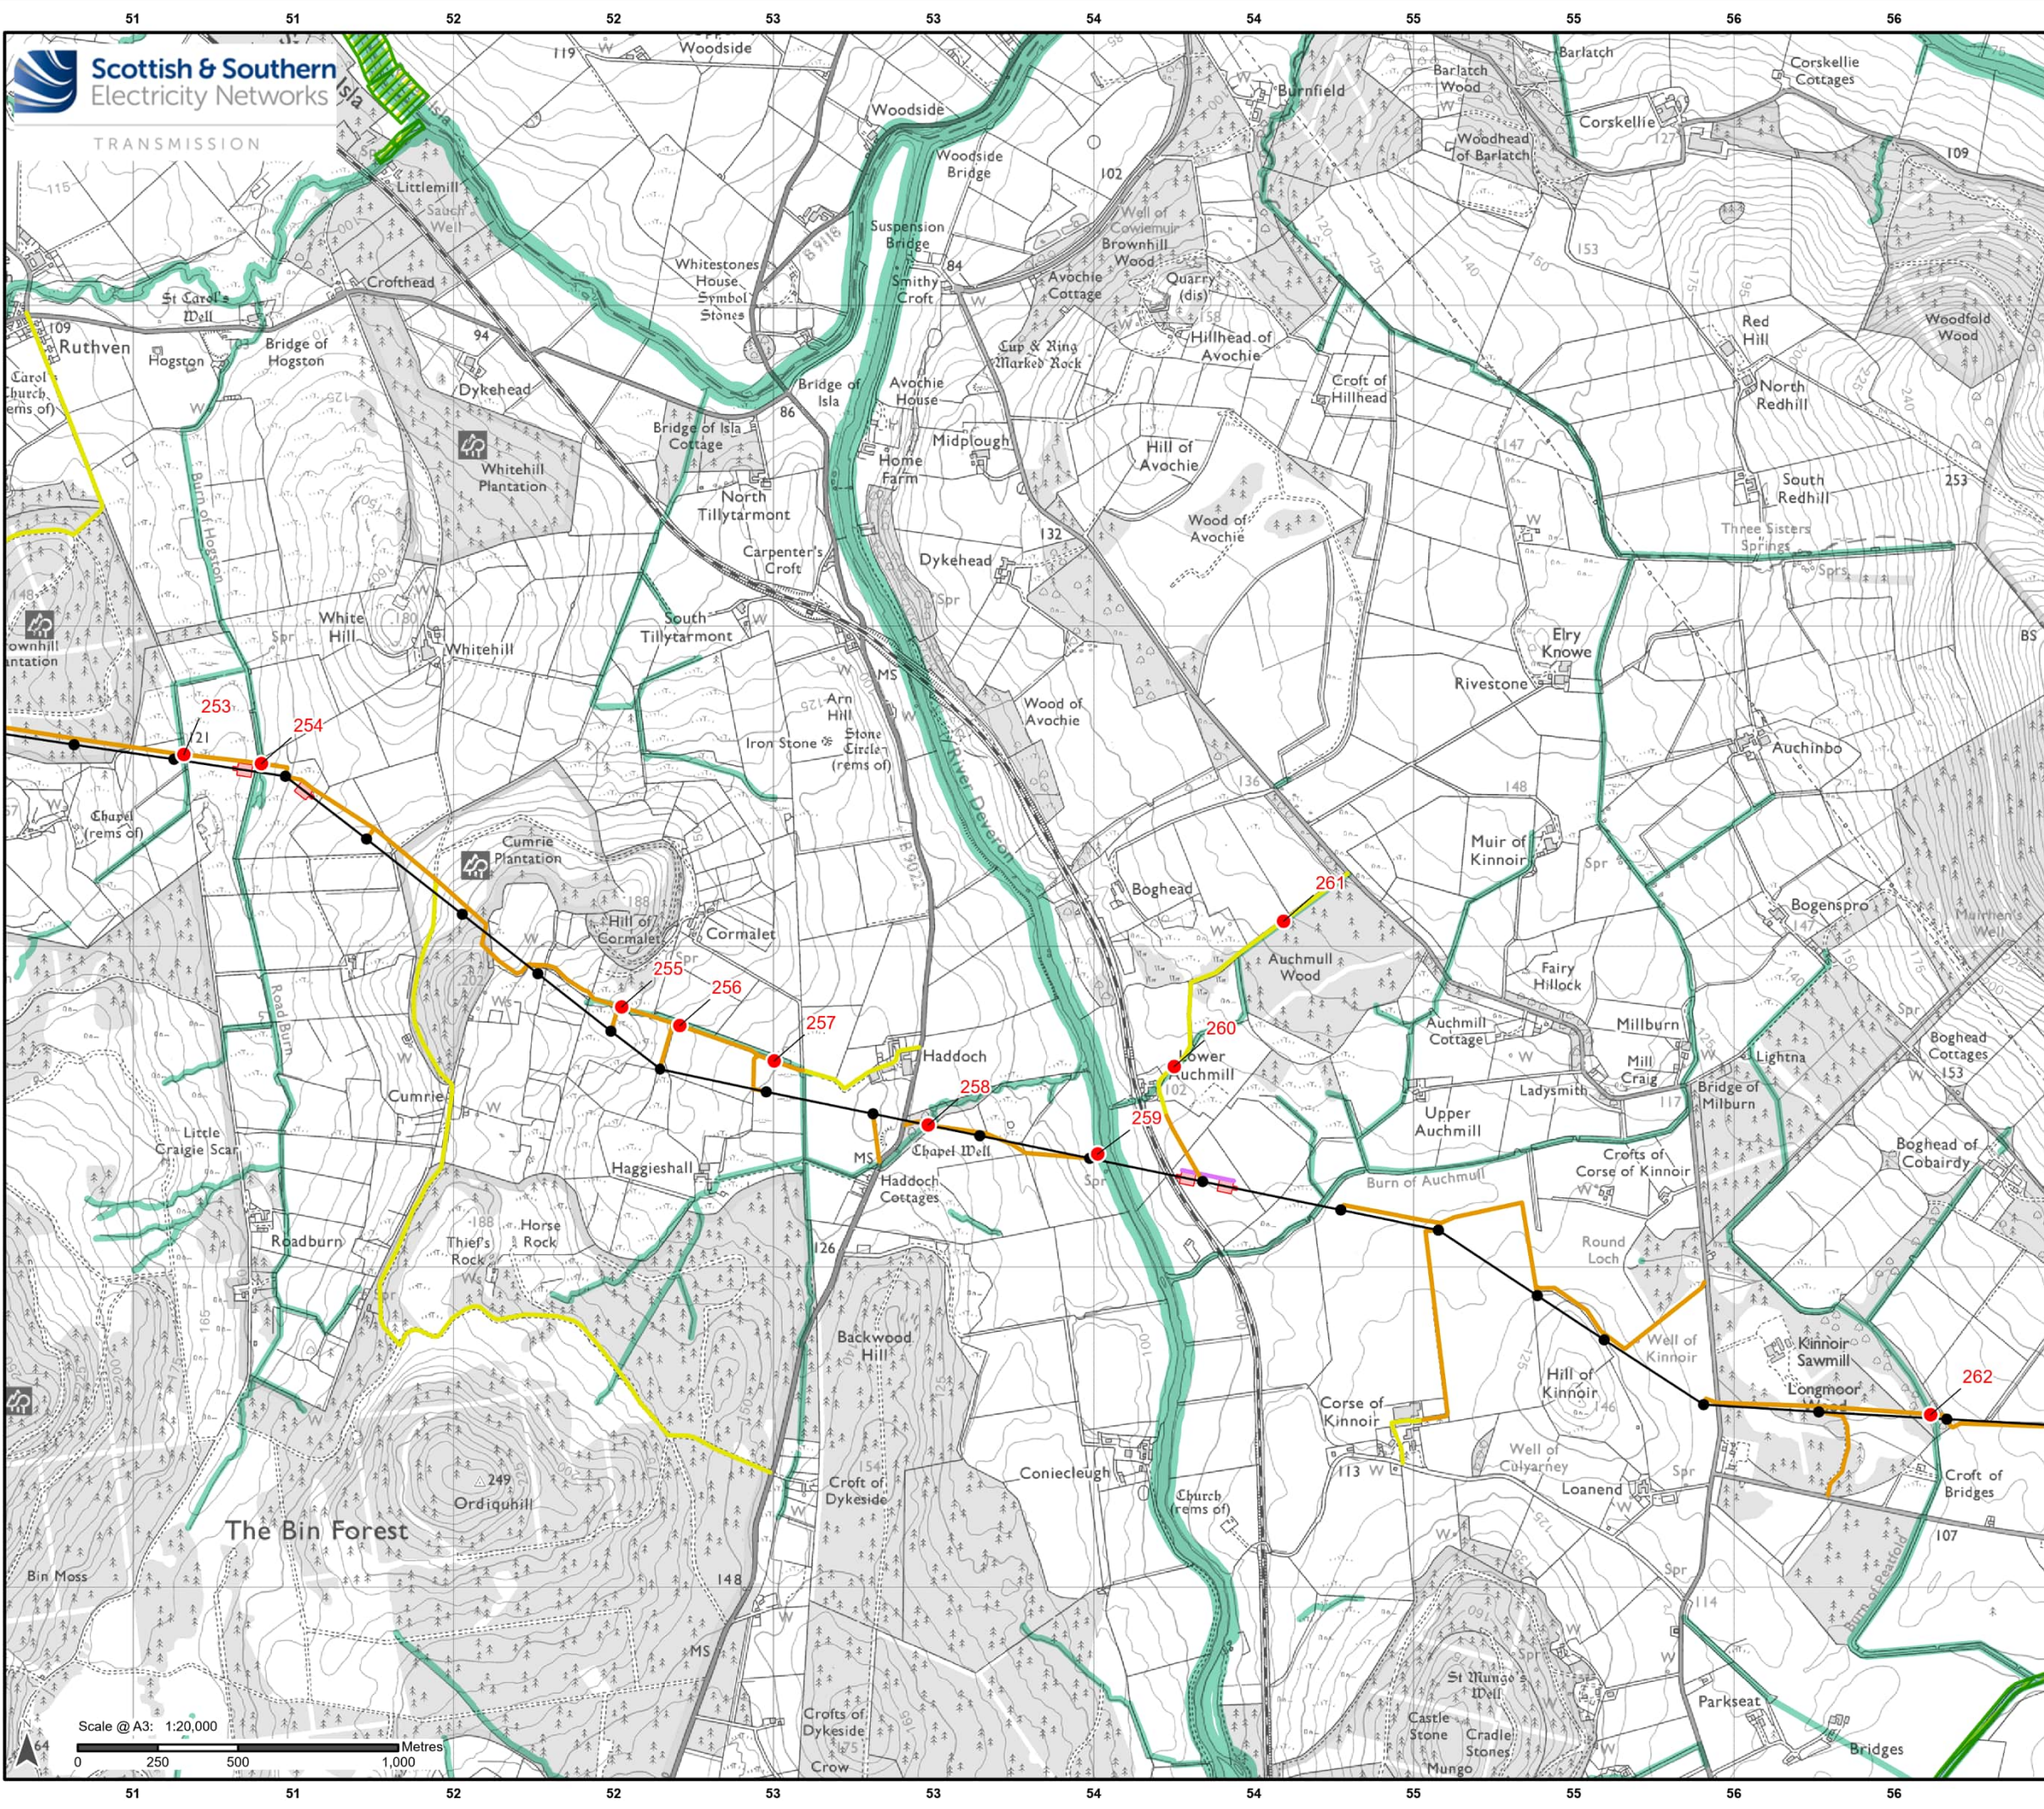

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 17 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

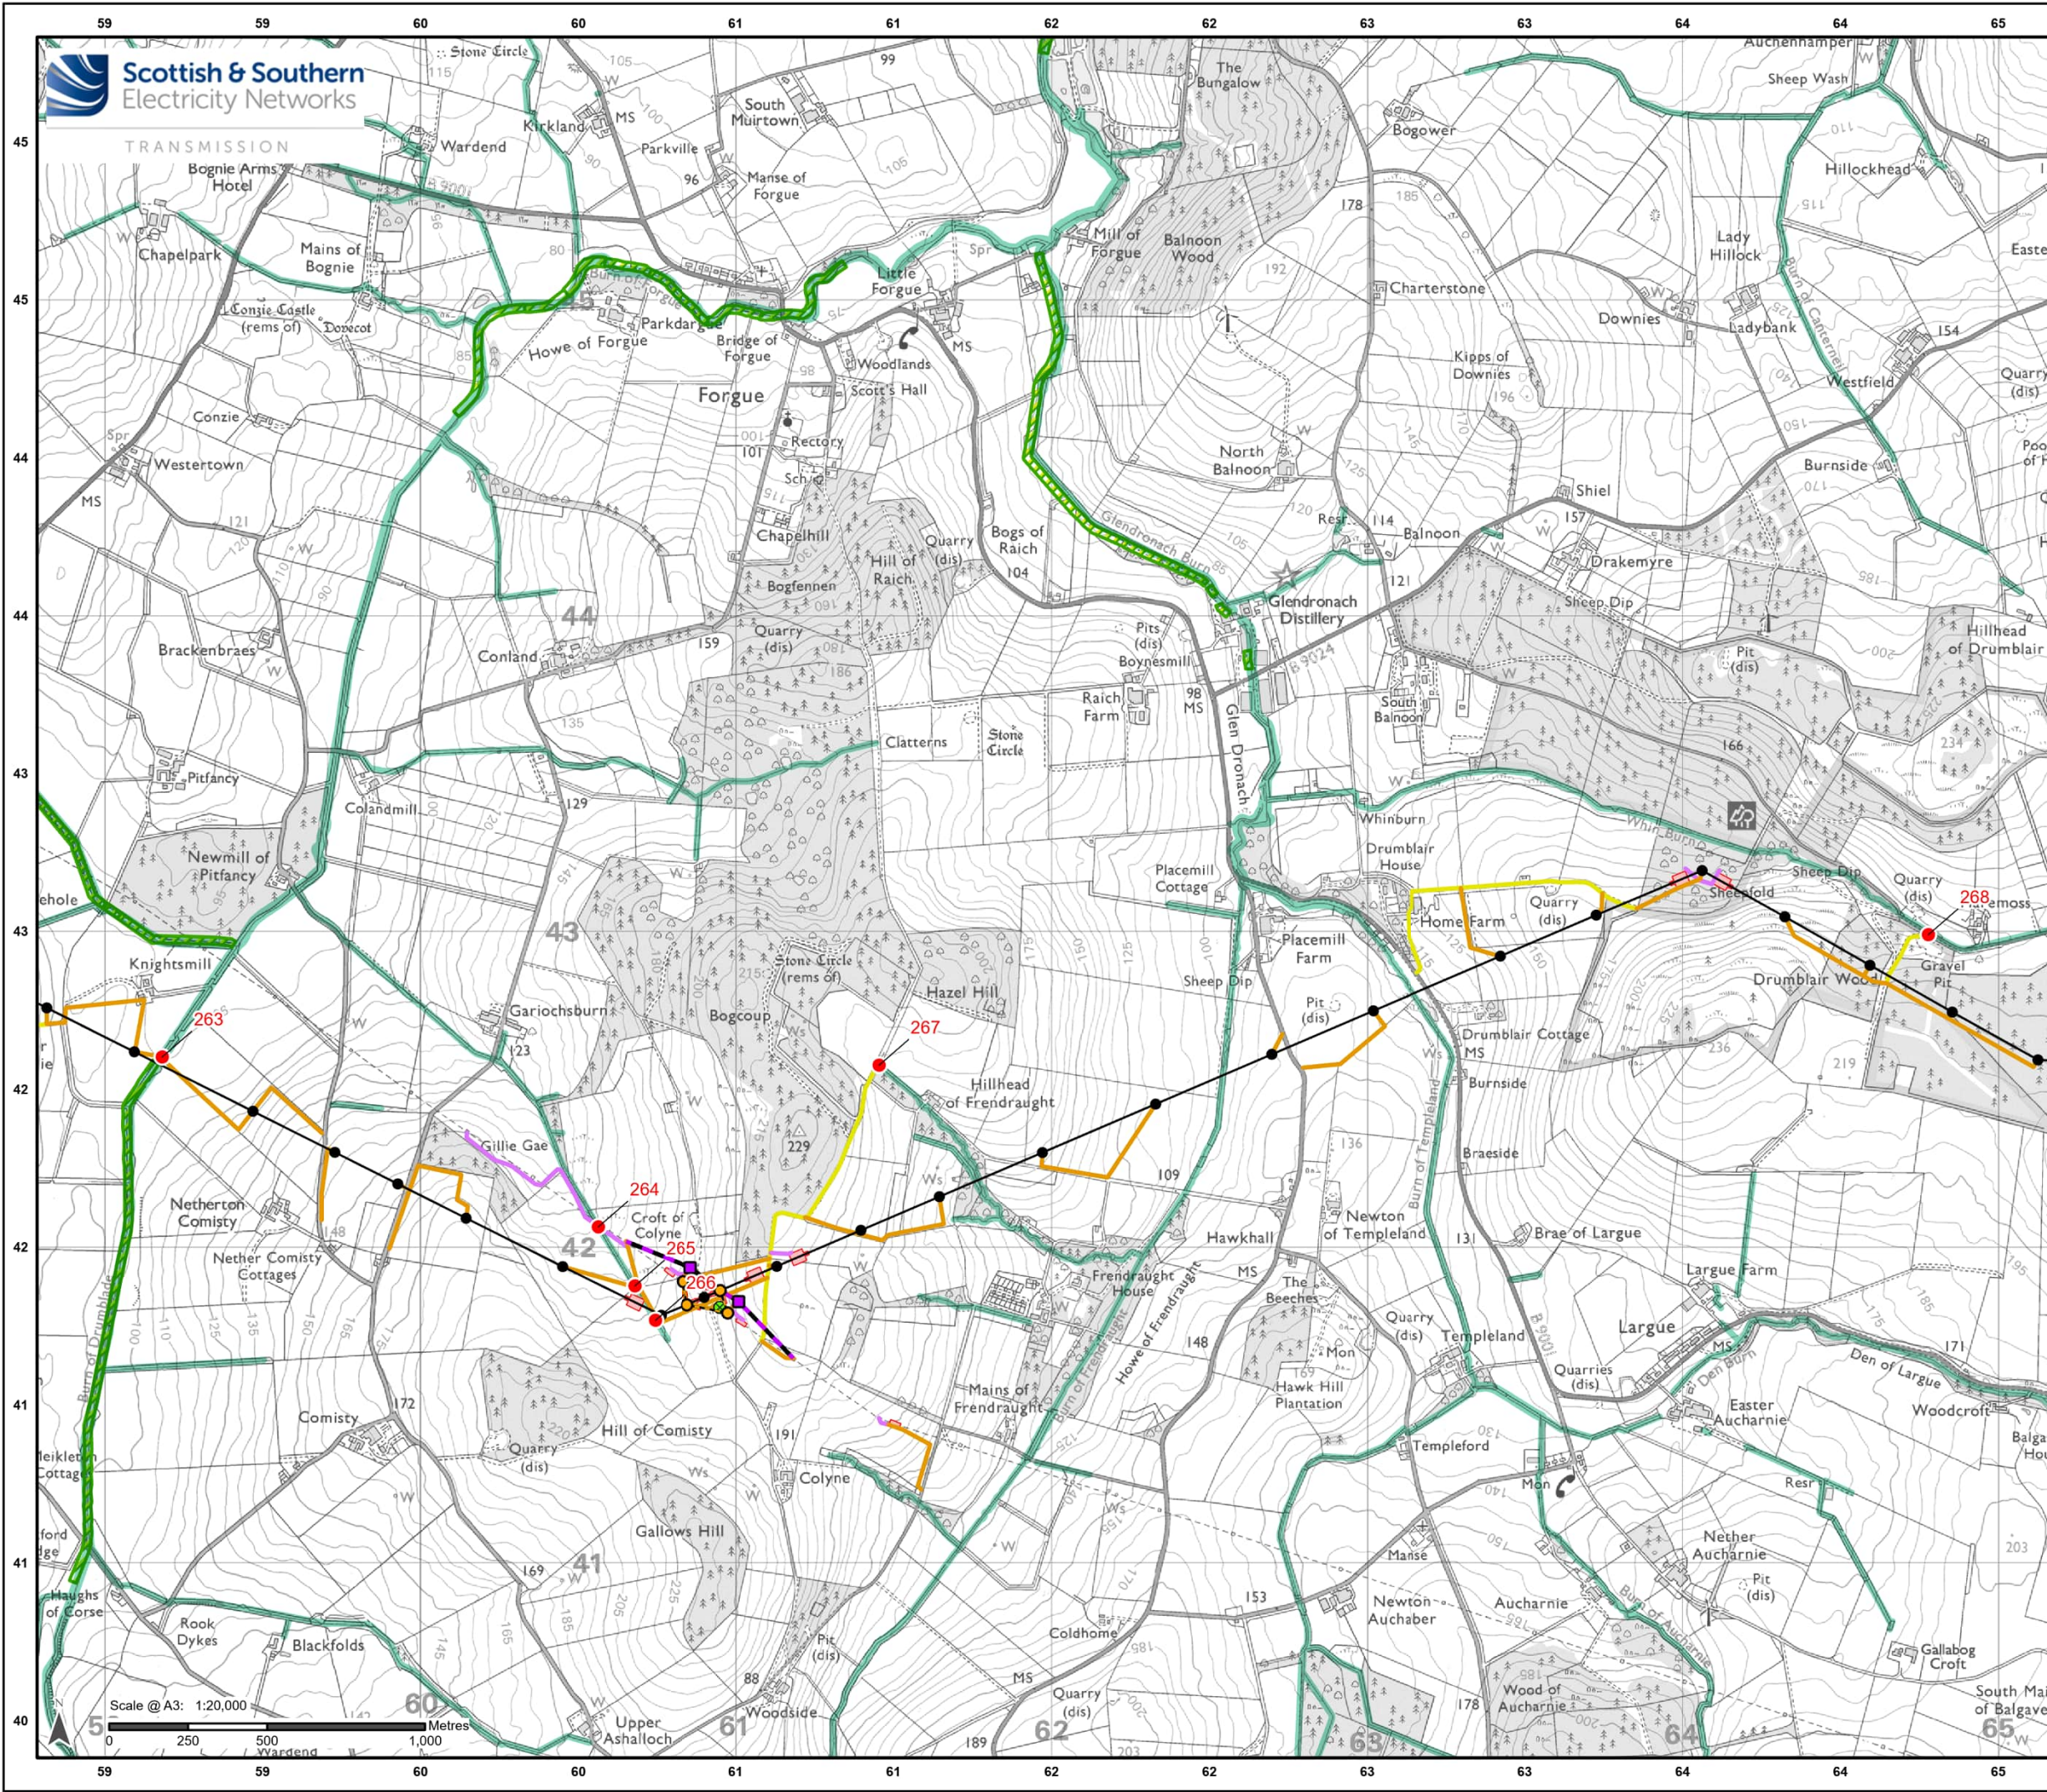

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL
- Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary

Ancillary Development

- Tower to be Removed
- Existing Access Upgrade
- Proposed Access - ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

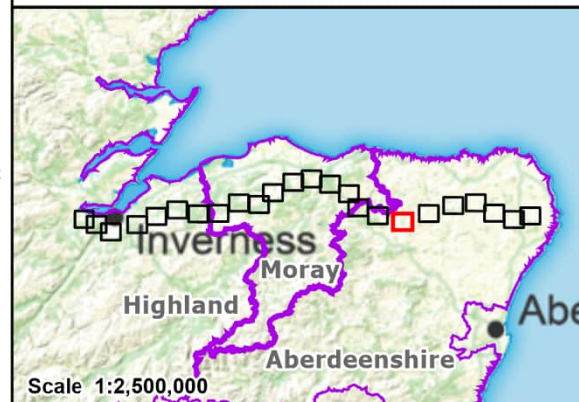


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SEEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 18 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

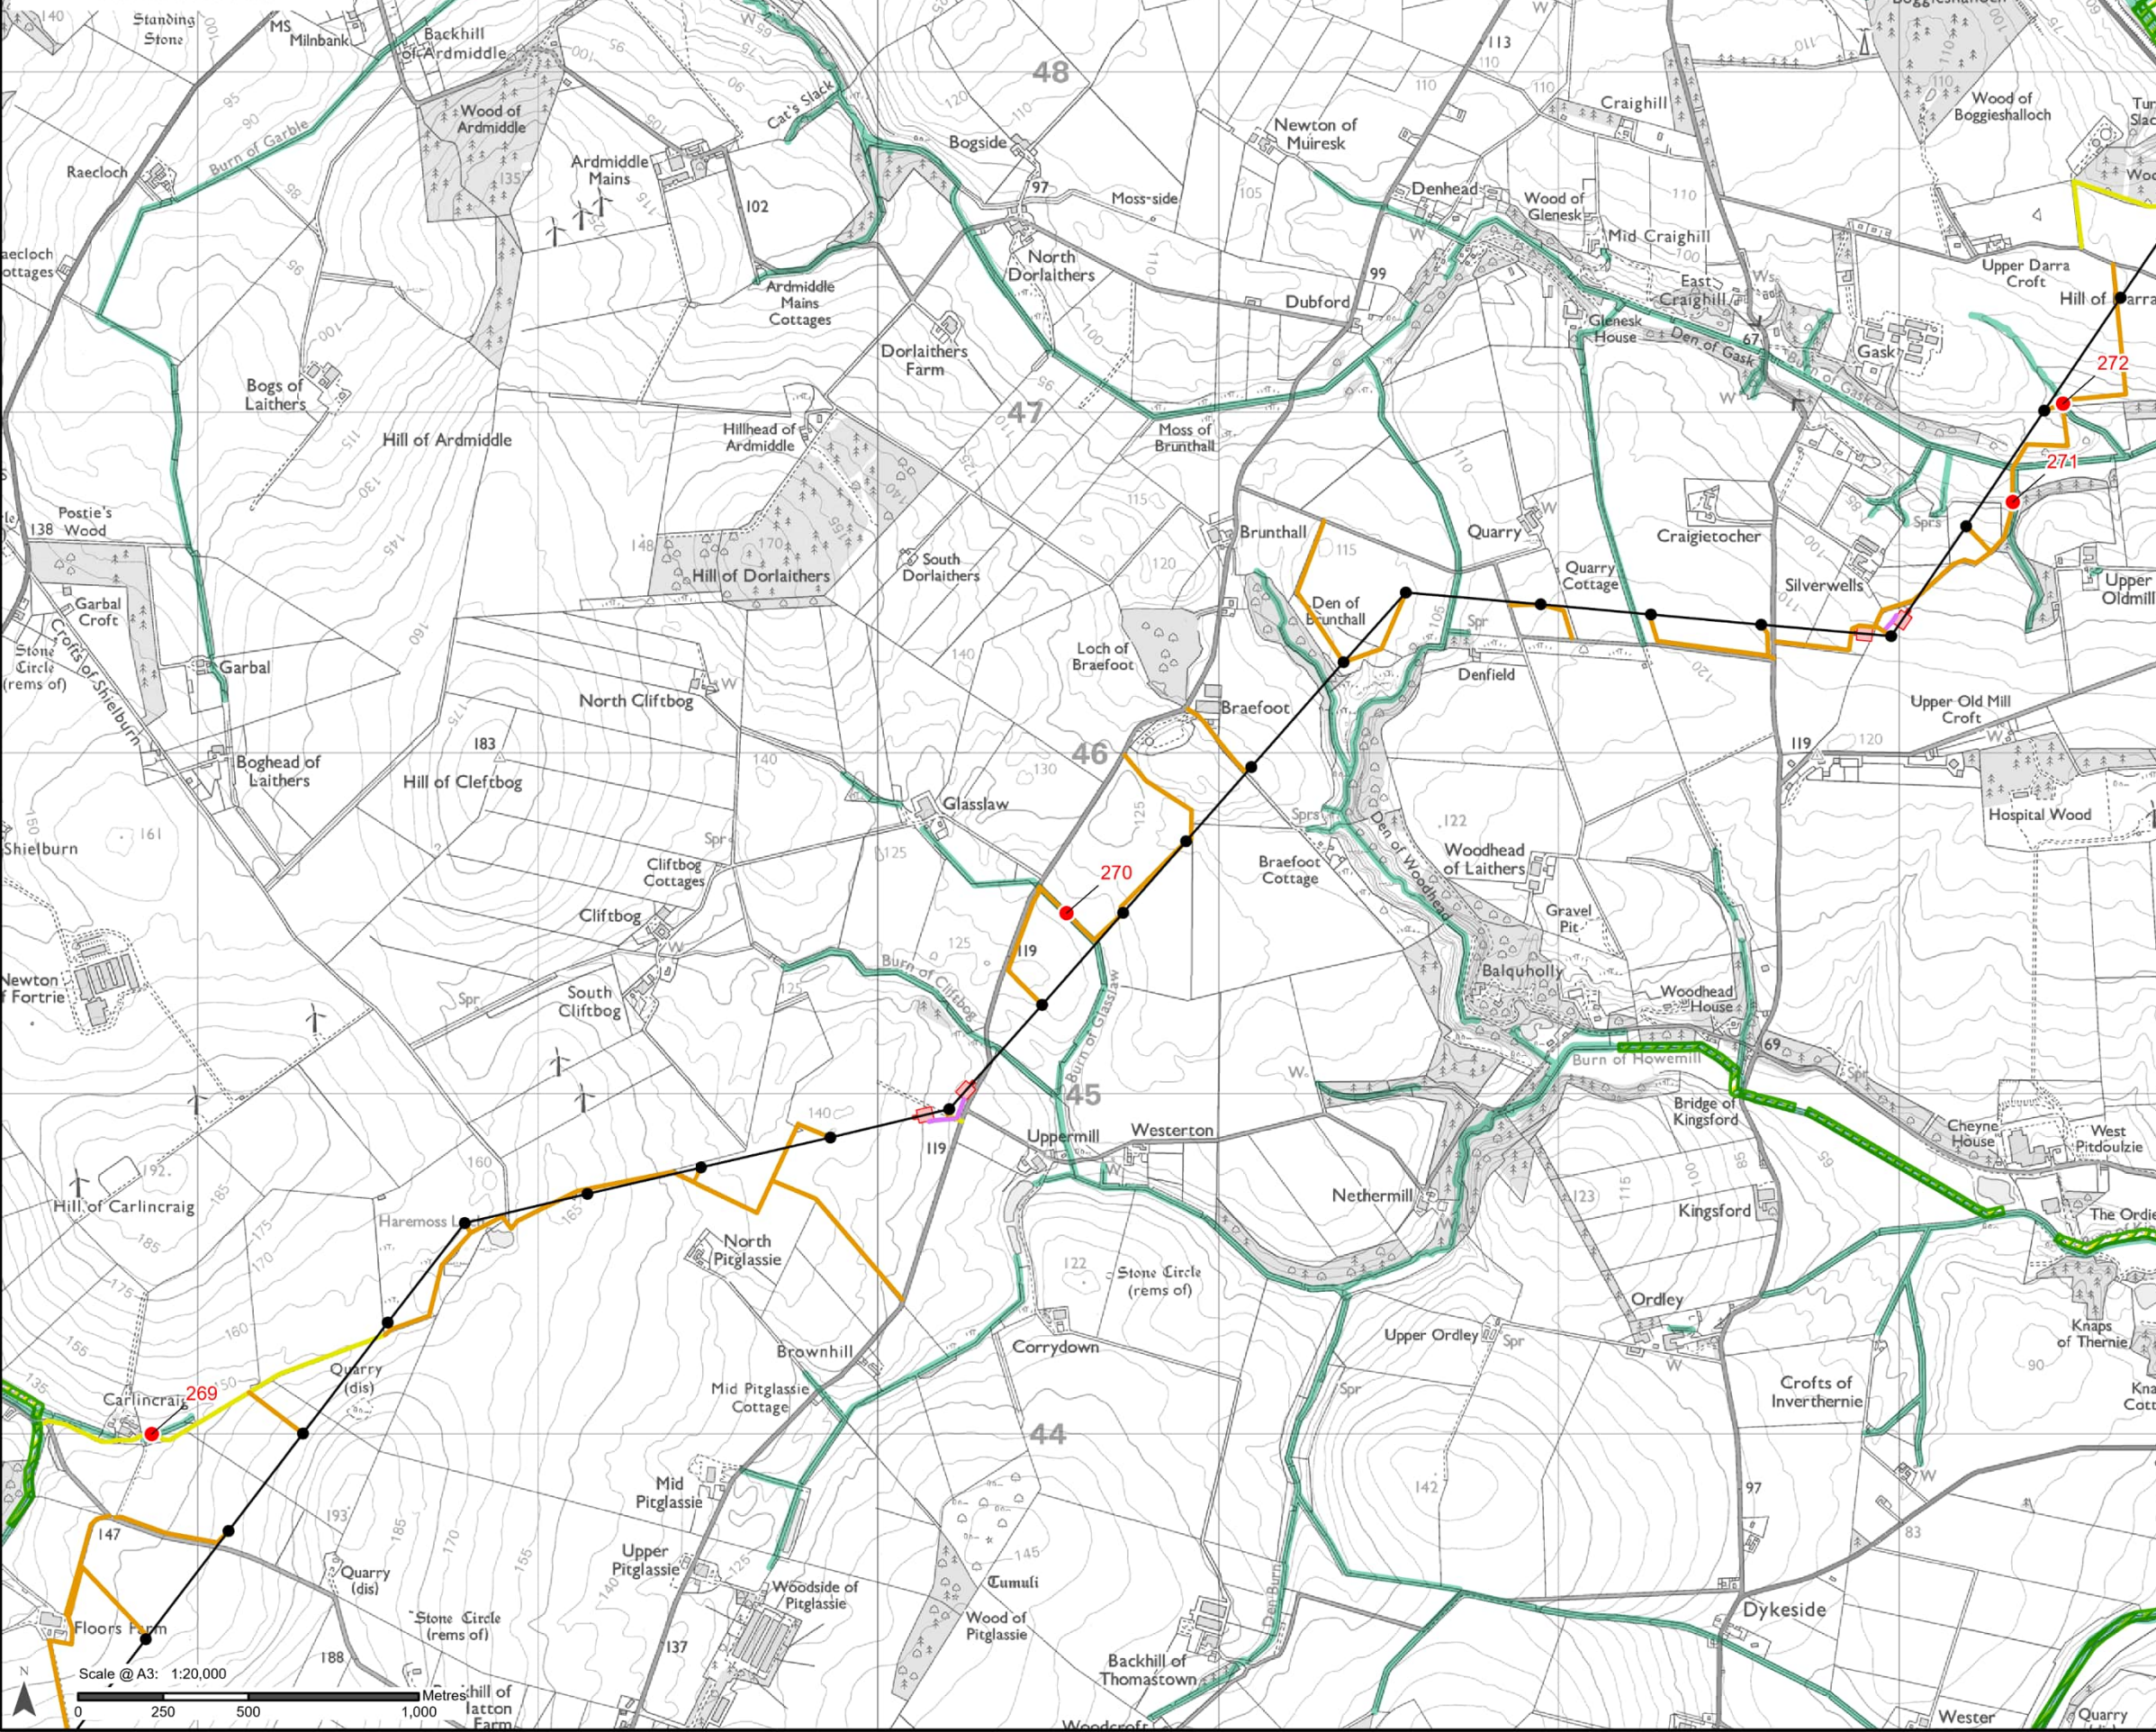

Legend

Development for which Section 37 Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/ Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

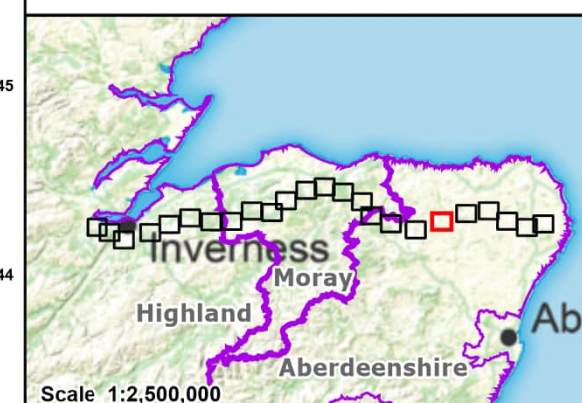


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauty to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 19 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

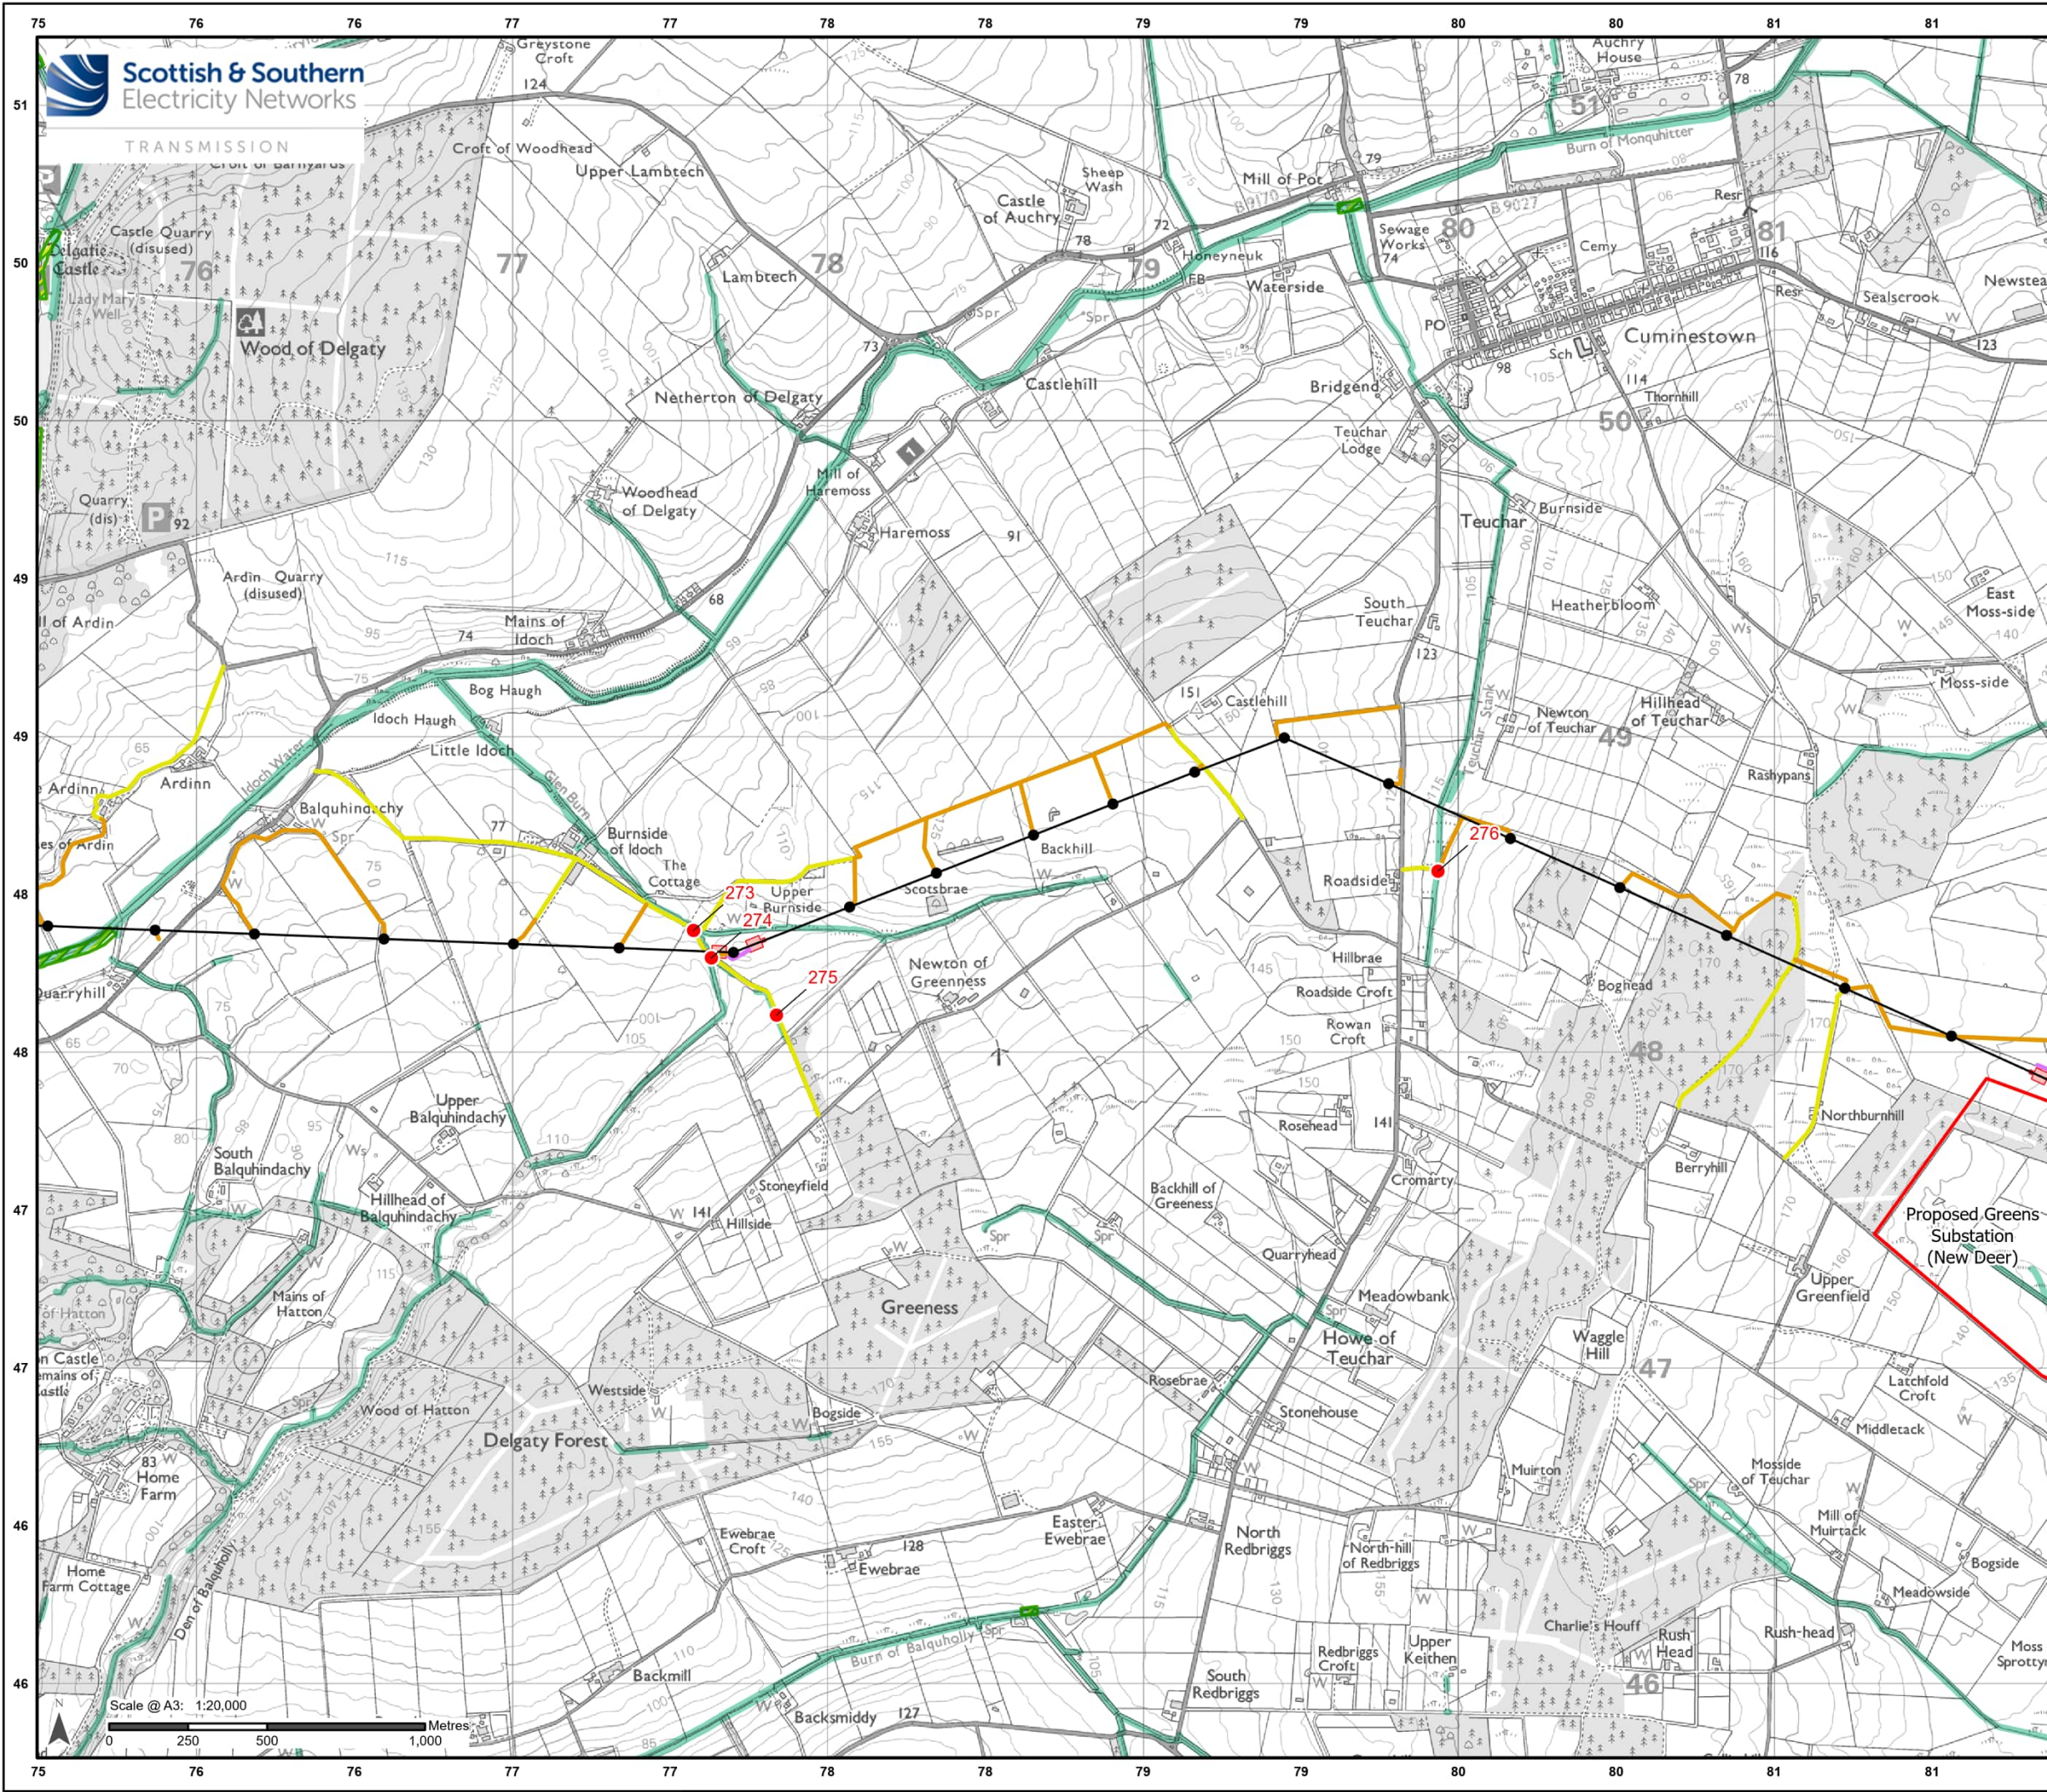

Legend

Proposed Substation Site Planning Red Line Boundary

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV

Ancillary Development

Existing Access Upgrade

Proposed Access – ATV or Temporary Trackway

Proposed Access (Temporary/Permanent)


Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

Infringement Location and ID

Geomorphic Risk Buffer

Recommended Riparian Corridor

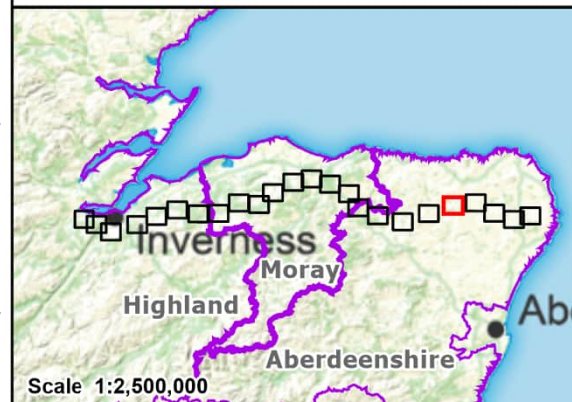


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 20 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

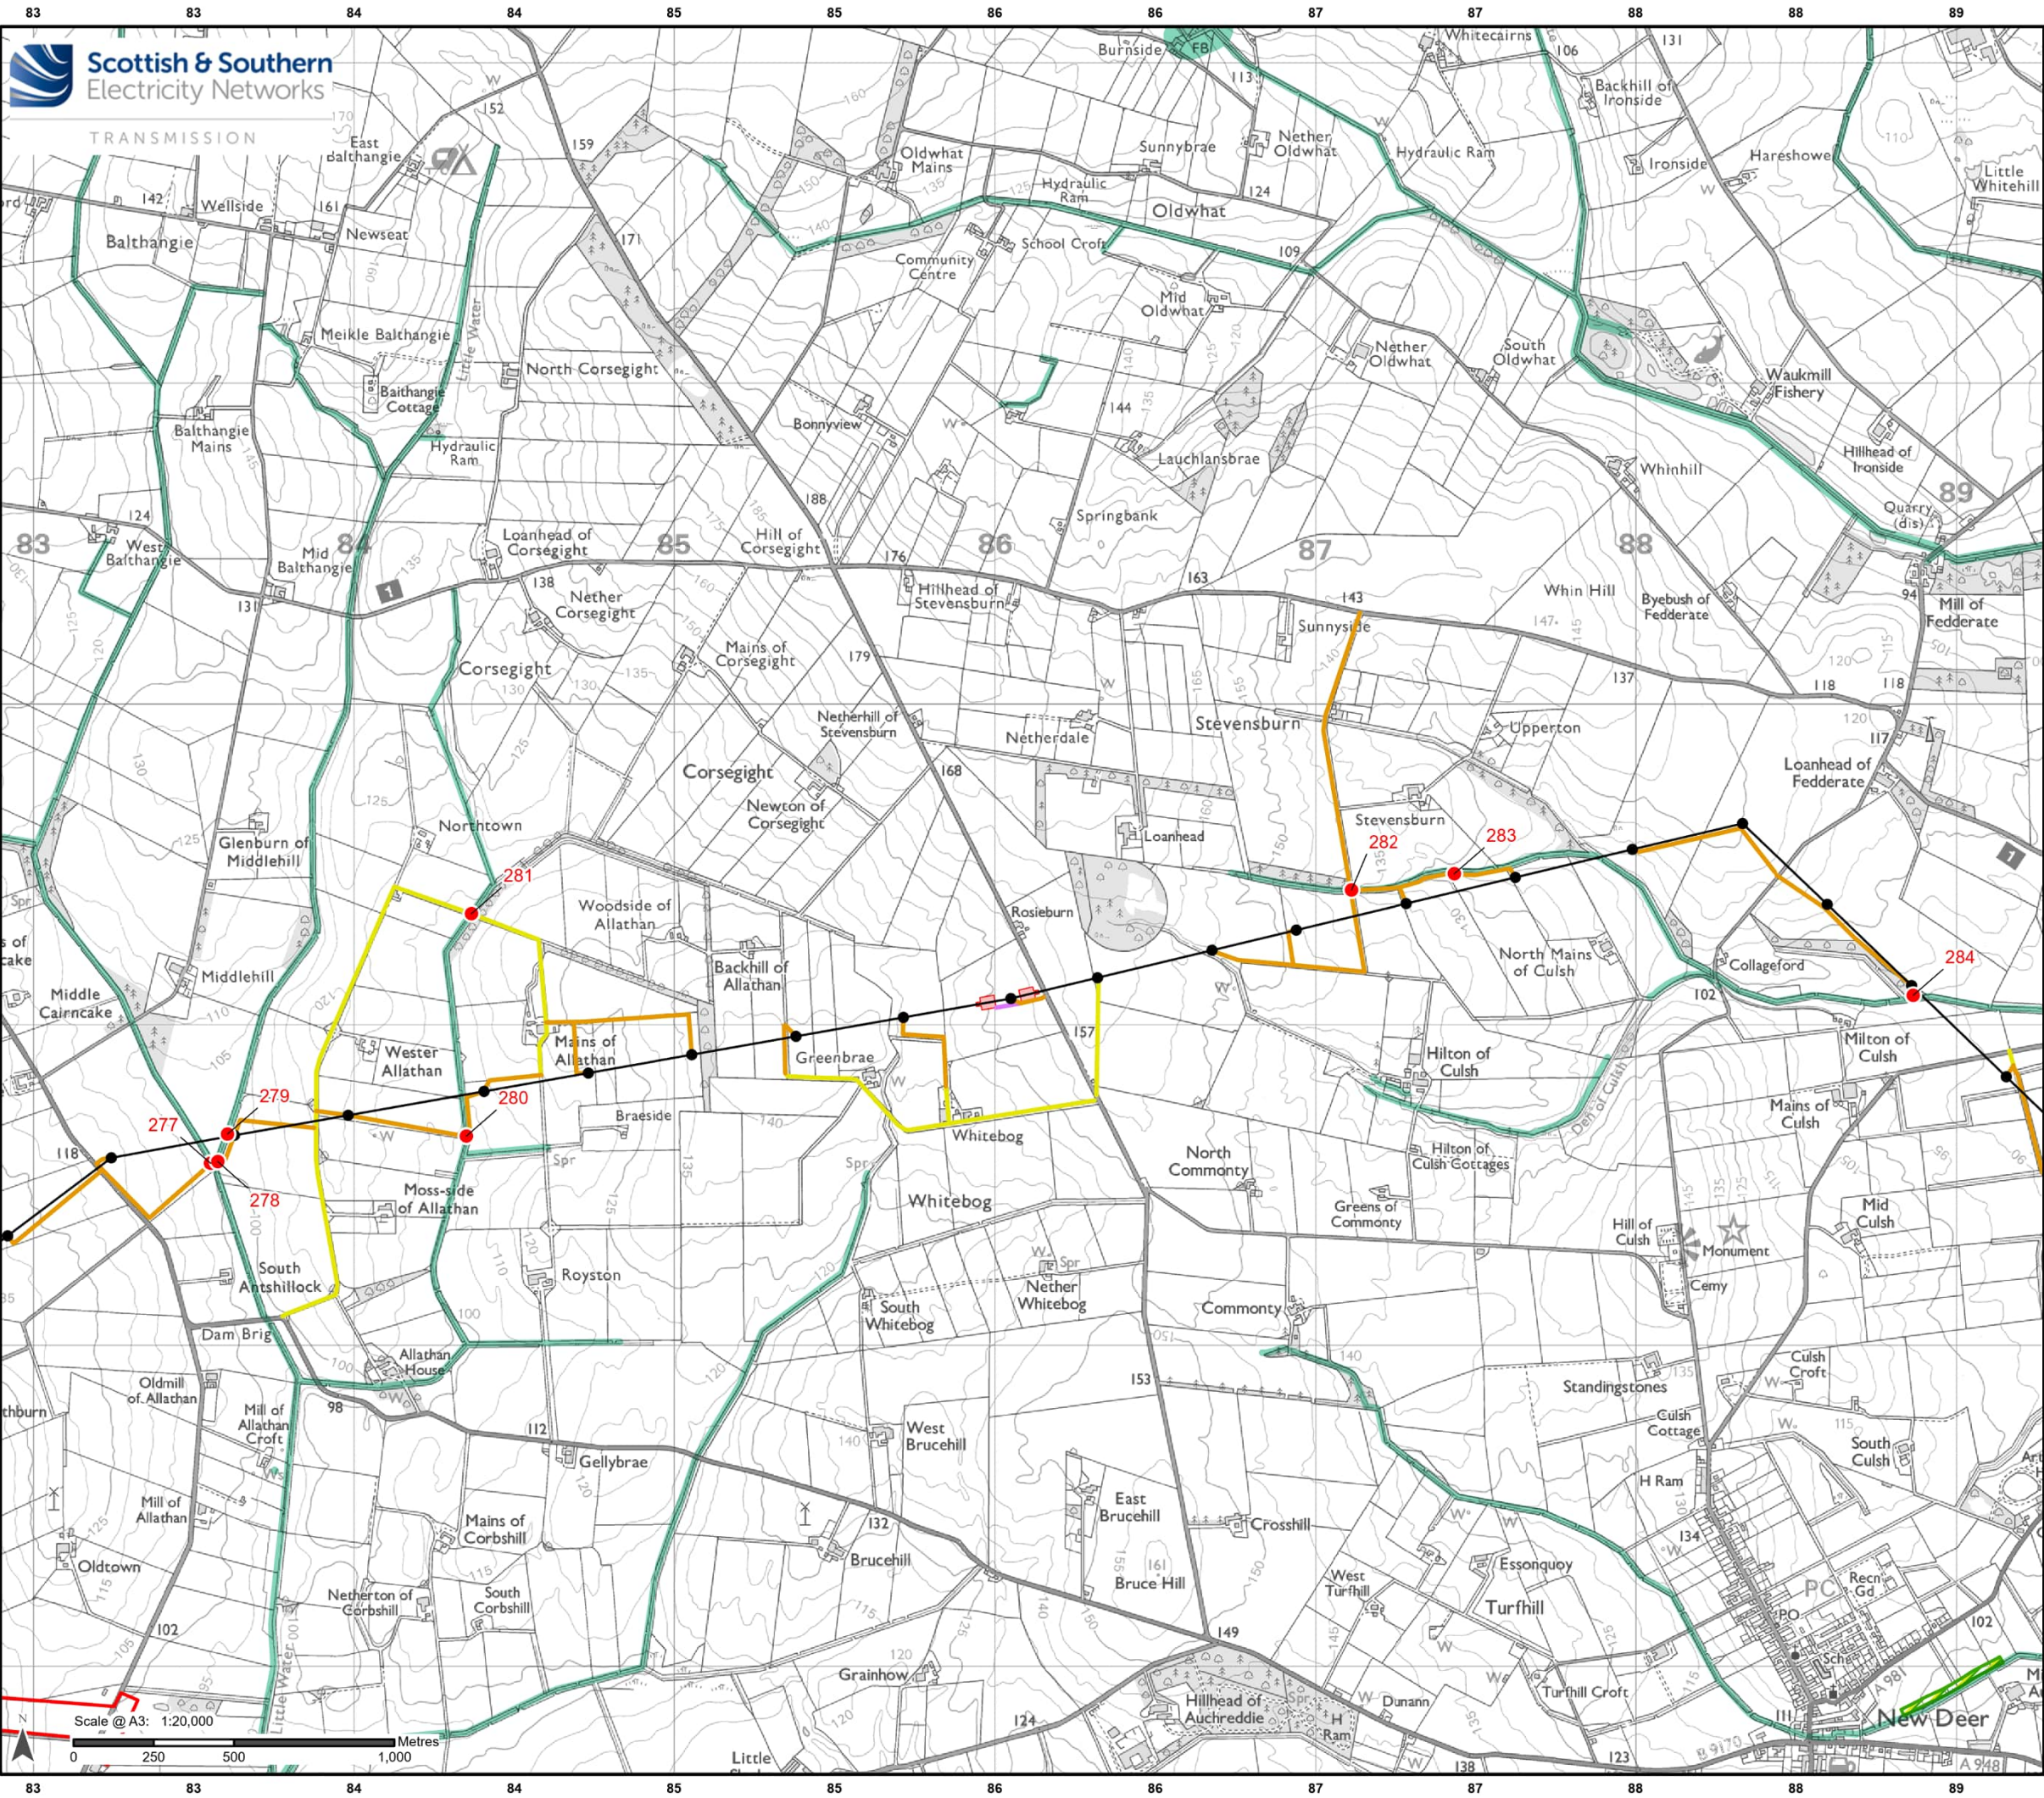

Legend

 Proposed Substation Site Planning Red Line Boundary

Development for which Section 37 Consent is Sought

 Proposed OHL Alignment - 400 kV

 Proposed Tower - 400 kV

Ancillary Development

 Existing Access Upgrade

 Proposed Access – ATV or Temporary Trackway

 Proposed Access (Temporary/ Permanent)


 Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

 Infringement Location and ID

 Geomorphic Risk Buffer

 Recommended Riparian Corridor

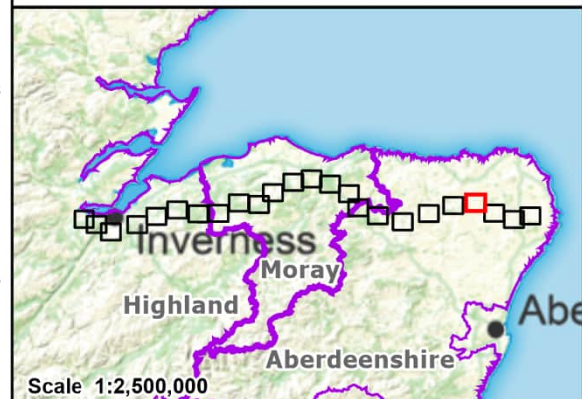

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project


Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 21 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

Scale @ A3: 1:20,000

0 250 500 1,000 Metres

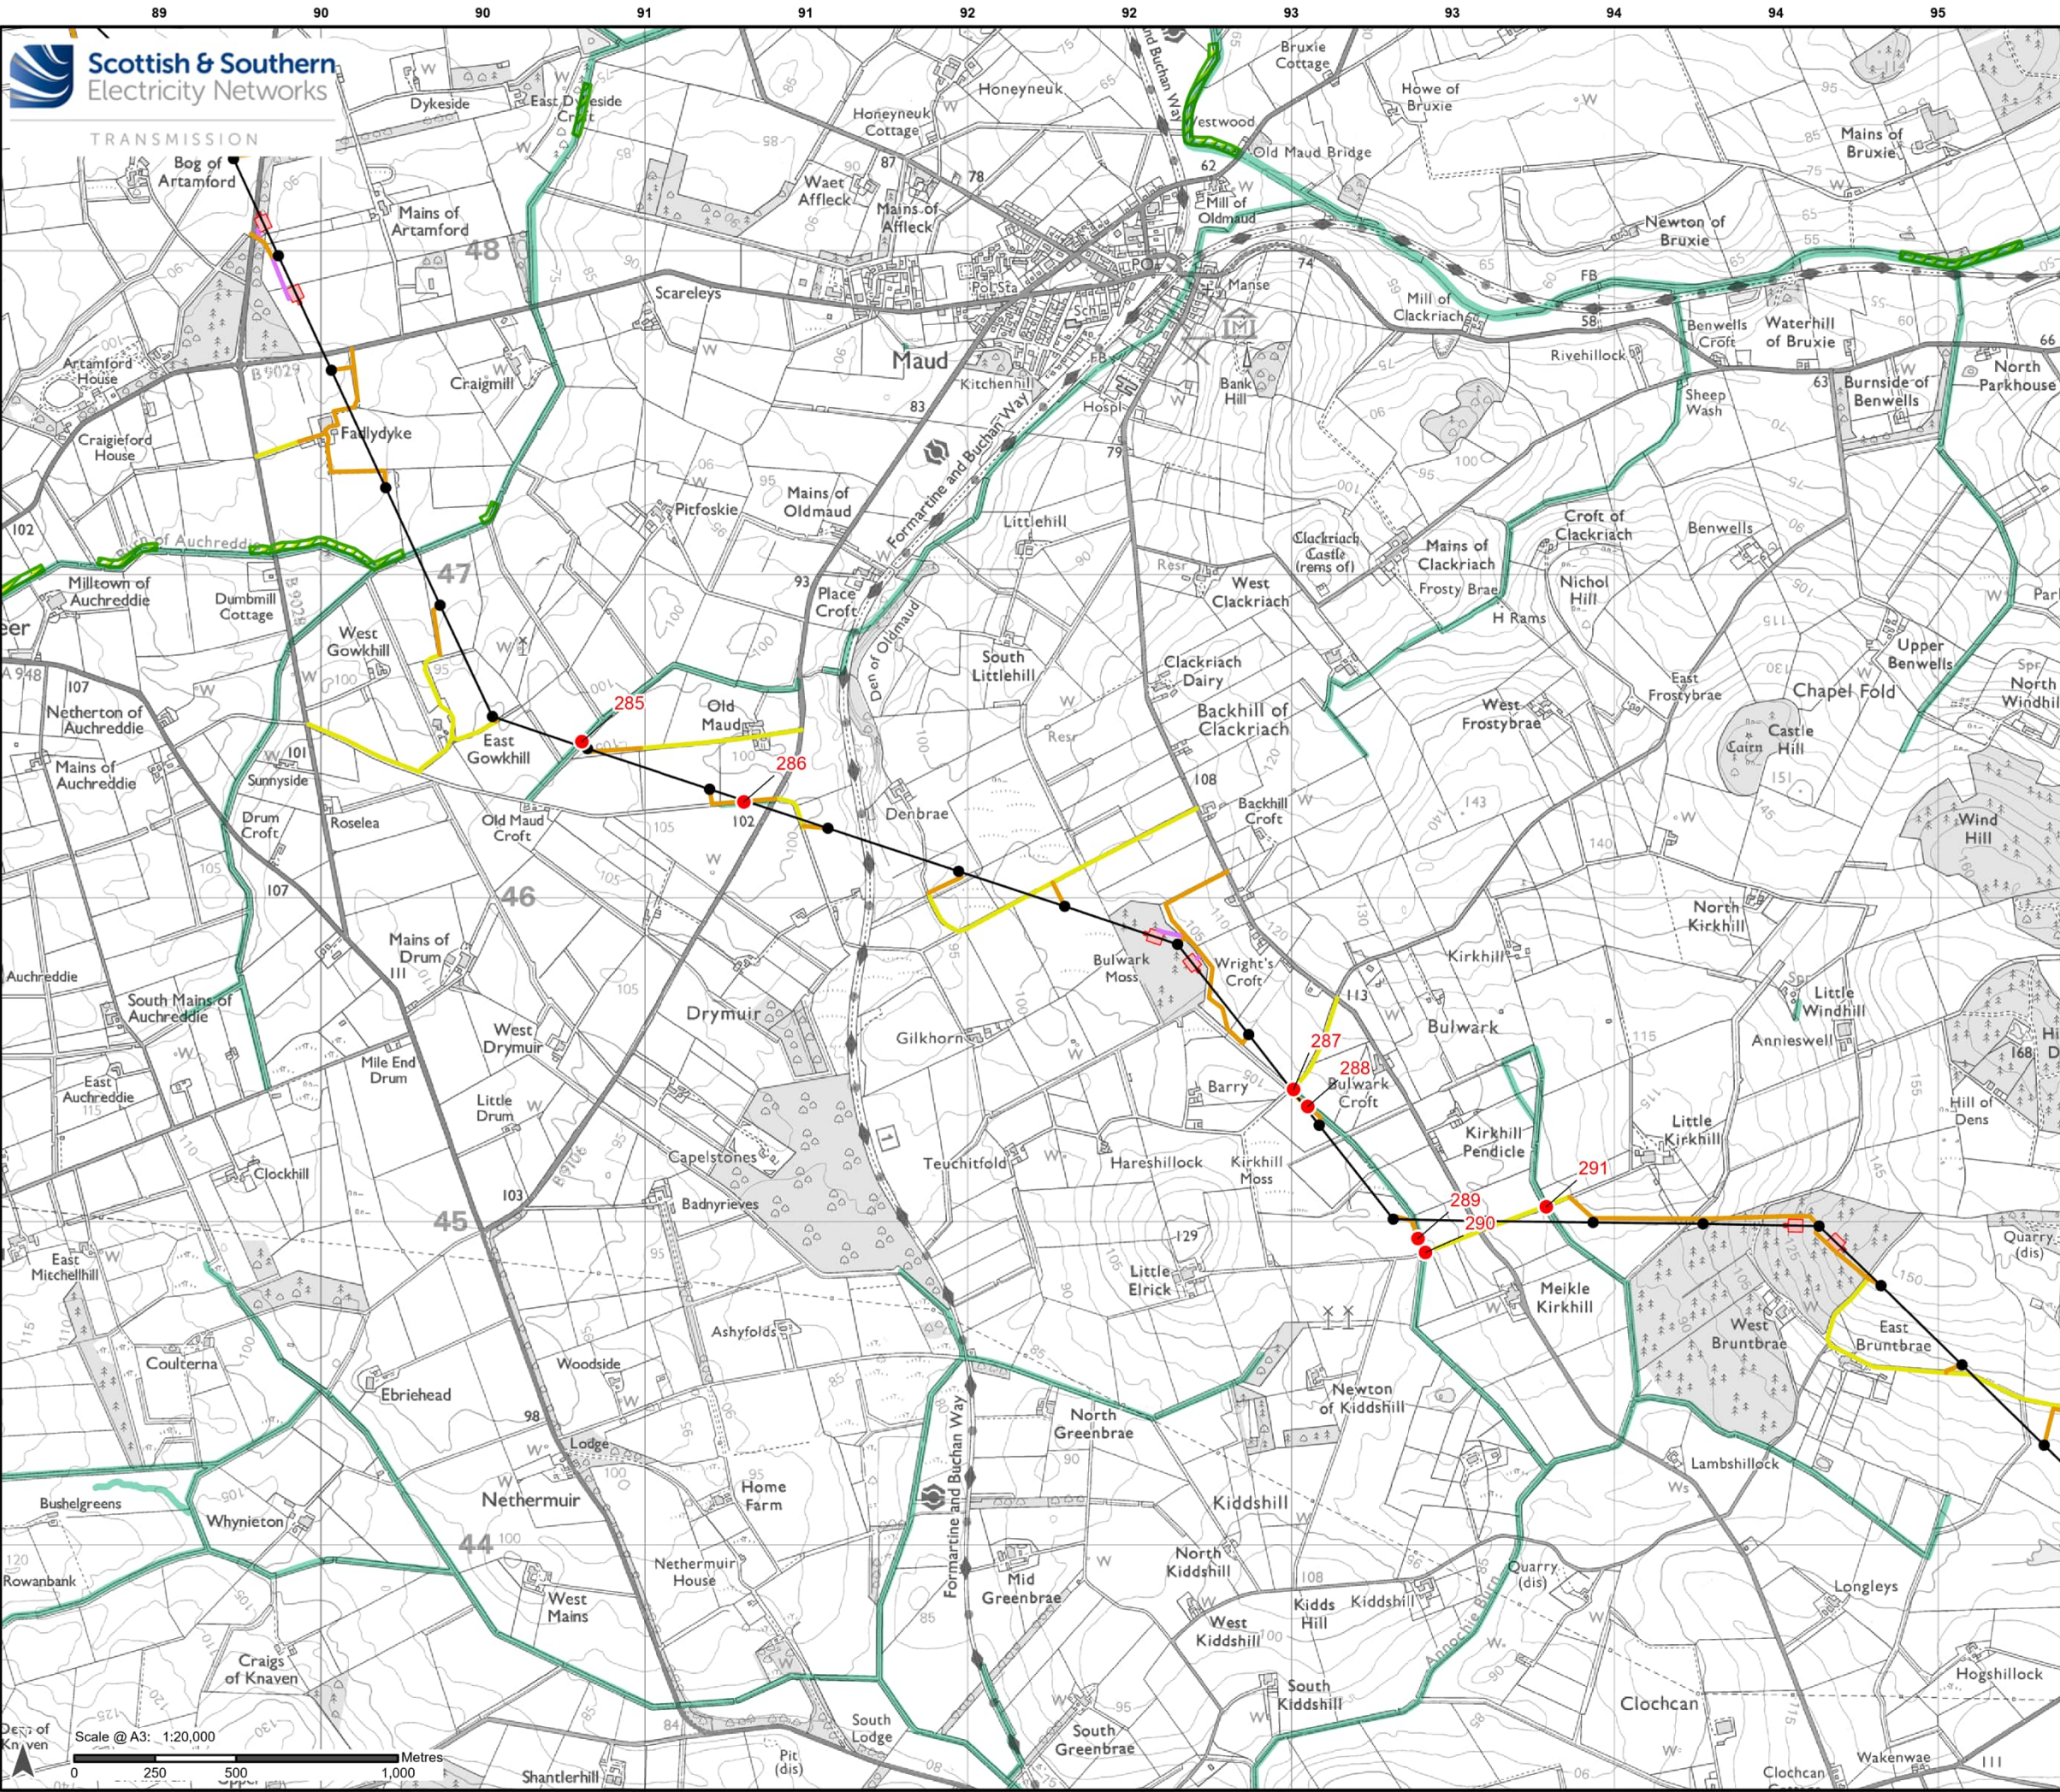

Legend

Development for which Section 37
Consent is Sought


- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/ Permanent)
- Proposed Conductor Pulling Area (EPZ)


Watercourse Buffer Infringement
Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

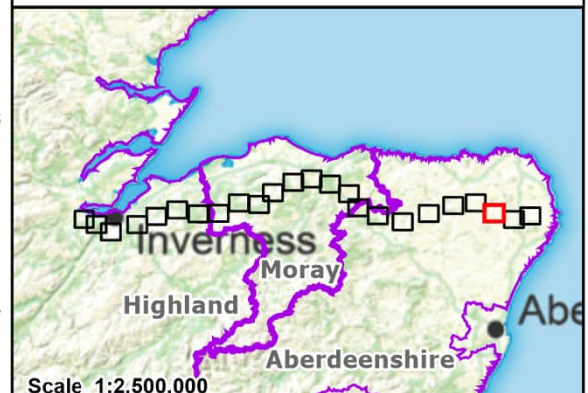

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the
Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright.
Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release
or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhilllock to New Deer to Peterhead 400 kV OHL Project	
Title:	Figure 10.10.1 - Watercourse Buffer Infringement Locations Page 22 of 24	
Drawn by:	MAL	Date: 24/09/2025
Drawing:	B2P-WSP-DA-70092380-184	

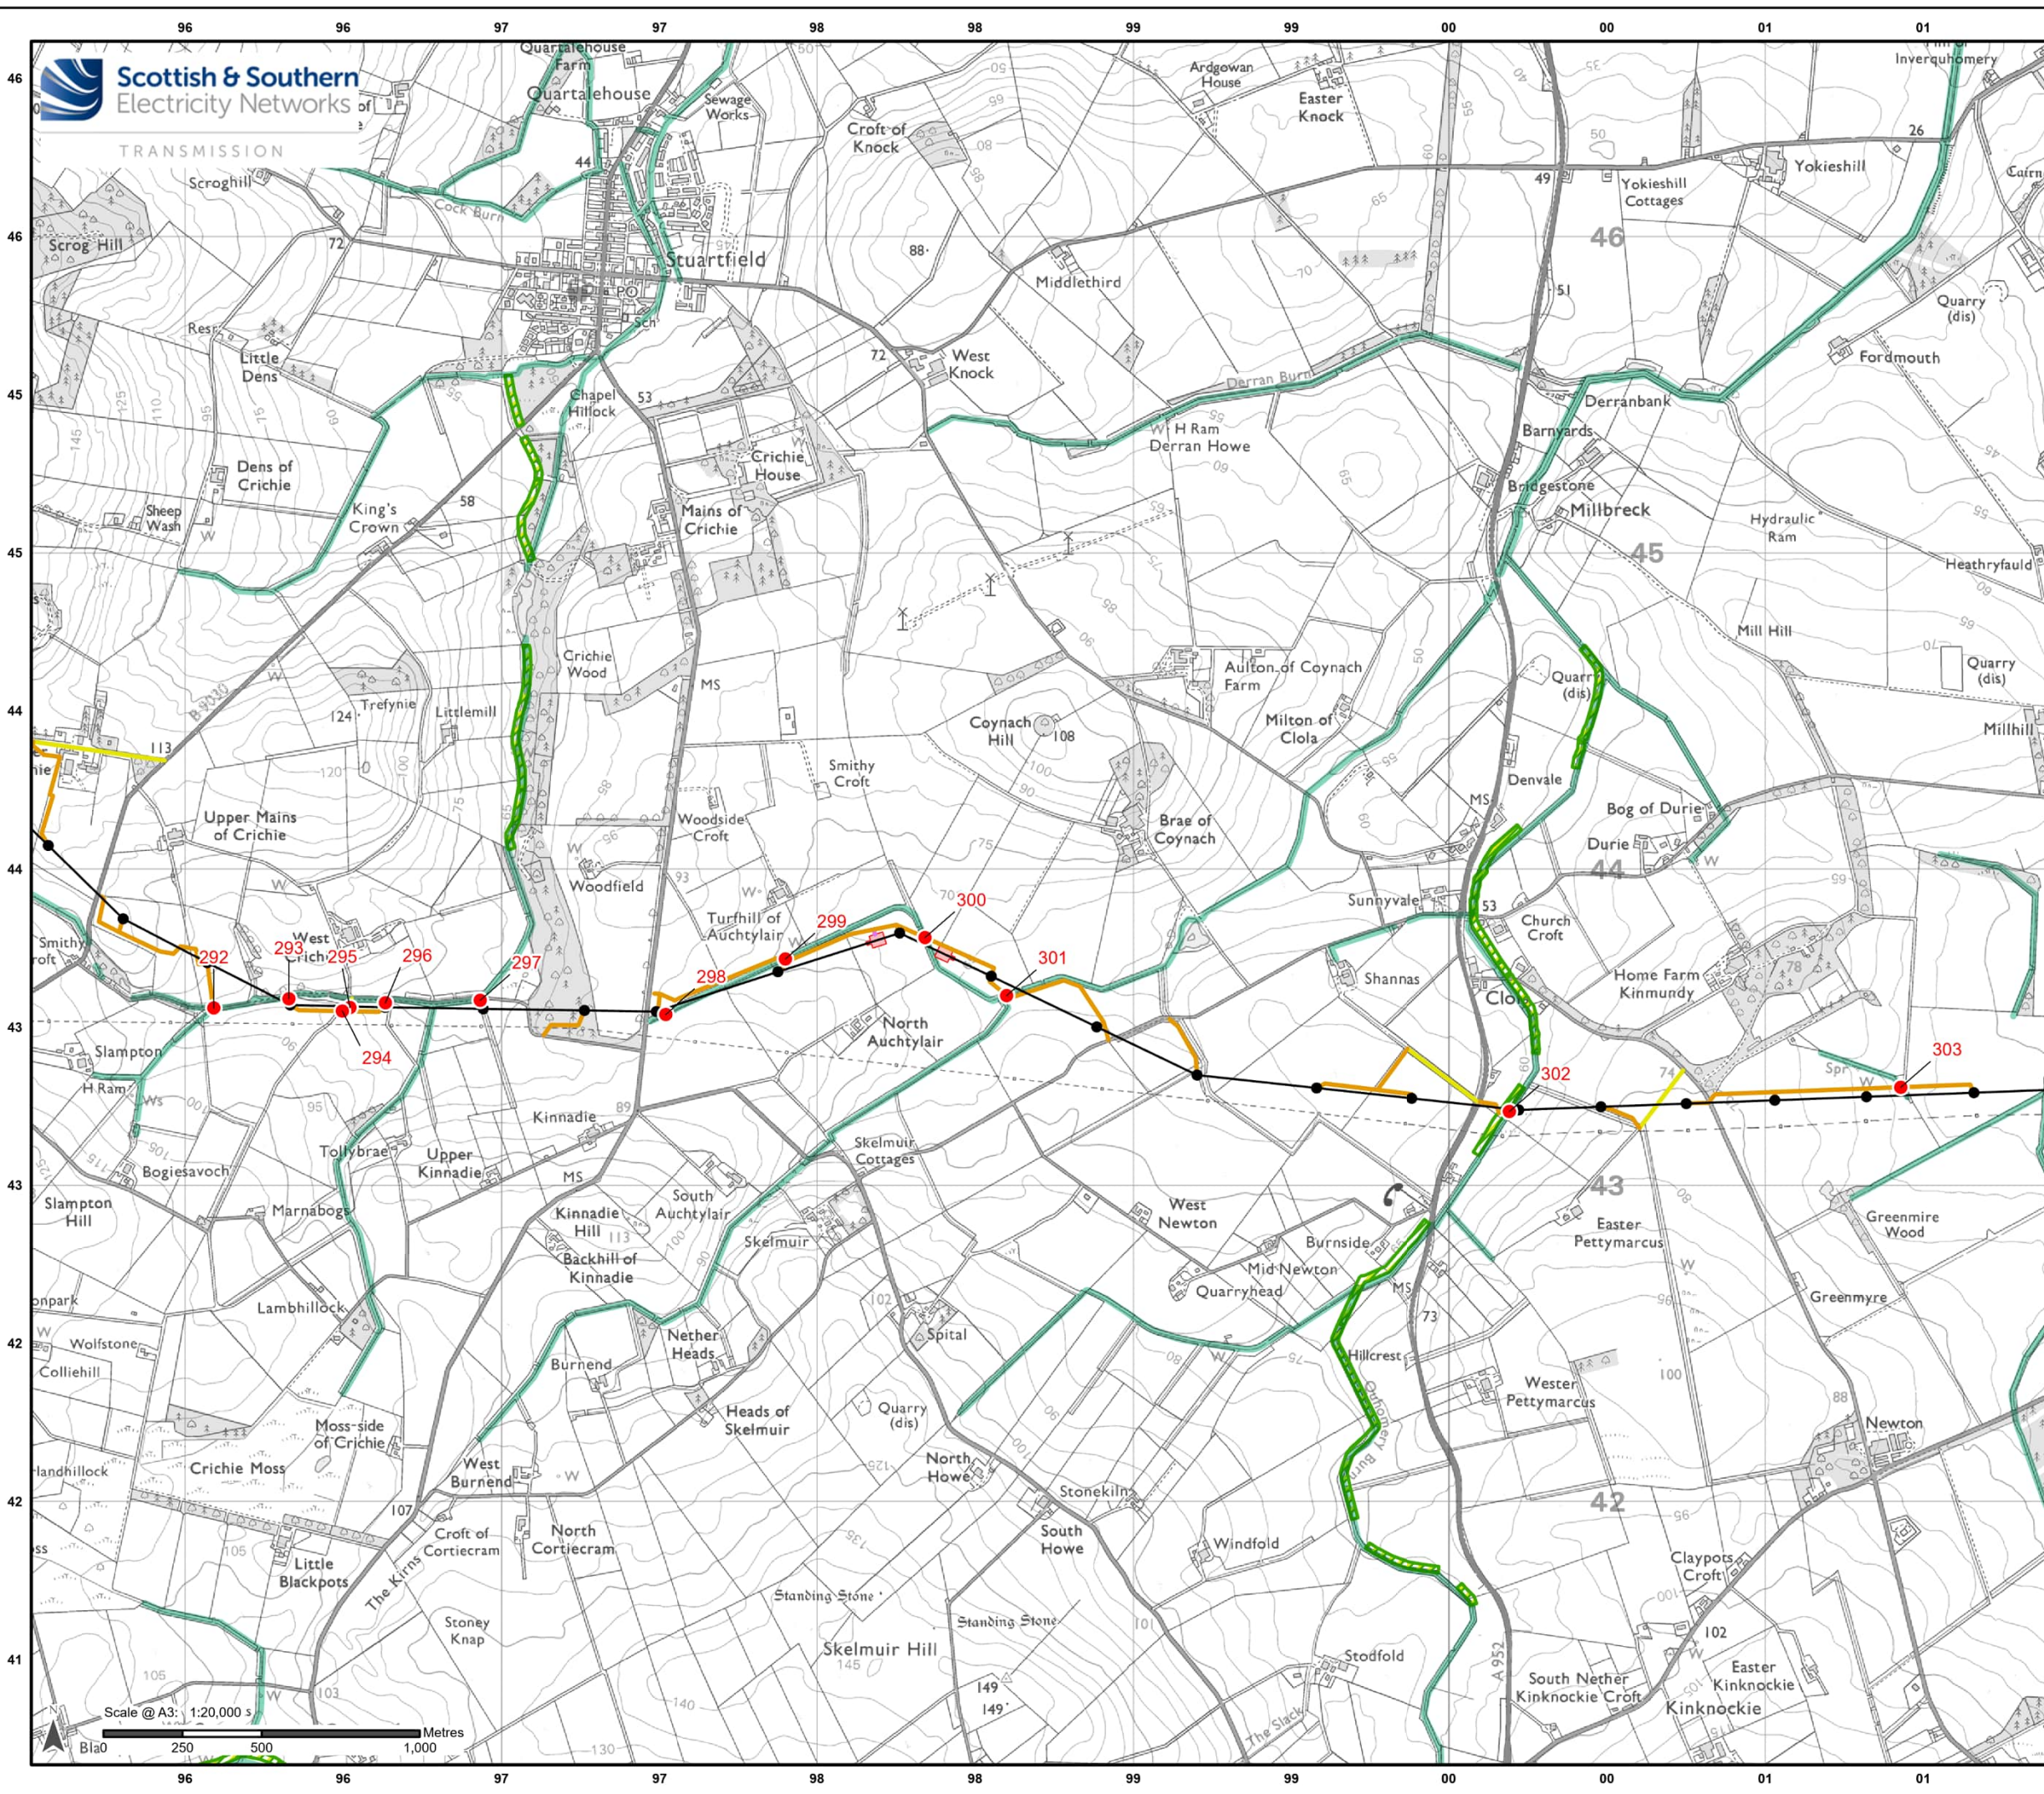

Legend

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Existing Access Upgrade
- Proposed Access – ATV or Temporary Trackway
- Proposed Access (Temporary/Permanent)
- Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

- Infringement Location and ID
- Geomorphic Risk Buffer
- Recommended Riparian Corridor

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 23 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184

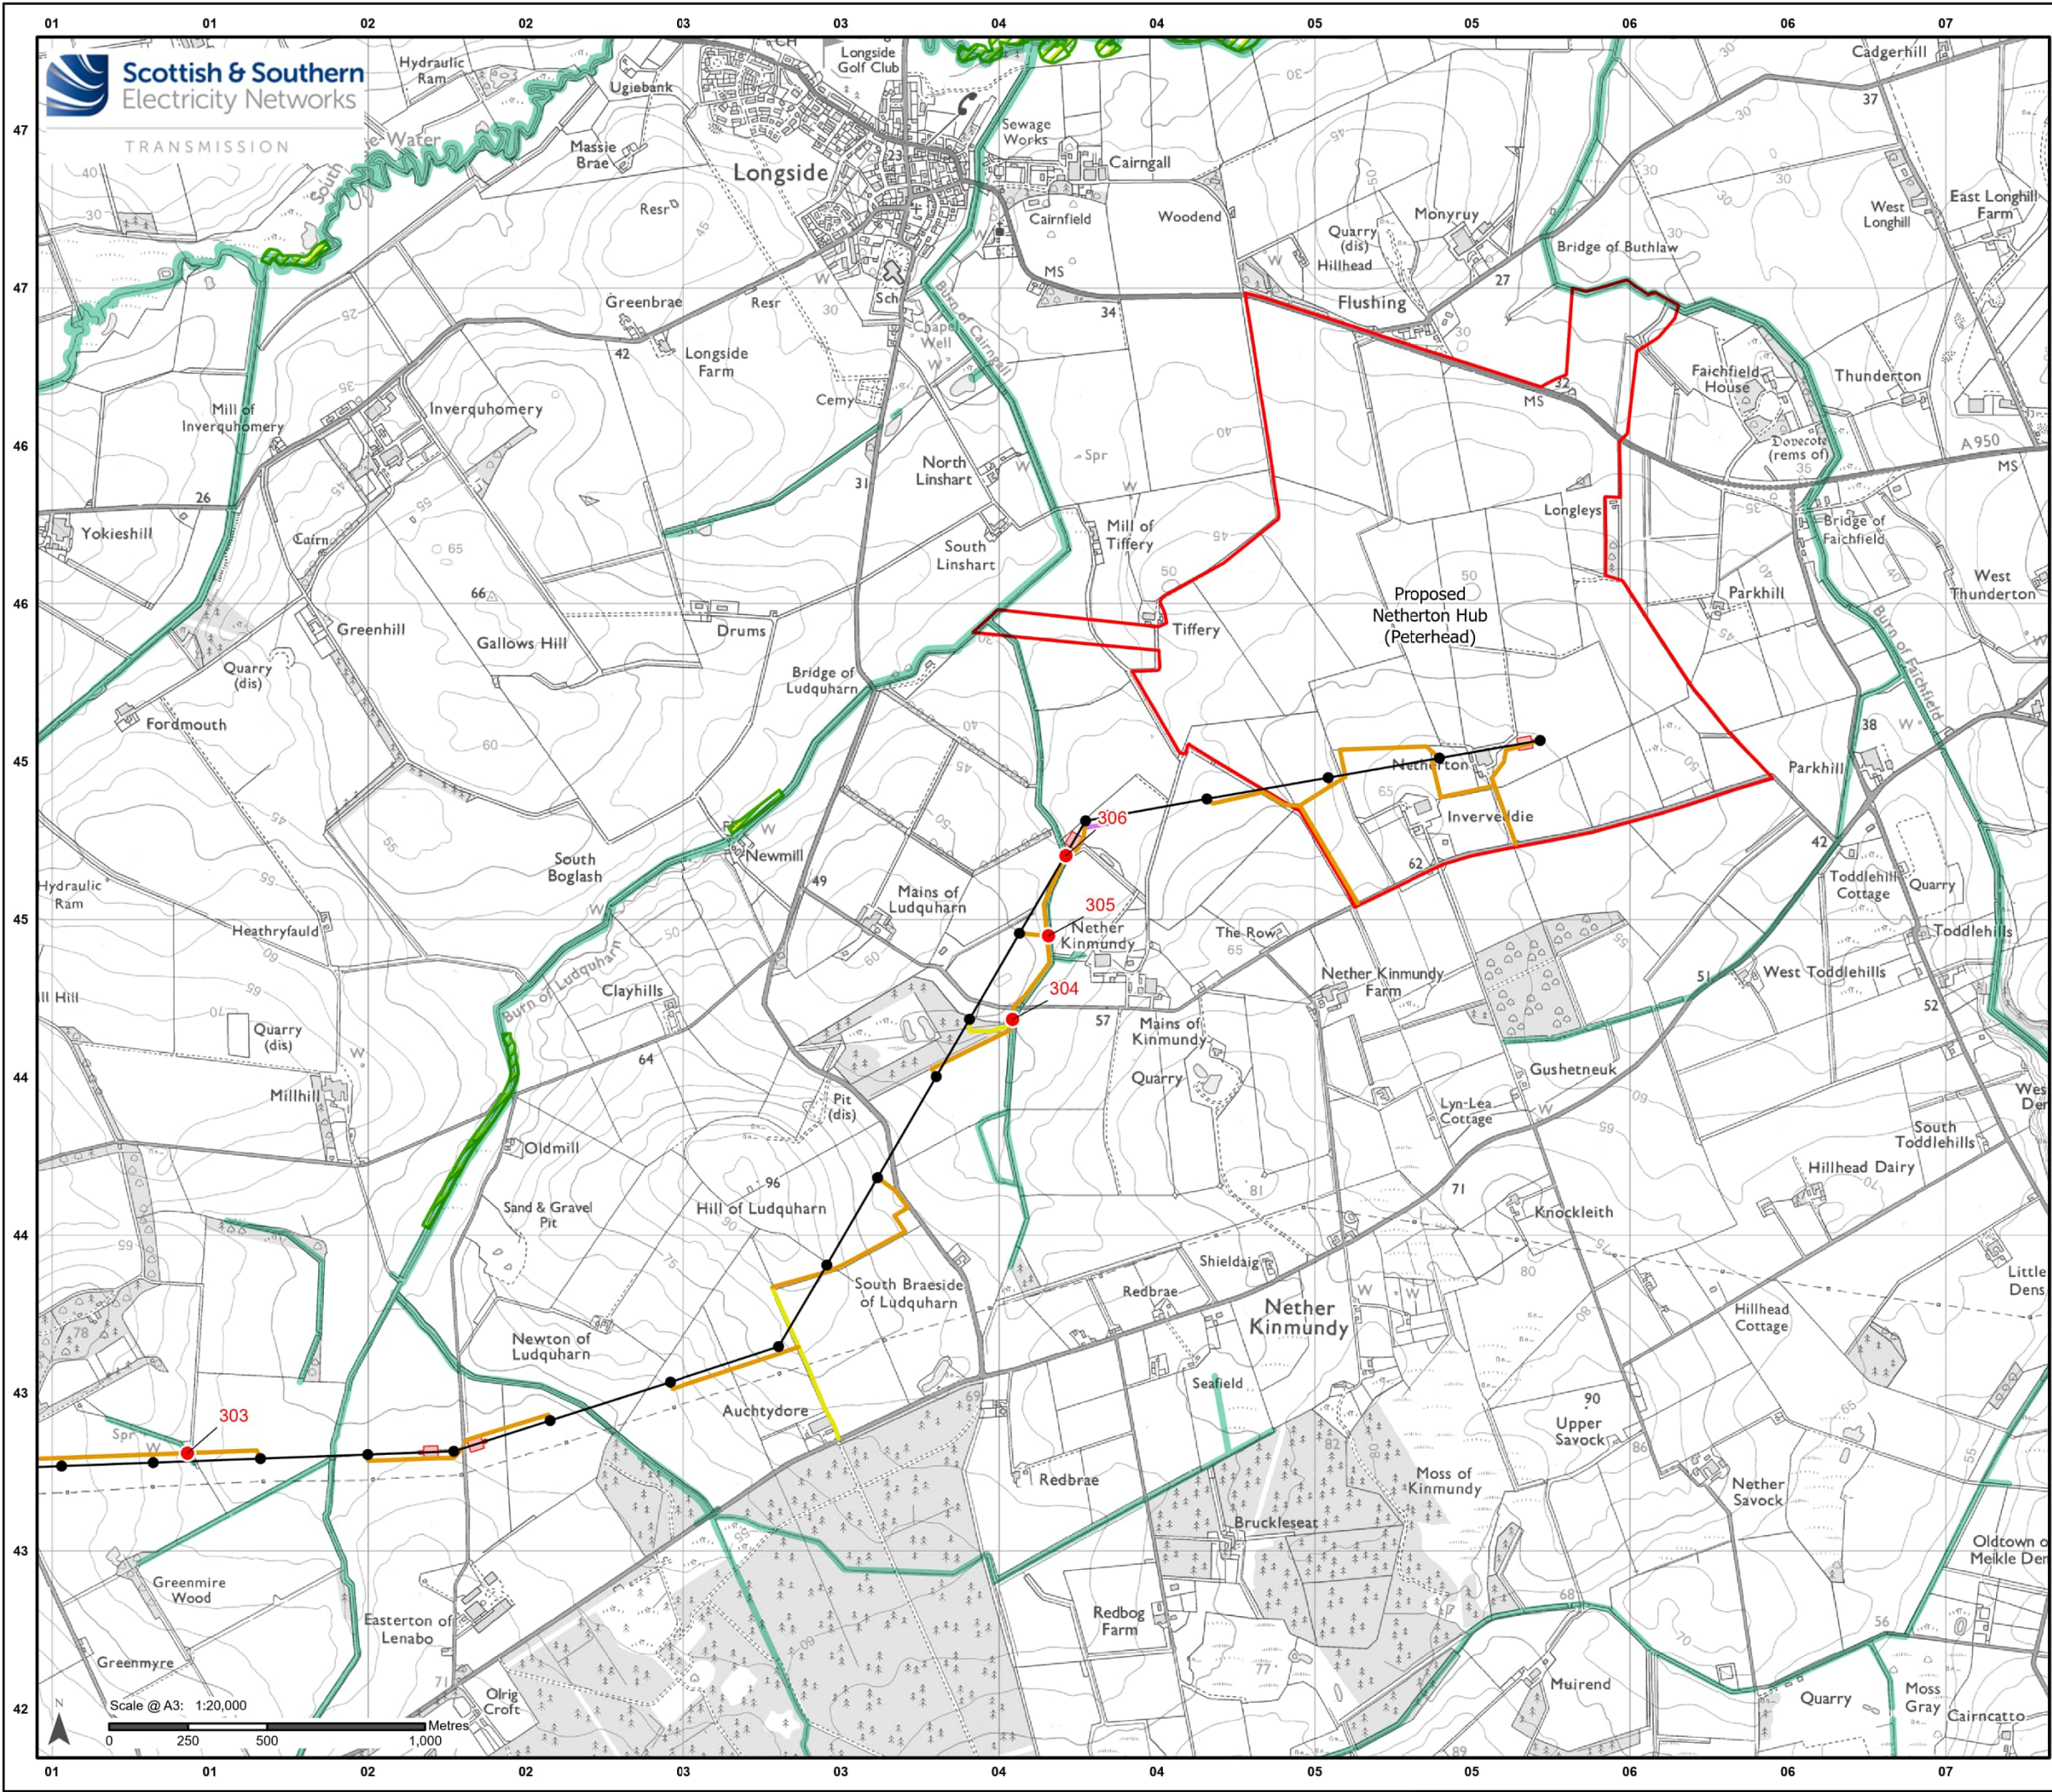

Legend

Proposed Substation Site Planning Red Line Boundary

Development for which Section 37 Consent is Sought

Proposed OHL Alignment - 400 kV

Proposed Tower - 400 kV

Ancillary Development

Existing Access Upgrade

Proposed Access – ATV or Temporary Trackway

Proposed Access (Temporary/Permanent)


Proposed Conductor Pulling Area (EPZ)

Watercourse Buffer Infringement Location

Infringement Location and ID

Geomorphic Risk Buffer

Recommended Riparian Corridor

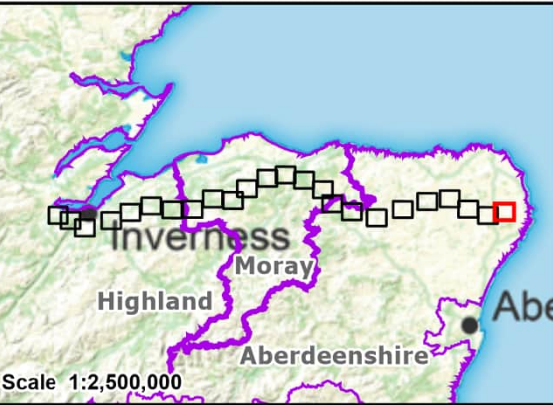

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Contains public sector information licensed under the Open Government Licence v3.0. © Scottish Environment Protection Agency. Contains OS data Copyright. Crown copyright and database right 2025. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.10.1 - Watercourse Buffer Infringement Locations
Page 24 of 24

Drawn by: MAL Date: 24/09/2025

Drawing: B2P-WSP-DA-70092380-184