


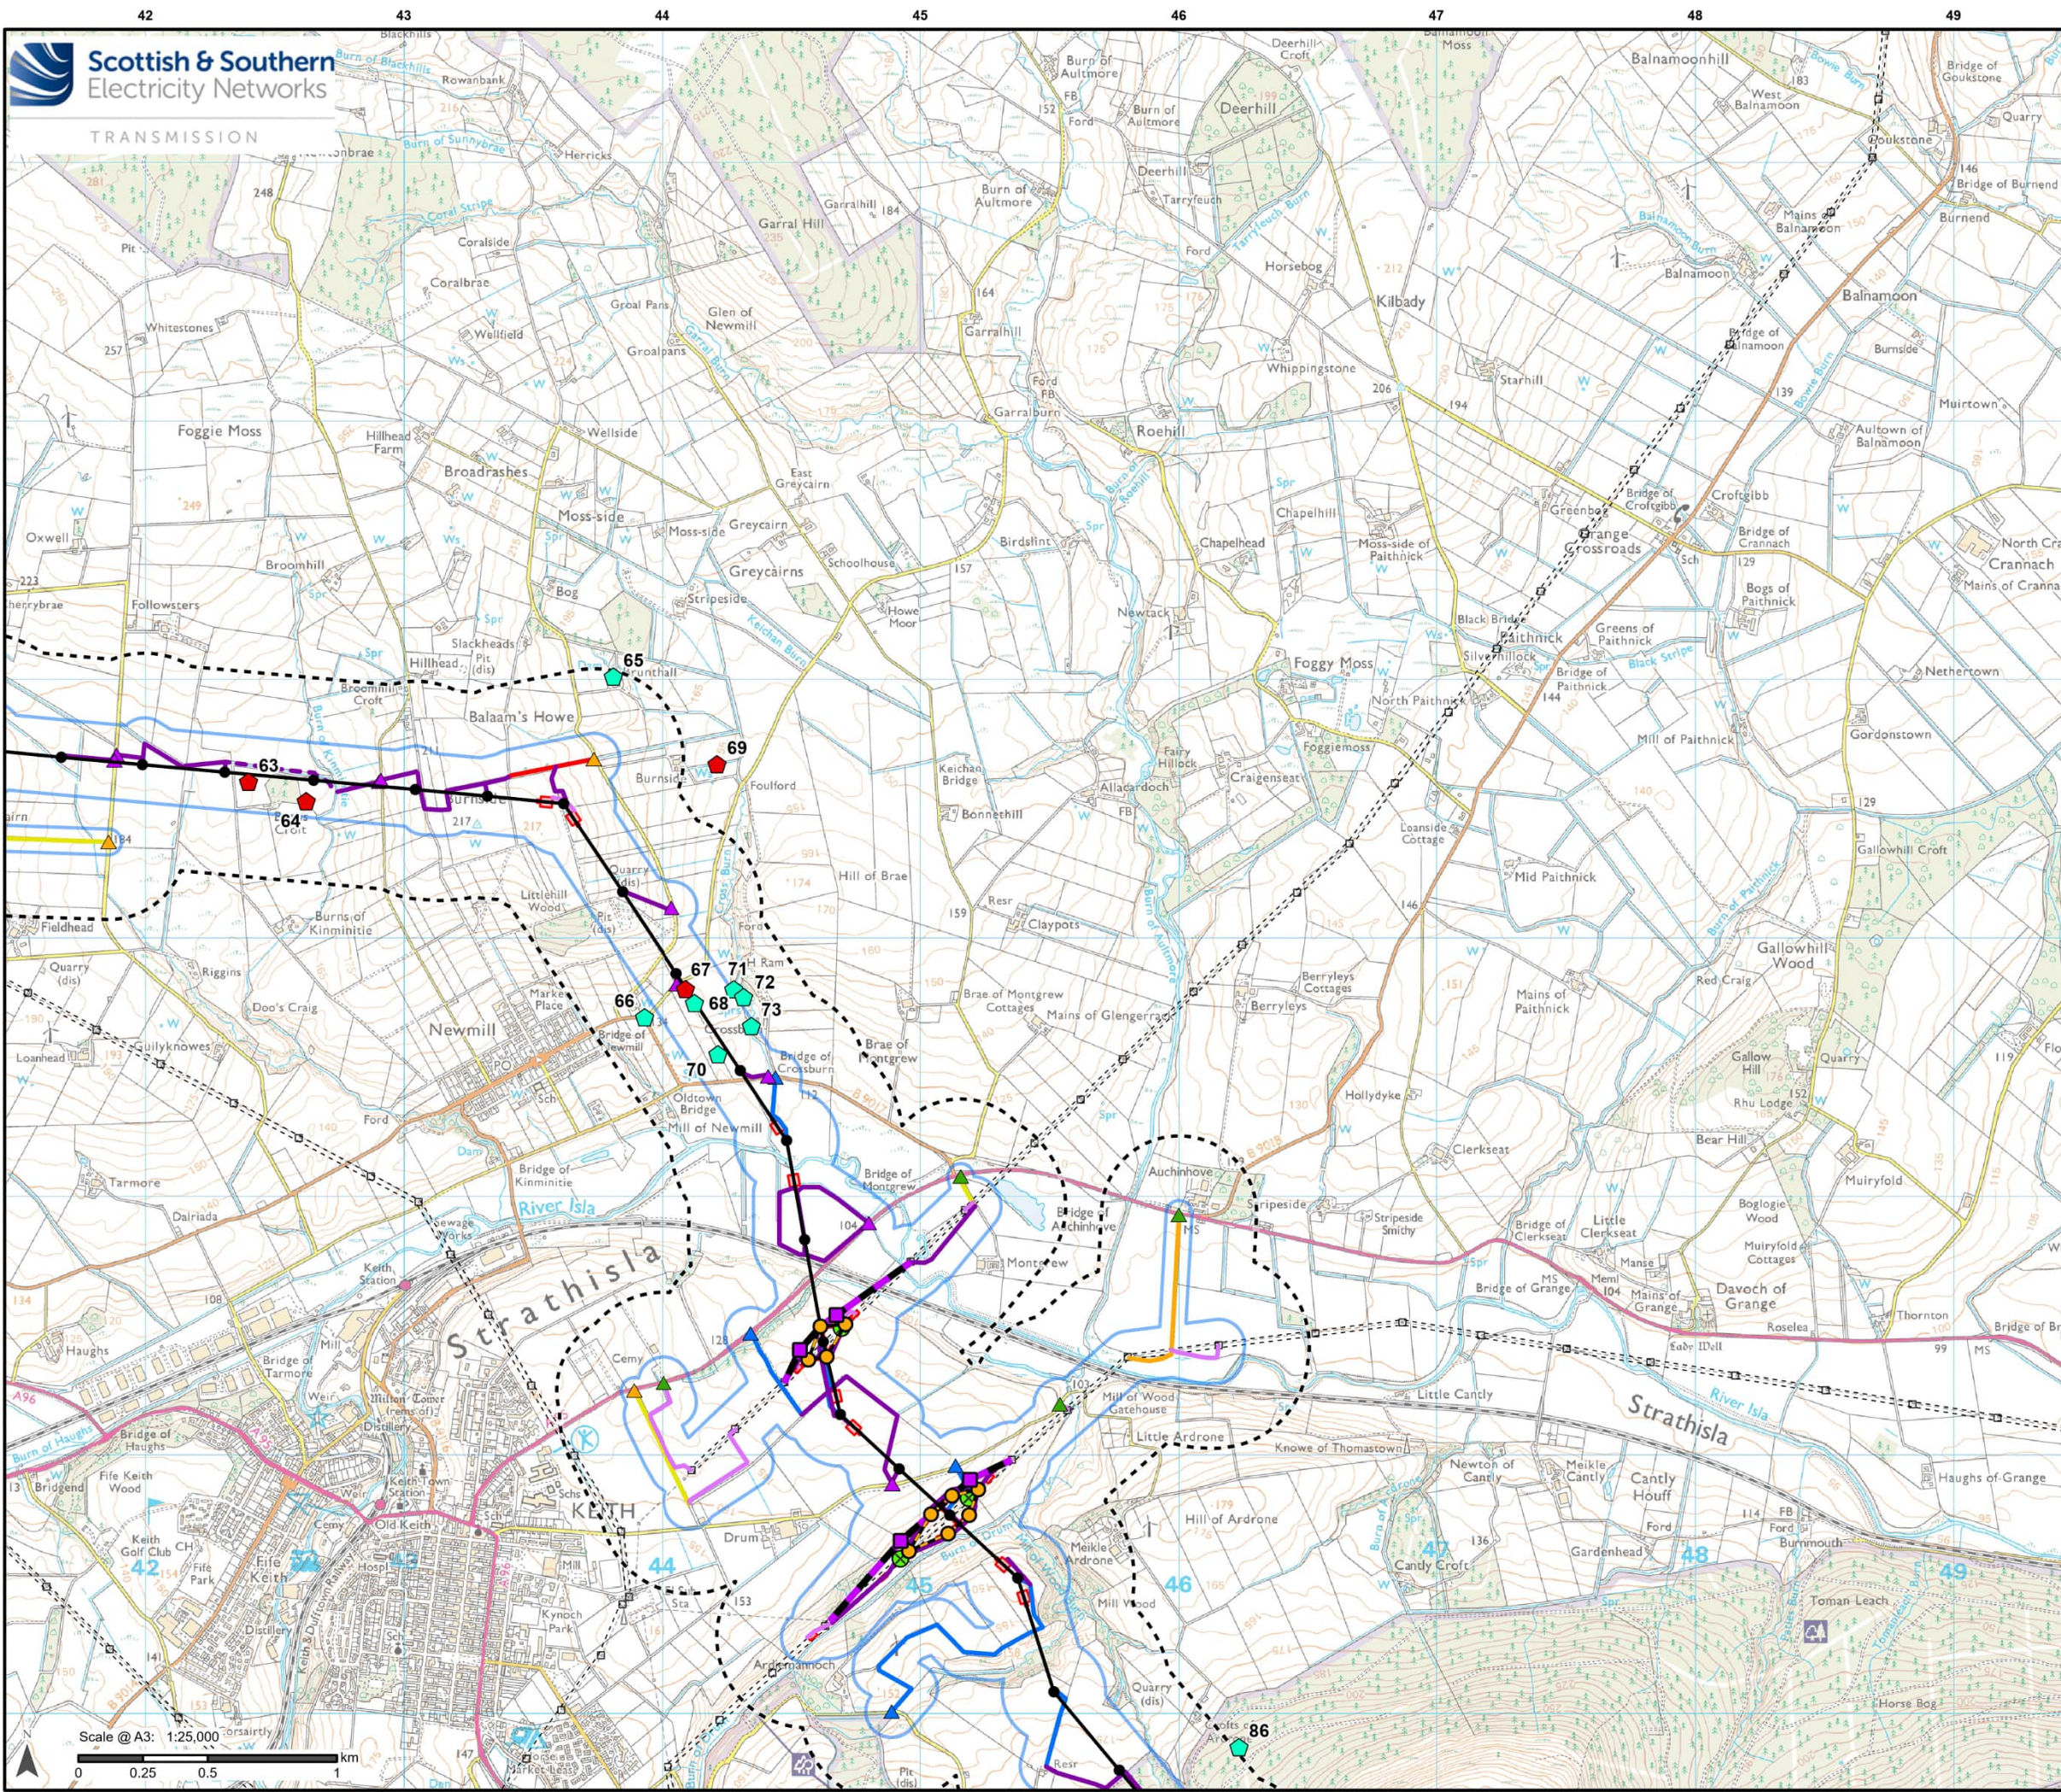

### Legend

- Existing OHL
- Existing Tower
- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD

#### Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Temporary OHL Diversion
- Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
- Proposed Tower - 400 kV
- Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
- Proposed Tower - Temporary

#### Ancillary Development

- Tower to be Removed
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Access Only / ATV
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

#### Private Water Supply

- Site Visit
- Council (source)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 16 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144

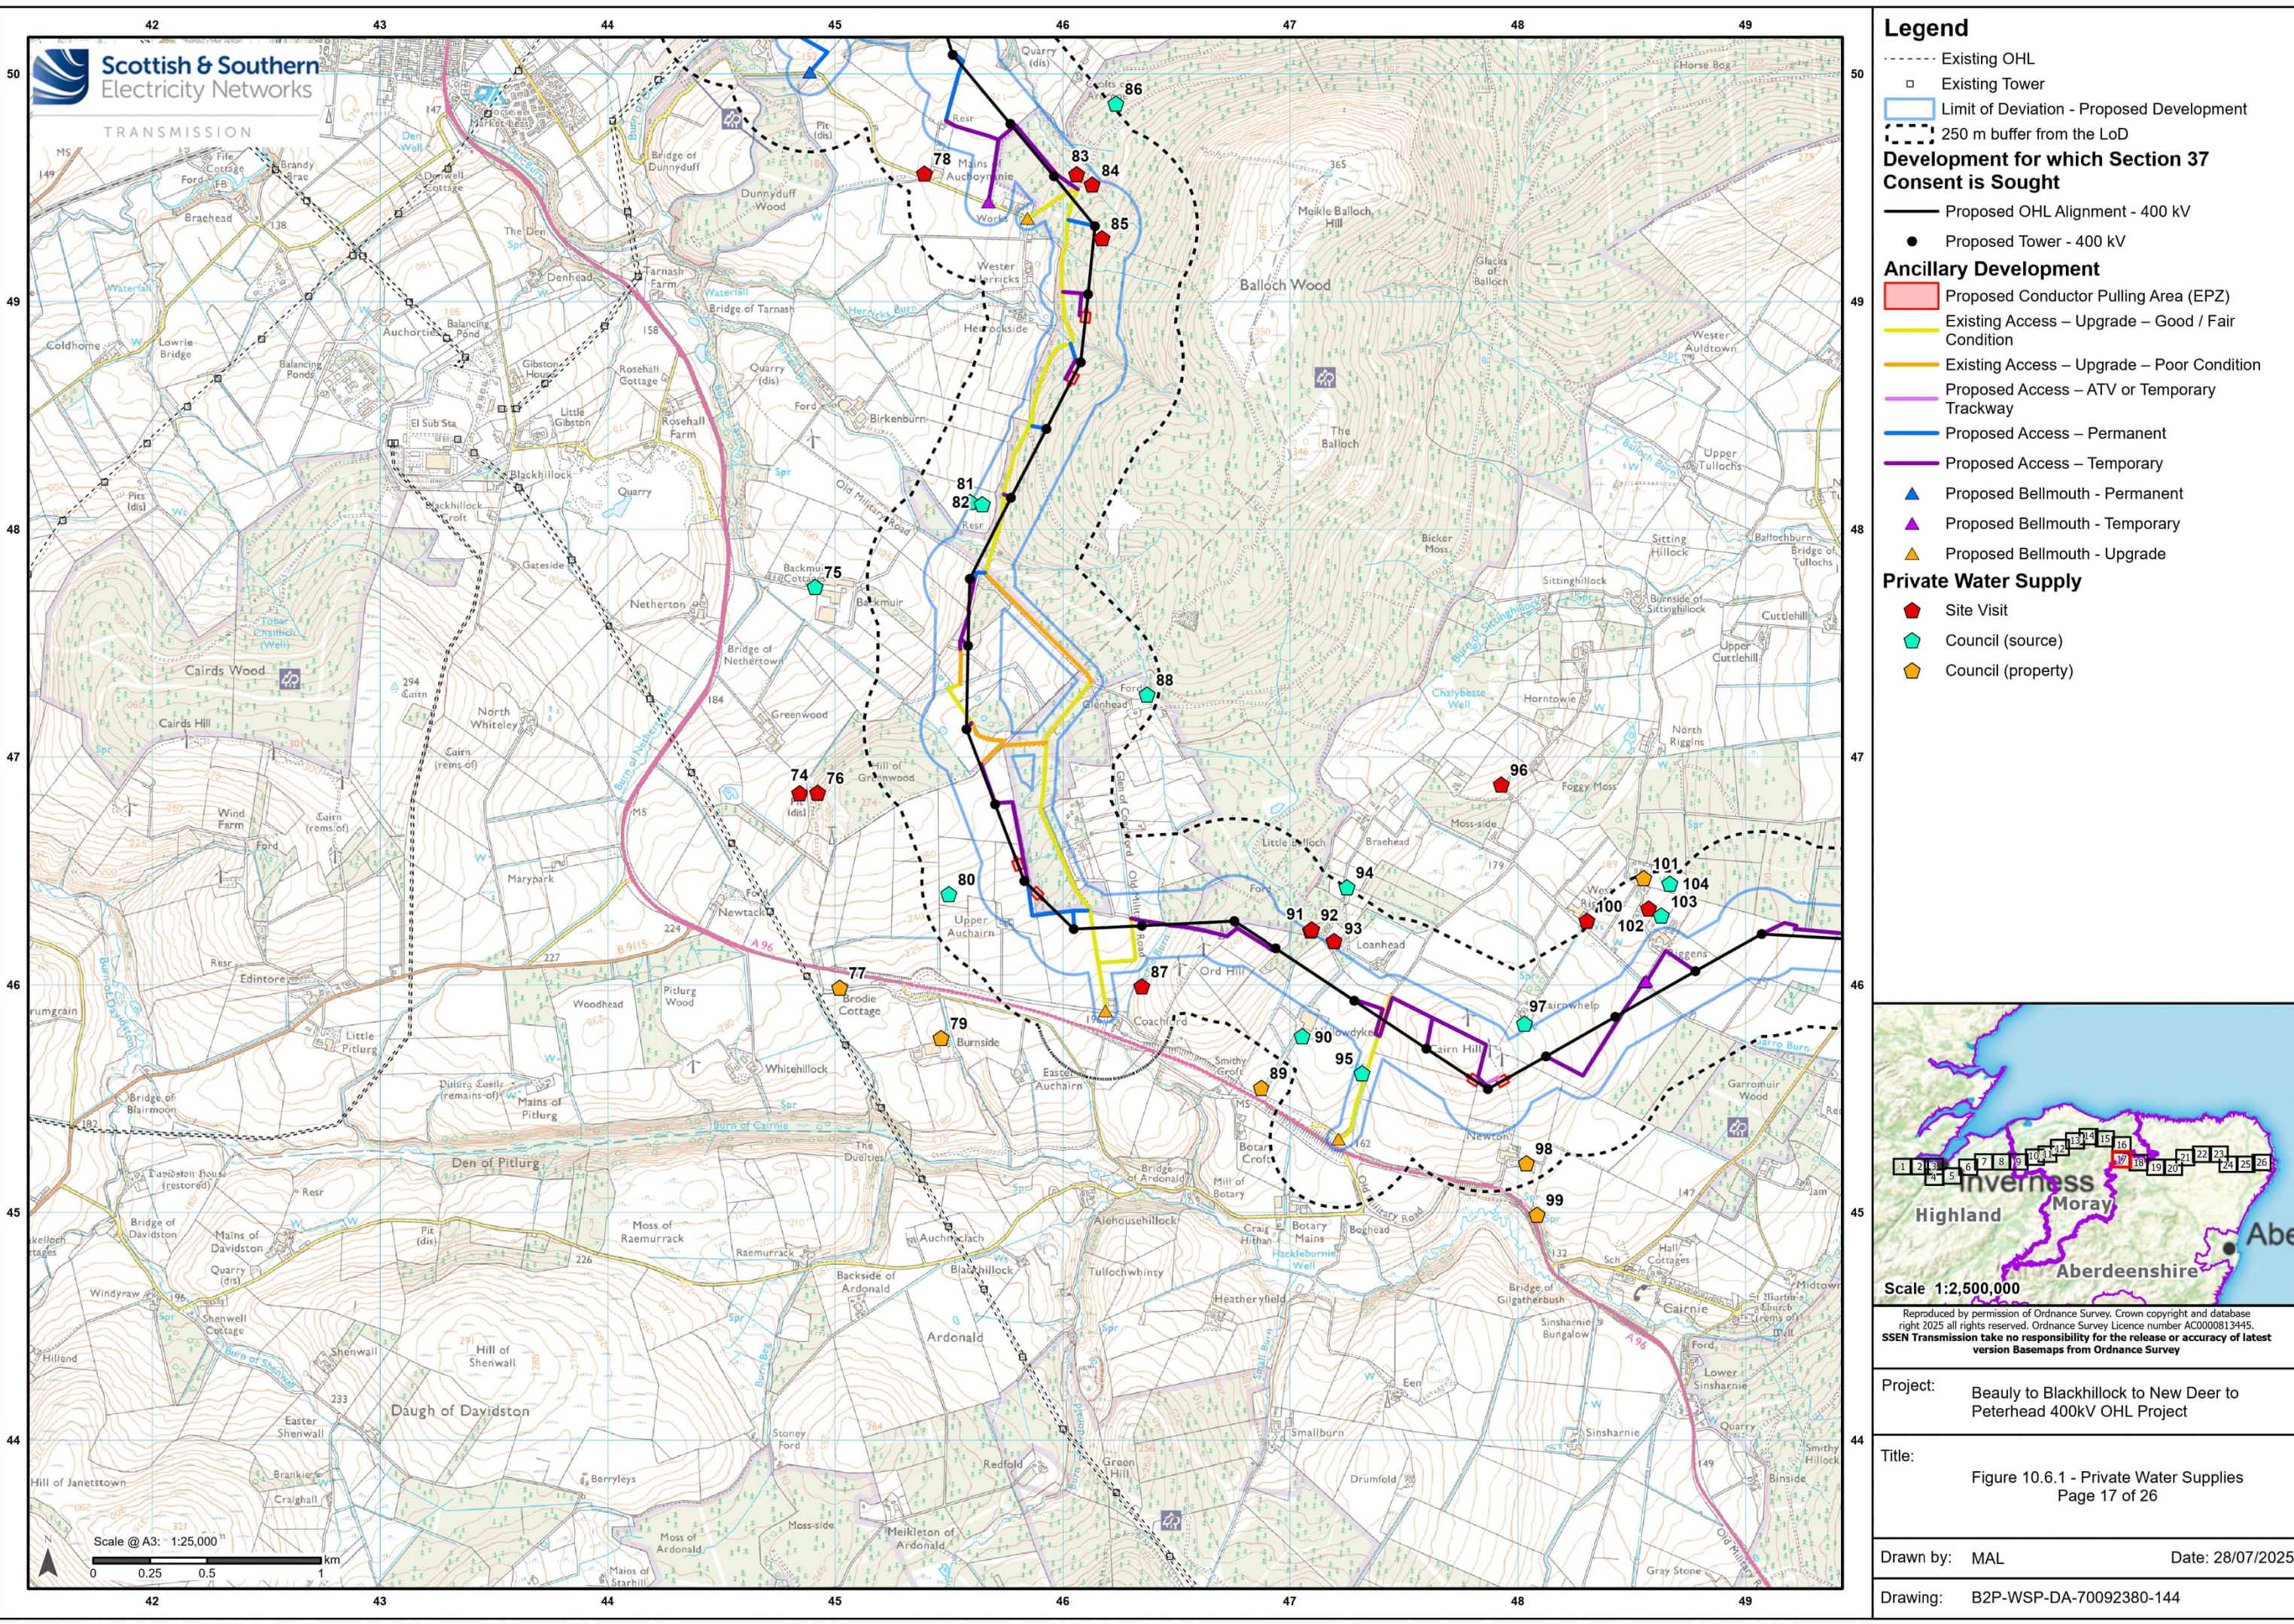

### Legend

- Existing OHL
- Existing Tower
- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV
- Ancillary Development**
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Permanent
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade
- Private Water Supply**
- Site Visit
- Council (source)
- Council (property)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 17 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144

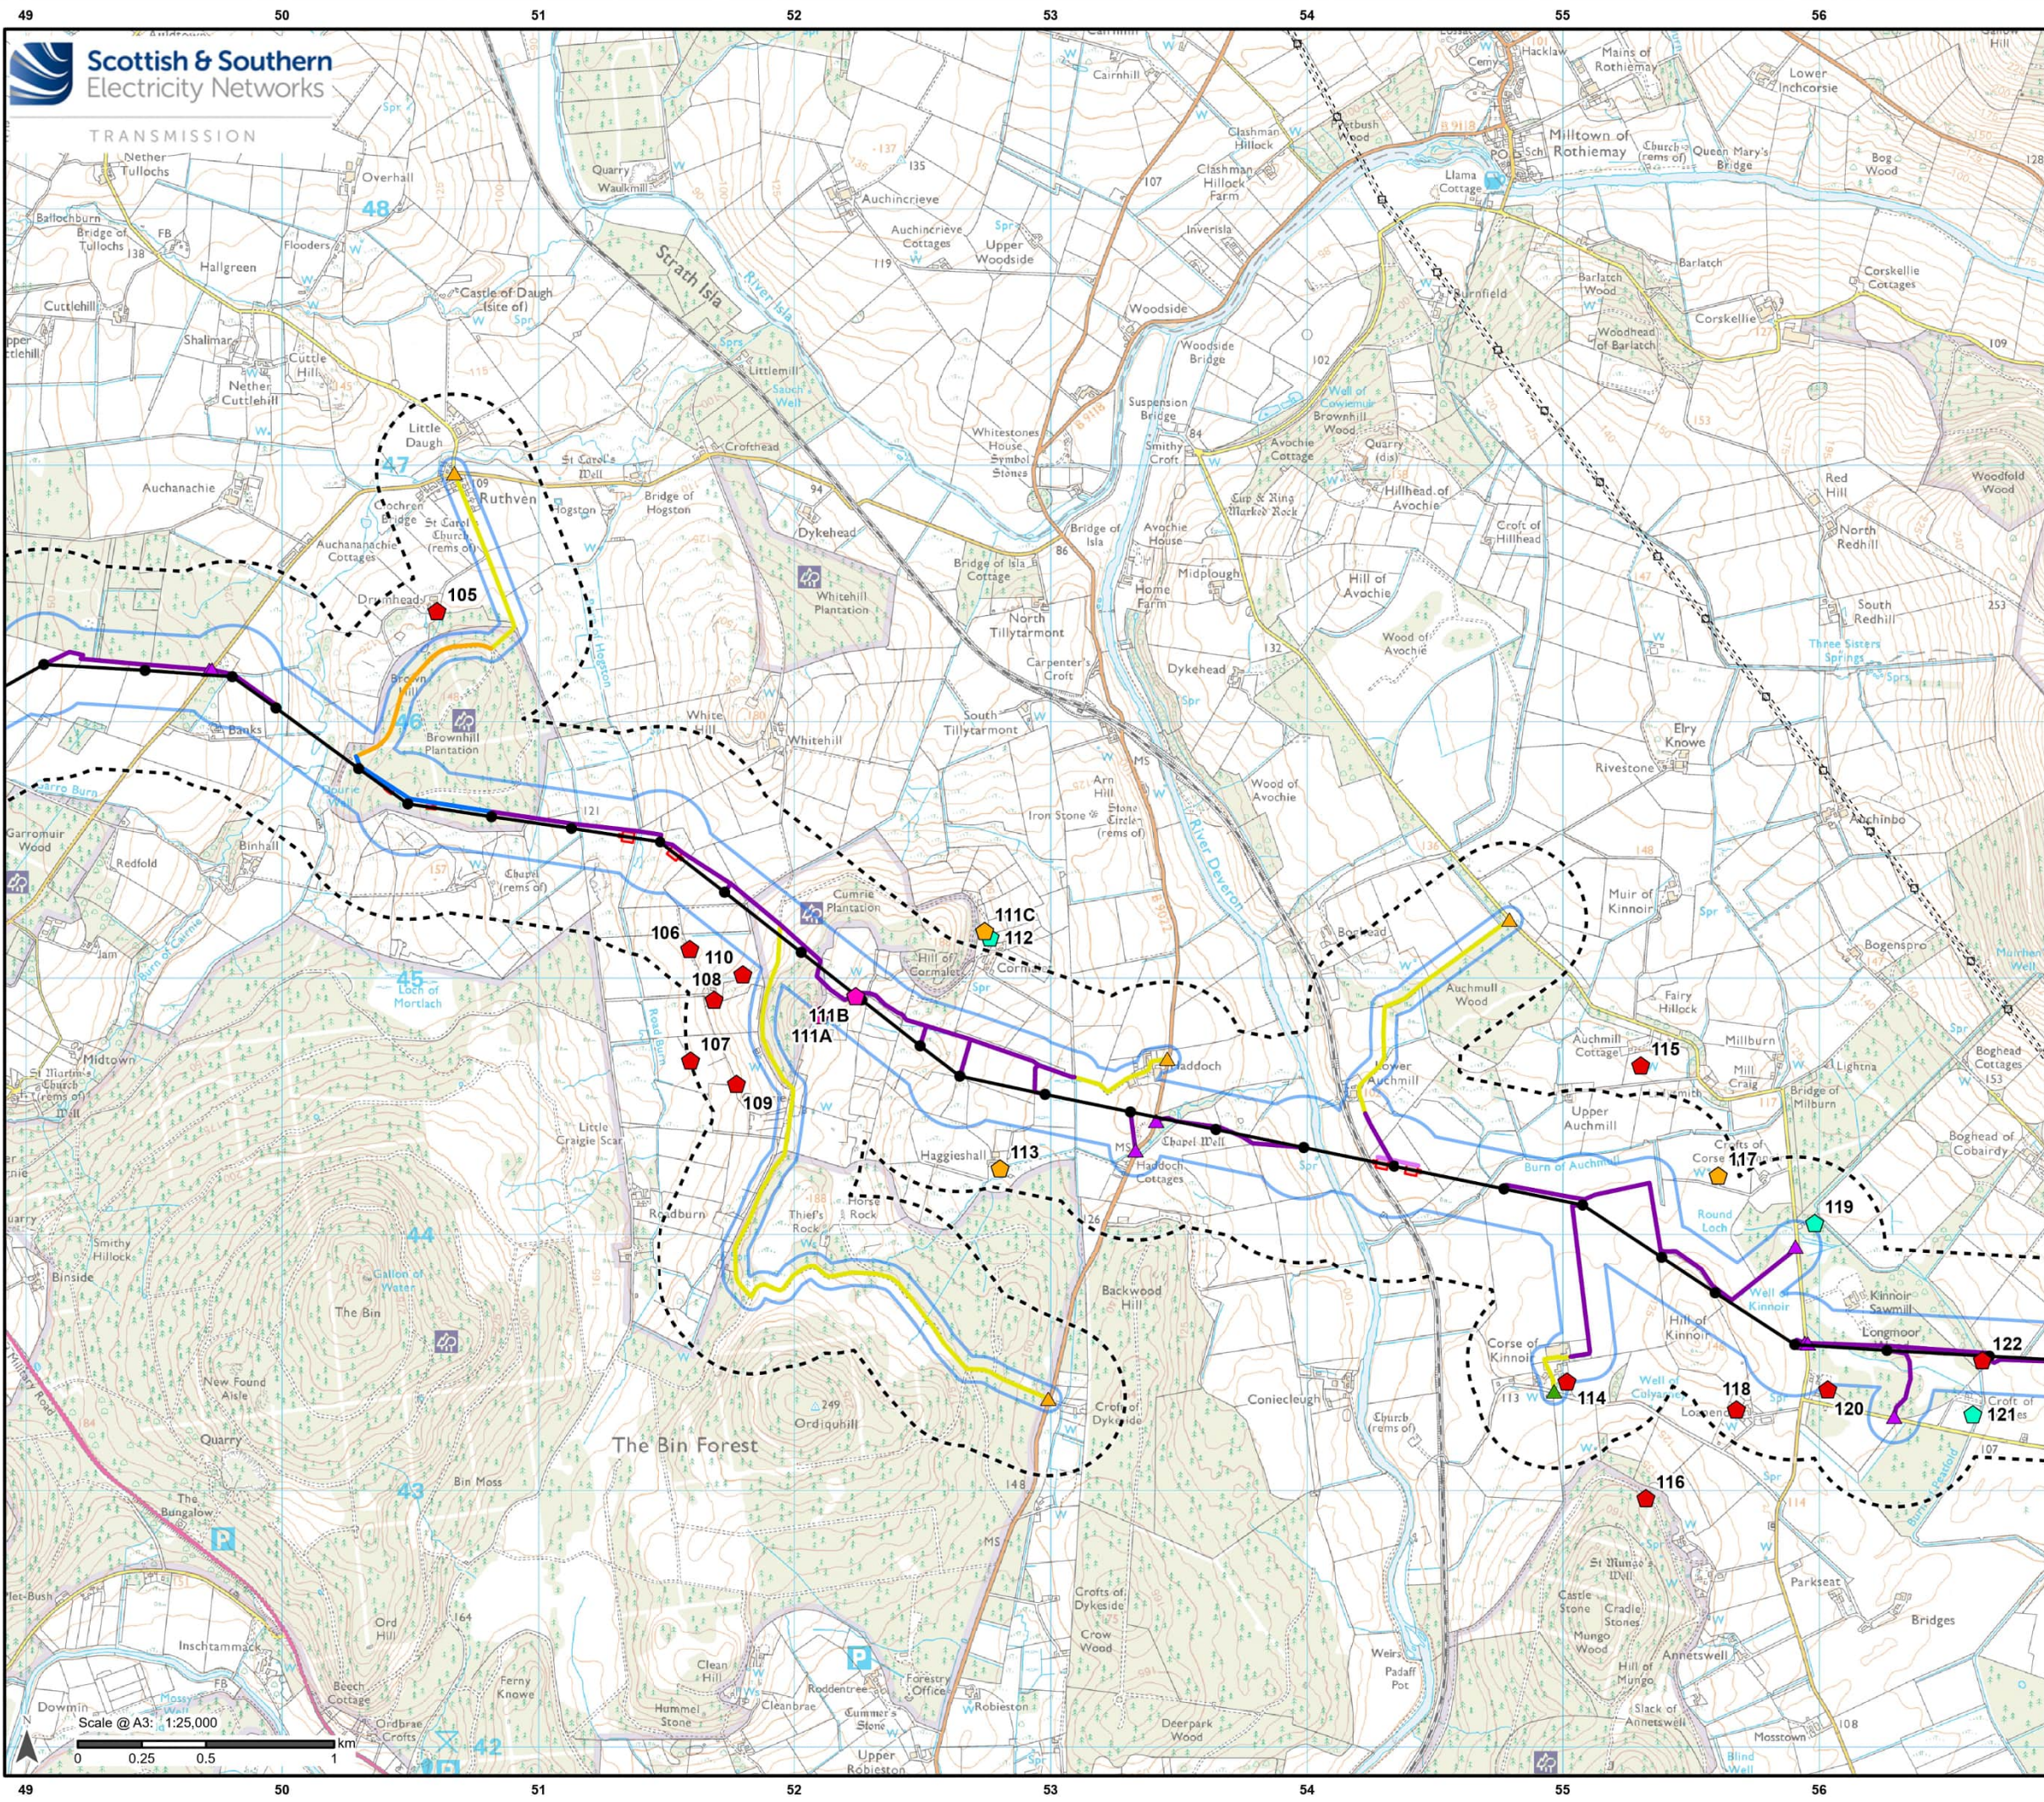

### Legend

- Existing OHL
- Existing Tower
- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD

#### Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

#### Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Access Only / ATV
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade


#### Private Water Supply

- Site Visit
- Council (source)
- Council (property)
- Questionnaire

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

|           |                                                                     |       |            |
|-----------|---------------------------------------------------------------------|-------|------------|
| Project:  | Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project |       |            |
| Title:    | Figure 10.6.1 - Private Water Supplies<br>Page 18 of 26             |       |            |
| Drawn by: | MAL                                                                 | Date: | 28/07/2025 |
| Drawing:  | B2P-WSP-DA-70092380-144                                             |       |            |

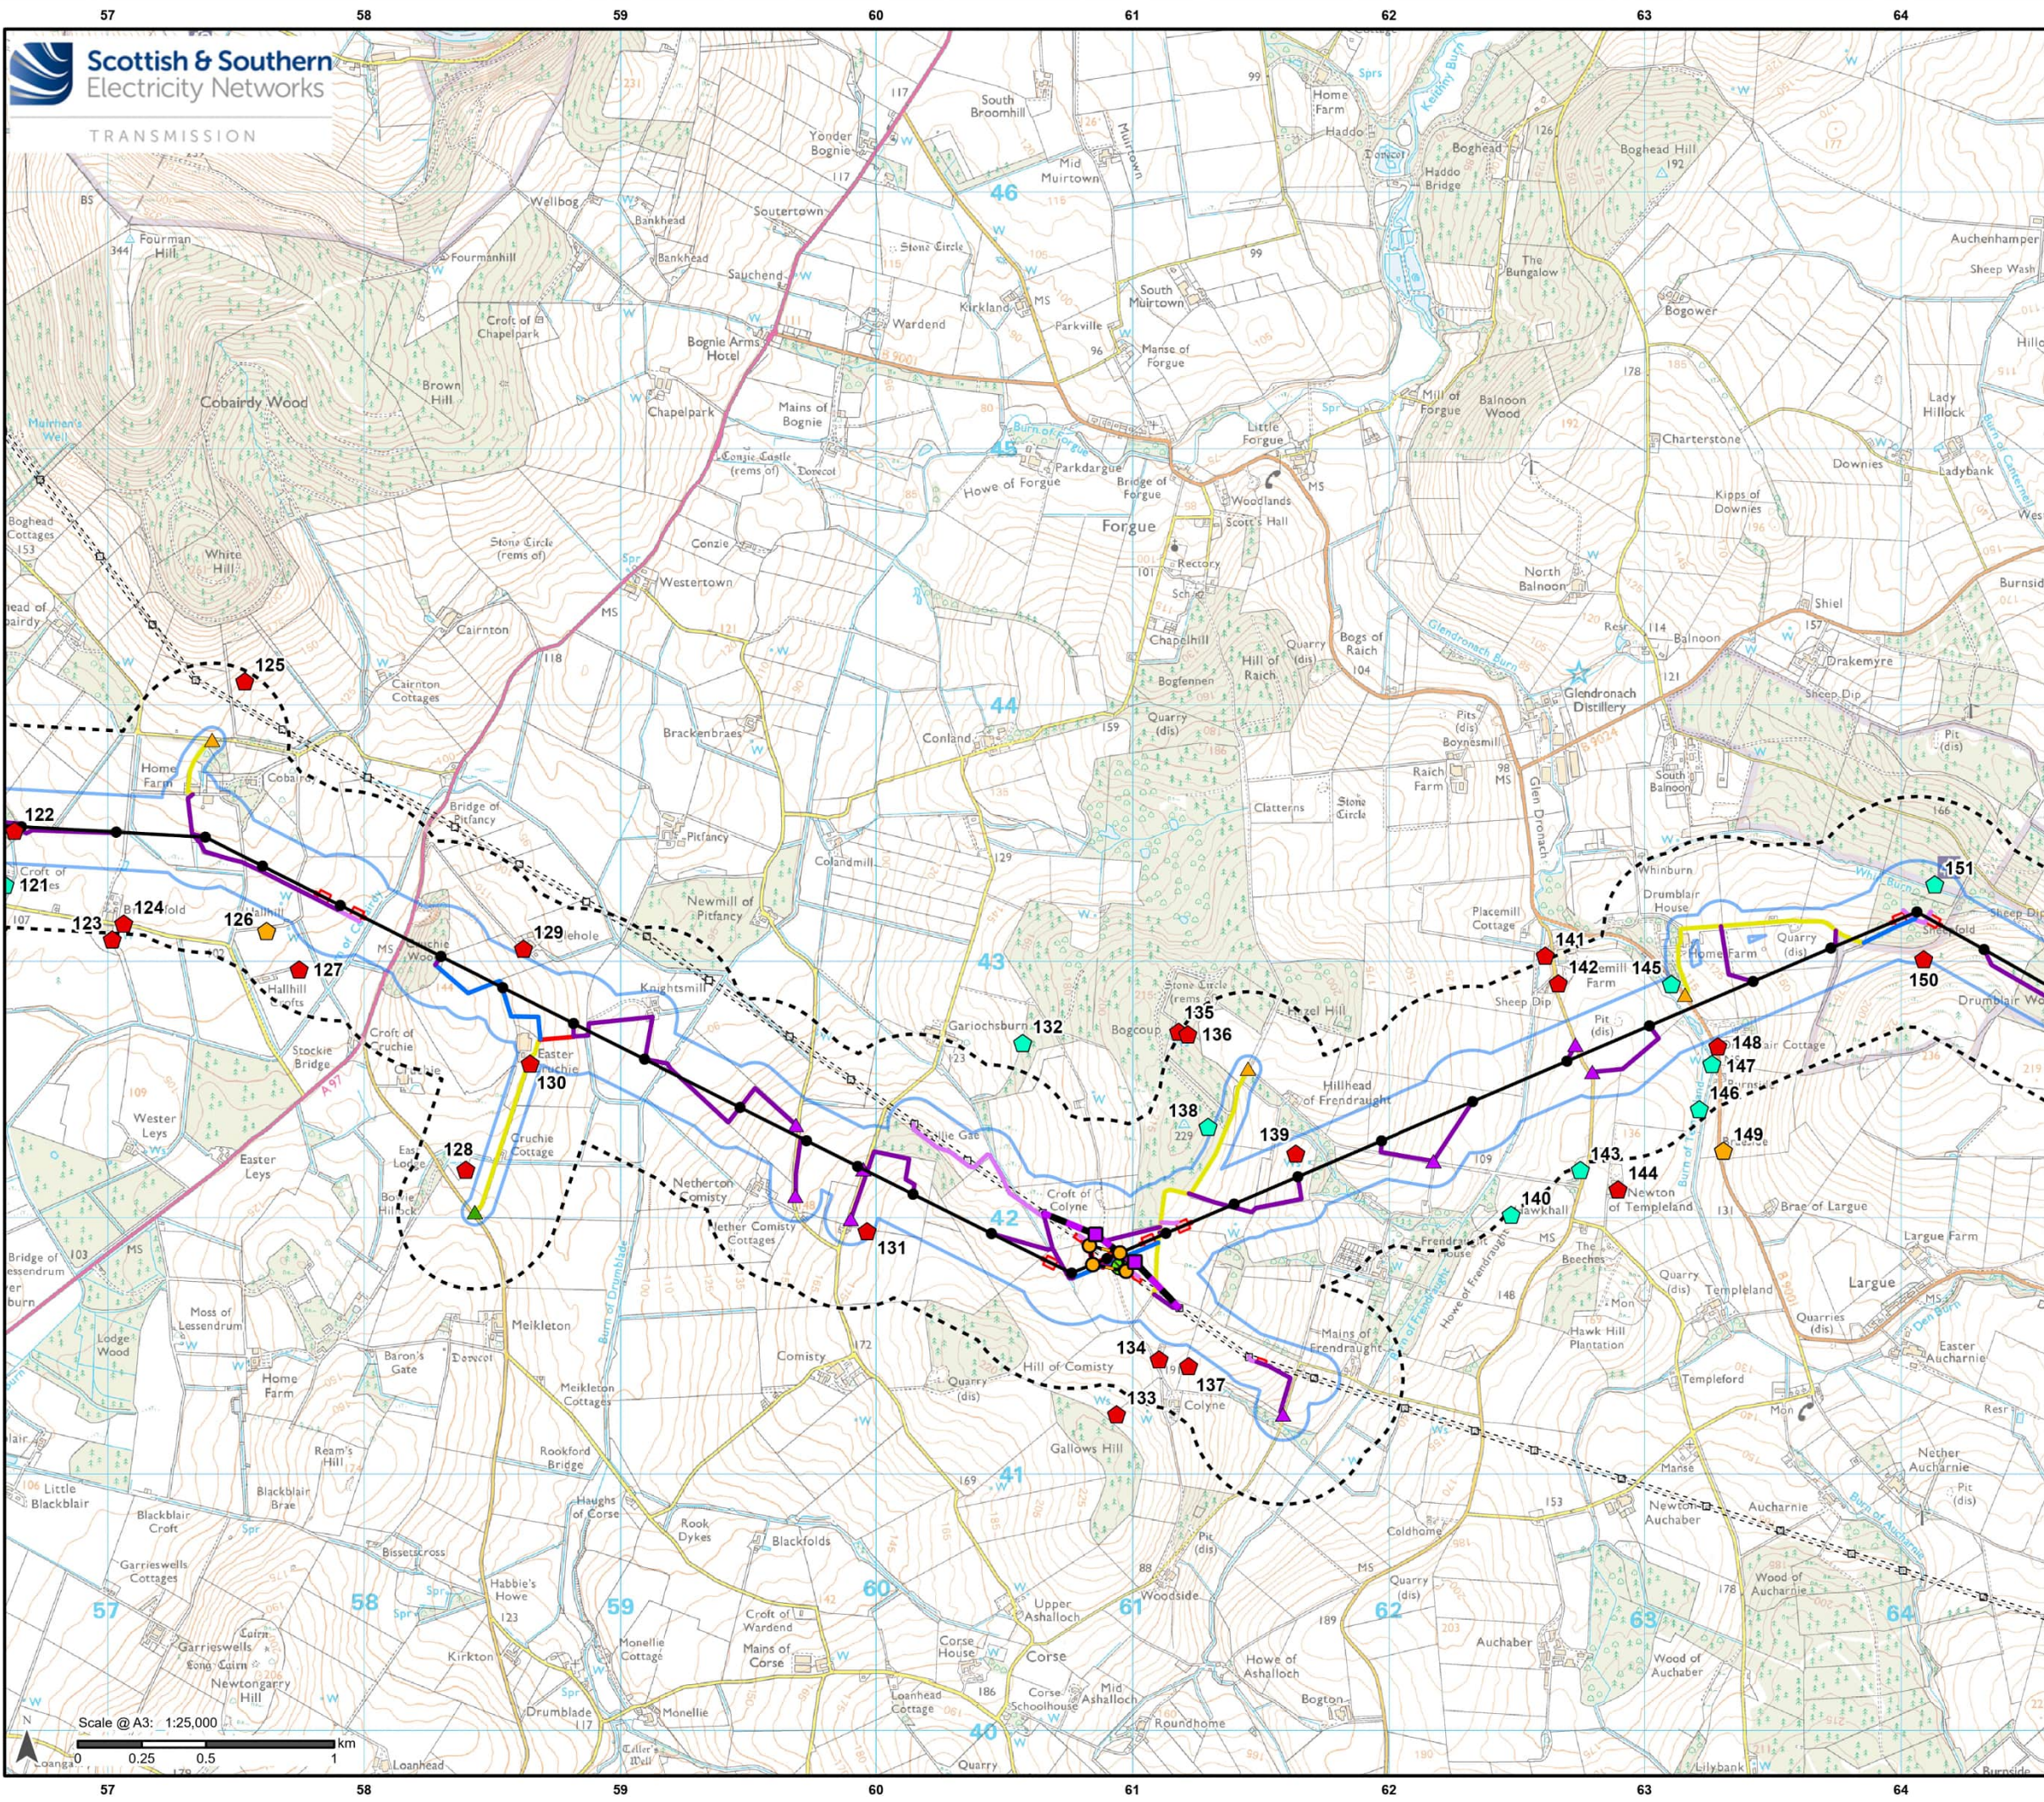

### Legend

- Existing OHL
- Existing Tower
- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
  - Proposed OHL Alignment - 400 kV
  - Temporary OHL Diversion
  - Proposed Alignment - Existing OHL Works (275 kV Realignment and Crossings)
  - Proposed Tower - 400 kV
  - Proposed Tower - Existing OHL Works (275 kV Realignment and Crossing)
  - Proposed Tower - Temporary
- Ancillary Development**
  - Tower to be Removed
  - Proposed Conductor Pulling Area (EPZ)
  - Existing Access – Upgrade – Good / Fair Condition
  - Existing Access – Upgrade – Very Poor Condition
  - Proposed Access – ATV or Temporary Trackway
  - Proposed Access – Permanent
  - Proposed Access – Temporary
  - Proposed Bellmouth - Access Only / ATV
  - Proposed Bellmouth - Temporary
  - Proposed Bellmouth - Upgrade
- Private Water Supply**
  - Site Visit
  - Council (source)
  - Council (property)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 19 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144

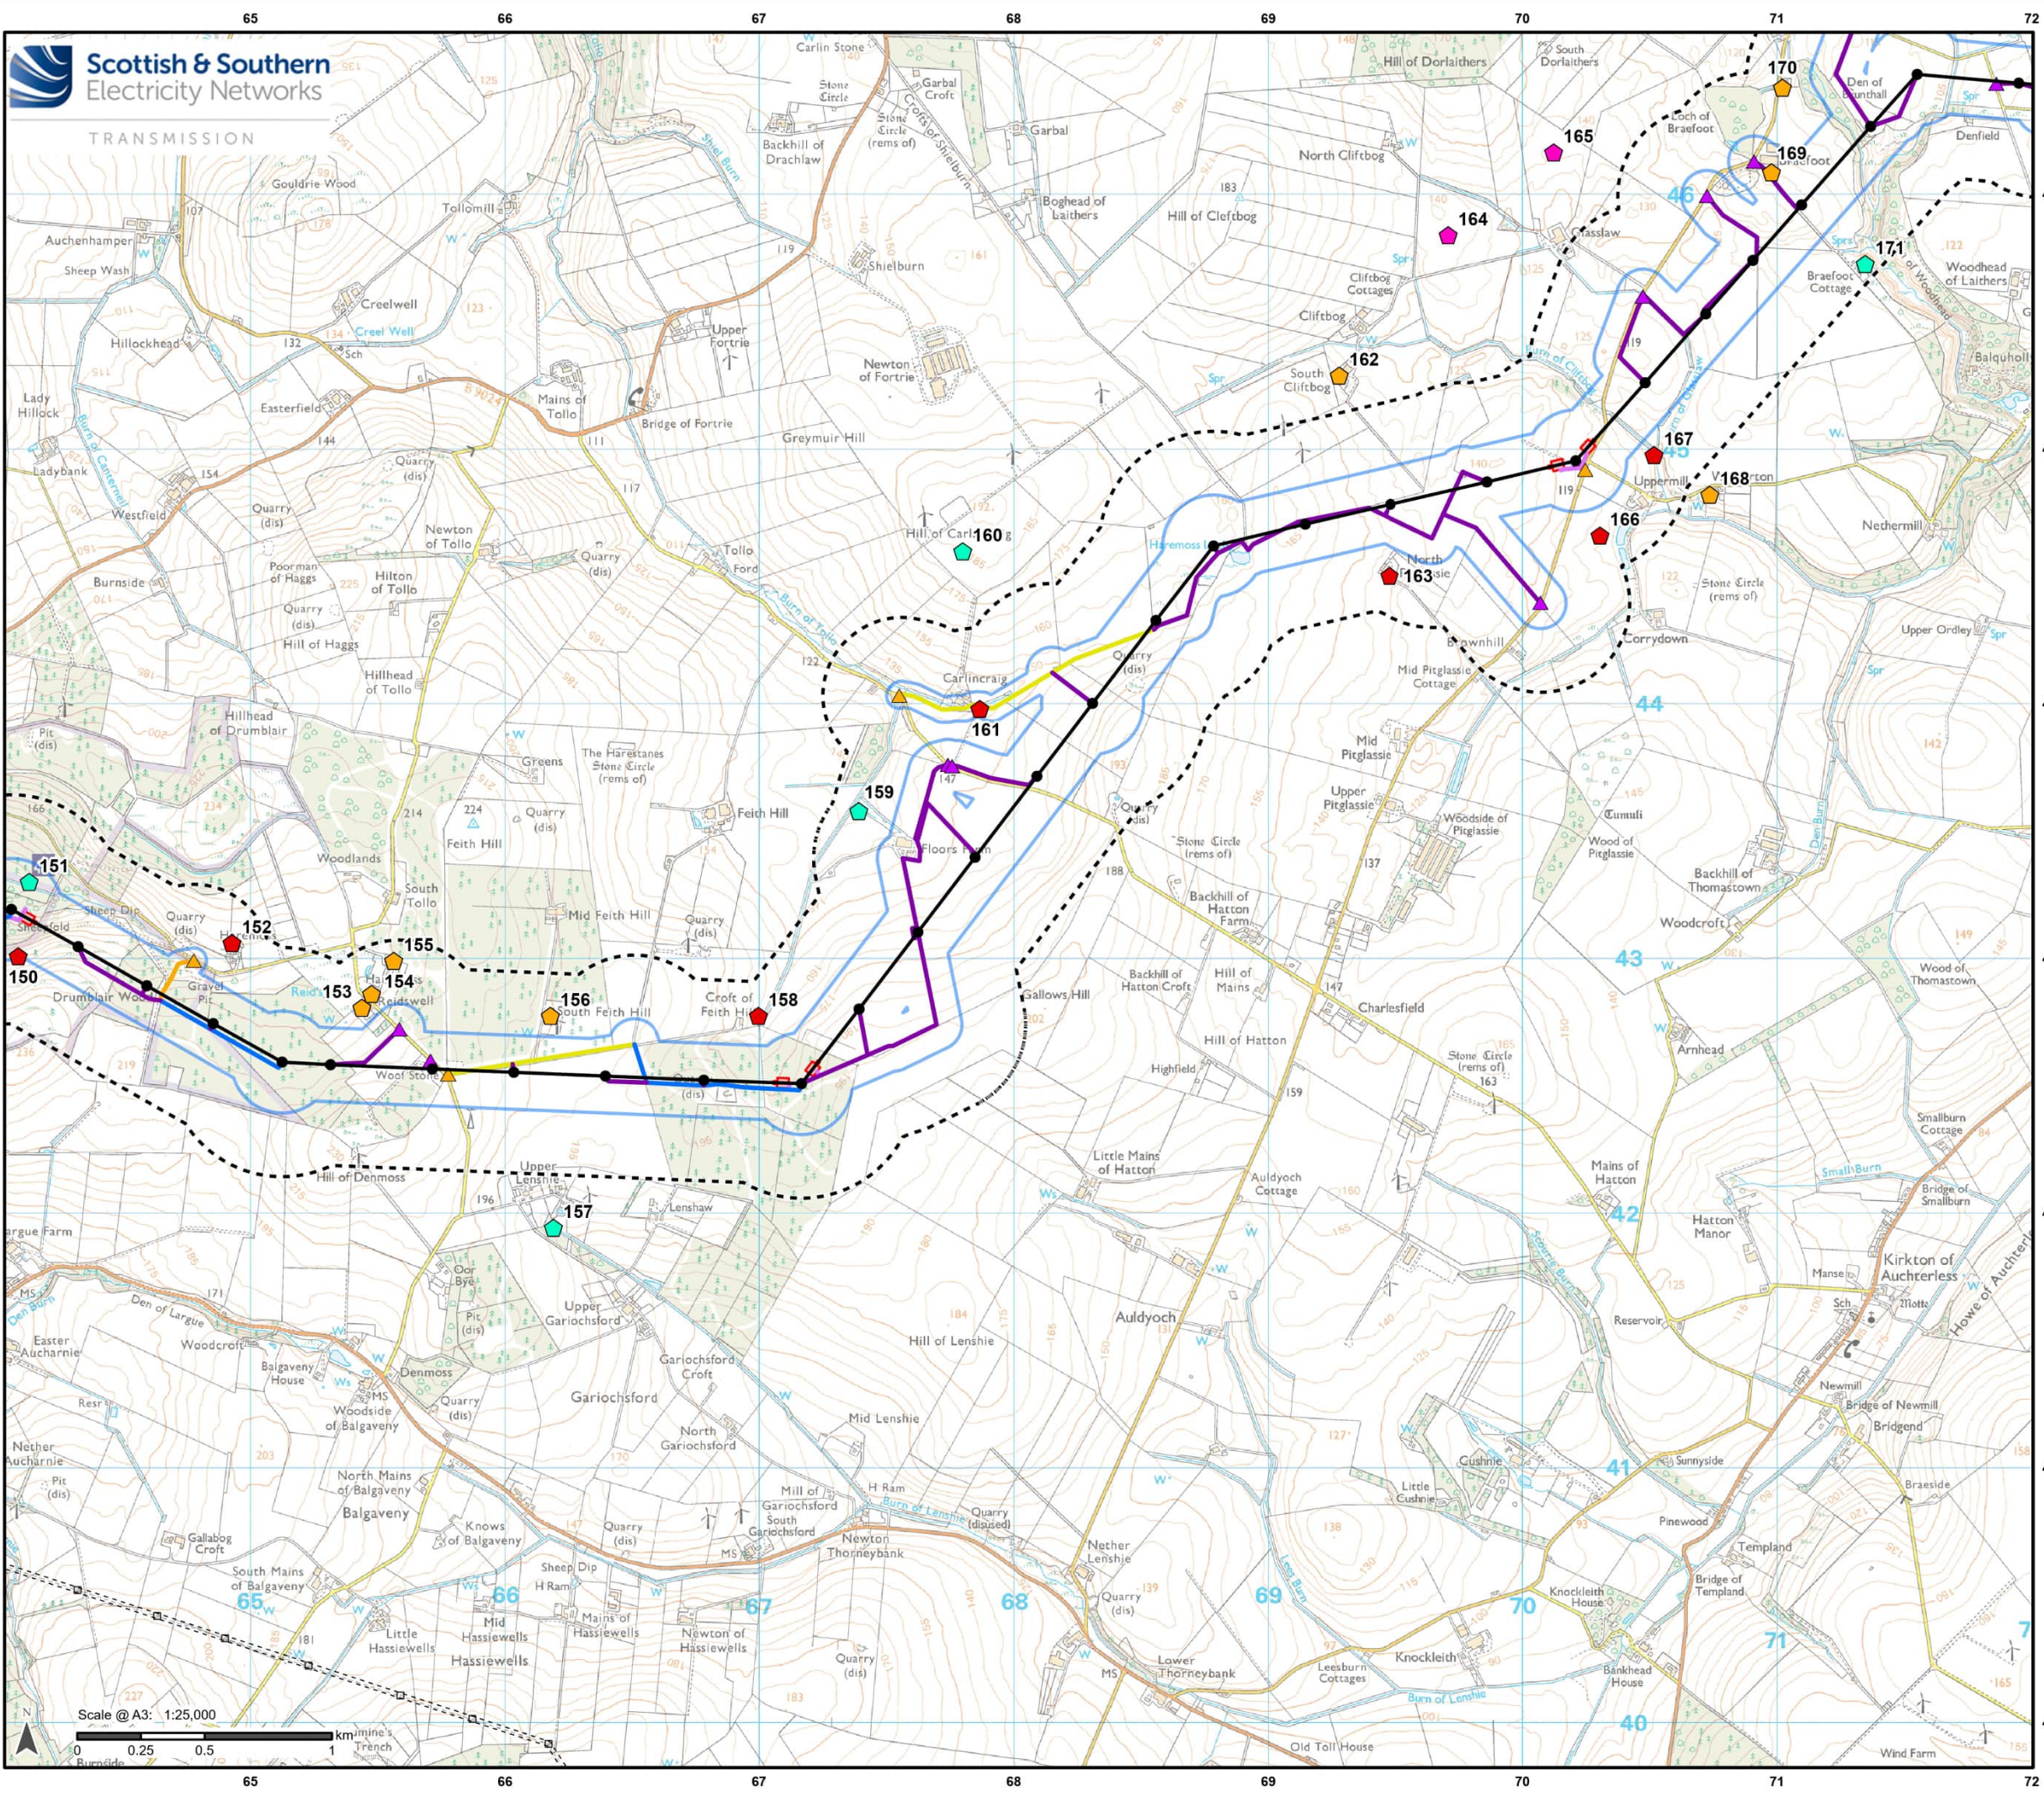

### Legend

- Existing OHL
- Existing Tower
- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV
- Ancillary Development**
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade
- Private Water Supply**
- Site Visit
- Council (source)
- Council (property)
- Questionnaire

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauty to Blackhillock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 20 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144

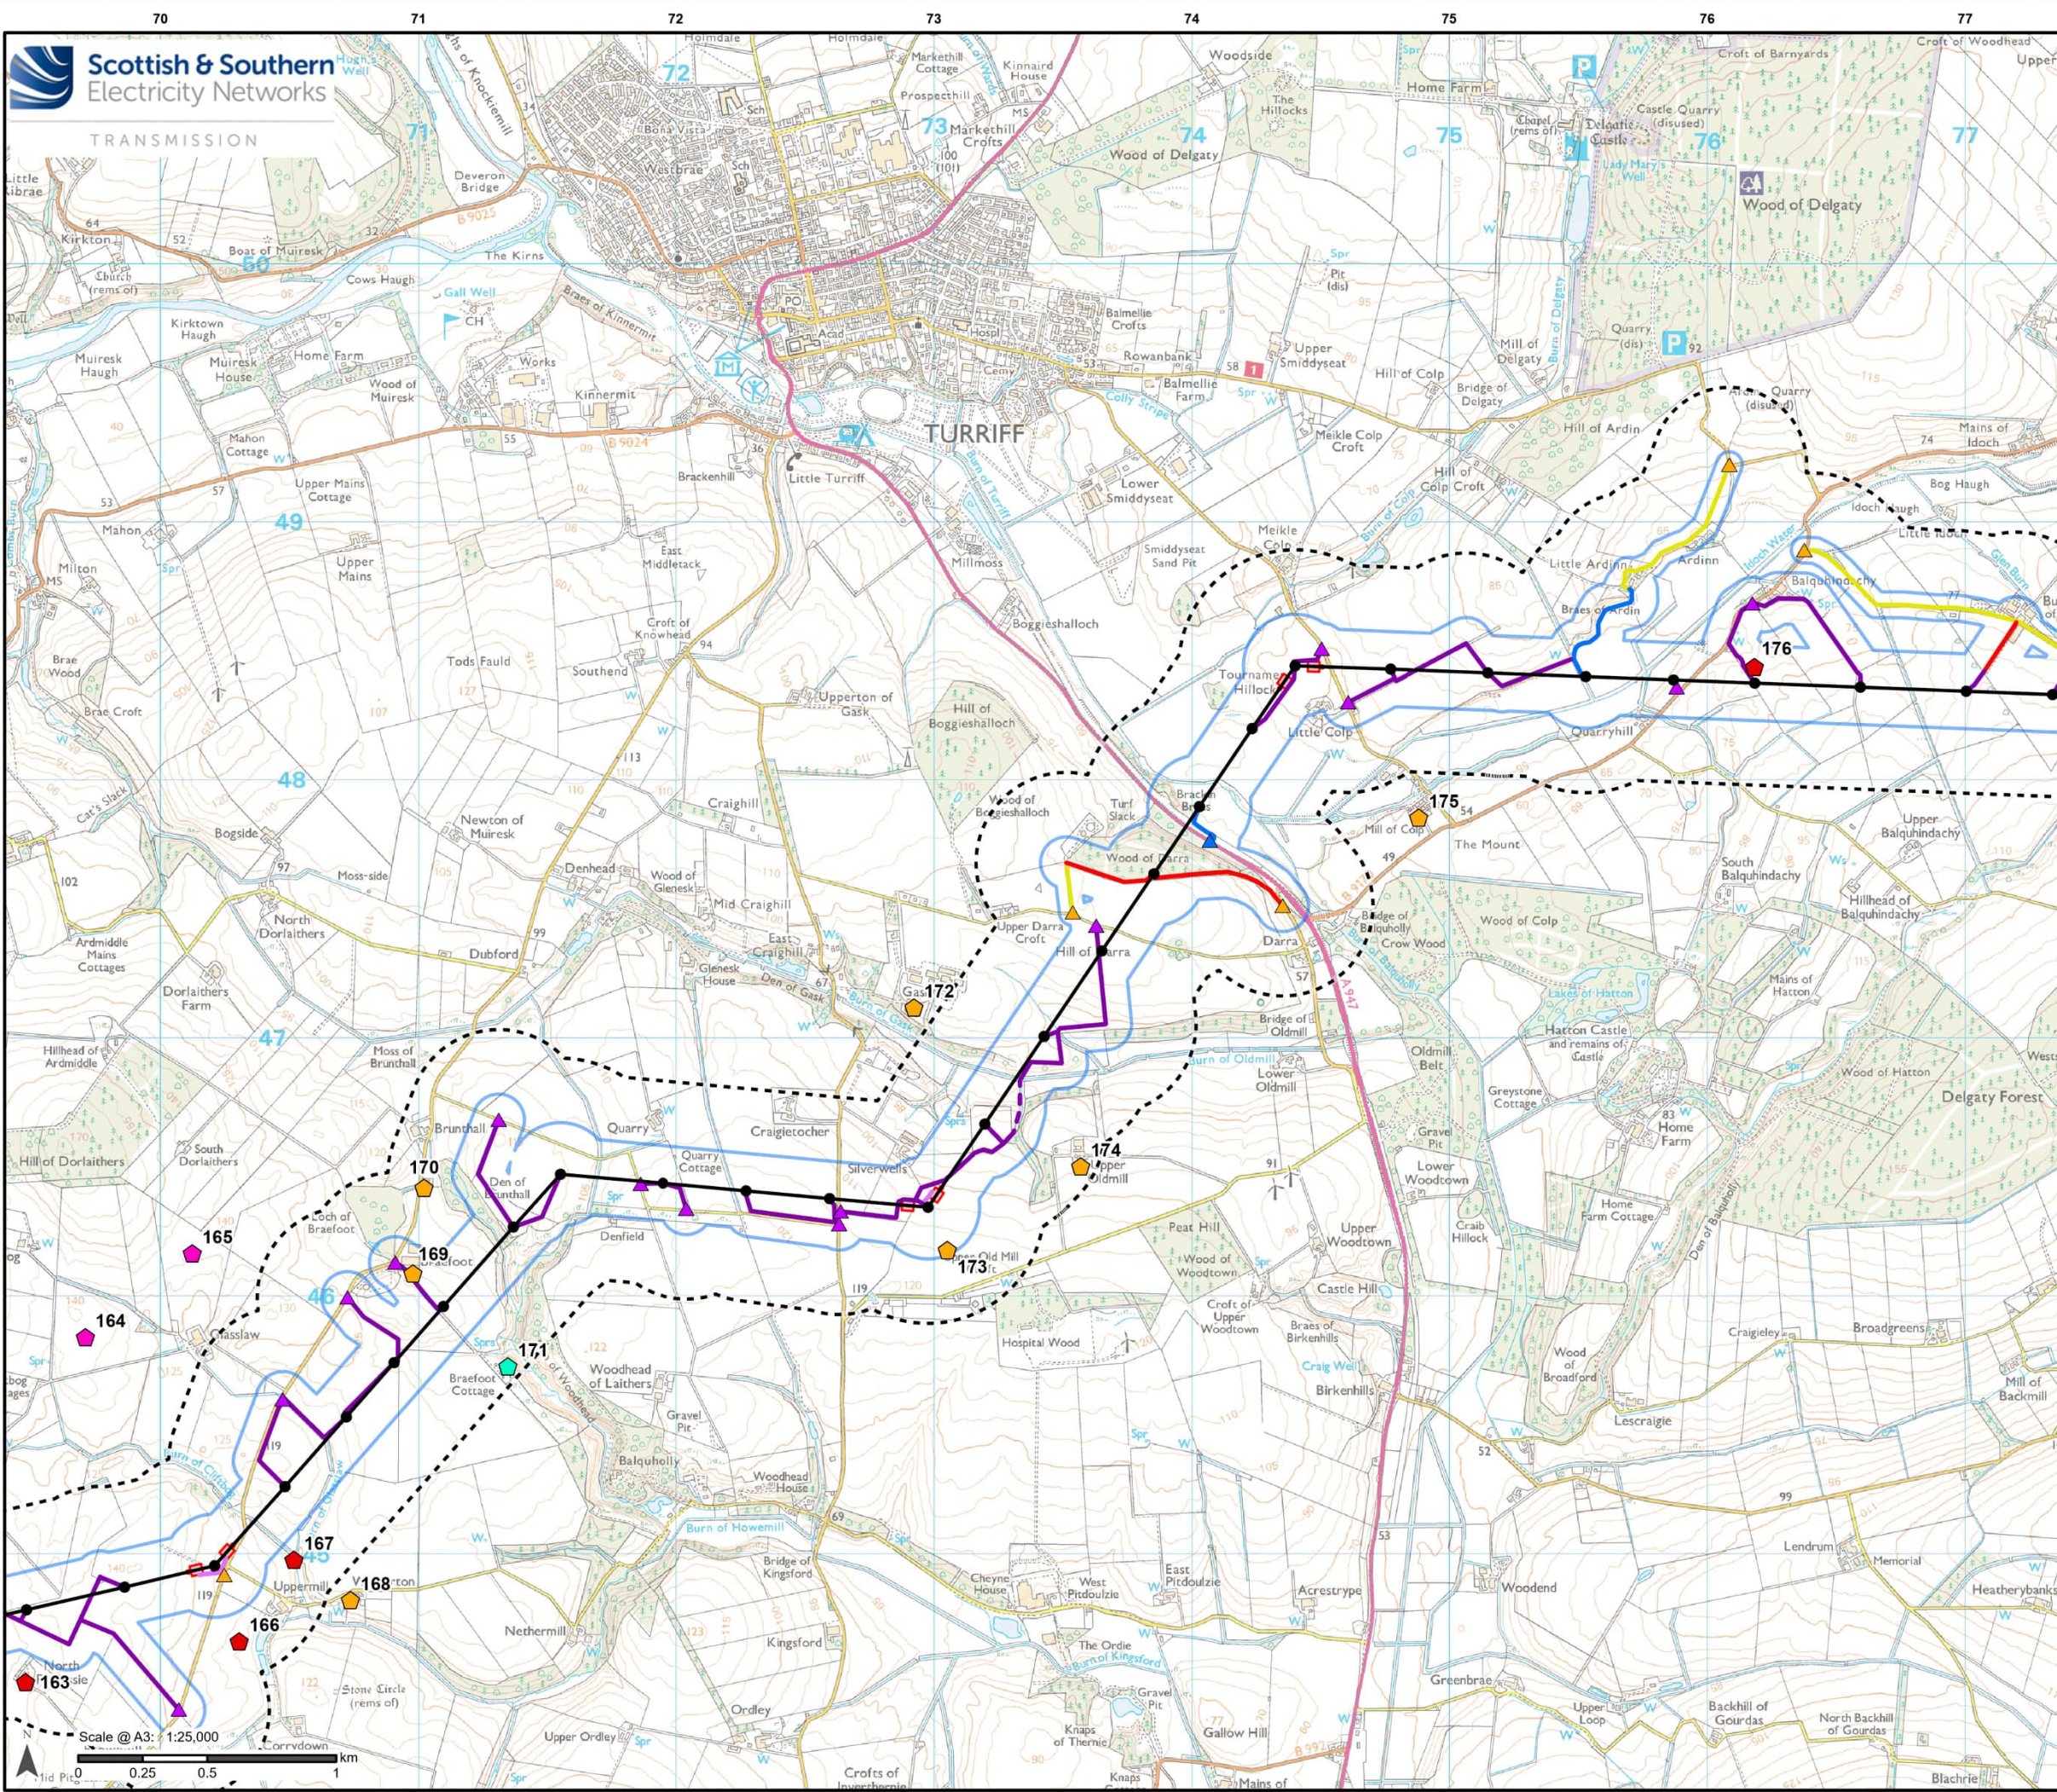

### Legend

- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
  - Proposed OHL Alignment - 400 kV
  - Proposed Tower - 400 kV
- Ancillary Development**
  - Proposed Conductor Pulling Area (EPZ)
  - Existing Access – Upgrade – Good / Fair Condition
  - Existing Access – Upgrade – Very Poor Condition
  - Proposed Access – ATV or Temporary Trackway
  - Proposed Access – Permanent
  - Proposed Access – Temporary
  - Proposed Access – Temporary Floated
  - Proposed Bellmouth - Permanent
  - Proposed Bellmouth - Temporary
  - Proposed Bellmouth - Upgrade
- Private Water Supply**
  - Site Visit
  - Council (source)
  - Council (property)
  - Questionnaire

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhilllock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 21 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144

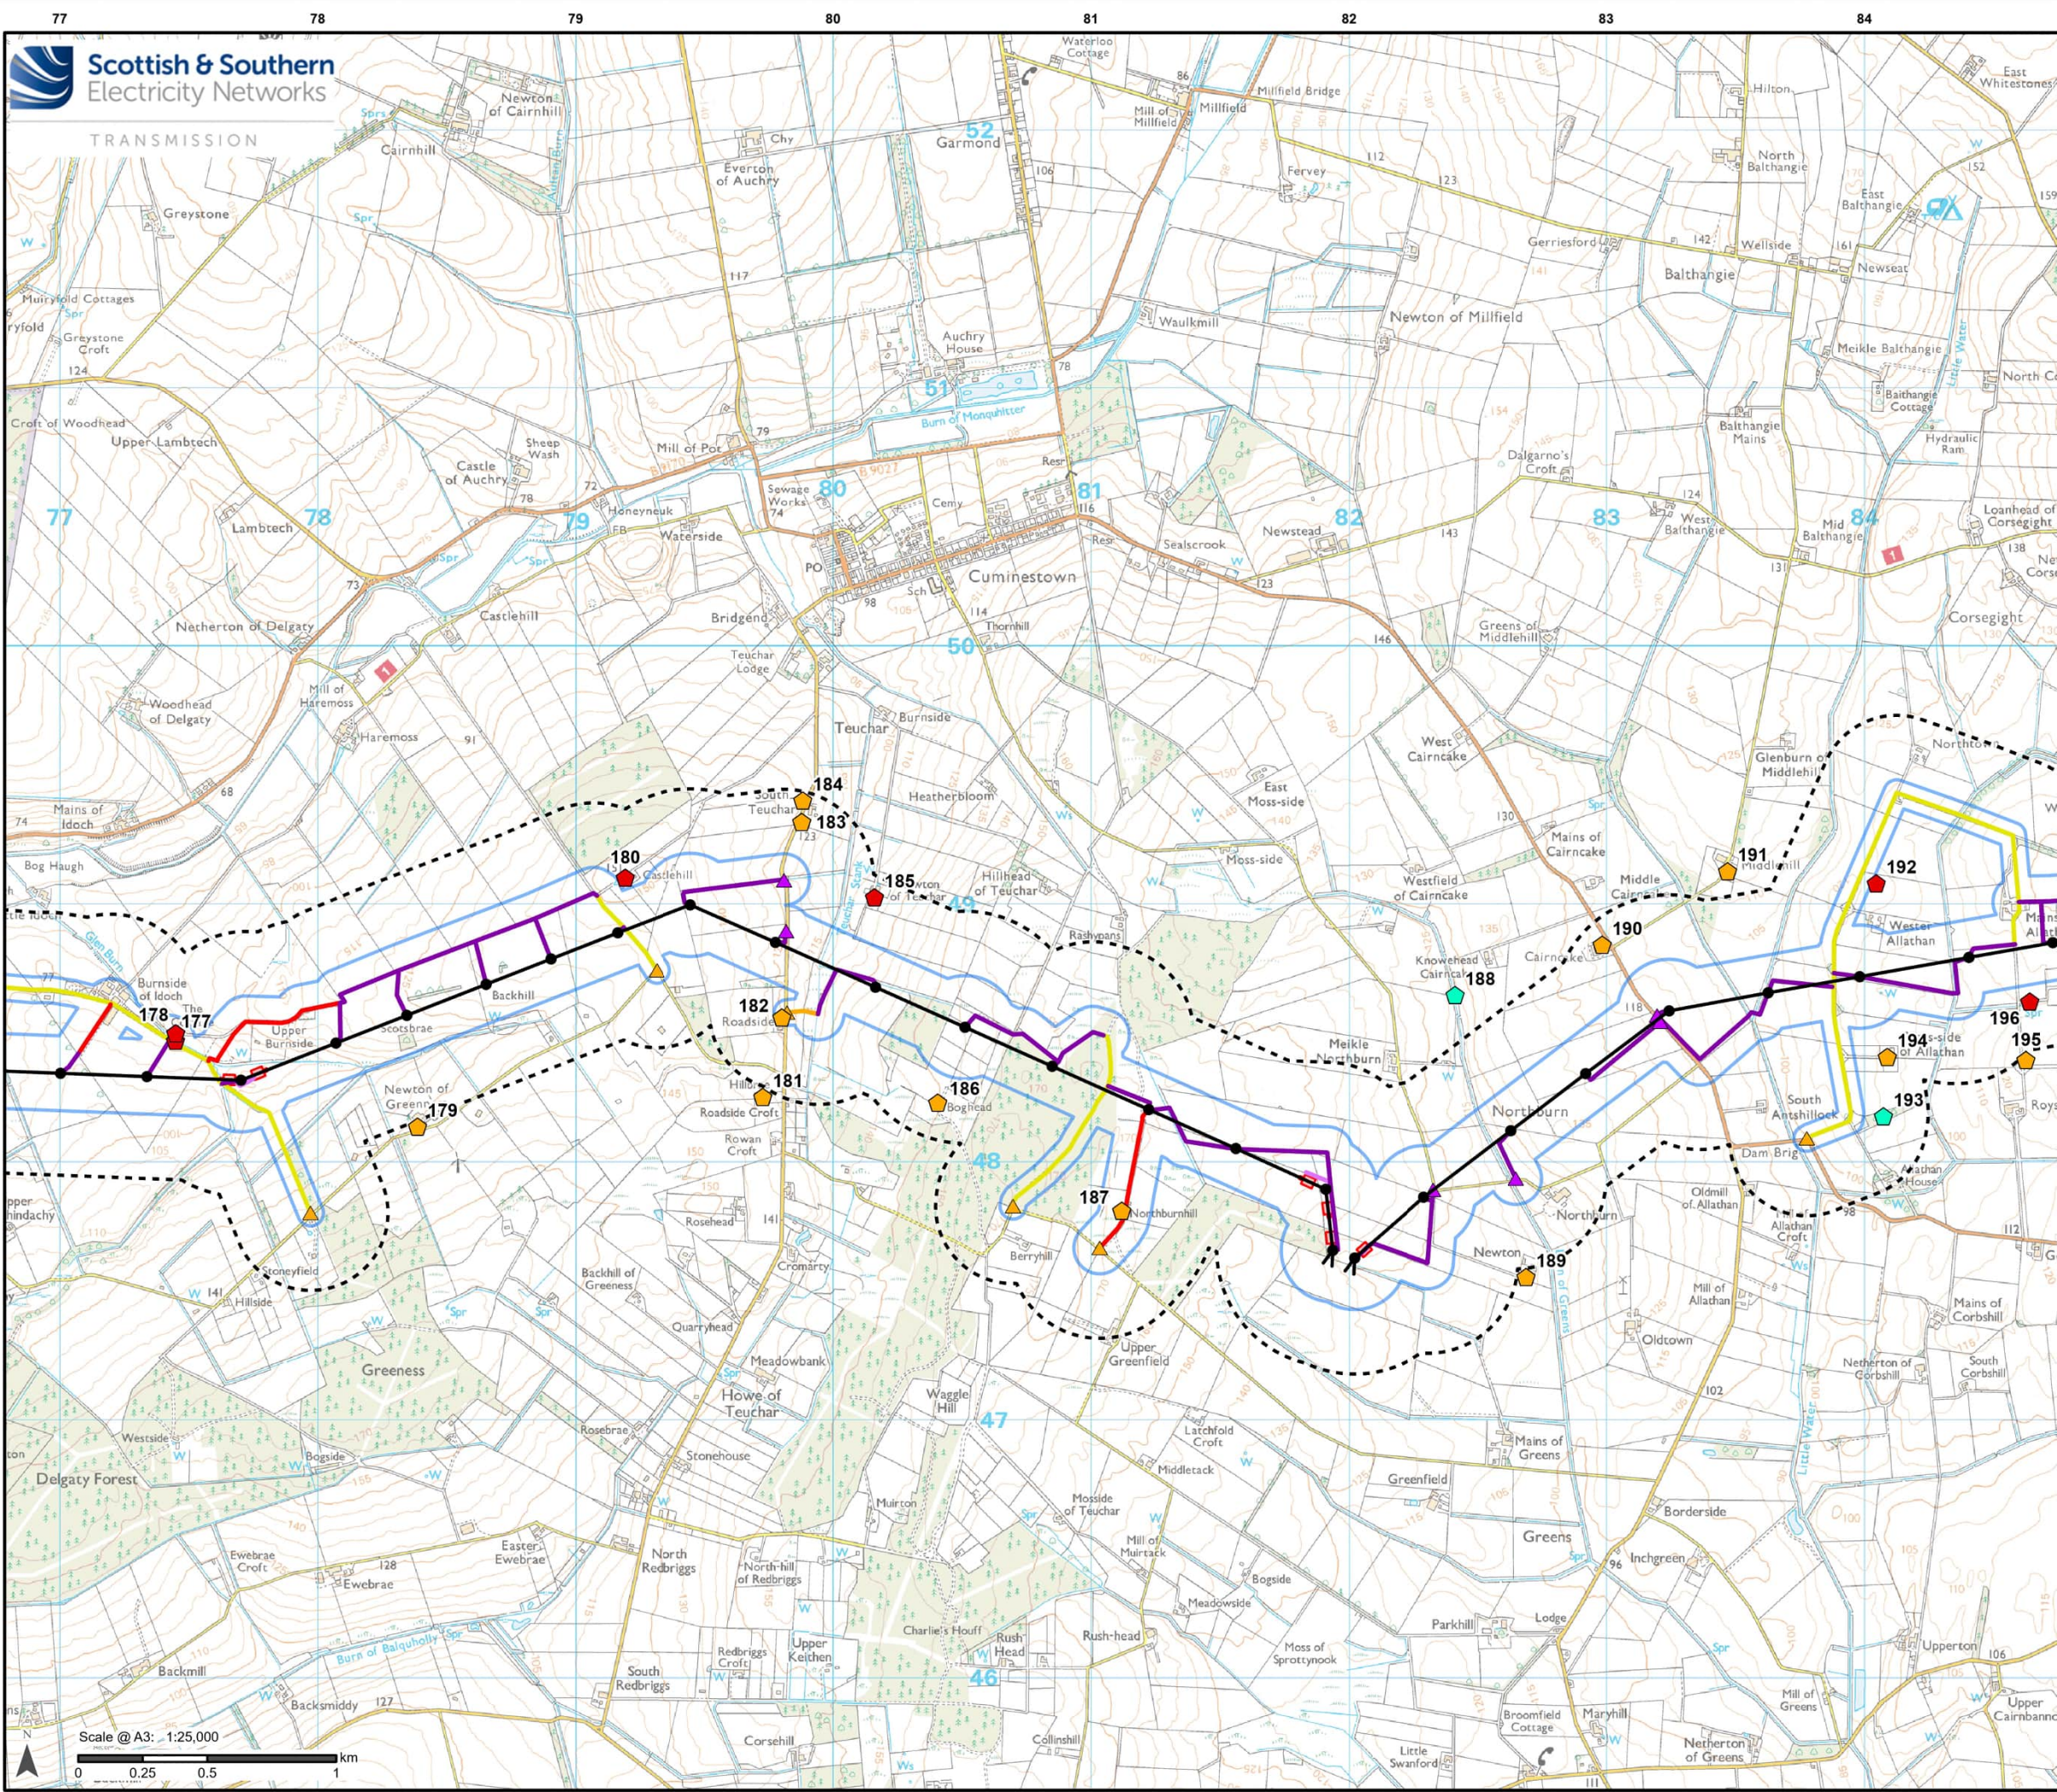

**Legend**

- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
  - Proposed OHL Alignment - 400 kV
  - Proposed Tower - 400 kV
- Ancillary Development**
  - Proposed Conductor Pulling Area (EPZ)
  - Existing Access – Upgrade – Good / Fair Condition
  - Existing Access – Upgrade – Poor Condition
  - Existing Access – Upgrade – Very Poor Condition
  - Proposed Access – ATV or Temporary Trackway
  - Proposed Access – Temporary
  - Proposed Bellmouth - Temporary
  - Proposed Bellmouth - Upgrade
- Private Water Supply**
  - Site Visit
  - Council (source)
  - Council (property)

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project: Beaulieu to Blackhilllock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 22 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144



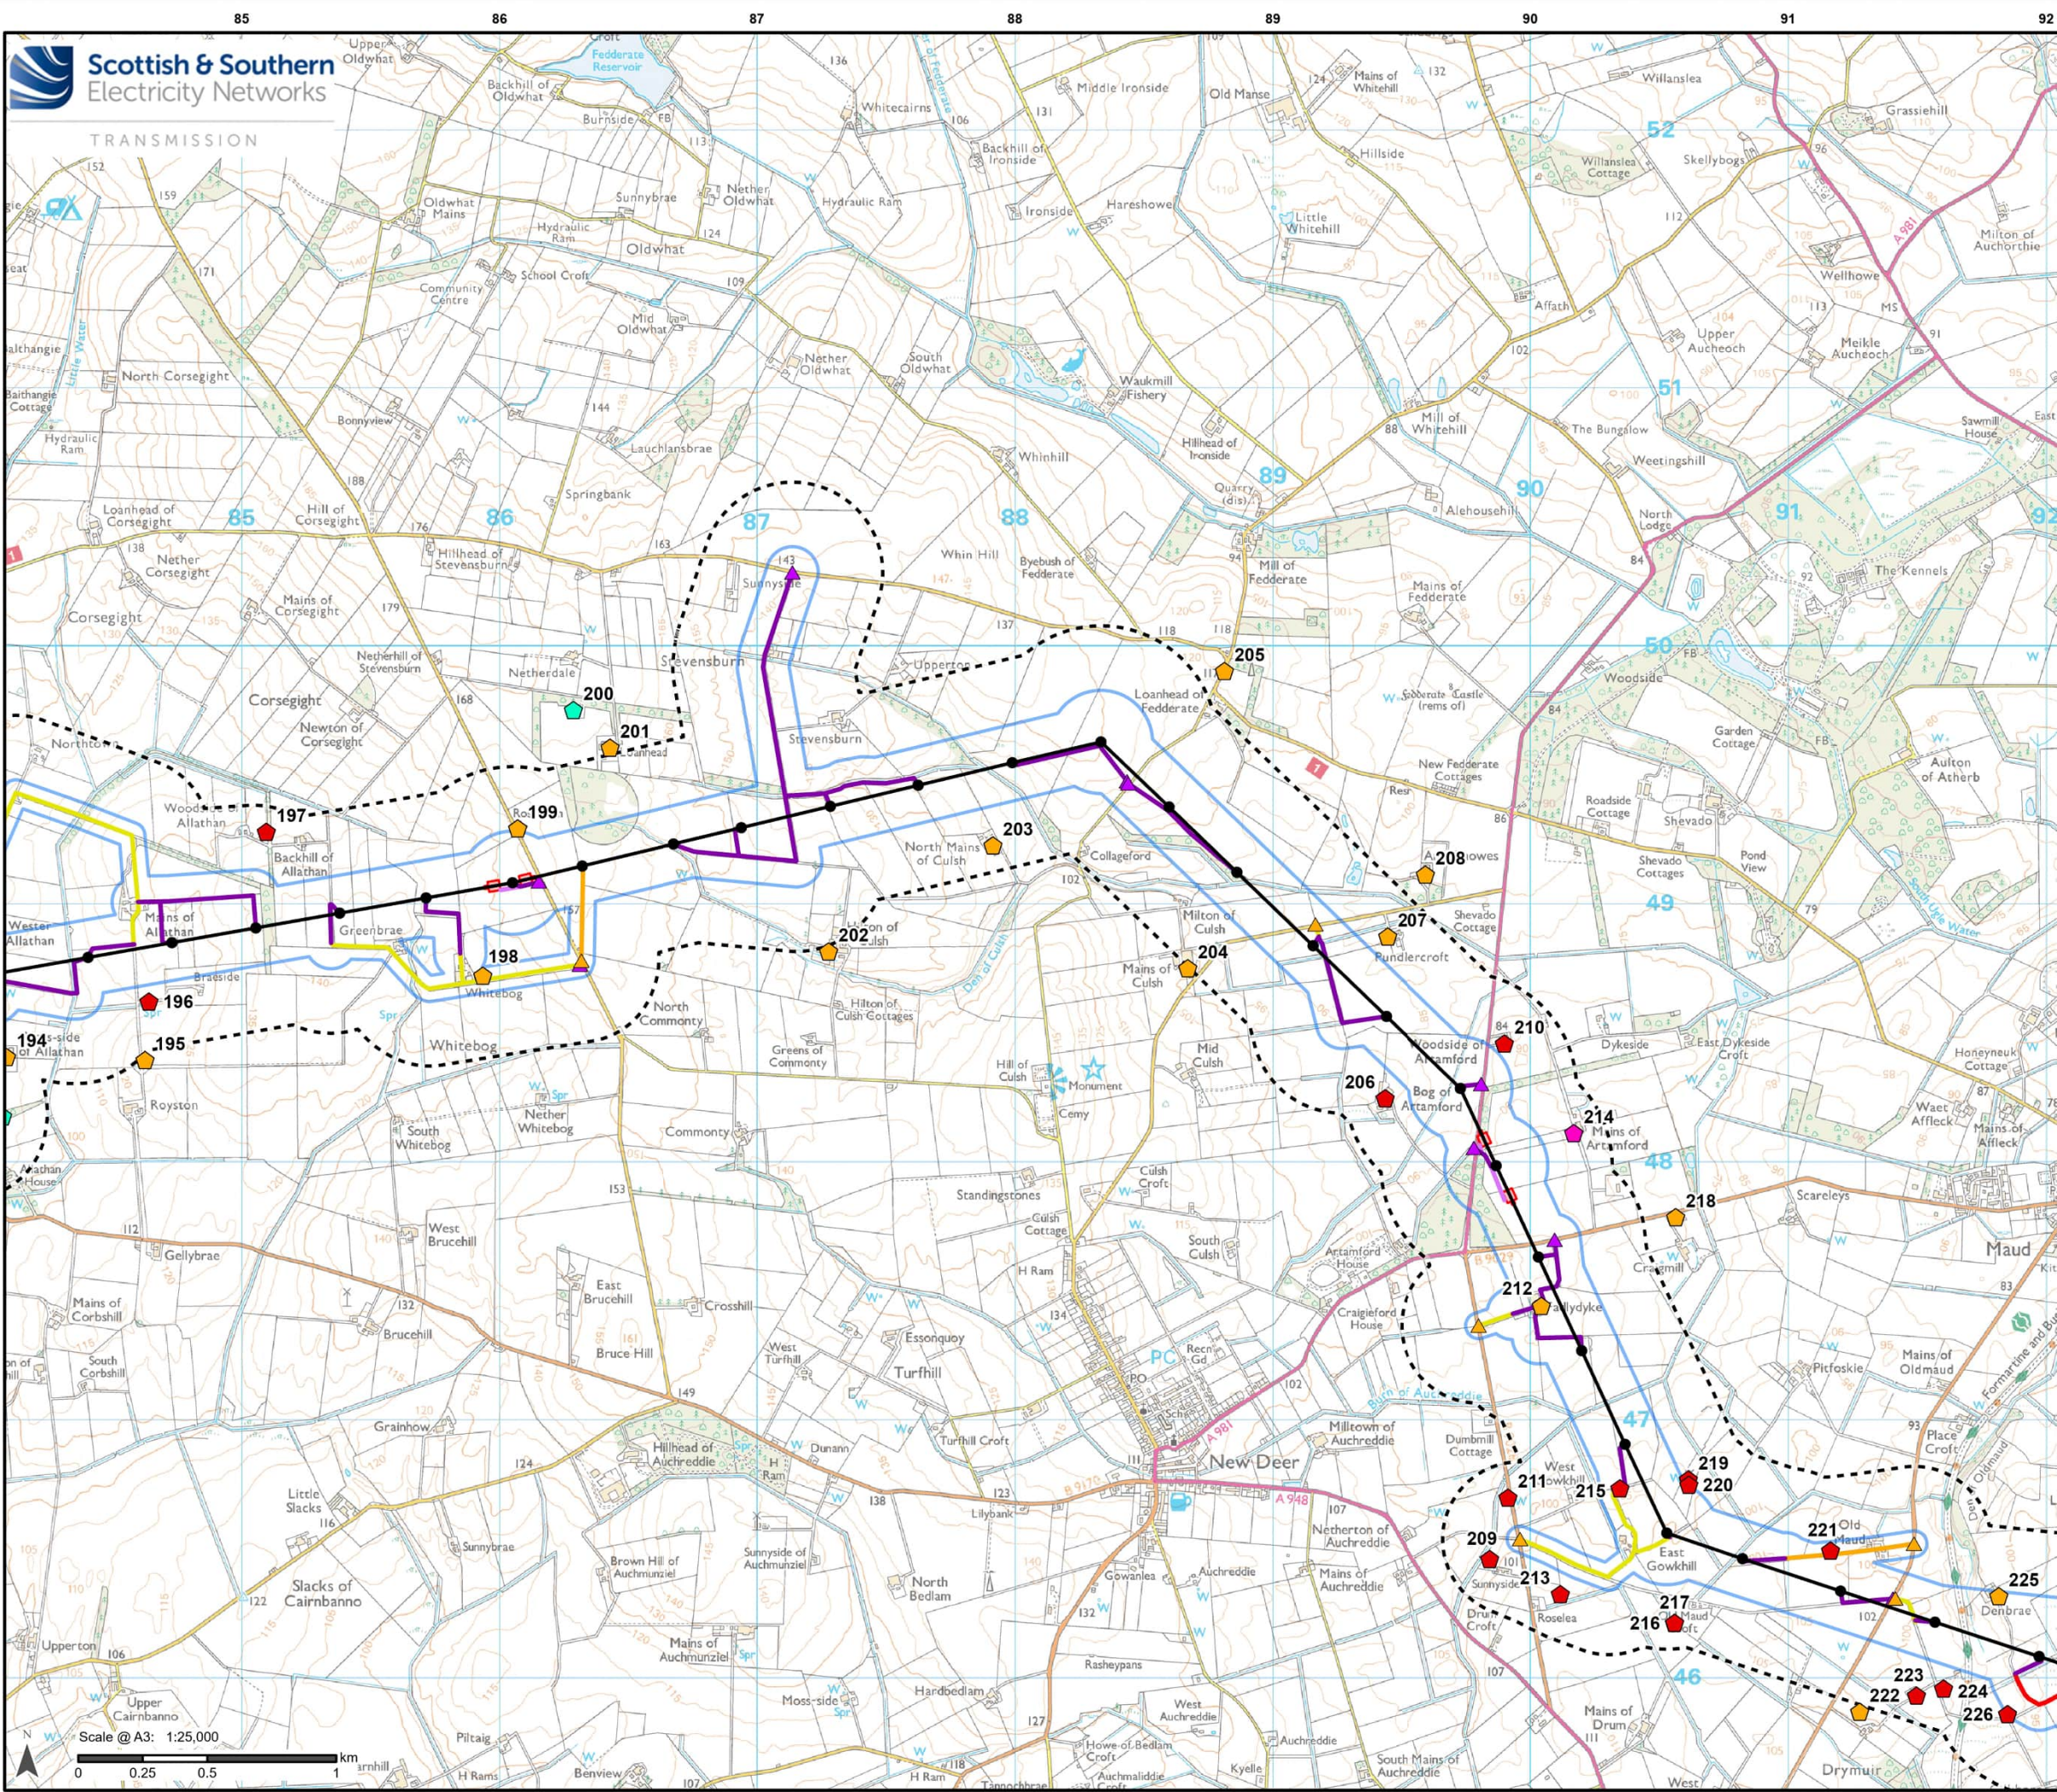

### Legend

- Limit of Deviation - Proposed Development
- 250 m buffer from the LoD
- Development for which Section 37 Consent is Sought**
  - Proposed OHL Alignment - 400 kV
  - Proposed Tower - 400 kV
- Ancillary Development**
  - Proposed Conductor Pulling Area (EPZ)
  - Existing Access – Upgrade – Good / Fair Condition
  - Existing Access – Upgrade – Poor Condition
  - Existing Access – Upgrade – Very Poor Condition
  - Proposed Access – ATV or Temporary Trackway
  - Proposed Access – Temporary
  - Proposed Bellmouth - Temporary
  - Proposed Bellmouth - Upgrade
- Private Water Supply**
  - Site Visit
  - Council (source)
  - Council (property)
  - Questionnaire

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beaulieu to Blackhilllock to New Deer to Peterhead 400kV OHL Project

Title: Figure 10.6.1 - Private Water Supplies  
Page 23 of 26

Drawn by: MAL Date: 28/07/2025

Drawing: B2P-WSP-DA-70092380-144