





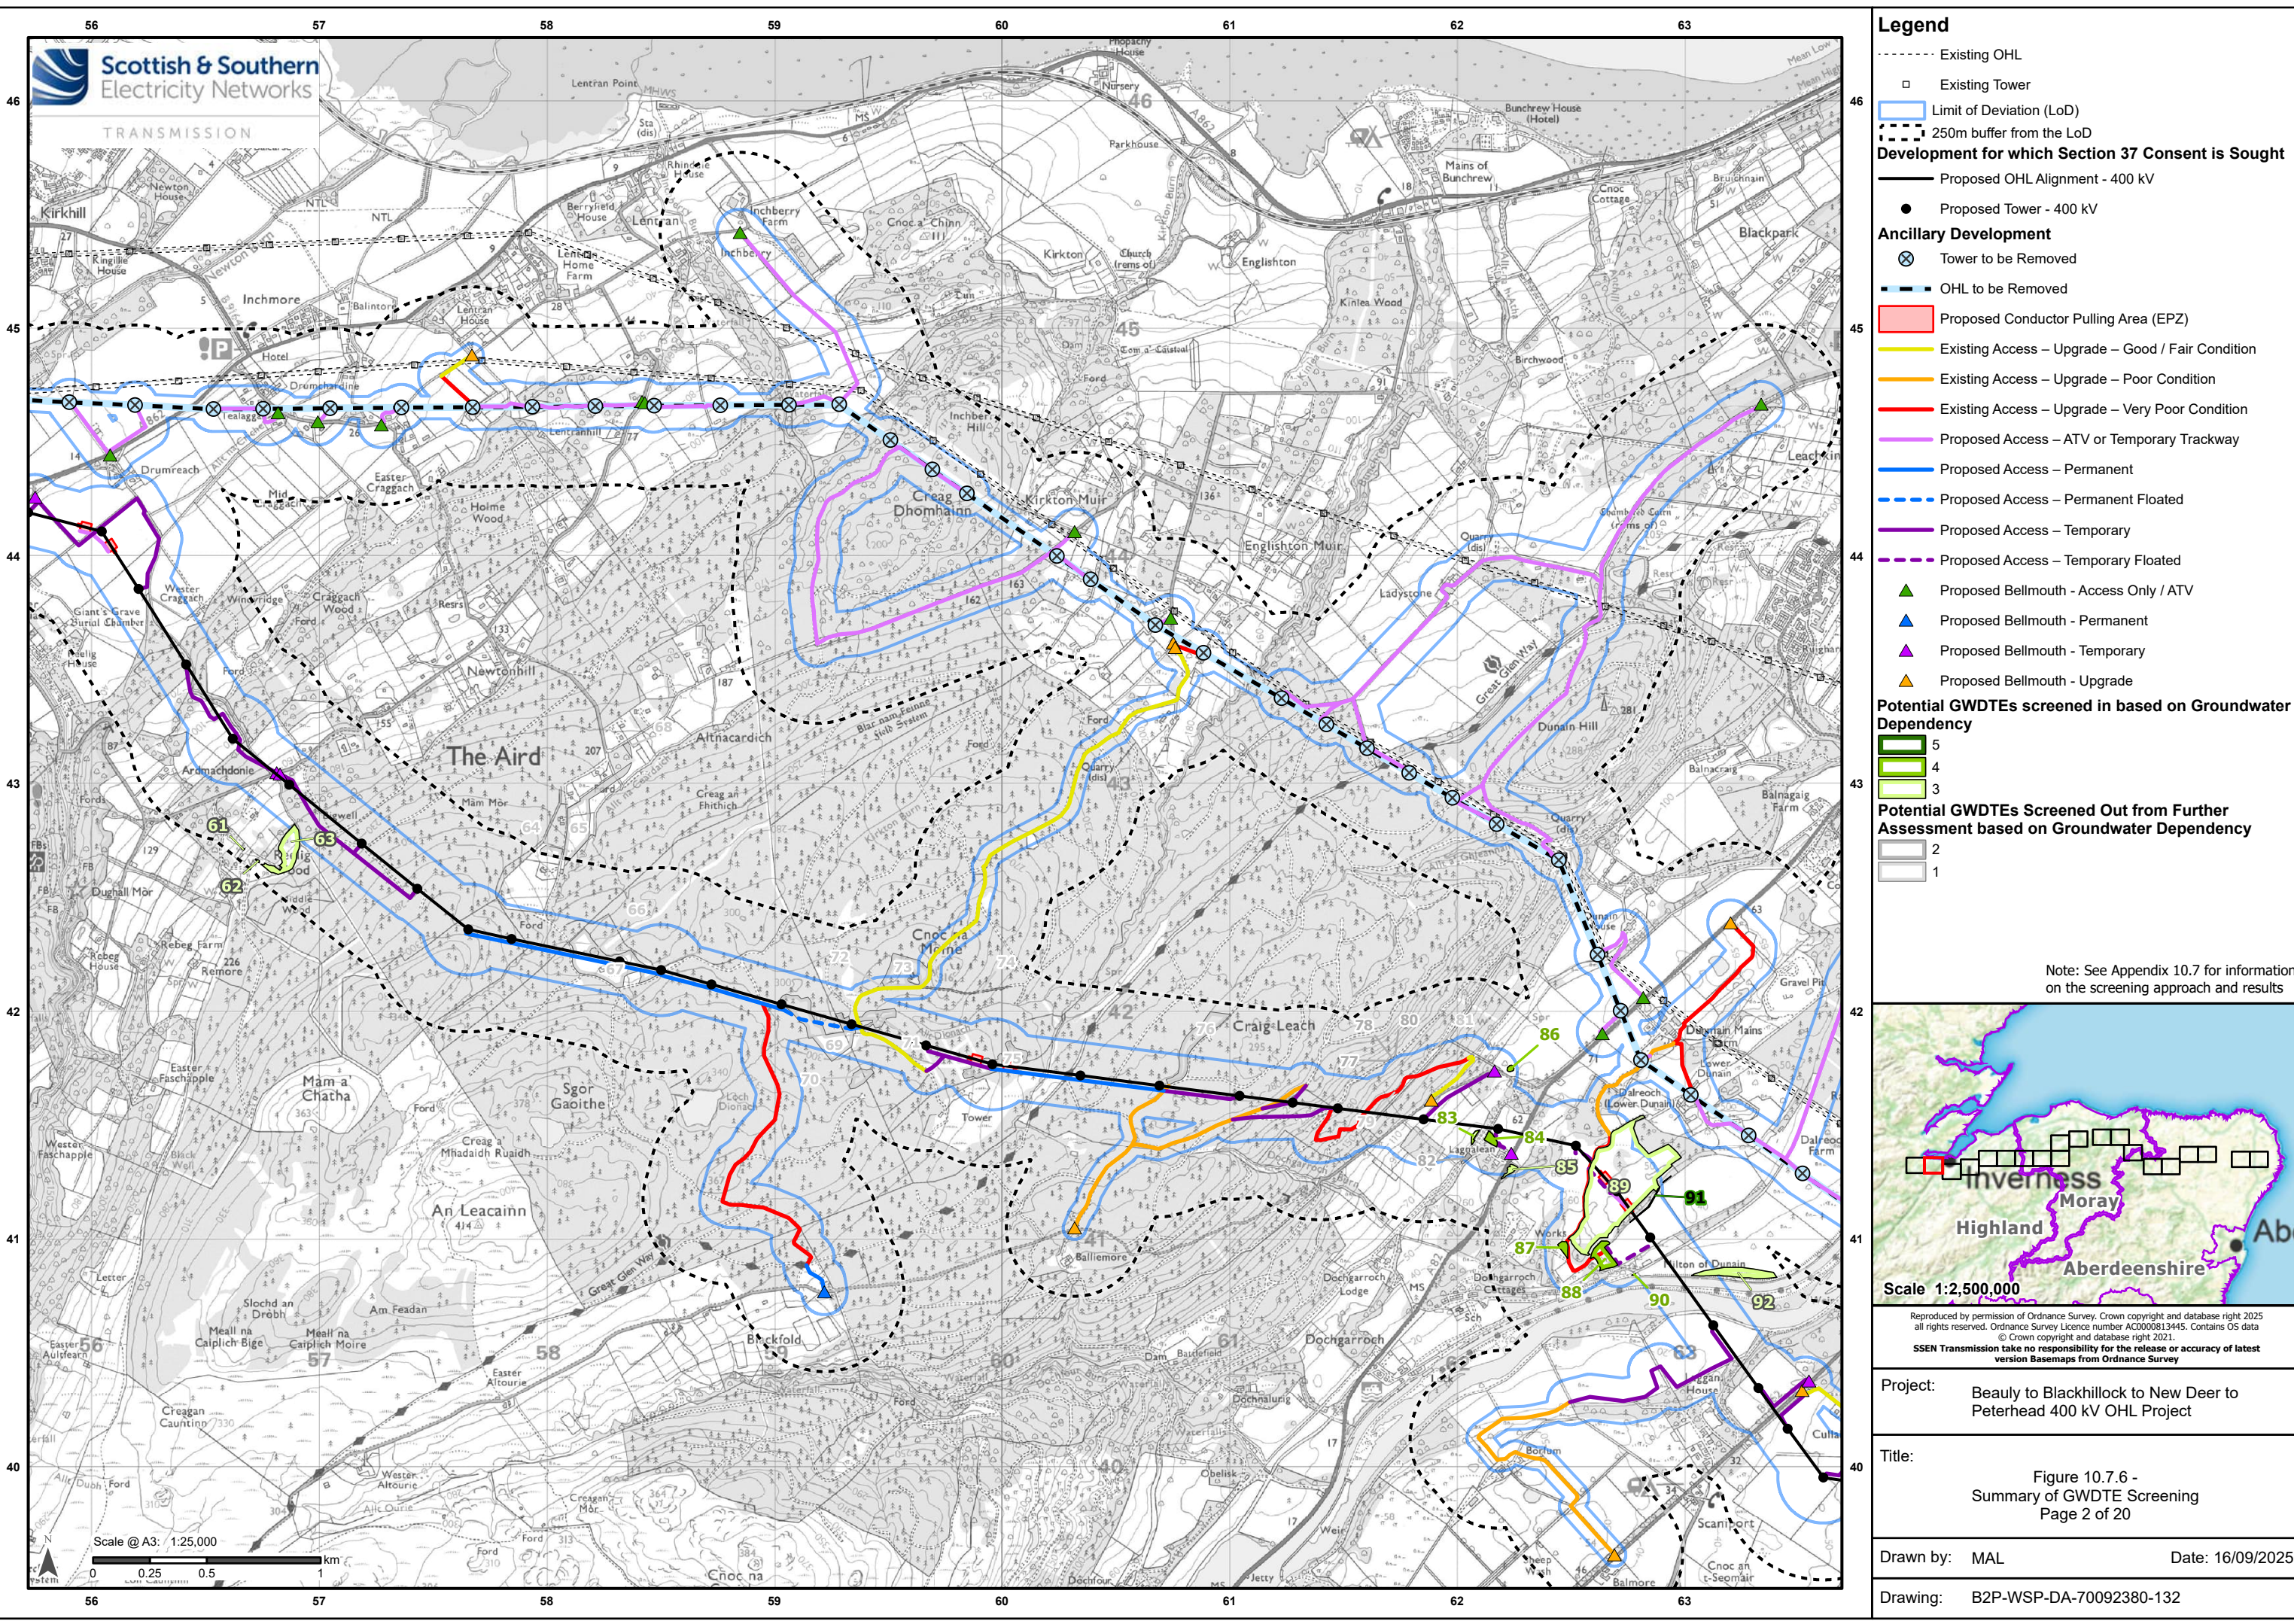

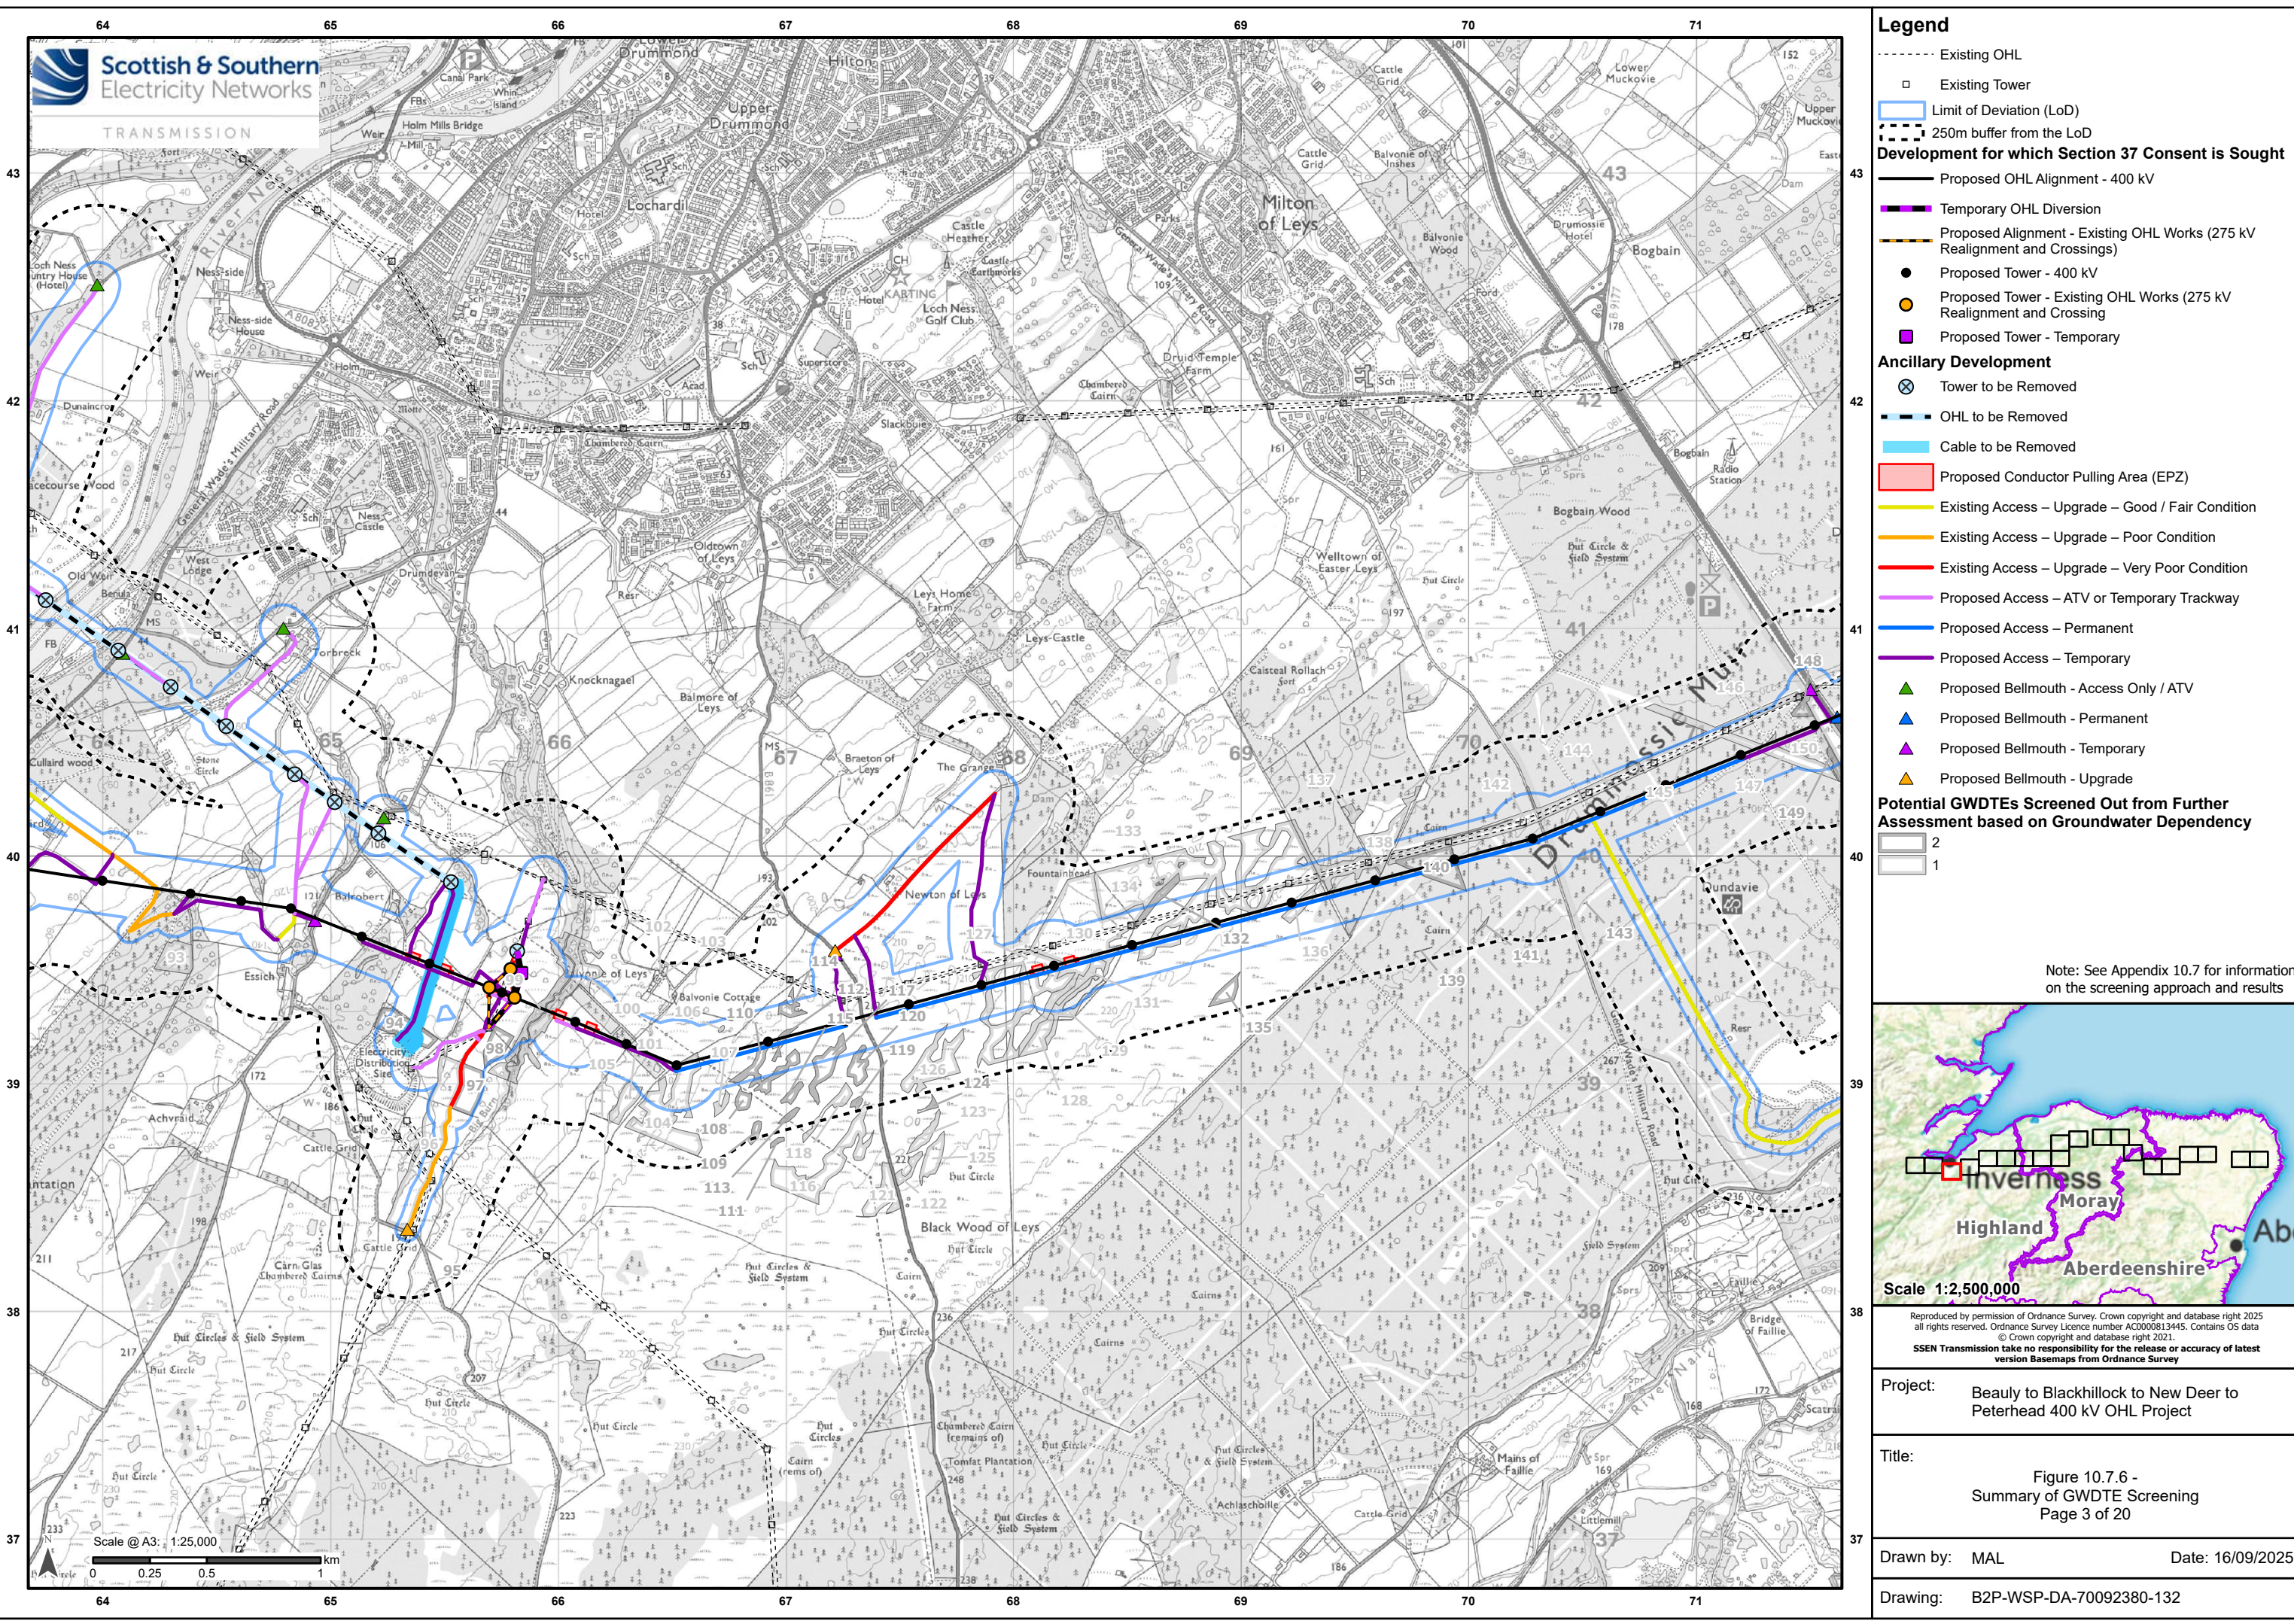

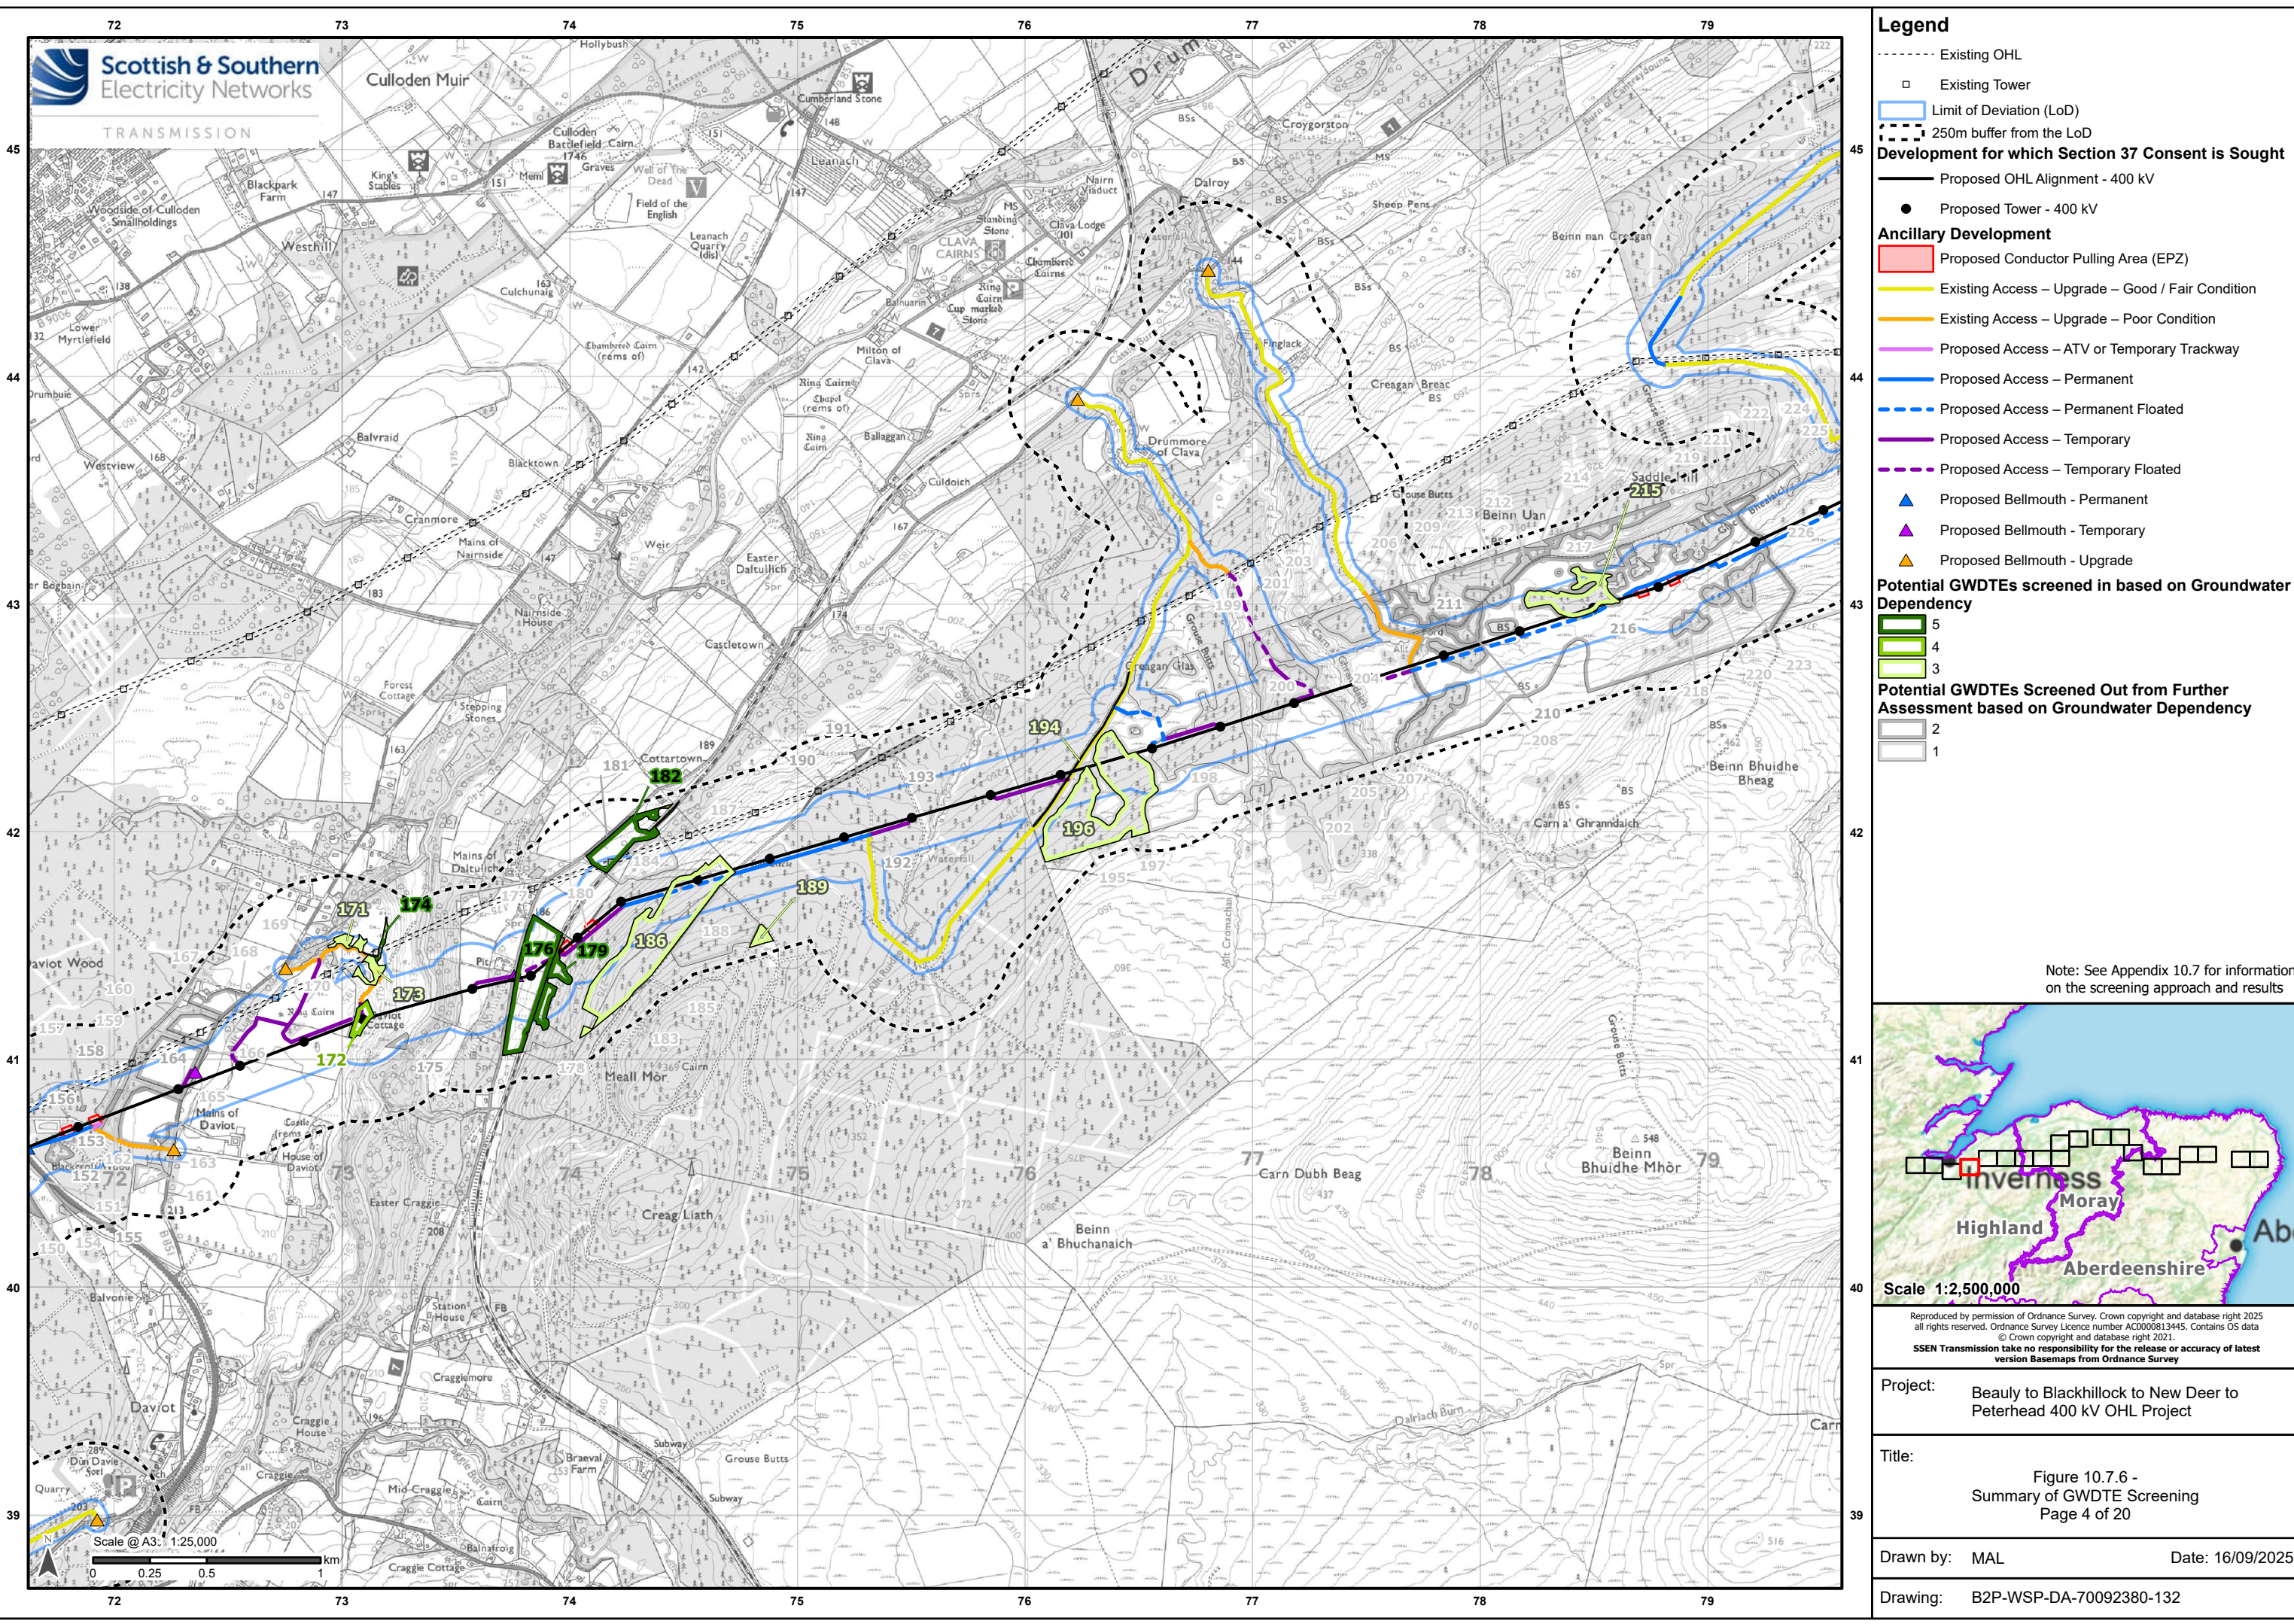

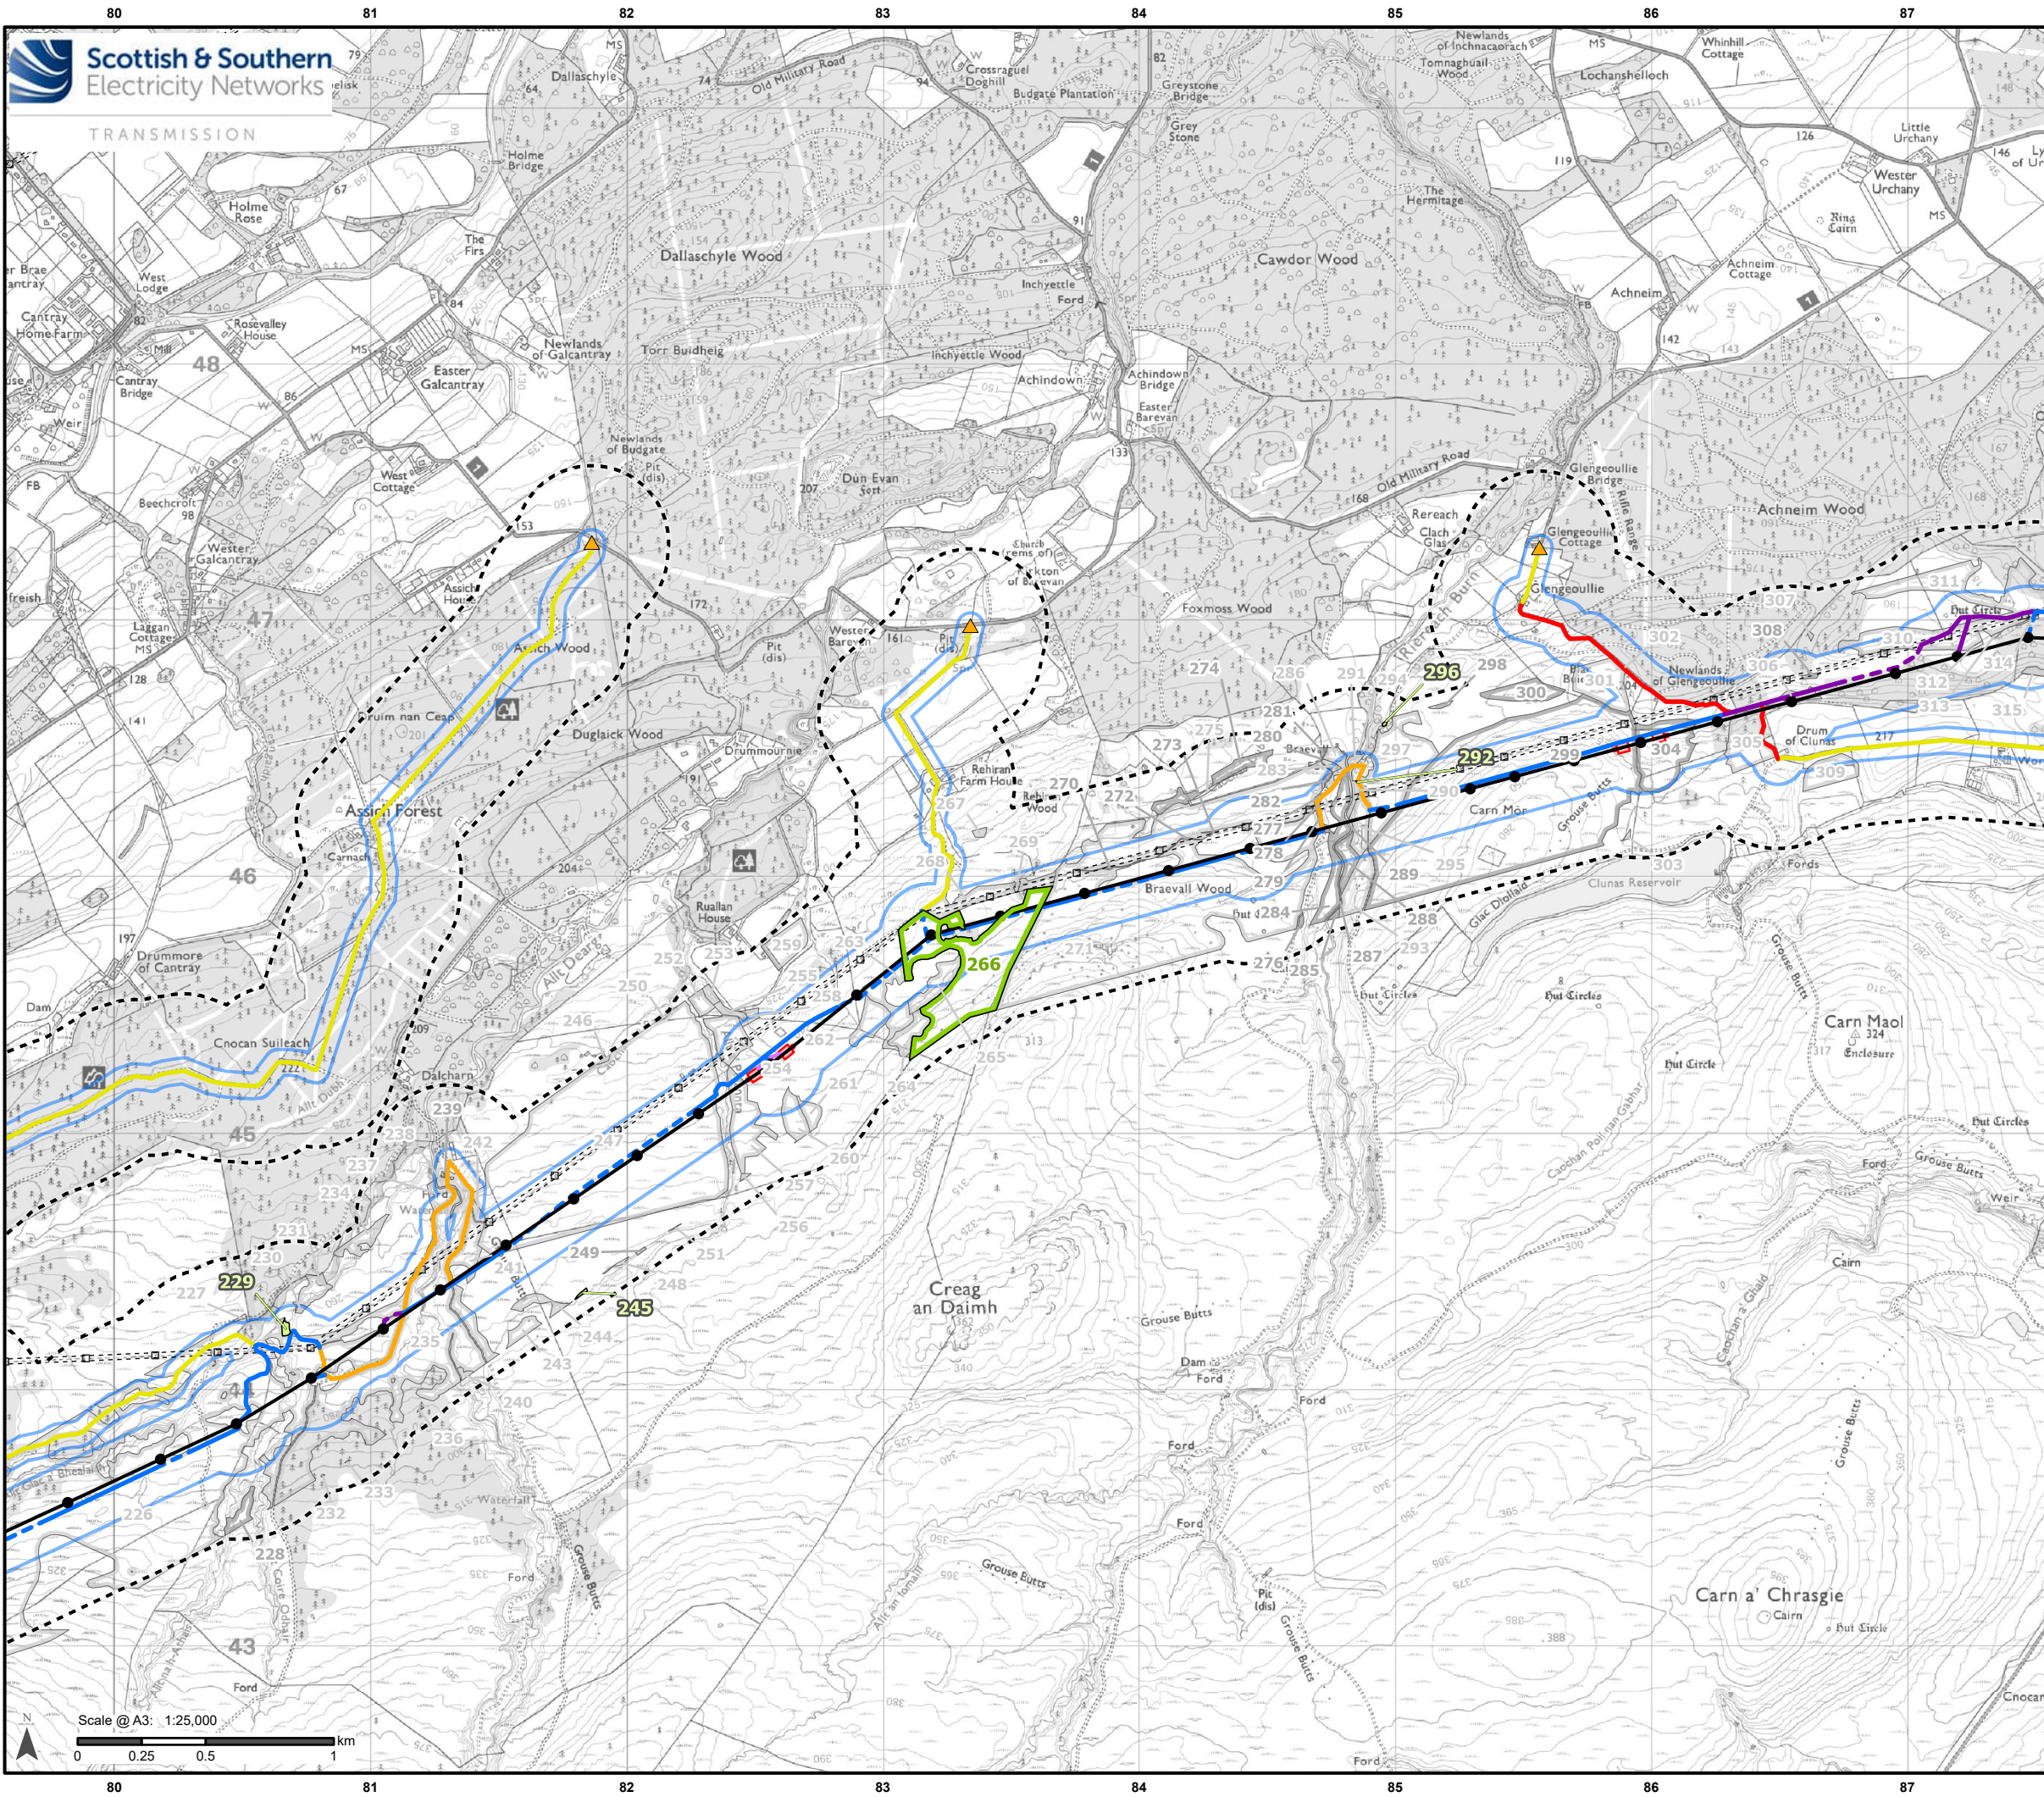

Legend

- Existing OHL
- Existing Tower
- Limit of Deviation (LoD)
- 250m buffer from the LoD
- Development for which Section 37 Consent is Sought**
- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV
- Ancillary Development**
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Permanent Floated
- Proposed Access – Temporary
- Proposed Access – Temporary Floated
- Proposed Bellmouth - Upgrade
- Potential GWDTes screened in based on Groundwater Dependency**
- 4
- 3
- Potential GWDTes Screened Out from Further Assessment based on Groundwater Dependency**
- 2
- 1

Note: See Appendix 10.7 for information on the screening approach and results

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number ACD000813445. Contains OS data © Crown copyright and database right 2021. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project		
Title:	Figure 10.7.6 - Summary of GWDT E Screening Page 5 of 20		
Drawn by:	MAL	Date:	16/09/2025
Drawing:	B2P-WSP-DA-70092380-132		