


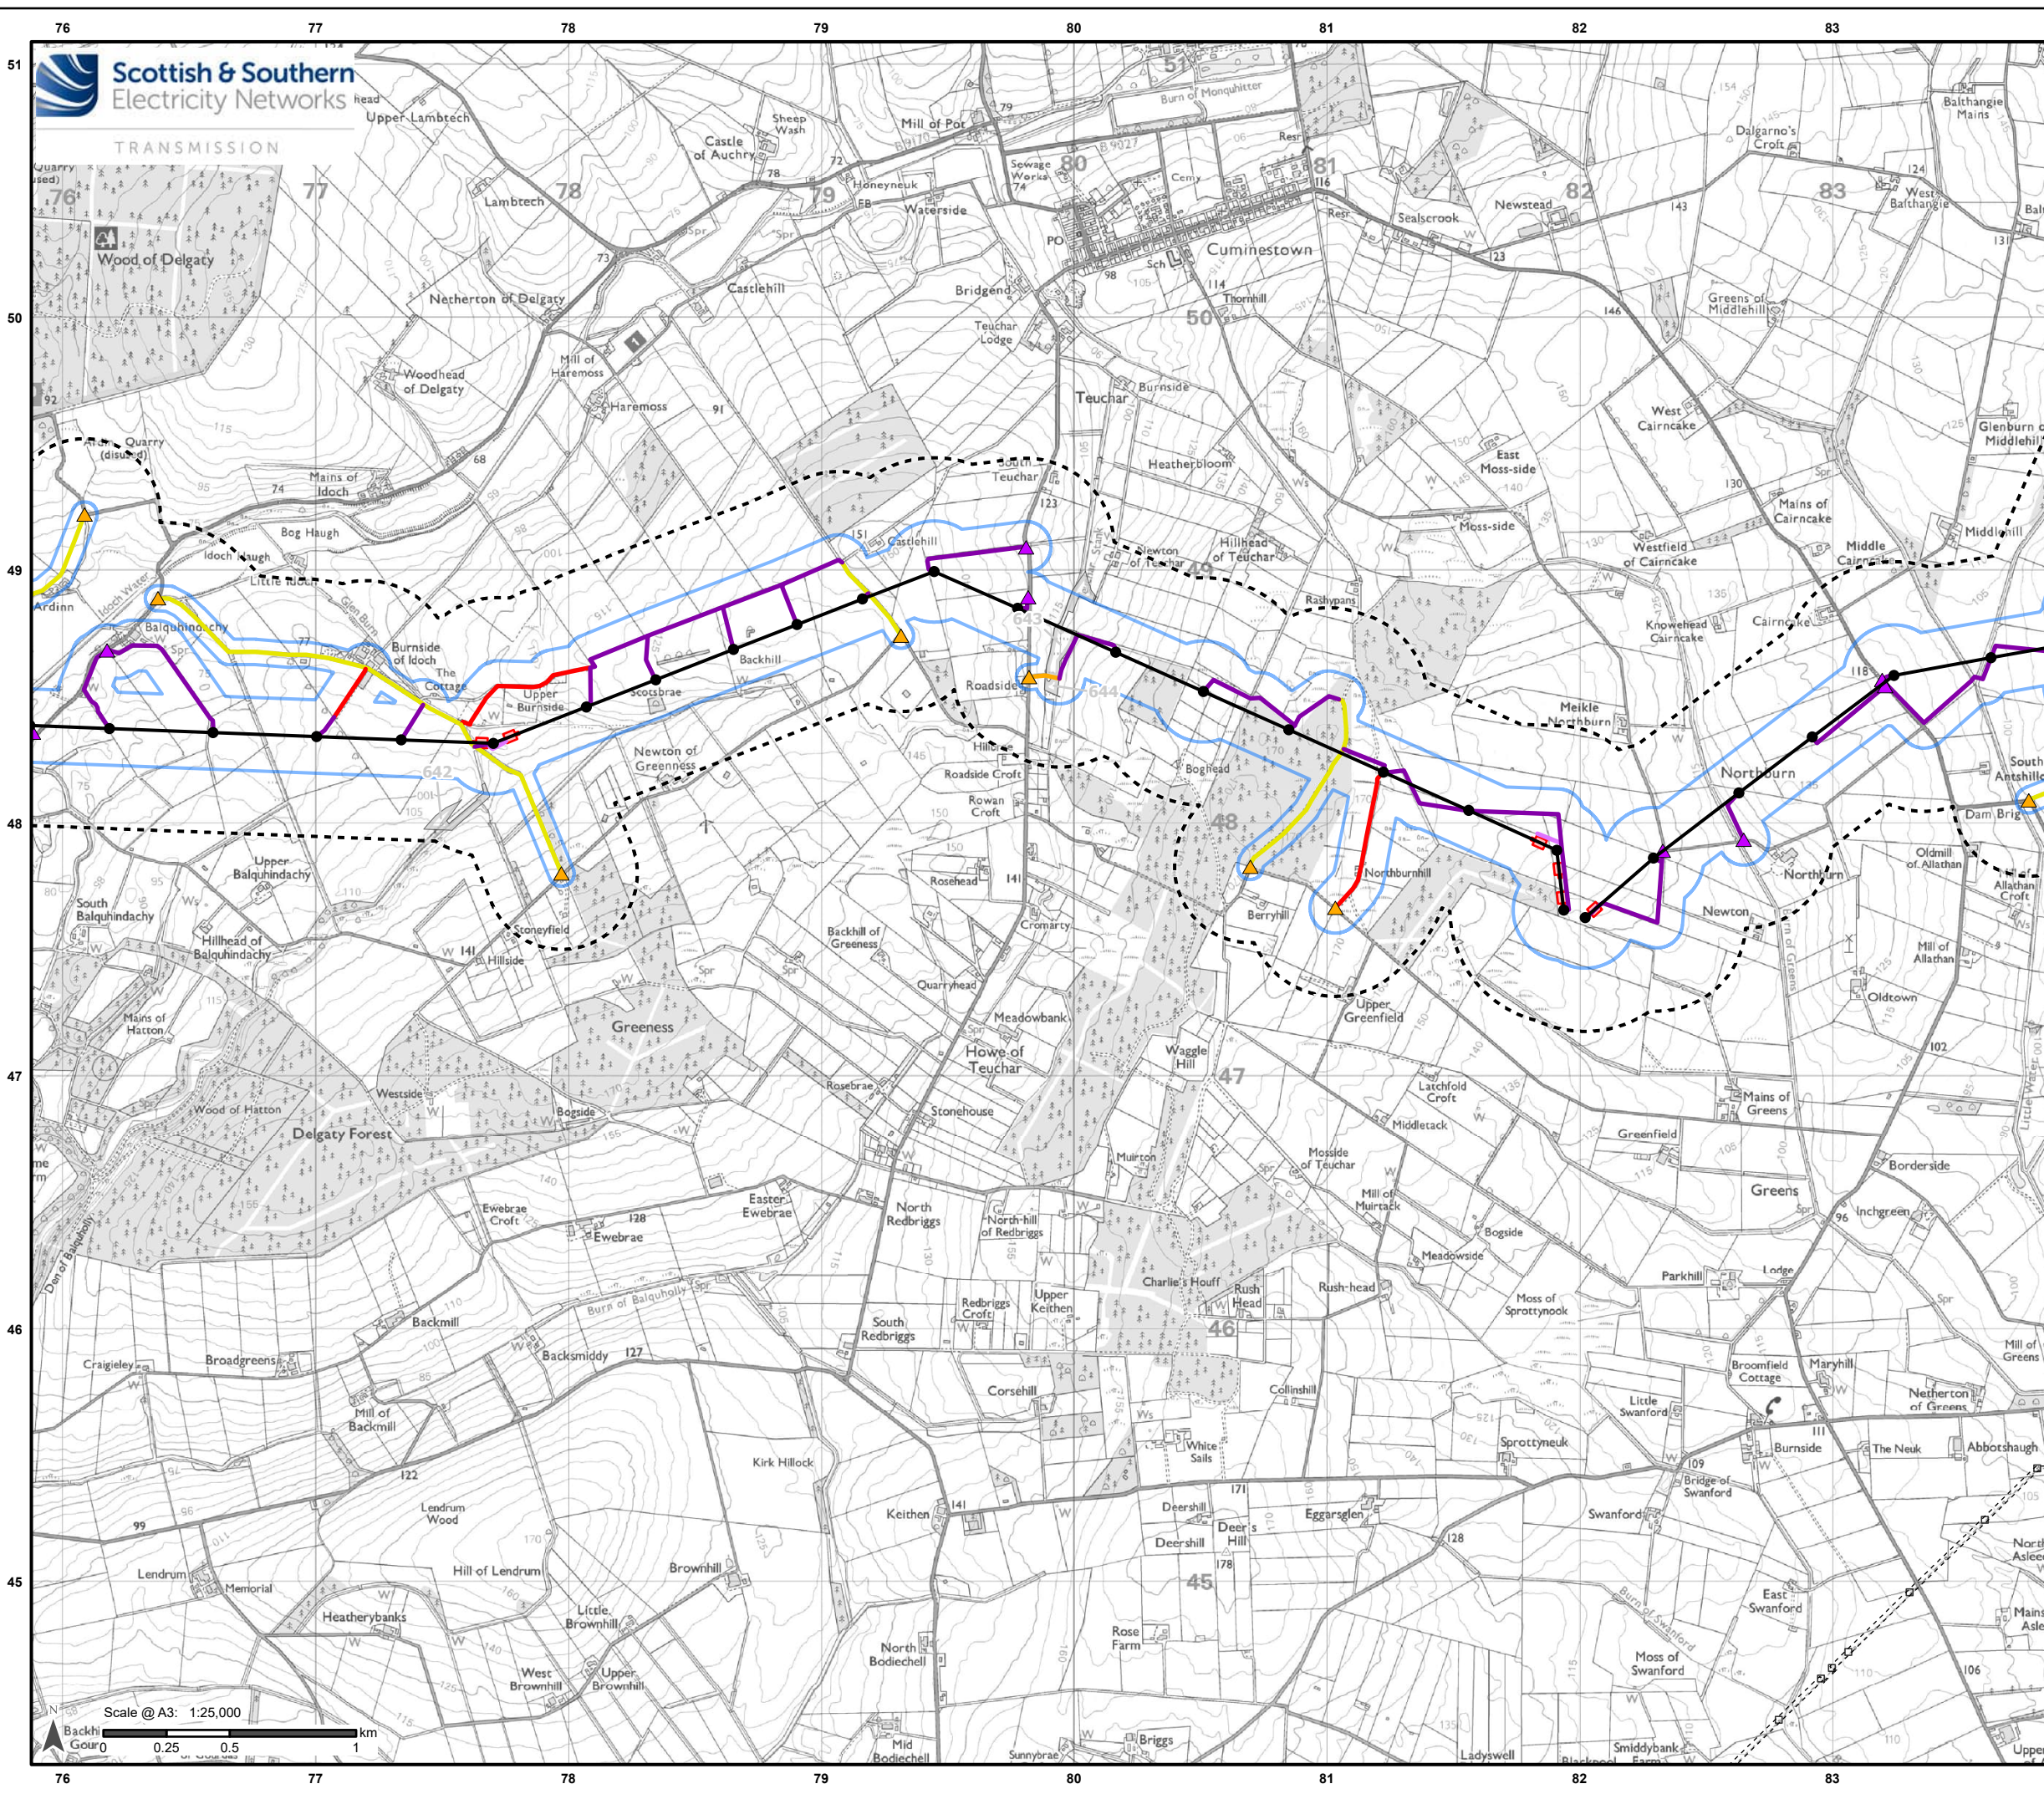

Legend


- Existing OHL
- Existing Tower
- Limit of Deviation (LoD)
- 250m buffer from the LoD
- Development for which Section 37 Consent is Sought**
- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV
- Ancillary Development**
- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade
- Potential GWDTEs Screened Out from Further Assessment based on Groundwater Dependency**
- 1

Note: See Appendix 10.7 for information on the screening approach and results

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number ACD000813445. Contains OS data © Crown copyright and database right 2021. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400 kV OHL Project		
Title:	Figure 10.7.6 - Summary of GWDTE Screening Page 18 of 20		
Drawn by:	MAL	Date:	16/09/2025
Drawing:	B2P-WSP-DA-70092380-132		

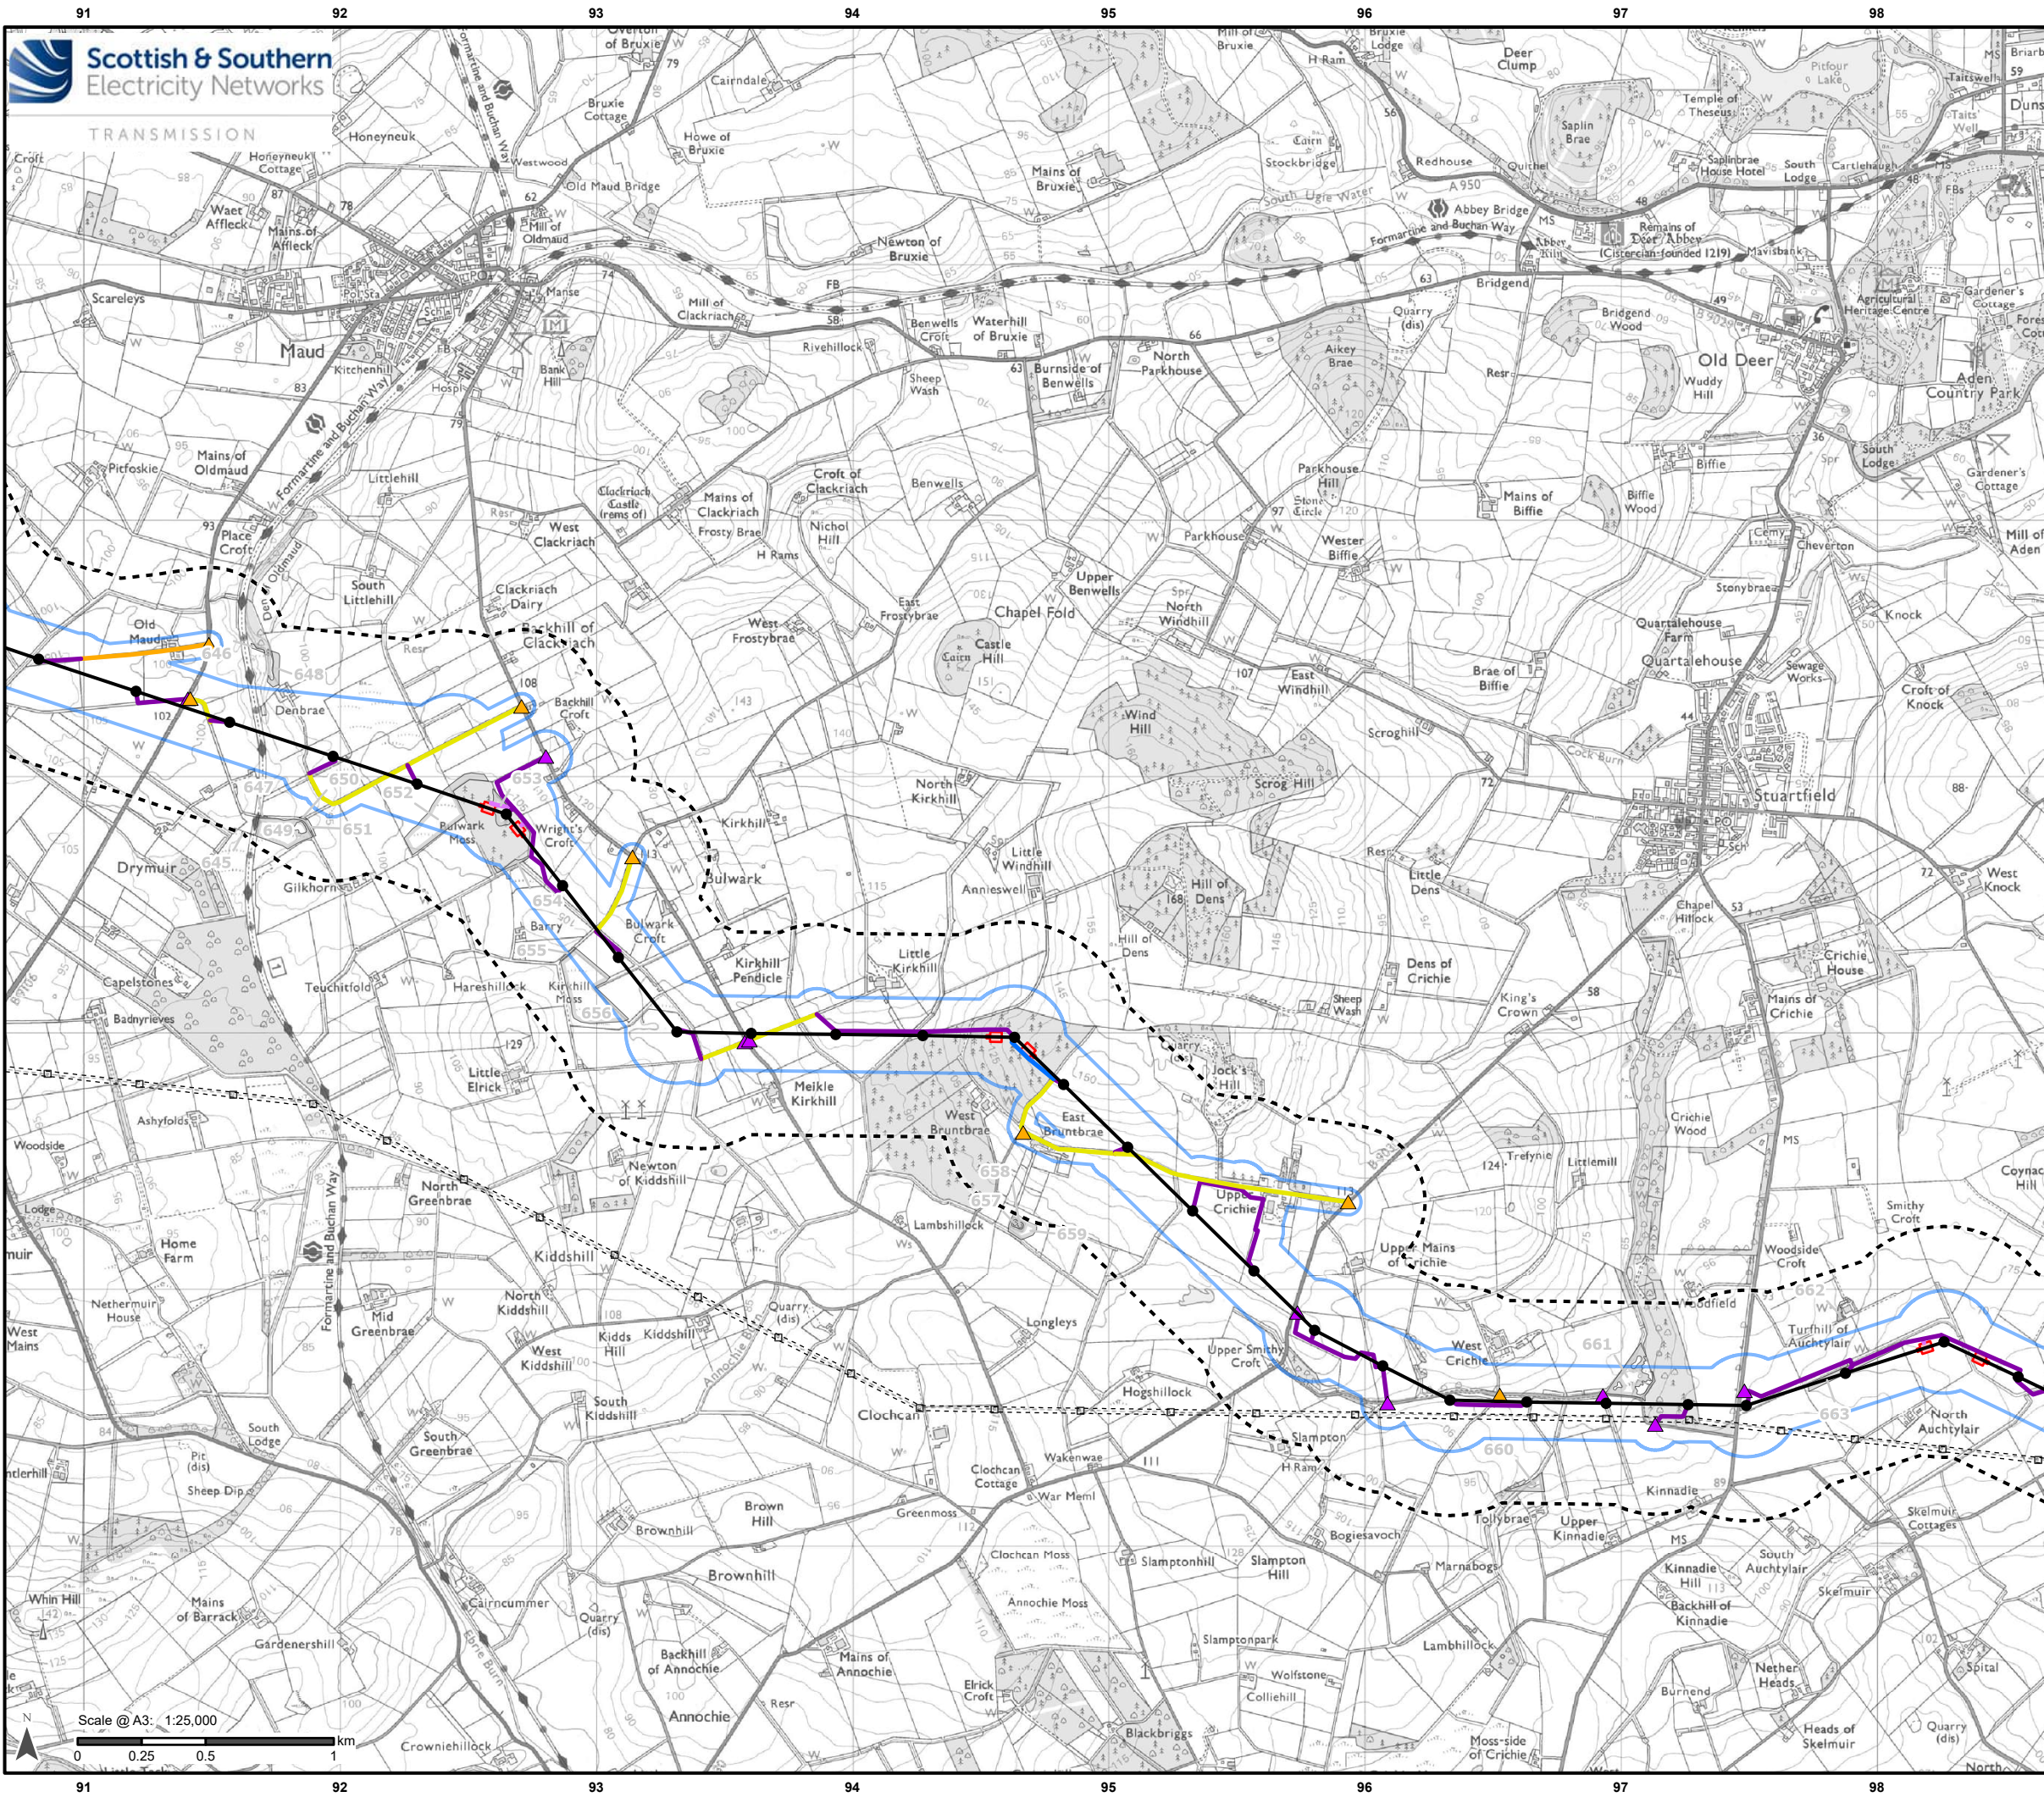

Legend

- Existing OHL
- Existing Tower
- Limit of Deviation (LoD)
- 250m buffer from the LoD

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Poor Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Permanent
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Potential GWDTEs Screened Out from Further Assessment based on Groundwater Dependency

- 1

Note: See Appendix 10.7 for information on the screening approach and results

Scale 1:2,500,000


Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number ACD000813445. Contains OS data © Crown copyright and database right 2021. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project: Beauly to Blackhilllock to New Deer to Peterhead 400 kV OHL Project

Title: Figure 10.7.6 - Summary of GWDTE Screening Page 19 of 20

Drawn by: MAL Date: 16/09/2025

Drawing: B2P-WSP-DA-70092380-132

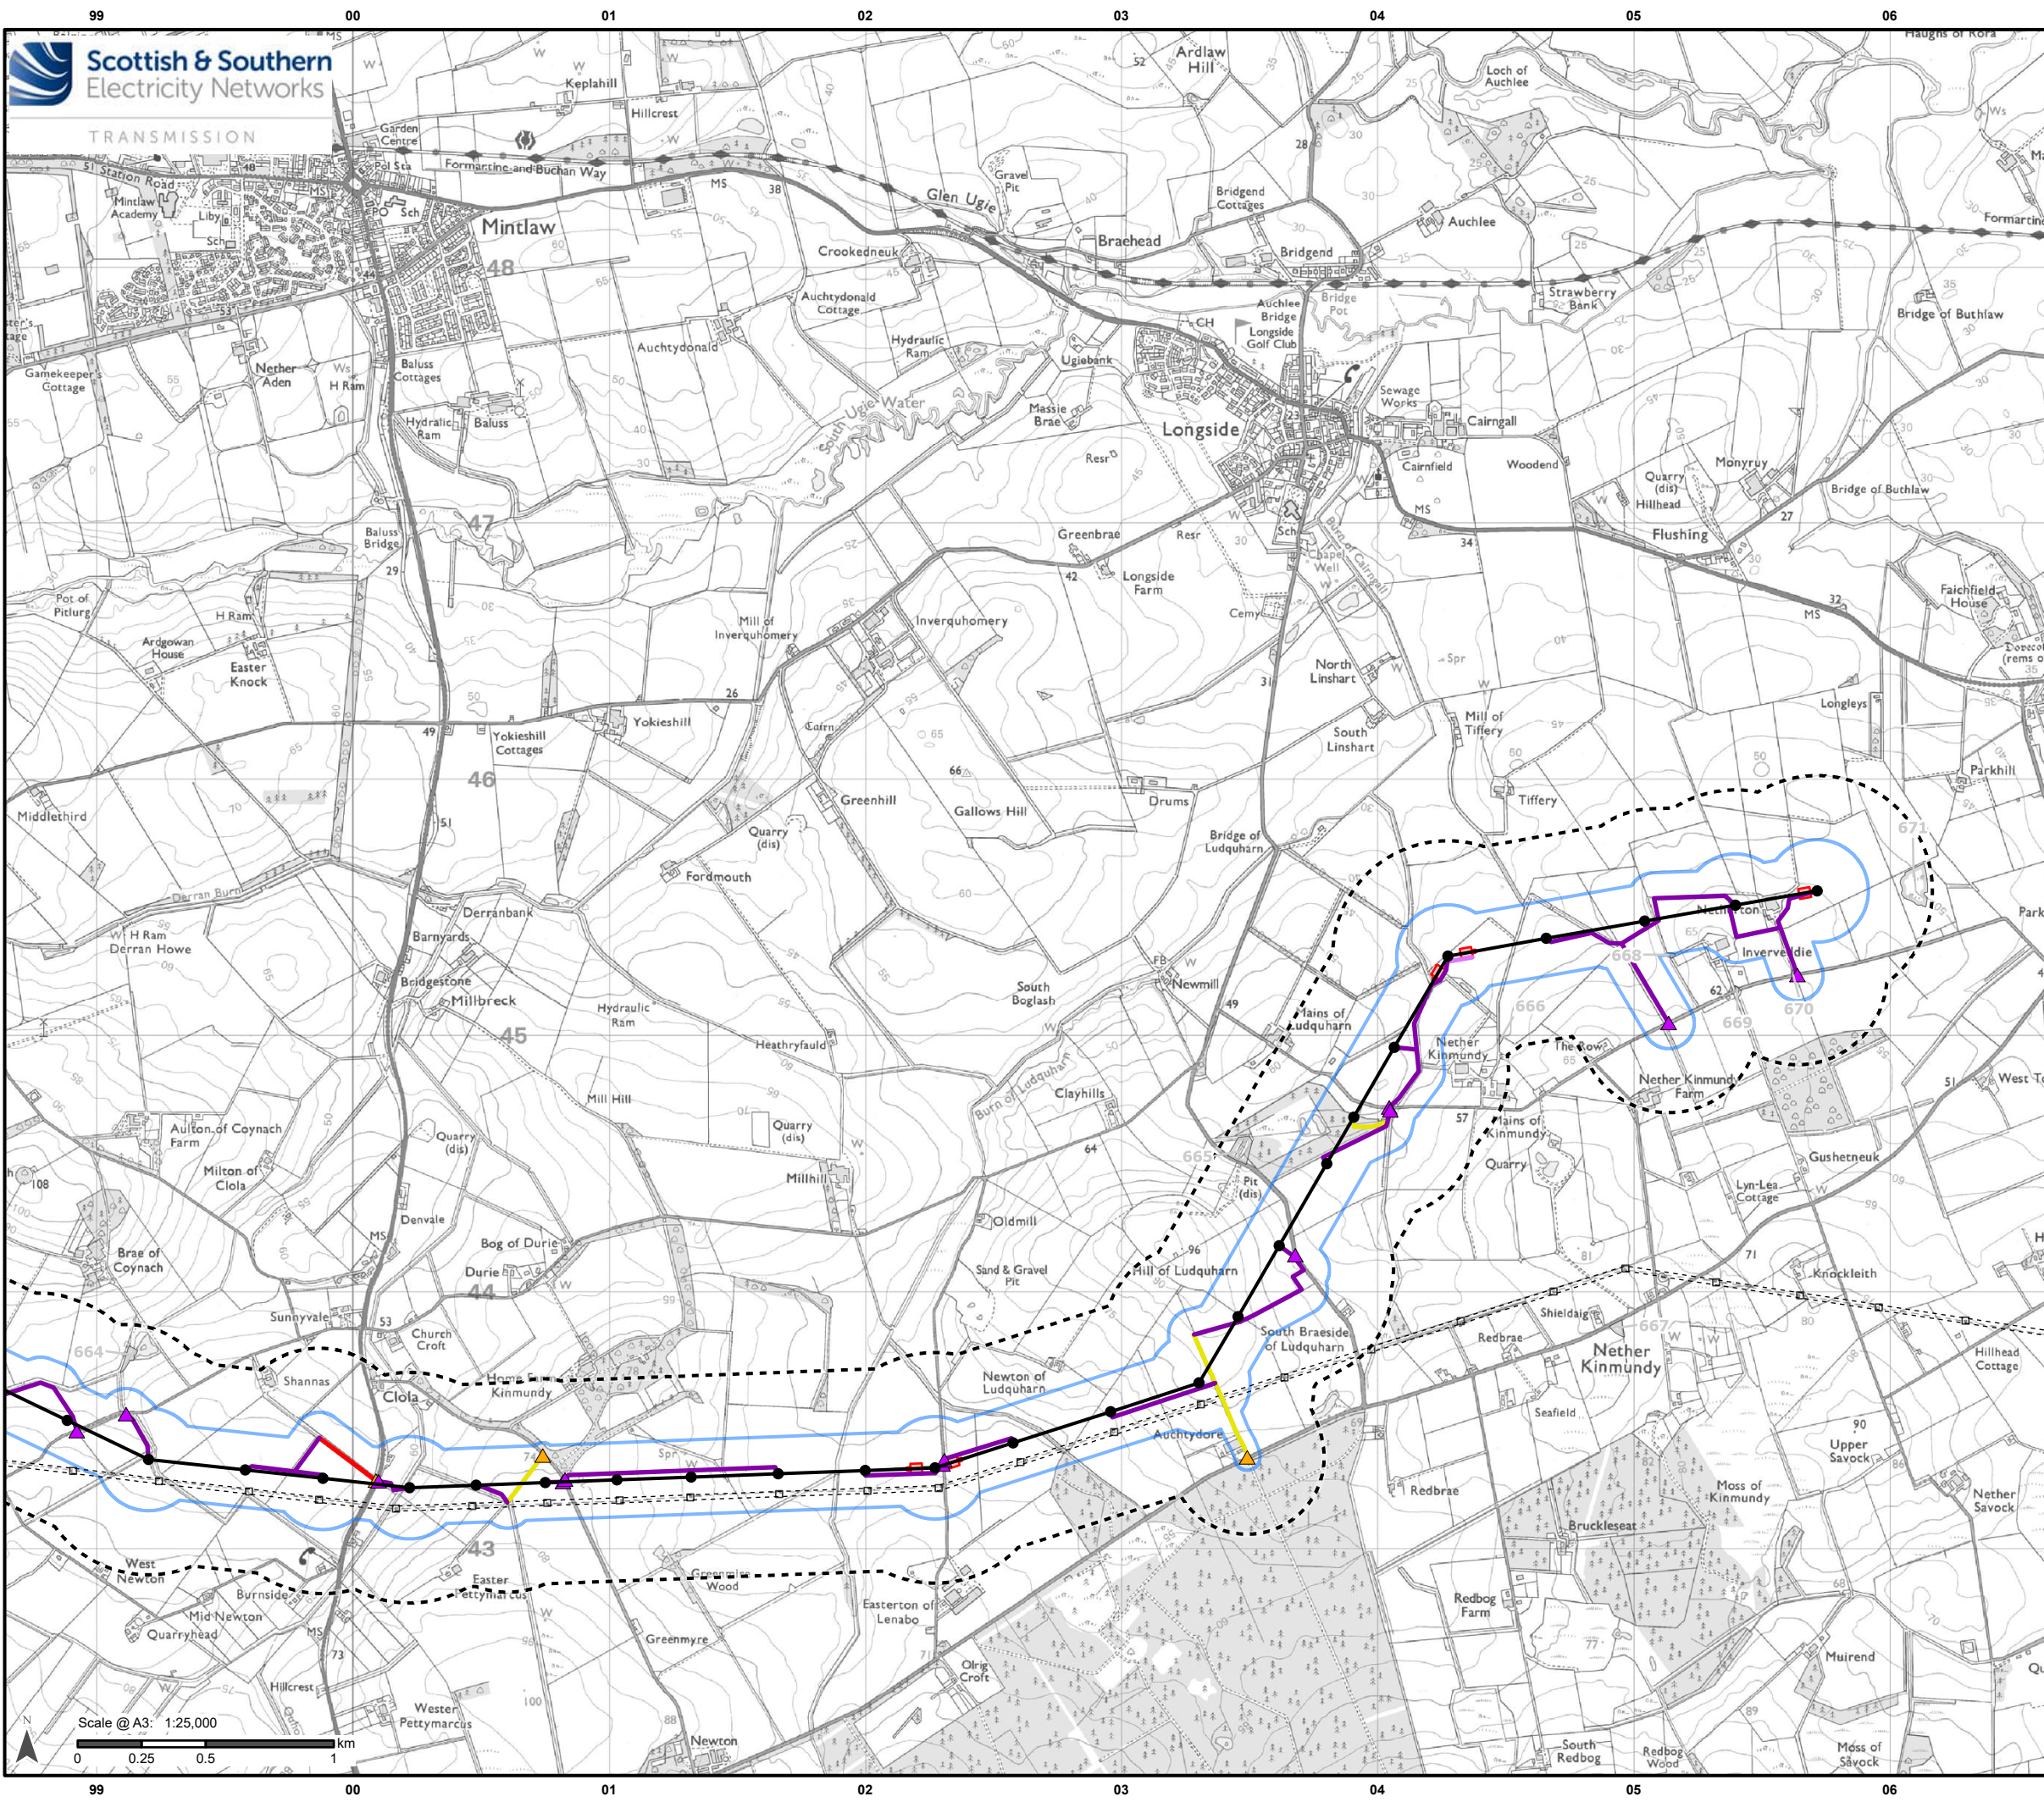

Legend

Existing OHL

□

Existing Tower

□

Limit of Deviation (LoD)

250m buffer from the LoD

Development for which Section 37 Consent is Sought

—

Proposed OHL Alignment - 400 kV

●

Proposed Tower - 400 kV

Ancillary Development

□

Proposed Conductor Pulling Area (EPZ)

—

Existing Access – Upgrade – Good / Fair Condition

—

Existing Access – Upgrade – Very Poor Condition

—

Proposed Access – ATV or Temporary Trackway

—

Proposed Access – Temporary

▲

Proposed Bellmouth - Temporary


▲

Proposed Bellmouth - Upgrade

Potential GWDTEs Screened Out from Further Assessment based on Groundwater Dependency

1

Note: See Appendix 10.7 for information on the screening approach and results

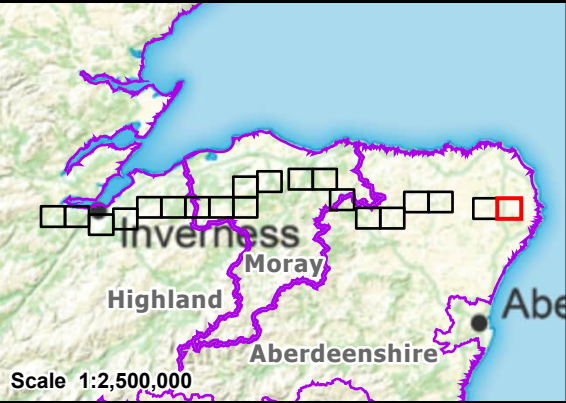

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number ACD000813445. Contains OS data © Crown copyright and database right 2021. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beauly to Blackhillock to New Deer to Peterhead 400 kV OHL Project	
Title:	Figure 10.7.6 - Summary of GWDTE Screening Page 20 of 20	
Drawn by:	MAL	Date: 16/09/2025
Drawing:	B2P-WSP-DA-70092380-132	