


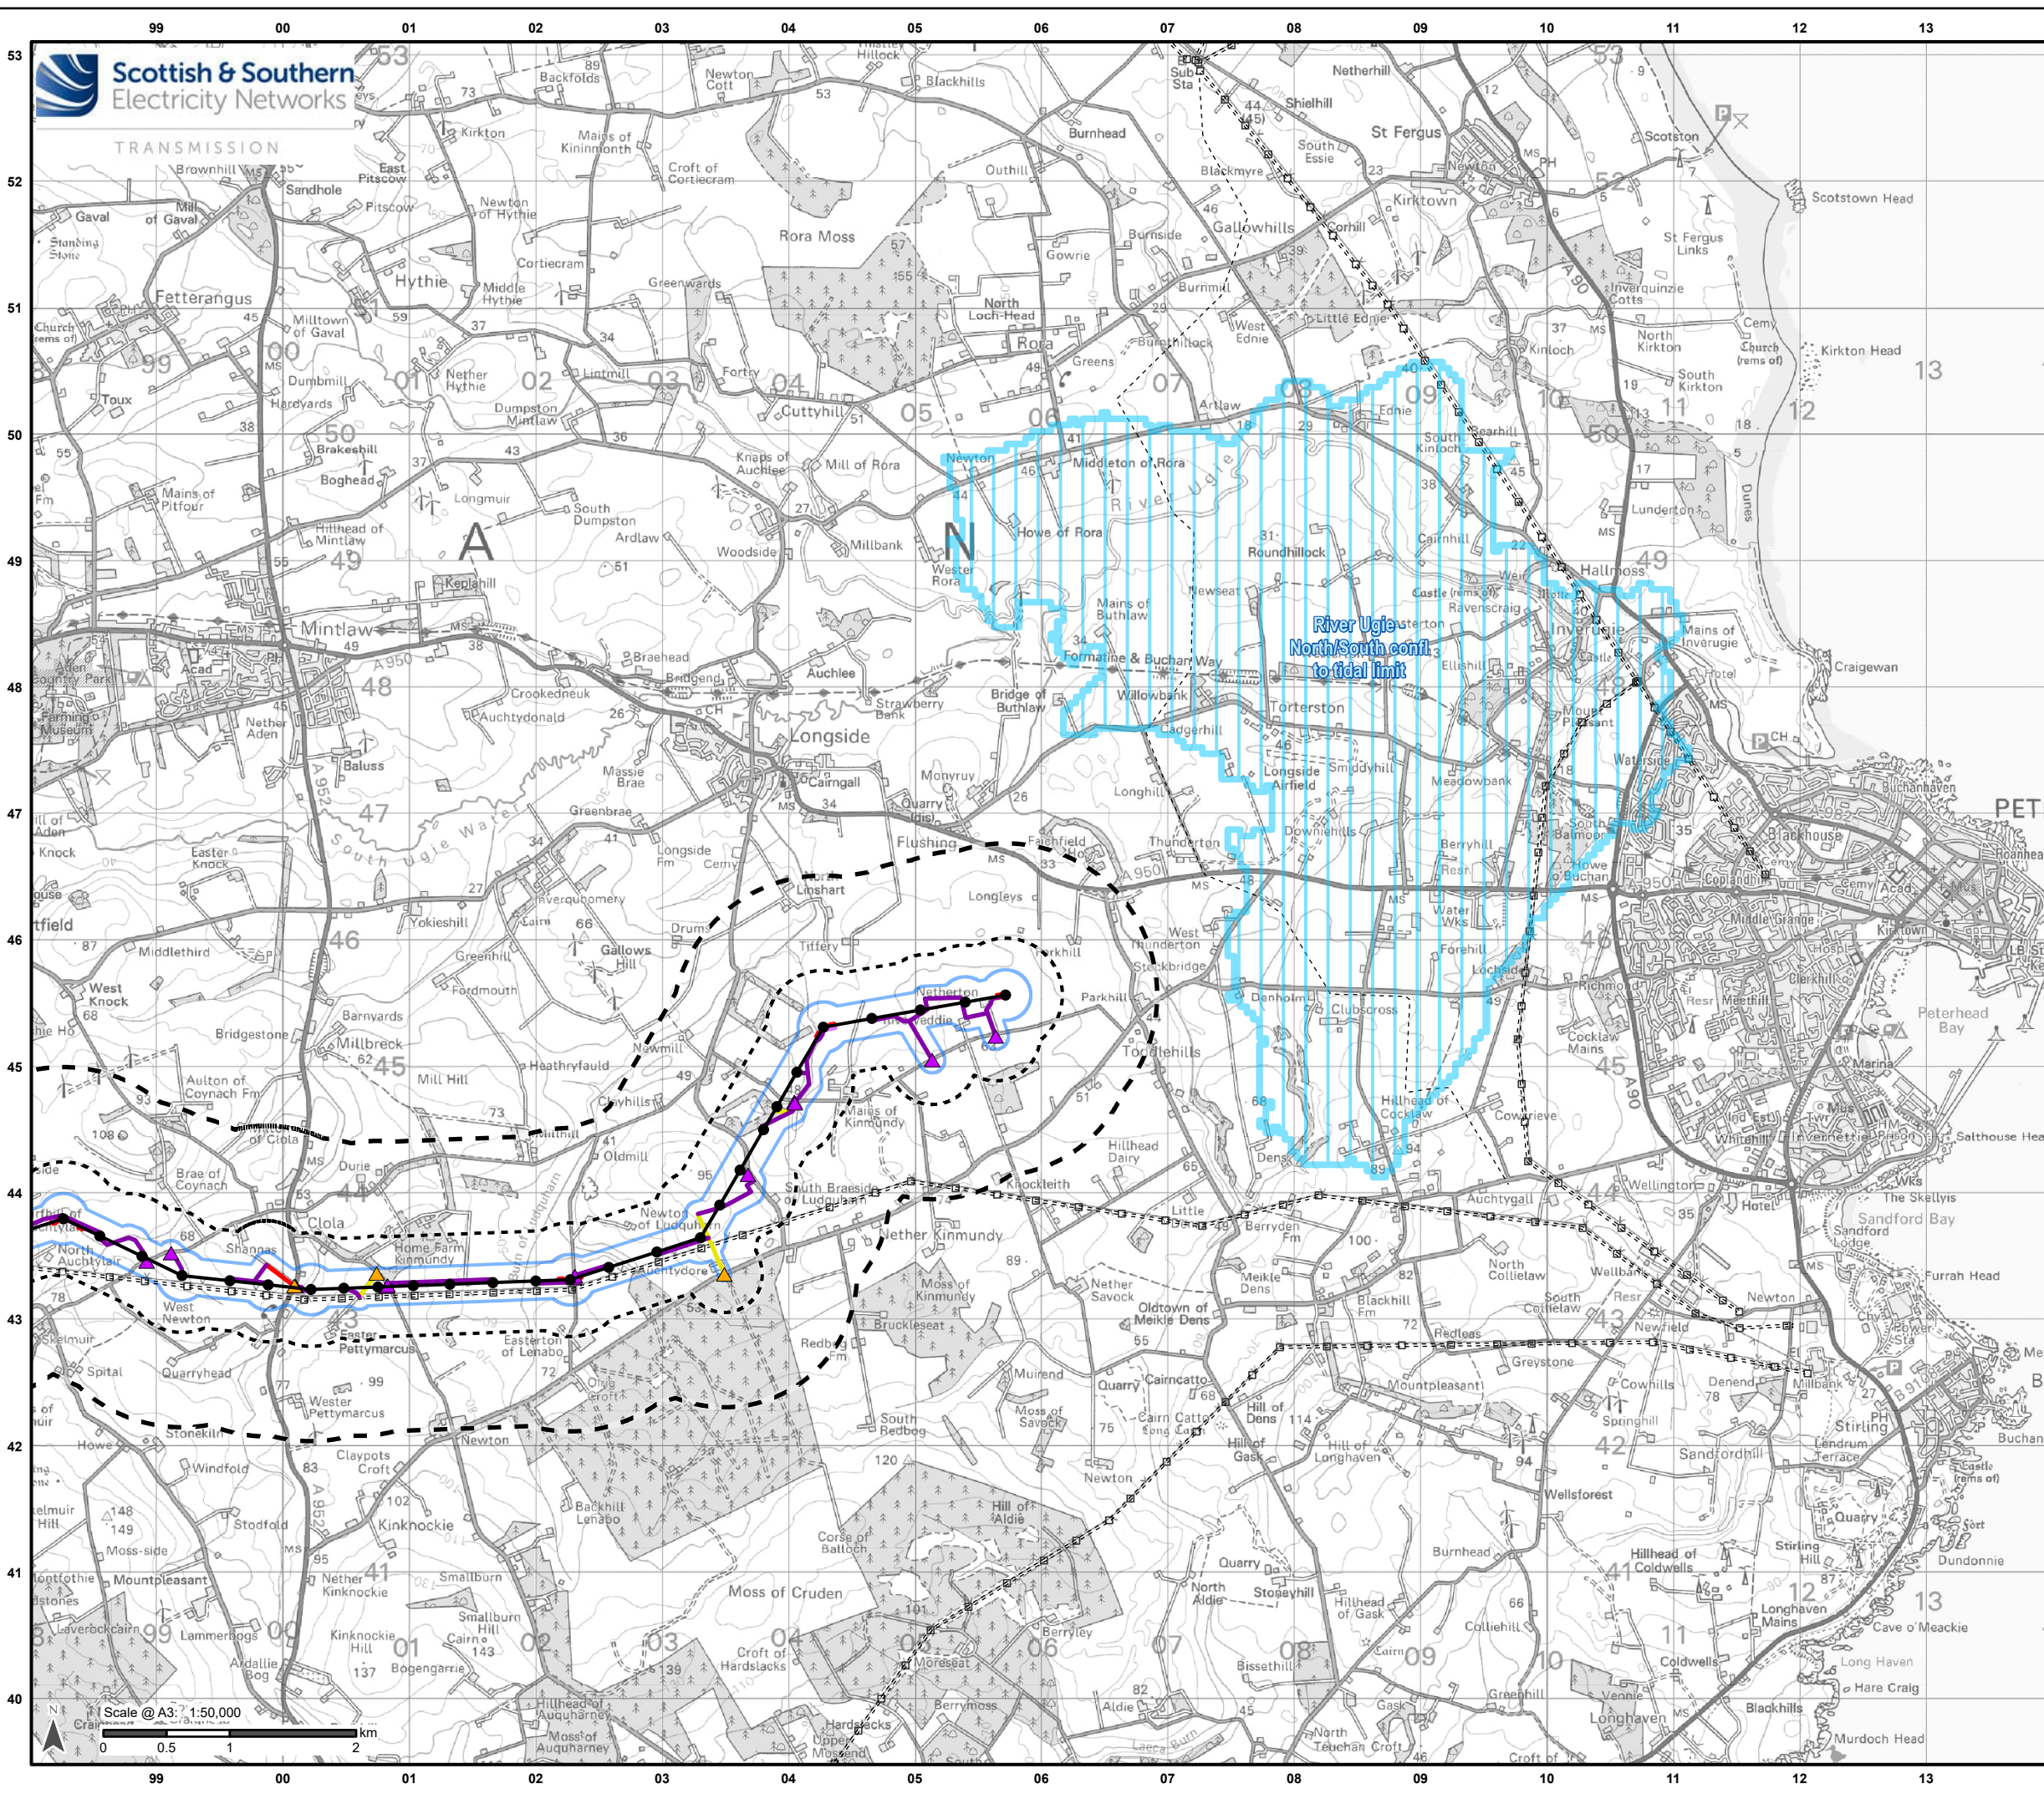

Legend

- Existing OHL
- Existing Tower
- Limit of Deviation (LoD)
- 250 m buffer from the LoD
- 1 km Study Area Buffer

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Ancillary Development

- Proposed Conductor Pulling Area (EPZ)
- Existing Access – Upgrade – Good / Fair Condition
- Existing Access – Upgrade – Very Poor Condition
- Proposed Access – ATV or Temporary Trackway
- Proposed Access – Temporary
- Proposed Bellmouth - Temporary
- Proposed Bellmouth - Upgrade

Water Abstractions and DWPA

- SEPA Drinking Water Protection Area

Scale 1:2,500,000

Reproduced by permission of Ordnance Survey, Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beaulieu to Blackhilllock to New Deer to Peterhead 400 kV OHL Project		
Title:	Figure 10.7.1 - SEPA CAR Abstractions, Scottish Water Abstractions & SEPA Drinking Water Protection Areas Page 11 of 11		
Drawn by:	MAL	Date:	12/09/2025
Drawing:	B2P-WSP-DA-70092380-145		