


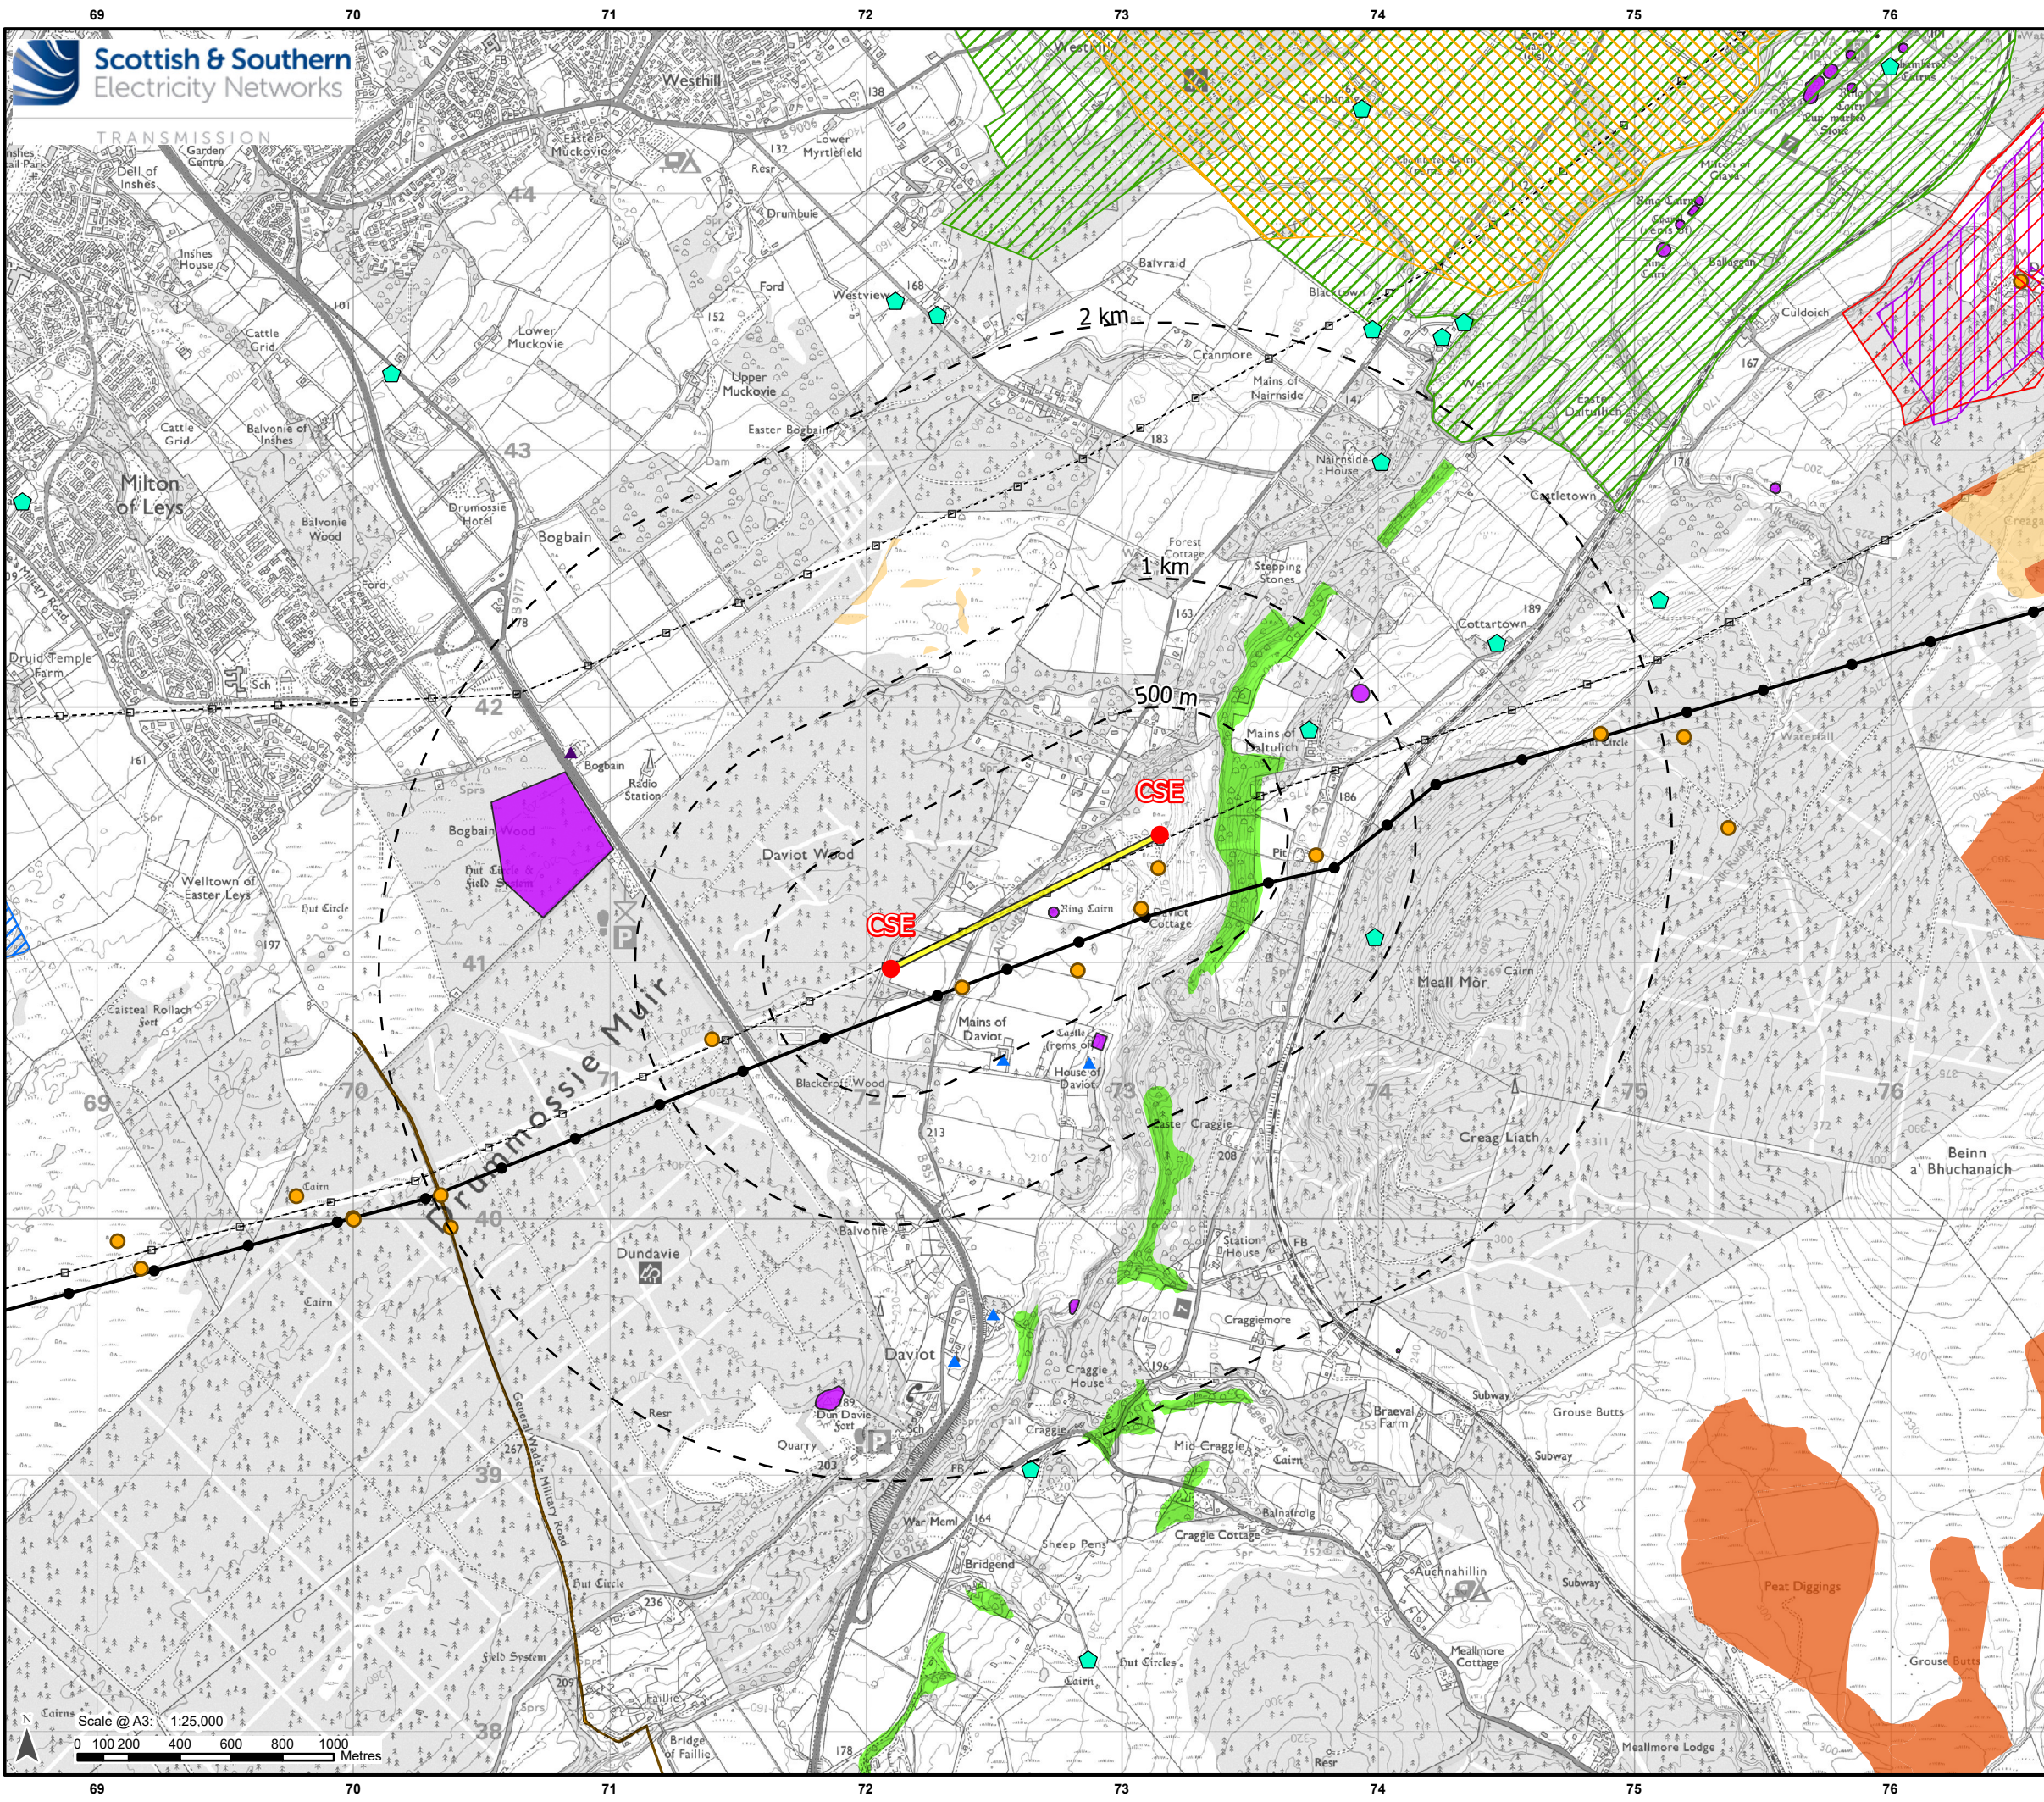

Legend

- Existing Tower
- Existing OHL
- Indicative Cable Sealing End Compound
- Section of Existing OHL to be Removed
- Buffer from Existing OHL to be Removed

Development for which Section 37 Consent is Sought

- Proposed OHL Alignment - 400 kV
- Proposed Tower - 400 kV

Environmental Constraints

- Scheduled Monument
- Ancient Woodland of Semi-Natural Origin
- Conservation Area
- Battlefield
- Gardens and Designed Landscape
- Site of Special Scientific Interest
- Geological Conservation Review Site
- NatureScot Priority Peatland Habitat - Class 1
- NatureScot Priority Peatland Habitat - Class 2
- Non-designated Heritage Asset (Polygon)
- Non-designated Heritage Asset (Point)
- Private Water Supply Source
- Listed Building Category B
- Listed Building Category C

Scale- 1:2,500,000

Reproduced by permission of Ordnance Survey. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000813445. Copyright NatureScot Contains Ordnance Survey data (© Crown copyright and database right 2025). Contains Historic Environment Scotland and Ordnance Survey data (© Historic Environment Scotland - Scottish Charity No. SC045925 © Crown copyright and database right 2025. Contains public sector information licensed under the Open Government Licence v3.0. Data reproduced with the permission of RSPB. © Crown Copyright. Ordnance Survey licence number 100021787 (2025). SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project:	Beaulieu to Blackhillock to New Deer to Peterhead 400kV OHL Project		
Title:	Figure 11.4.1 - Daviot Mitigation Environmental Constraints		
Drawn by:	MAL	Date:	28/08/2025
Drawing:	B2P-WSP-DA-70092380-189		