
36

Scottish & Southern Electricity Networks

TRANSMISSION

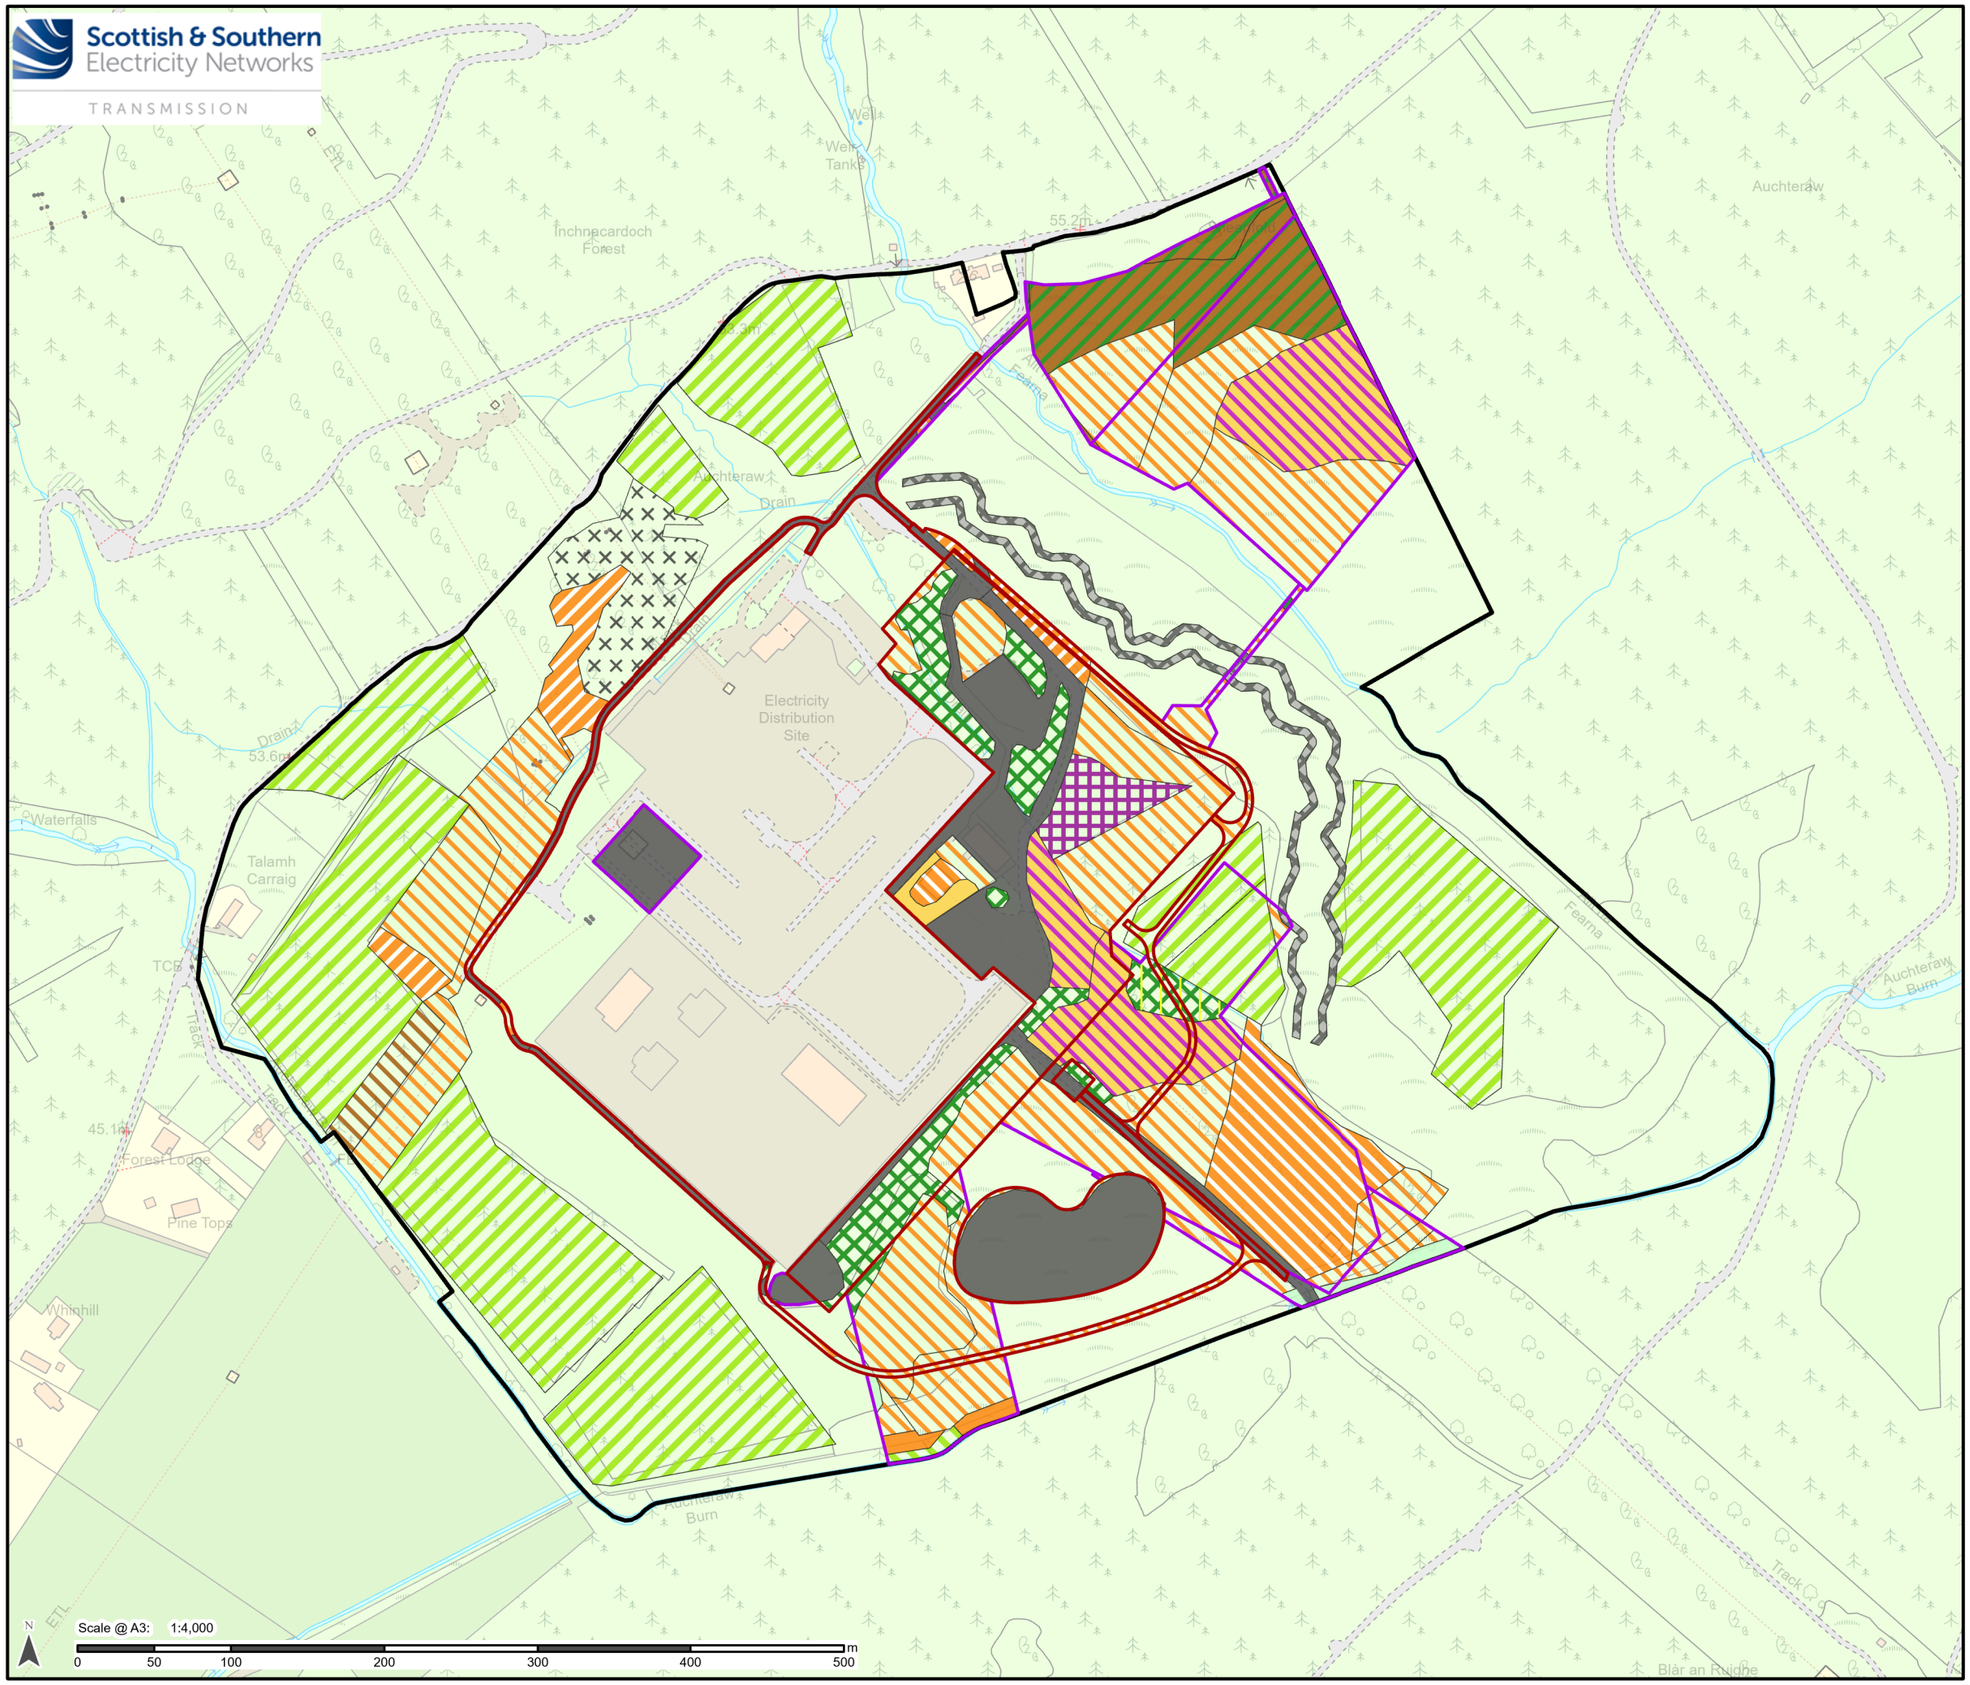

08

08

Legend


- Operational Site Boundary

Proposed Layout

- Permanent
- Temporary

Habitat Classification

- f1a6 Degraded blanket bog (H7130)
- g1b6 Other upland acid grassland
- g1c Bracken
- g1c Bracken (underscrub)
- g3c Other neutral grassland
- g3c 16 Other neutral grassland - Tall forbs
- g3c5 Arrhenatherum neutral grassland
- g3c7 Deschampsia neutral grassland
- h1b5 Dry heaths; upland (H4030)
- h1b6 Wet heathland with cross-leaved heath; upland (H4010)
- h3e Gorse scrub
- h3h Mixed scrub
- u1 Built-up areas and gardens (artificial flood control channel)
- u1c Artificial unvegetated, unsealed surface
- u1f Sparsely vegetated urban land
- w1f 30 Lowland mixed deciduous woodland - Semi-natural
- w1g 29 Other broadleaved woodland - Plantation
- w2a 30 Native pinewoods - Semi-natural
- w2b 29 Other Scots Pine woodland - Plantation
- w2c 29 Other coniferous woodland - Plantation

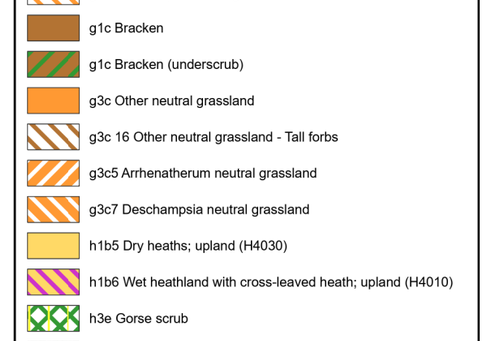

Contains public sector information licensed under the Open Government Licence v3.0. Reprocued by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2024 all rights reserved. Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT000519

Project: Fort Augustus Substation 400kV Upgrade

Title:
Post-intervention Habitat Plan

Drawn by: JBARR Date: 05/07/2024

Drawing: Annex B