
Scottish & Southern Electricity Networks
TRANSMISSION

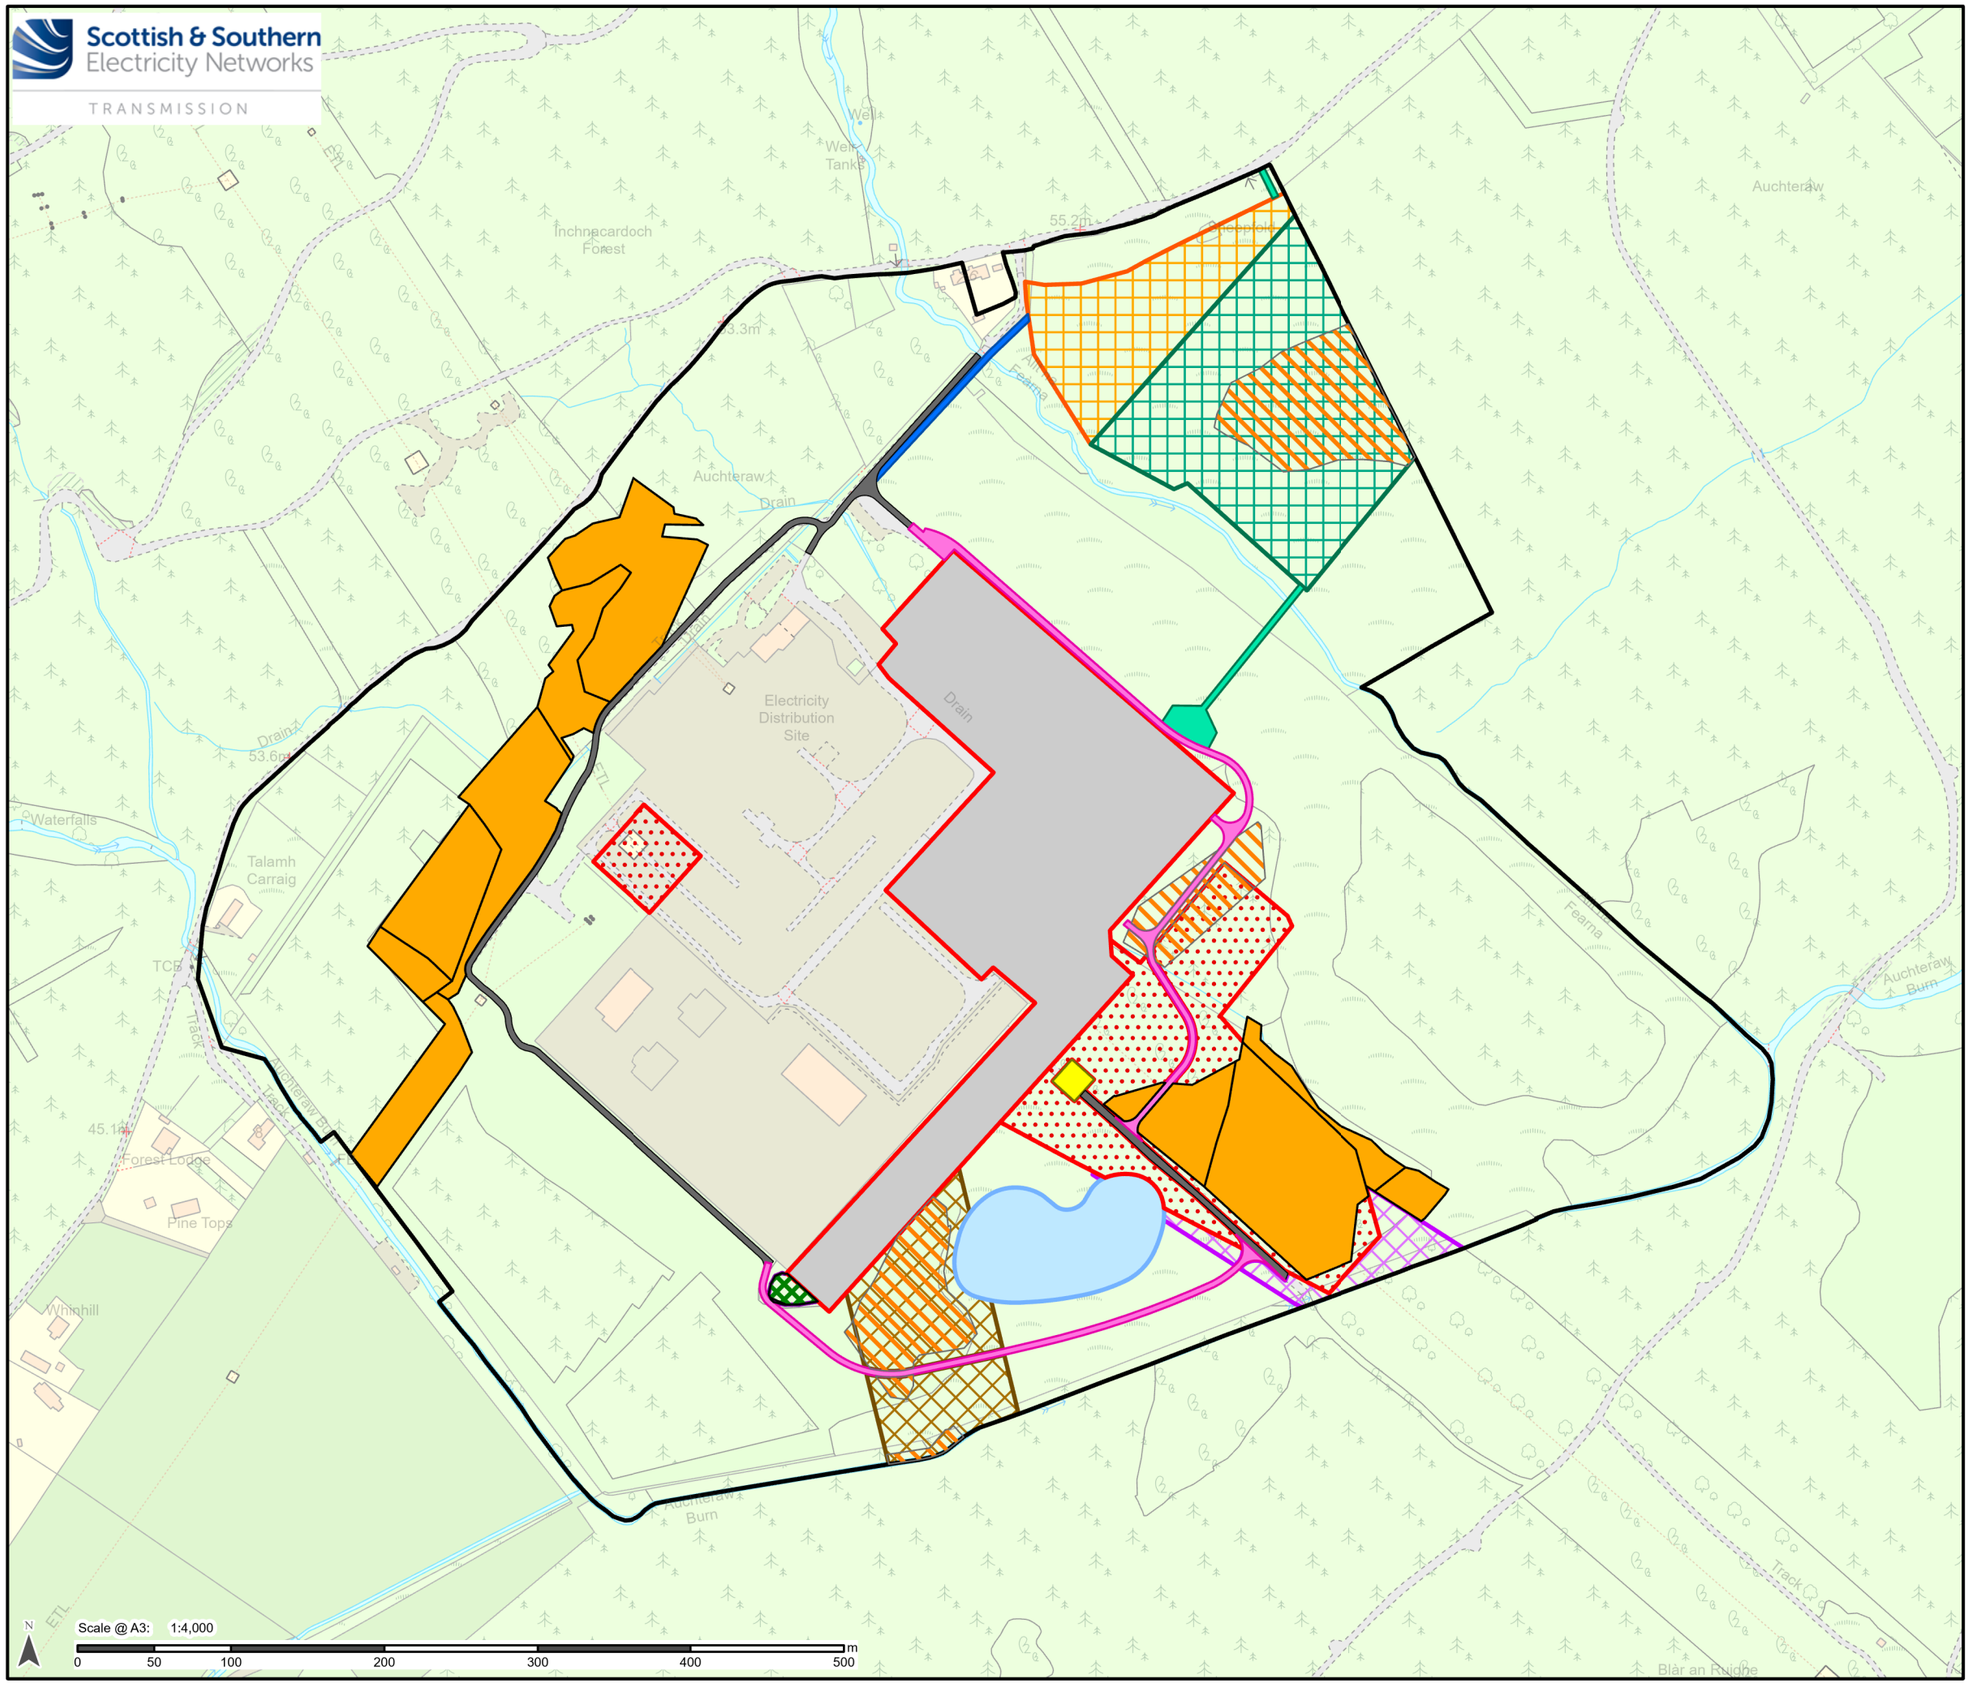

08

08

Legend


- Operational Site Boundary

Scheme Layout

- Substation Platform Extension Area
- Existing Road to be Upgraded
- Proposed Access Road
- Extent of Working Area
- Tower Base
- SuDS Pond
- SUDs Pond to be Removed
- KE CDM Heavy Vehicle
- KE CDM Pedestrian Access
- KE CDM Laydown Area
- KE CDM Site Compound
- S37 Exemption - Wayleave
- Coire Glas - Wayleave

Post Intervention Habitat Plan

- g1b6 - Other upland acid grassland
- g3c - Other neutral grassland
- h3h Mixed scrub

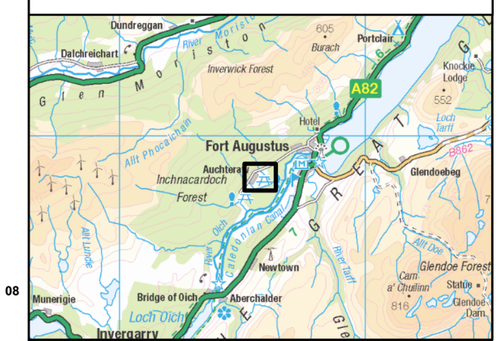

Contains public sector information licensed under the Open Government Licence v3.0. Reprocued by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2024 all rights reserved. Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT000519

Project: Fort Augustus Substation 400kV Upgrade

Title:
Post-development Habitat Plan

Drawn by: JBARR Date: 05/07/2024

Drawing: Annex D