

Legend

Proposed Development Sites 50m Buffer

Substation

Proposed Development Site

Permanent Site Layout

Substation Platform

SUDs Basin

Access Track

Earthworks

Temporary Site Layout

Access Track

Earthworks

Temporary Office and Welfare Compound

Temporary Compound

OHL

Proposed Development Site

Permanent OHL Section Spans

Temporary OHL Section Spans

Peat Slide Assessed Hazard

1 - Negligible

2 - Unlikely

3 - Likely

4 - Probable

5 - Almost certain

Area of No Peat Probing Data Available within 50m - Peat depths assumed

Contains public sector information licensed under the Open Government Licence v3.0. Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. **SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey**


Project No: LT000521

Project: Bingly 400kV Substation Upgrade

Title: Peat Slide Assessed Hazard
Page 1 of 5

Drawn by: JBARR Date: 08/05/2025

Drawing: Figure 9e

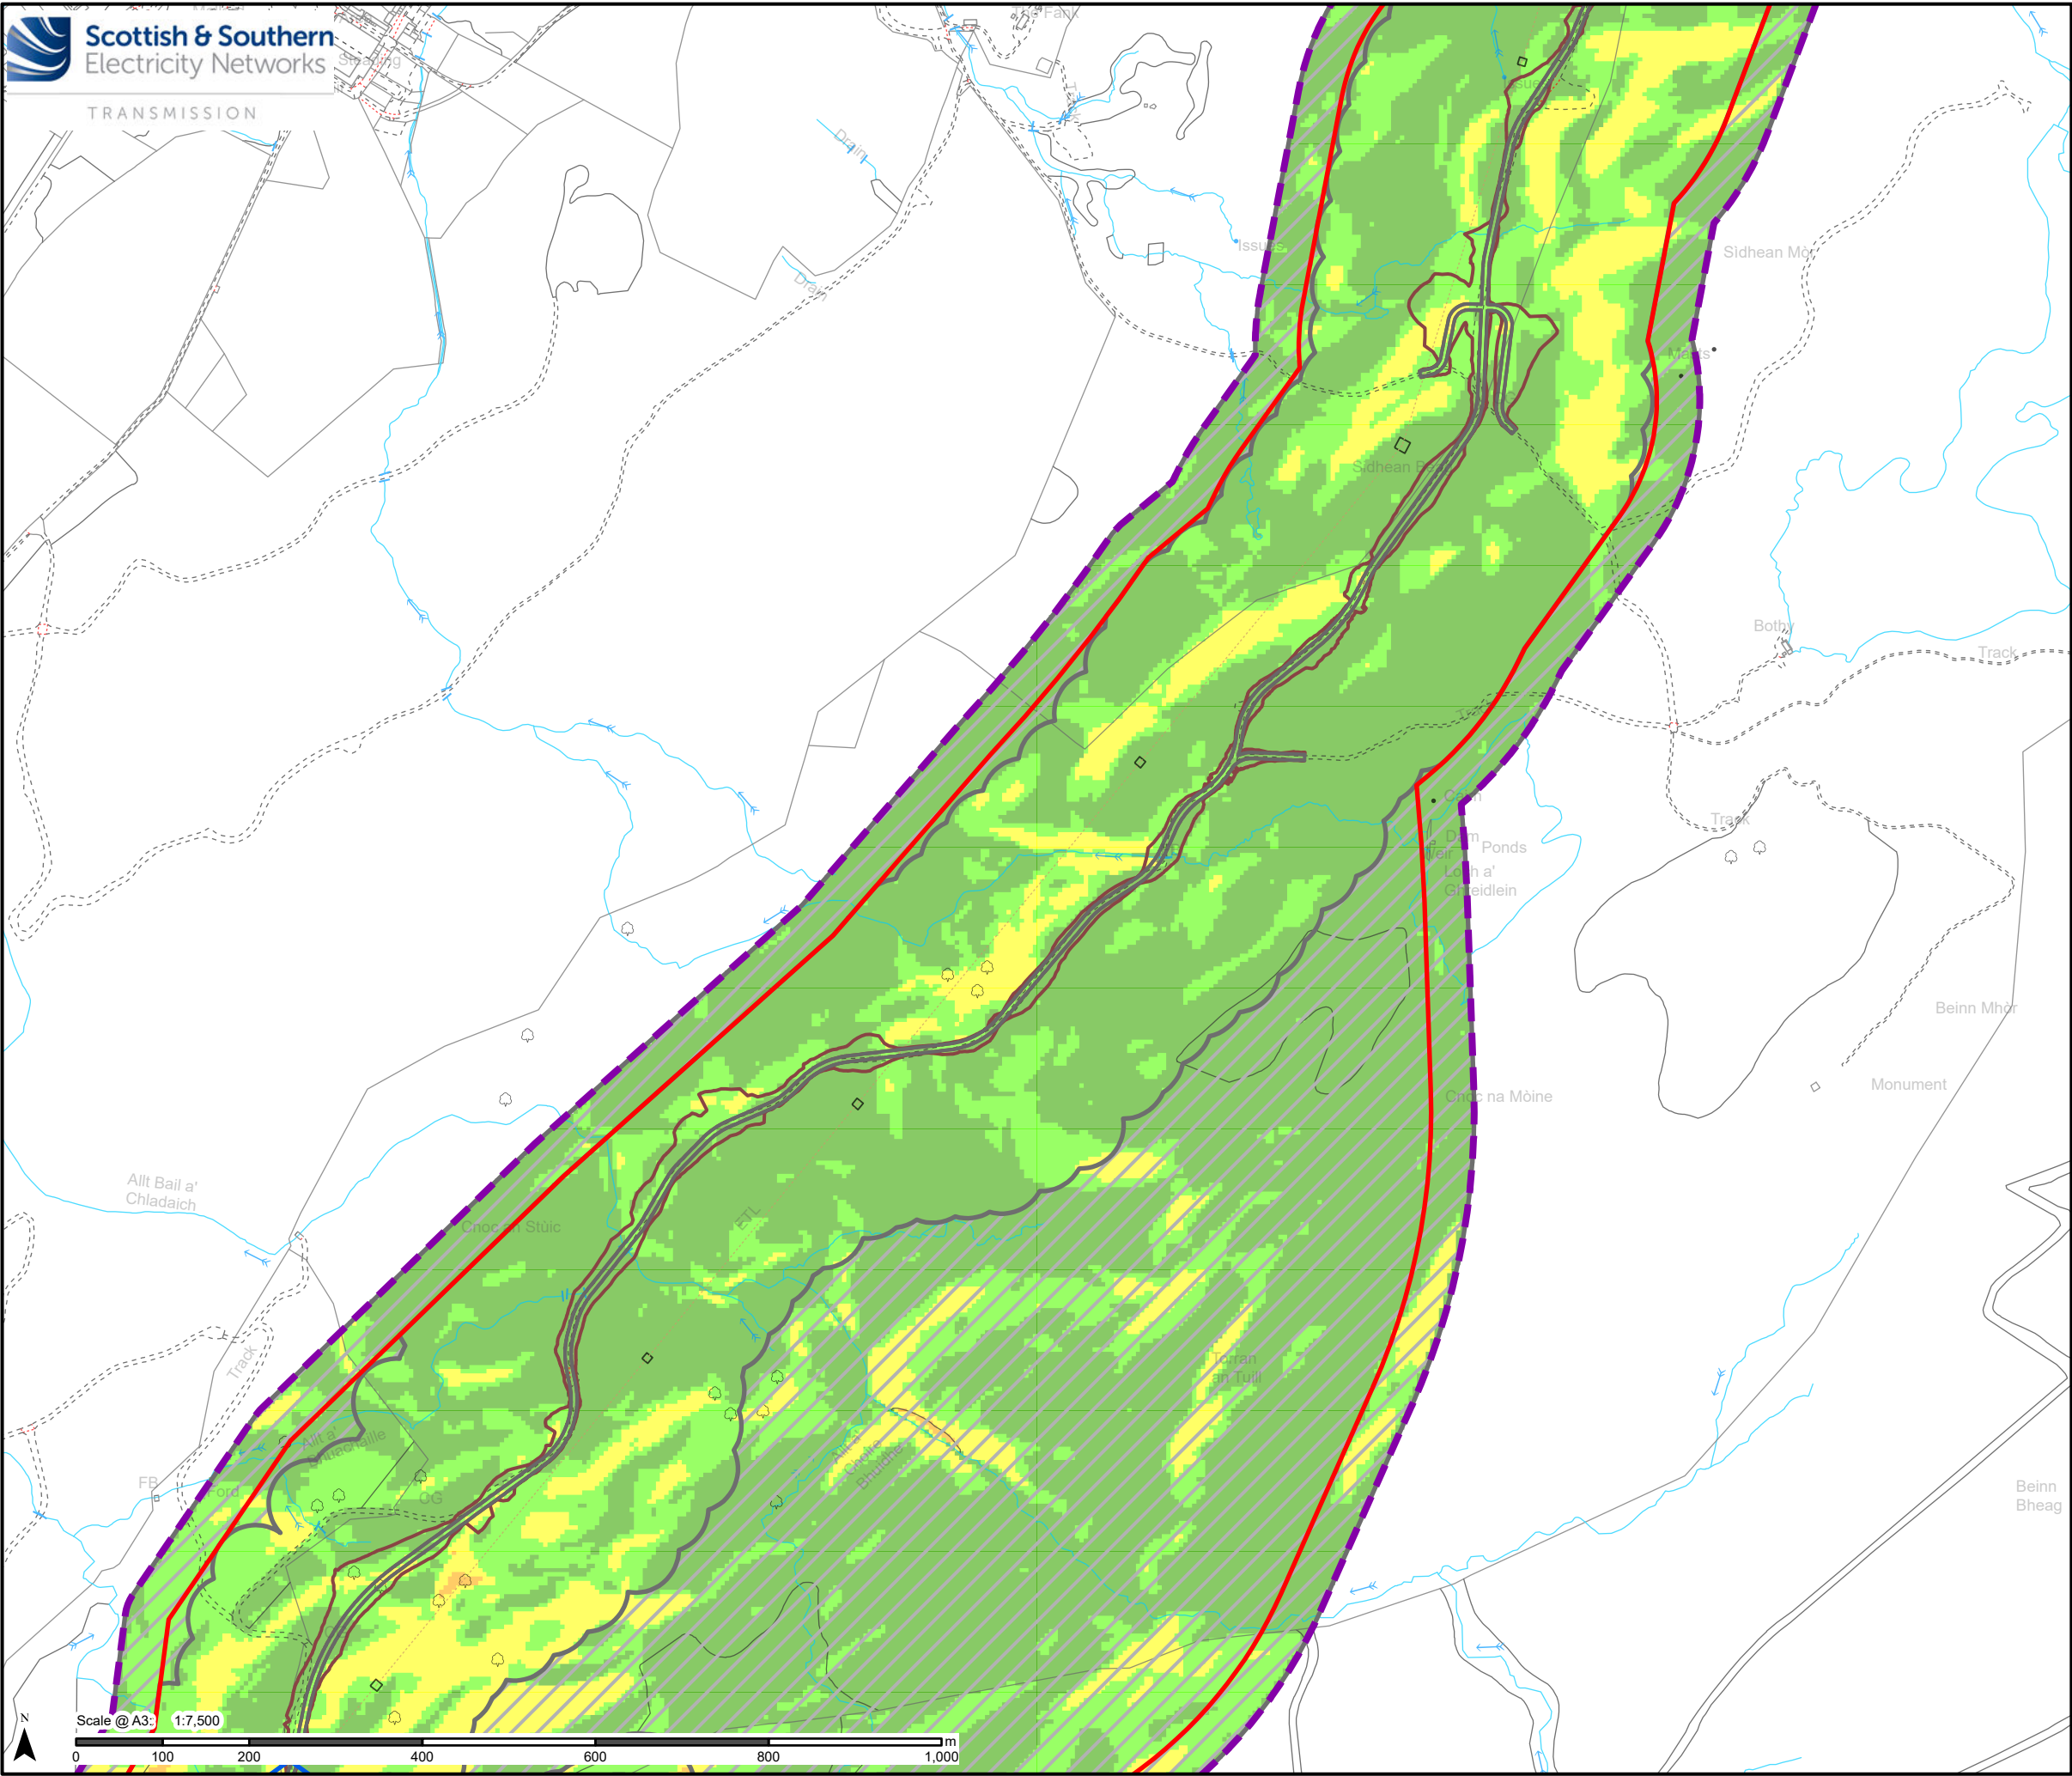

Legend

Proposed Development Sites 50m Buffer

Substation

Proposed Development Site

Permanent Site Layout

Access Track

Earthworks

OHL

Proposed Development Site

Peat Slide Assessed Hazard

1 - Negligible


2 - Unlikely

3 - Likely

4 - Probable

5 - Almost certain

Area of No Peat Probing Data Available within 50m - Peat depths assumed

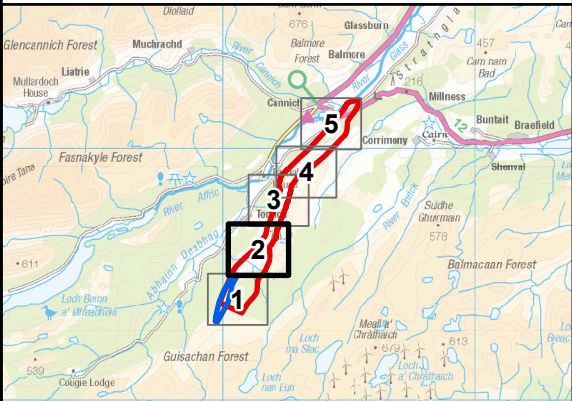

Contains public sector information licensed under the Open Government Licence v3.0. Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. **SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey**

Project No: LT000521


Project: Bingly 400kV Substation Upgrade

Title:
Peat Slide Assessed Hazard
Page 2 of 5

Drawn by: JBARR

Date: 08/05/2025

Drawing: Figure 9b

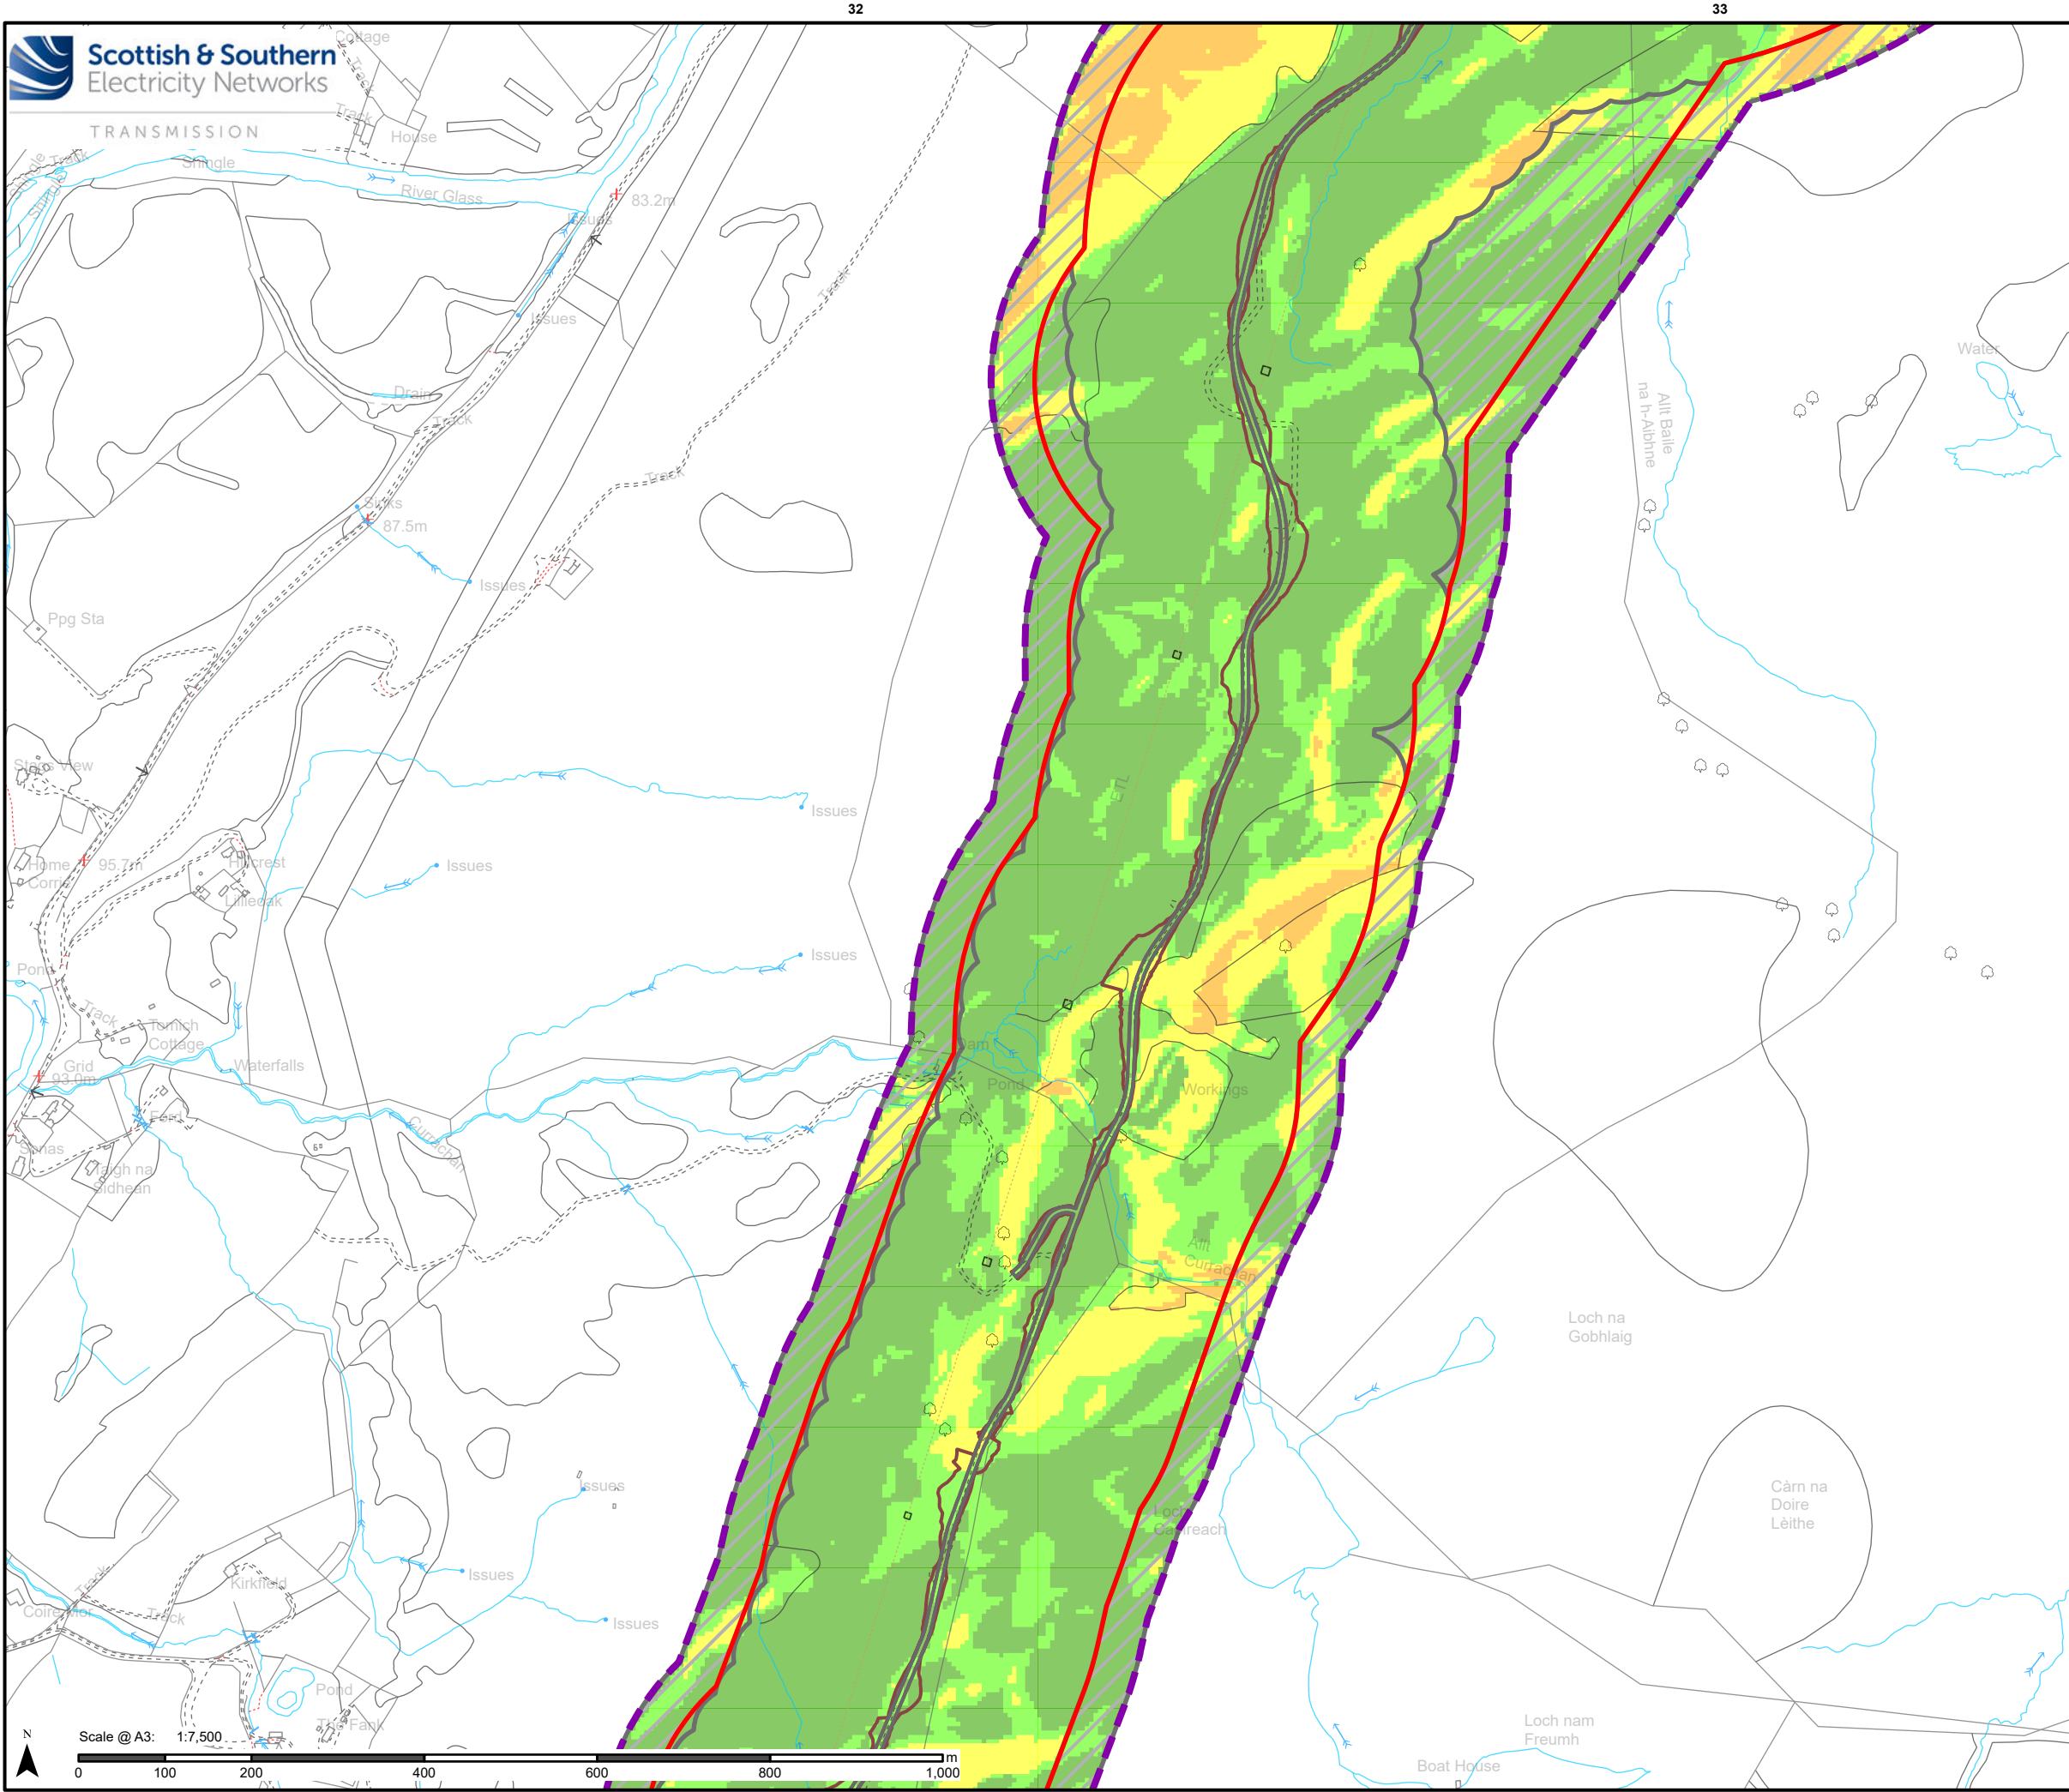

Legend

Proposed Development Sites 50m Buffer

Substation

Proposed Development Site

Permanent Site Layout

Access Track

Earthworks

Peat Slide Assessed Hazard

1 - Negligible

2 - Unlikely

3 - Likely

4 - Probable

5 - Almost certain

Area of No Peat Probing Data Available within 50m - Peat depths assumed

Contains public sector information licensed under the Open Government Licence v3.0. Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. **SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey**


Project No: LT000521

Project: Bingly 400kV Substation Upgrade

Title: Peat Slide Assessed Hazard
Page 3 of 5

Drawn by: JBARR Date: 08/05/2025

Drawing: Figure 9c

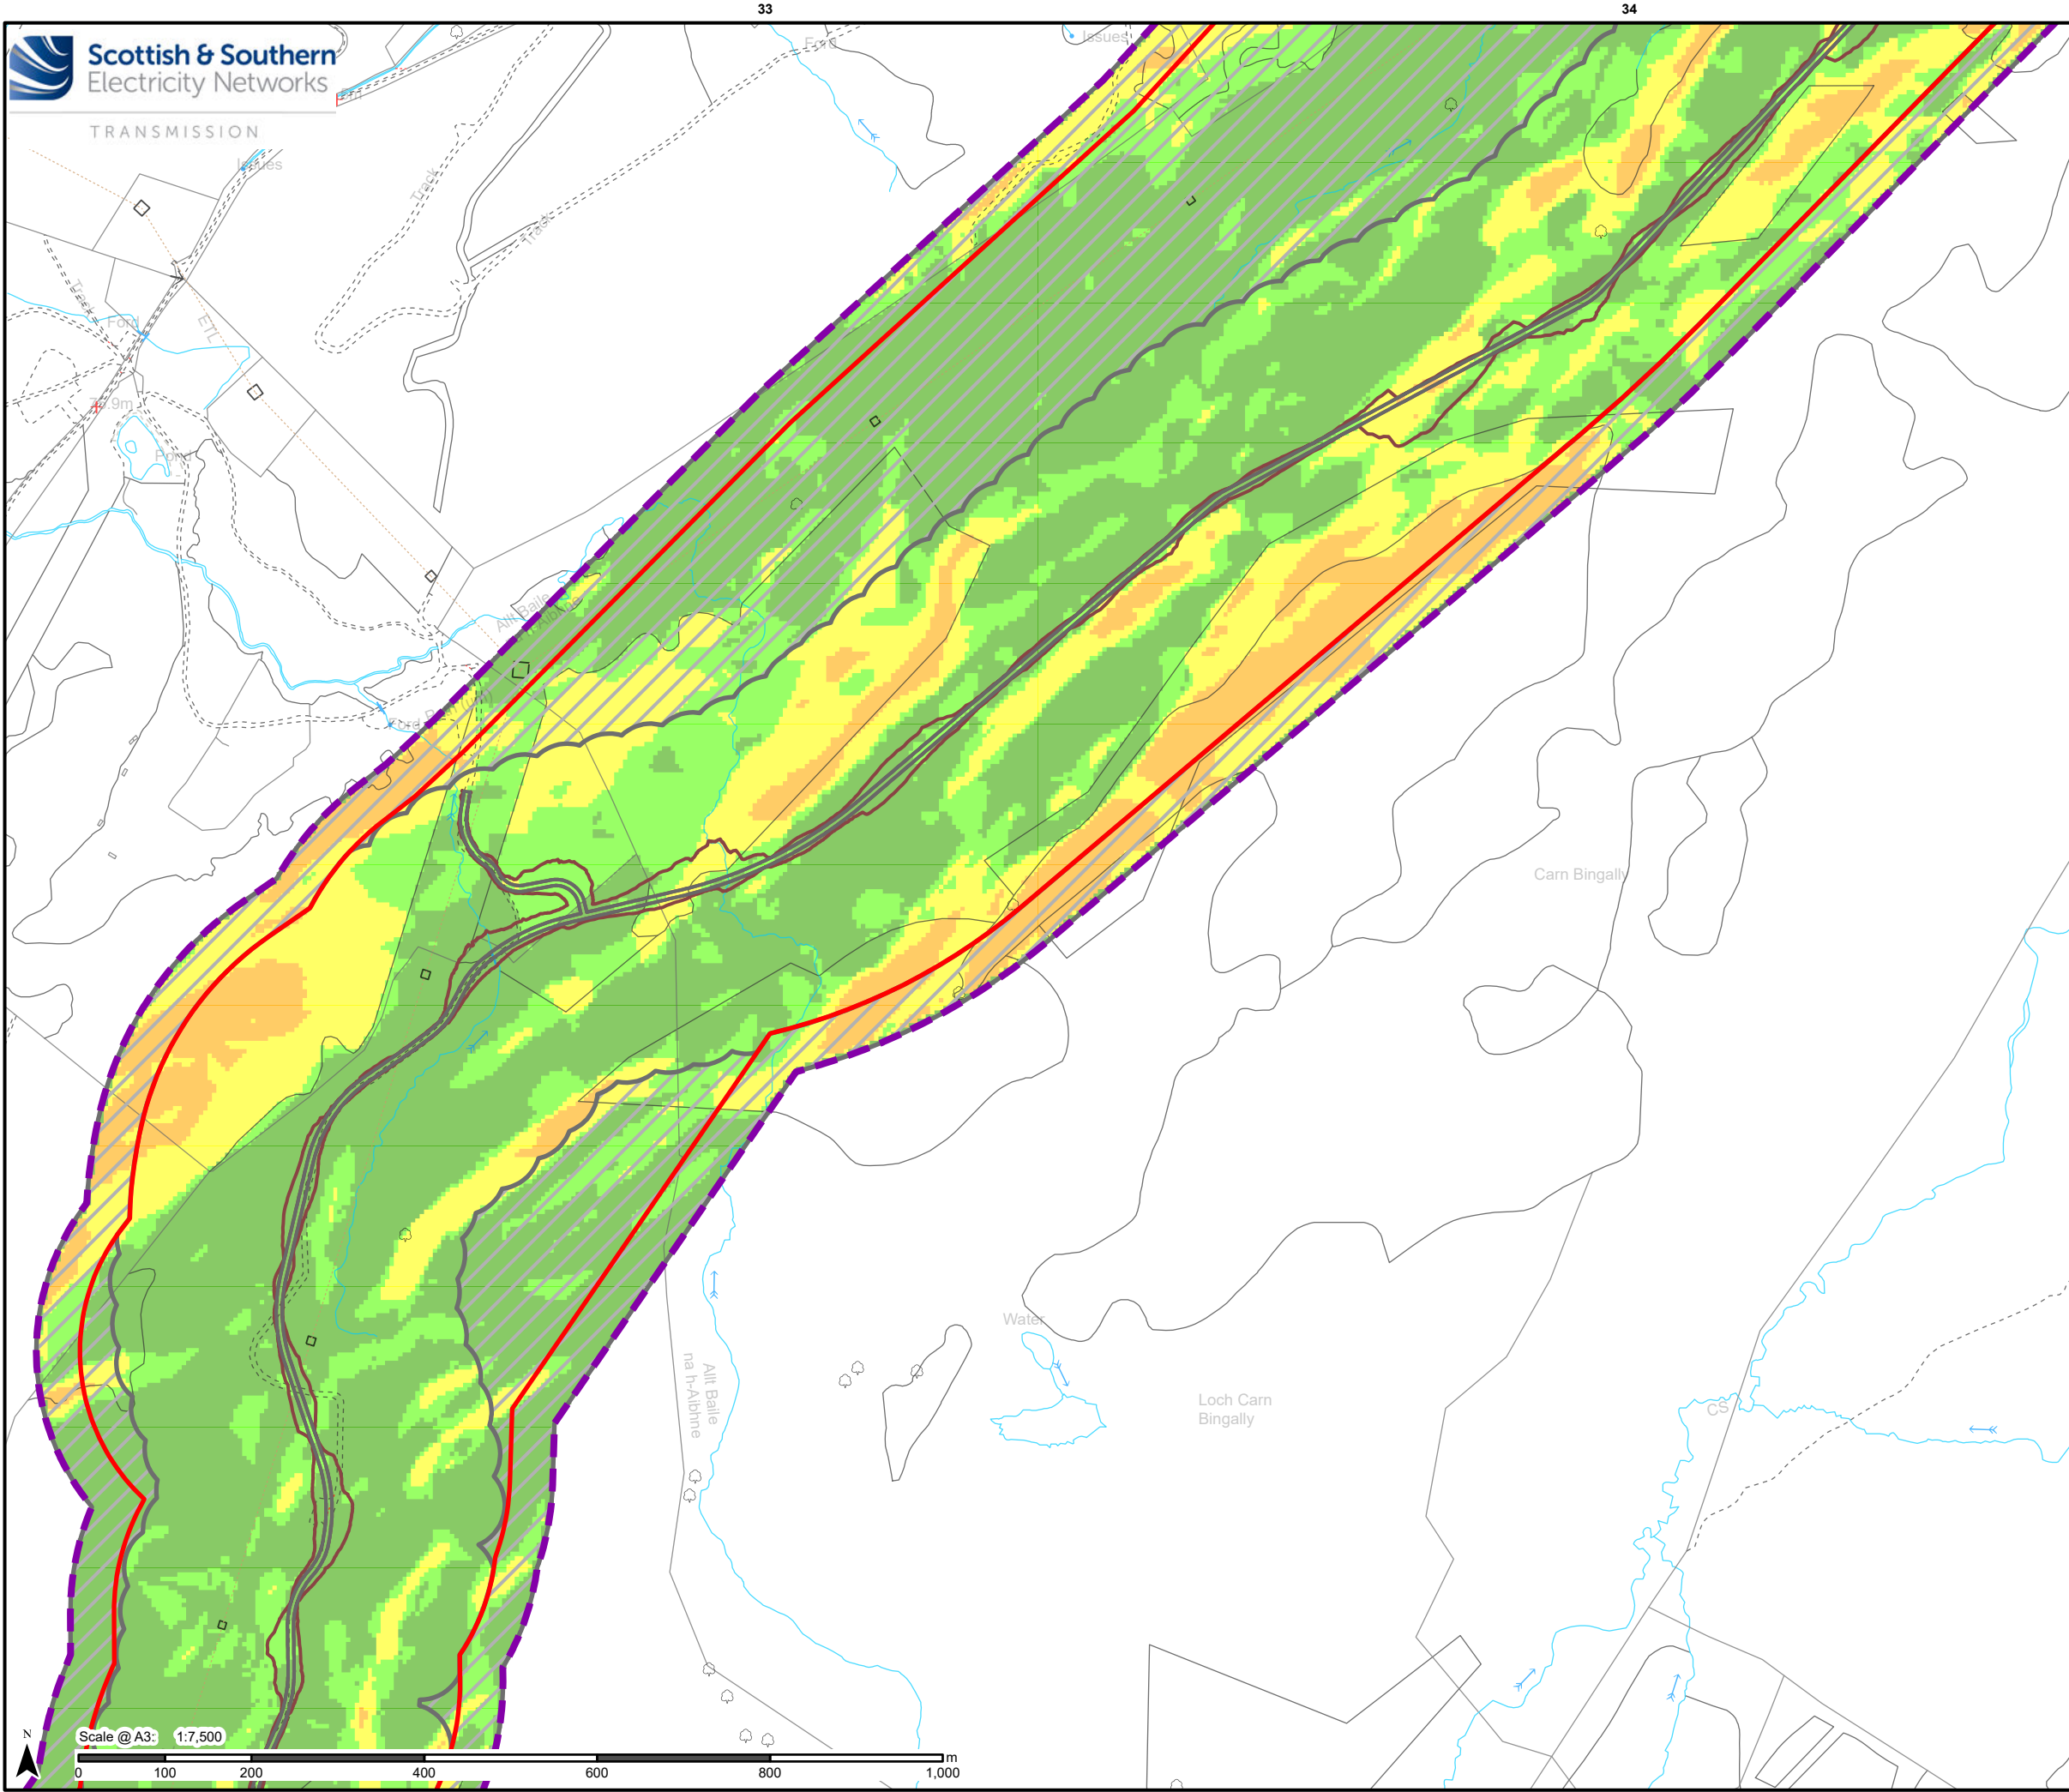

Legend

- Proposed Development Sites 50m Buffer
- Substation**
 - Proposed Development Site
- Permanent Site Layout**
 - Access Track
 - Earthworks
- Peat Slide Assessed Hazard**
 - 1 - Negligible
 - 2 - Unlikely
 - 3 - Likely
 - 4 - Probable
 - 5 - Almost certain
 - Area of No Peat Probing Data Available within 50m - Peat depths assumed

Contains public sector information licensed under the Open Government Licence v3.0. Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. **SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey**


Project No: LT000521

Project: Bingly 400kV Substation Upgrade

Title:
Peat Slide Assessed Hazard
Page 4 of 5

Drawn by: JBARR Date: 08/05/2025

Drawing: Figure 9d

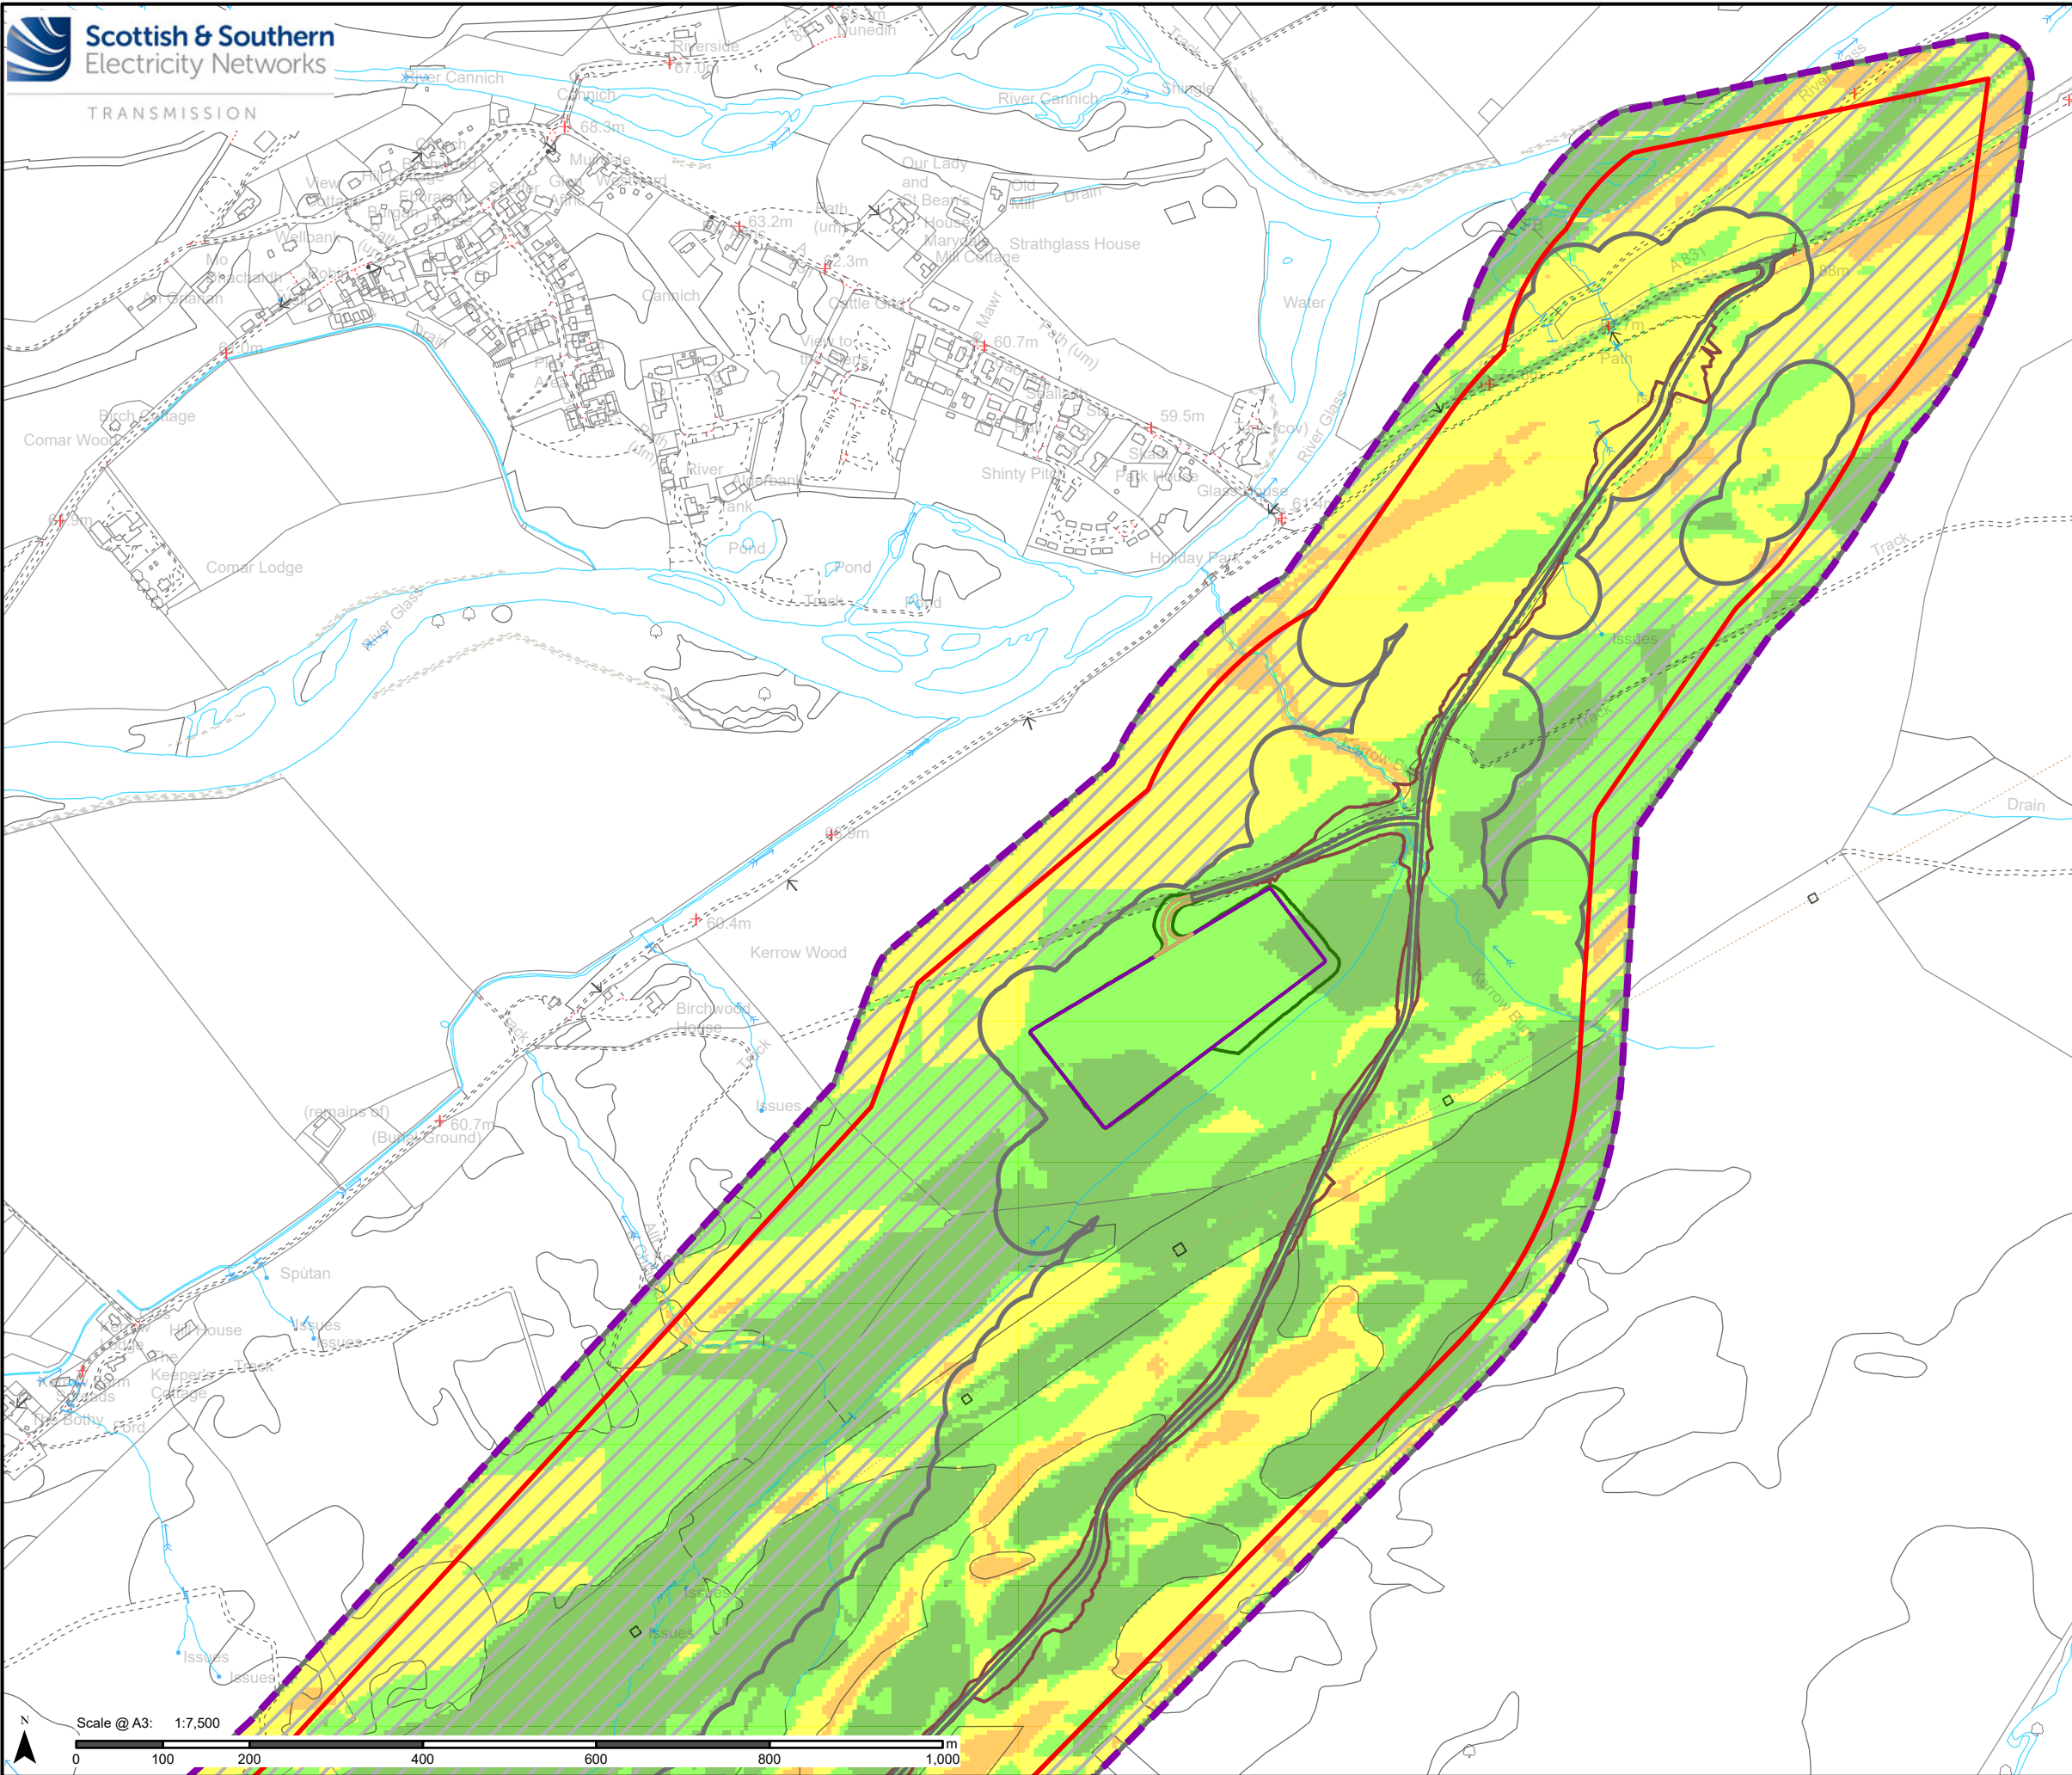

Legend

Proposed Development Sites 50m Buffer

Substation

Proposed Development Site

Permanent Site Layout

Access Track

Earthworks

Temporary Site Layout

Access Track

Earthworks

Temporary Compound

Peat Slide Assessed Hazard

1 - Negligible

2 - Unlikely

3 - Likely

4 - Probable

5 - Almost certain

Area of No Peat Probing Data Available within 50m - Peat depths assumed

Contains public sector information licensed under the Open Government Licence v3.0. Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT000521

Project: Bingly 400kV Substation Upgrade

Title: Peat Slide Assessed Hazard
Page 5 of 5

Drawn by: JBARR Date: 08/05/2025

Drawing: Figure 9e