

Chleansaid Wind Farm 132 kV OHL Connection Environmental Appraisal (EA) Report

Appendix 1.1: Figures

November 2024



Figures

Figure 1.1 – Location Plan

Figure 2.1 – Route Options

Figure 2.2 – Alignment Options

Figure 2.3 – Proposed Alignment

Figure 3.1 – Proposed Development Layout Plan

Figure 3.2 – Key Environmental Constraints

Figure 5.1 – Cumulative Developments

Figure 6.1 – ZTV and Viewpoint Locations

Figure 6.2 – Wild Land Areas within the Study Area

Figure 6.3 – Landscape Character Types within the Study Area

Figure 9.1 – Cultural Heritage Assets

Figure 9.2a-d – Existing view, wireline and solid visualisations from Dalnessie, Settlement N of Feith Osdail (SM4563)

Figure 9.3a-d - Existing view, wireline and solid visualisation from Loch Beag Na Fuaralachd, Shielings 1000m Sw of Sw end of SM5159

Figure 9.4a-d - Existing view, wireline and solid visualisation from Cnoc A' Bhreac-Leathaid, shielings and cairnfield 700m Nne of SM5300


Figure 10.1 – Hydrology Overview

Figure 10.2 – Superficial Geology

Figure 11.1 – Forestry Location Map

Figure 11.2 – Forestry Project Felling Corridor

Date Saved: 20/09/2024
Document Path: \\uk.wspgroup.com\central\data\Projects\70109xxx\70109477 - Chleasaid WF Connection EIA\03 WPIE&E (CRC GISMXD)\Figure 3.1 - Site Layout.mxd

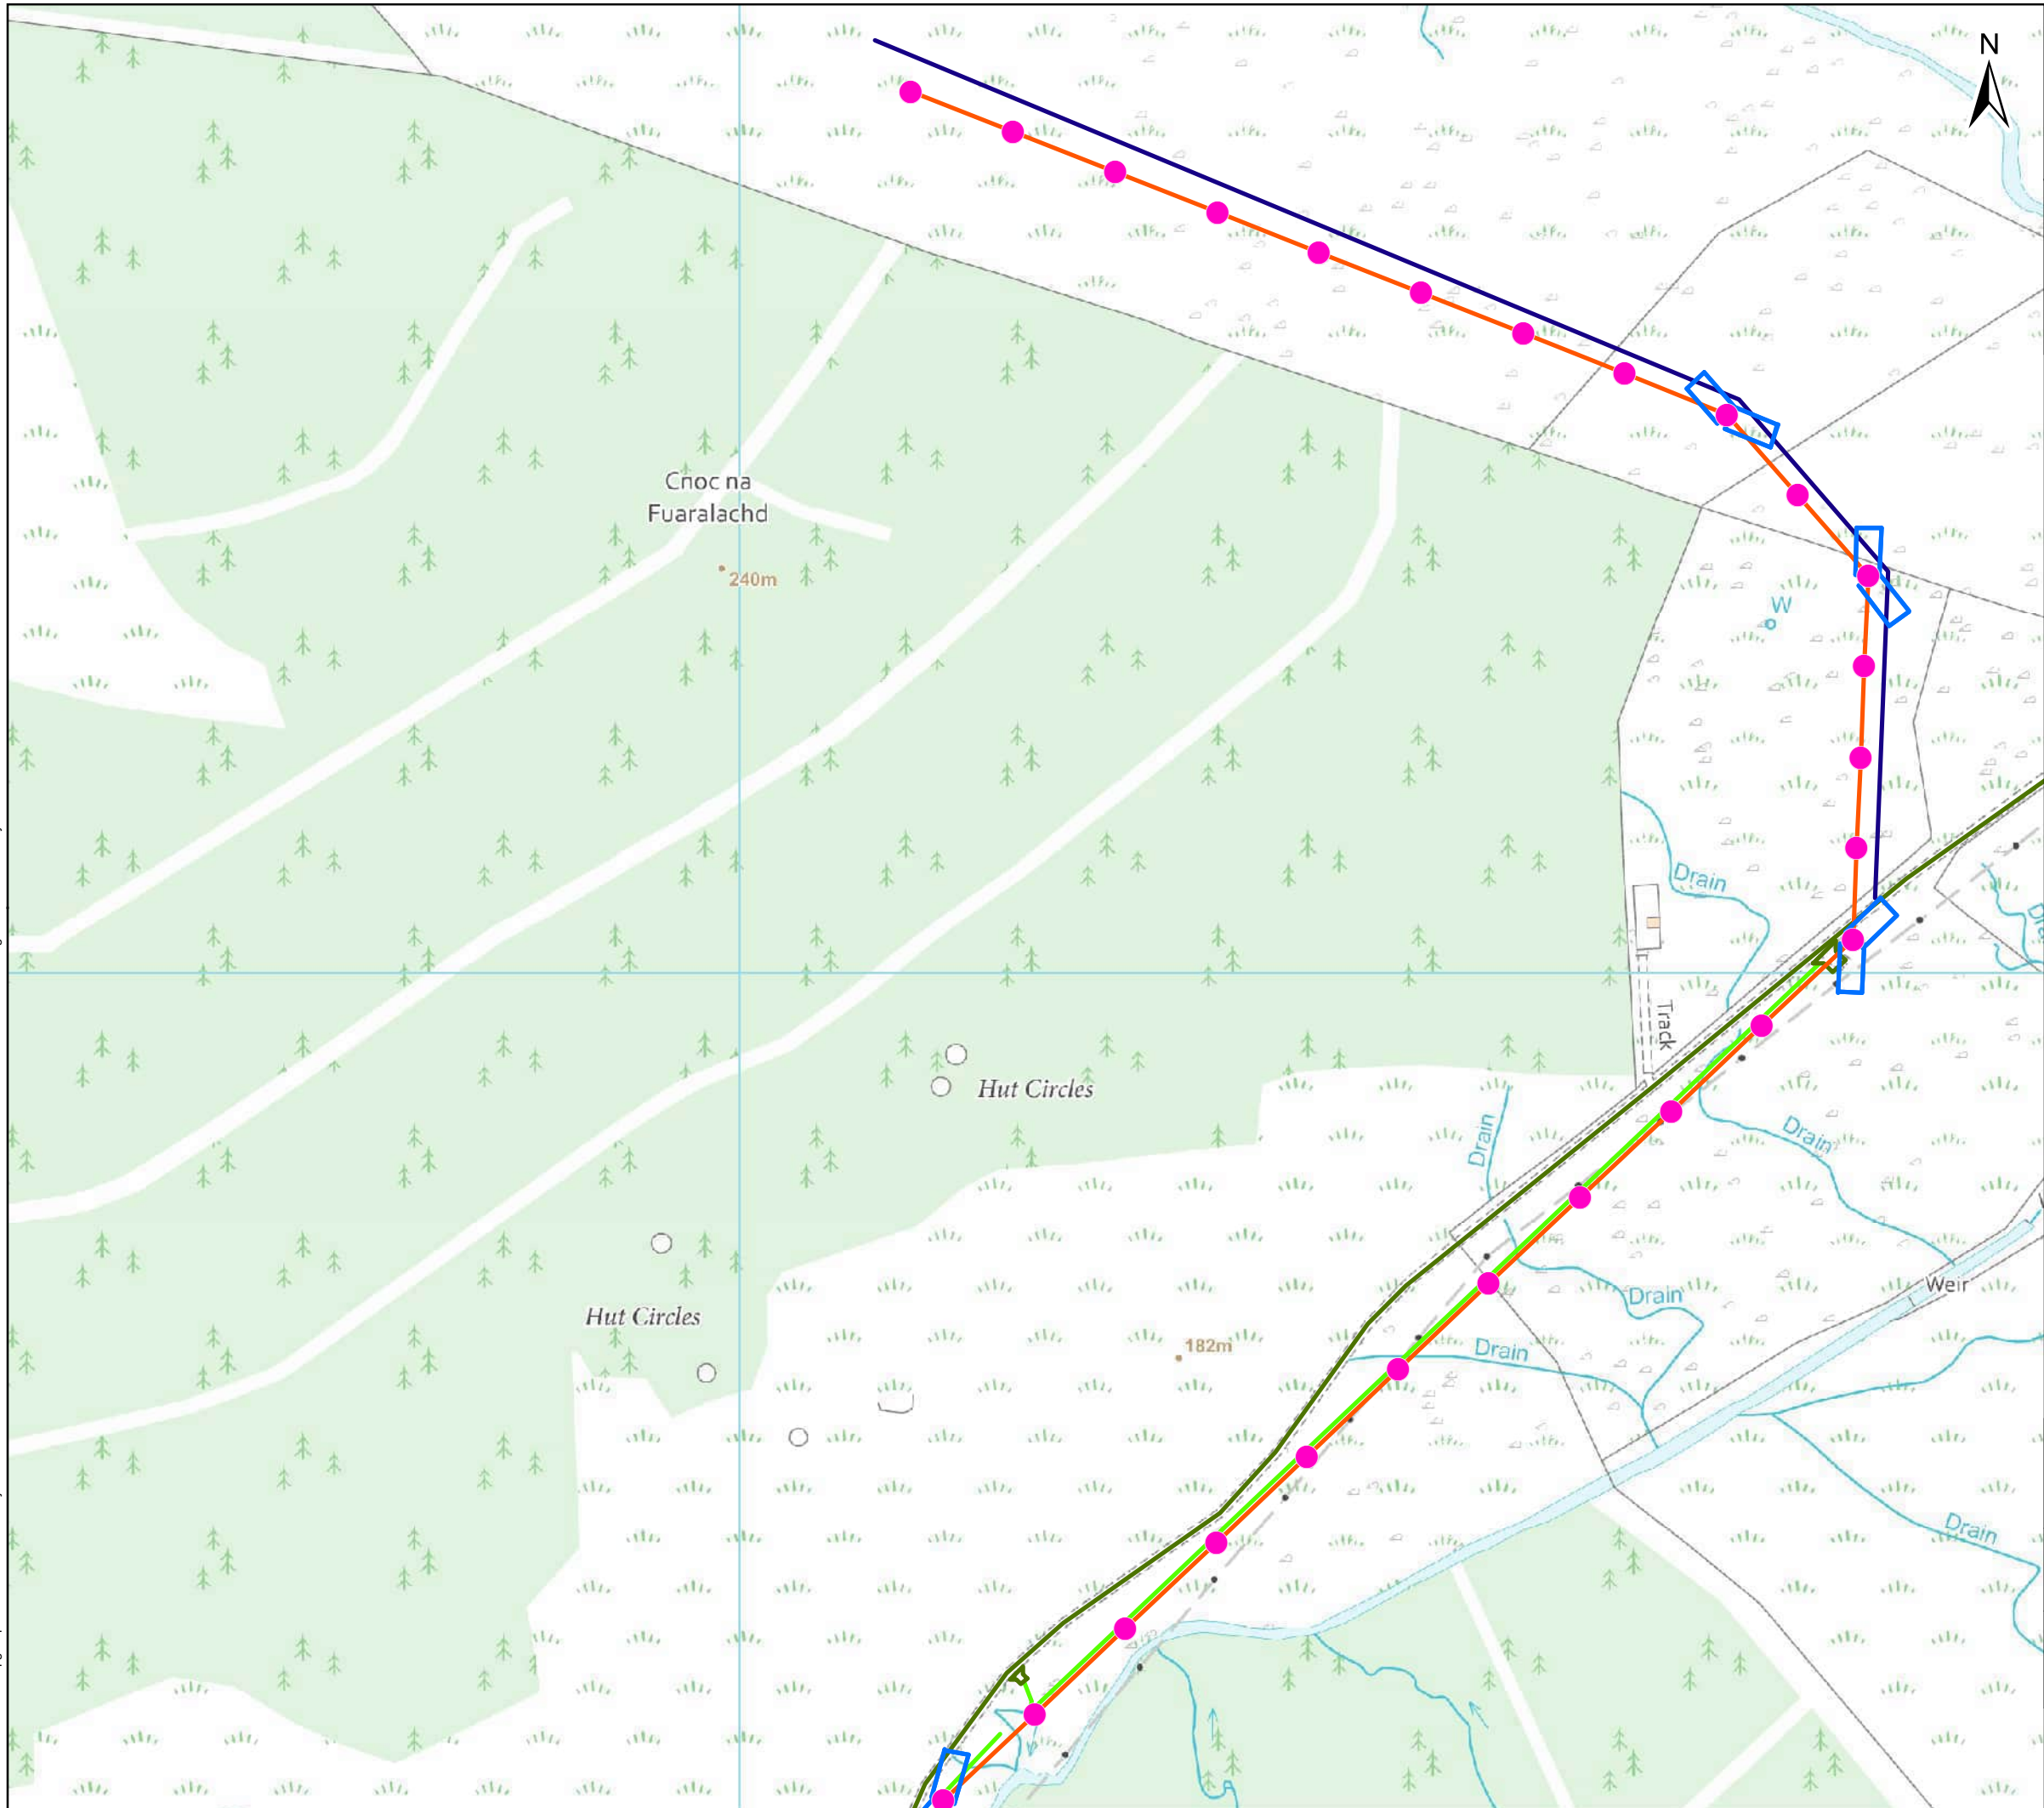

- ### Legend
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Chleasaid Windfarm Developer Access
 - Proposed Pulling Position




Client:  Scottish & Southern Electricity Networks
TRANSMISSION



Project: Chleasaid Wind Farm 132 kV OHL Connection

Title: Figure 3.1 Proposed Development Layout Plan
Page 1 of 8

Date: 20/09/2024 Scale: 4,800 @ A3
Drawn: PB Checked: CE Approved: MR
Drawing Number: CWFC-WSP-DA-GIS-118

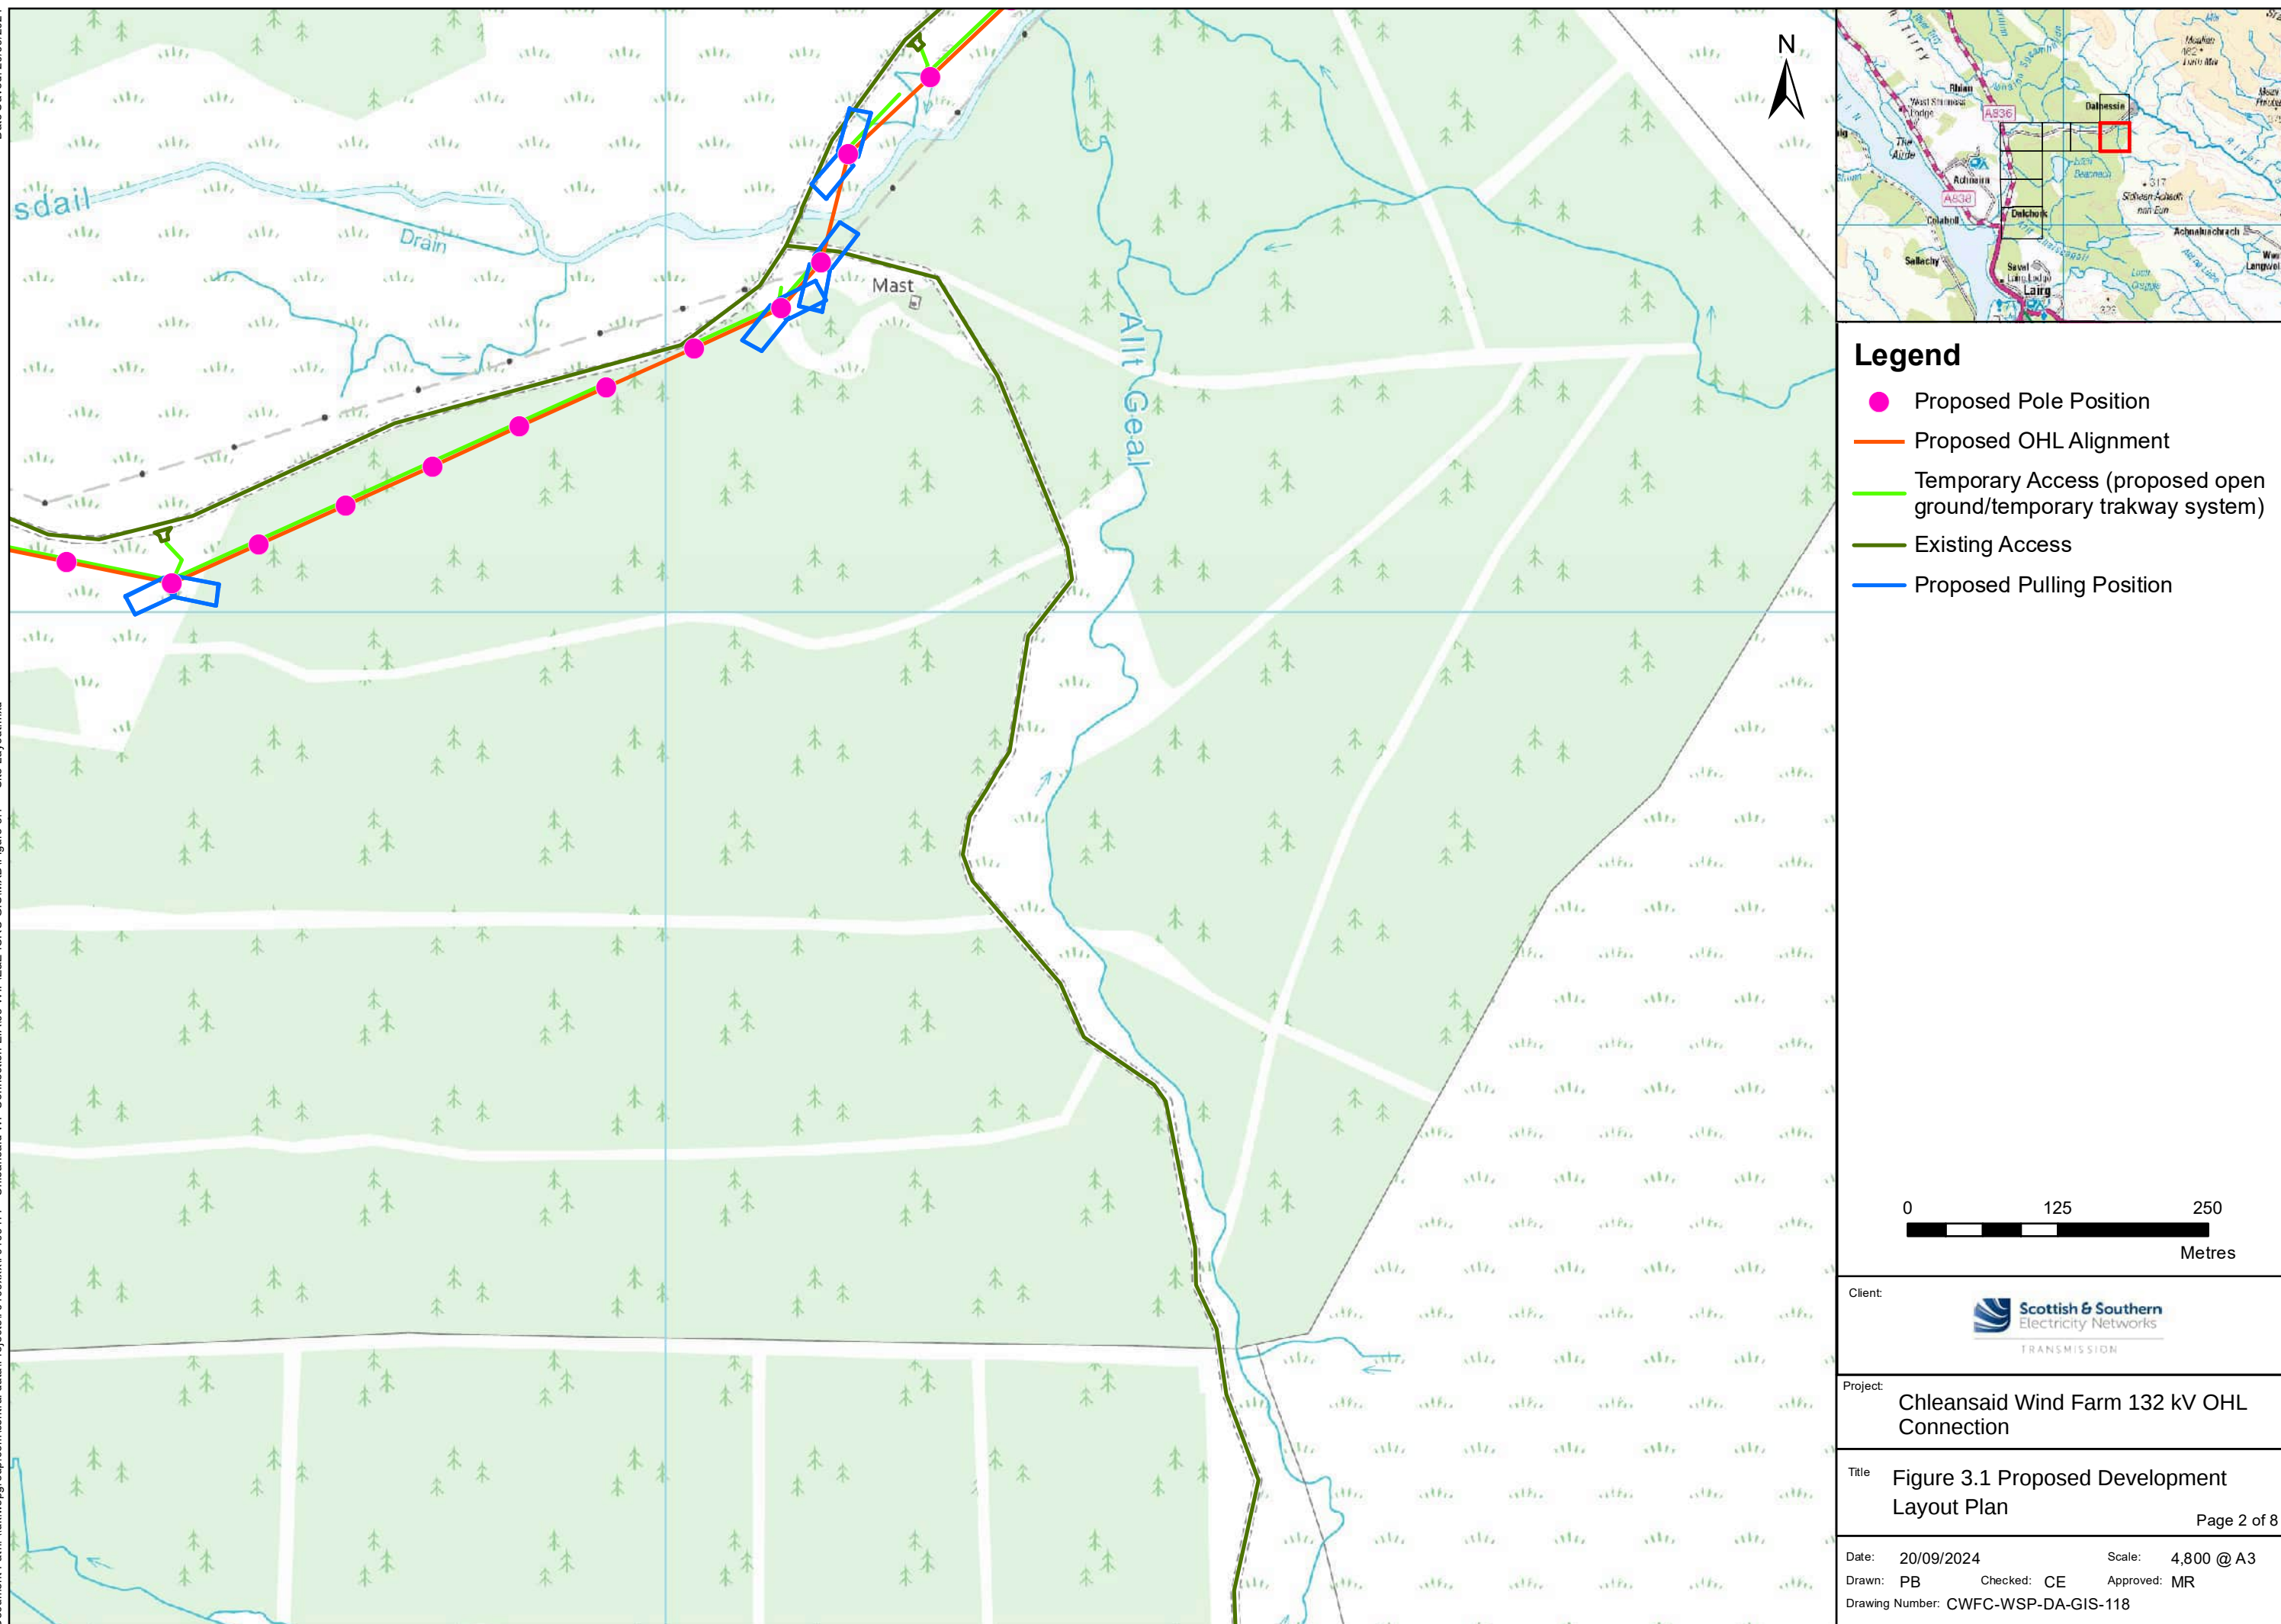

Date Saved: 20/09/2024
Document Path: \\uk.wspgroup.com\central_data\Projects\70109xxx\70109477 - Cleansaid WF Connection EIA\03 WIP\E&E (CRC GISMXD)\Figure 3.1 - Site Layout.mxd

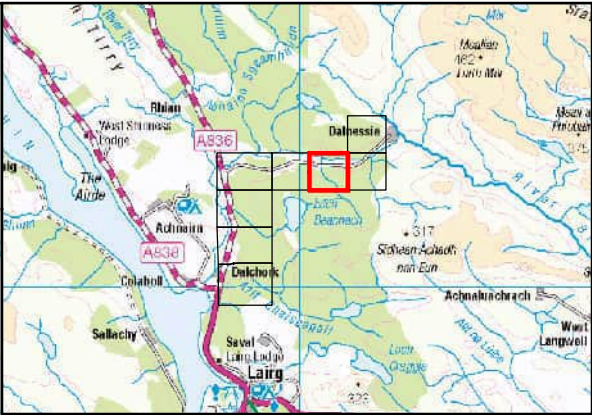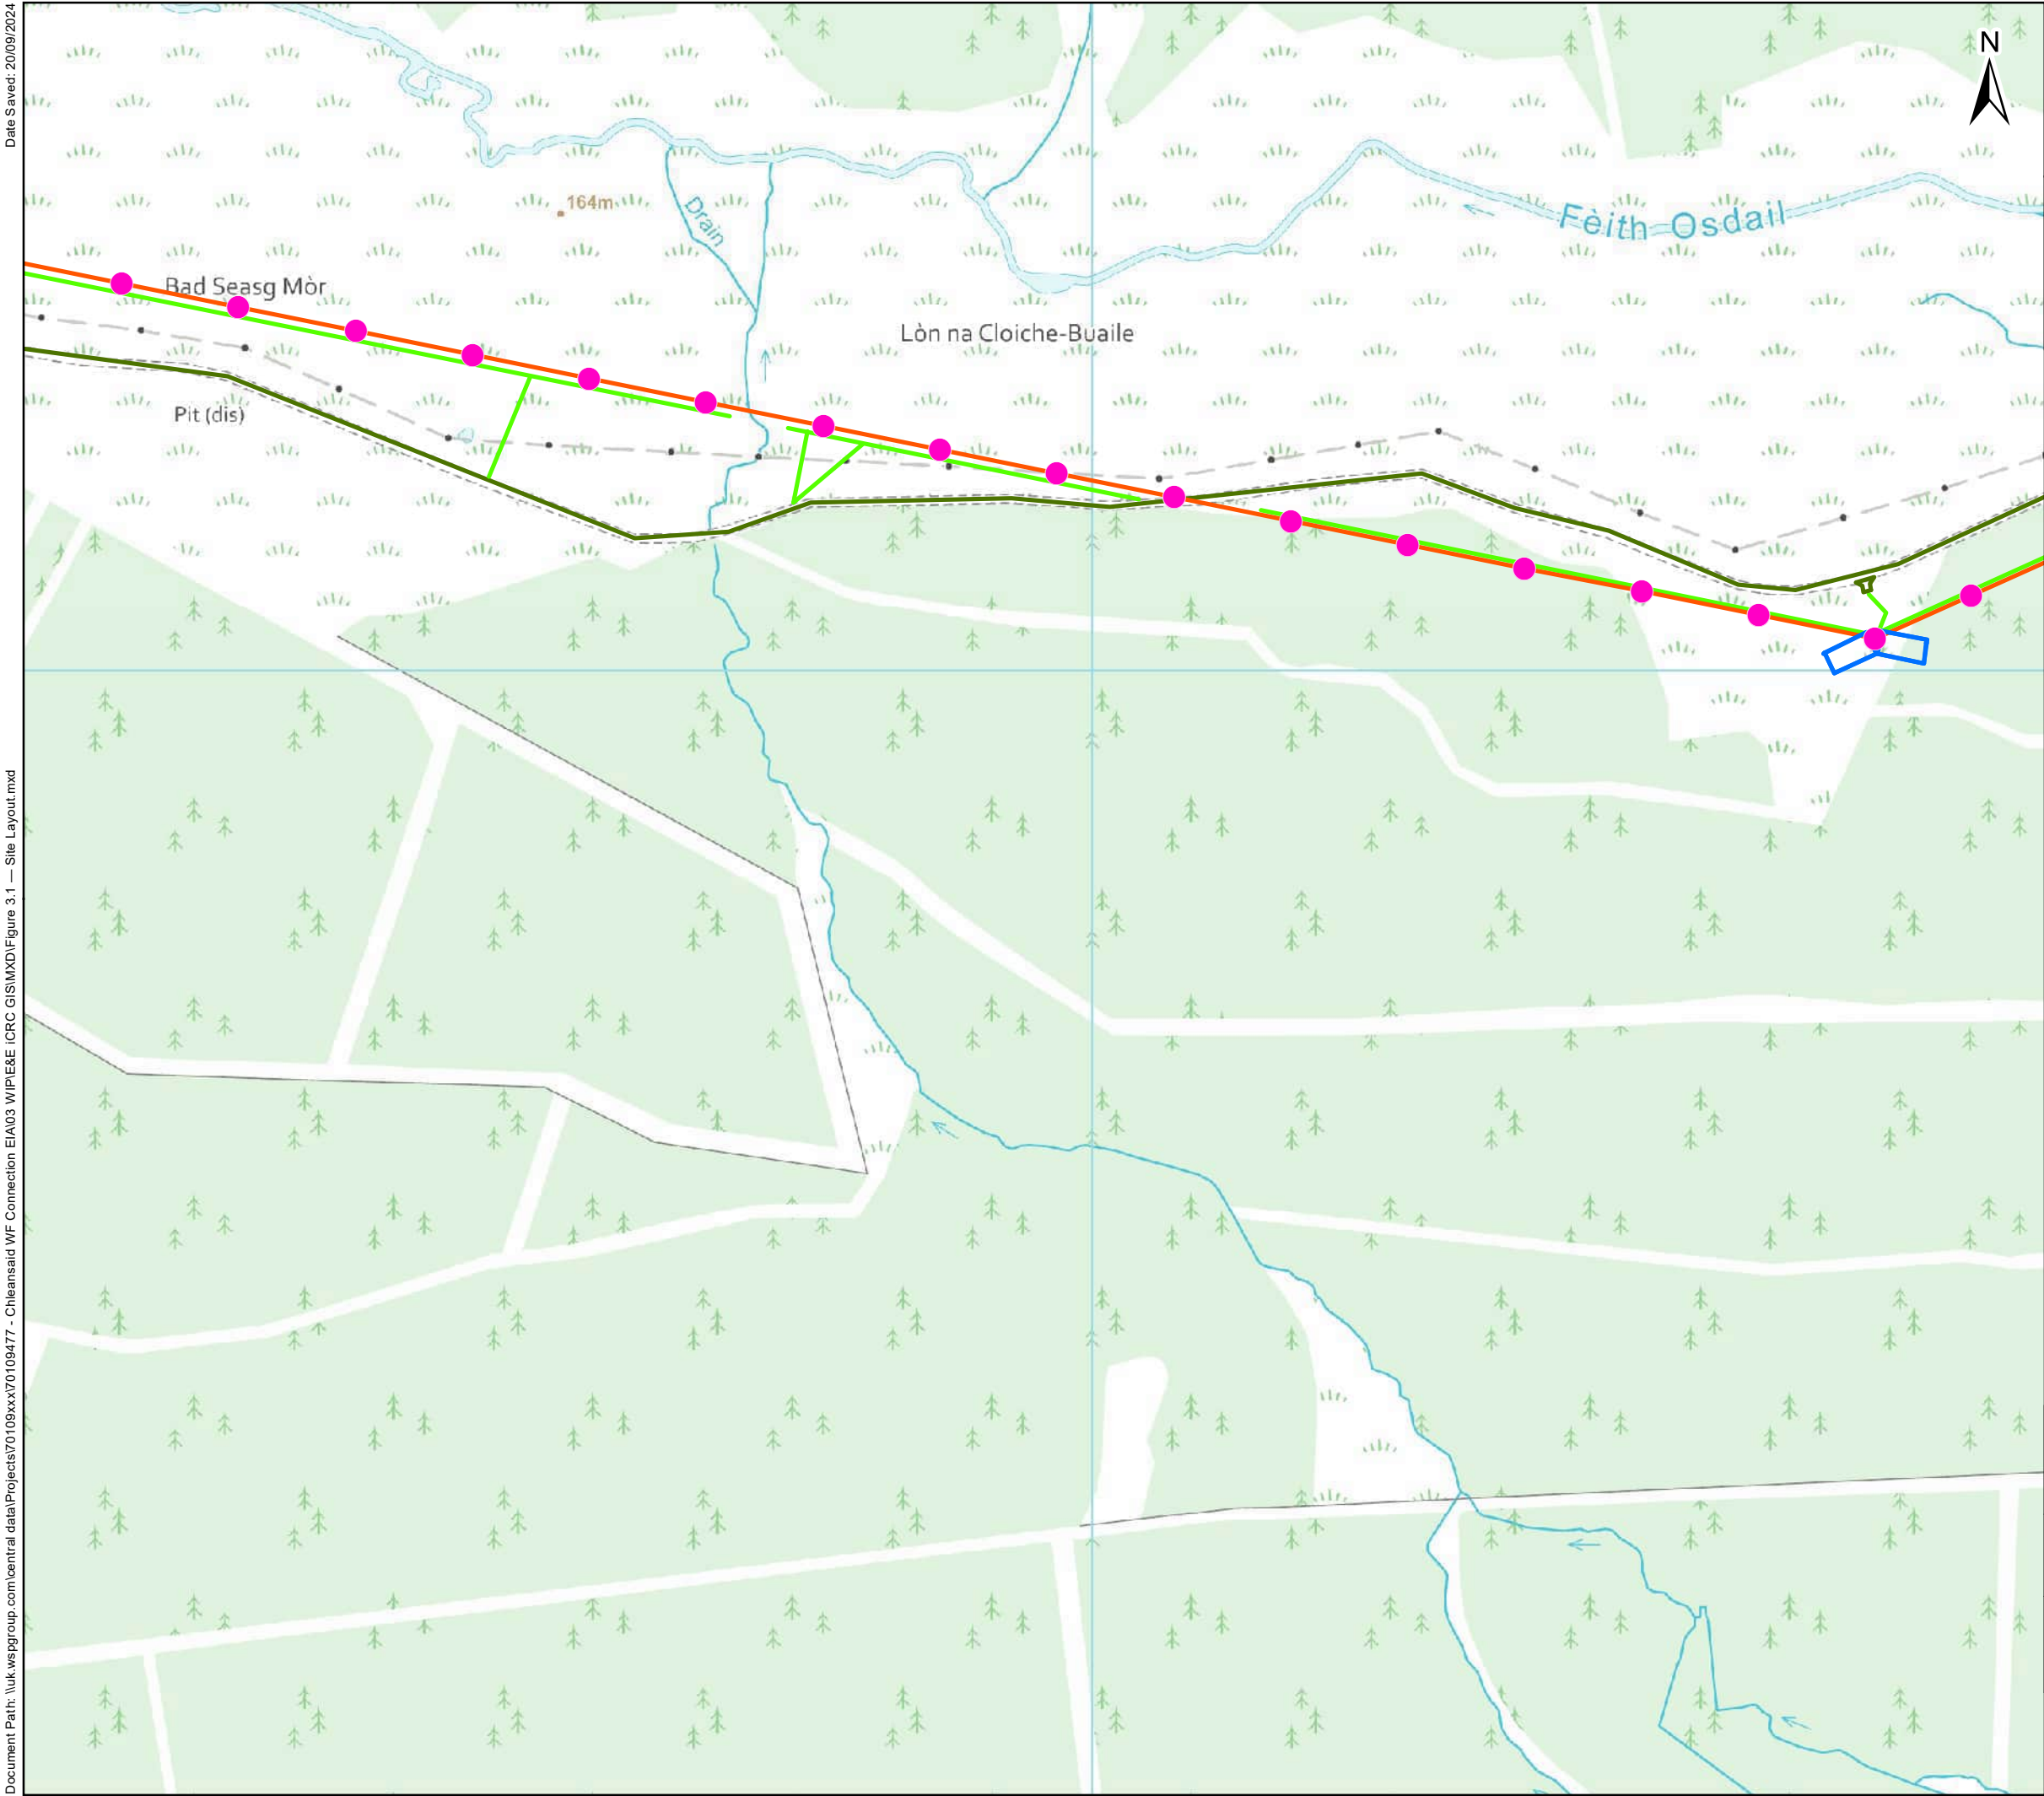


- Legend**
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Pulling Position



Client:					
Project:	Cleansaid Wind Farm 132 kV OHL Connection				
Title:	Figure 3.1 Proposed Development Layout Plan				
Page 3 of 8					
Date:	20/09/2024	Scale:	4,800 @ A3		
Drawn:	PB	Checked:	CE	Approved:	MR
Drawing Number: CWFC-WSP-DA-GIS-118					



Date Saved: 20/09/2024
Document Path: \\uk.wspgroup.com\\central data\\Projects\\70109xxx\\70109477 - Cleansaid WF Connection EIA\\03 WPIE&E (CRC GISMXD)\\Figure 3.1 - Site Layout.mxd

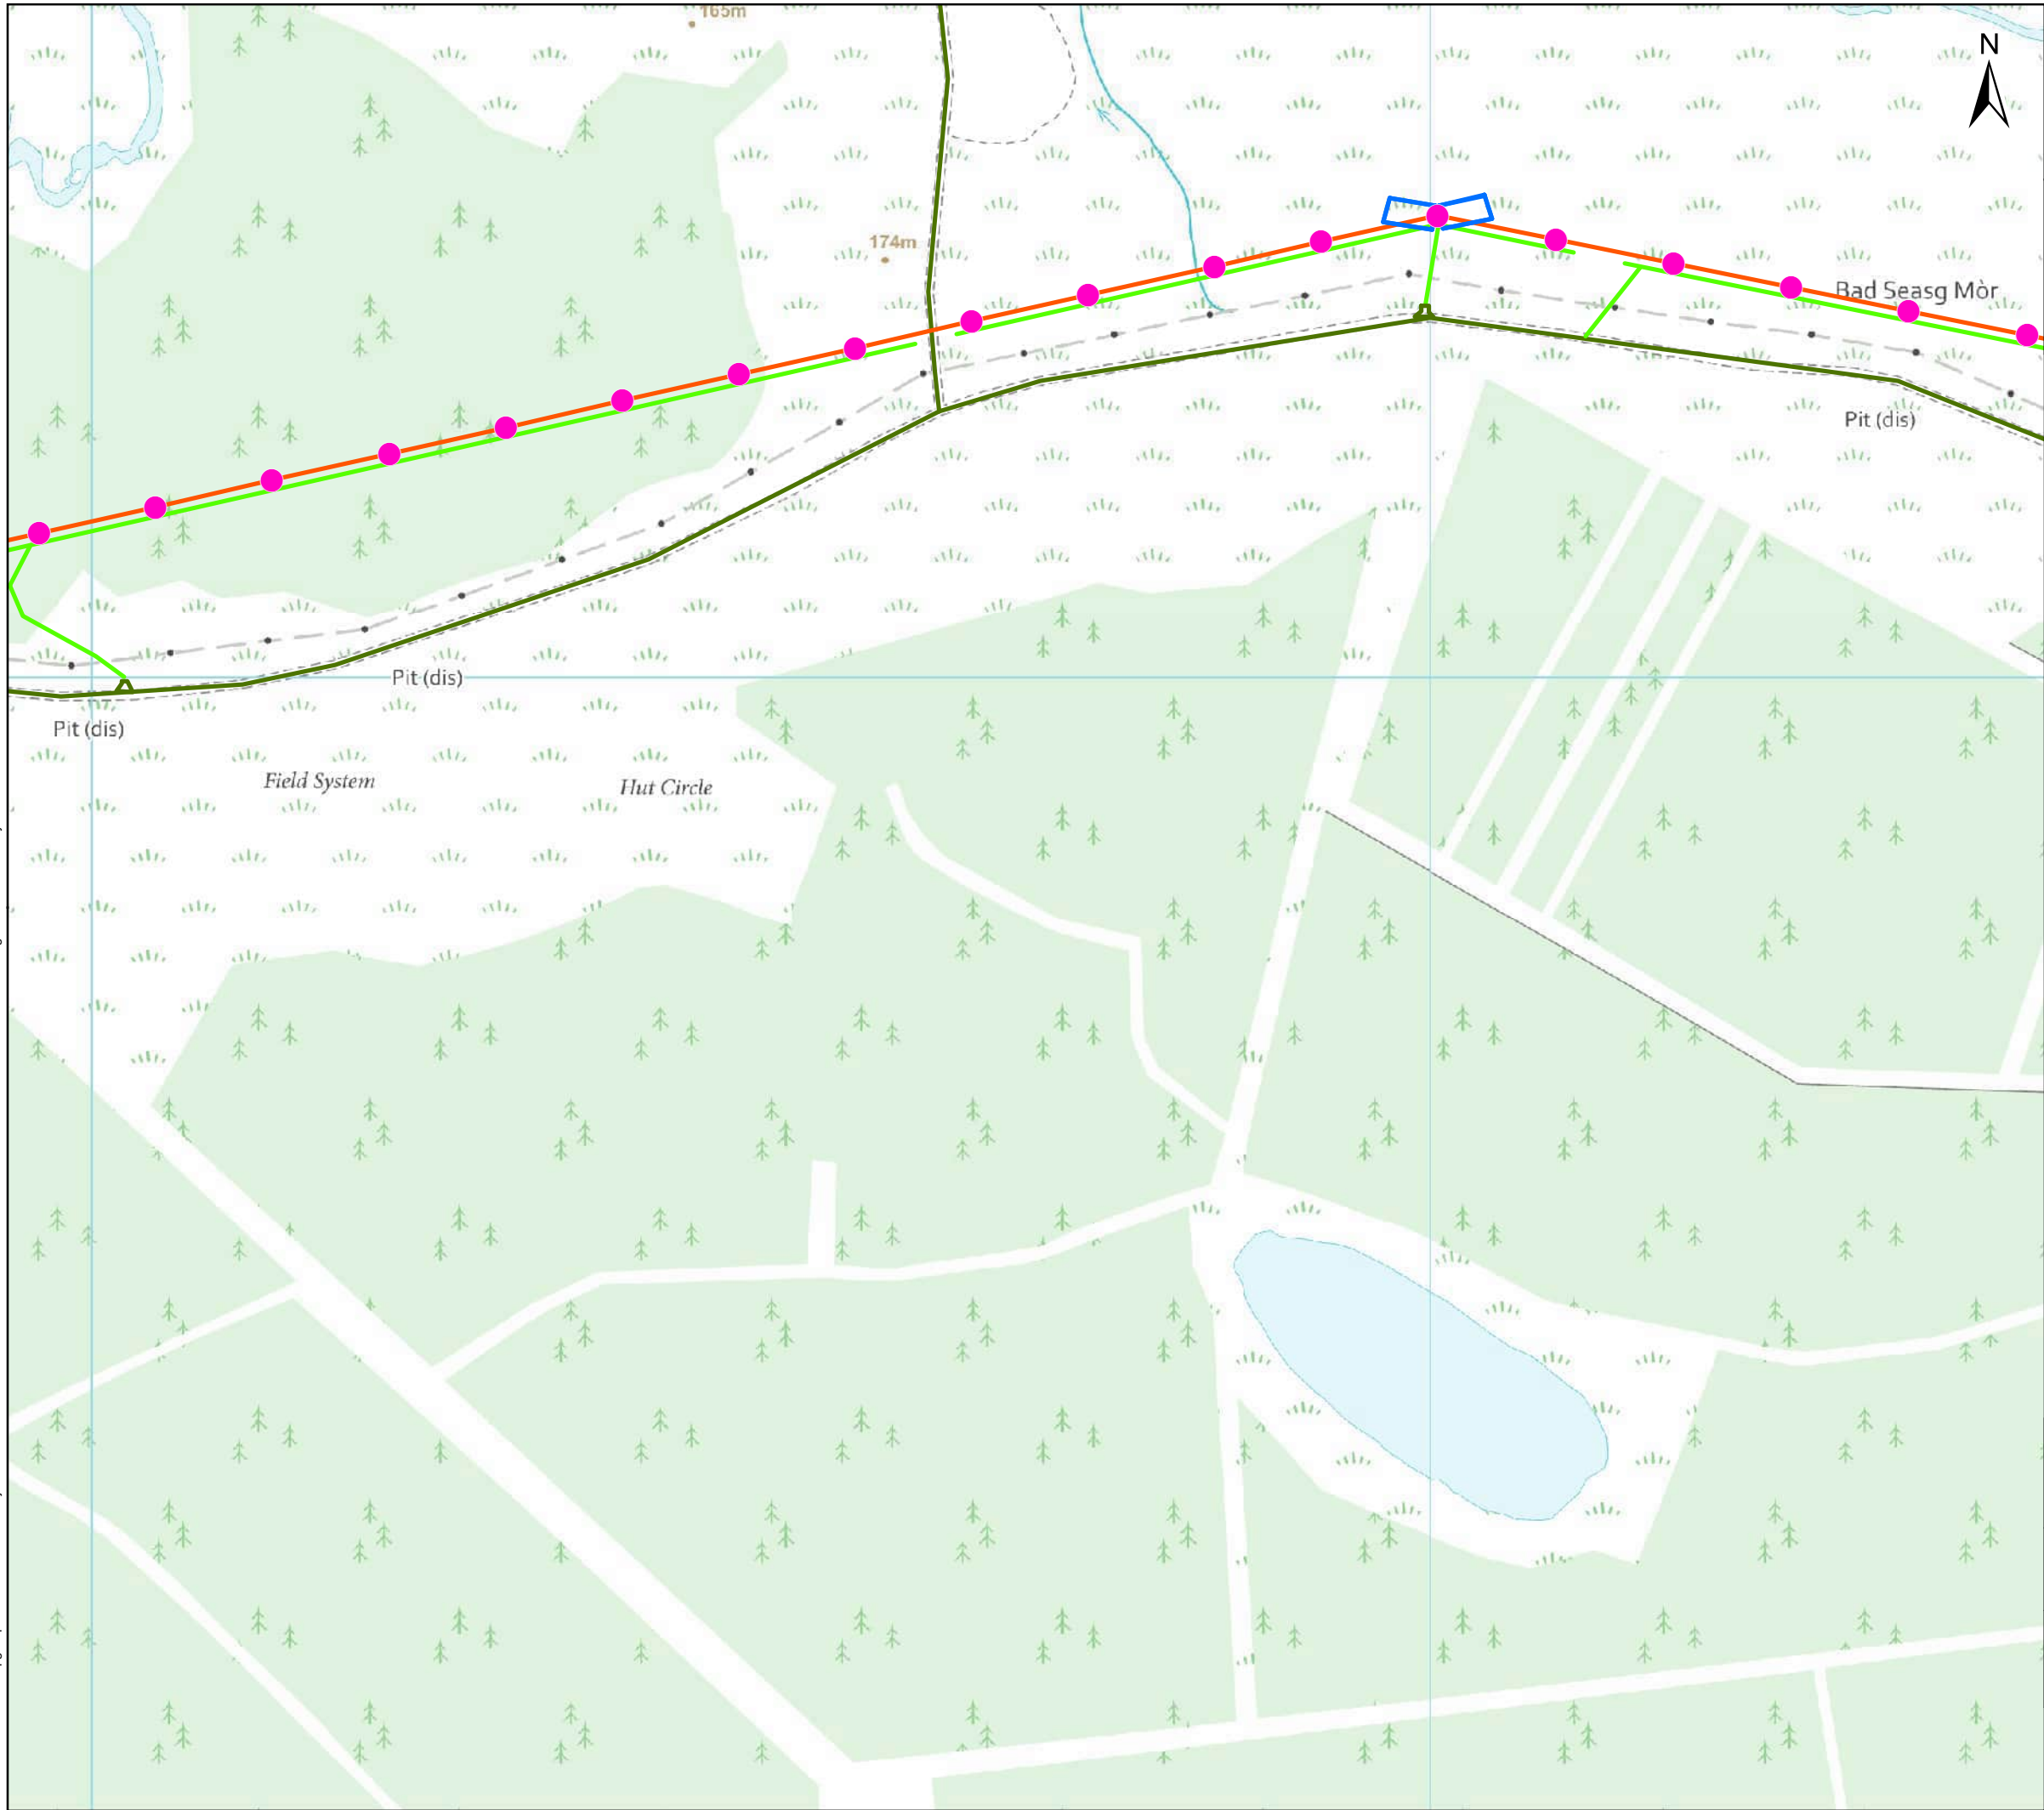

- Legend**
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Pulling Position



Client:			
Project:	Chleansaid Wind Farm 132 kV OHL Connection		
Title	Figure 3.1 Proposed Development Layout Plan		Page 4 of 8
Date:	20/09/2024	Scale:	4,800 @ A3
Drawn:	PB	Checked:	CE
		Approved:	MR
Drawing Number: CWFC-WSP-DA-GIS-118			

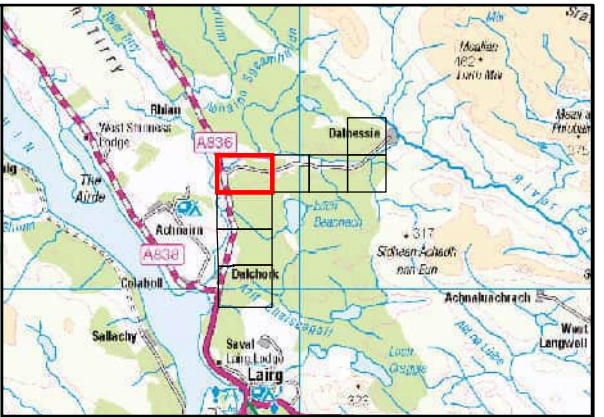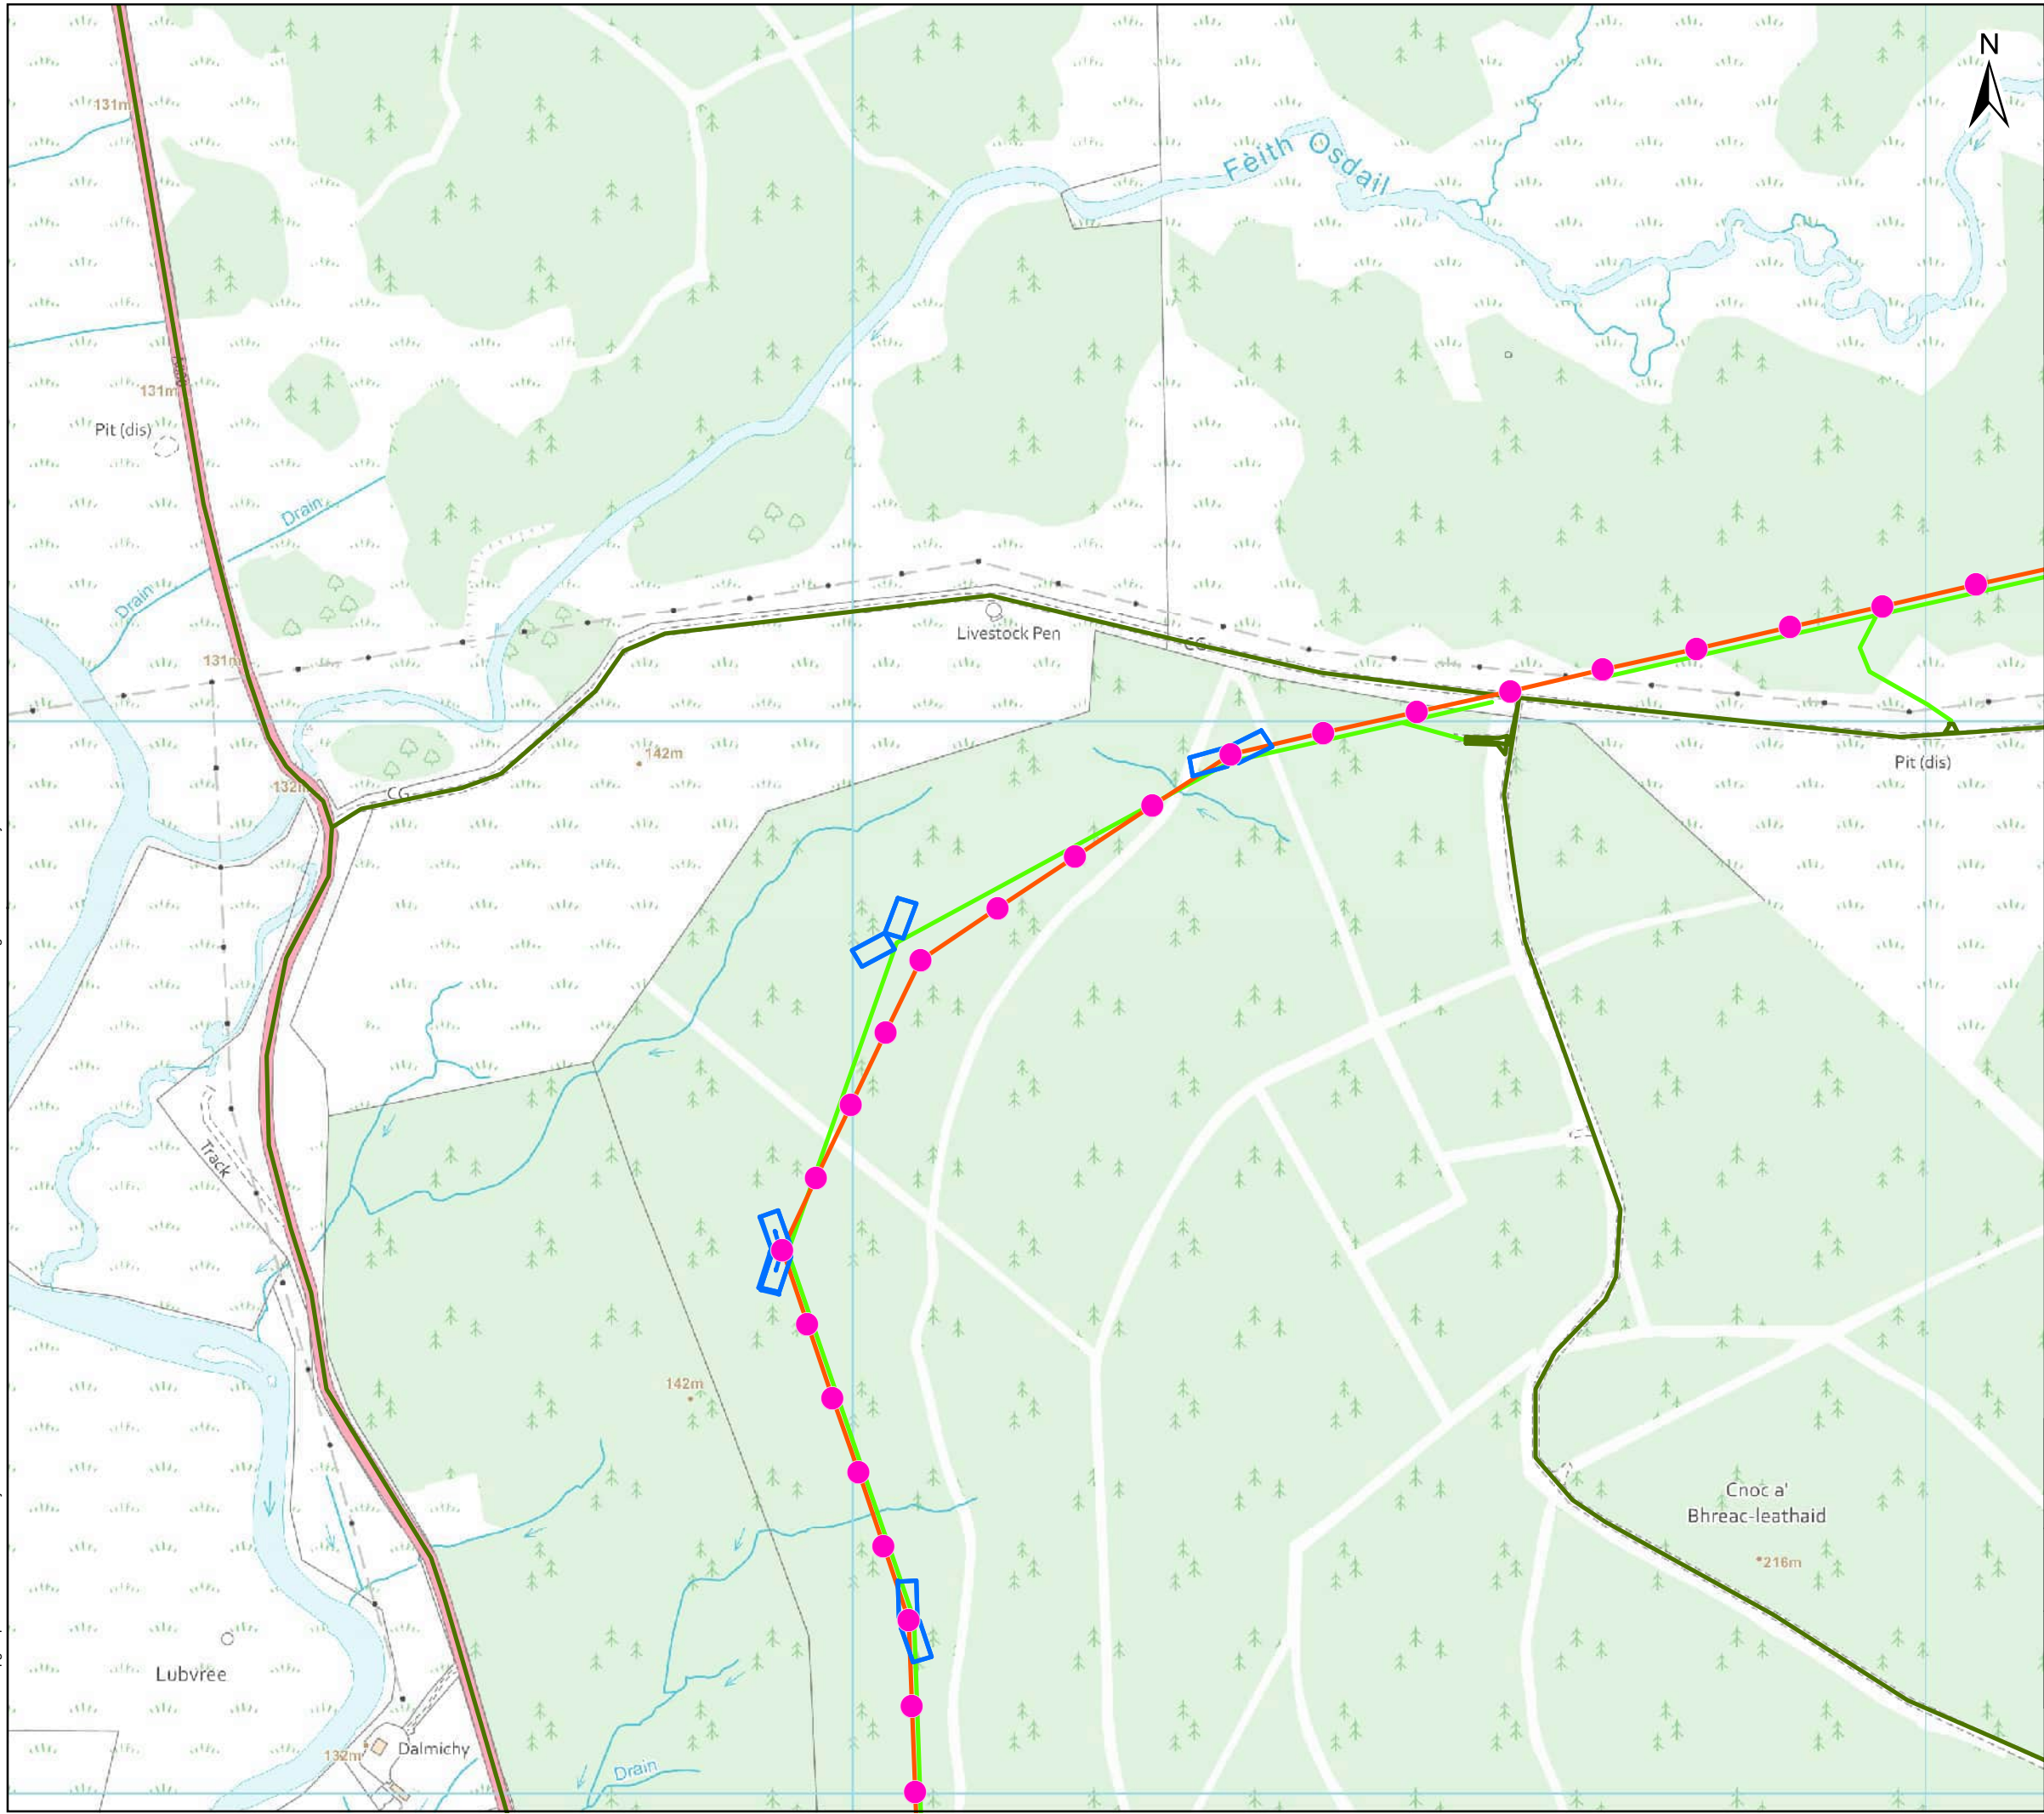

- Legend**
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Pulling Position





Client:  Scottish & Southern Electricity Networks
TRANSMISSION

Project: **Cleansaid Wind Farm 132 kV OHL Connection**

Title: **Figure 3.1 Proposed Development Layout Plan**

Date: 20/09/2024 Scale: 6,000 @ A3
Drawn: PB Checked: CE Approved: MR
Drawing Number: CWFC-WSP-DA-GIS-118

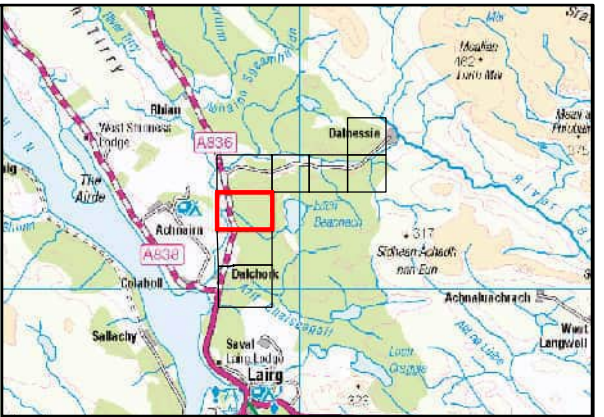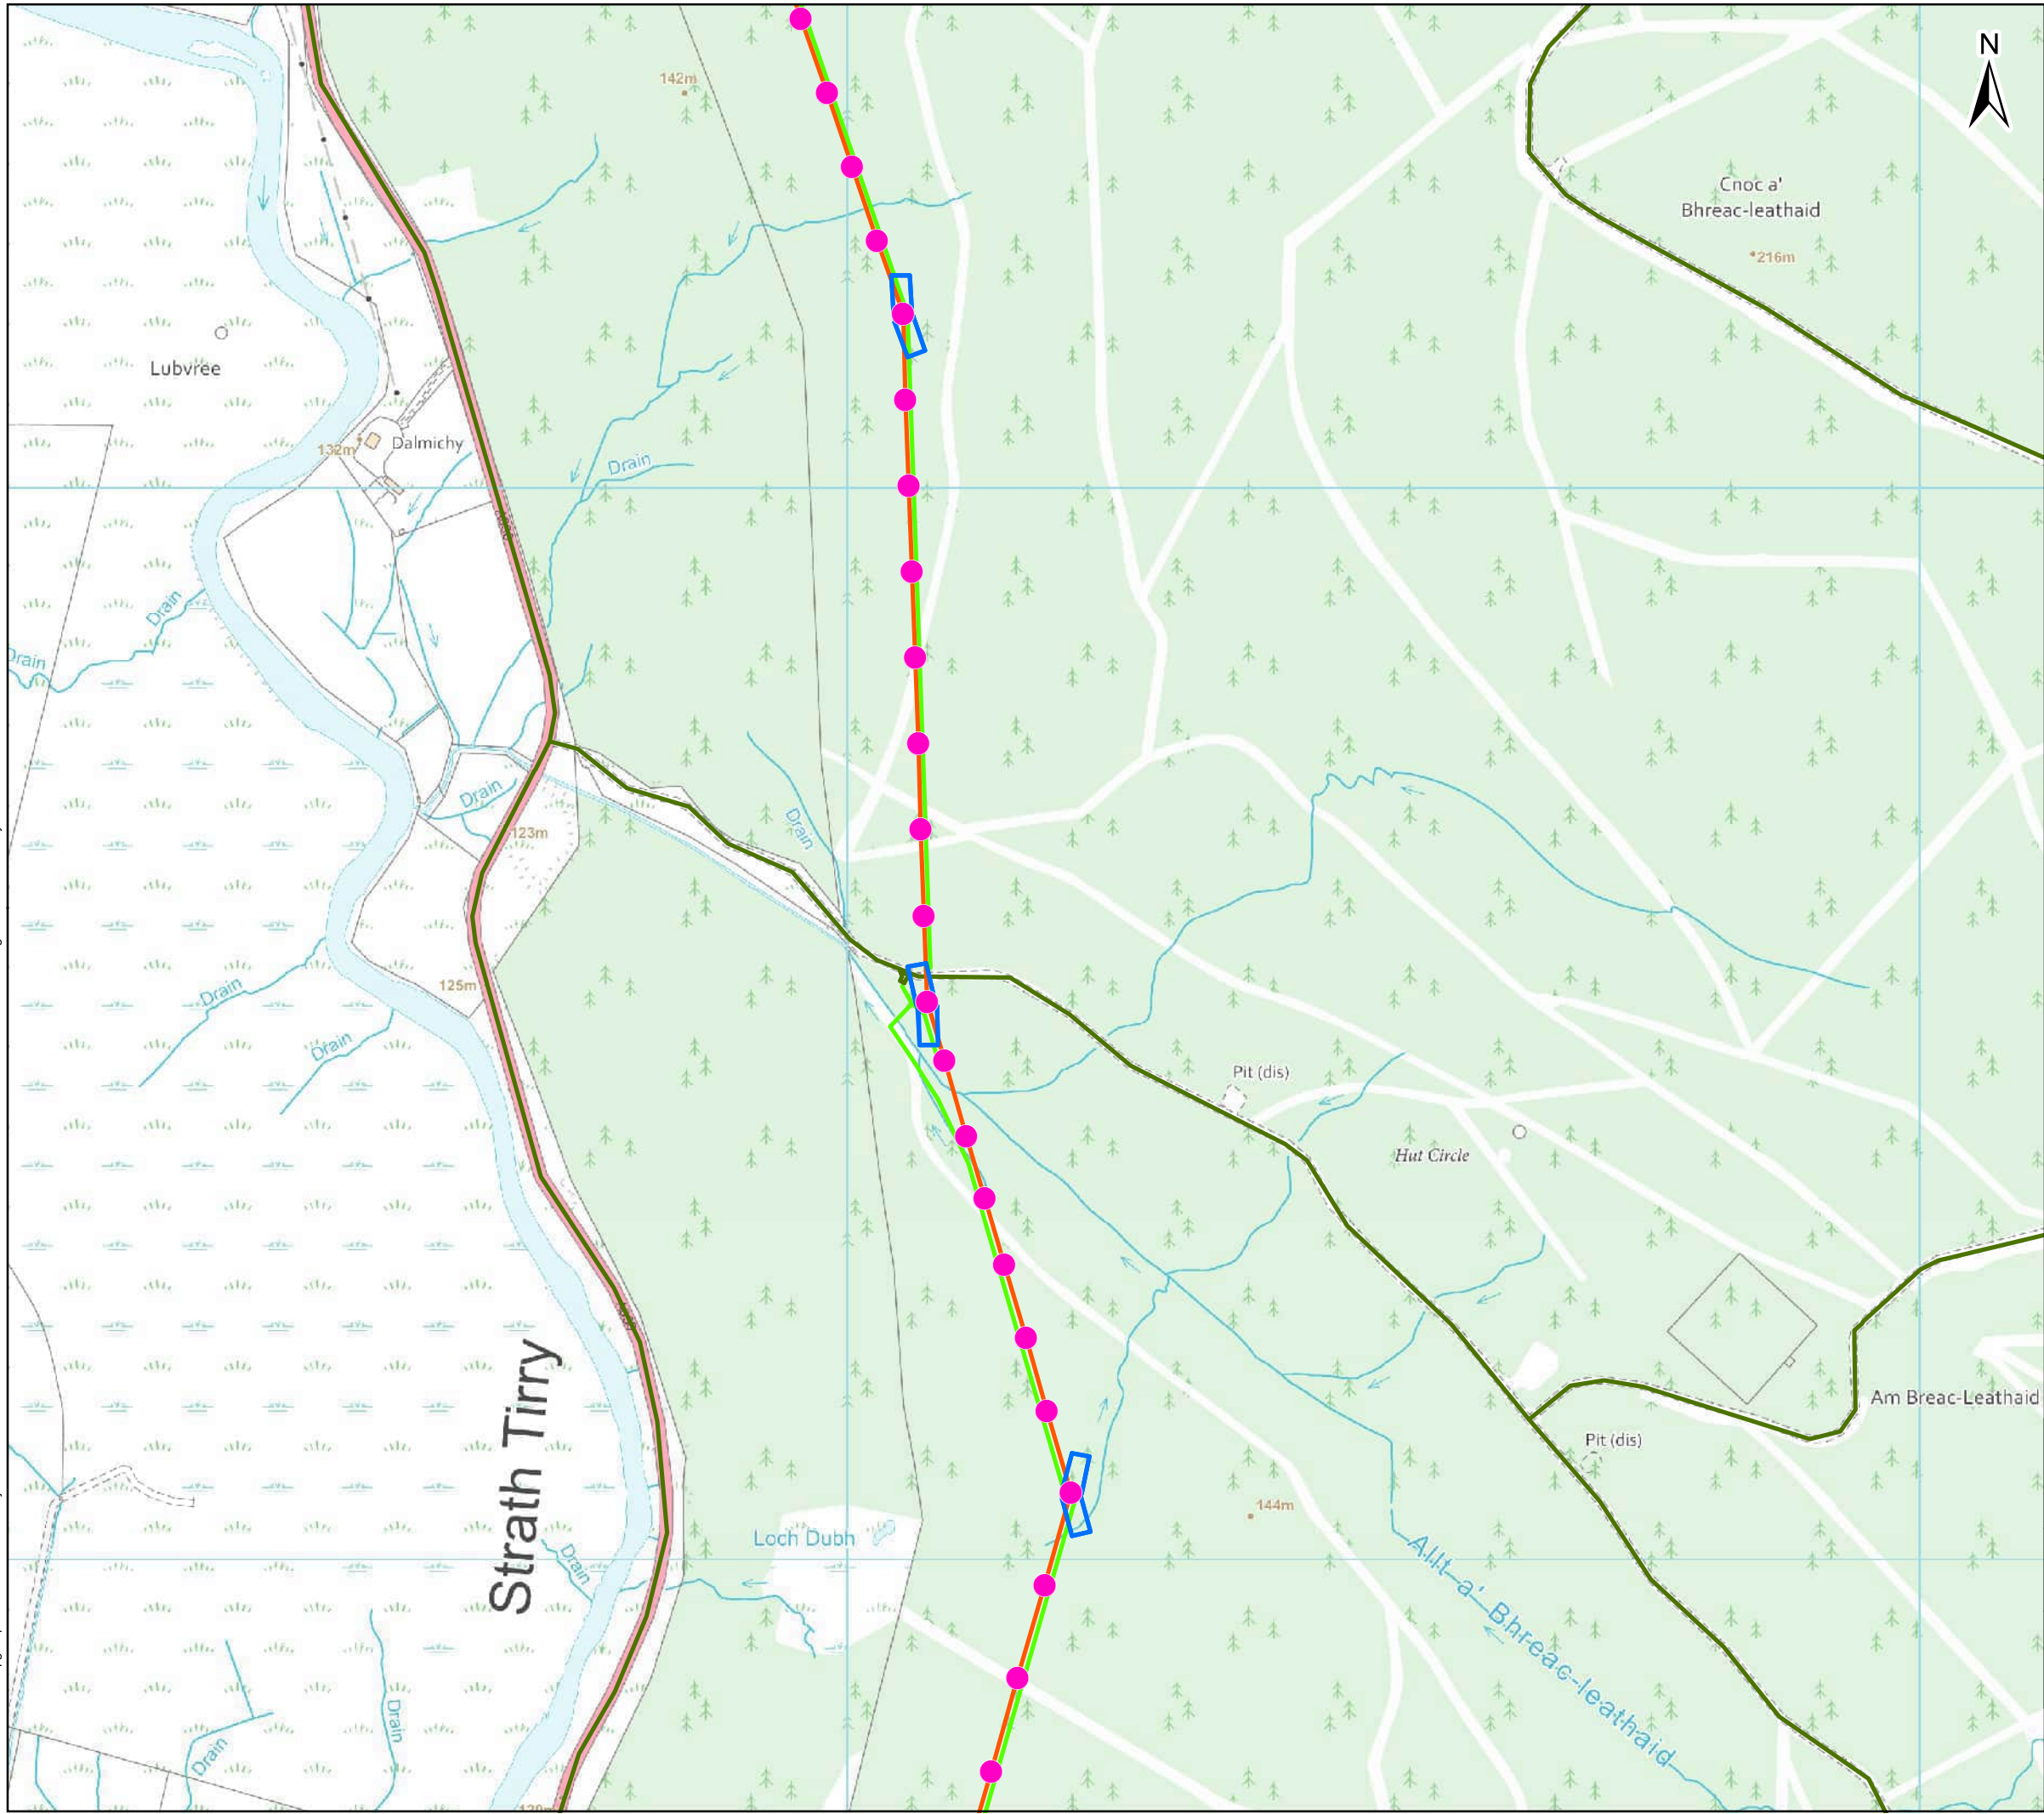

Legend

- Proposed Pole Position
- Proposed OHL Alignment
- Temporary Access (proposed open ground/temporary trakway system)
- Existing Access
- Proposed Pulling Position

0 150 300 Metres



Client: 

Project: Cleansaid Wind Farm 132 kV OHL Connection

Title: Figure 3.1 Proposed Development Layout Plan

Date: 20/09/2024 Scale: 6,000 @ A3
Drawn: PB Checked: CE Approved: MR
Drawing Number: CWFC-WSP-DA-GIS-118

Page 6 of 8

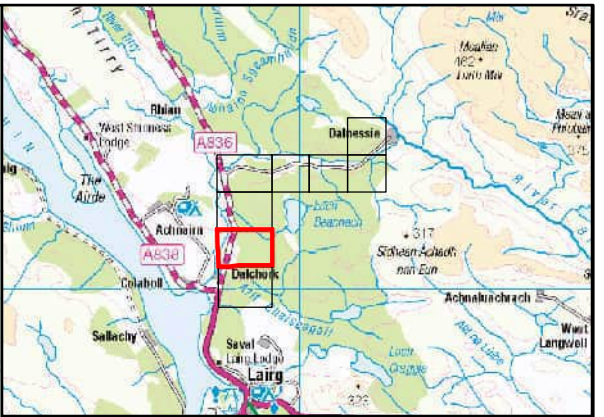
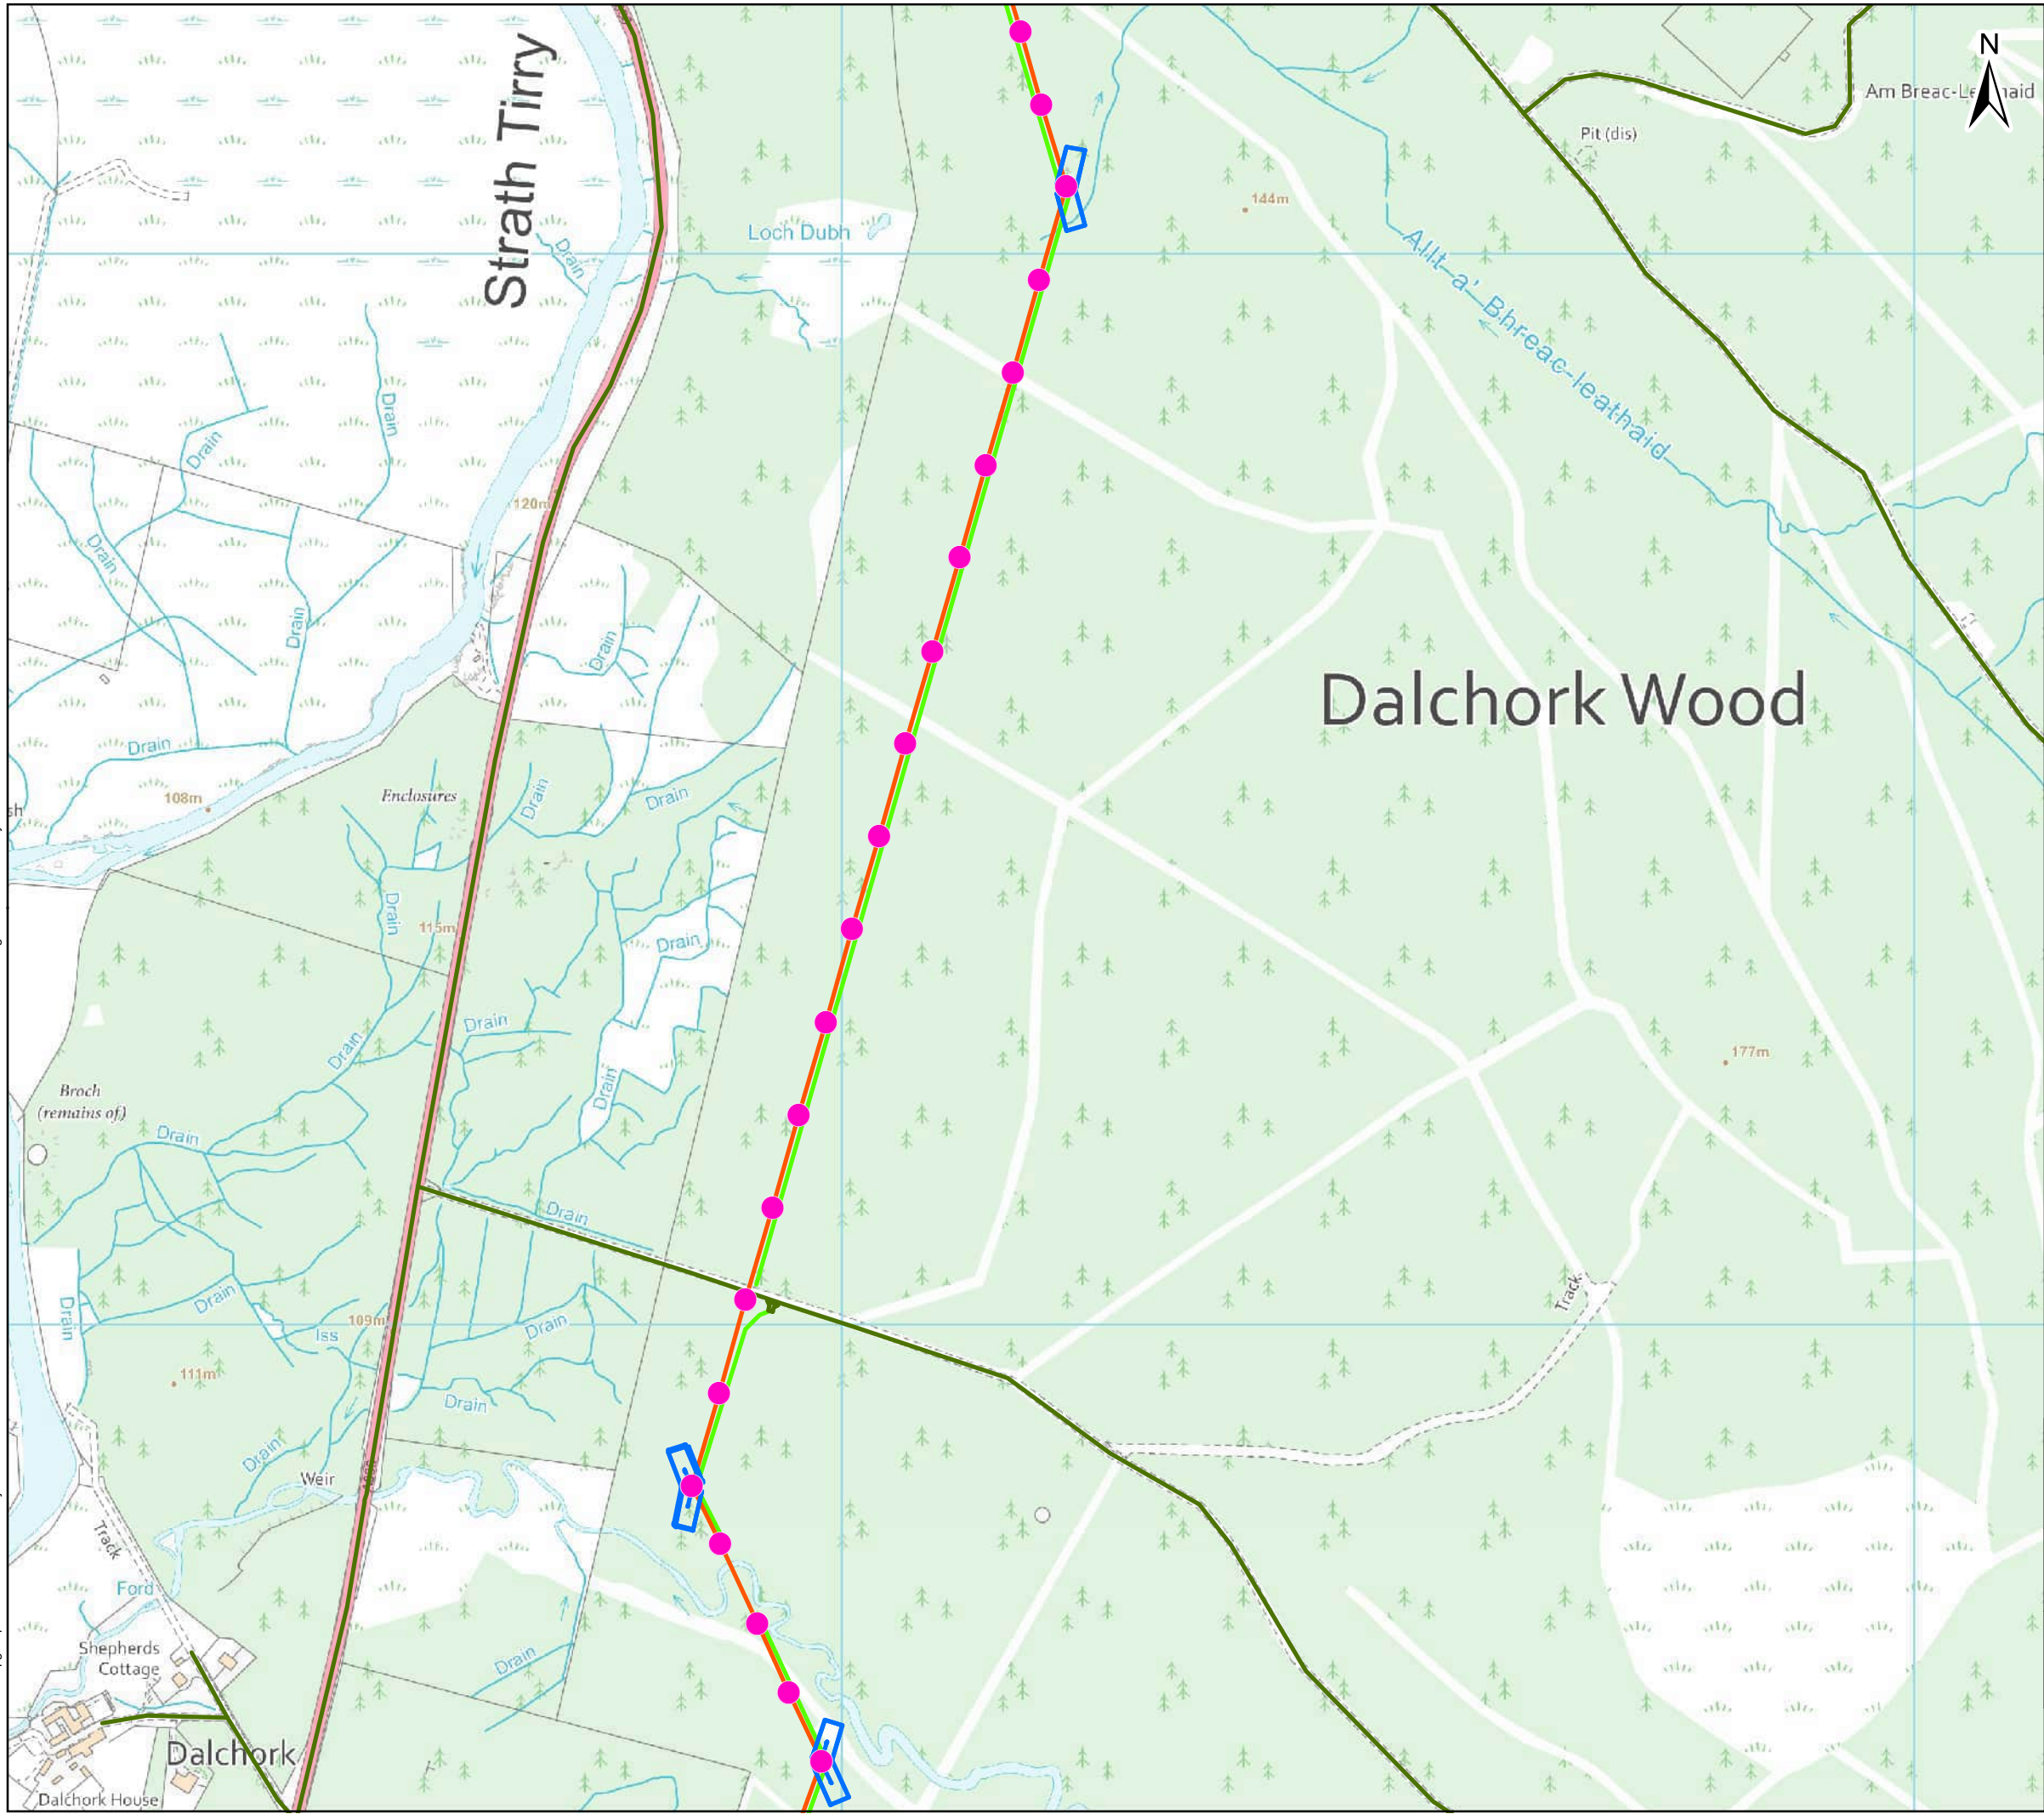


- Legend**
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Pulling Position




Client:			
Project:	Chleansaid Wind Farm 132 kV OHL Connection		
Title	Figure 3.1 Proposed Development Layout Plan		Page 7 of 8
Date:	20/09/2024	Scale:	6,000 @ A3
Drawn:	PB	Checked:	CE
		Approved:	MR
Drawing Number:	CWFC-WSP-DA-GIS-118		


Date Saved: 20/09/2024
Document Path: \\uk.wspgroup.com\central data\Projects\70109xxx\70109477 - Cleansaid WF Connection EIA\03 WPIE&E (CRC GISMXD)\Figure 3.1 - Site Layout.mxd

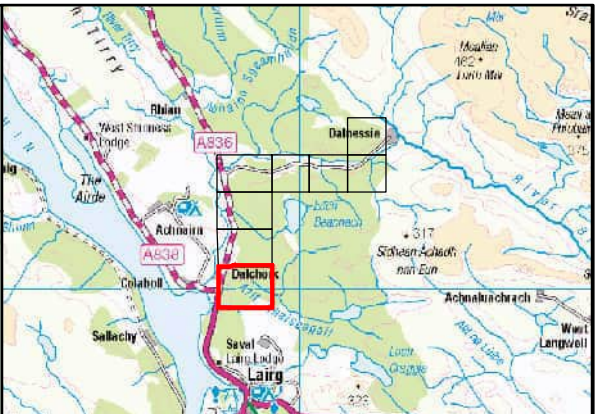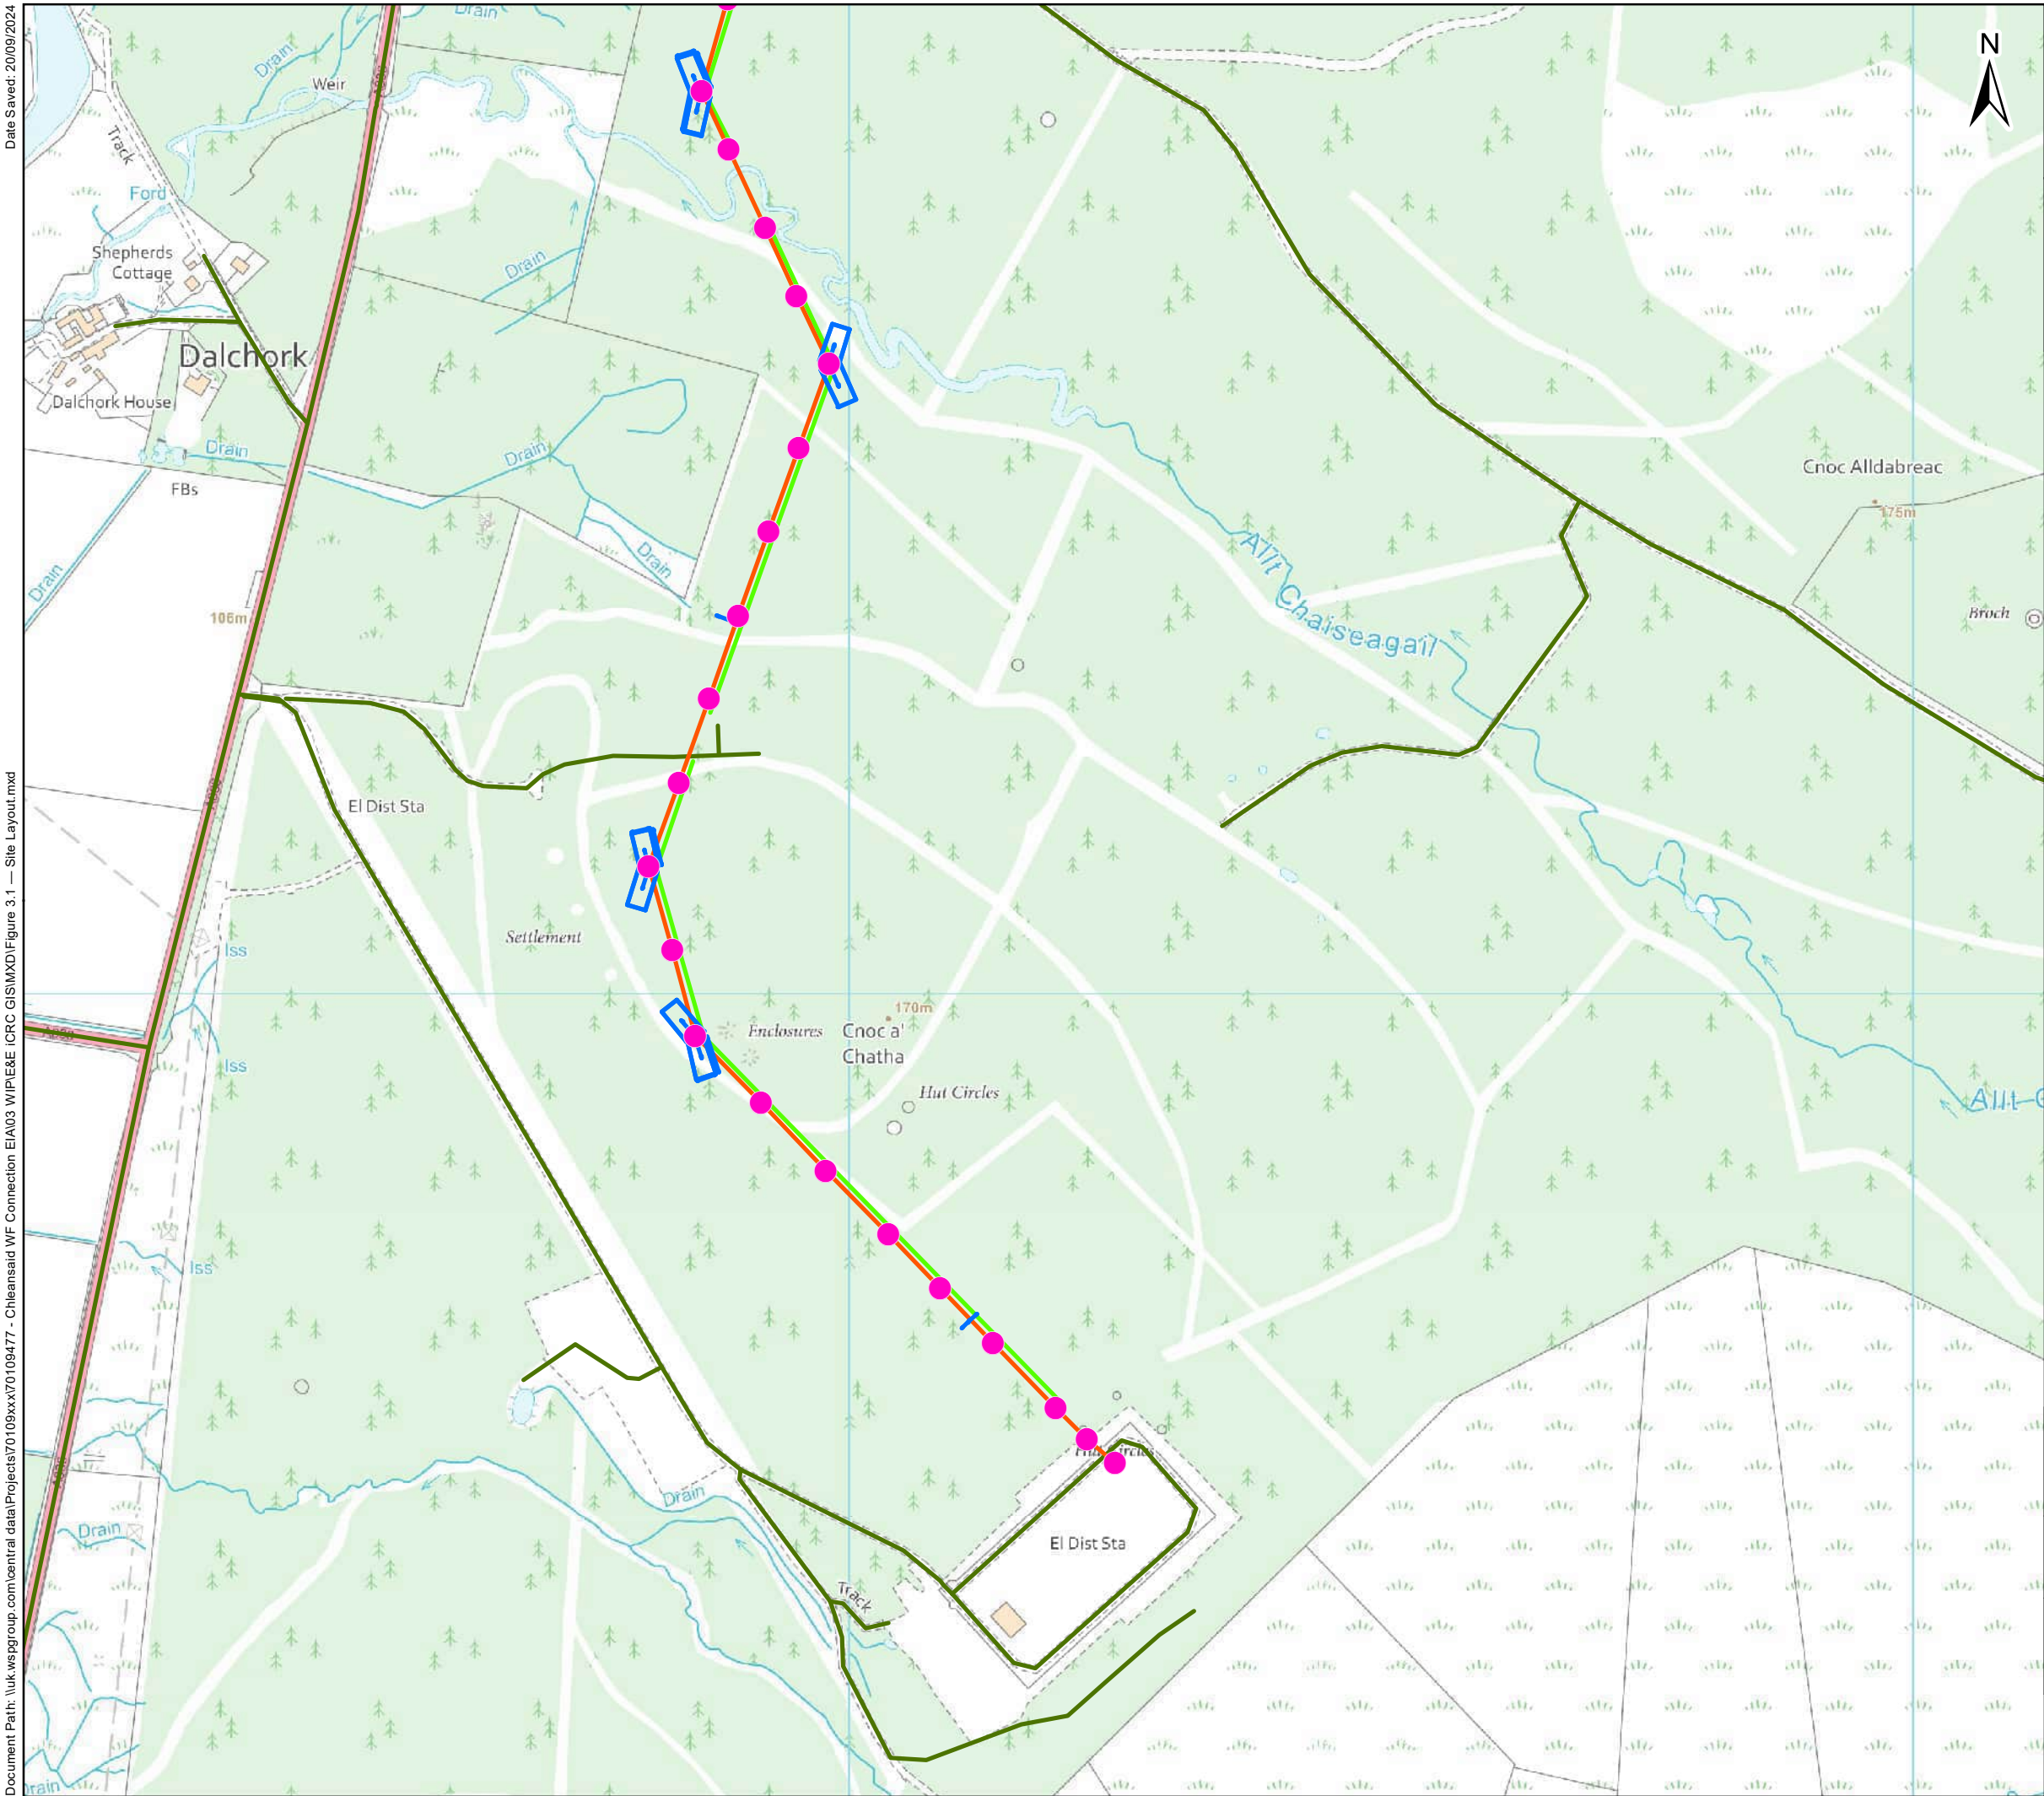



- Legend**
- Proposed Pole Position
 - Proposed OHL Alignment
 - Temporary Access (proposed open ground/temporary trakway system)
 - Existing Access
 - Proposed Pulling Position



Client:			
Project:	Chleansaid Wind Farm 132 kV OHL Connection		
Title	Figure 3.1 Proposed Development Layout Plan		Page 8 of 8
Date:	20/09/2024	Scale:	6,000 @ A3
Drawn:	PB	Checked:	CE
		Approved:	MR
Drawing Number: CWFC-WSP-DA-GIS-118			

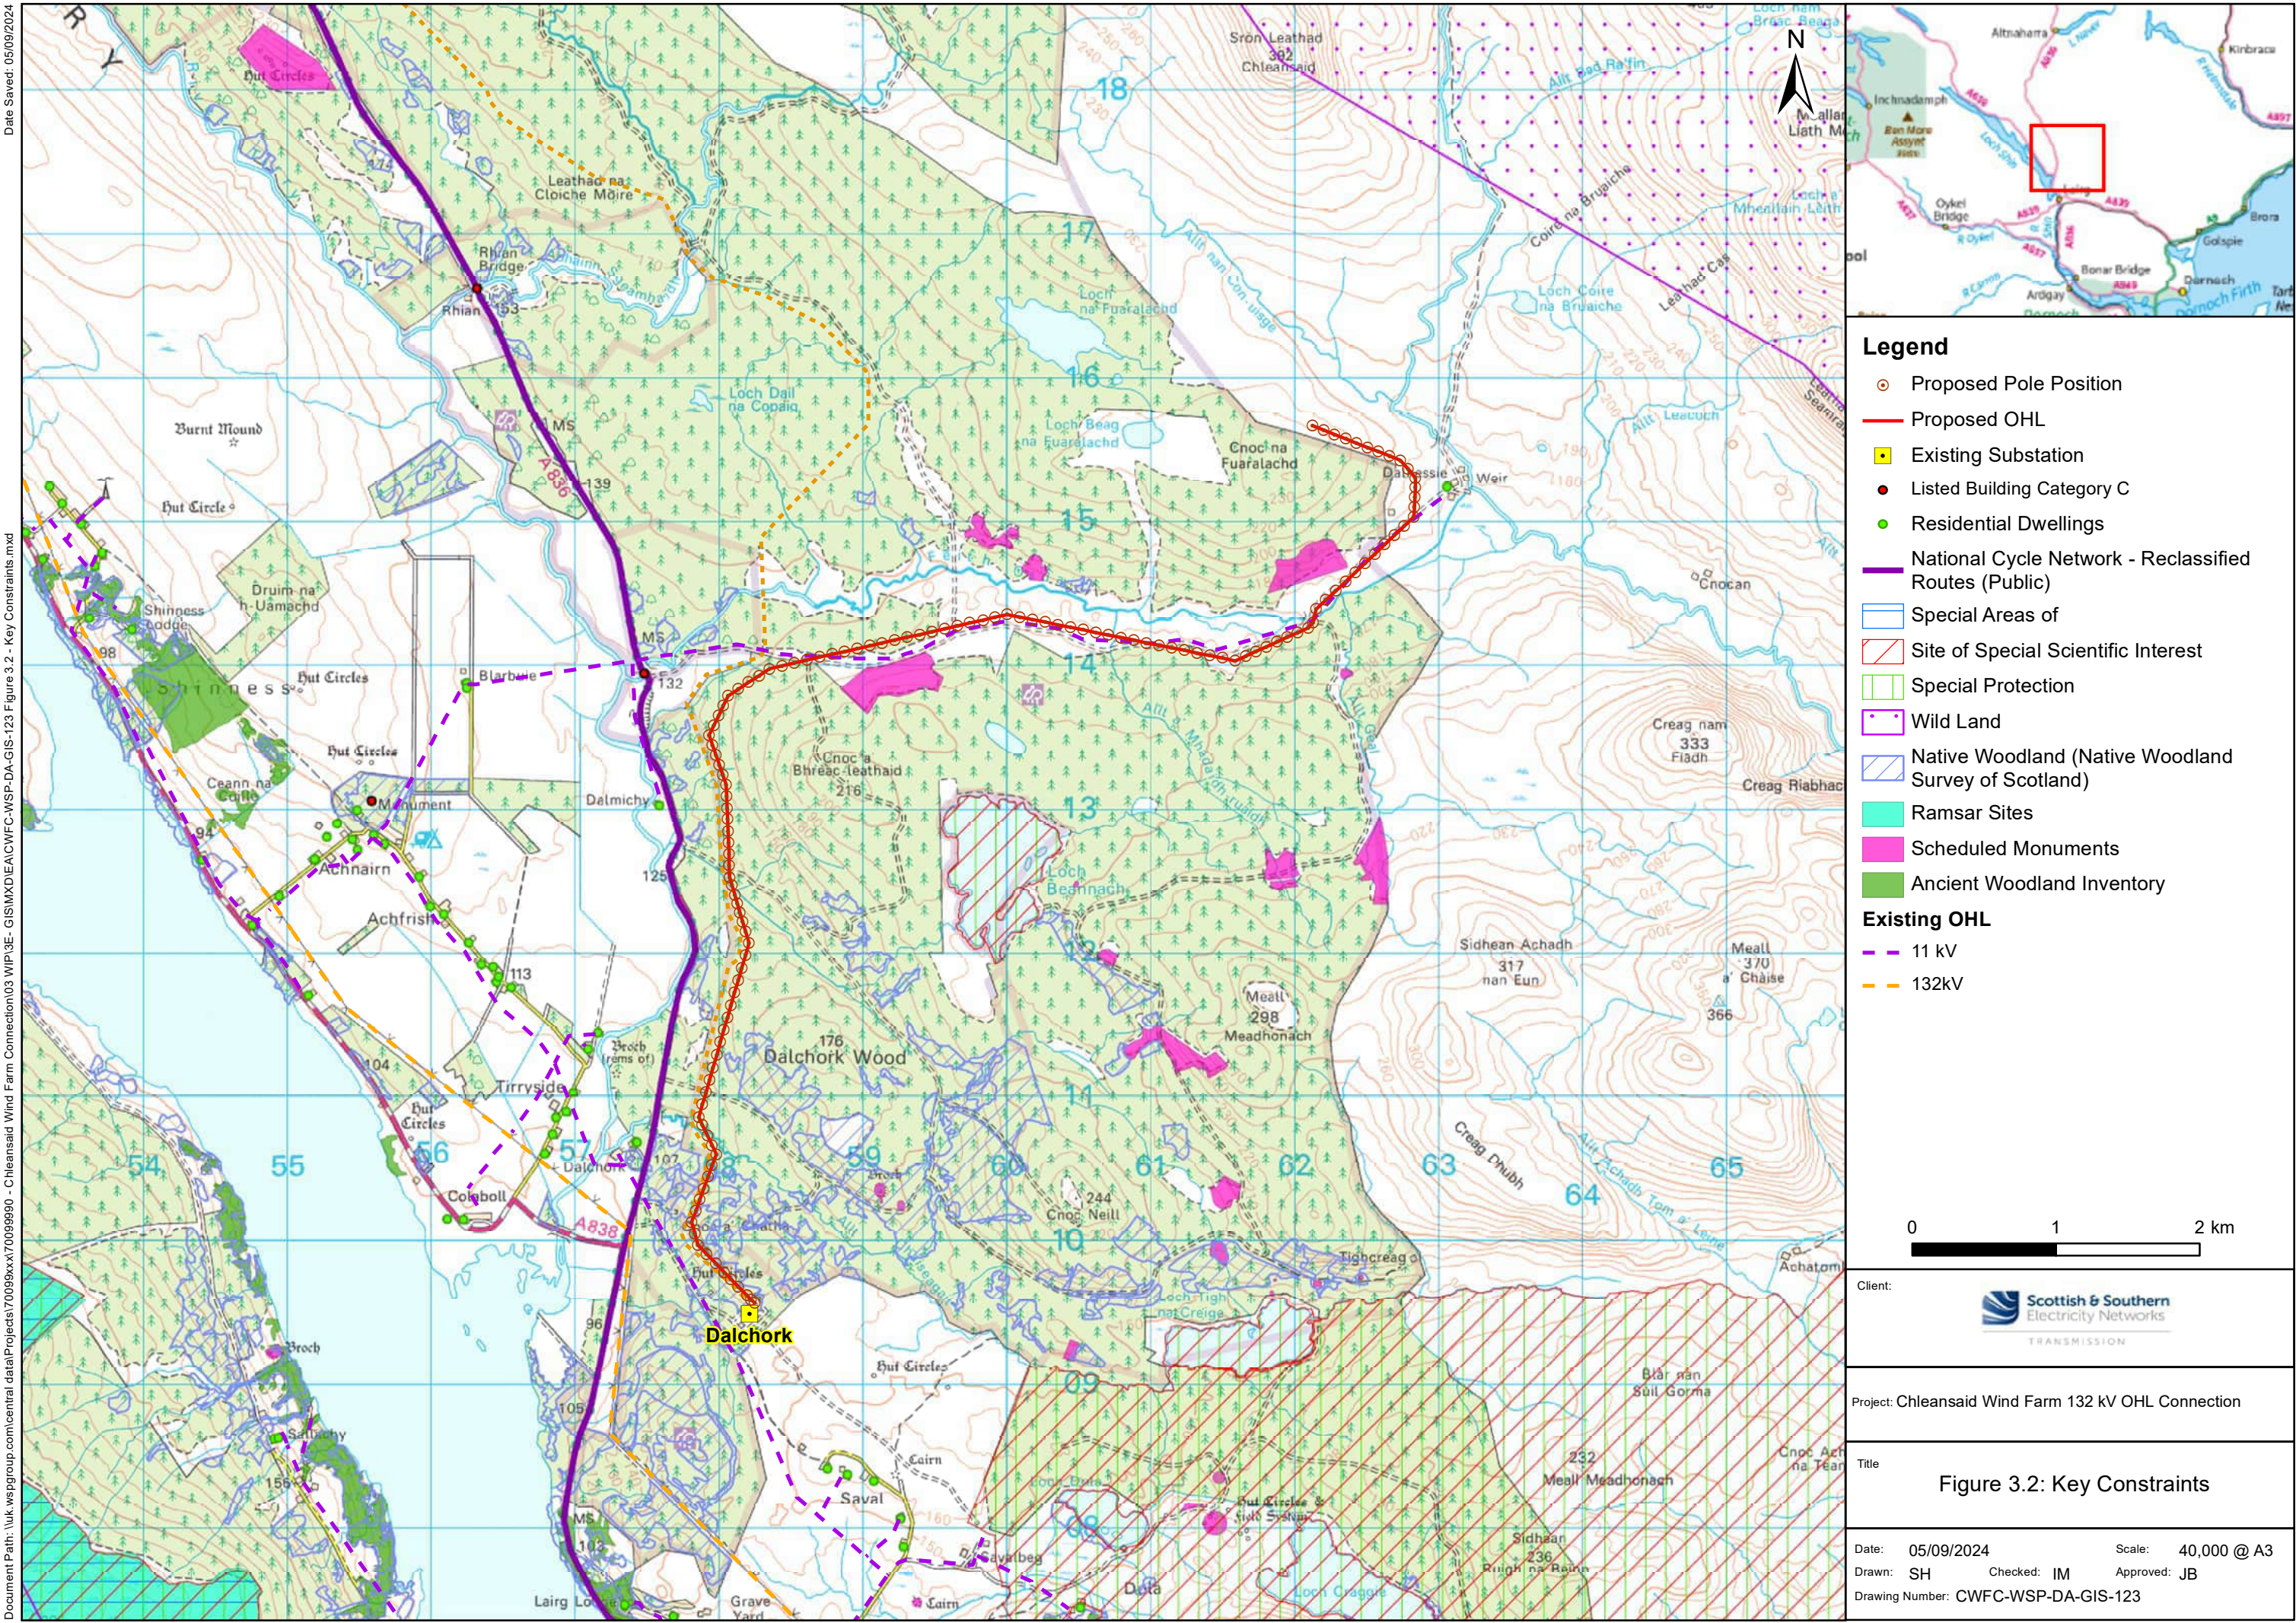

Date Saved: 08/11/2024
Document Path: \\uk.wspgroup.com\central\data\Projects\70109xxx\70109477 - Chleasaid WF Connection EIA\03 WPIE&E (CRC GISMXD)\Figure 5.1 - Cumulative Developments.mxd

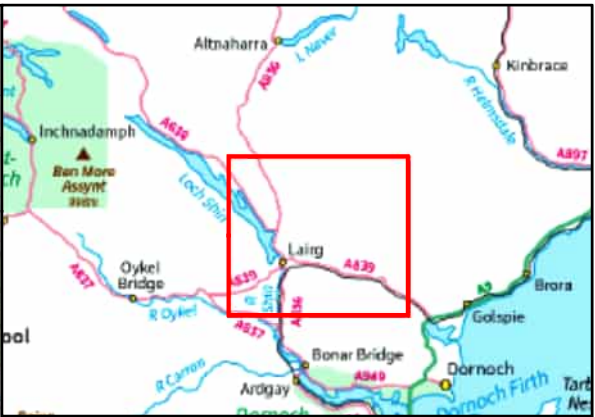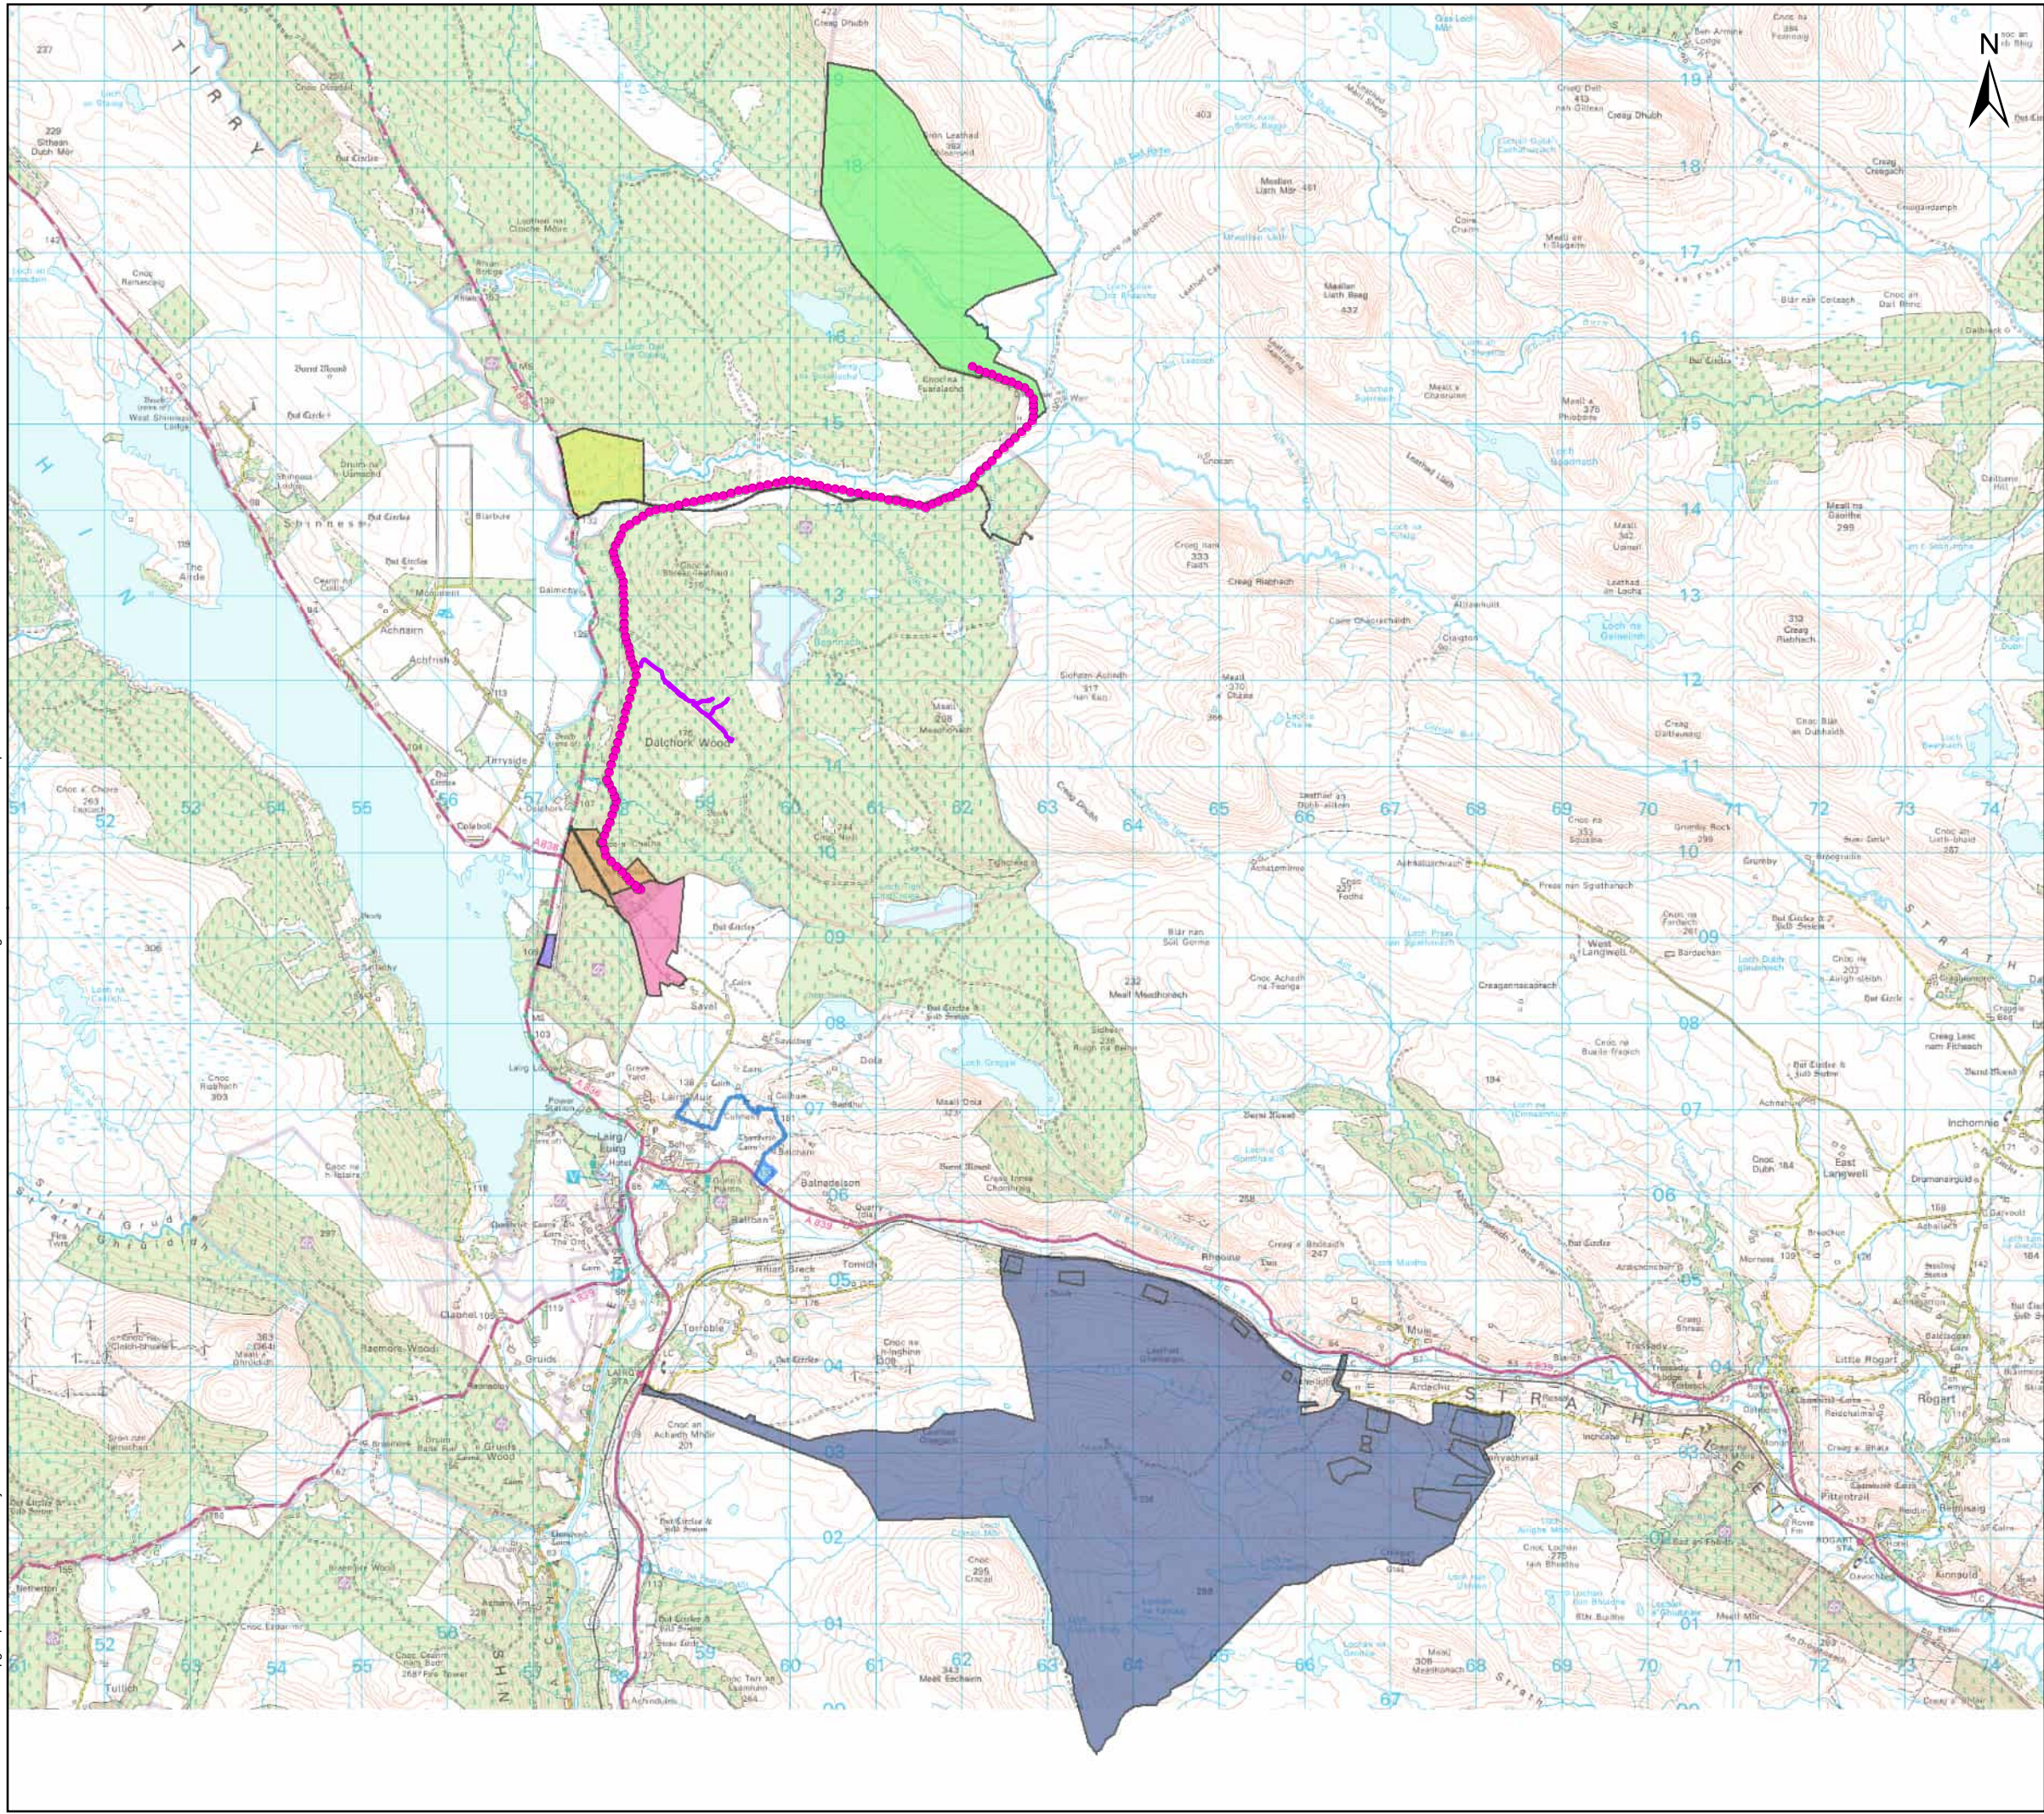

Legend

- Proposed OHL Alignment
- Proposed Pole Position

Cumulative Developments

- 19/05557/RCC
- 20/05067/FUL
- 22/00844/FUL
- 22/01635/S36
- 23/05390/SCRE
- 24/02016/SCRE
- 24/02094/S36
- 24/03540/SCRE
- 24/01682/PNO

0 1.5 3 km

Client: 

Project: Chleasaid Wind Farm 132 kV OHL Connection

Title: Figure 5.1 - Cumulative Developments

Date: 08/11/2024 Scale: 75,000 @ A3
Drawn: PB Checked: CE Approved: MR
Drawing Number: CWFC-WSP-DA-GIS-118