

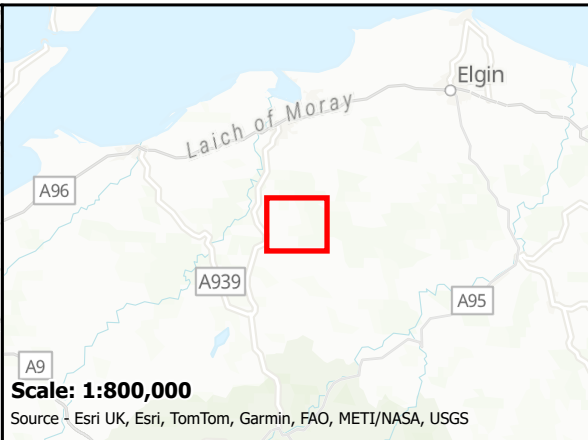


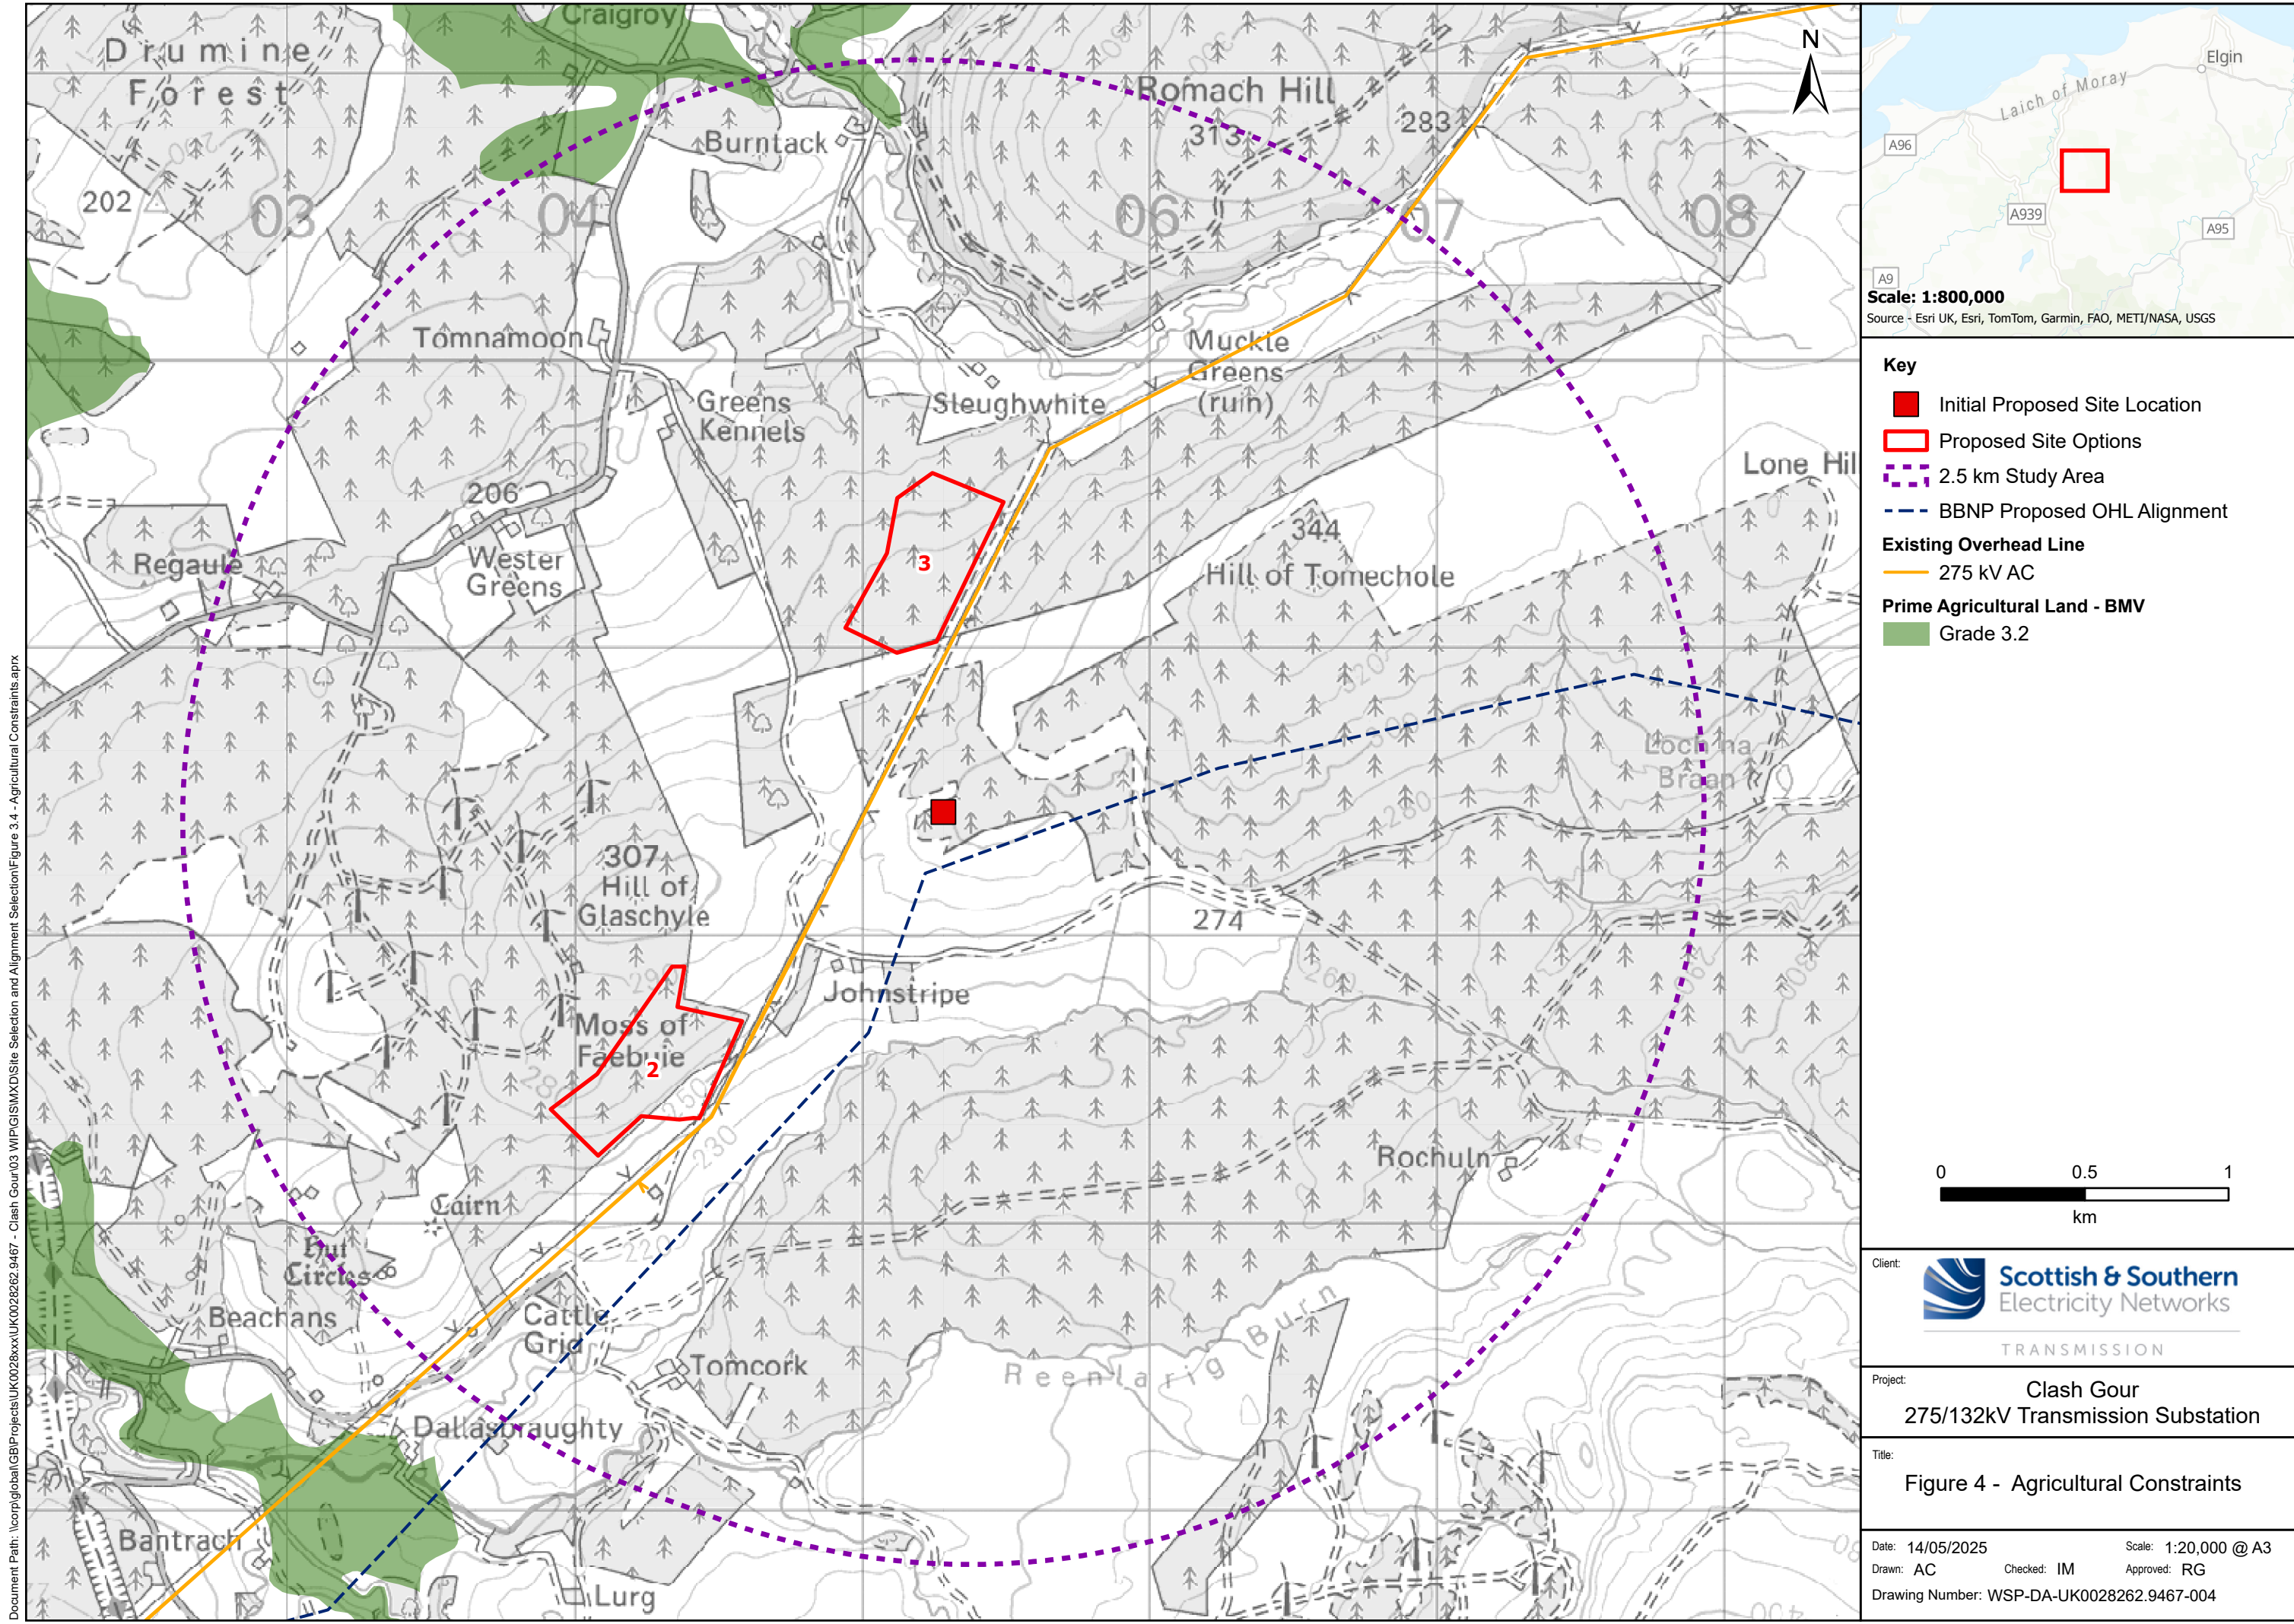

Scale: 1:800,000
Source - Esri UK, Esri, TomTom, Garmin, FAO, METI/NASA, USGS

Key

- Initial Proposed Site Location
- Proposed Site Options
- 2.5 km Study Area
- BBNP Proposed OHL Alignment
- Existing Overhead Line
- 275 kV AC
- Prime Agricultural Land - BMV
- Grade 3.2

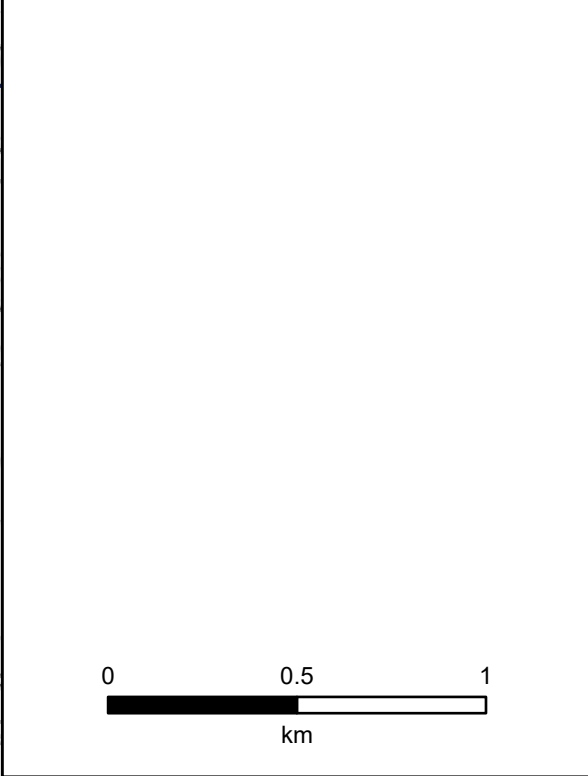

Client: Scottish & Southern Electricity Networks

Project: Clash Gour
275/132kV Transmission Substation

Title: Figure 4 - Agricultural Constraints

Date: 14/05/2025
Drawn: AC
Checked: IM
Approved: RG
Drawing Number: WSP-DA-UK0028262.9467-004

Scale: 1:20,000 @ A3

Document Path: \\corp\global\GB\Projects\UK0028xxxx\UK0028262.9467 - Clash Gour\03 WIP\GIS\MXD\Site Selection and Alignment Selection\Figure 3.4 - Agricultural Constraints.aprx