

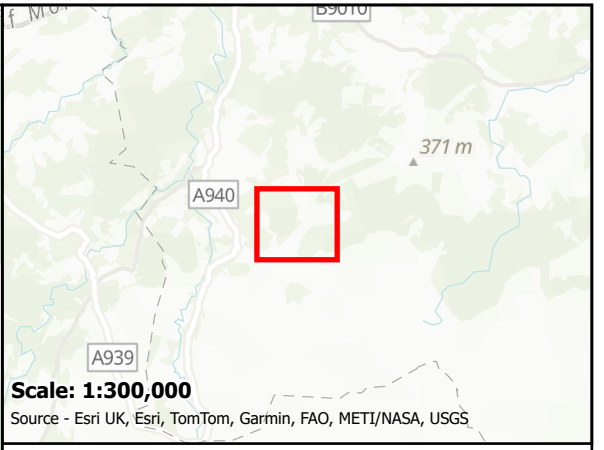


Document Path: \\corp\global\GB\Projects\UK0028xxxx\UK0028262.9467 - Clash Gour\03 WPI\GIS\MXD\Site Selection and Alignment Selection\Figure 4.1 - Site 2 proposed location and alignment.aprx

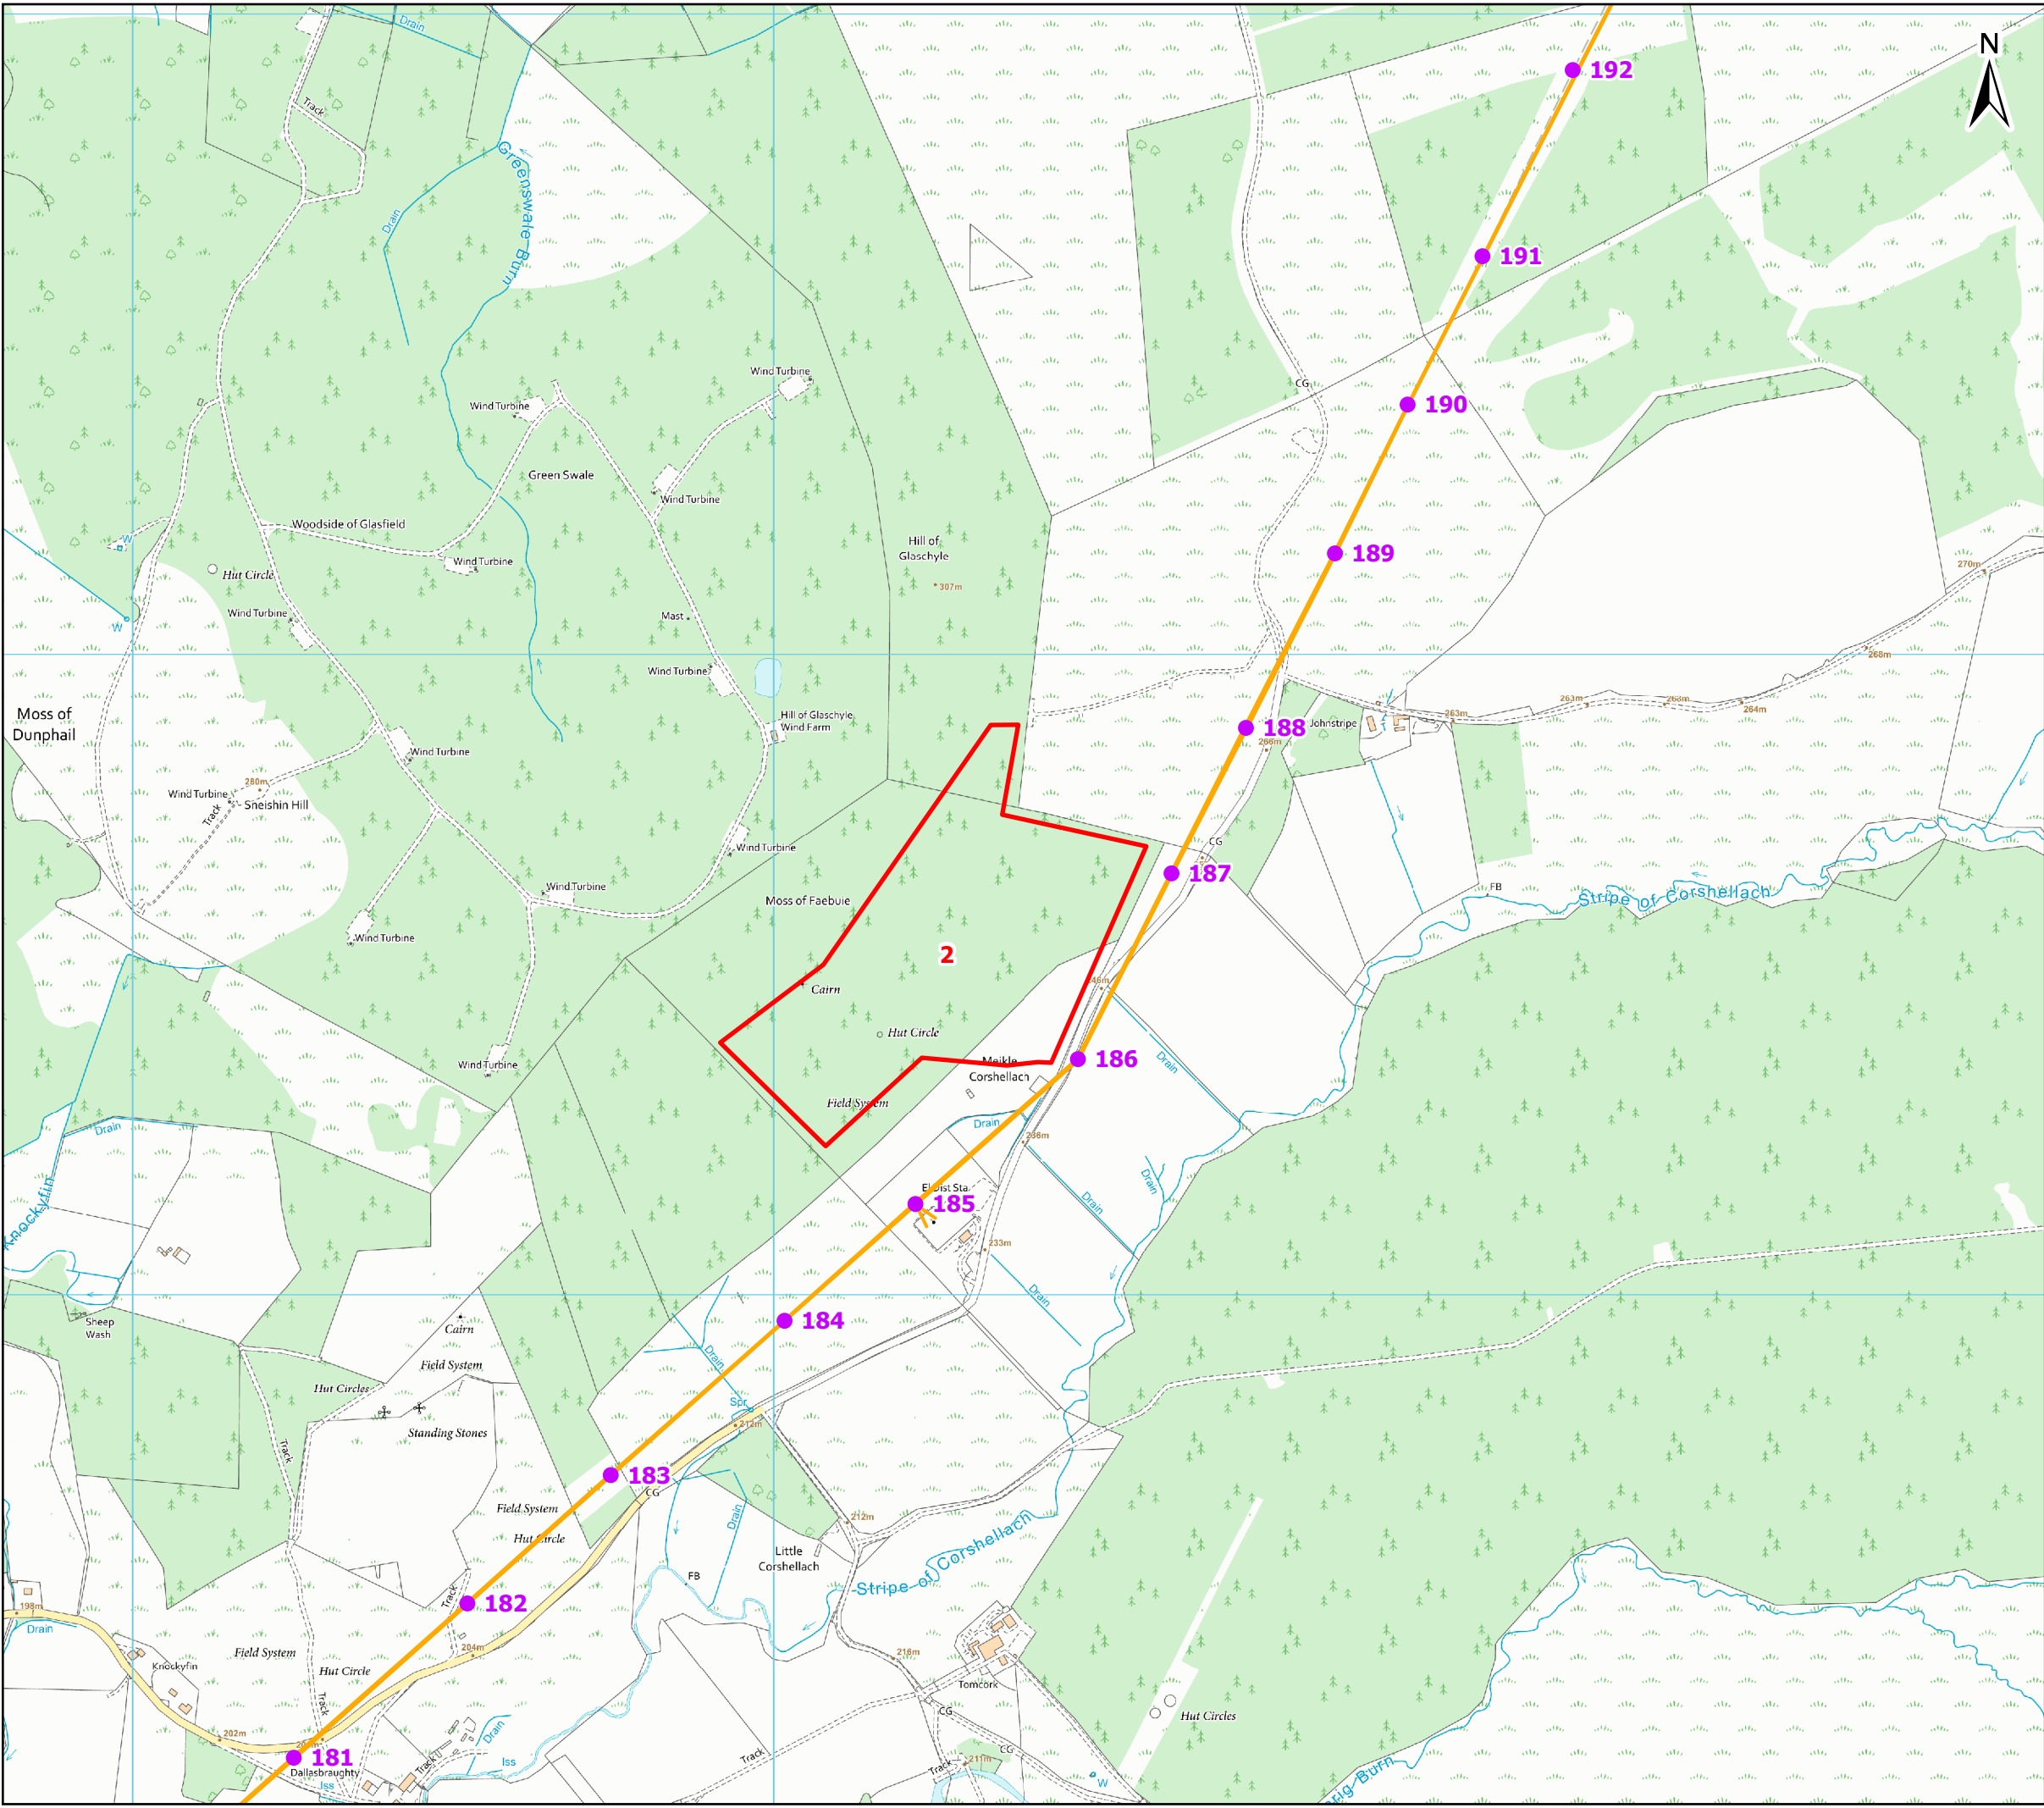

Scale: 1:300,000
Source - Esri UK, Esri, TomTom, Garmin, FAO, METI/NASA, USGS

- Key
- Site 2 Proposed Option
 - Existing Overhead Line
 - 275 kV AC
 - Existing Tower



Client:	 TRANSMISSION		
Project:	Clash Gour 275/132kV Transmission Substation		
Title:	Figure 6 - Site 2 Proposed Location		
Date:	14/05/2025	Scale:	1:10,000 @ A3
Drawn:	AC	Checked:	IM
Approved:	RG		
Drawing Number:	WSP-DA-UK0028262.9467-006		