
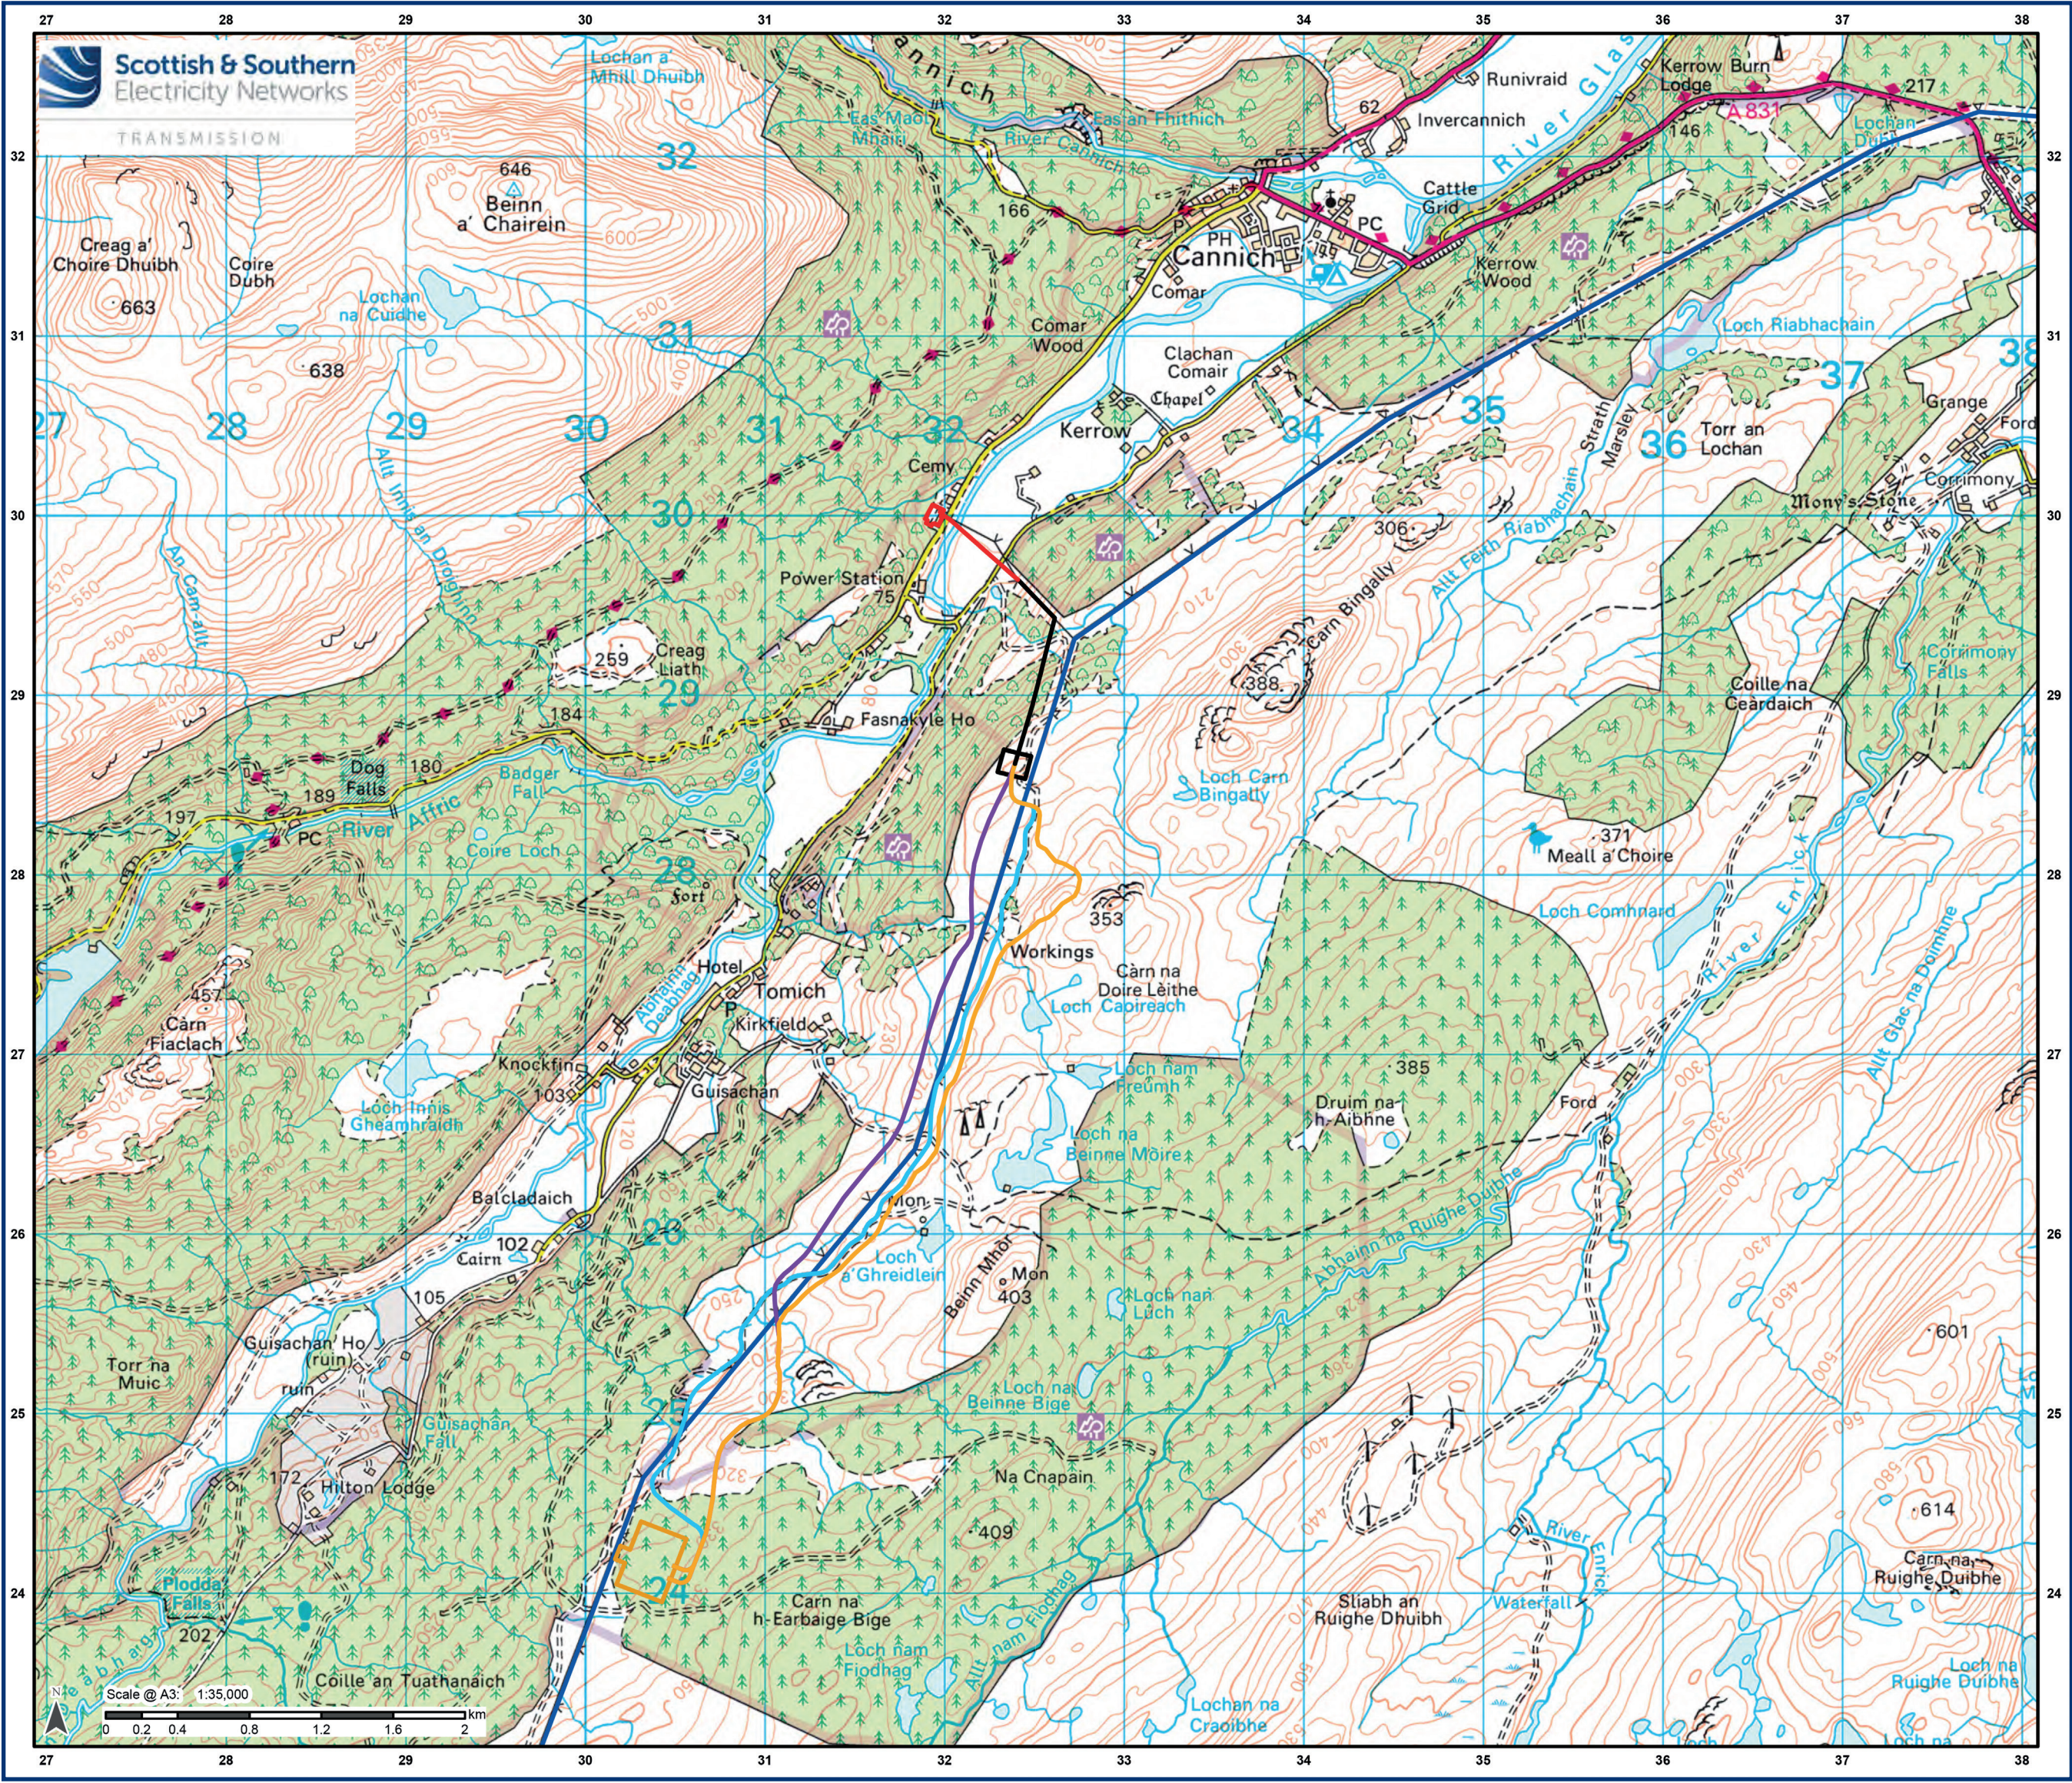


Fasnakyle to Bingally 132kV Connection

Alignment options

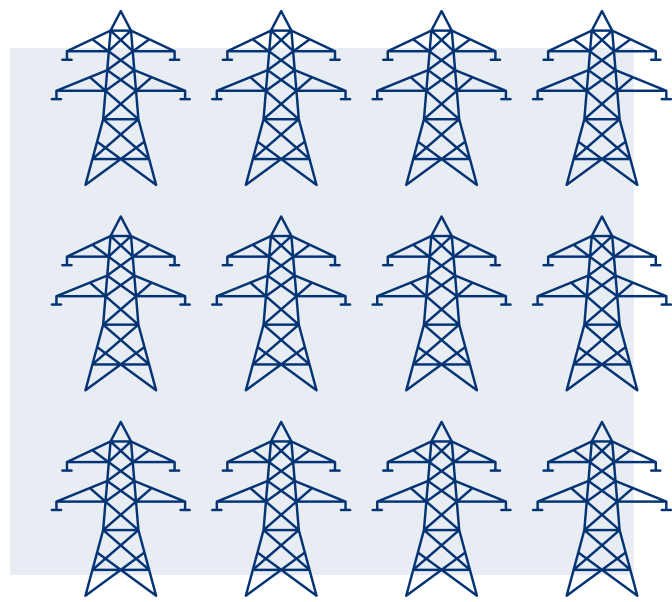

Legend

- Cable Route Option 1
- Cable Route Option 2
- Cable Route Option 3
- Existing OHL
- New OHL
- Existing Fasnakyle 275kV Substation
- Proposed Bingally 400kV Substation
- Cable Sealing End
- Existing Beaully to Denny Line

