


Future East Coast projects at a glance

Current East Coast Network

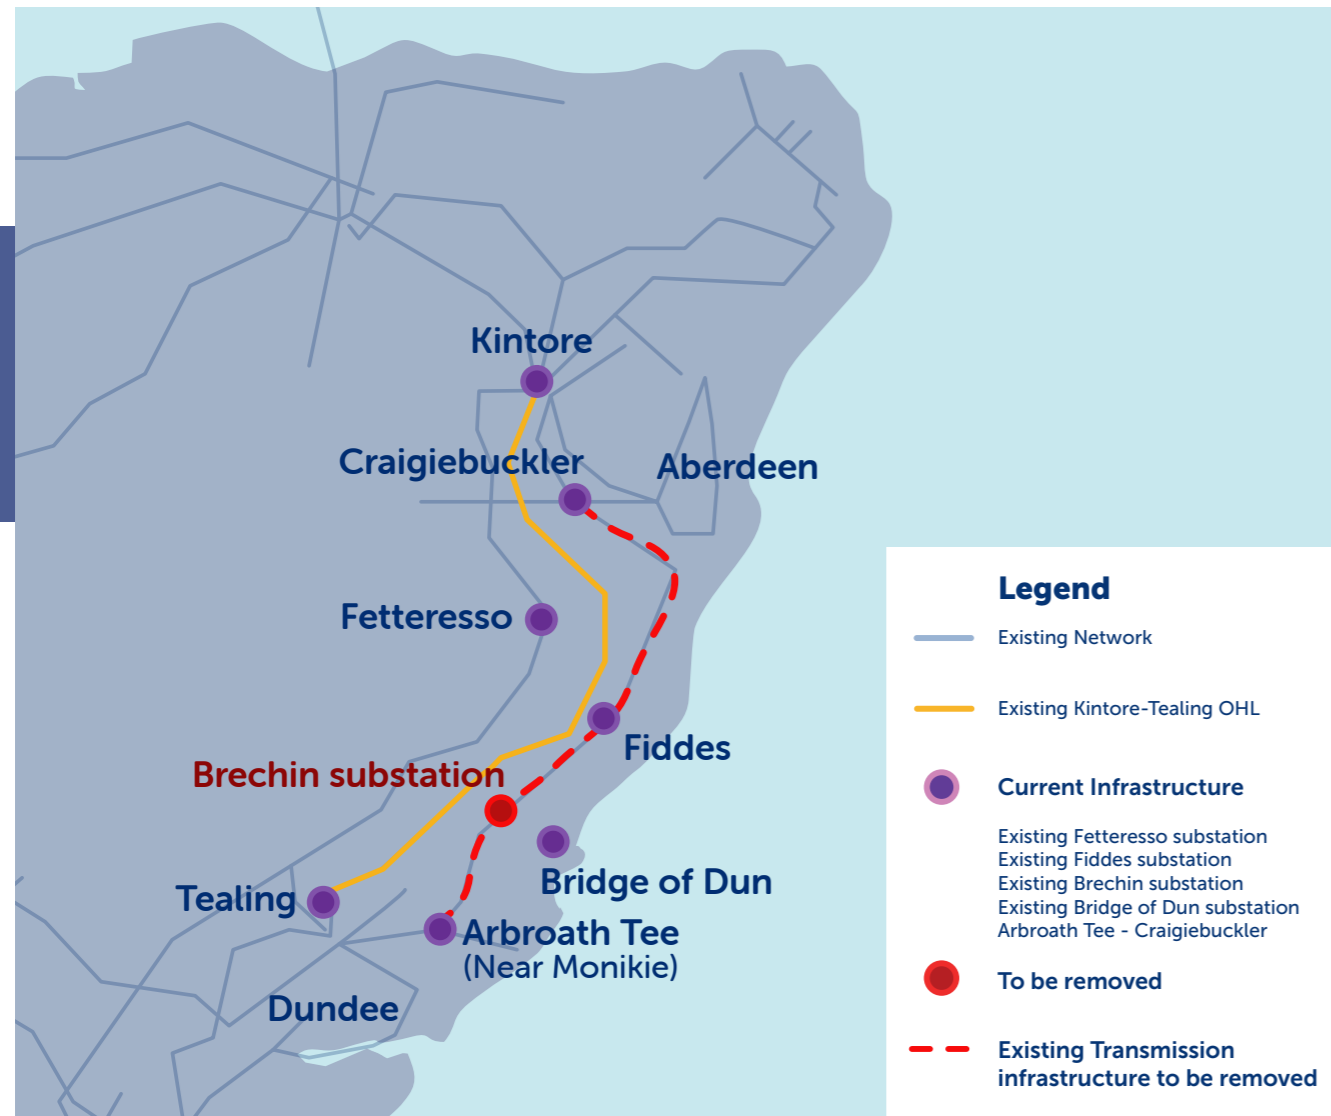

The existing 132kV single-circuit Overhead Line (OHL) spanning from Craigiebuckler to Arbroath (red dashed line) is reaching the end of its operational lifespan. To allow it to be removed from the network, Fiddes and Bridge of Dun substations need to be reconnected to other parts of network. New 132kV circuits and substation infrastructure is required to allow these changes to happen, as well as increasing capacity on the network. The existing 132kV overhead line between Craigiebuckler and Arbroath Tee must remain in service while all the new infrastructure is developed, as it is critical to current electricity supply in the East Coast area. Once all the works are complete, it can then be removed.

Proposed East Coast Network

