


ANNEX A – FIGURES

Figure 10.3.7b\ a- 10.3.7b\ f

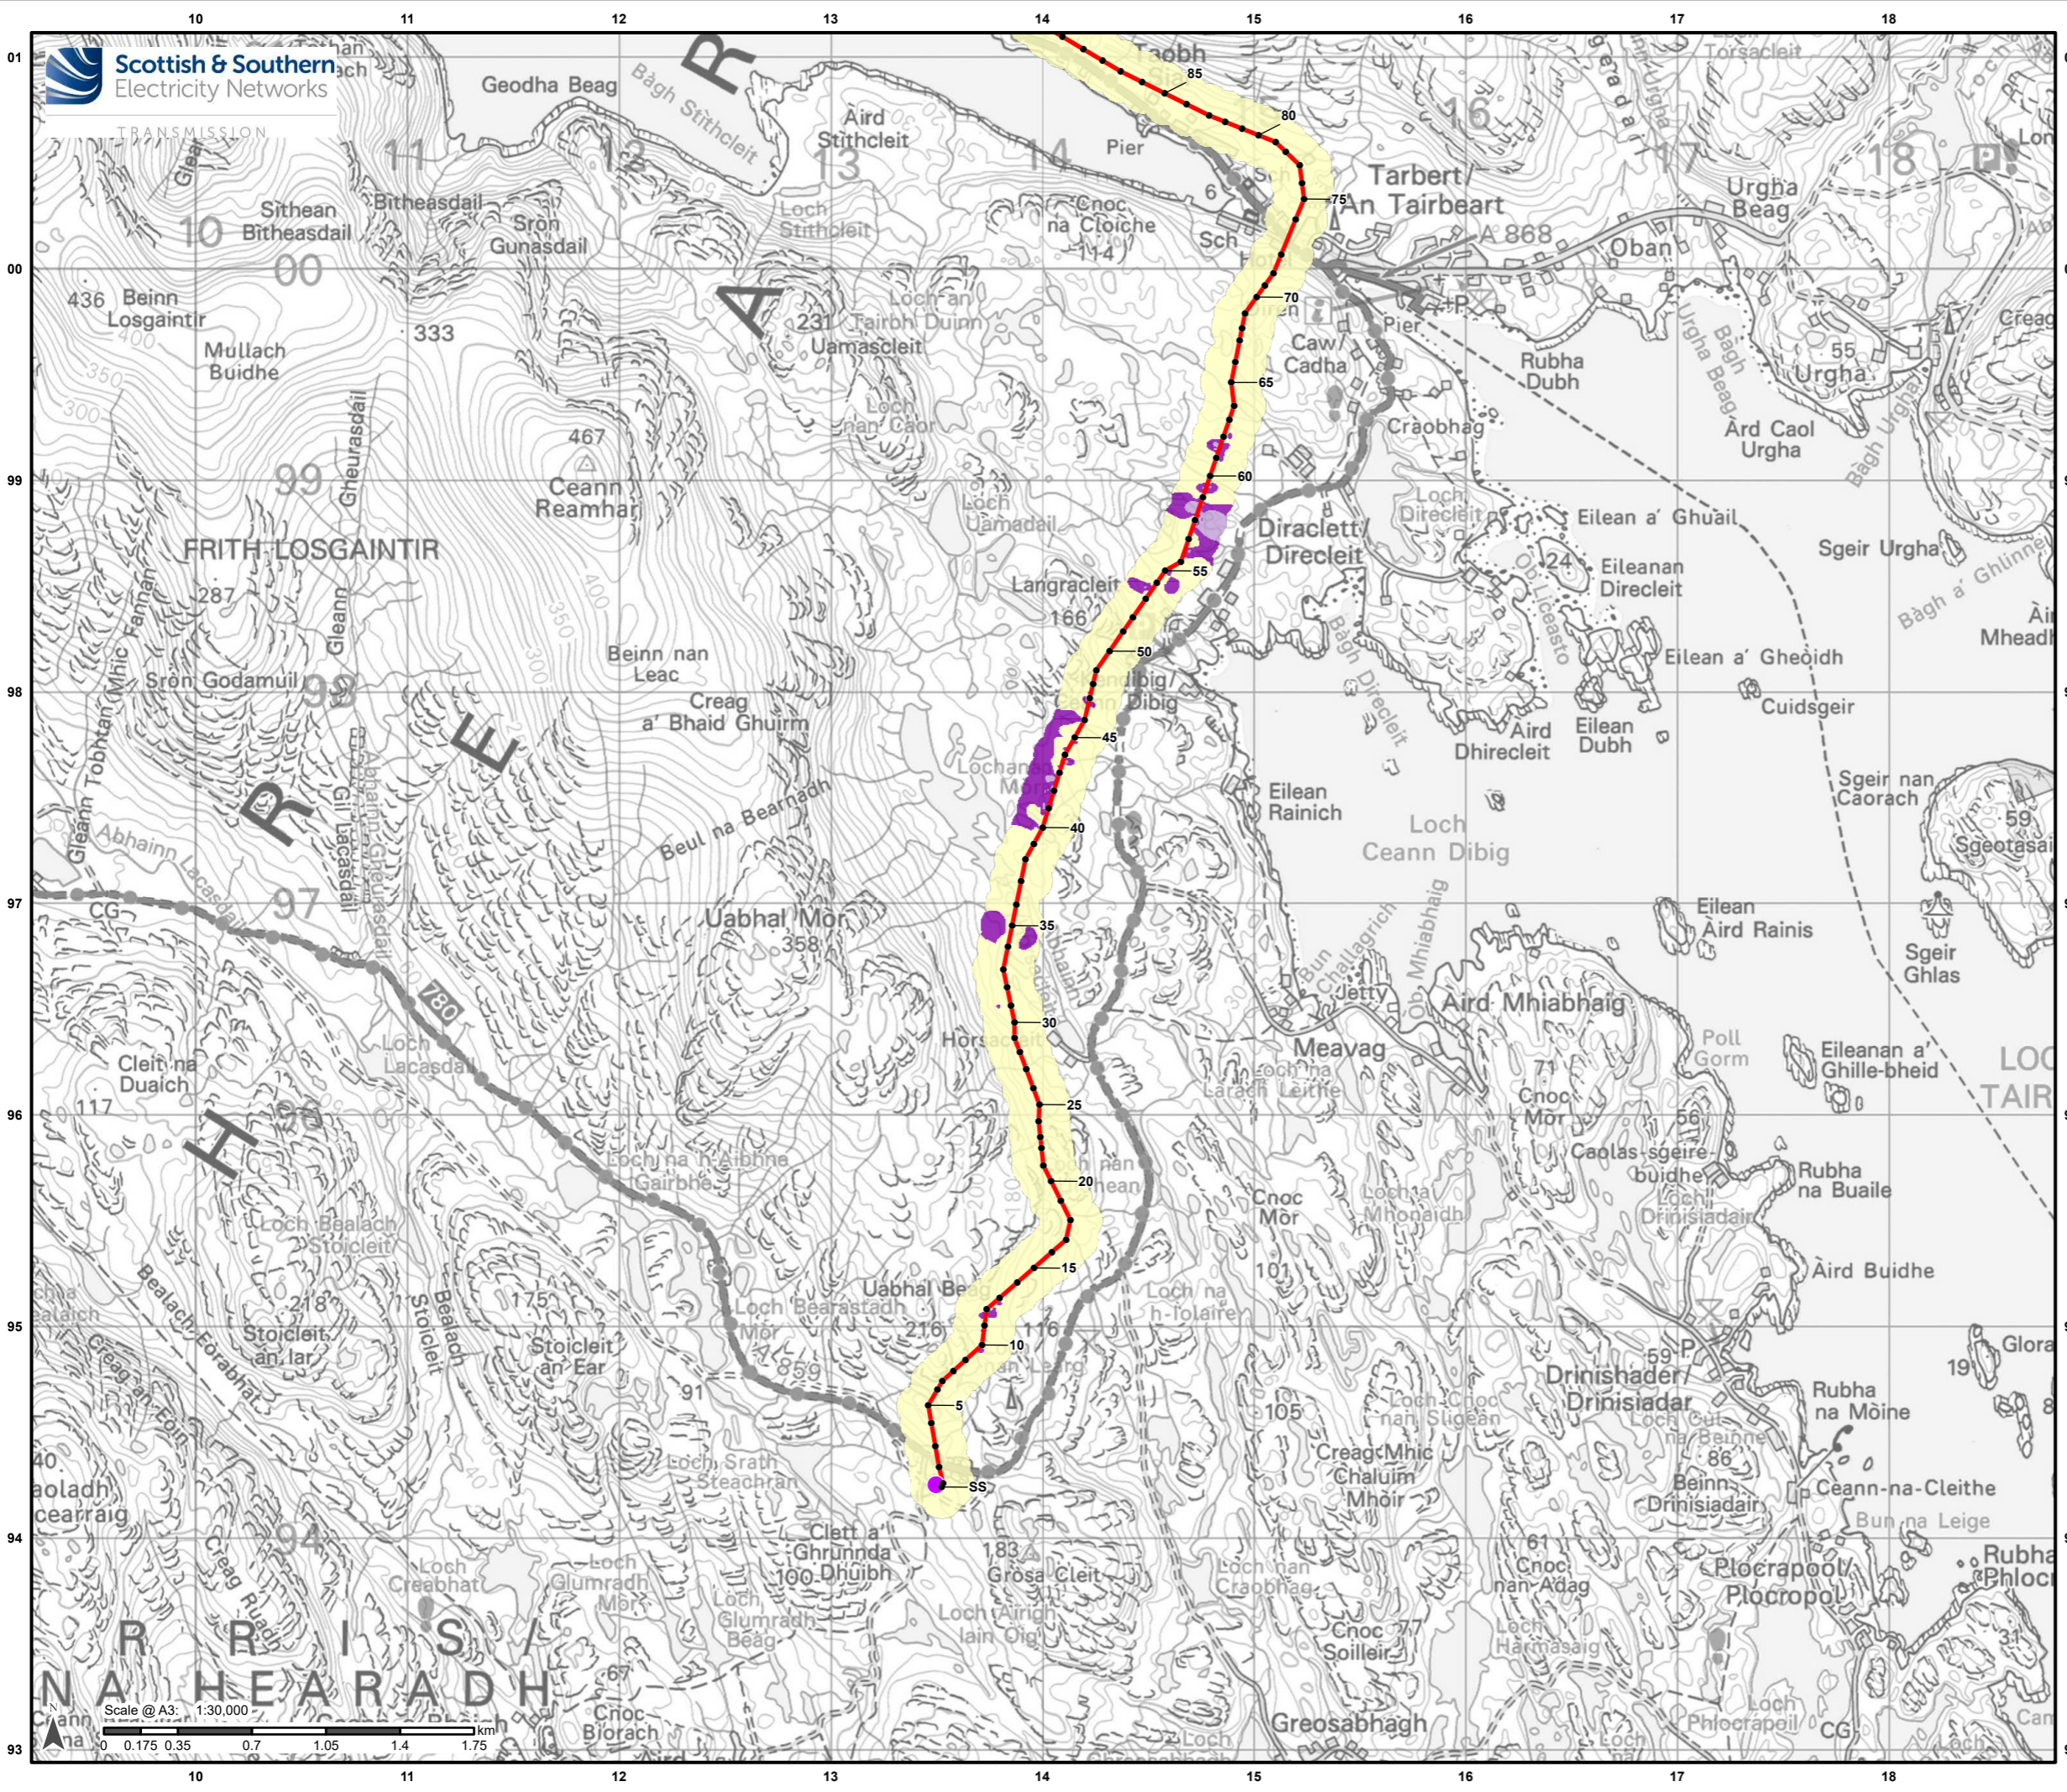


Legend

- Proposed Alignment
- Indicative Pole Location
- Harris 132kV Grid Supply Point

Peat Depth Scores (P)

- Score 1: < 0.5 m
- Score 2: > 1.5 m
- Score 3: 0.5 - 1.5 m

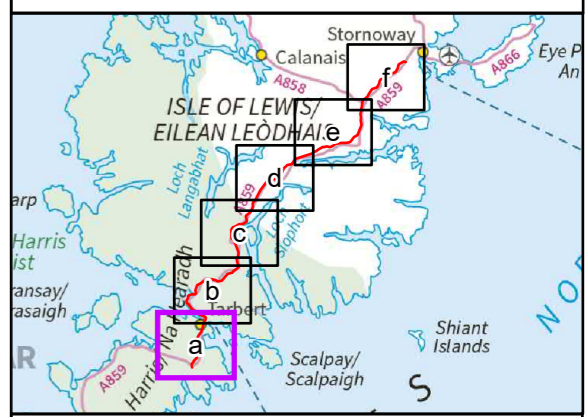


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7bva:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Peat Depth Score


Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B

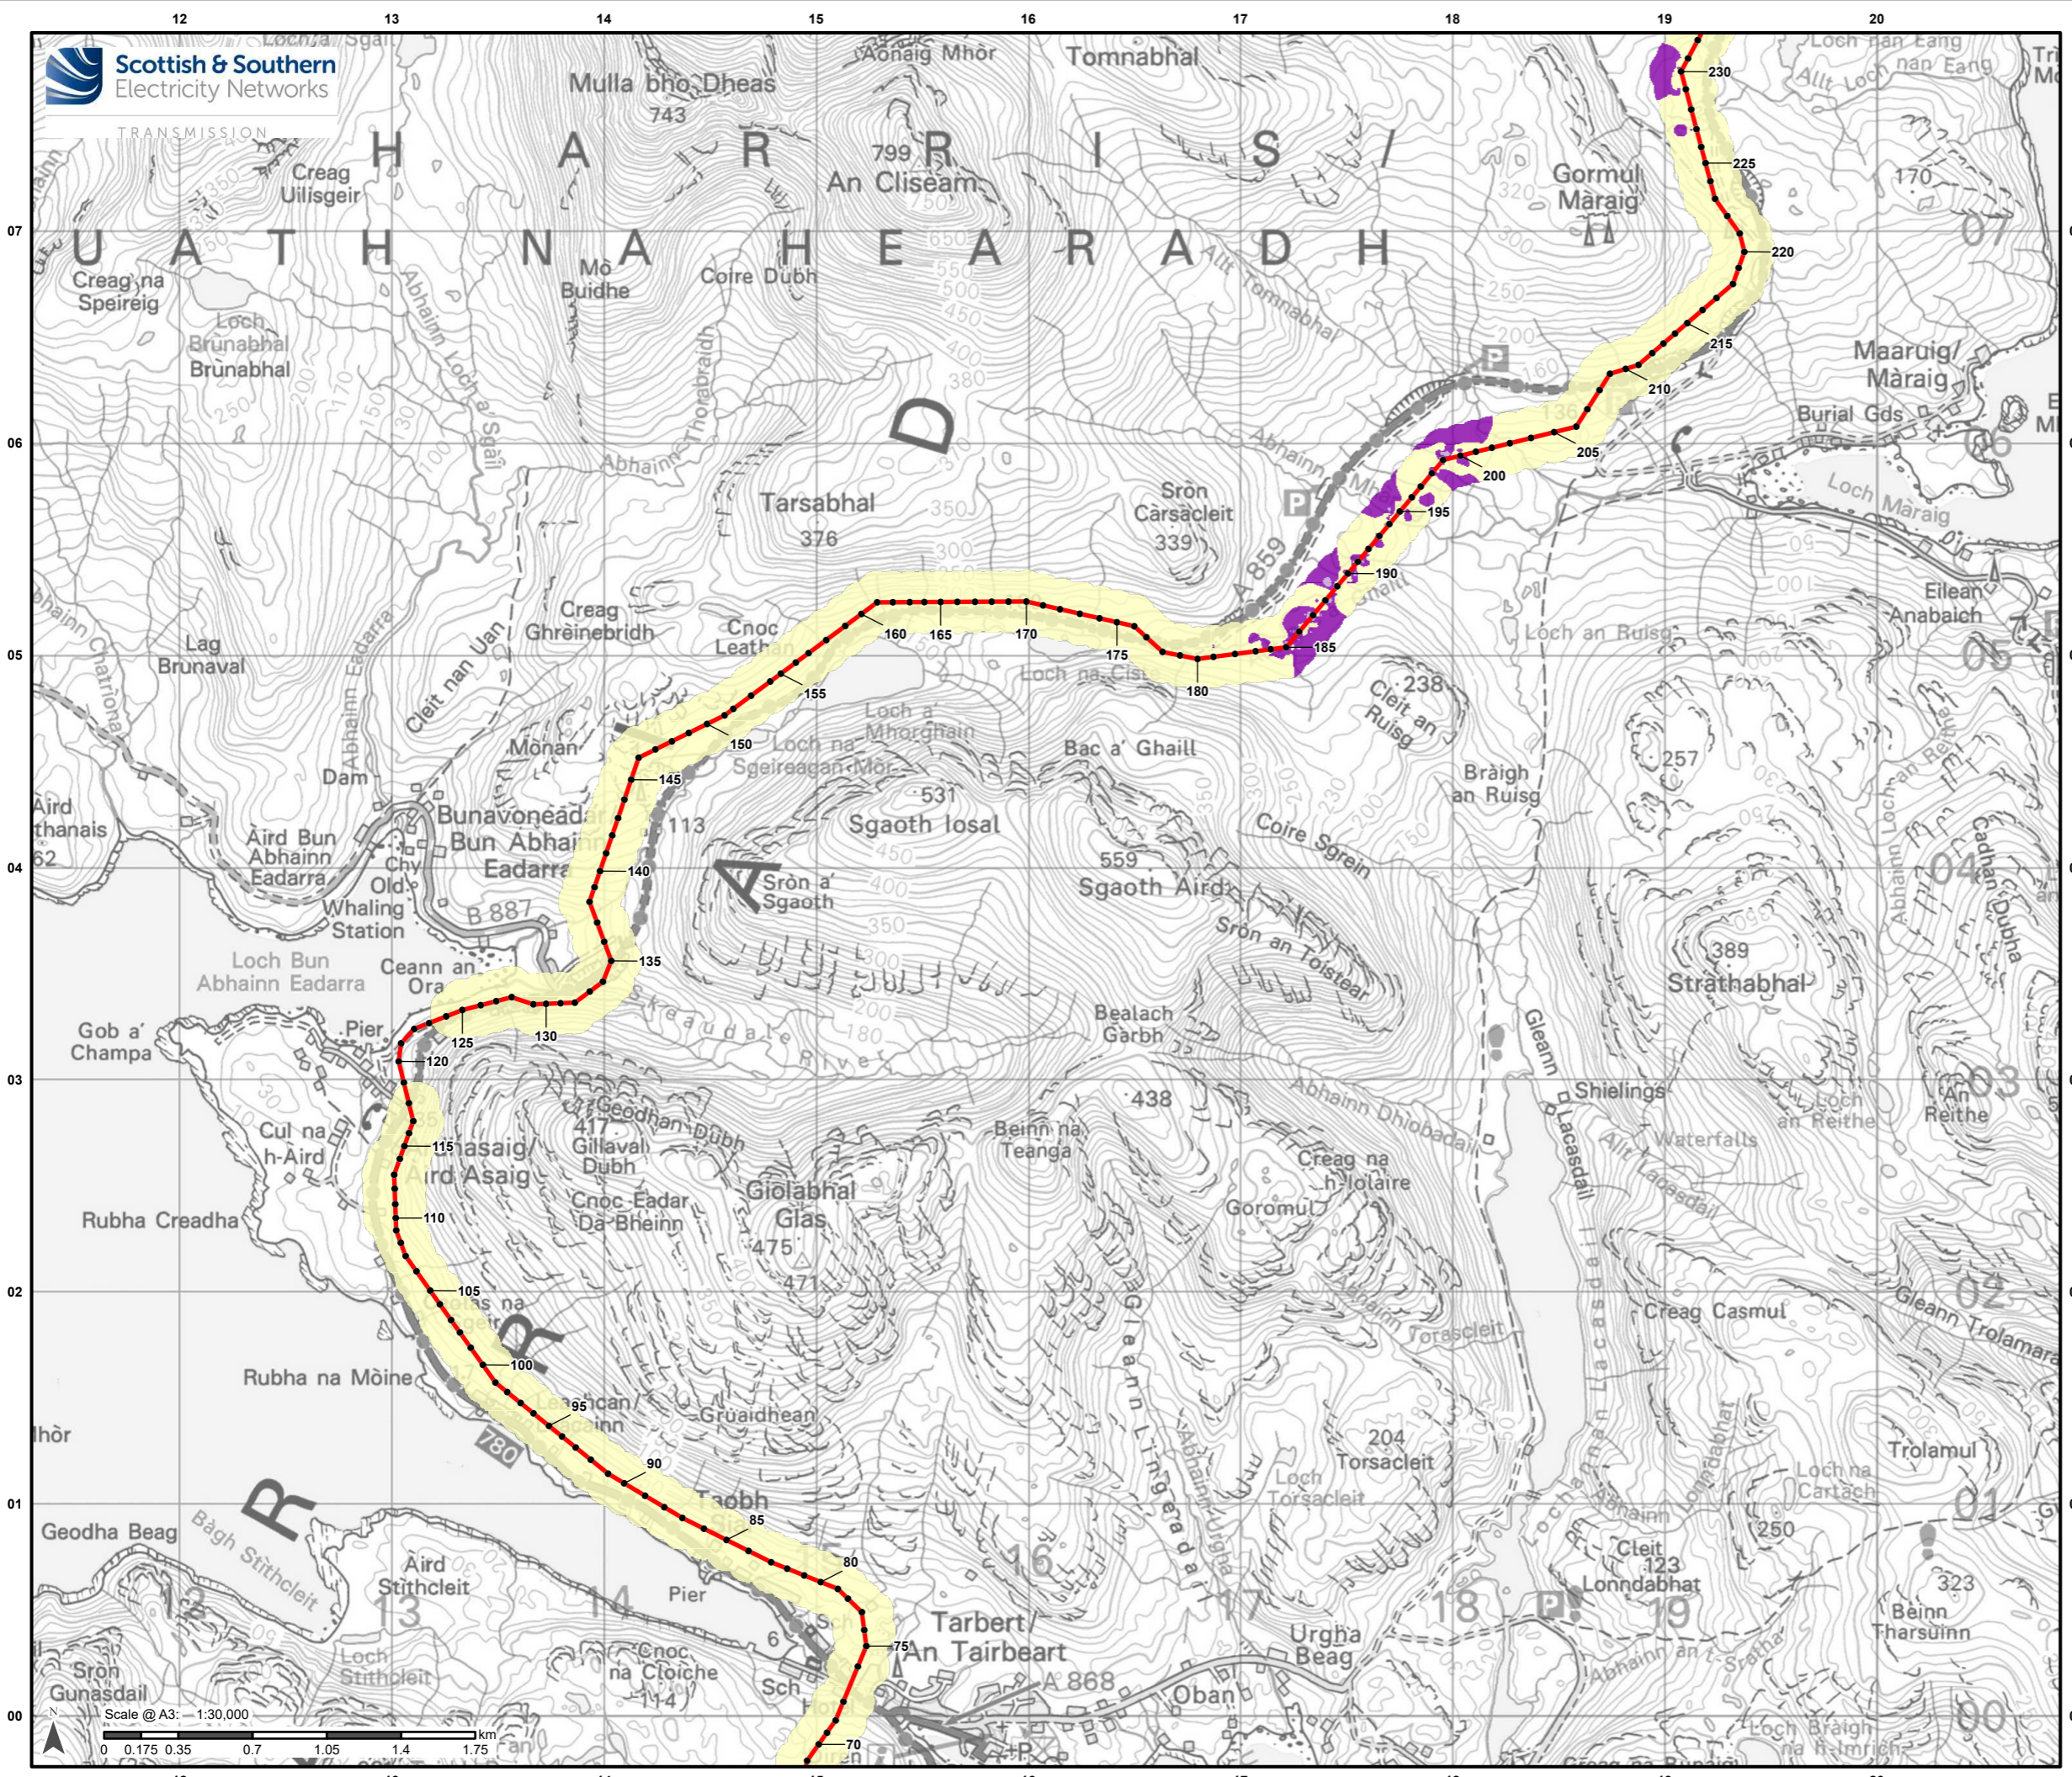

Legend

- Proposed Alignment
 - Indicative Pole Location
- Peat Depth Scores (P)**
- Score 1: <math>P < 0.5\text{ m}</math>
 - Score 2: $P > 1.5\text{ m}$
 - Score 3: $0.5 - 1.5\text{ m}$

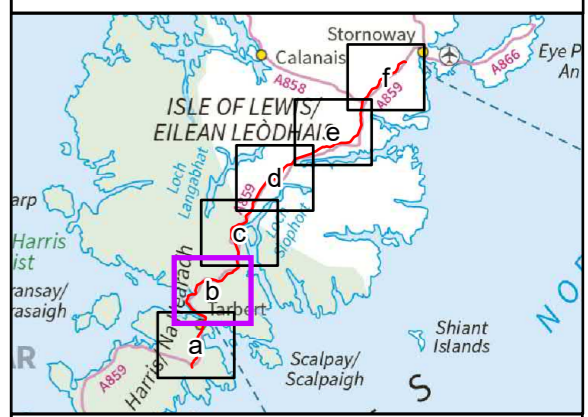

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement



Title: Figure 10.3.7bb: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Peat Depth Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B

Legend

- Proposed Alignment
 - Indicative Pole Location
- Peat Depth Scores (P)**
- Score 1: < 0.5 m
 - Score 2: > 1.5 m
 - Score 3: 0.5 - 1.5 m

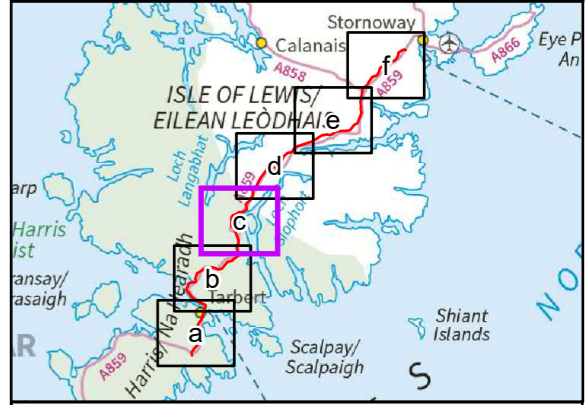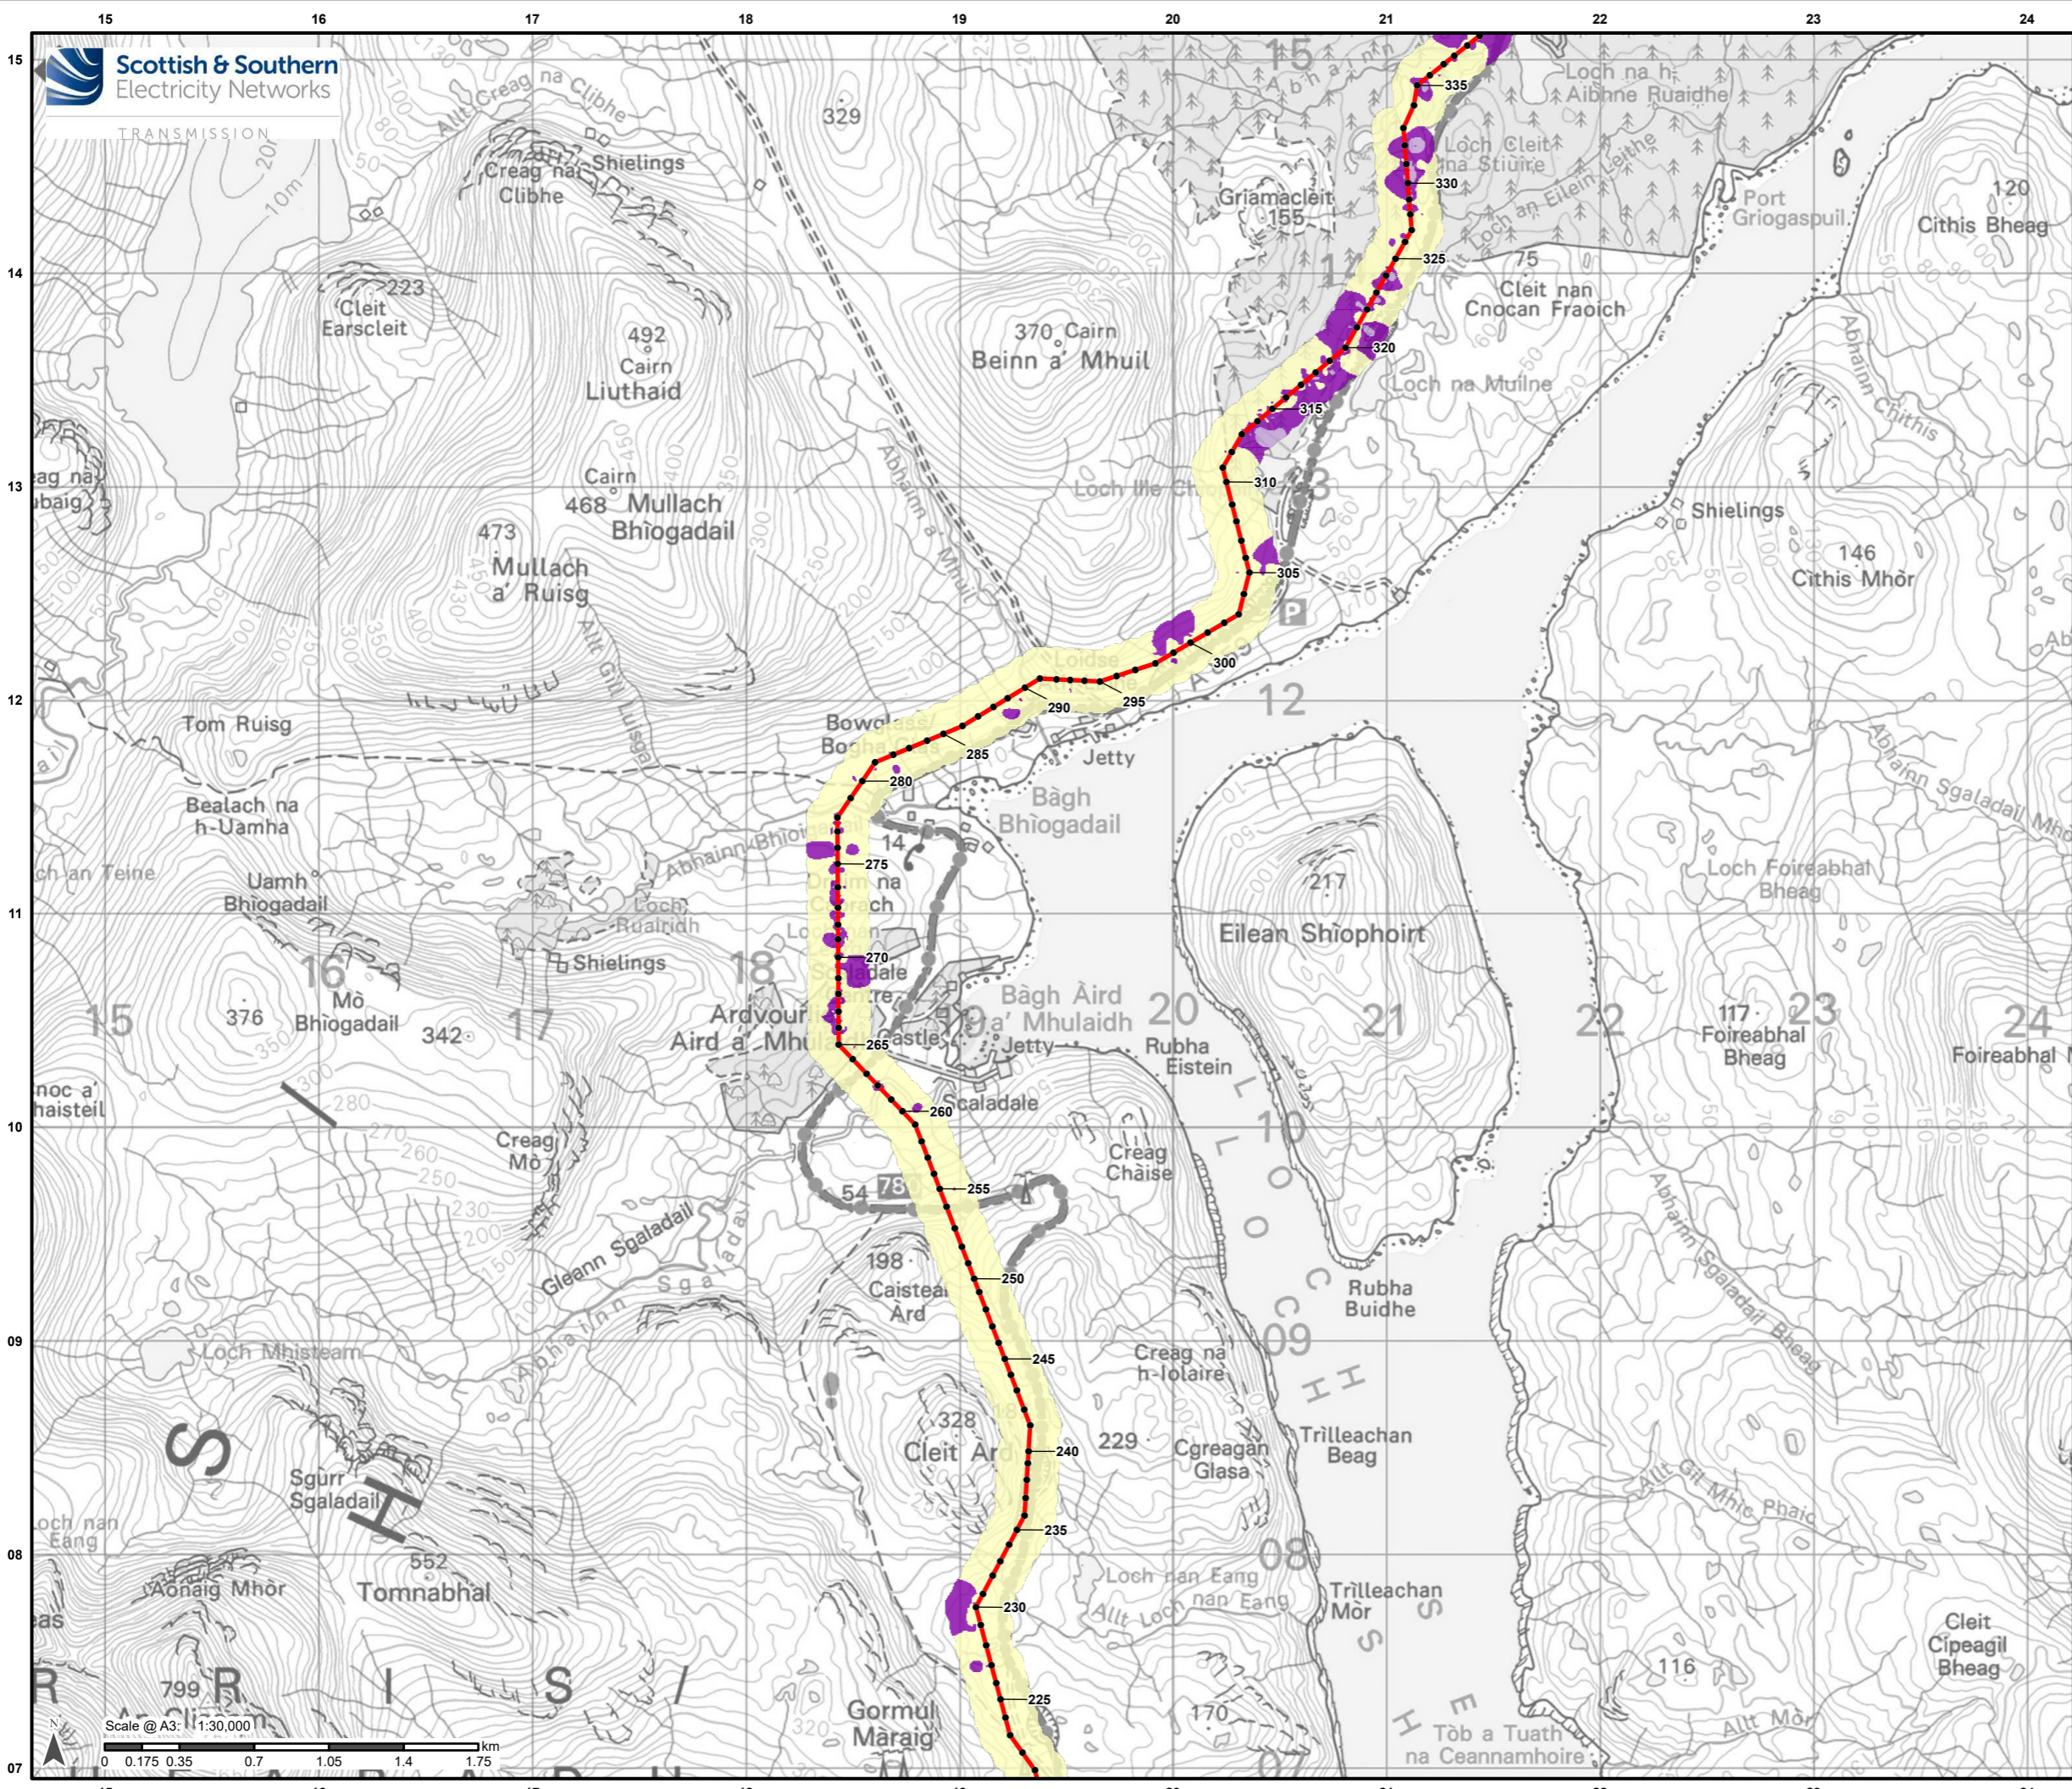


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7b/c: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Peat Depth Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B




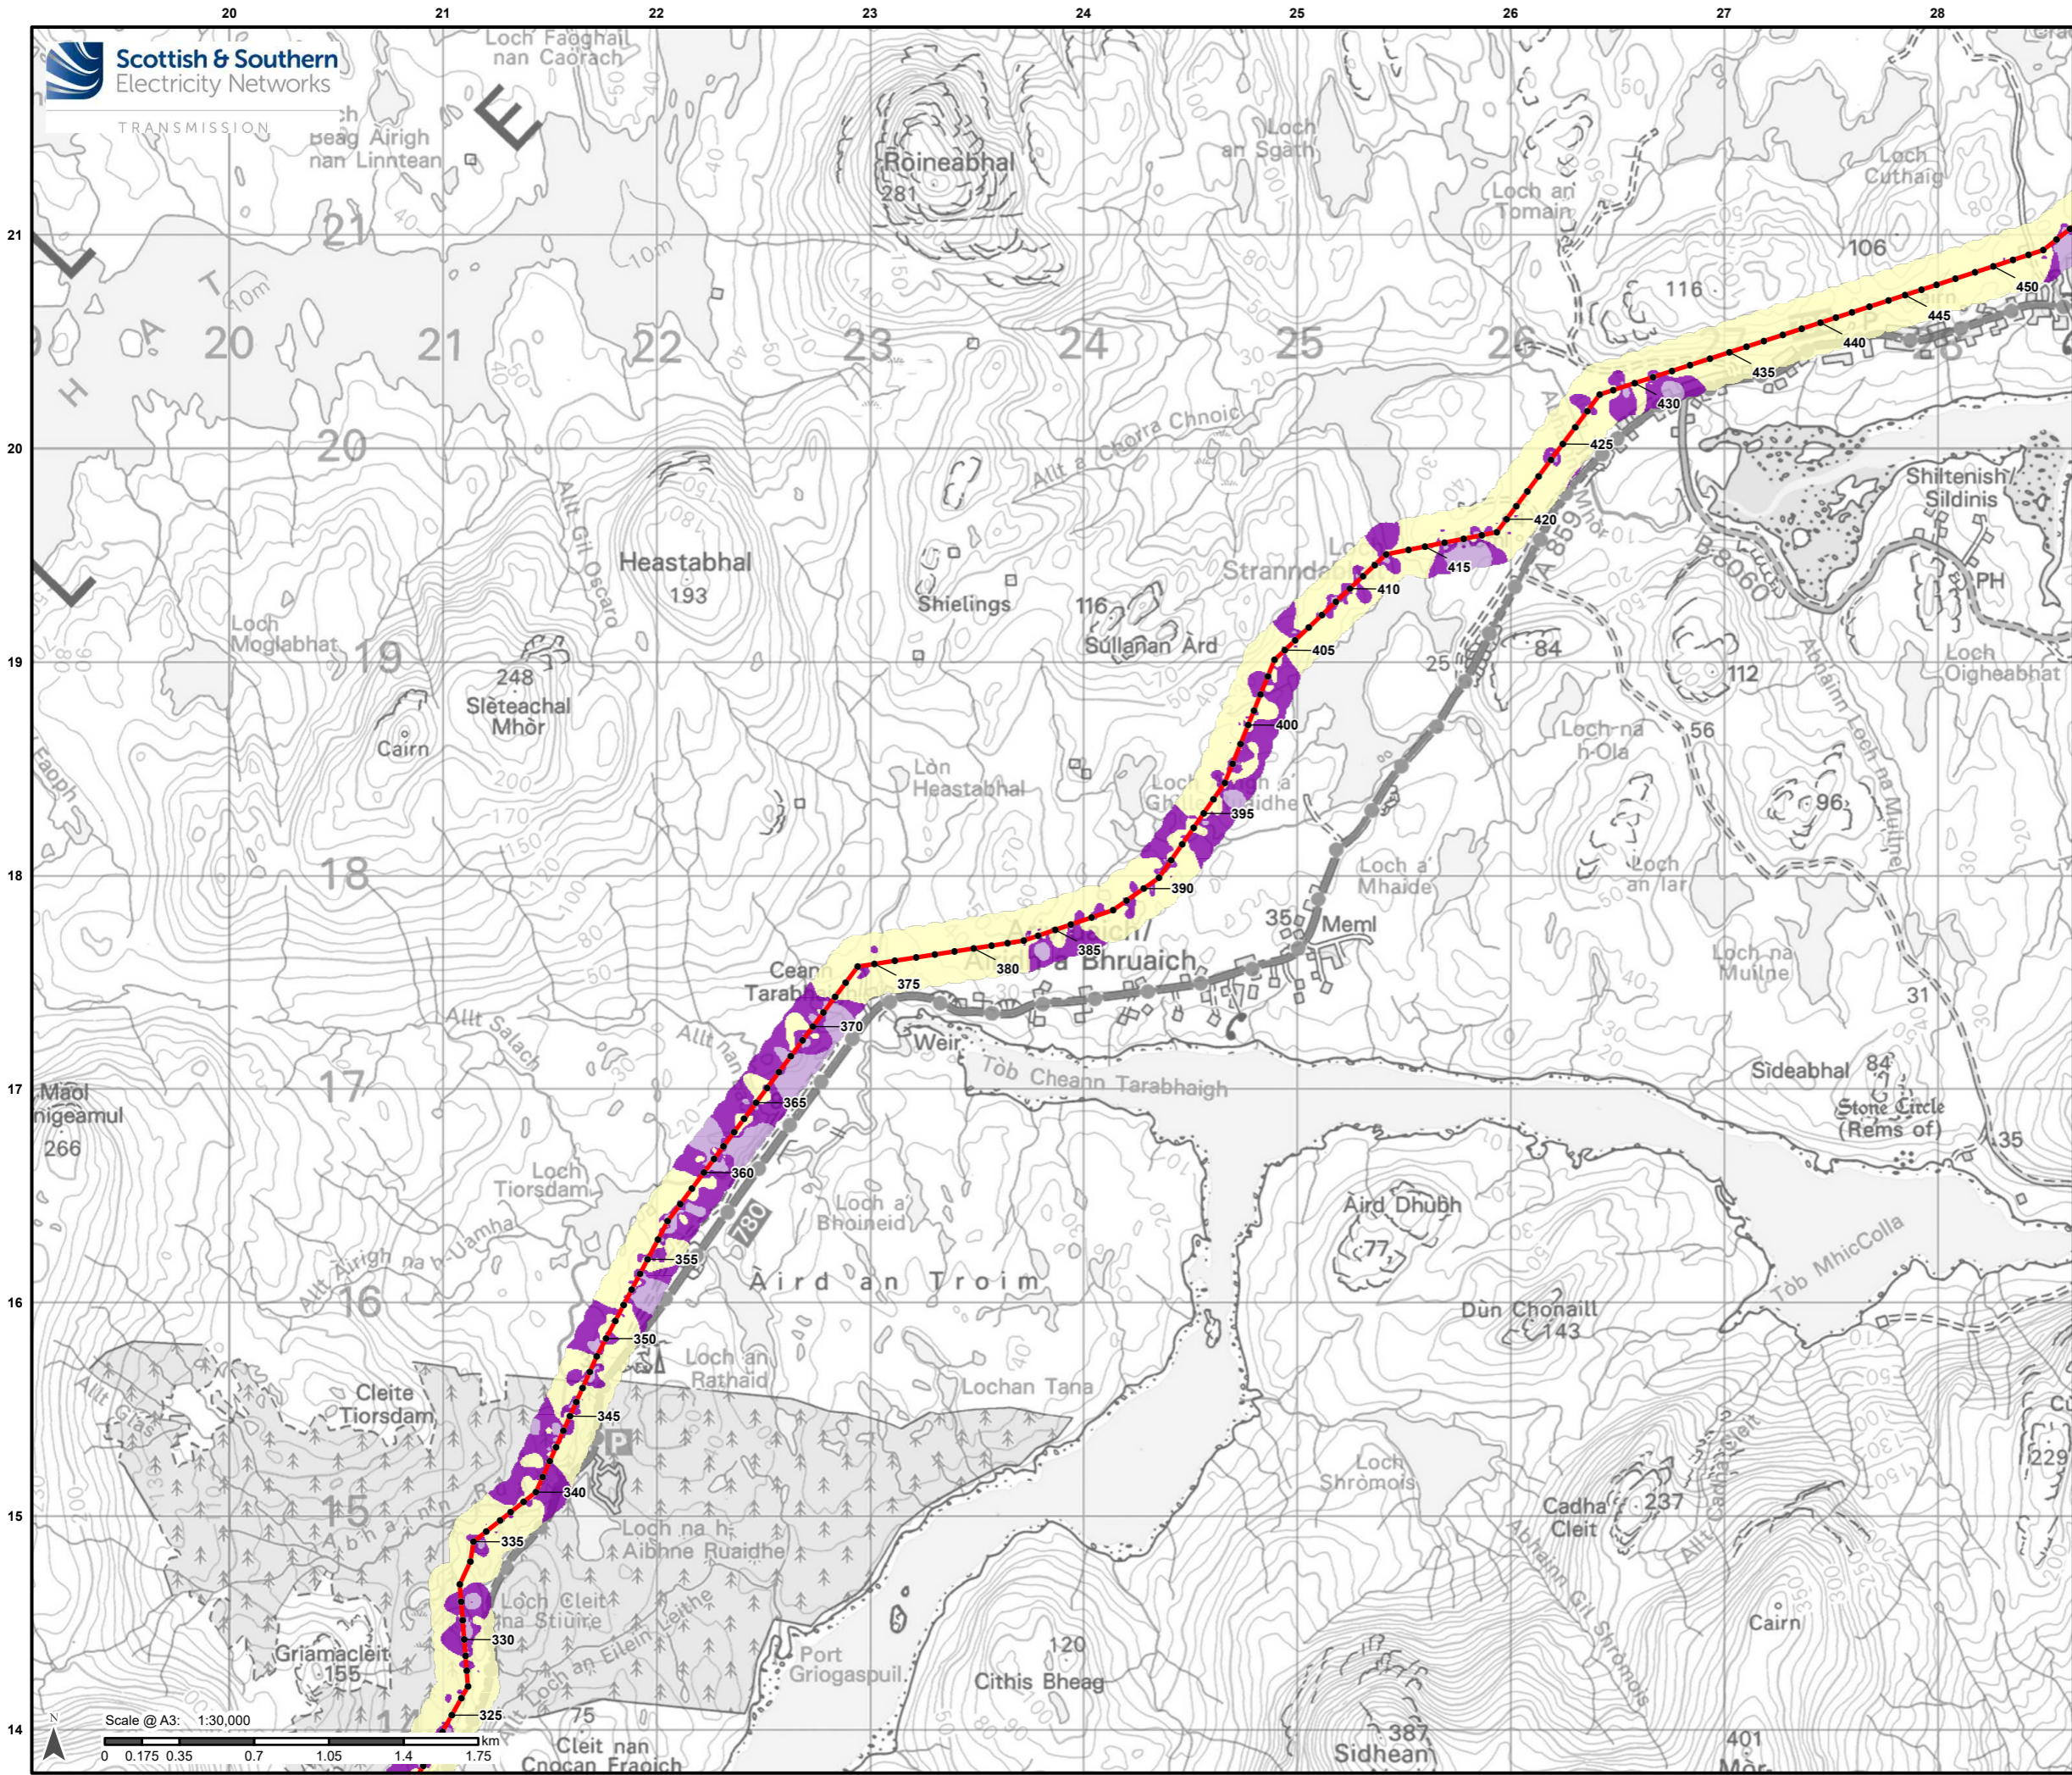


Legend

- Proposed Alignment
- Indicative Pole Location

Peat Depth Scores (P)

- Score 1: < 0.5 m
- Score 2: > 1.5 m
- Score 3: 0.5 - 1.5 m

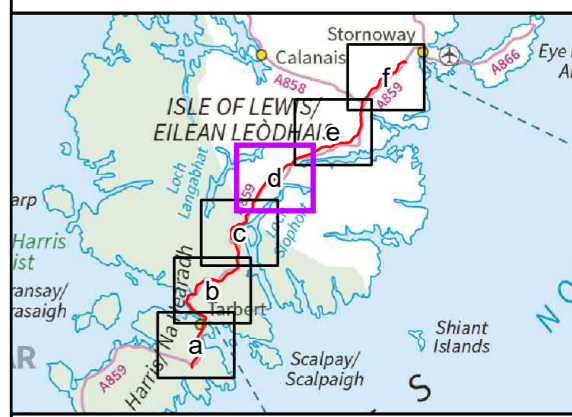


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7bvd: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Peat Depth Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B

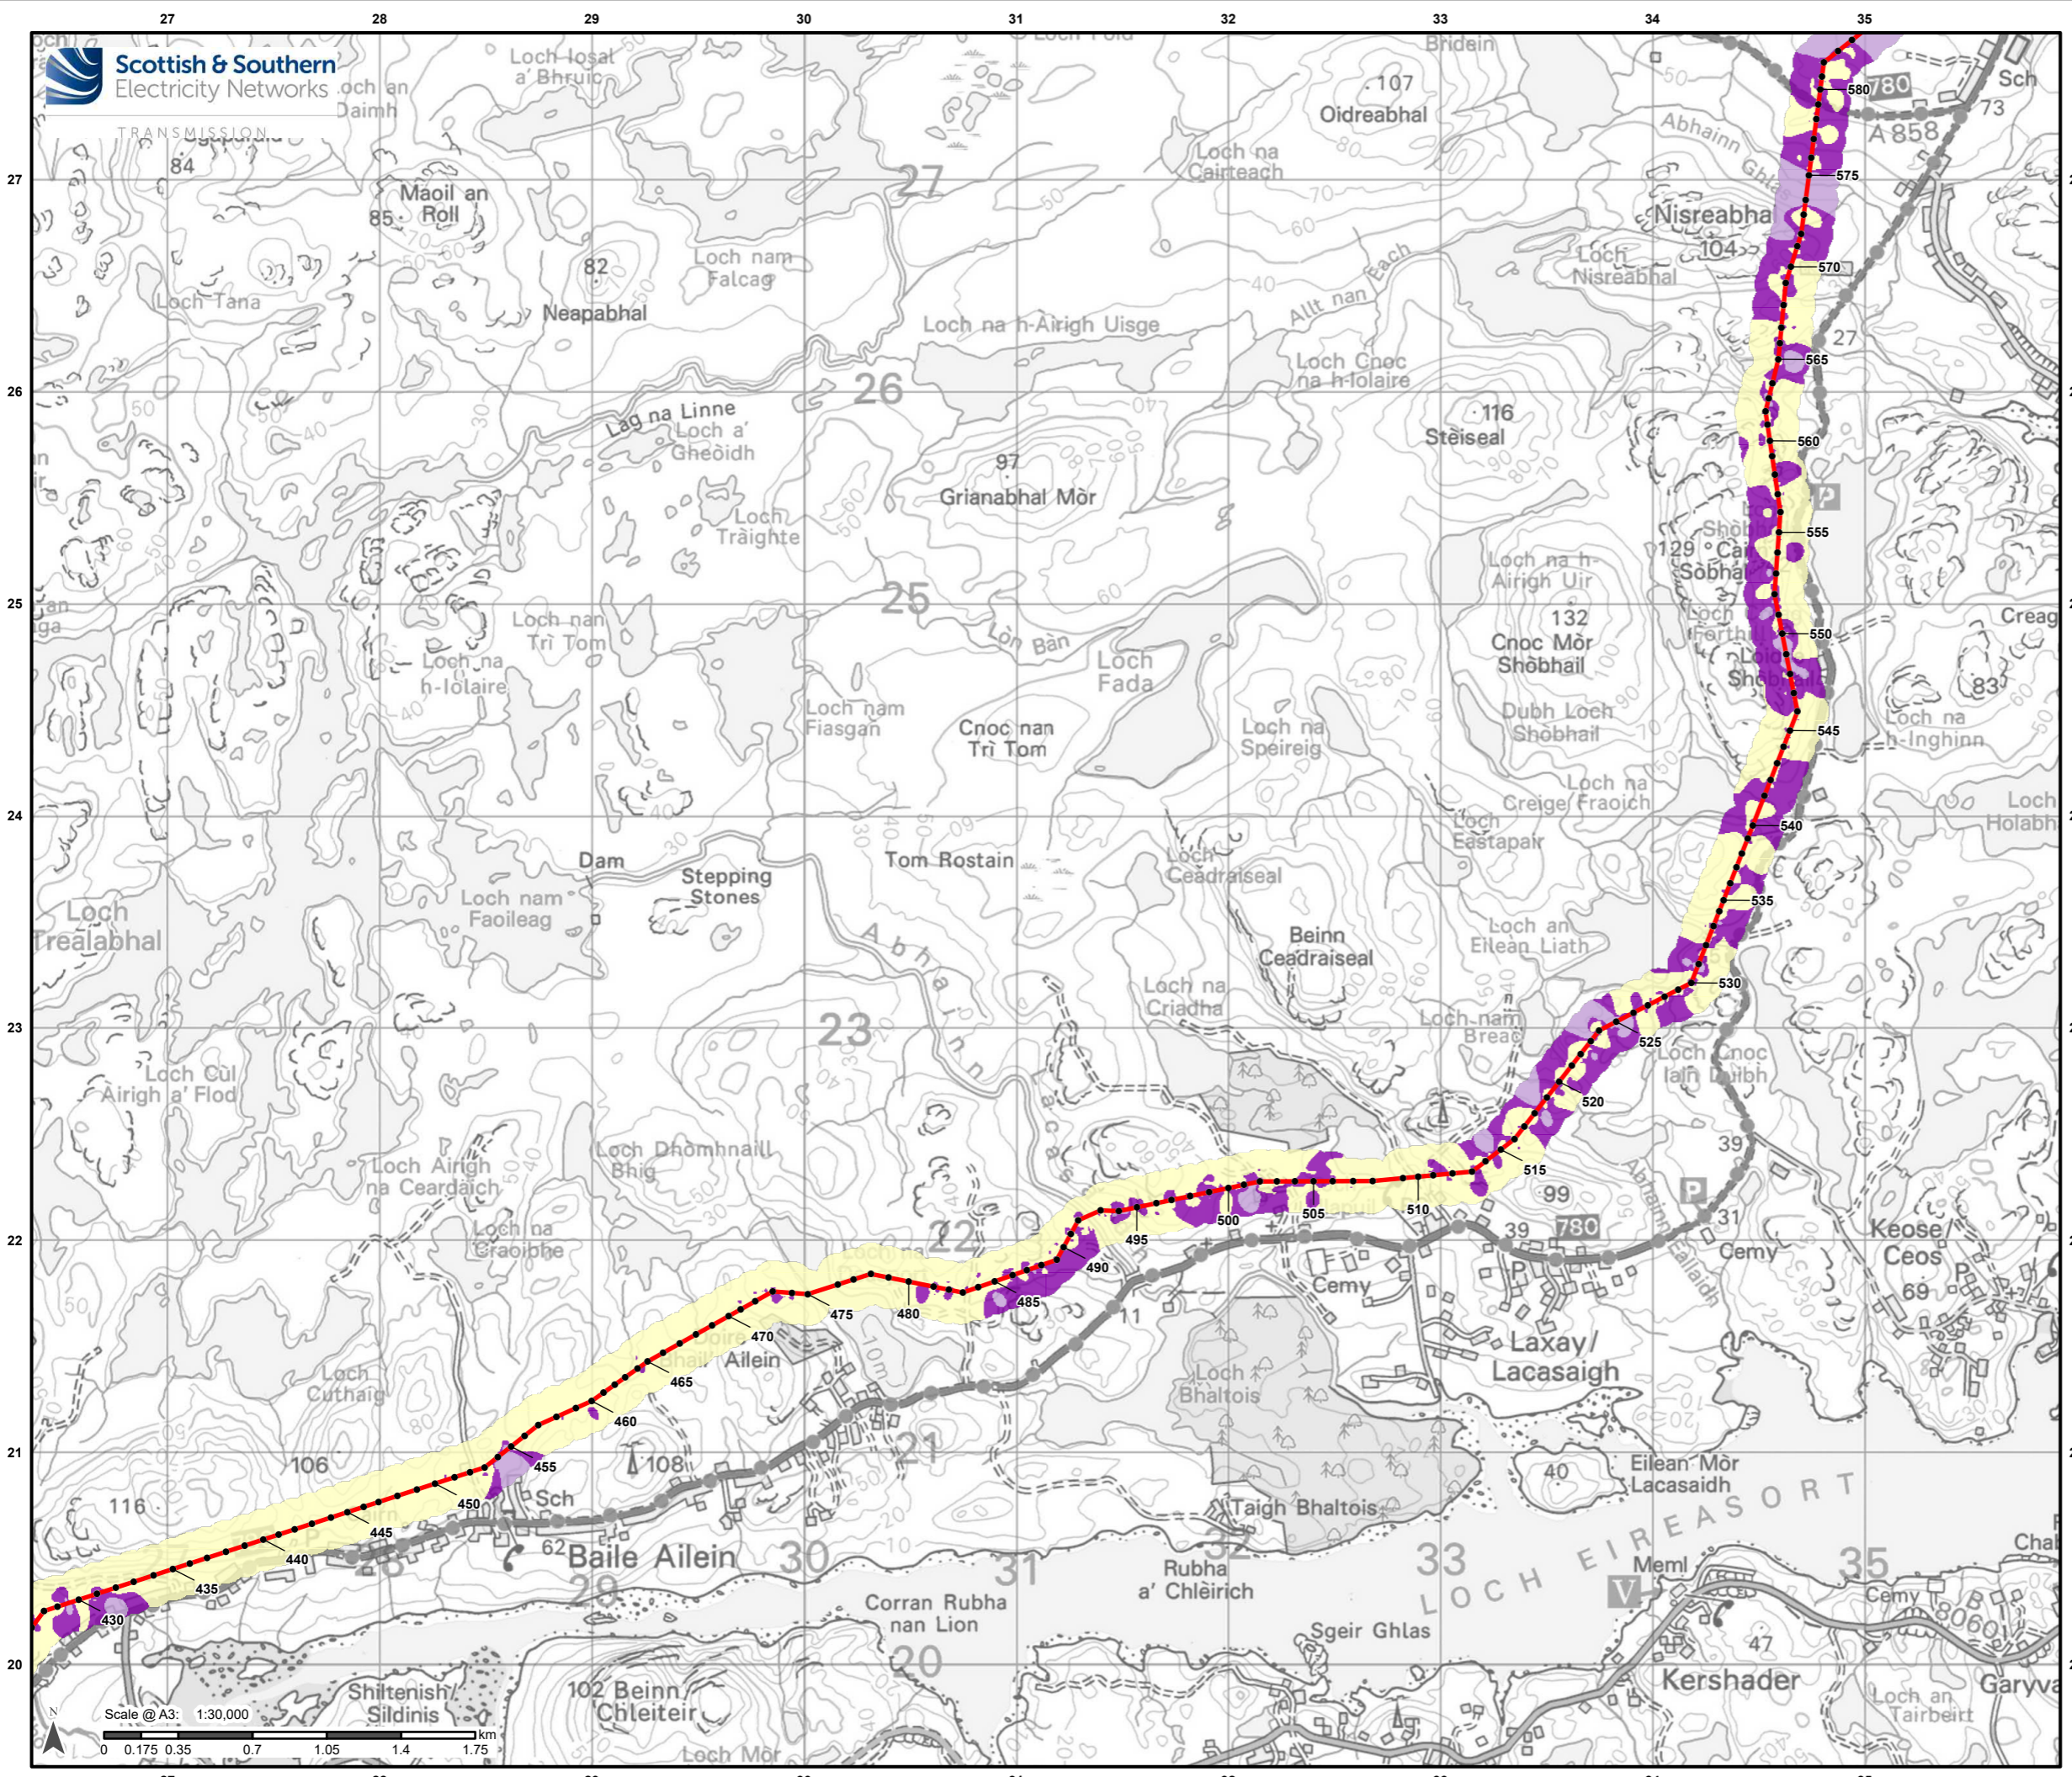


Legend

- Proposed Alignment
- Indicative Pole Location

Peat Depth Scores (P)

- Score 1: < 0.5 m
- Score 2: > 1.5 m
- Score 3: 0.5 - 1.5 m

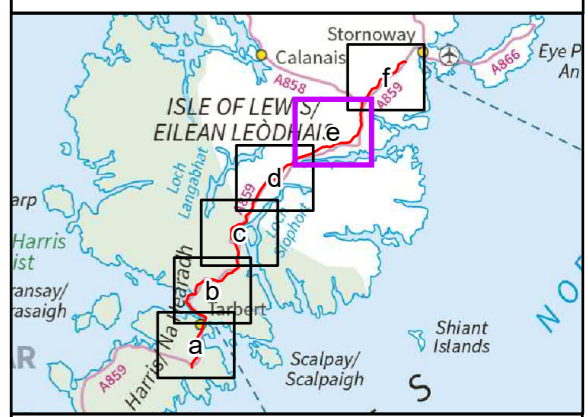


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title:
Figure 10.3.7bIe:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Peat Depth Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B

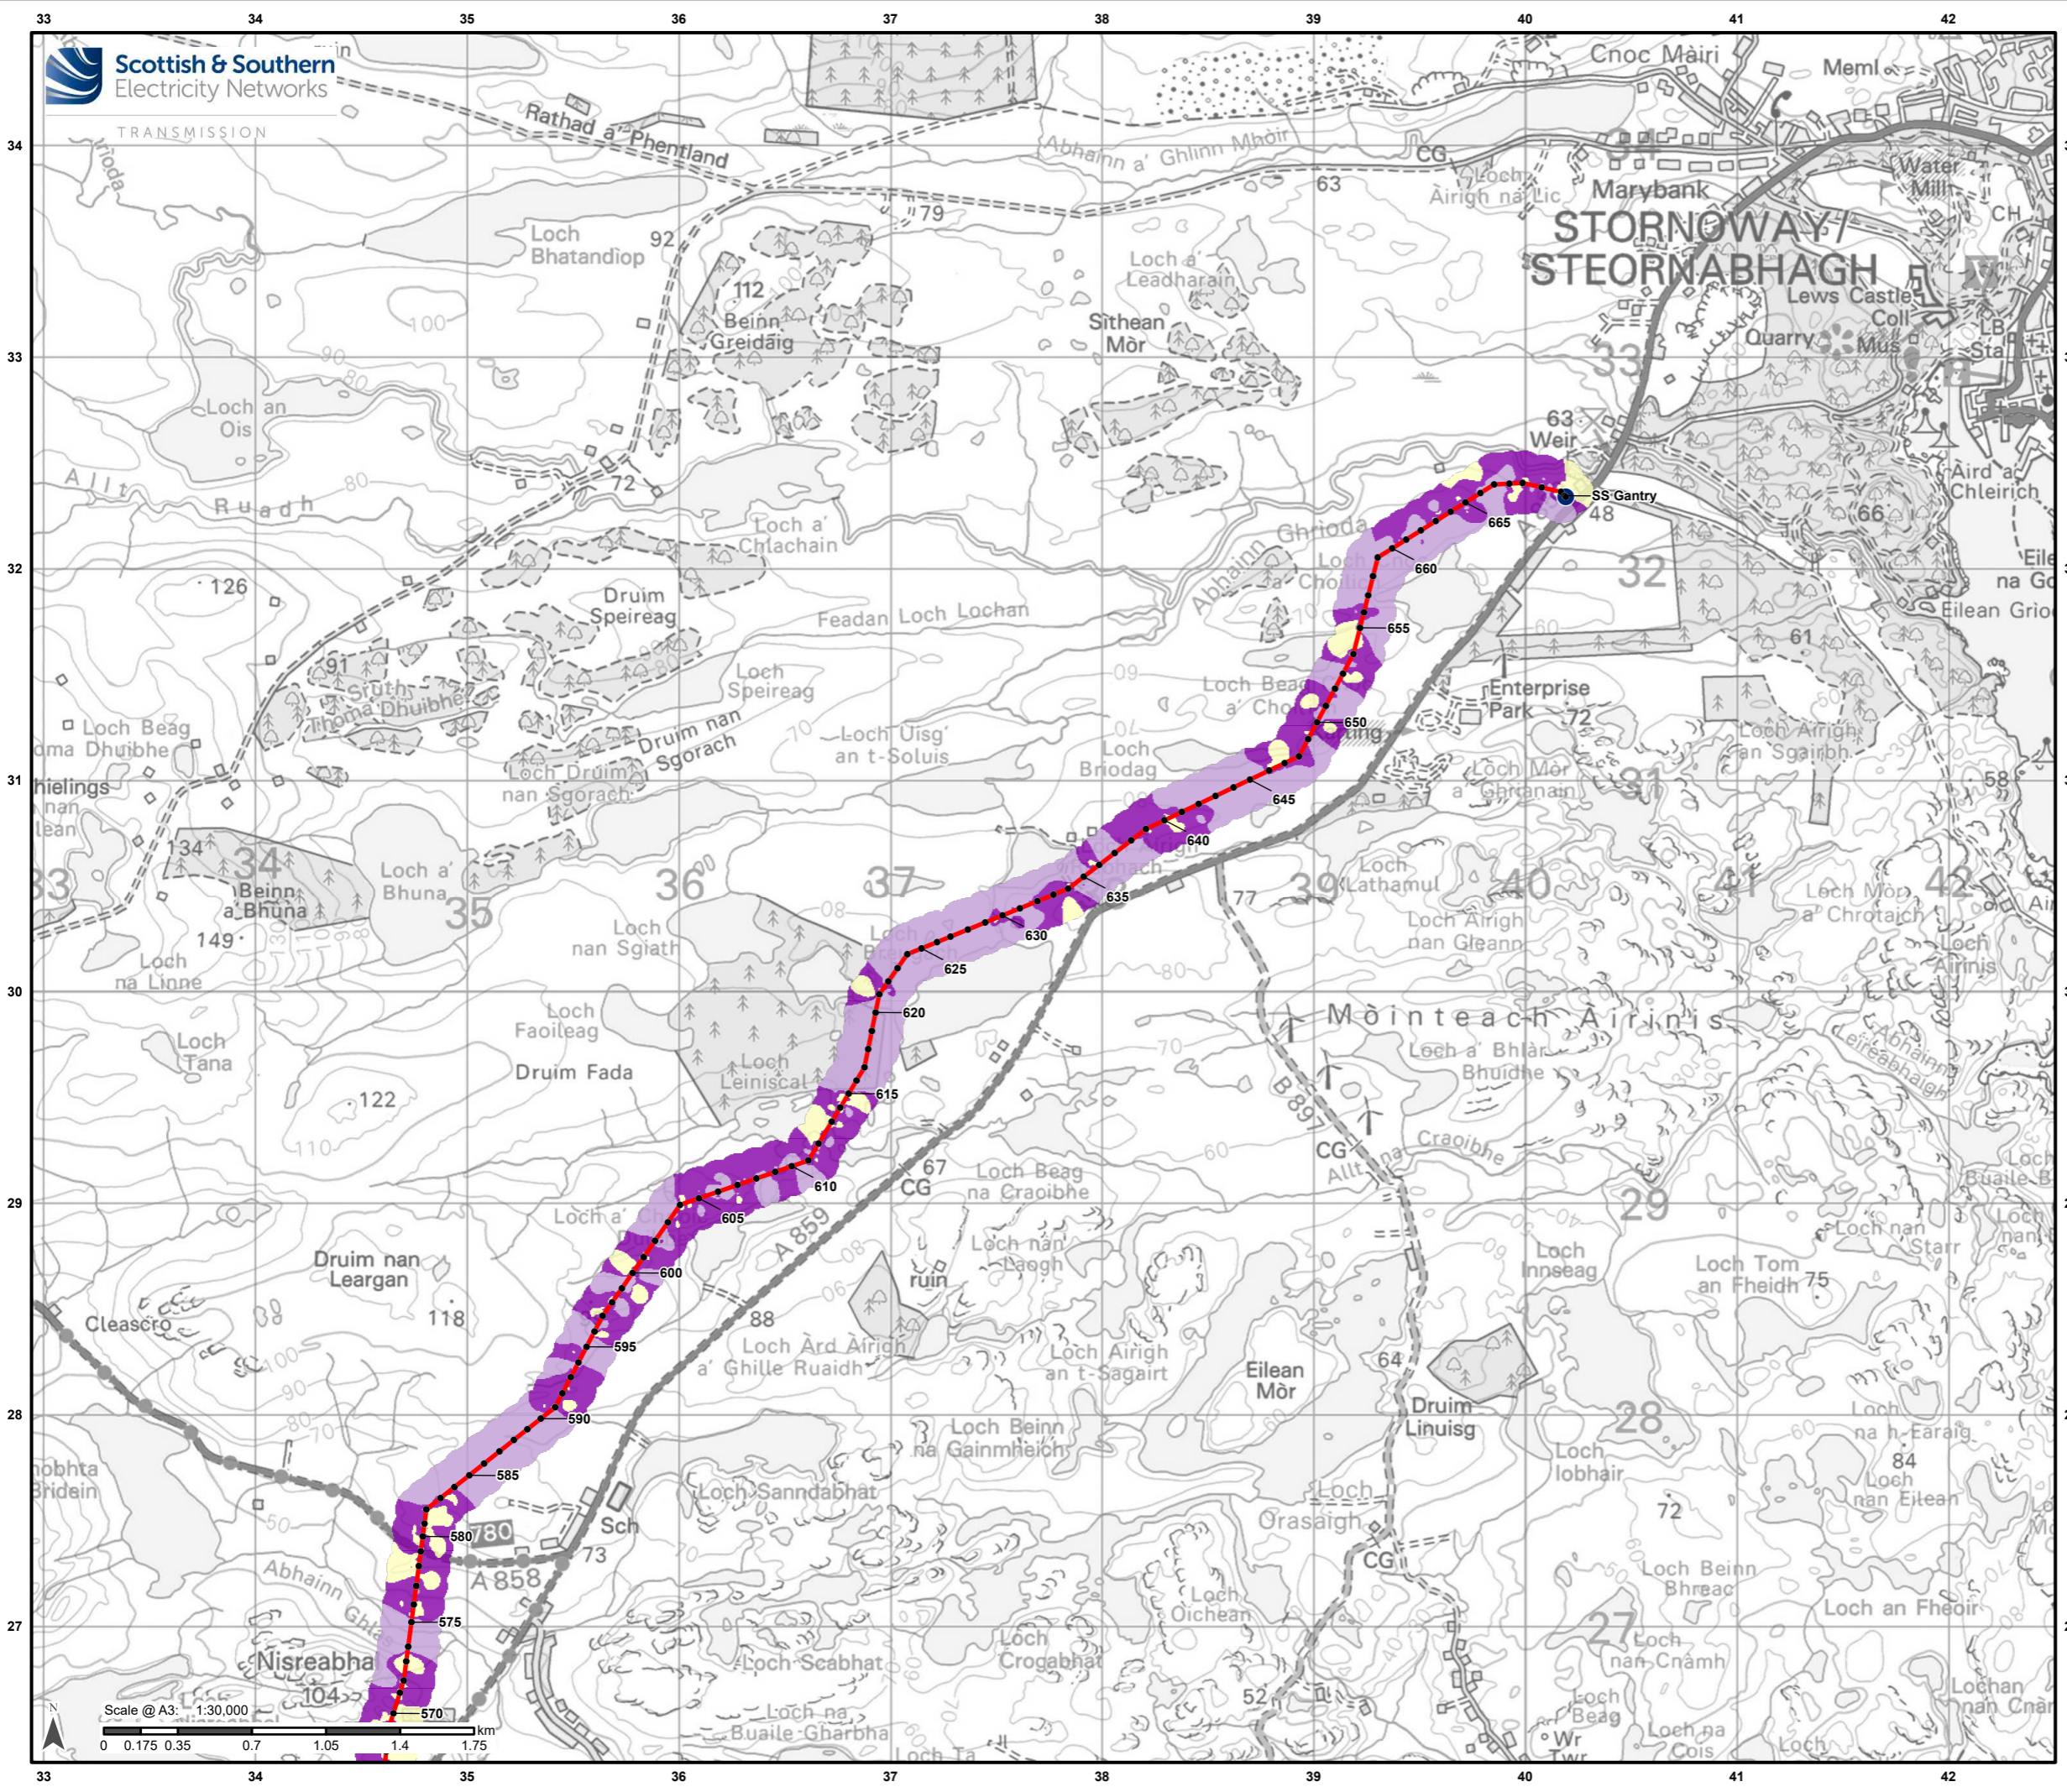


Legend

- Proposed Alignment
- Indicative Pole Location
- Stornoway Substation

Peat Depth Scores (P)

- Score 1: < 0.5 m
- Score 2: > 1.5 m
- Score 3: 0.5 - 1.5 m

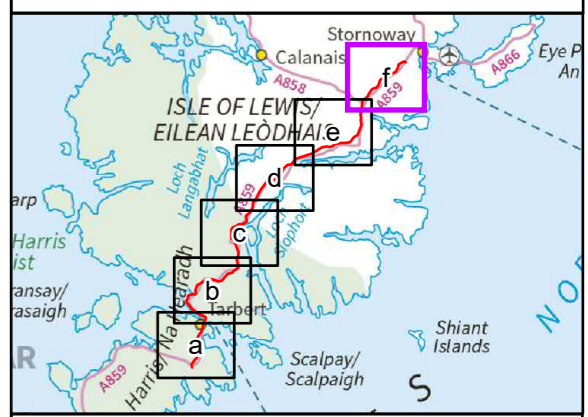

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7bvf: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Peat Depth Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7b_ContribFactPeatDepth_B

