


ANNEX A – FIGURES

Figure 10.3.7c/a - 10.3.7c/f

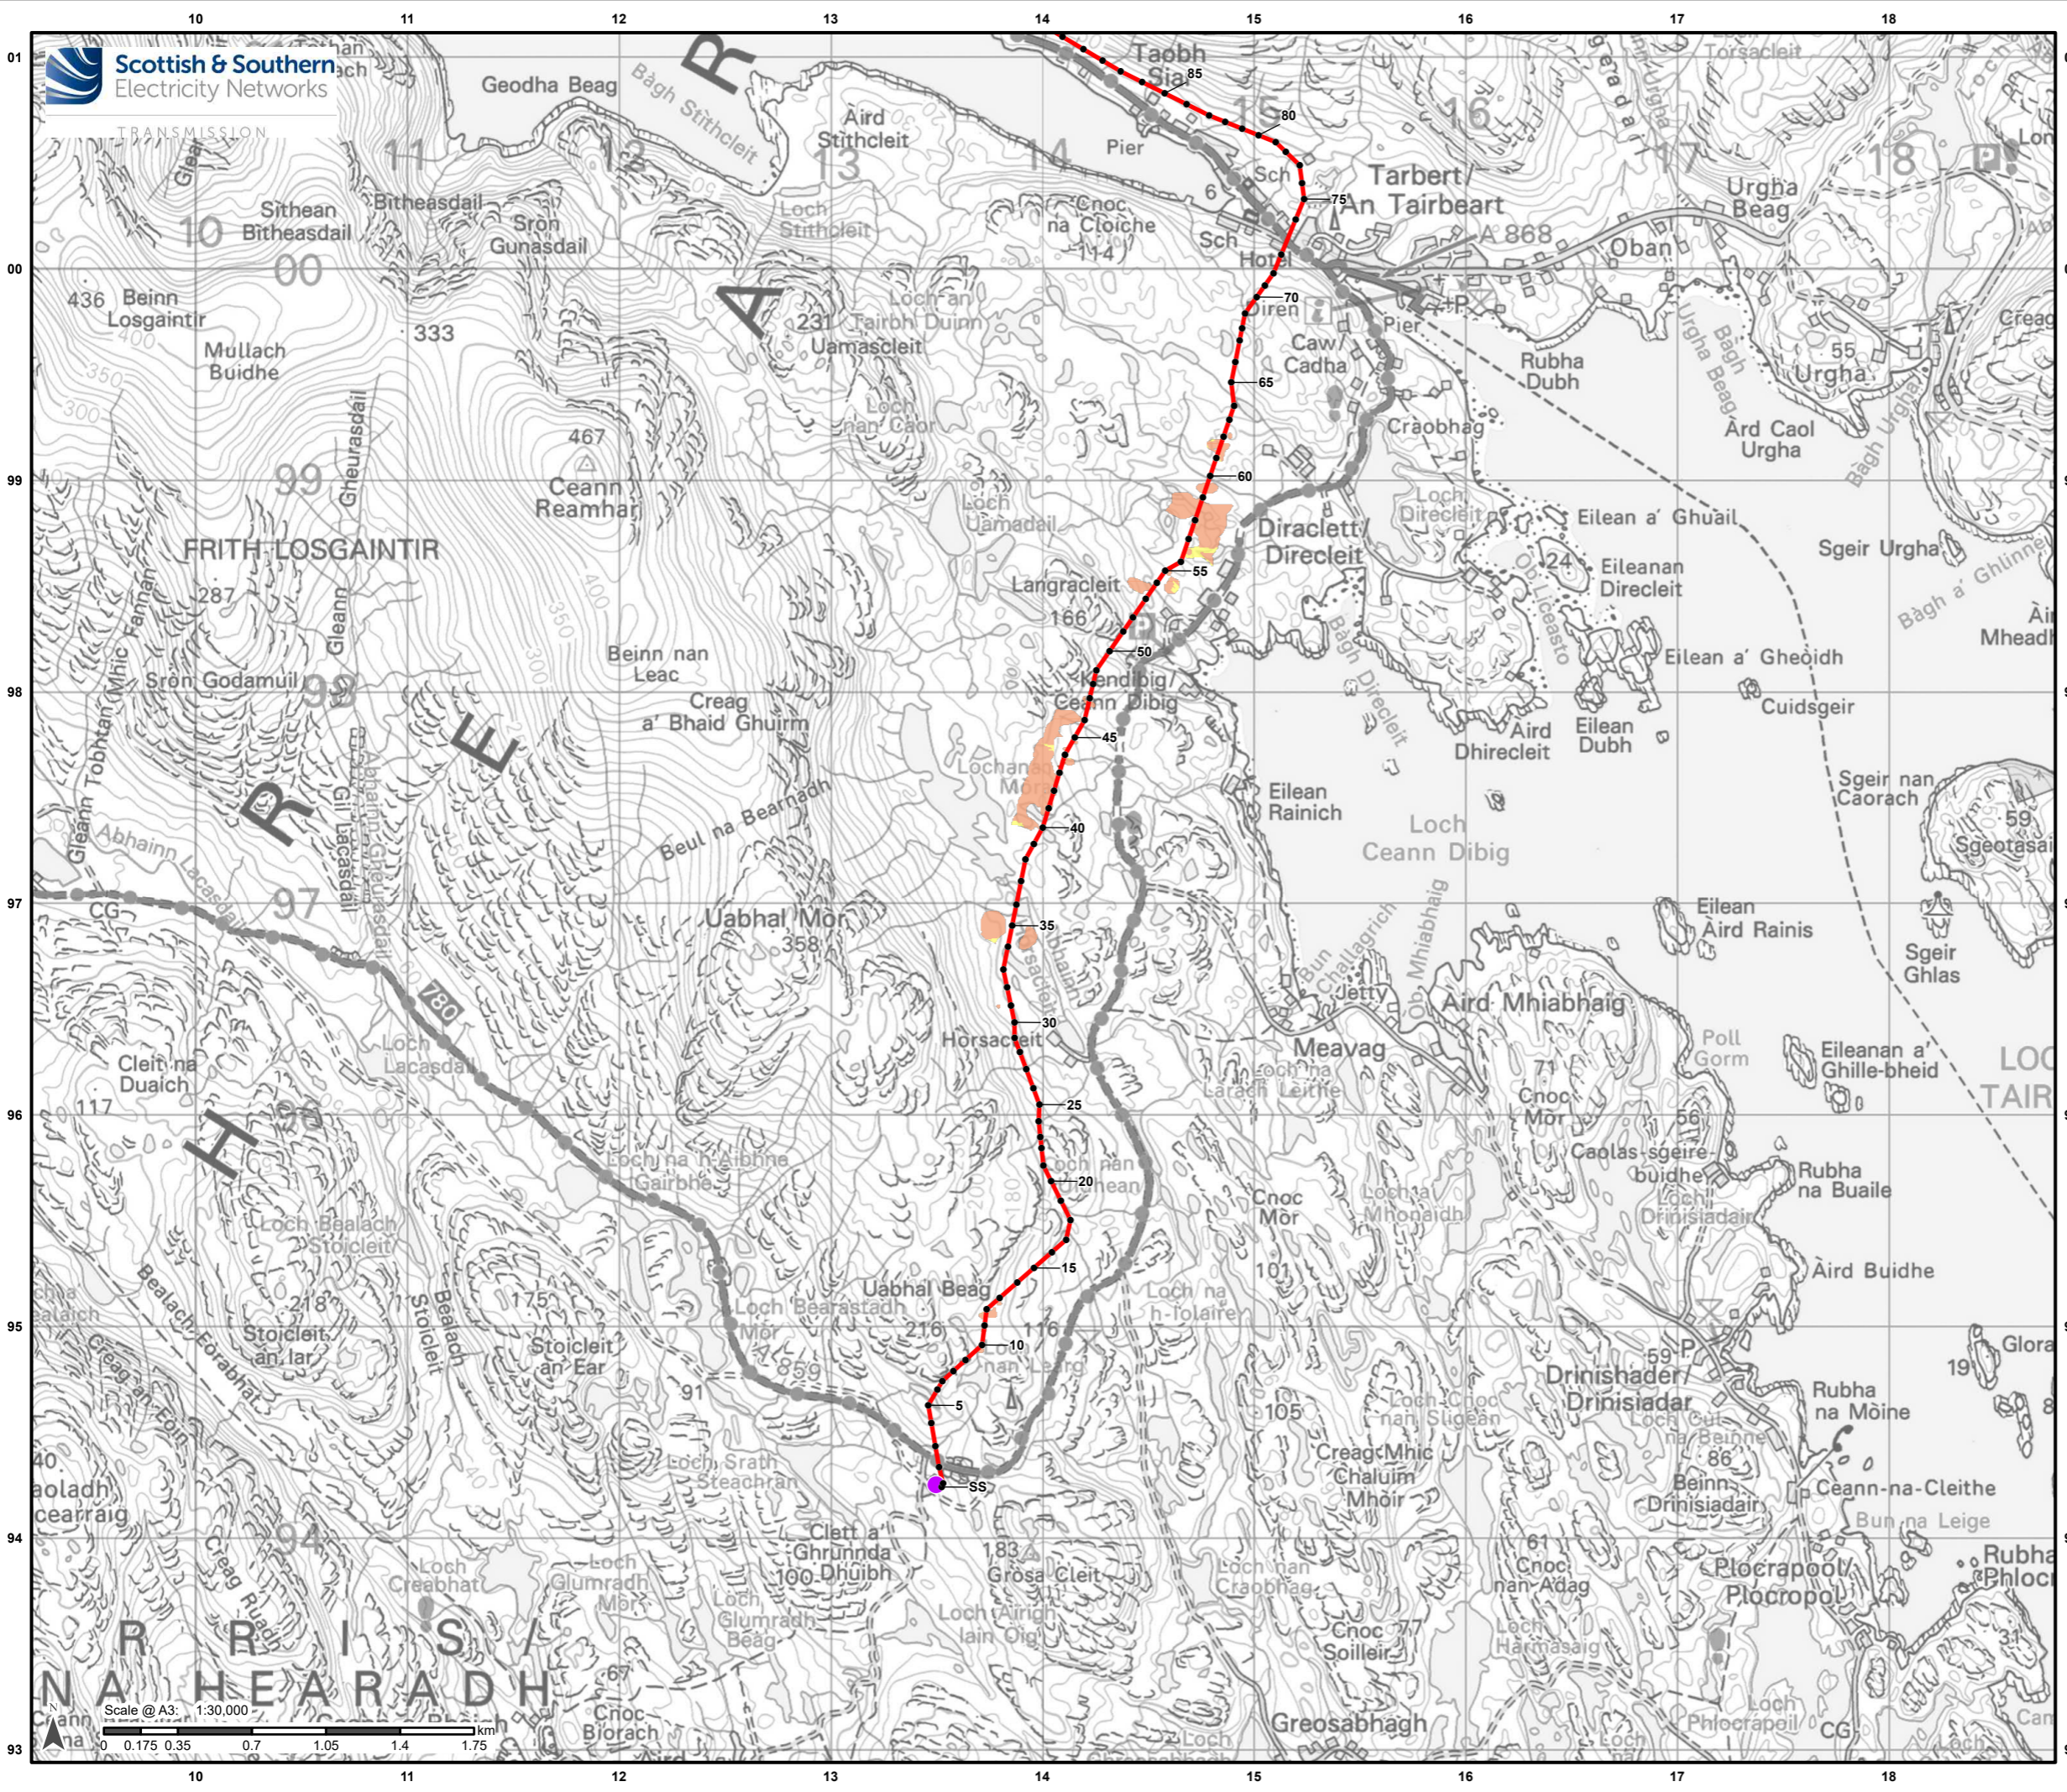


Legend

- Proposed Alignment
- Indicative Pole Location
- Harris 132kV Grid Supply Point

Substrate Geology Scores (G)

- Score 0: Permeable Bedrock
- Score 1: Impermeable Bedrock
- Score 2: Glacial Till

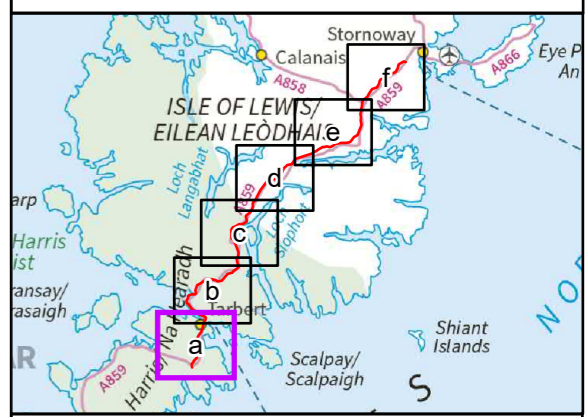


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/a:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B

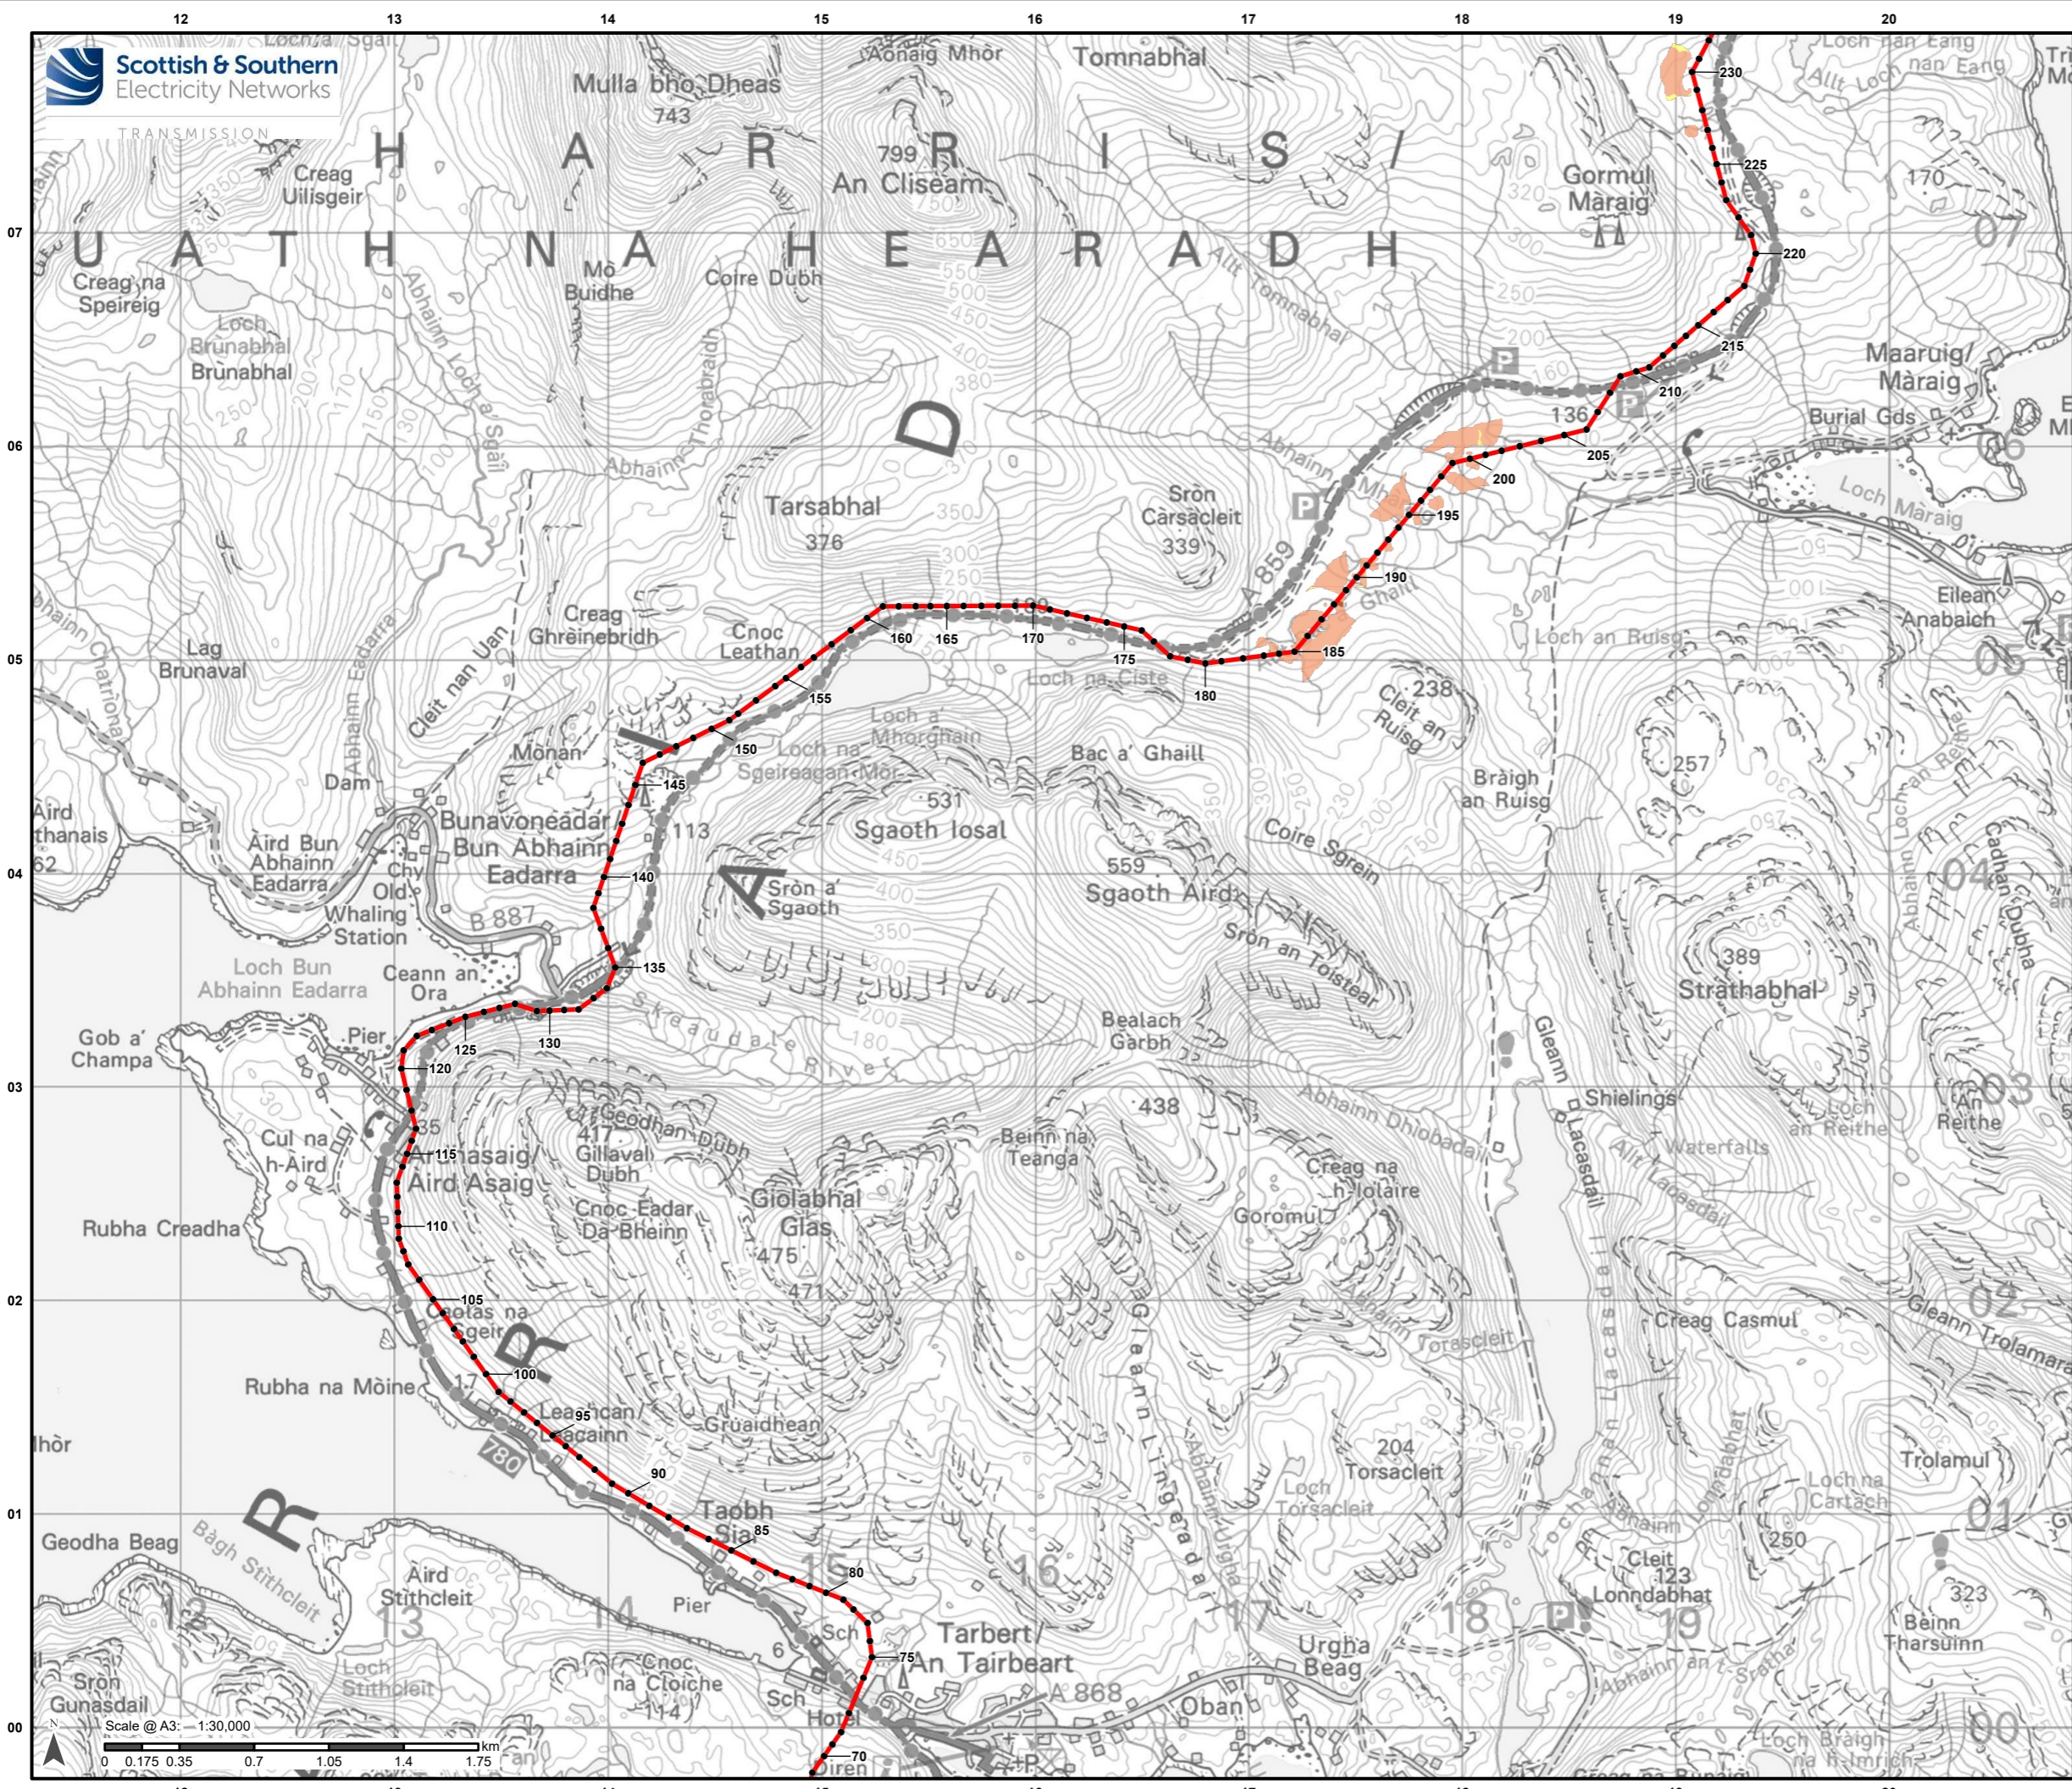


Legend

- Proposed Alignment
- Indicative Pole Location

Substrate Geology Scores (G)

- Score 0: Permeable Bedrock
- Score 1: Impermeable Bedrock
- Score 2: Glacial Till

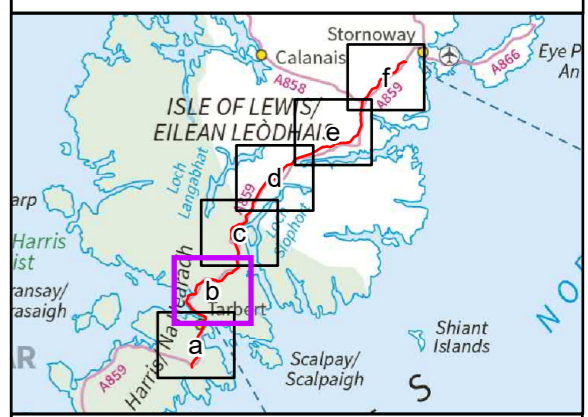


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/b:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022


Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B



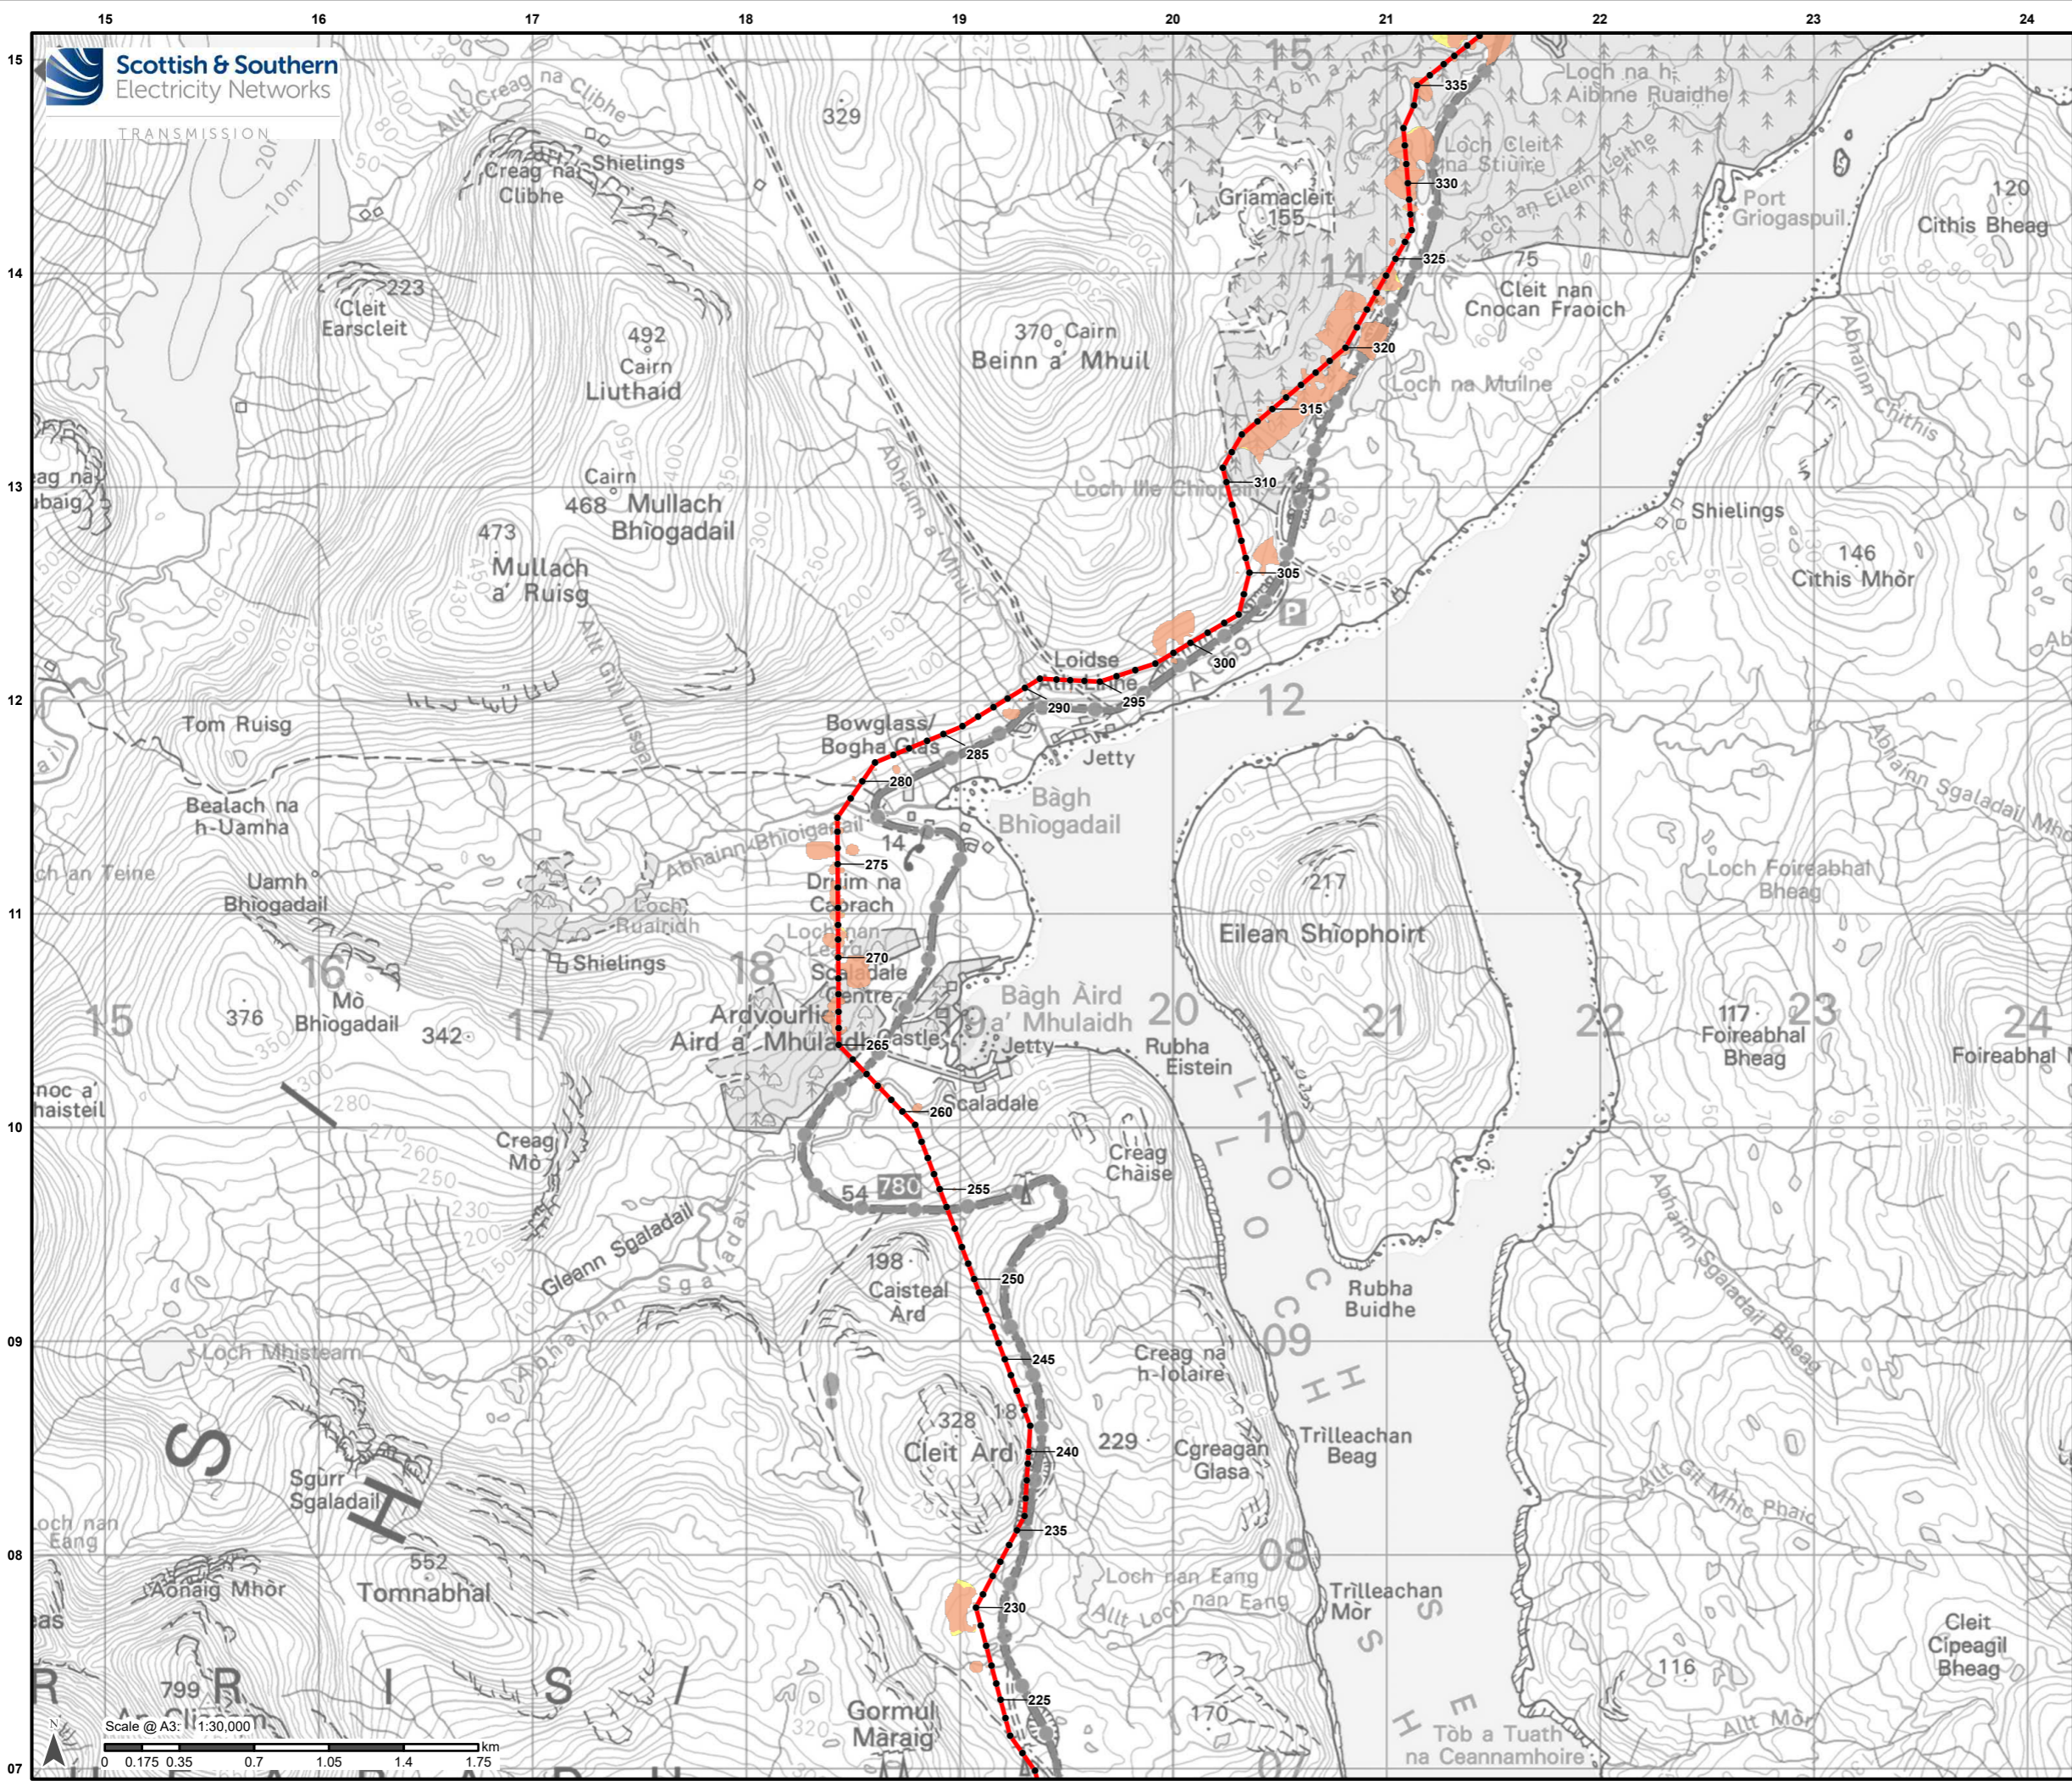

Legend

- Proposed Alignment
 - Indicative Pole Location
- Substrate Geology Scores (G)**
- Score 0: Permeable Bedrock
 - Score 1: Impermeable Bedrock
 - Score 2: Glacial Till

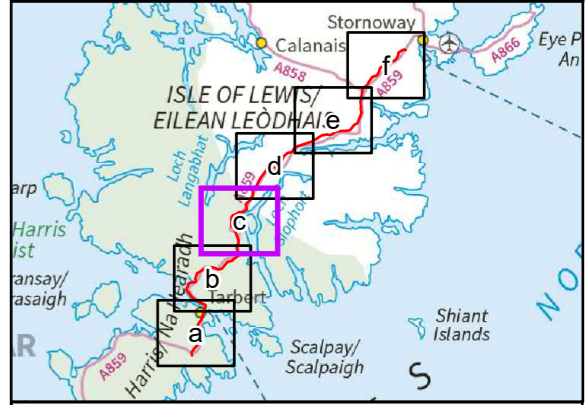

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245


Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/c:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B



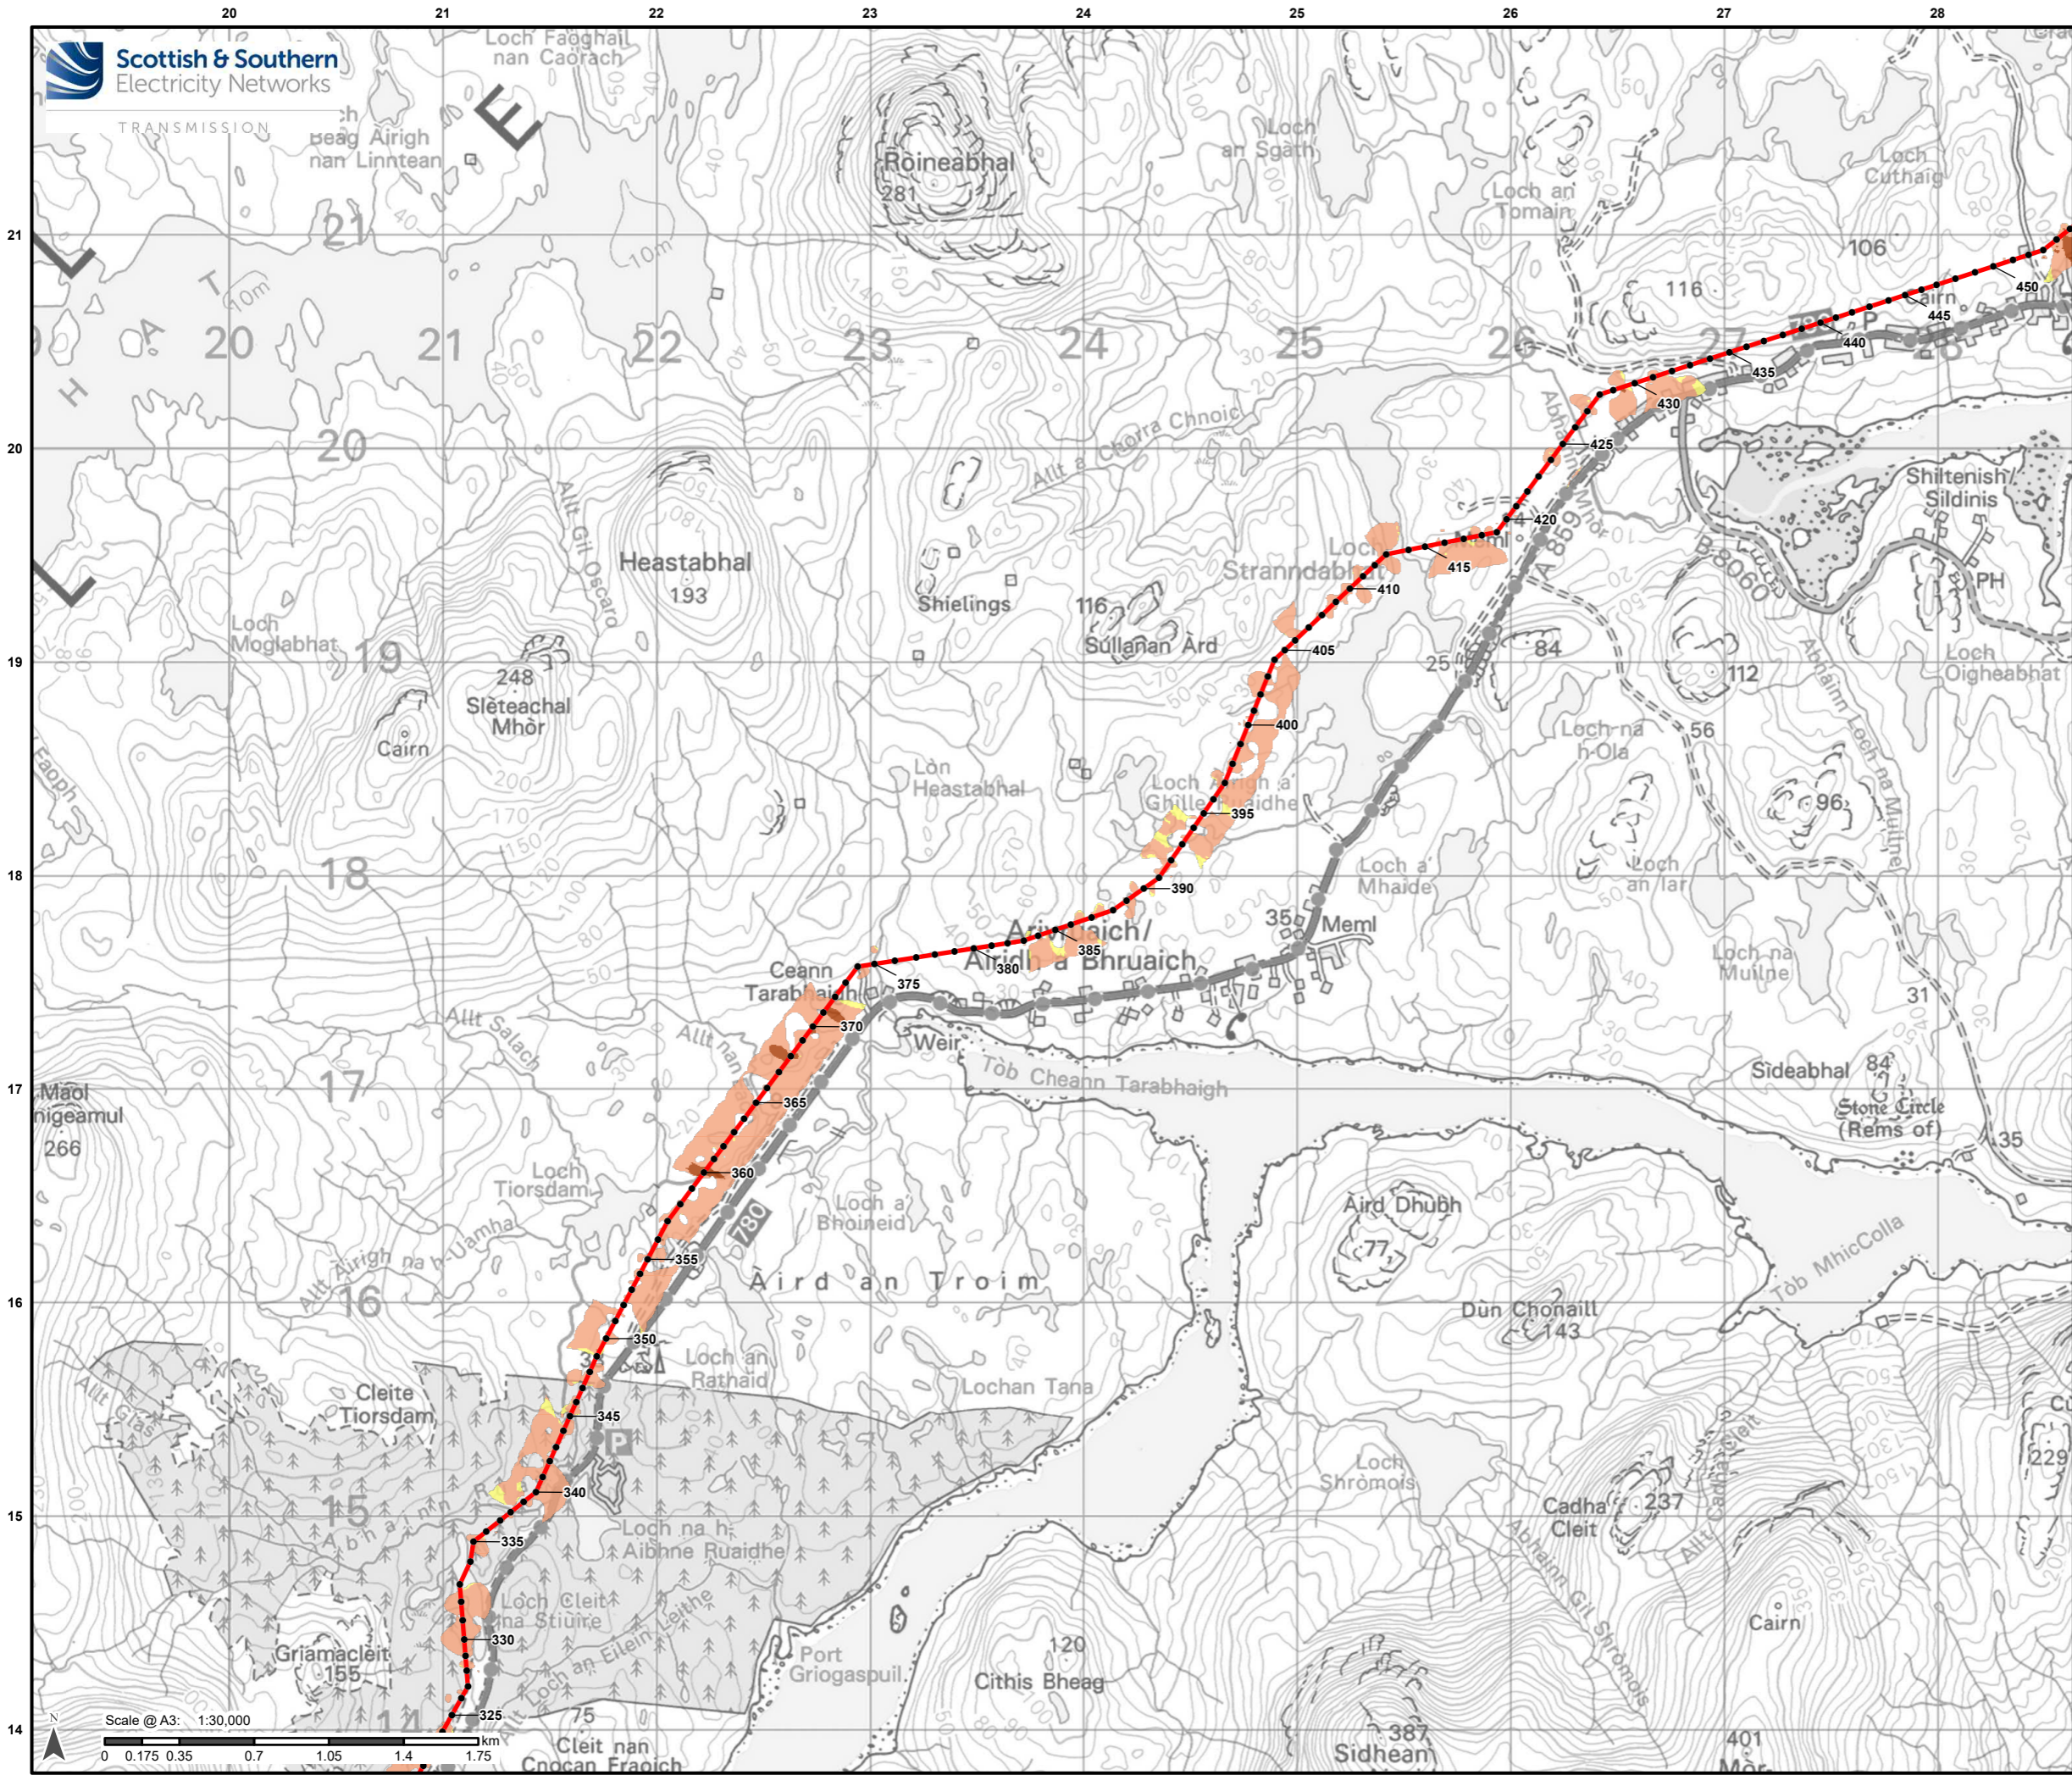


Legend

- Proposed Alignment
- Indicative Pole Location

Substrate Geology Scores (G)

- Score 0: Permeable Bedrock
- Score 1: Impermeable Bedrock
- Score 2: Glacial Till

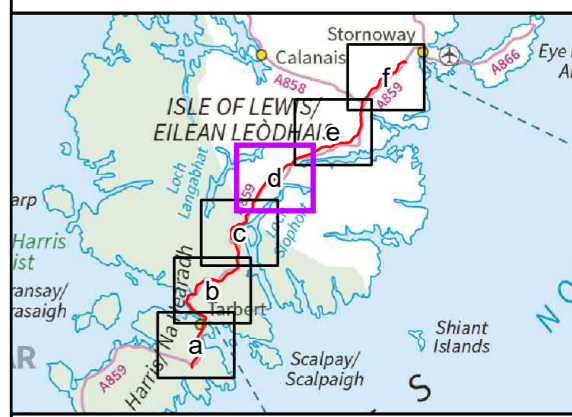


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/d:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022


Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B



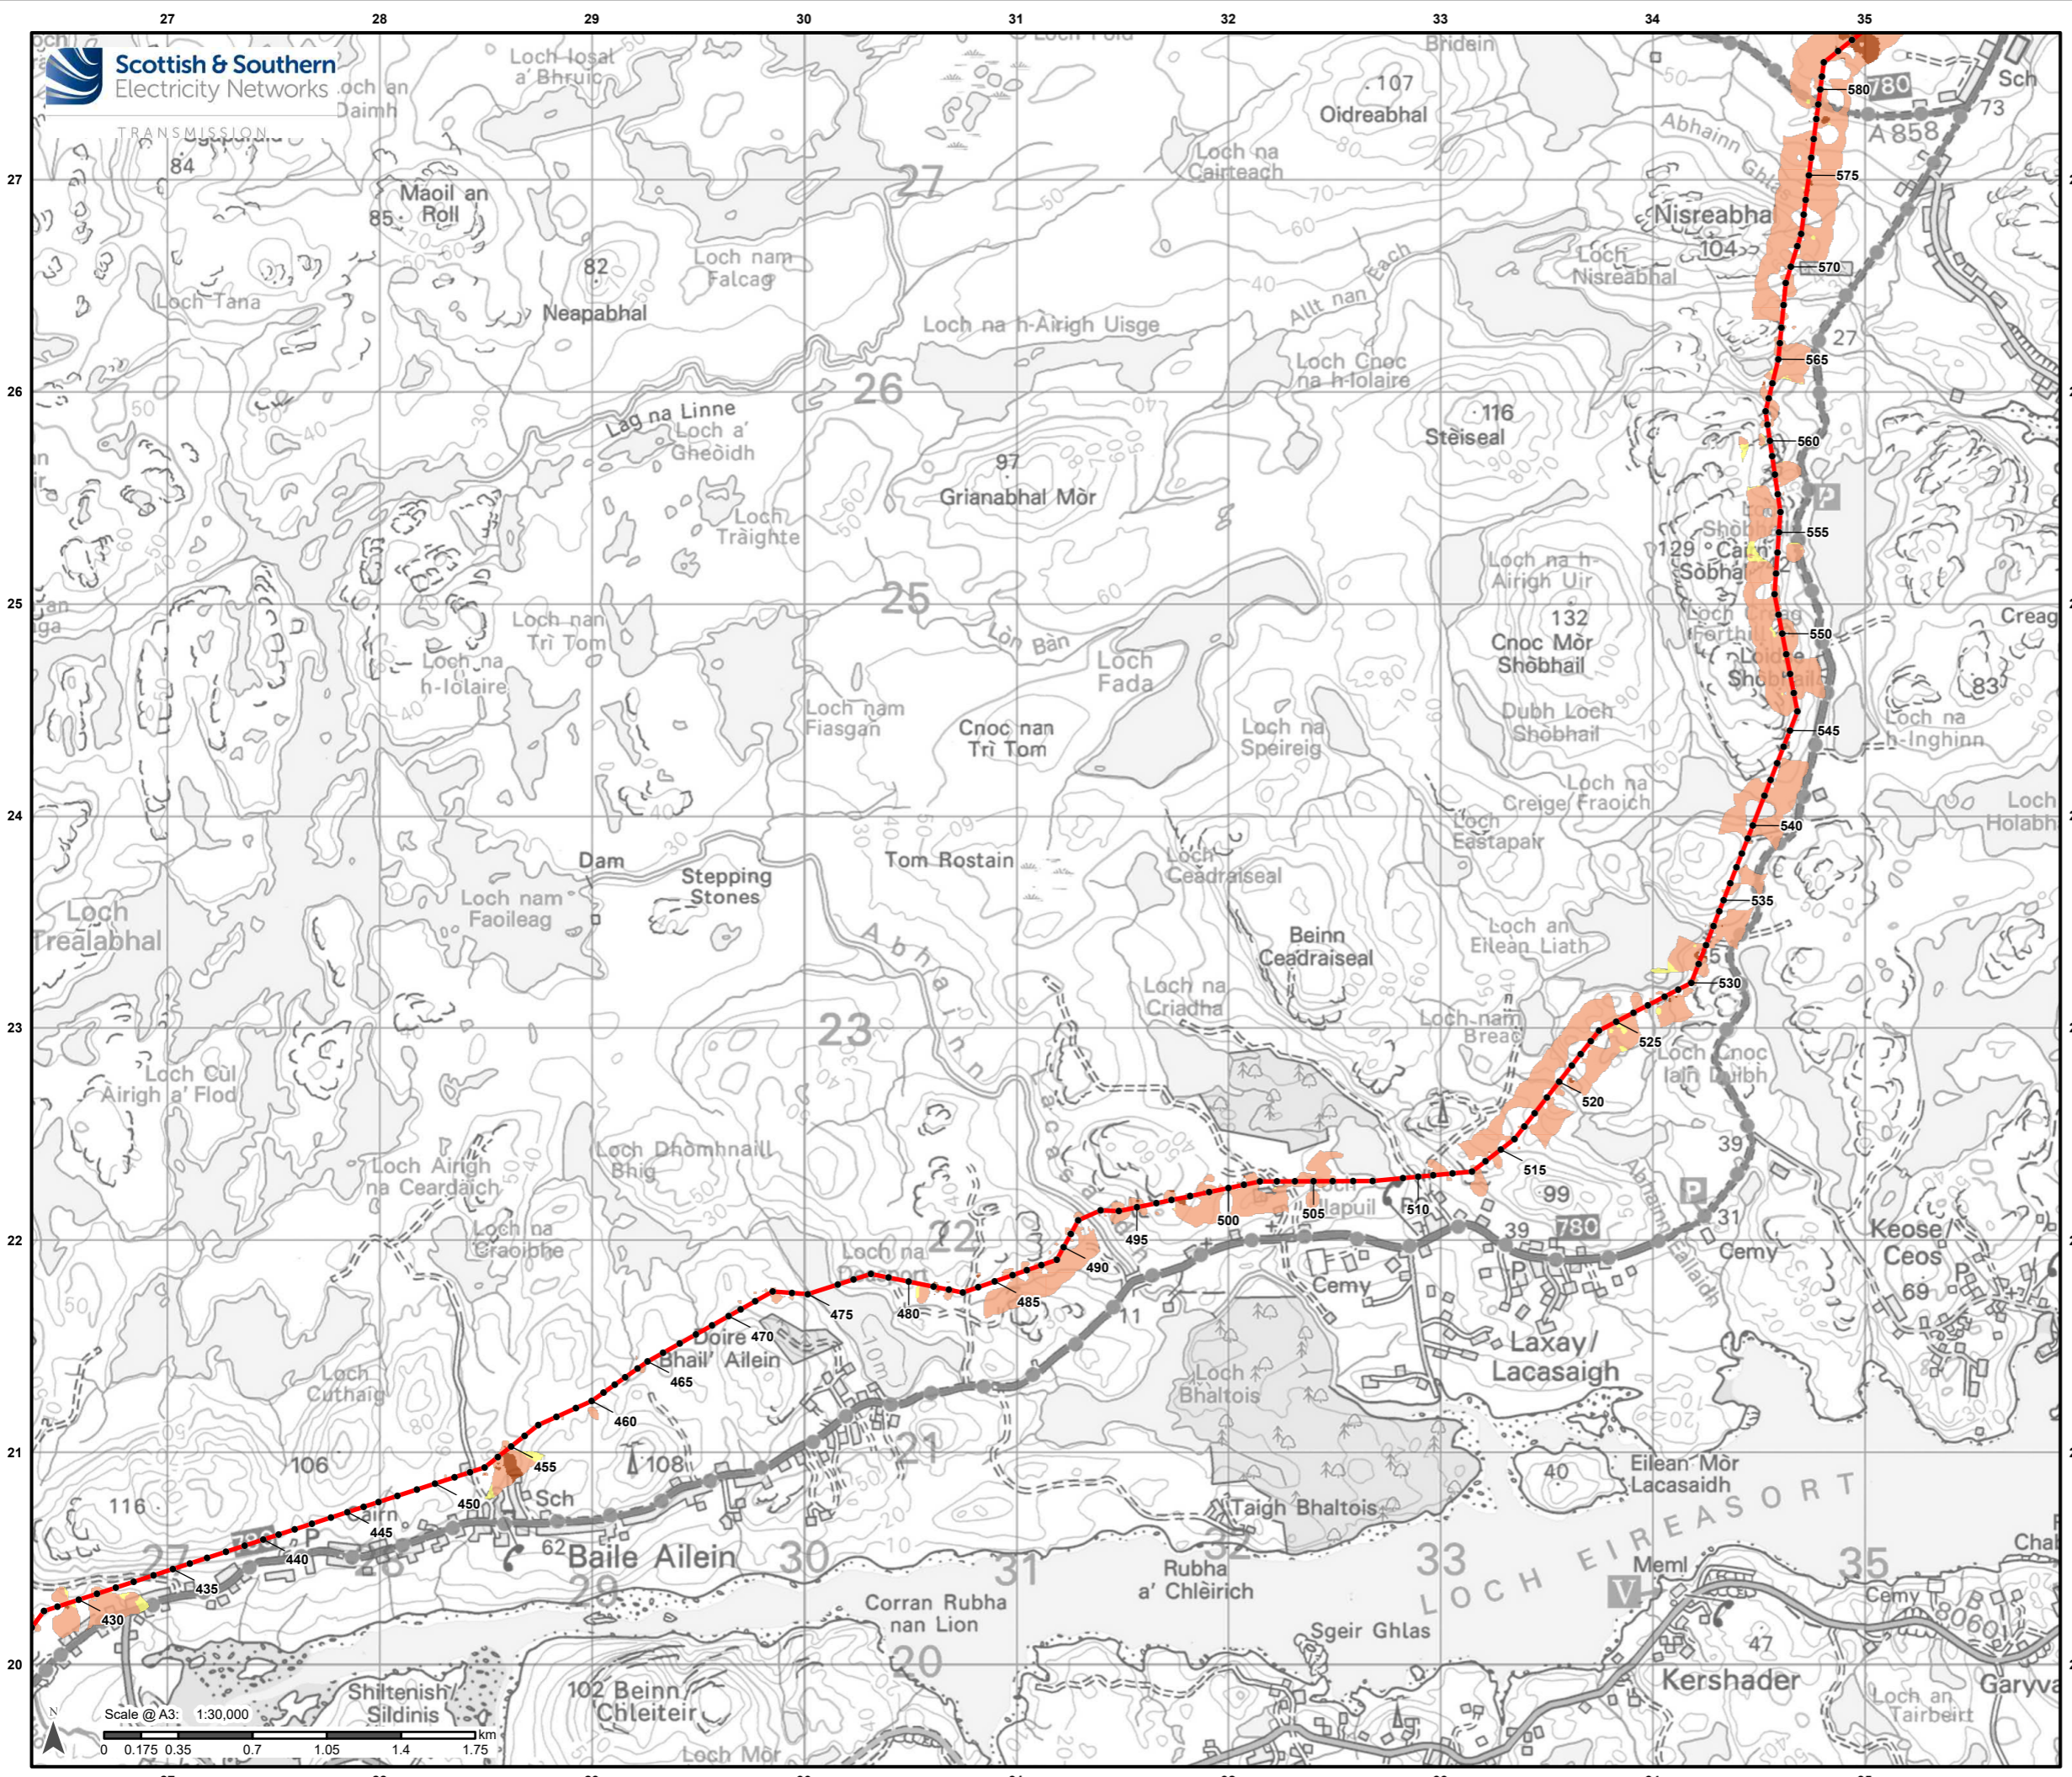

Legend

- Proposed Alignment
 - Indicative Pole Location
- Substrate Geology Scores (G)**
- Score 0: Permeable Bedrock
 - Score 1: Impermeable Bedrock
 - Score 2: Glacial Till

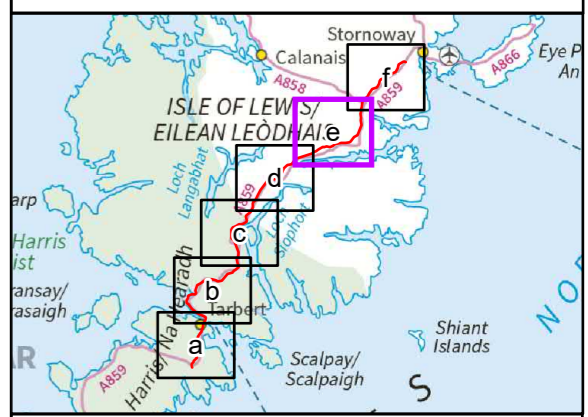

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245

Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/e: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B

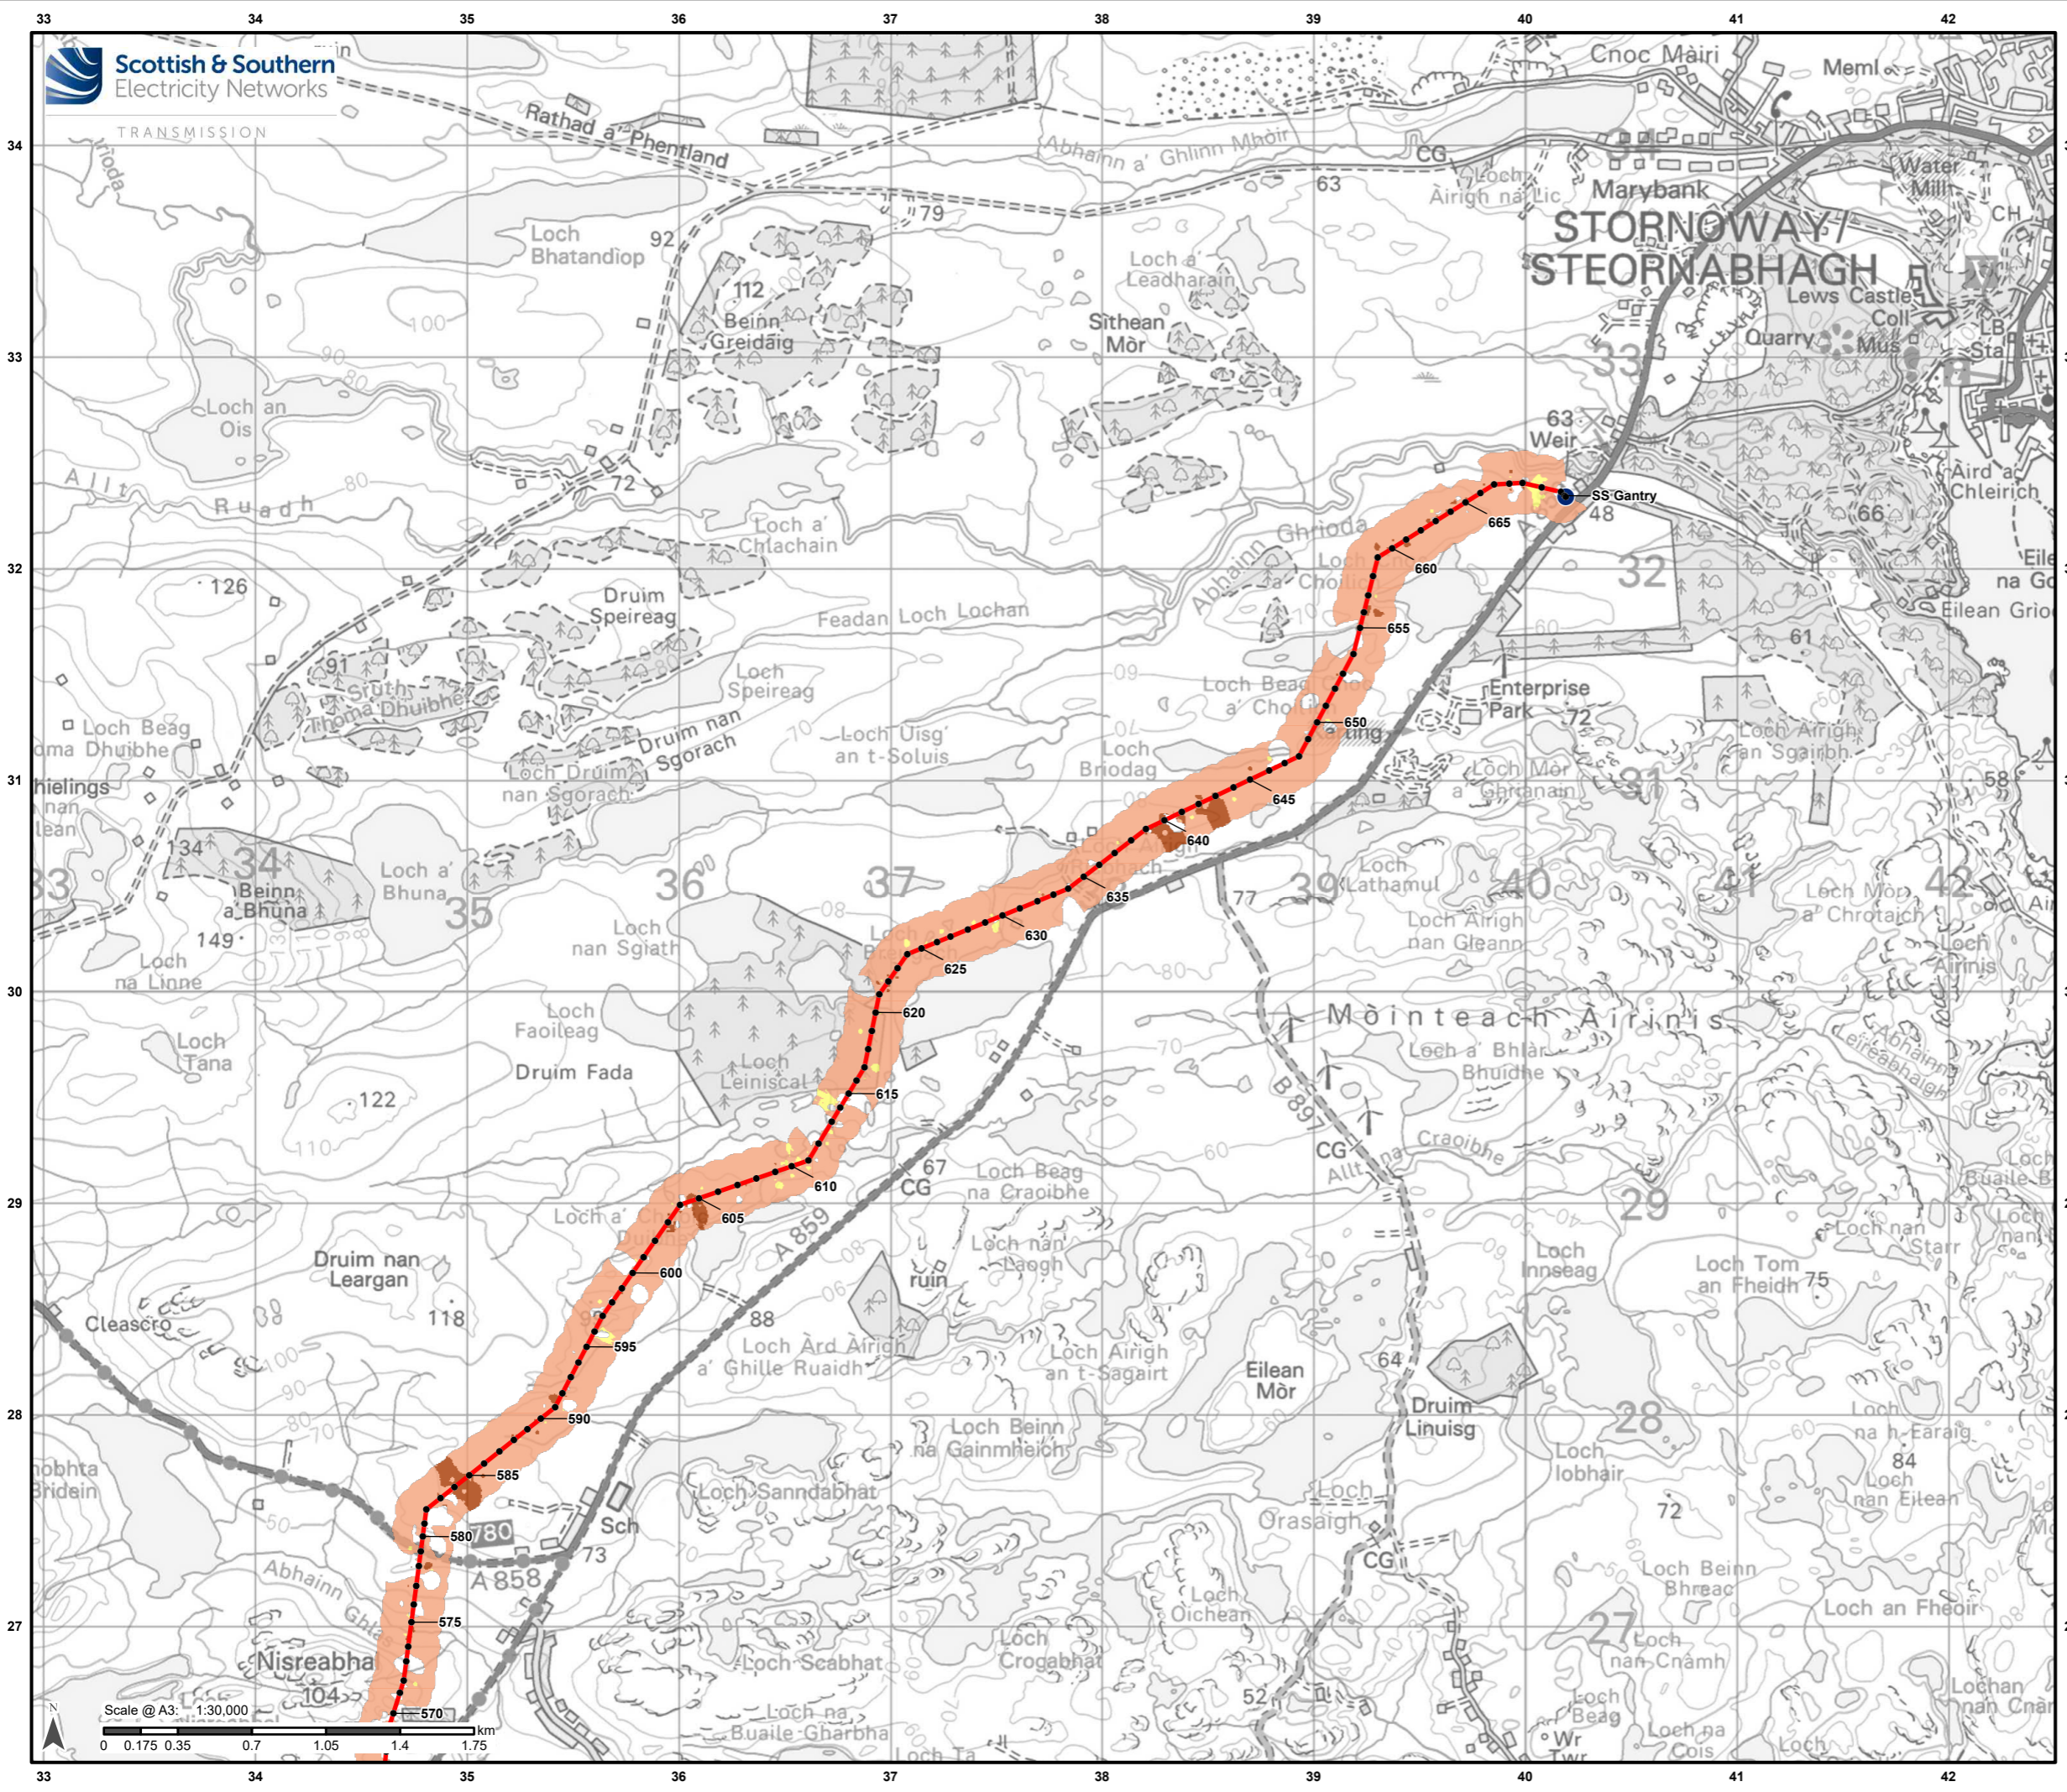


Legend

- Proposed Alignment
- Indicative Pole Location
- Stornoway Substation

Substrate Geology Scores (G)

- Score 0: Permeable Bedrock
- Score 1: Impermeable Bedrock
- Score 2: Glacial Till

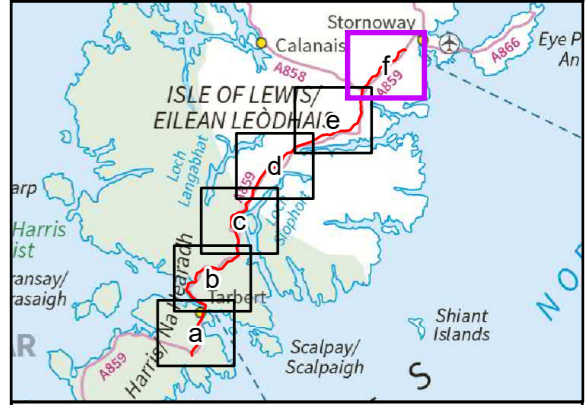

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7c/f: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Substrate Geology Score

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-7c_ContribFactSubstrateGeo_B