


## **ANNEX A – FIGURES**

### **Figure 10.3.7fa- 10.3.7ff**

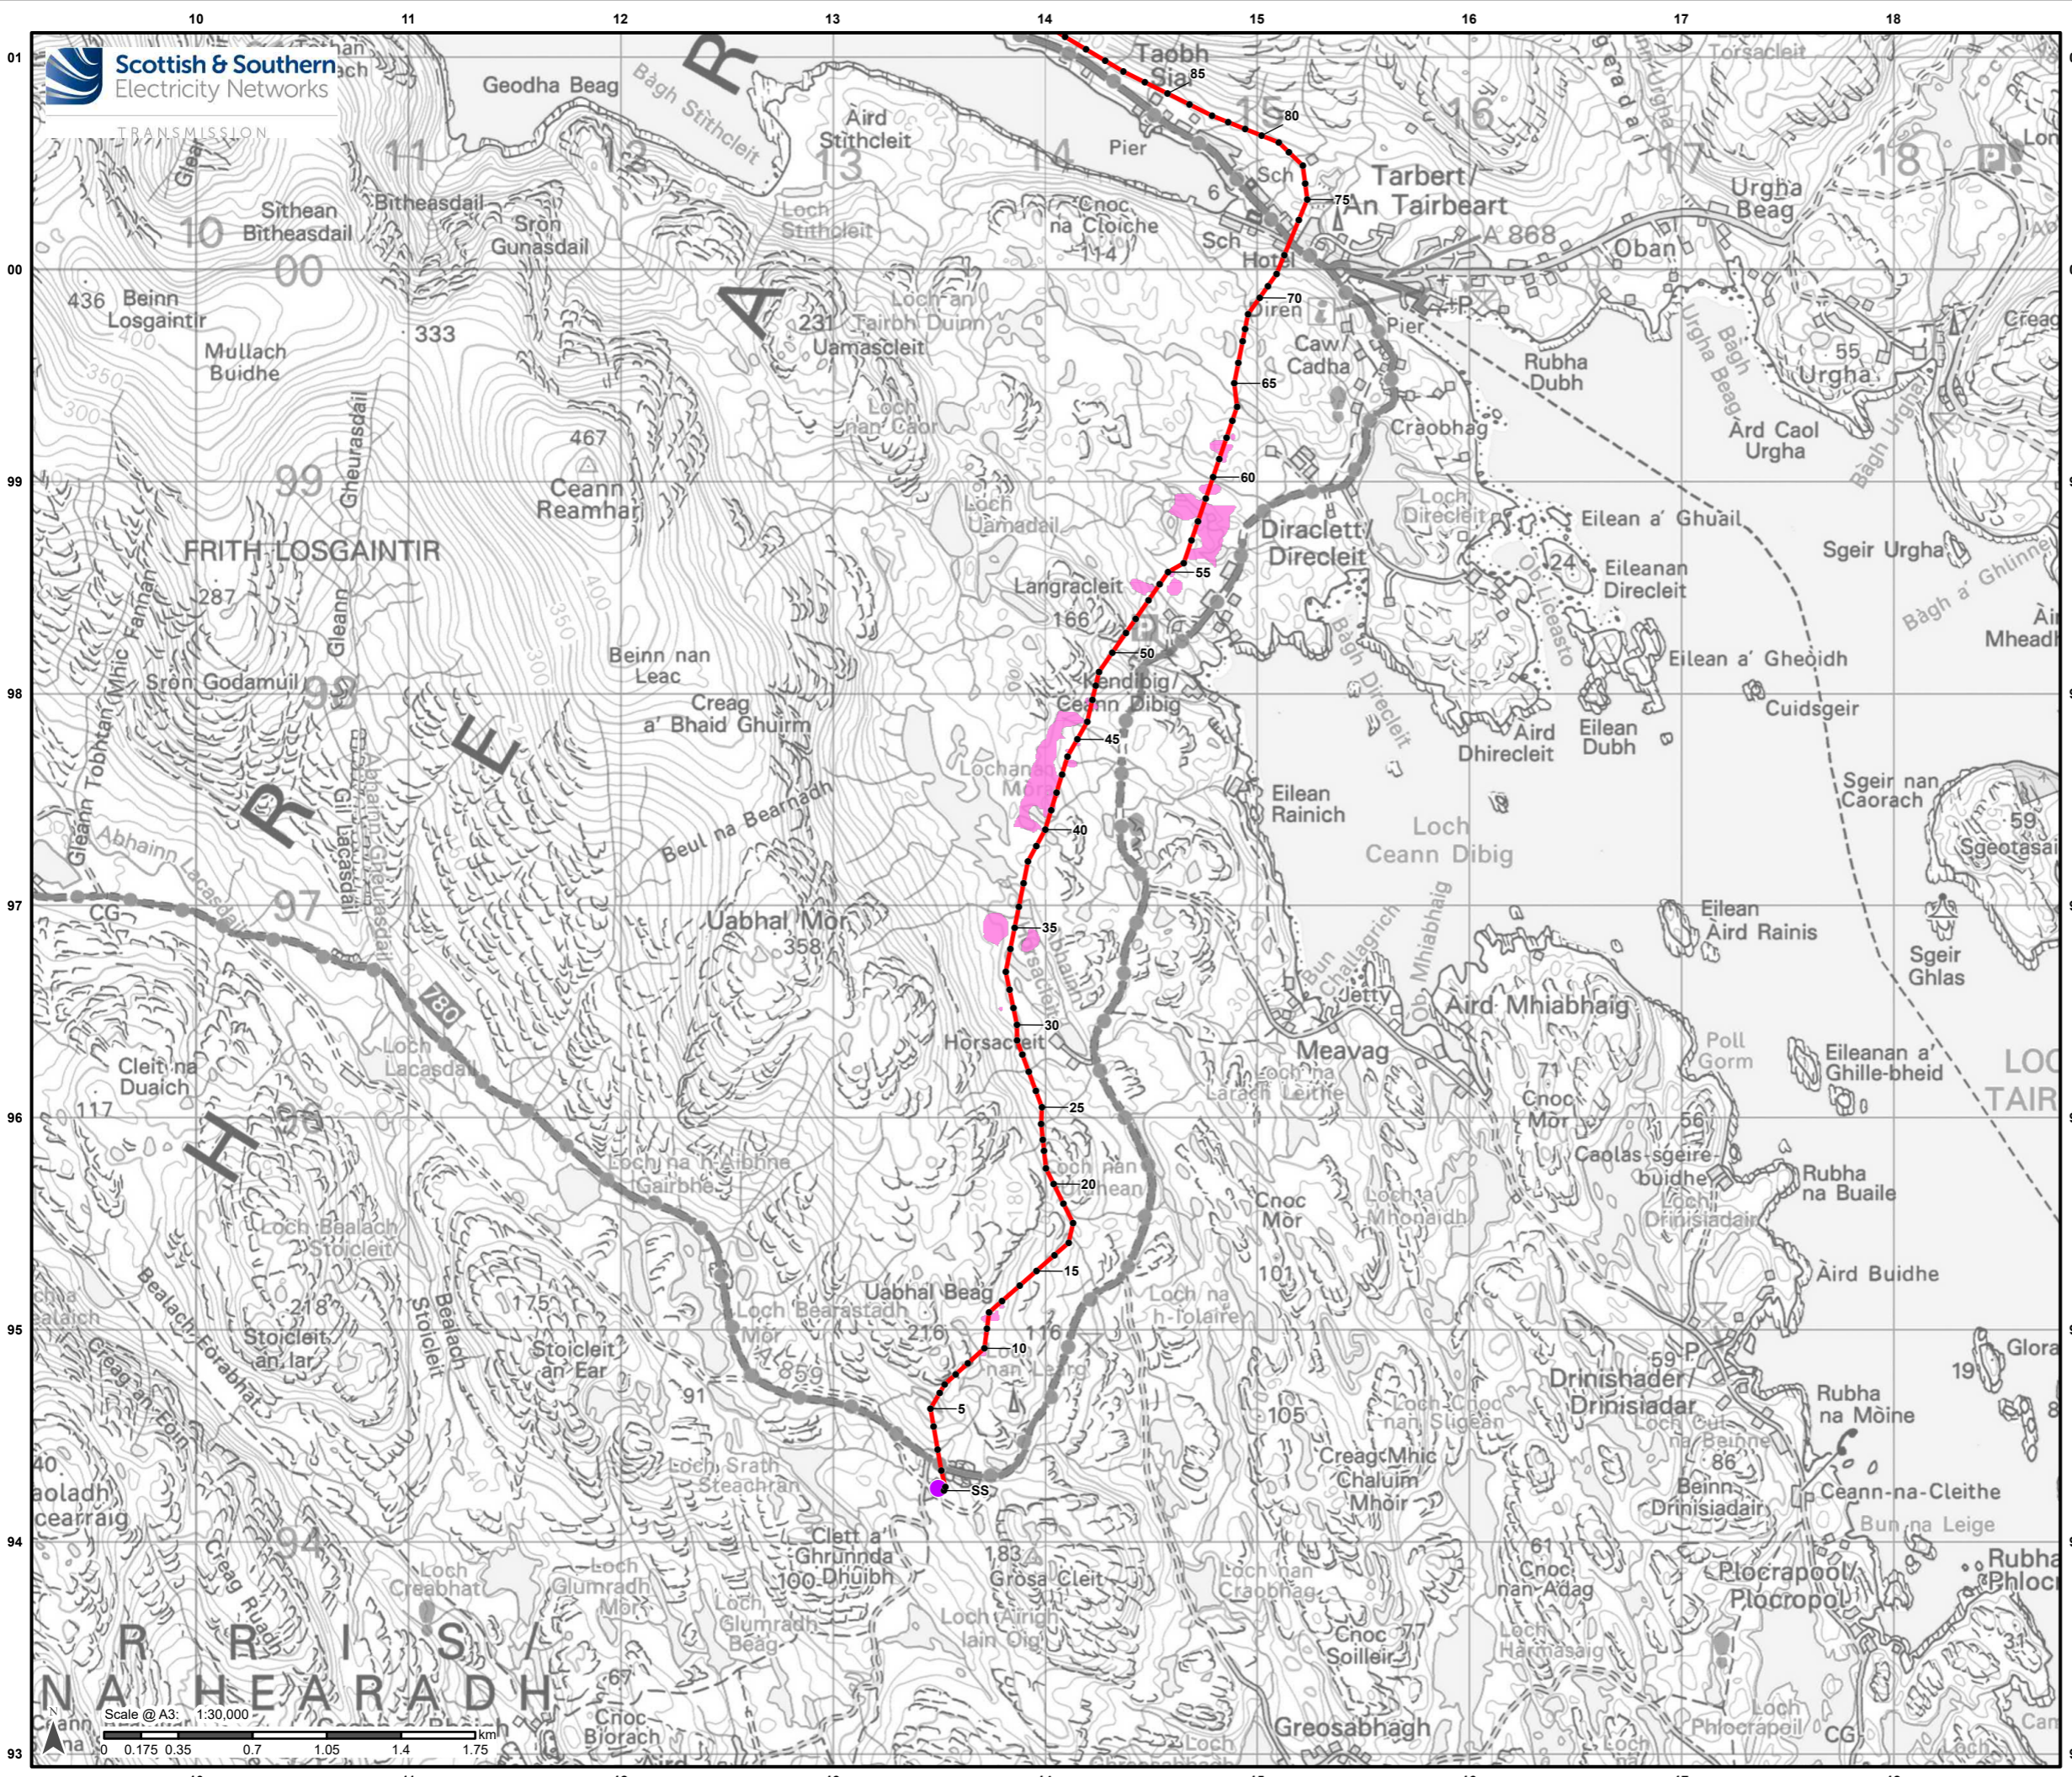


**Legend**

- Proposed Alignment
- Indicative Pole Location
- Harris 132kV Grid Supply Point

**Forestry Scores (F)**

- Score 0: Not afforested

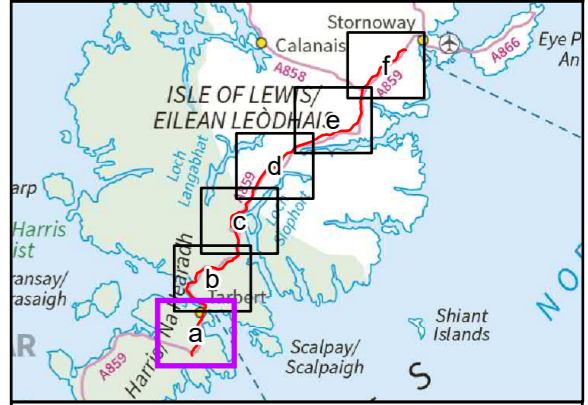


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7f/a:  
Peat Landslide Hazard and Risk Assessment:  
Contributing Factor - Forestry Score

Drawn by: AB Date: 01/09/2022

Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B

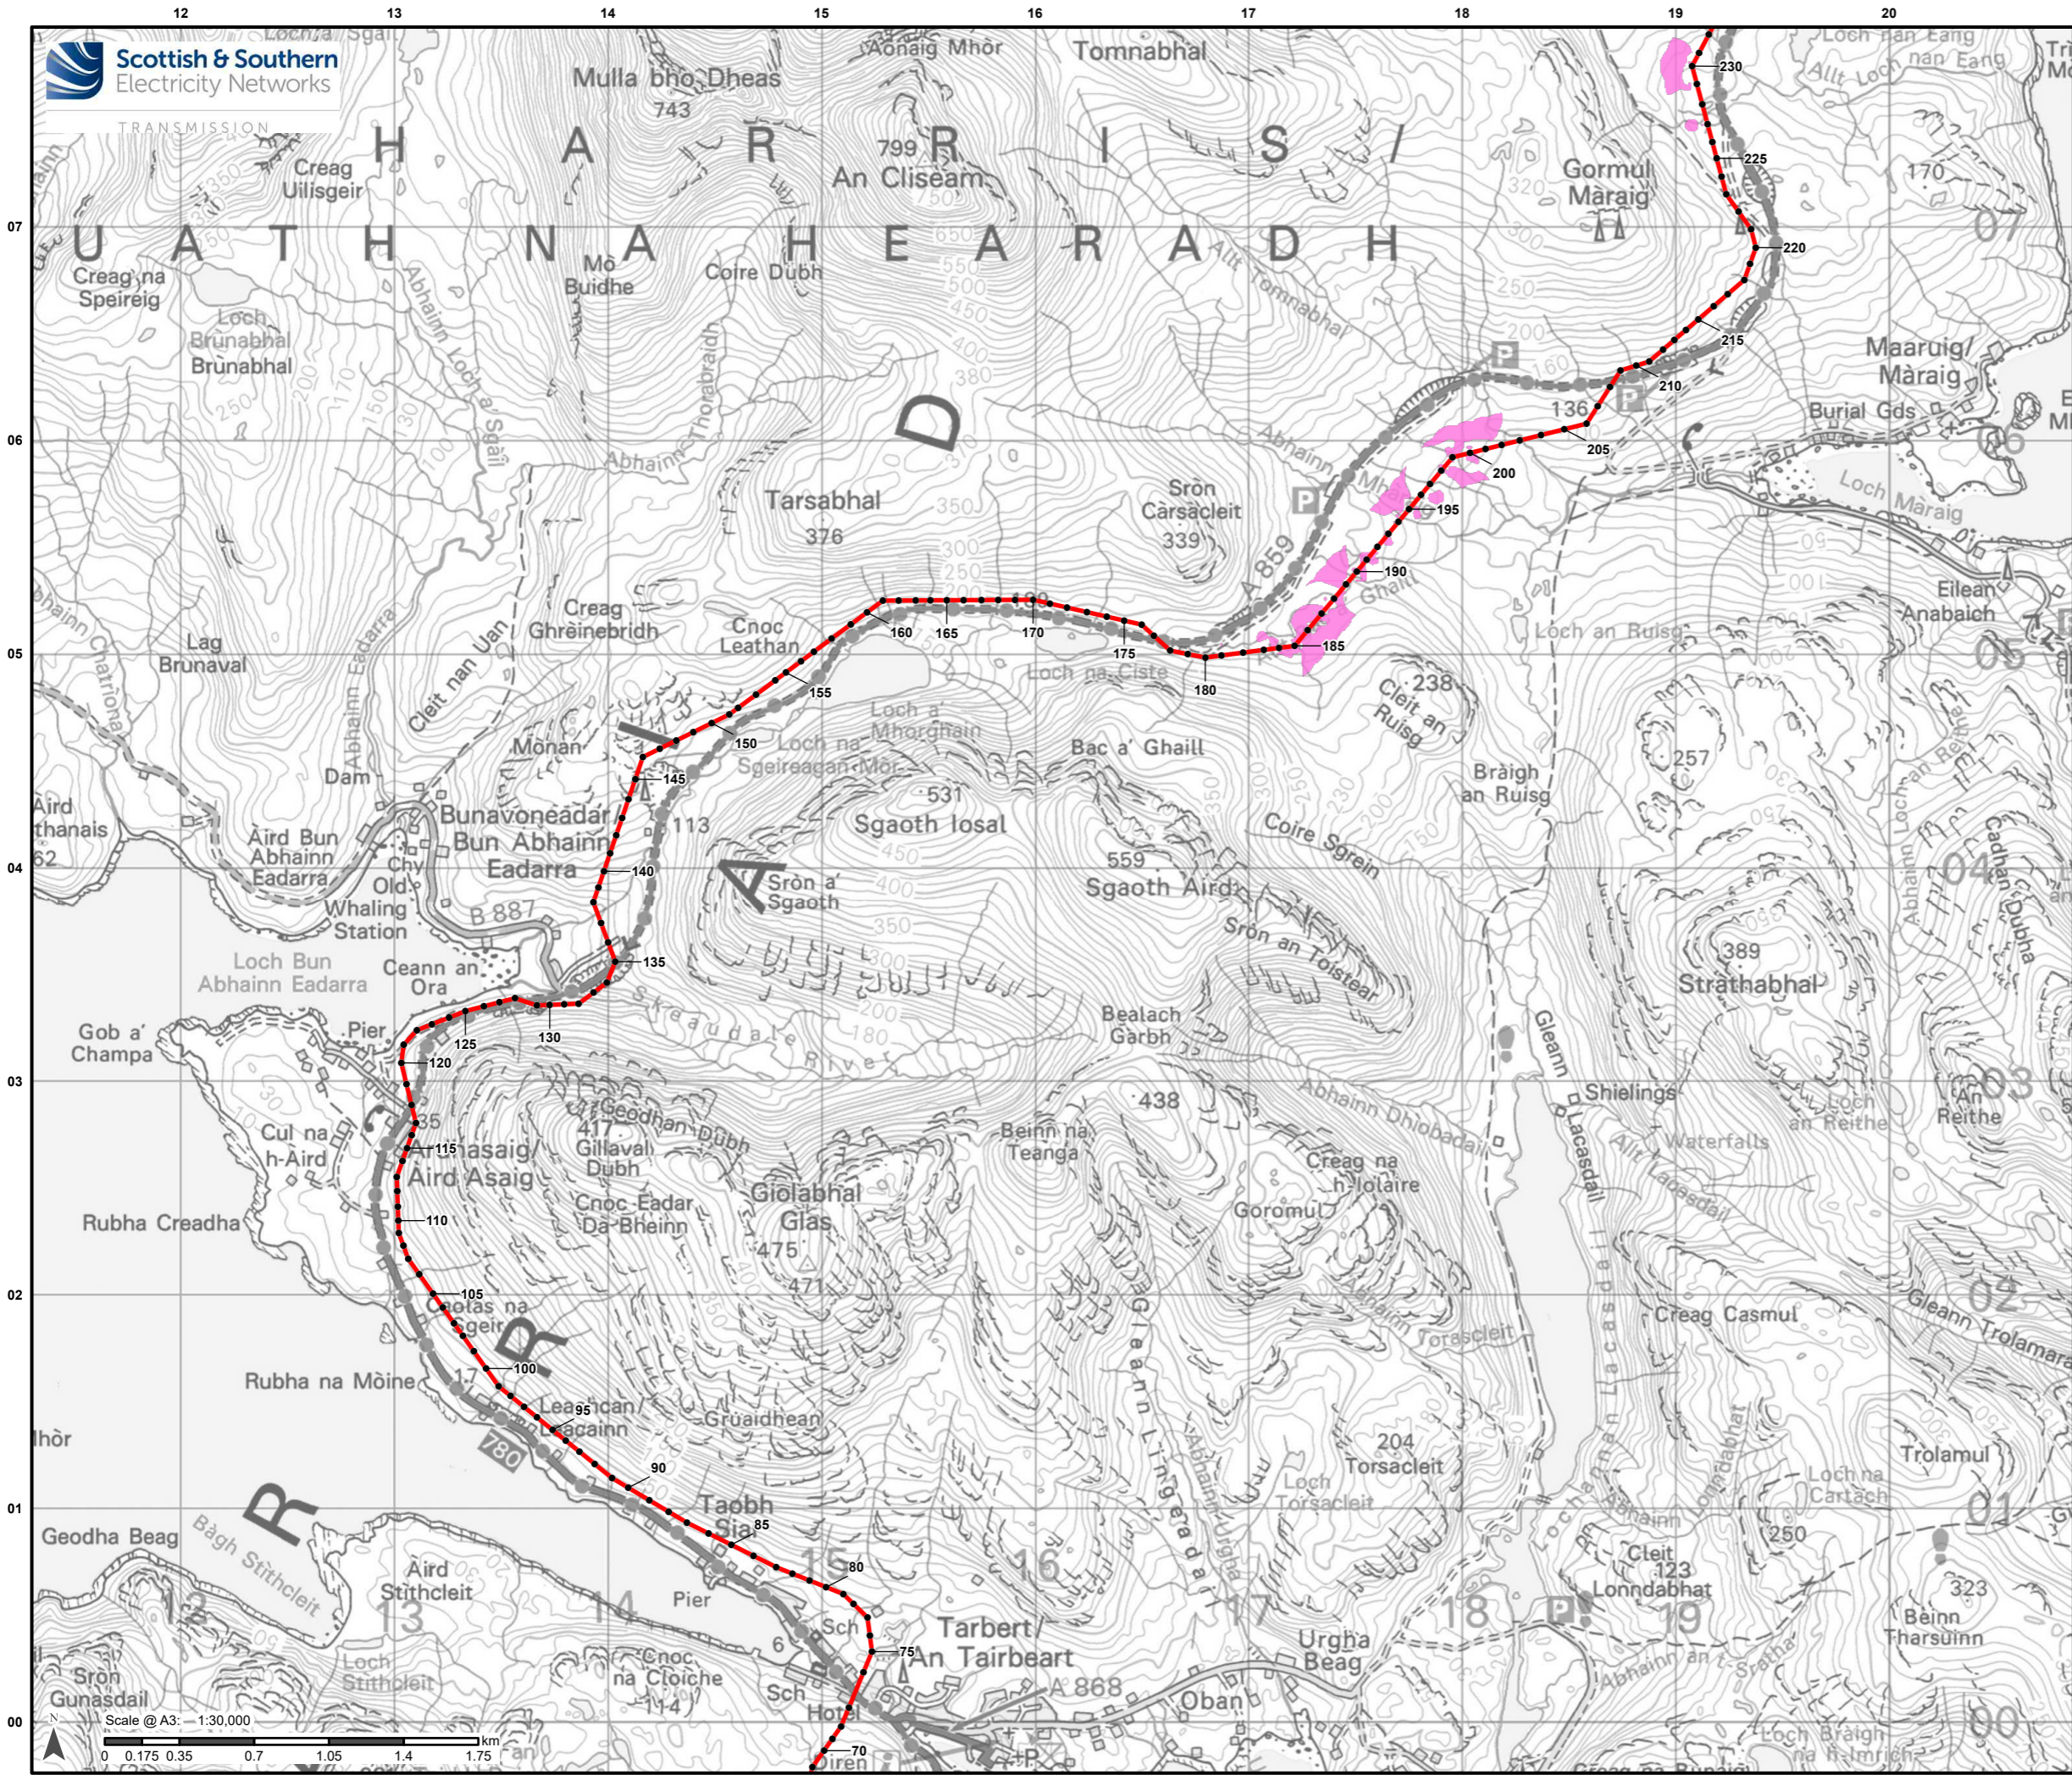


**Legend**

- Proposed Alignment
- Indicative Pole Location

**Forestry Scores (F)**

- Score 0: Not afforested

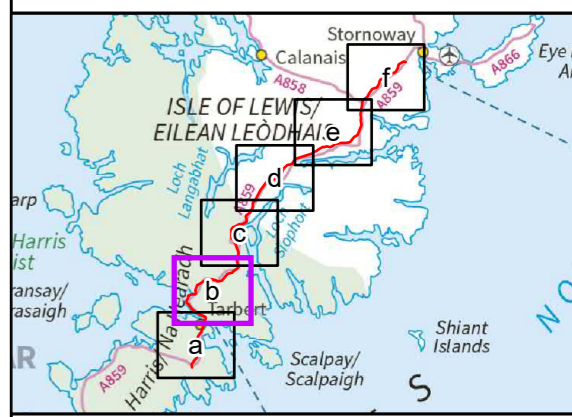


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7f/b:  
Peat Landslide Hazard and Risk Assessment:  
Contributing Factor - Forestry Score



Drawn by: AB Date: 01/09/2022

Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B



**Legend**

- Proposed Alignment
  - Indicative Pole Location
- Forestry Scores (F)**
- Score 0: Not afforested
  - Score 1: Afforested aligned
  - Score 2: Deforested aligned

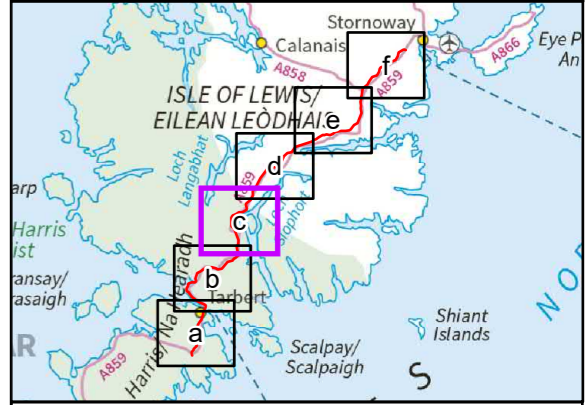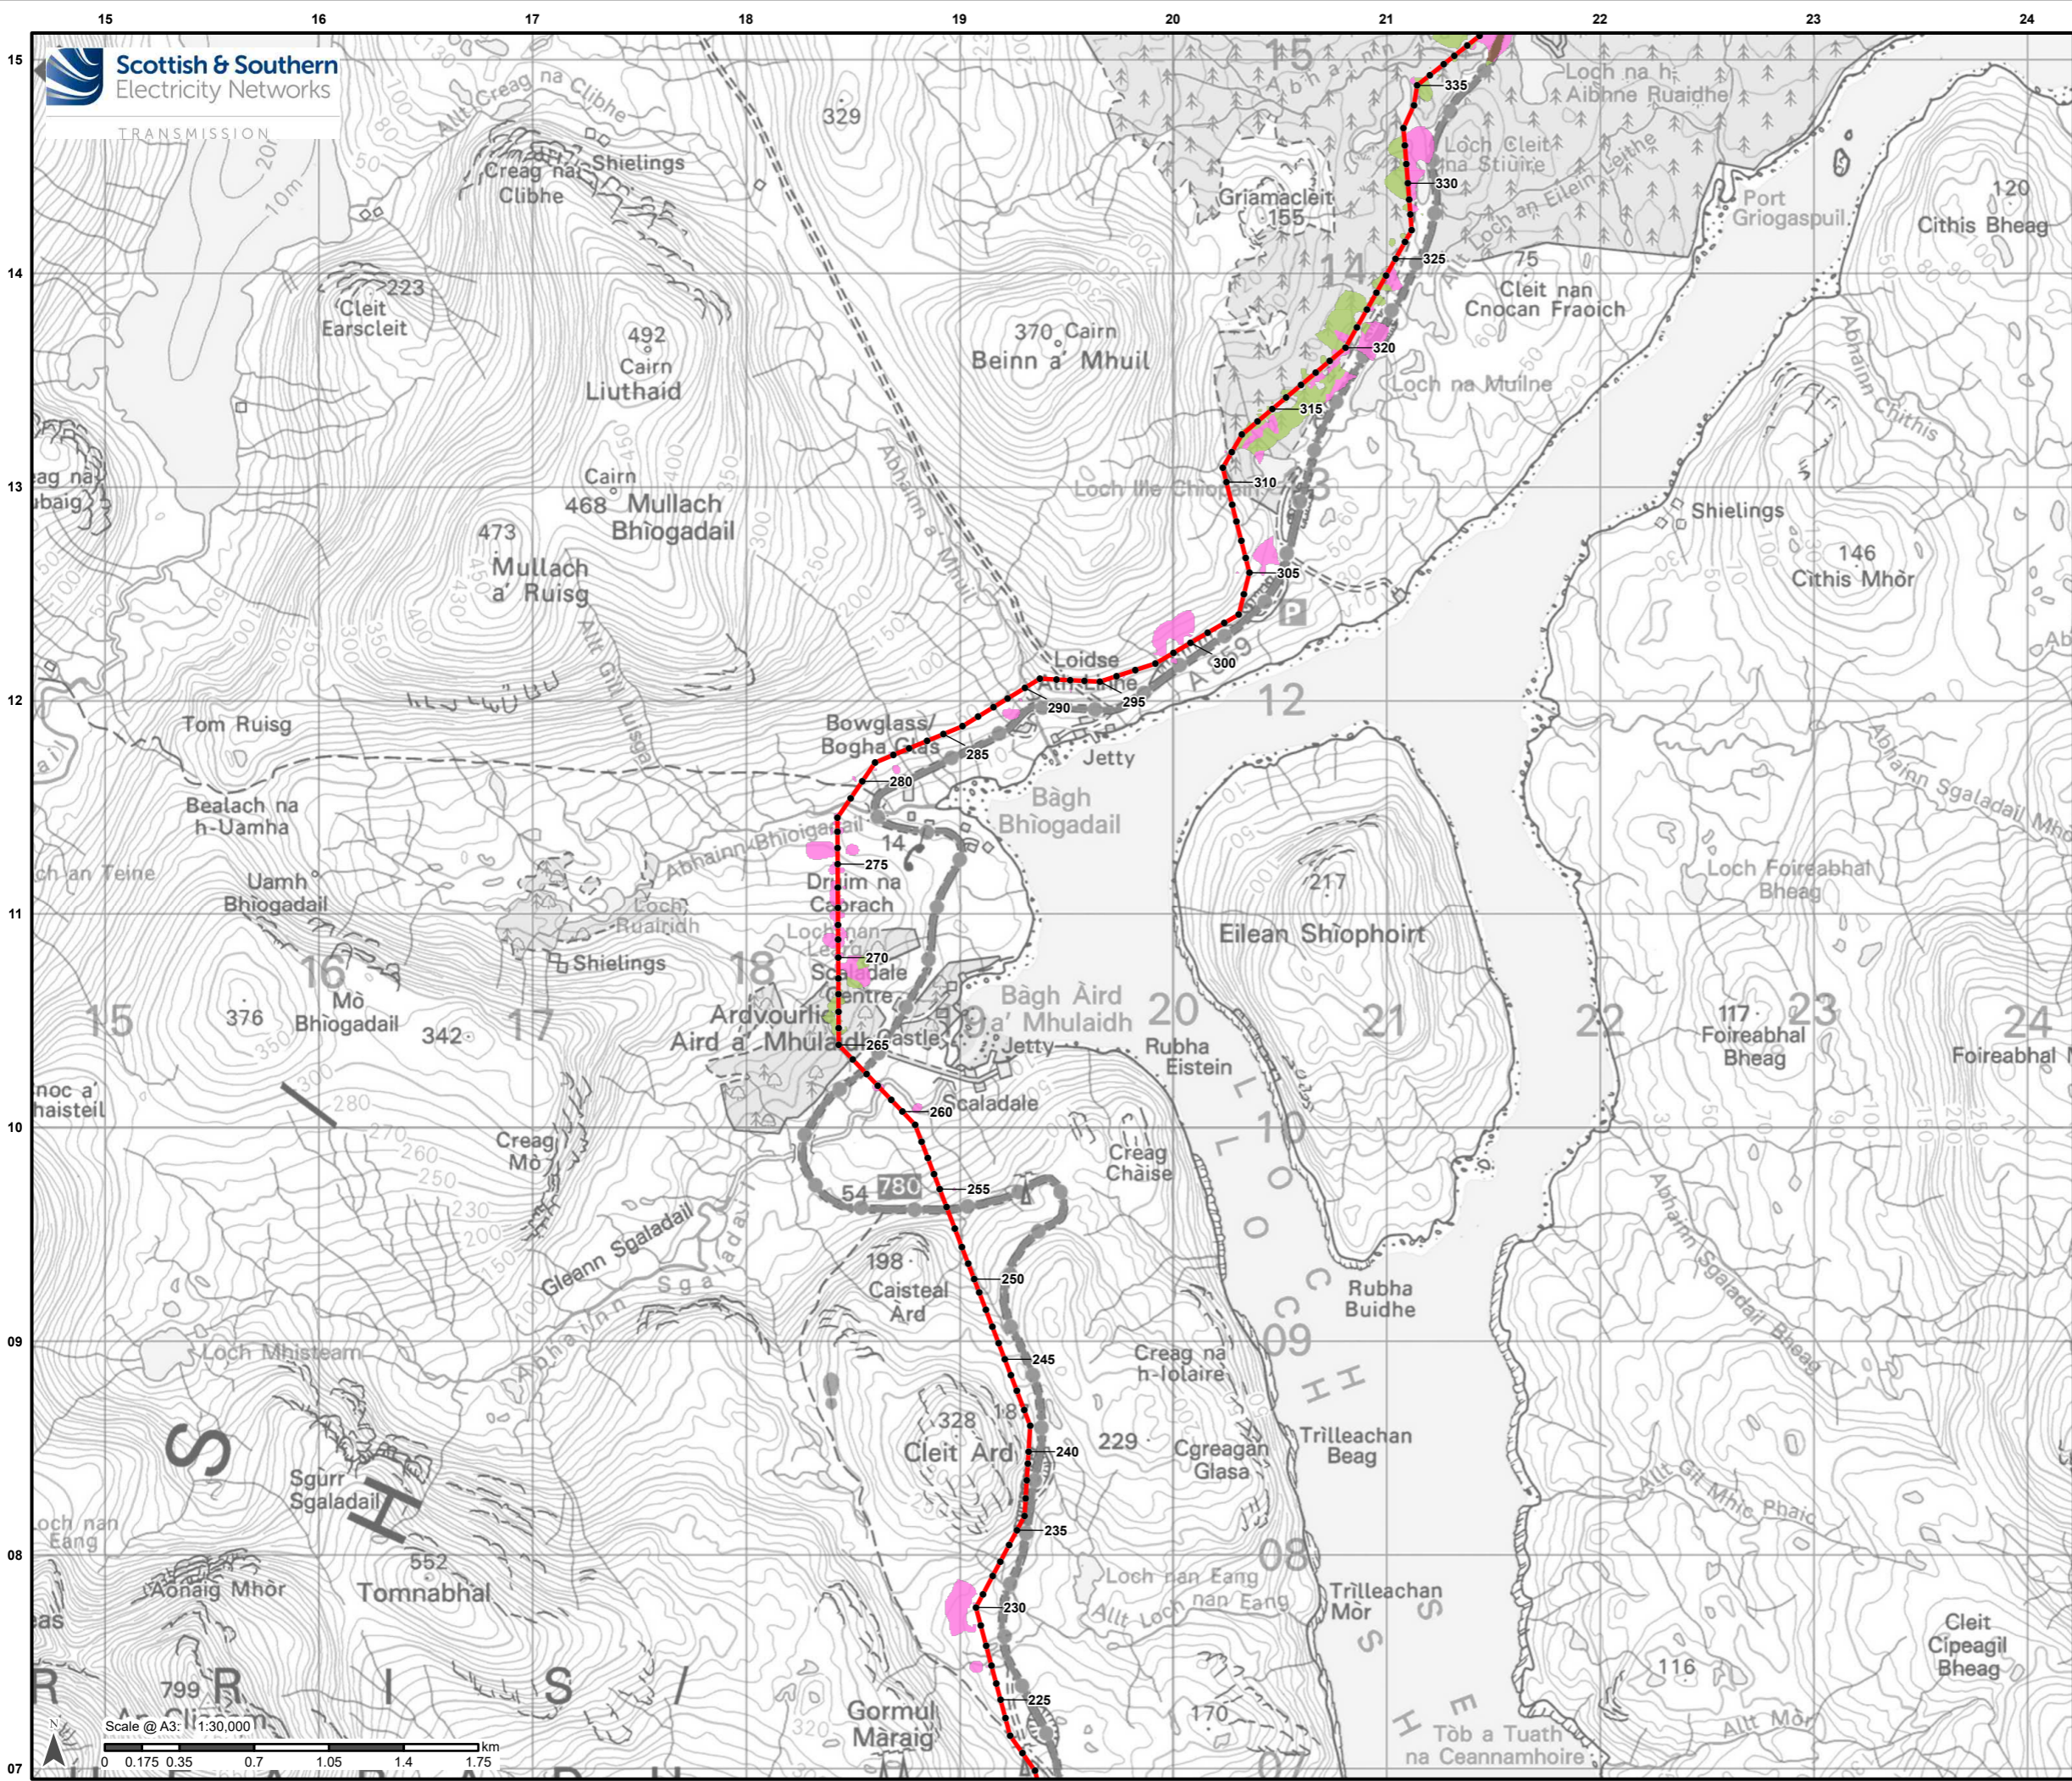


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7f/c:  
Peat Landslide Hazard and Risk Assessment:  
Contributing Factor - Forestry Score

Drawn by: AB Date: 01/09/2022


Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B



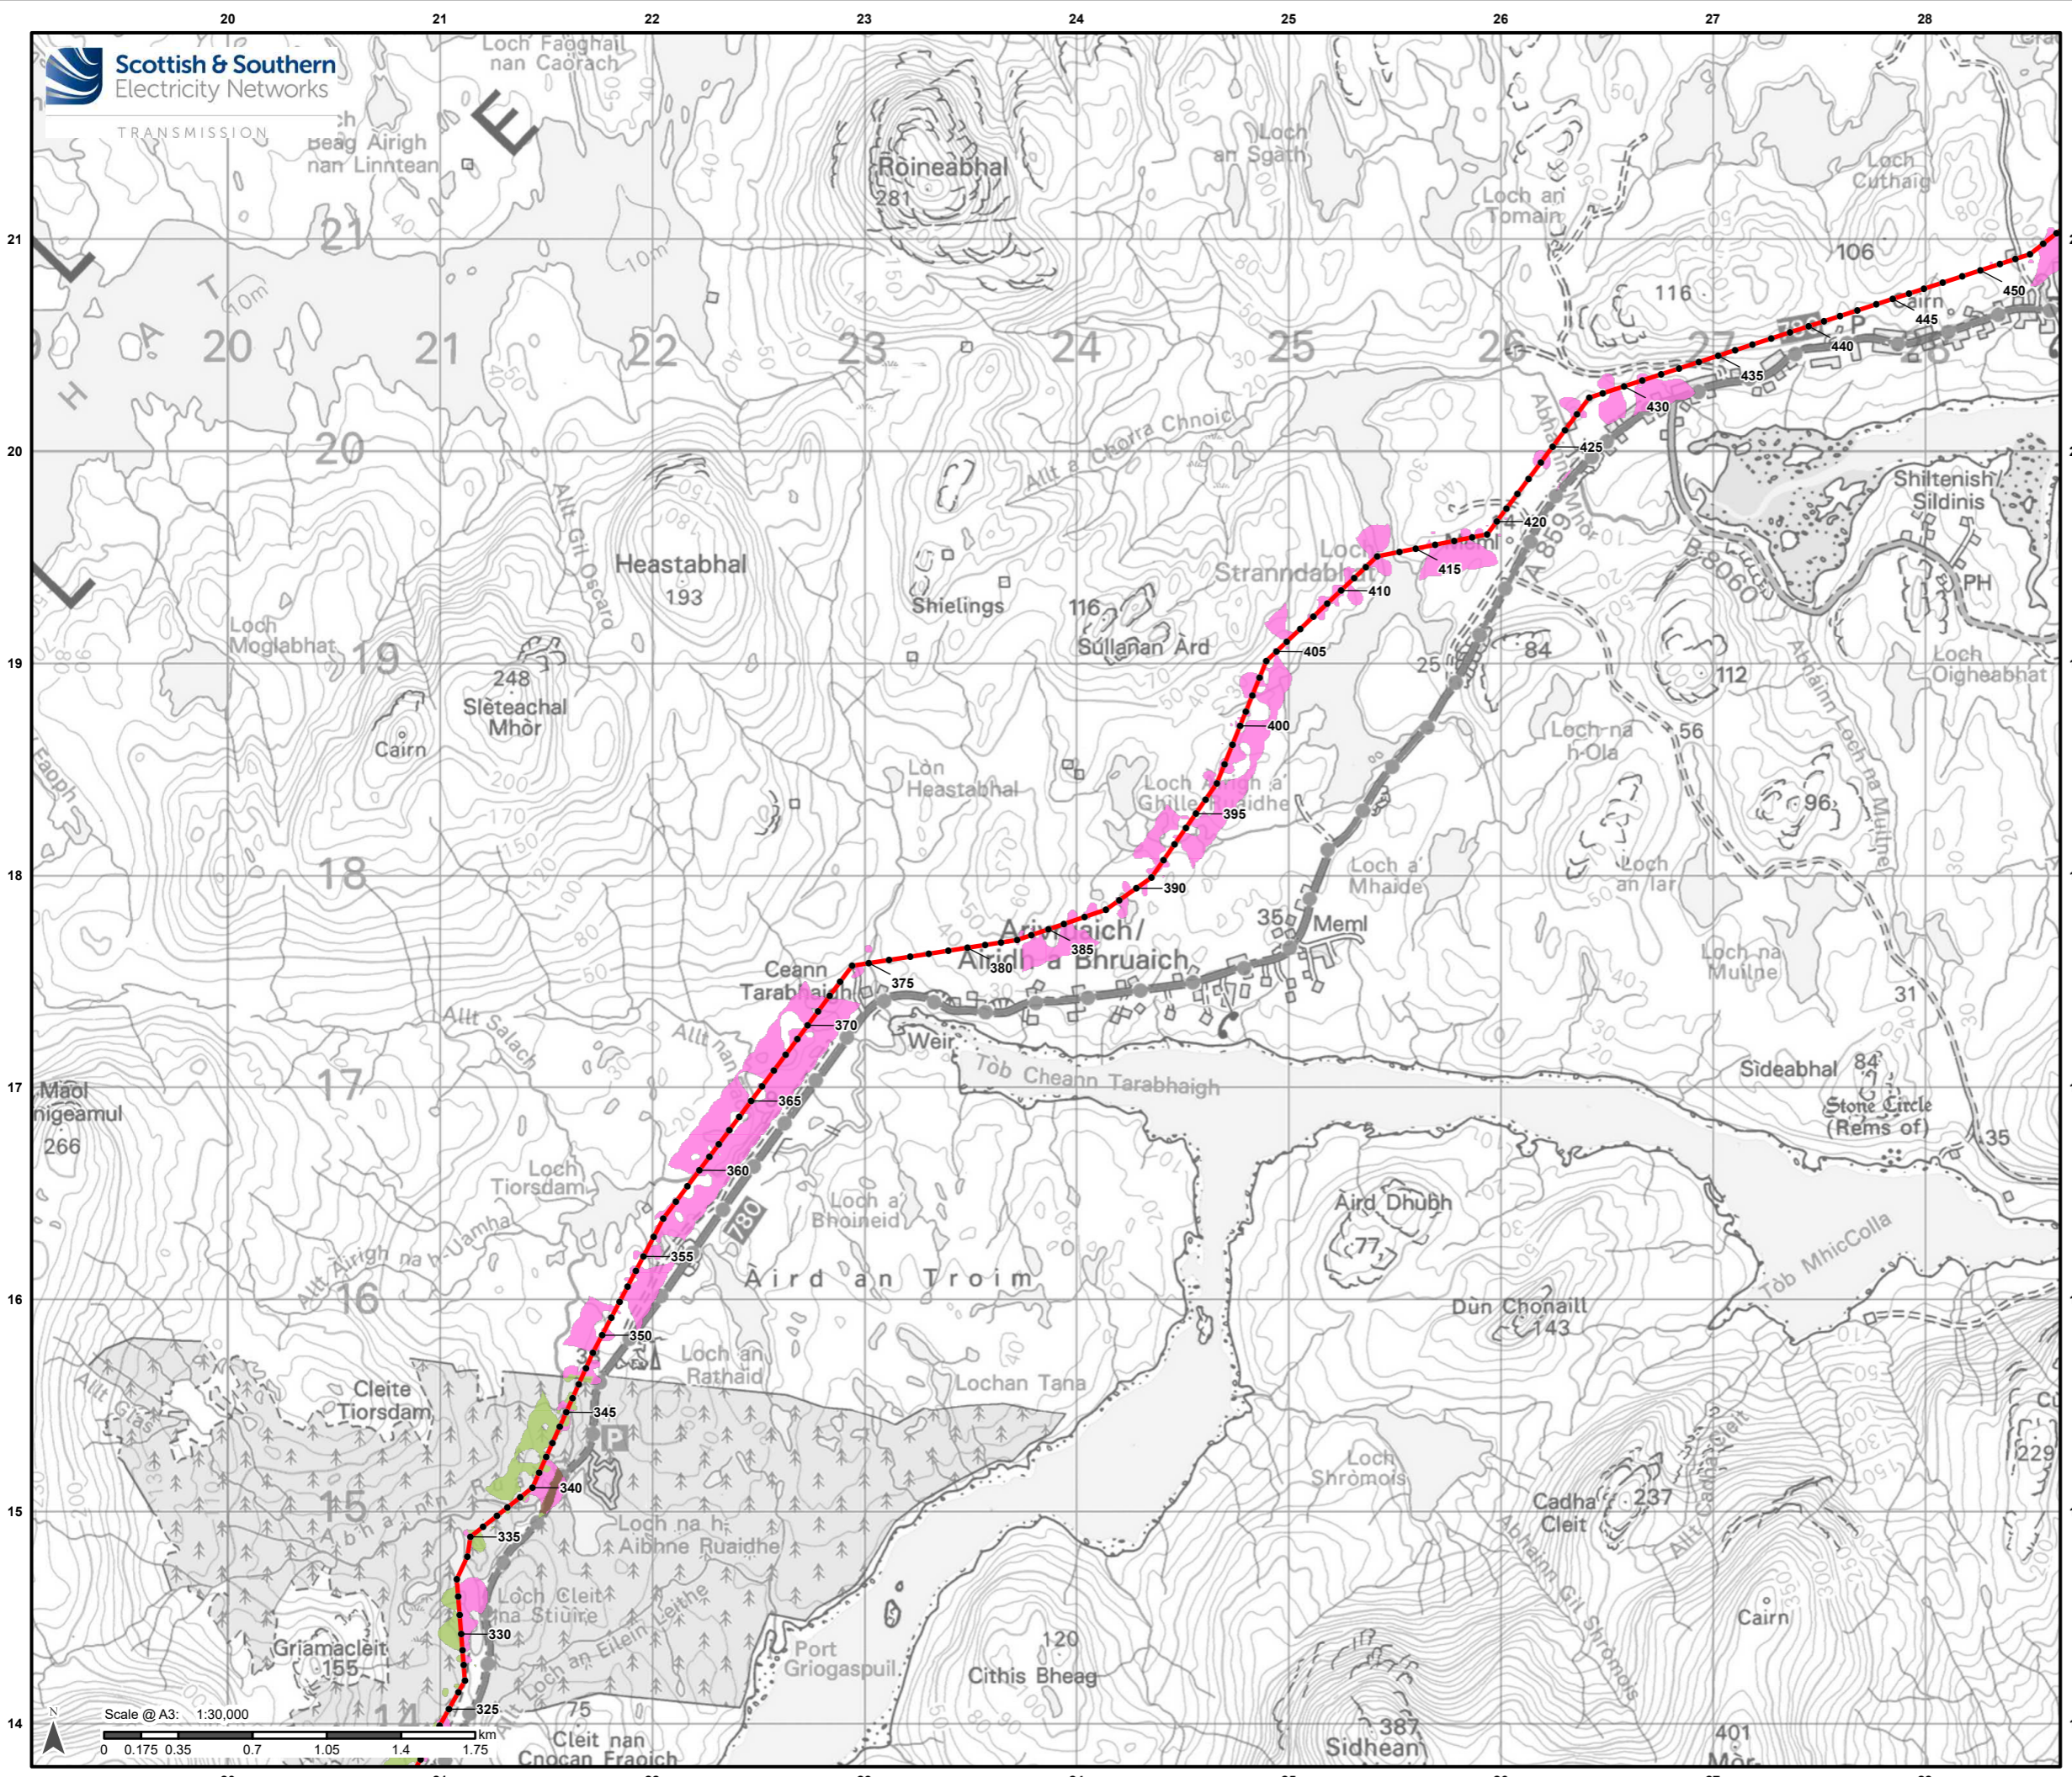

**Legend**

- Proposed Alignment
  - Indicative Pole Location
- Forestry Scores (F)**
- Score 0: Not afforested
  - Score 1: Afforested aligned
  - Score 2: Deforested aligned

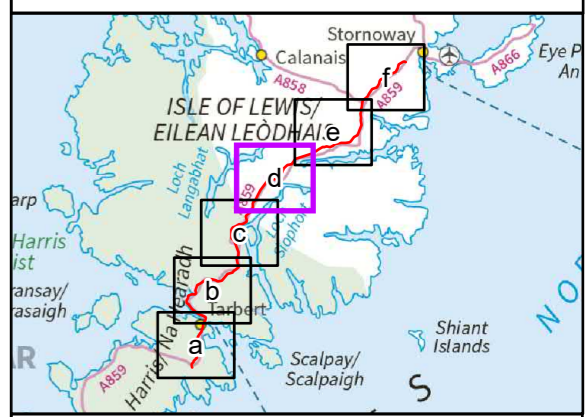


Reproduced by permission of Ordnance Survey on behalf of HMSO.  
Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number 0100022432.

Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title:  
Figure 10.3.7f/d:  
Peat Landslide Hazard and Risk Assessment:  
Contributing Factor - Forestry Score

Drawn by: AB  
Date: 01/09/2022

Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B

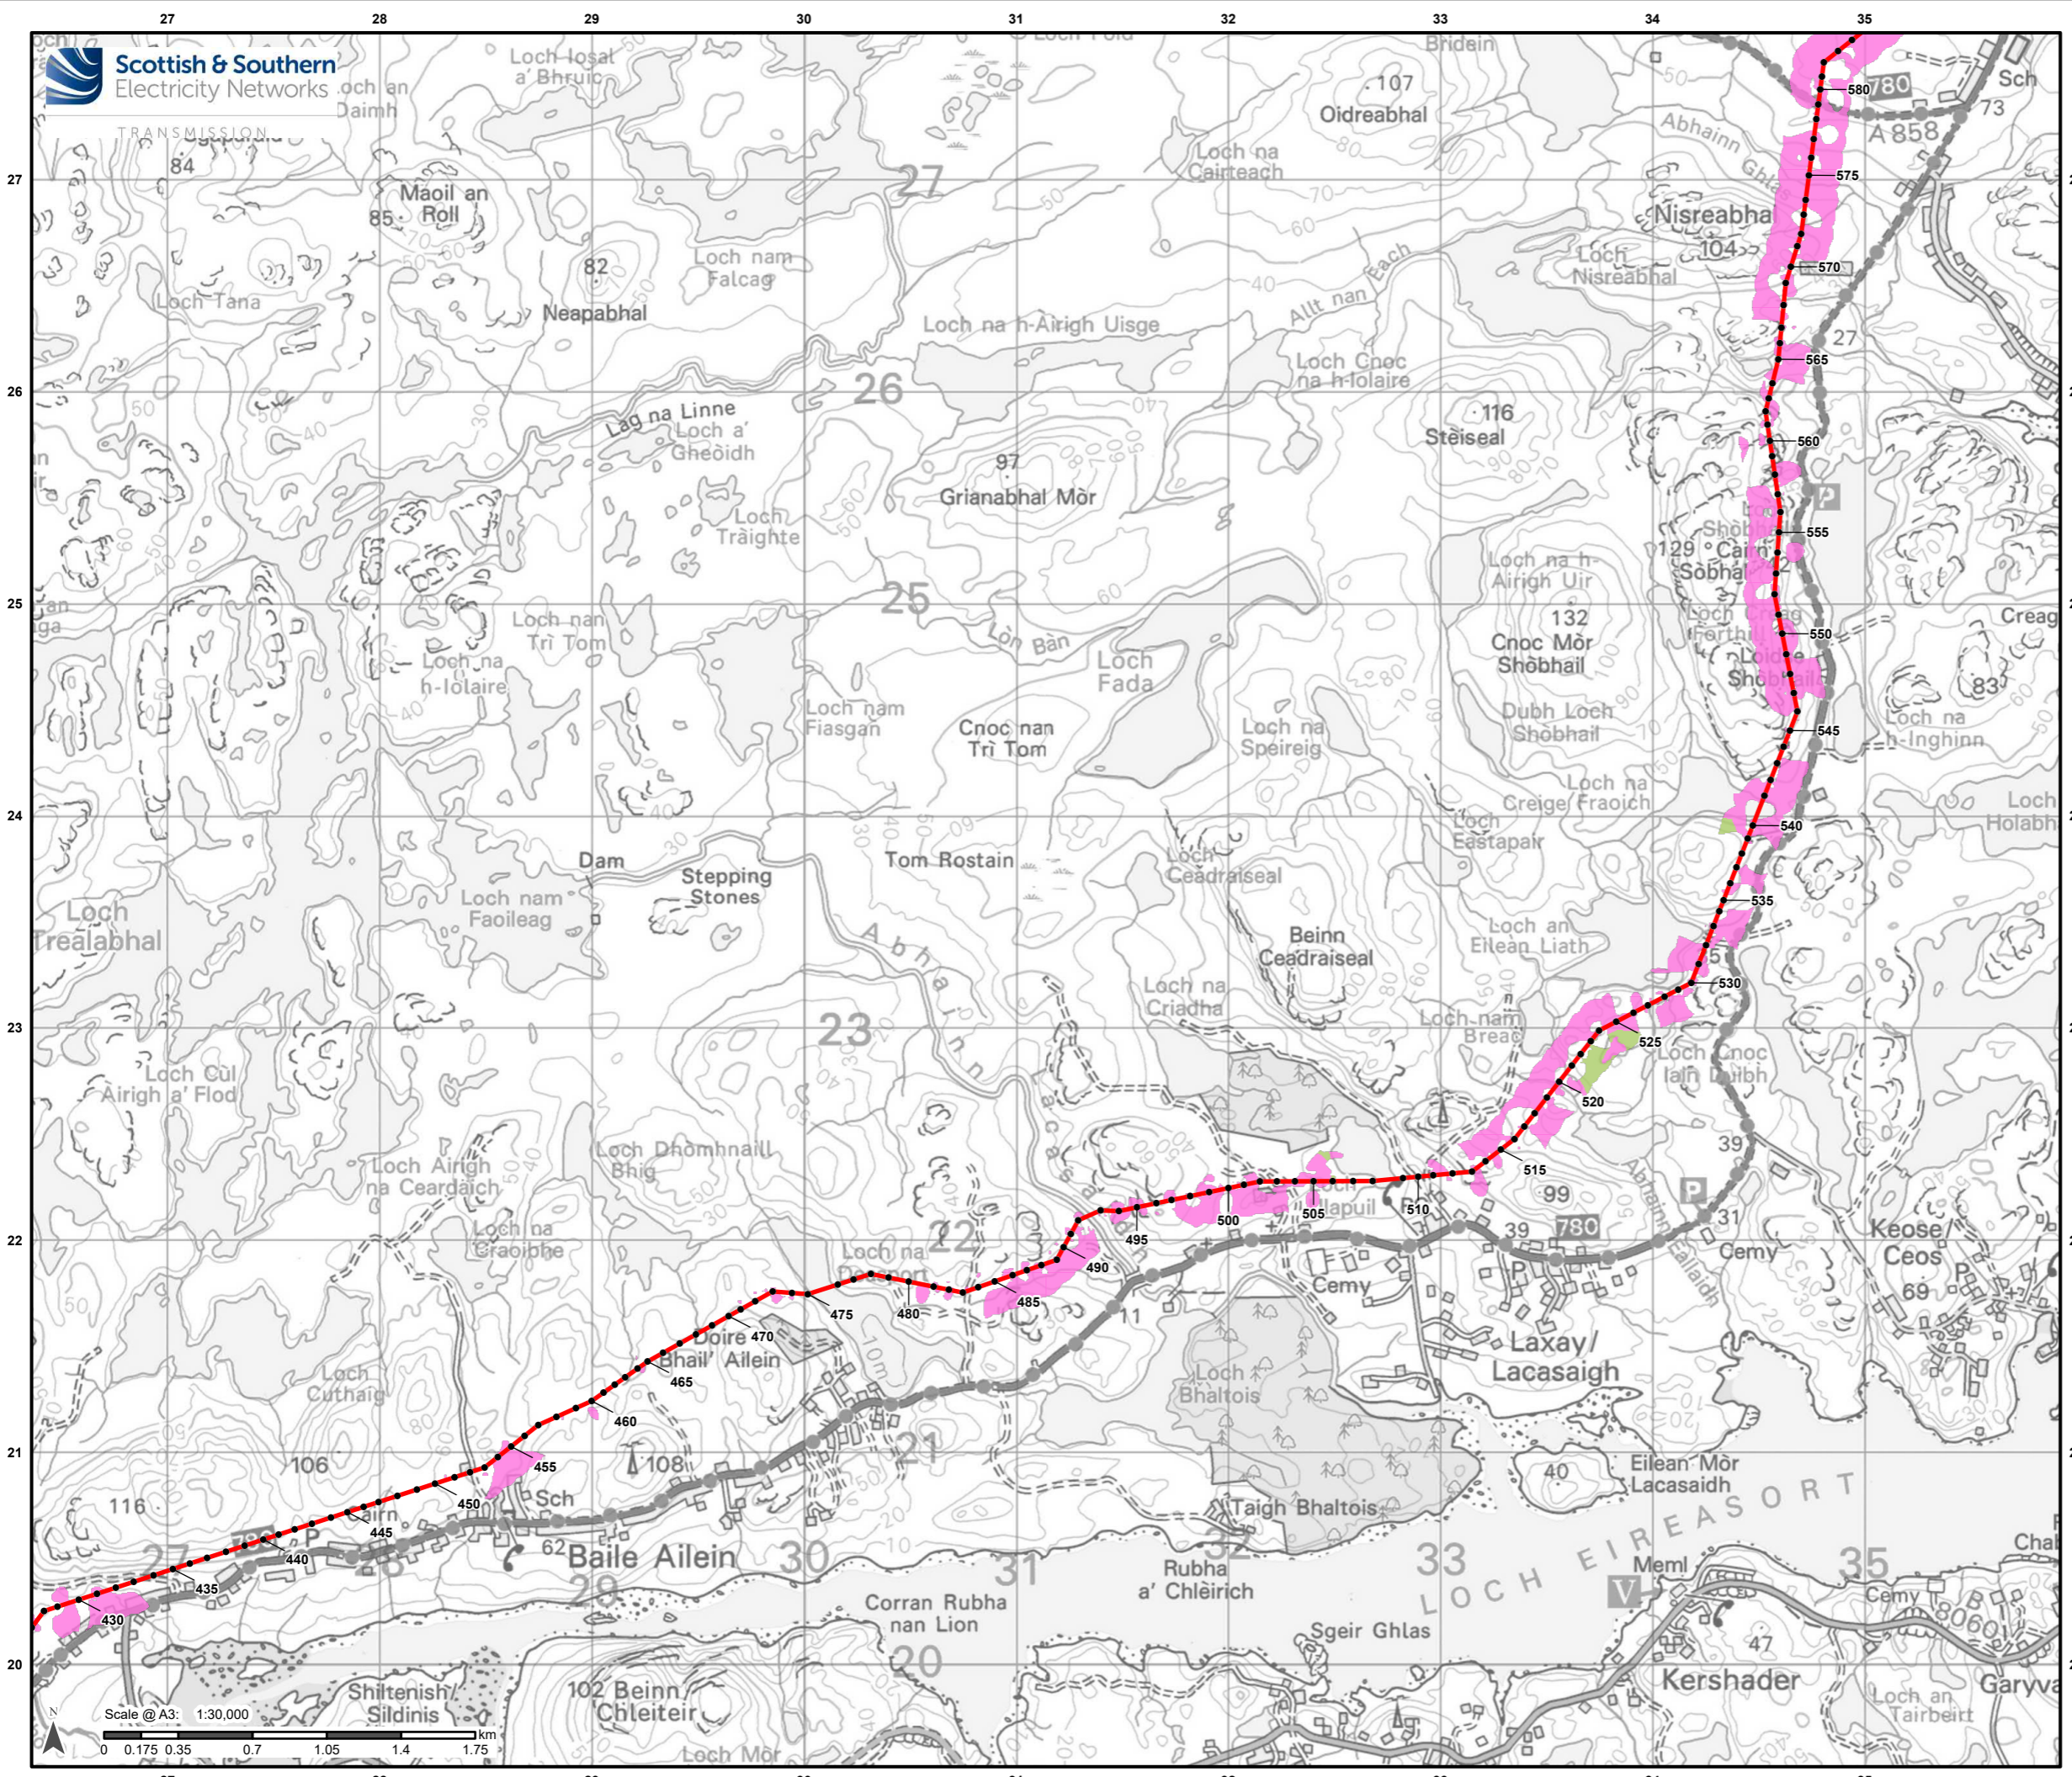


**Legend**

- Proposed Alignment
- Indicative Pole Location

**Forestry Scores (F)**

- Score 0: Not afforested
- Score 1: Afforested aligned

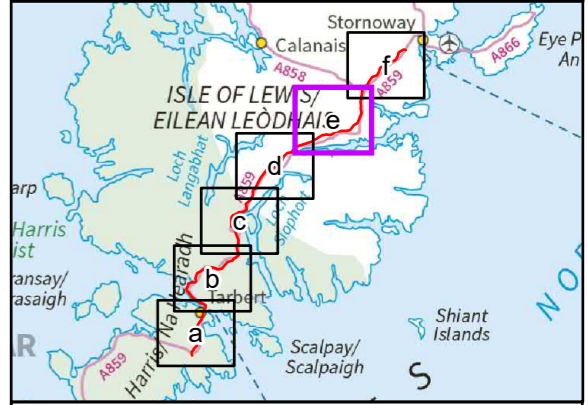


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7f/e:  
Peat Landslide Hazard and Risk Assessment:  
Contributing Factor - Forestry Score

Drawn by: AB Date: 01/09/2022

Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B



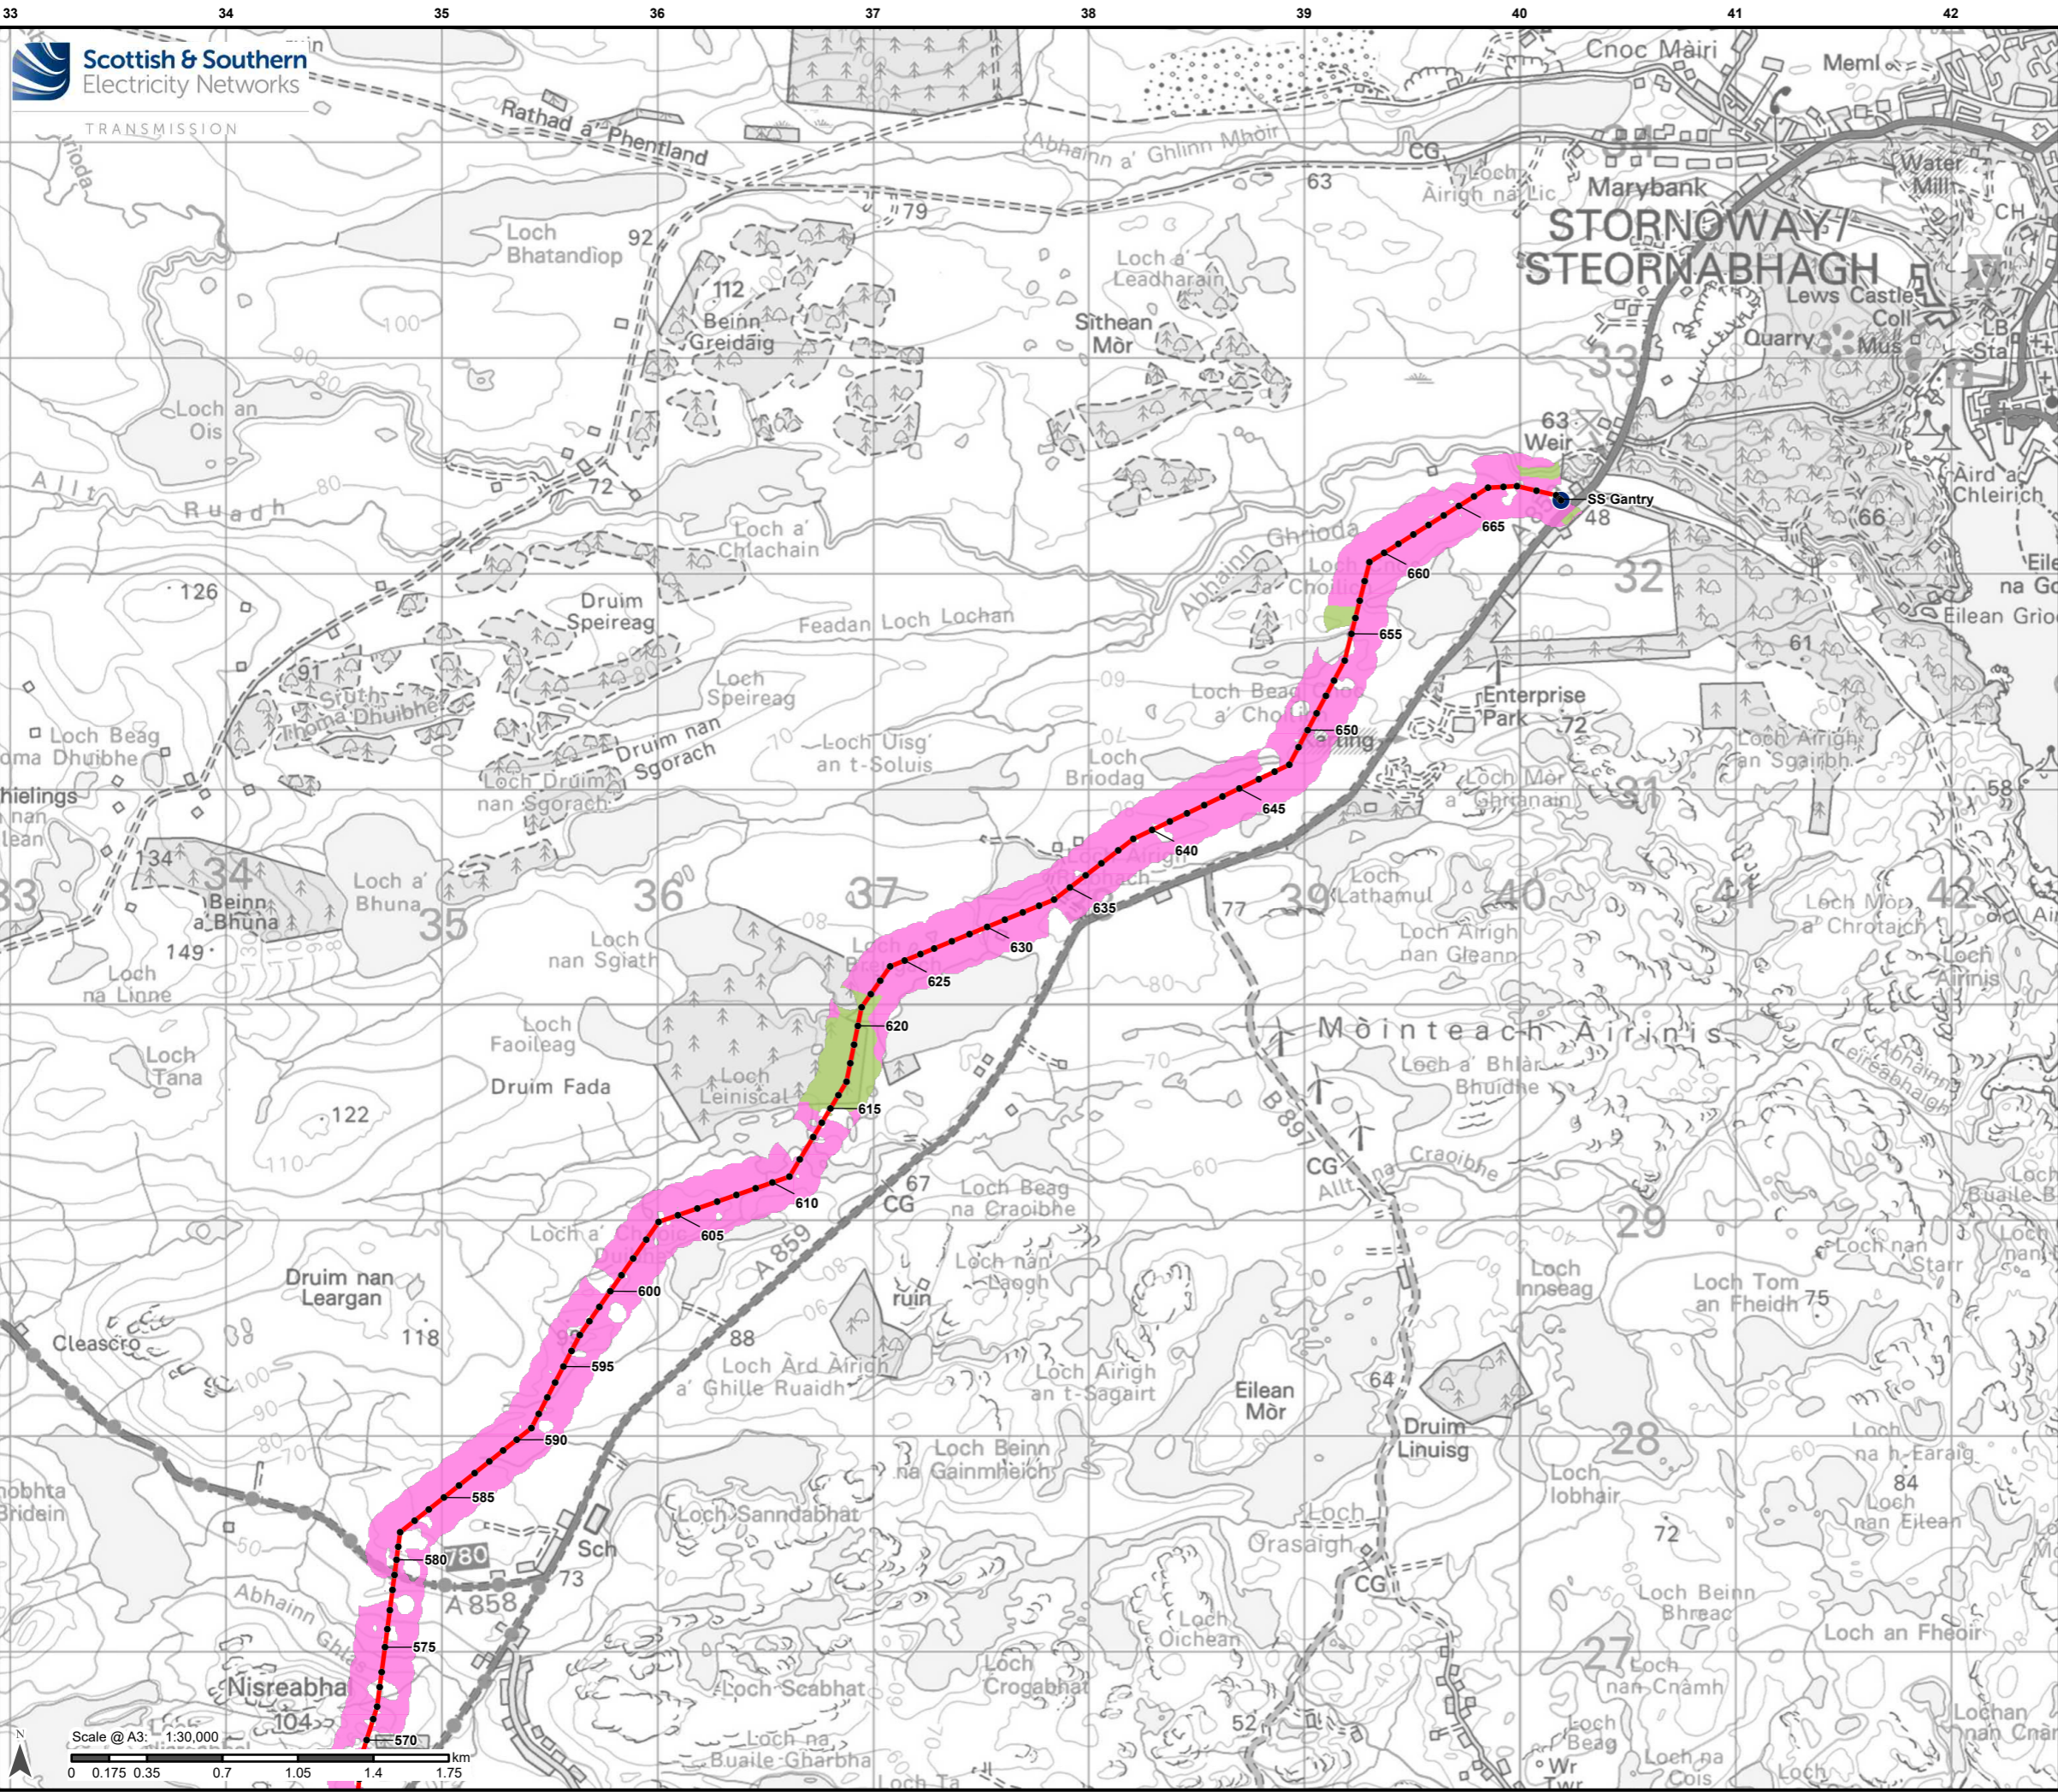


### Legend

- Proposed Alignment
- Indicative Pole Location
- Stornoway Substation

### Forestry Scores (F)

- Score 0: Not afforested
- Score 1: Afforested aligned

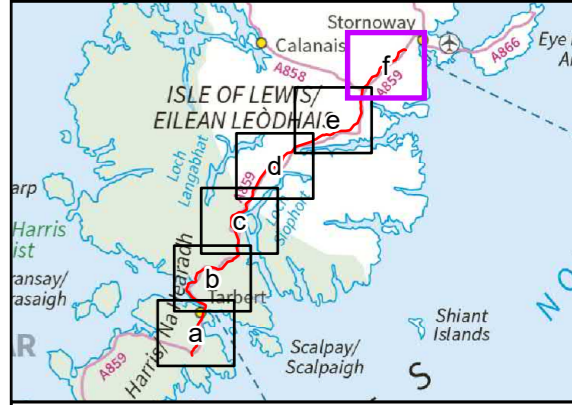

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245  
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7f/f: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Forestry Score

Drawn by: AB Date: 01/09/2022

Drawing: R162\_11469\_001\_Fig10-3-7f\_ContribFactForestry\_B