


ANNEX A – FIGURES

Figure 10.3.7g\|a- 10.3.7g\|f

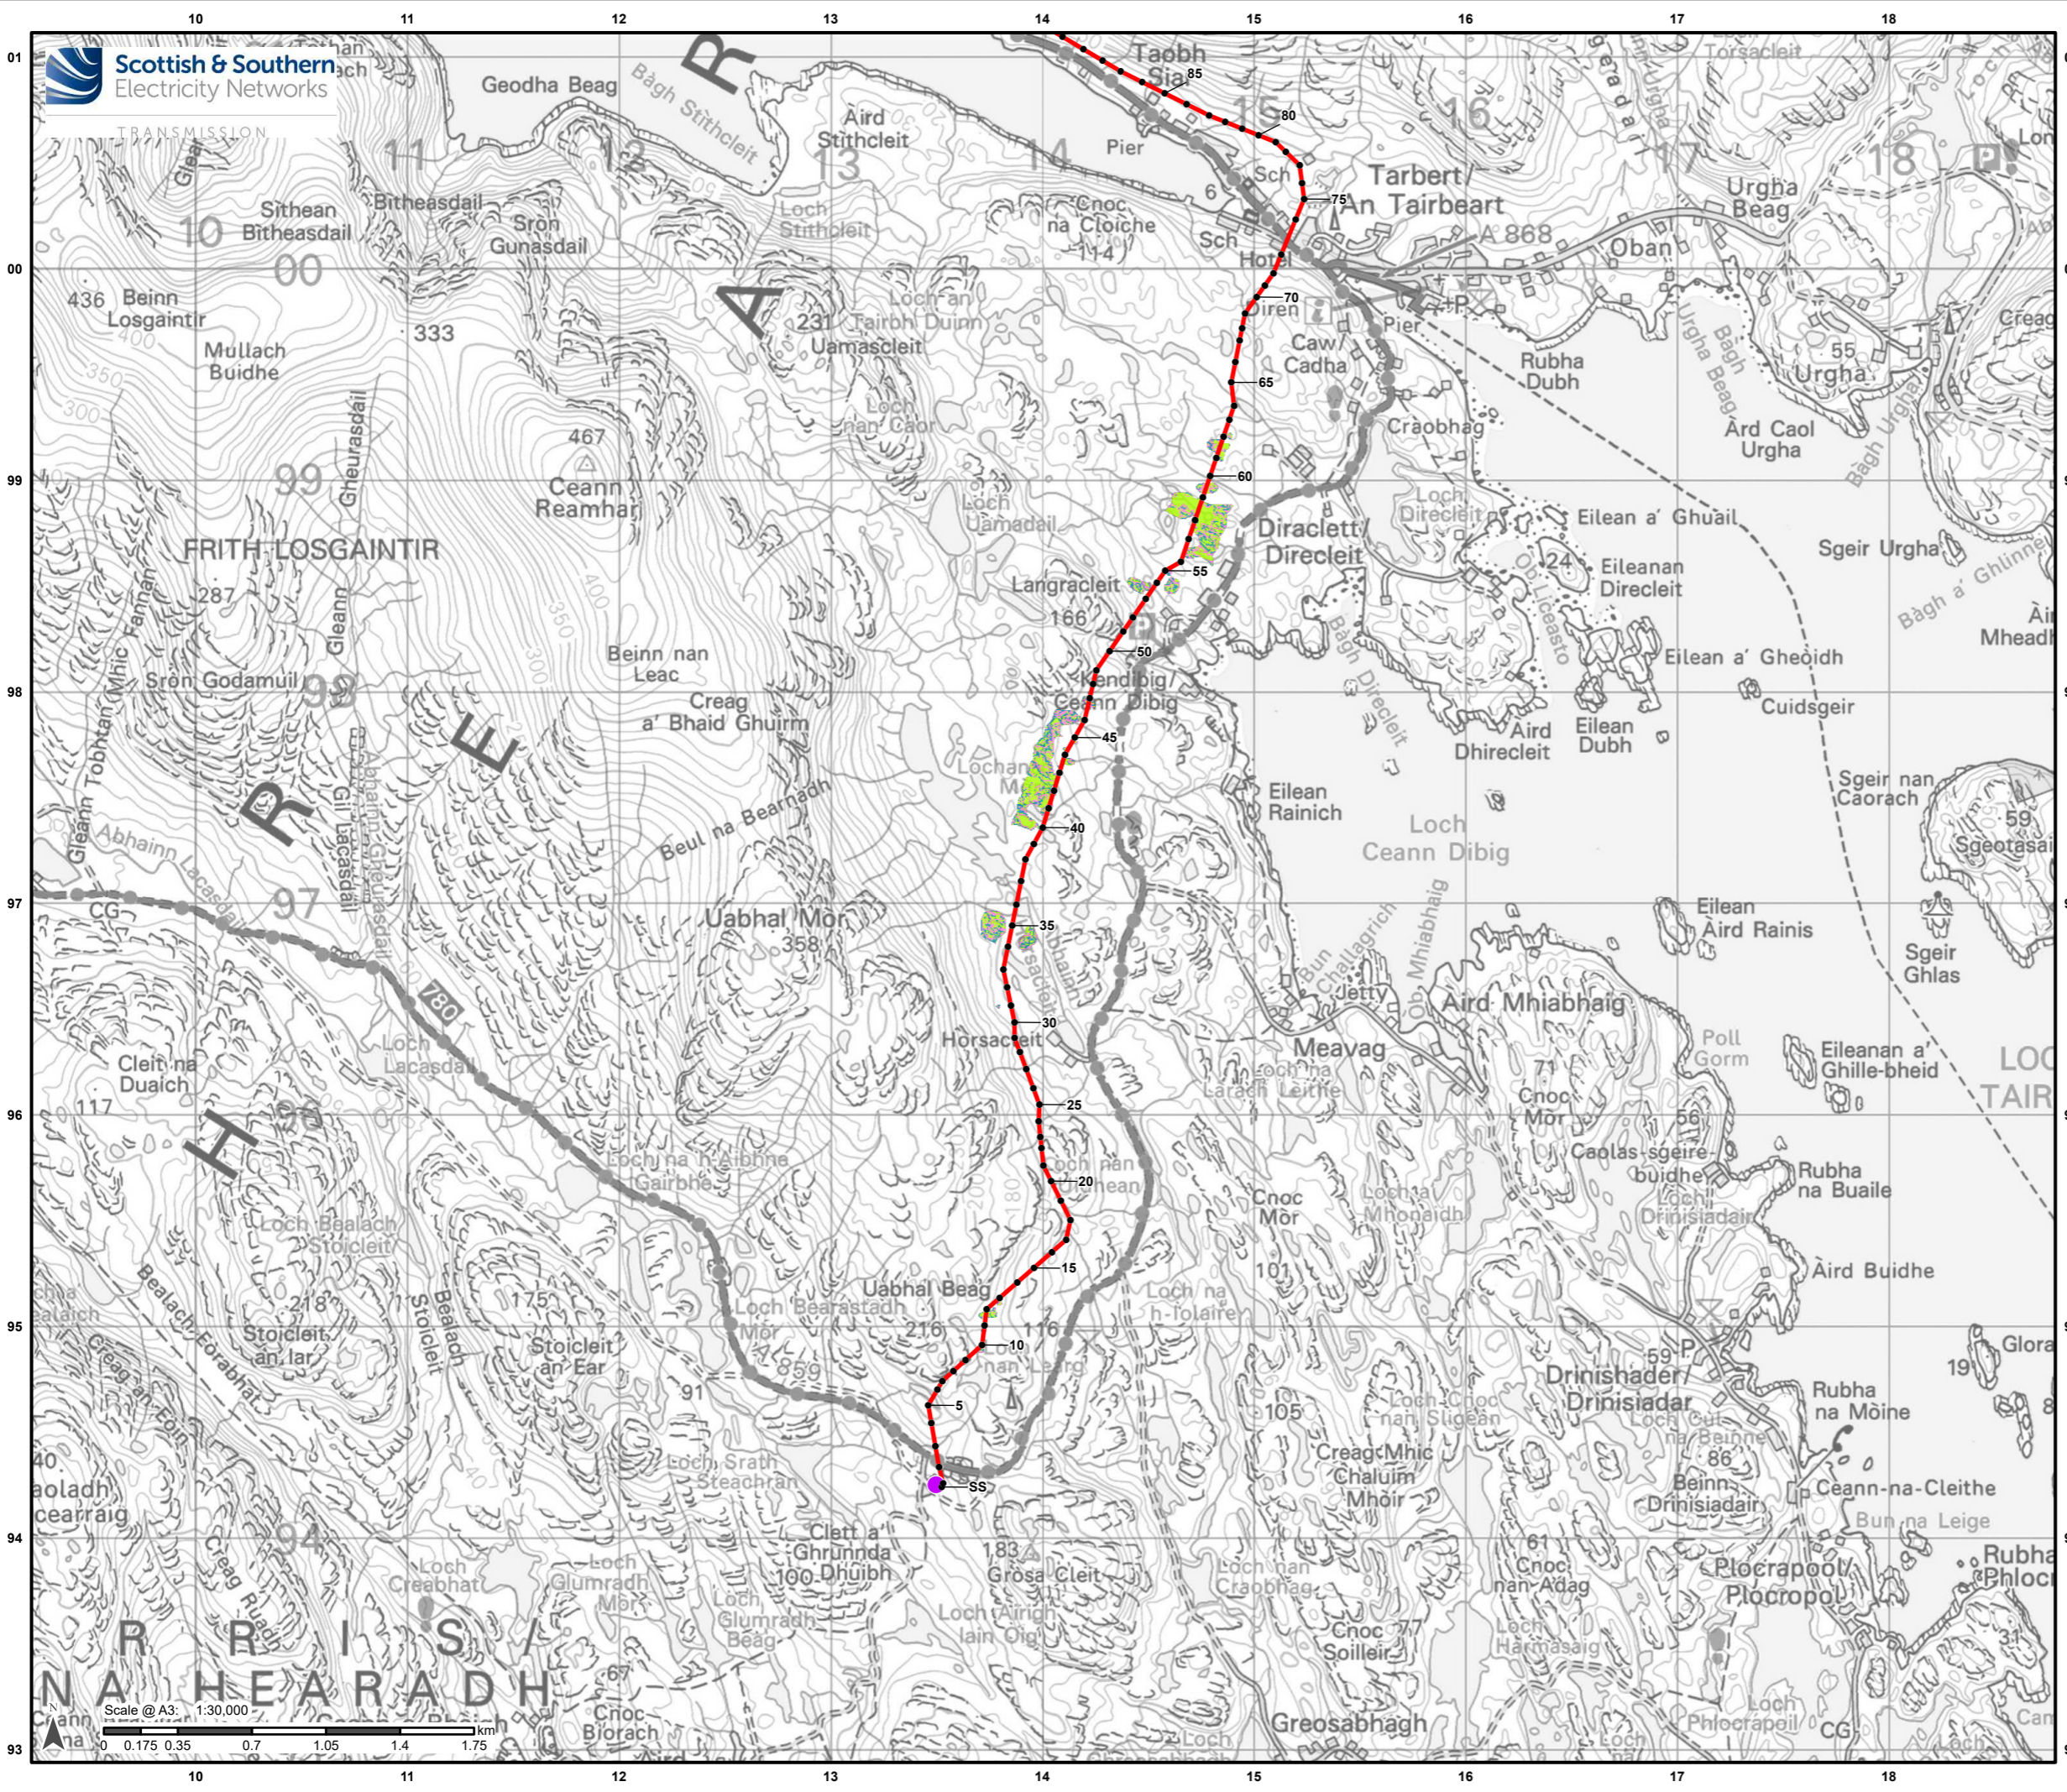


Legend

- Proposed Alignment
- Indicative Pole Location
- Harris 132kV Grid Supply Point

Profile convexity scores (C)

- Score 0: Rectilinear slope
- Score 2: Concave slope
- Score 3: Convex slope

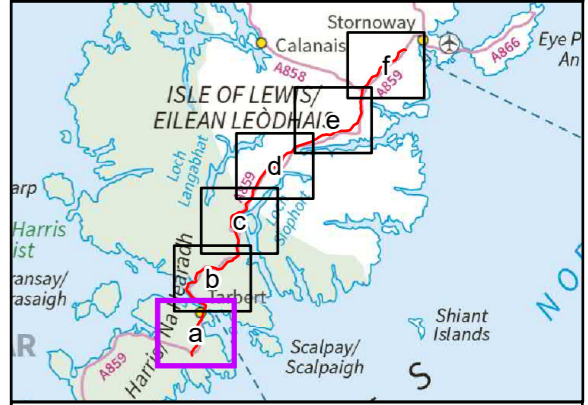


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7gla:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Convexity Score


Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B

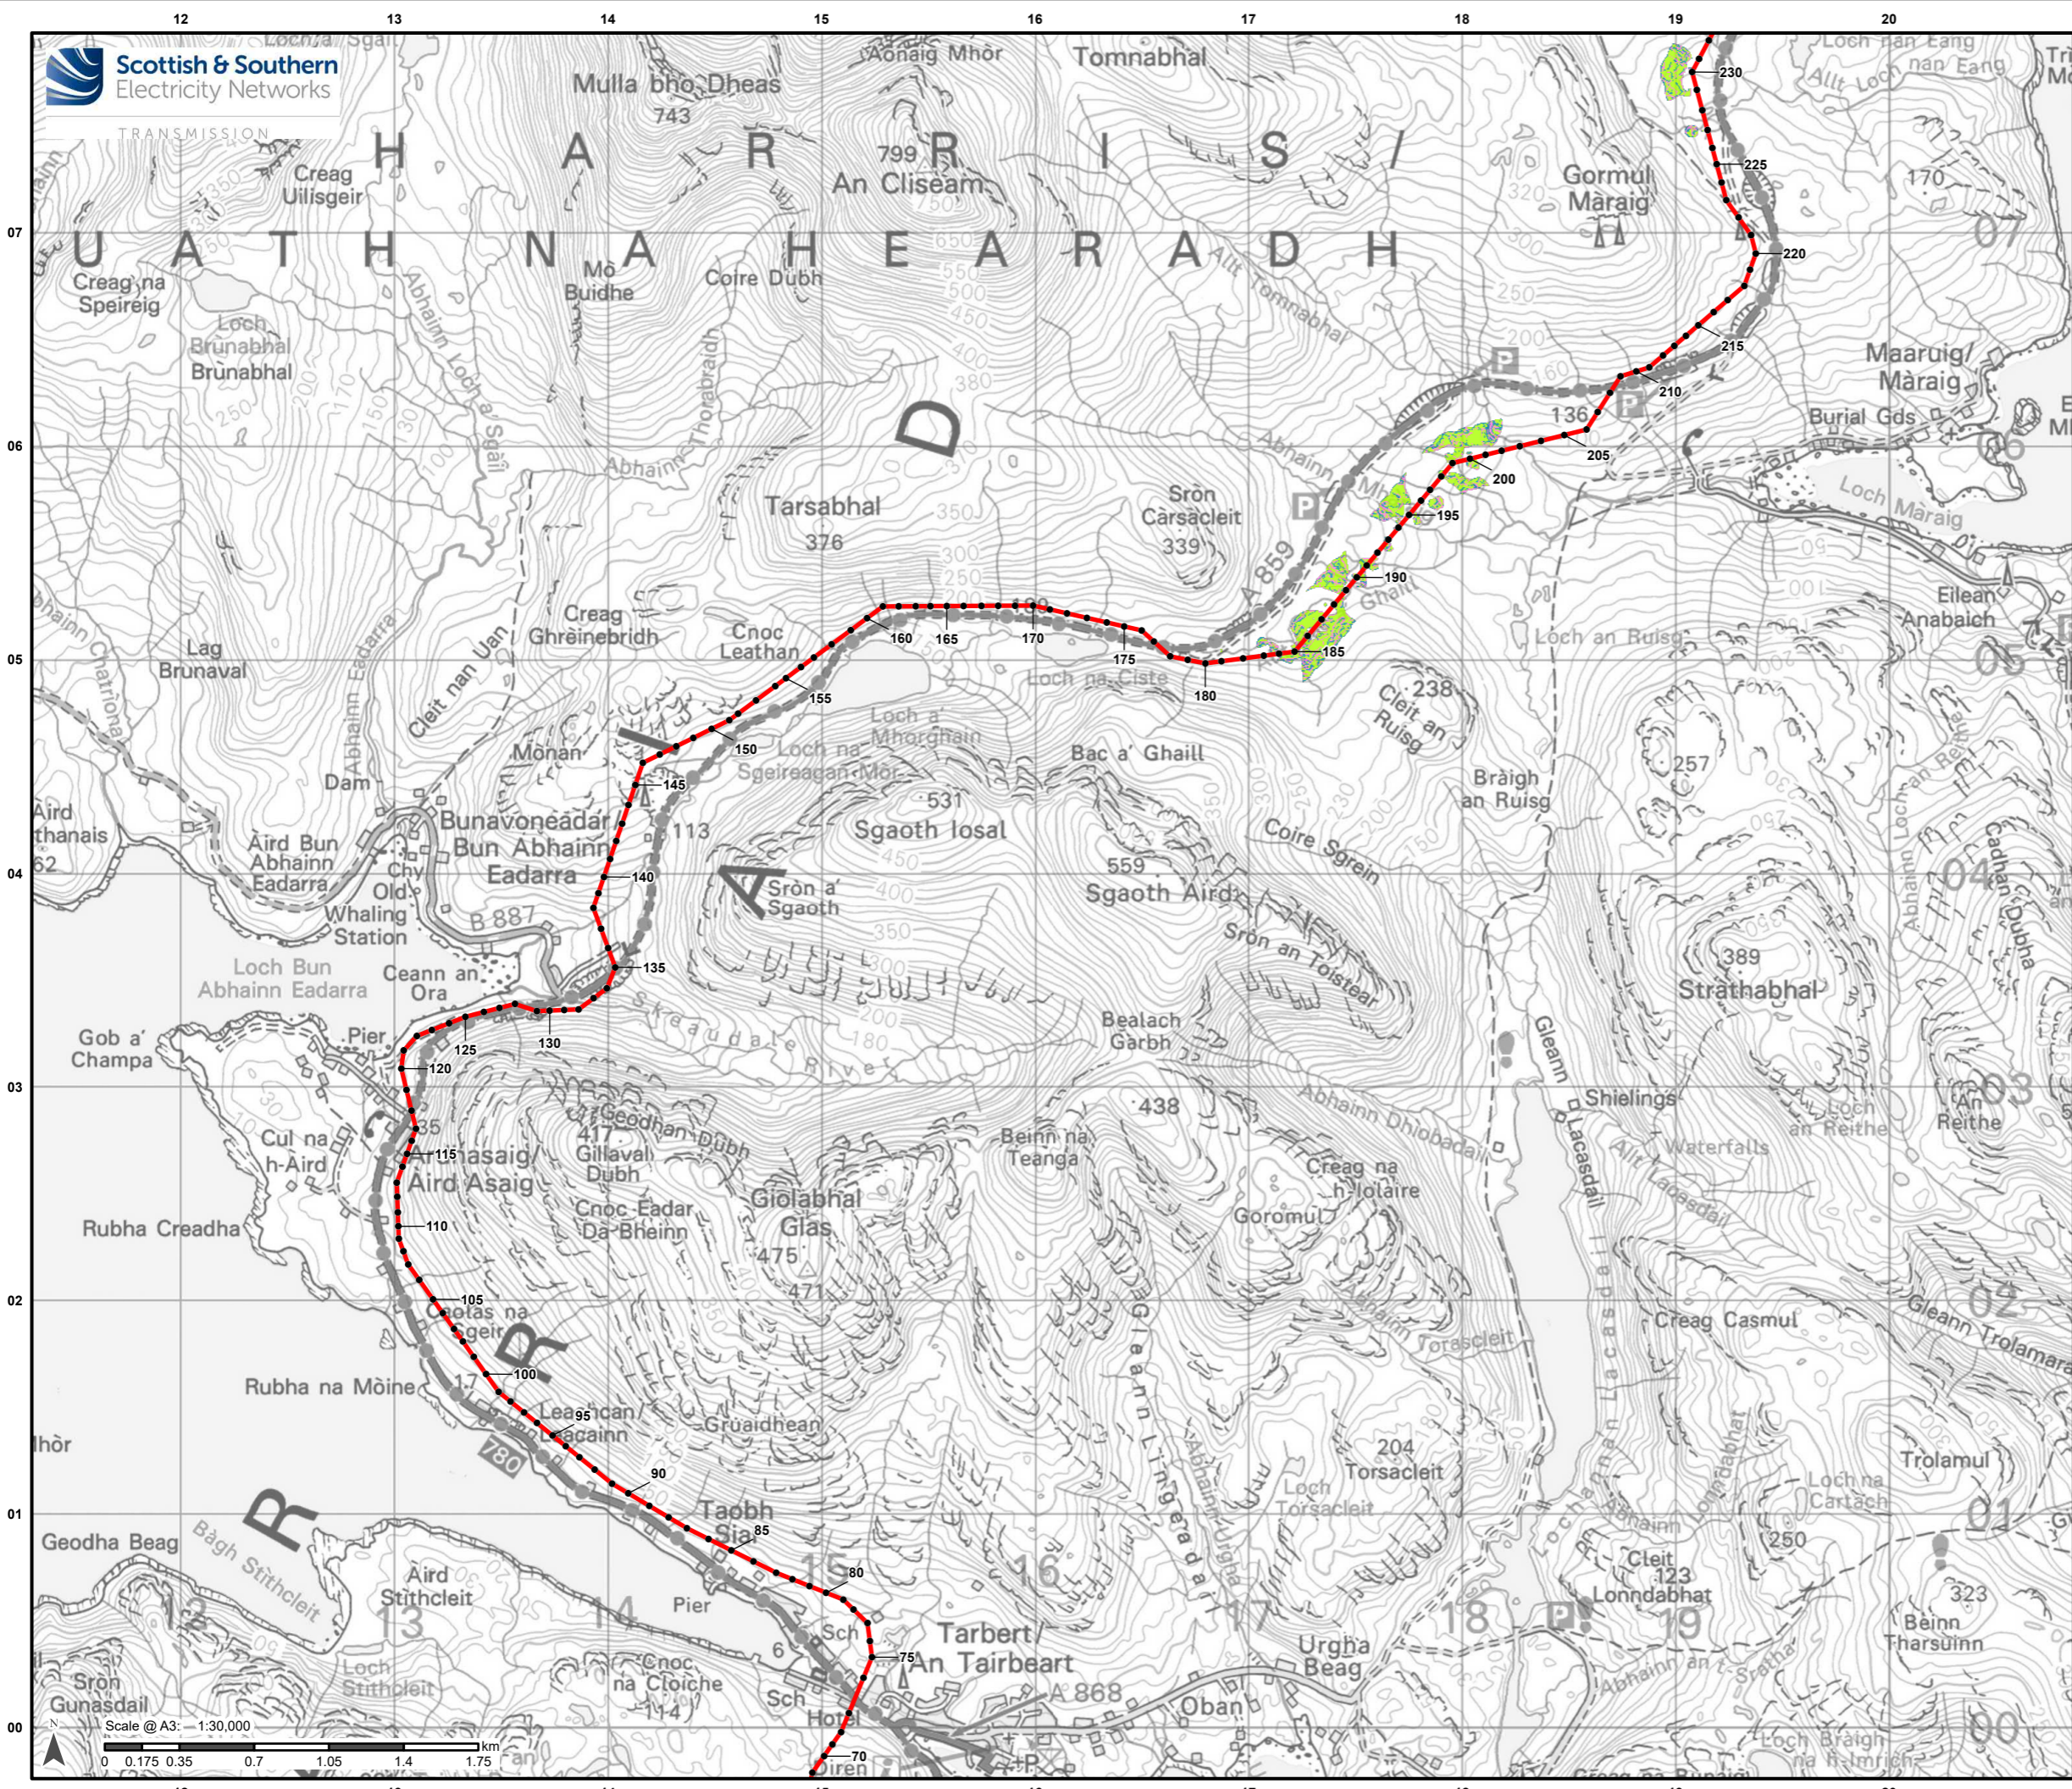

Legend

- Proposed Alignment
 - Indicative Pole Location
- Profile convexity scores (C)**
- Score 0: Rectilinear slope
 - Score 2: Concave slope
 - Score 3: Convex slope

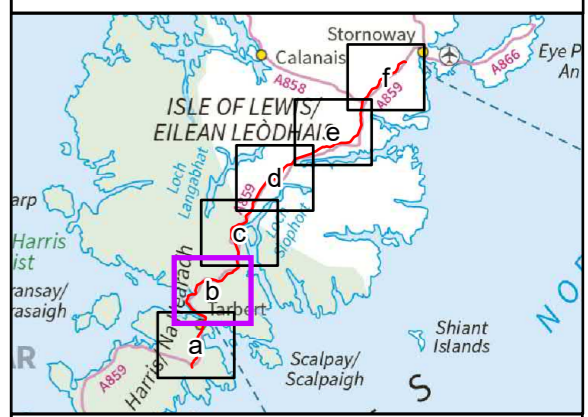

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245

Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7gb: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Convexity Score



Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B



Legend

- Proposed Alignment
- Indicative Pole Location
- Profile convexity scores (C)**
- Score 0: Rectilinear slope
- Score 2: Concave slope
- Score 3: Convex slope

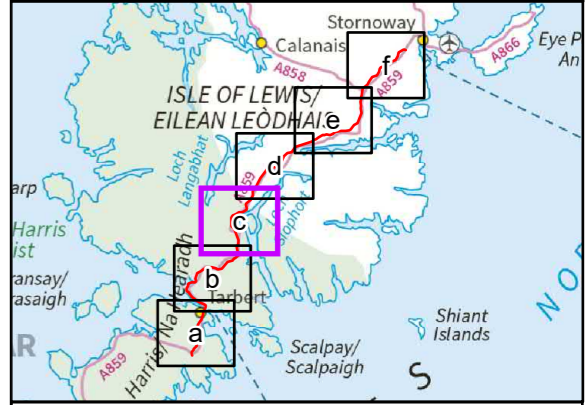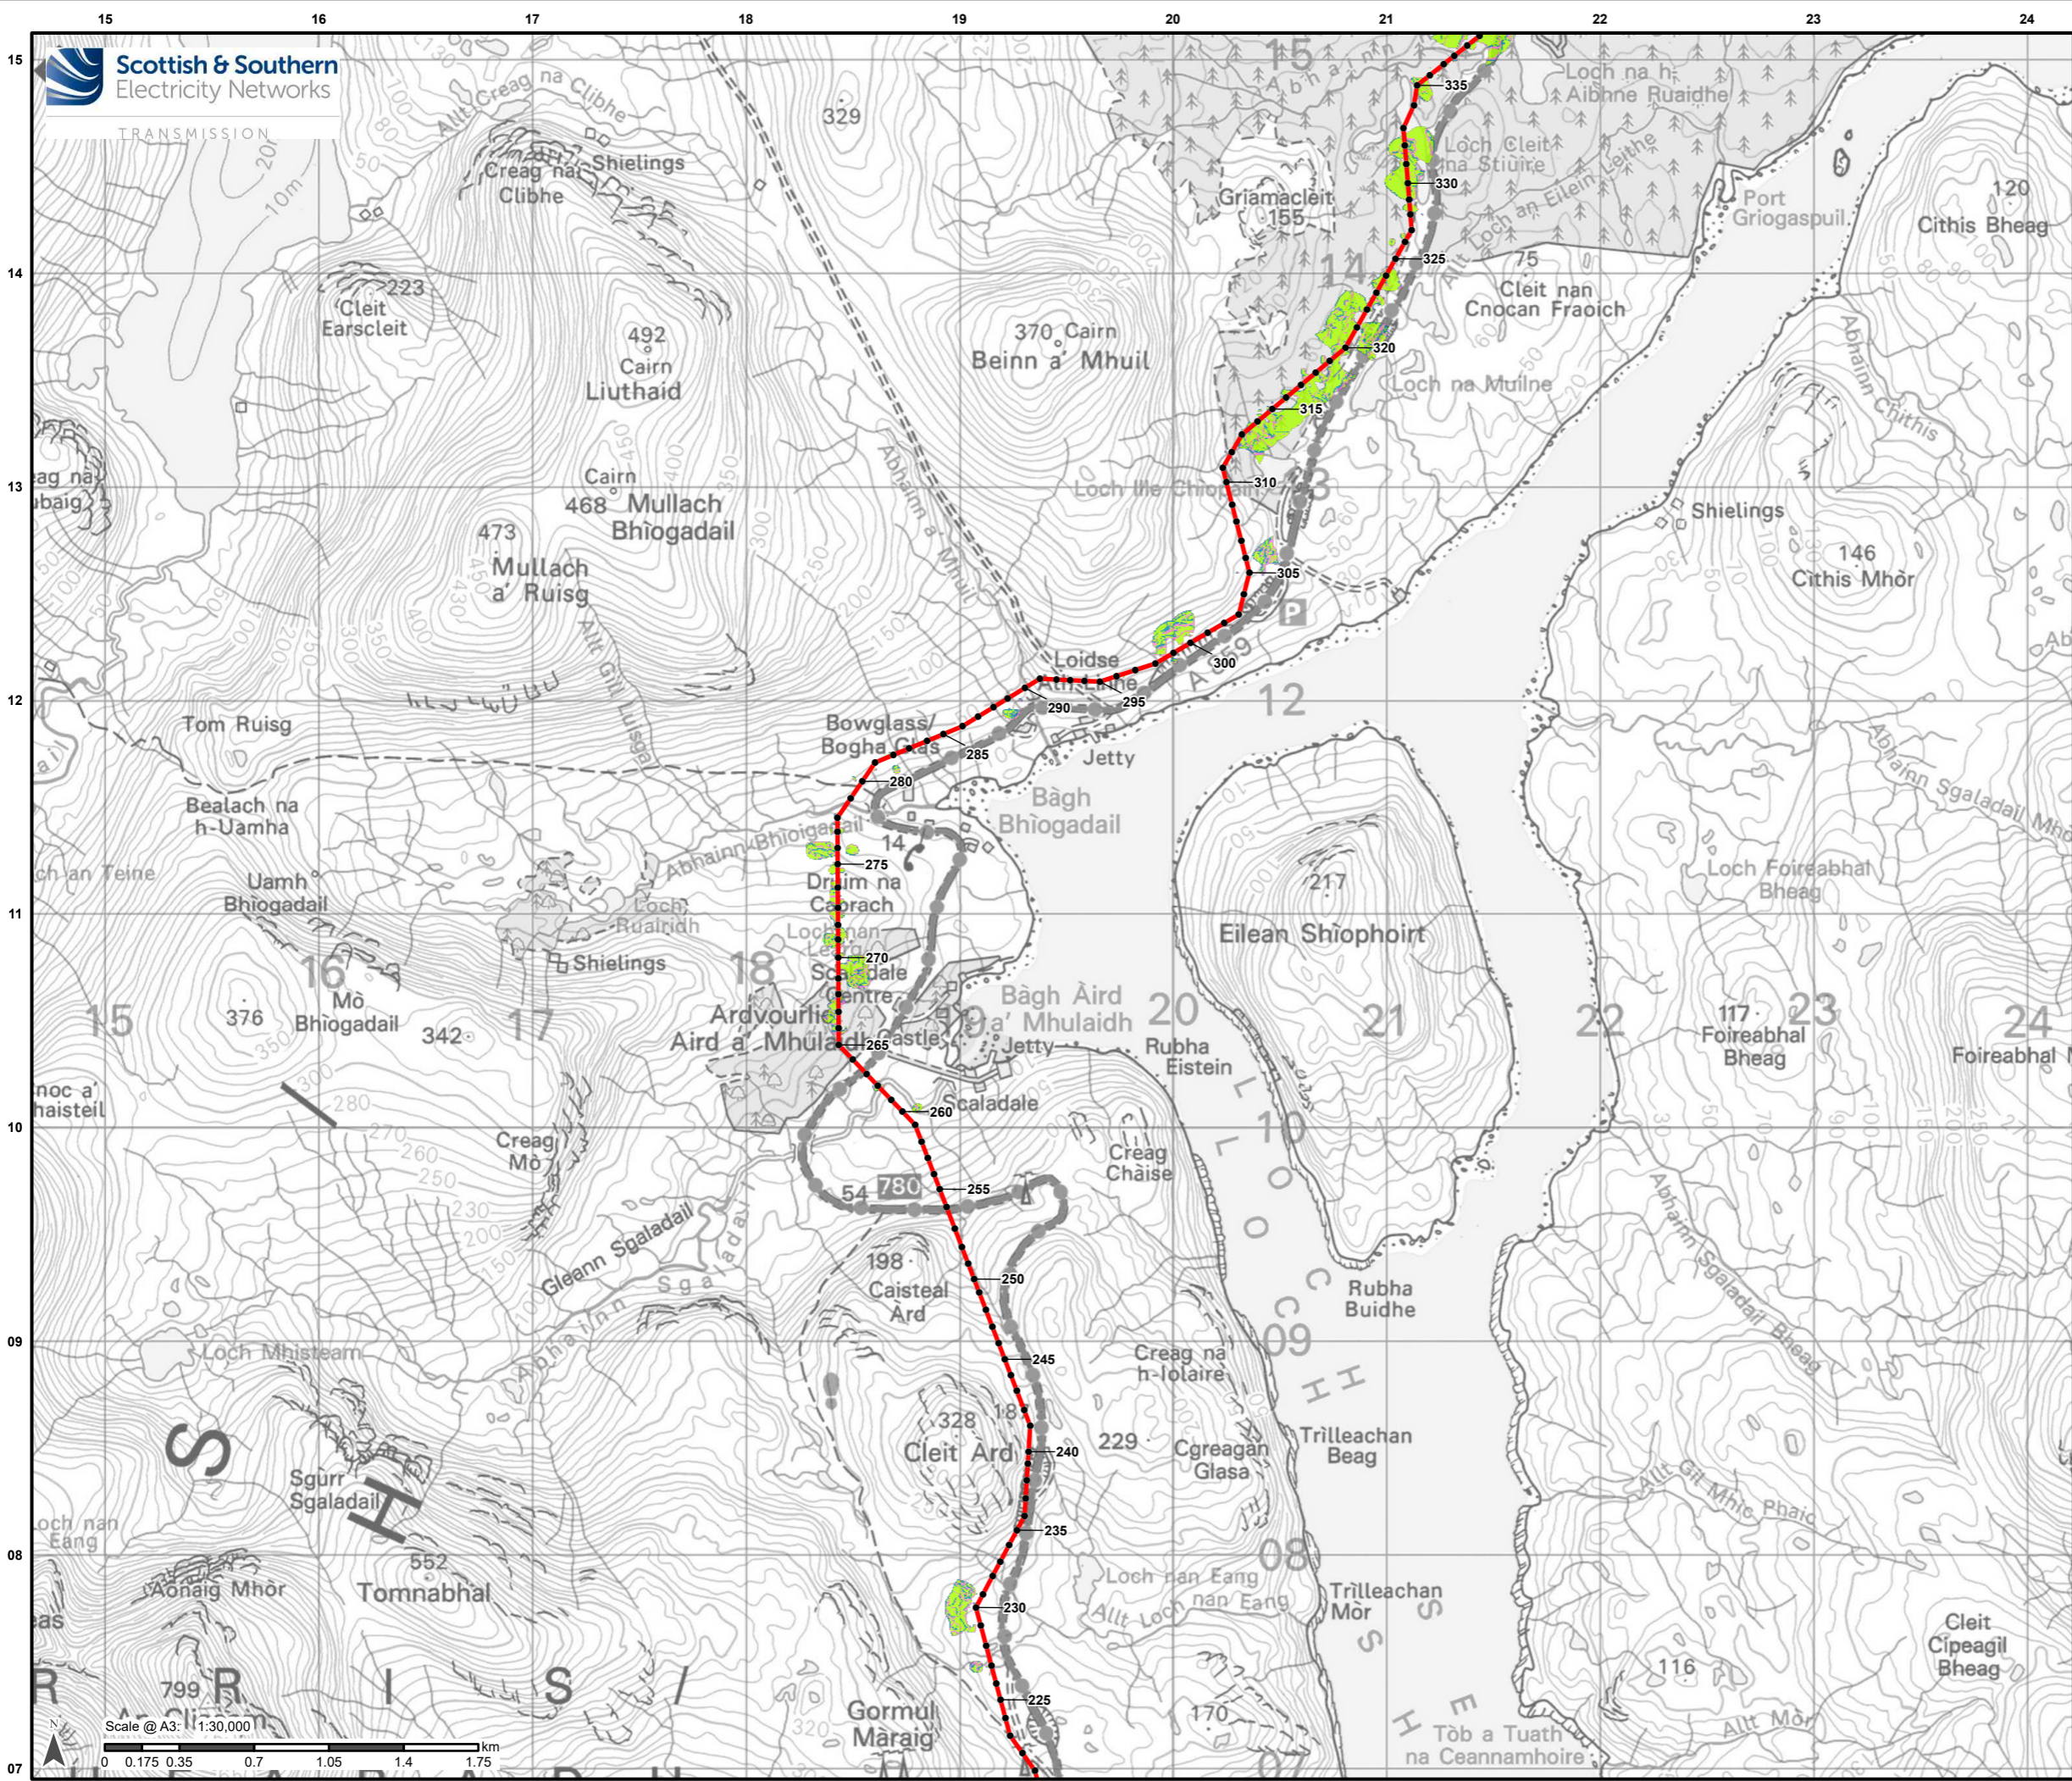


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number 0100022432.




Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title:
Figure 10.3.7gvc:
Peat Landslide Hazard and Risk Assessment:
Contributing Factor - Convexity Score

Drawn by: AB
Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B



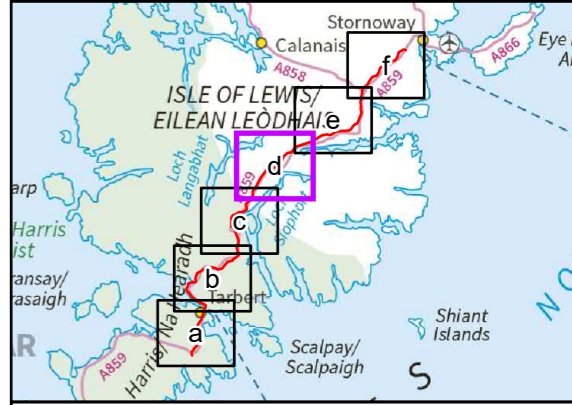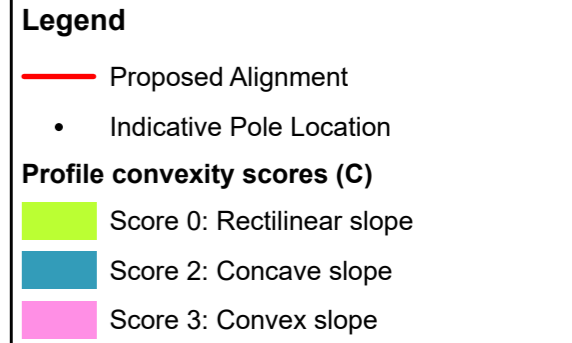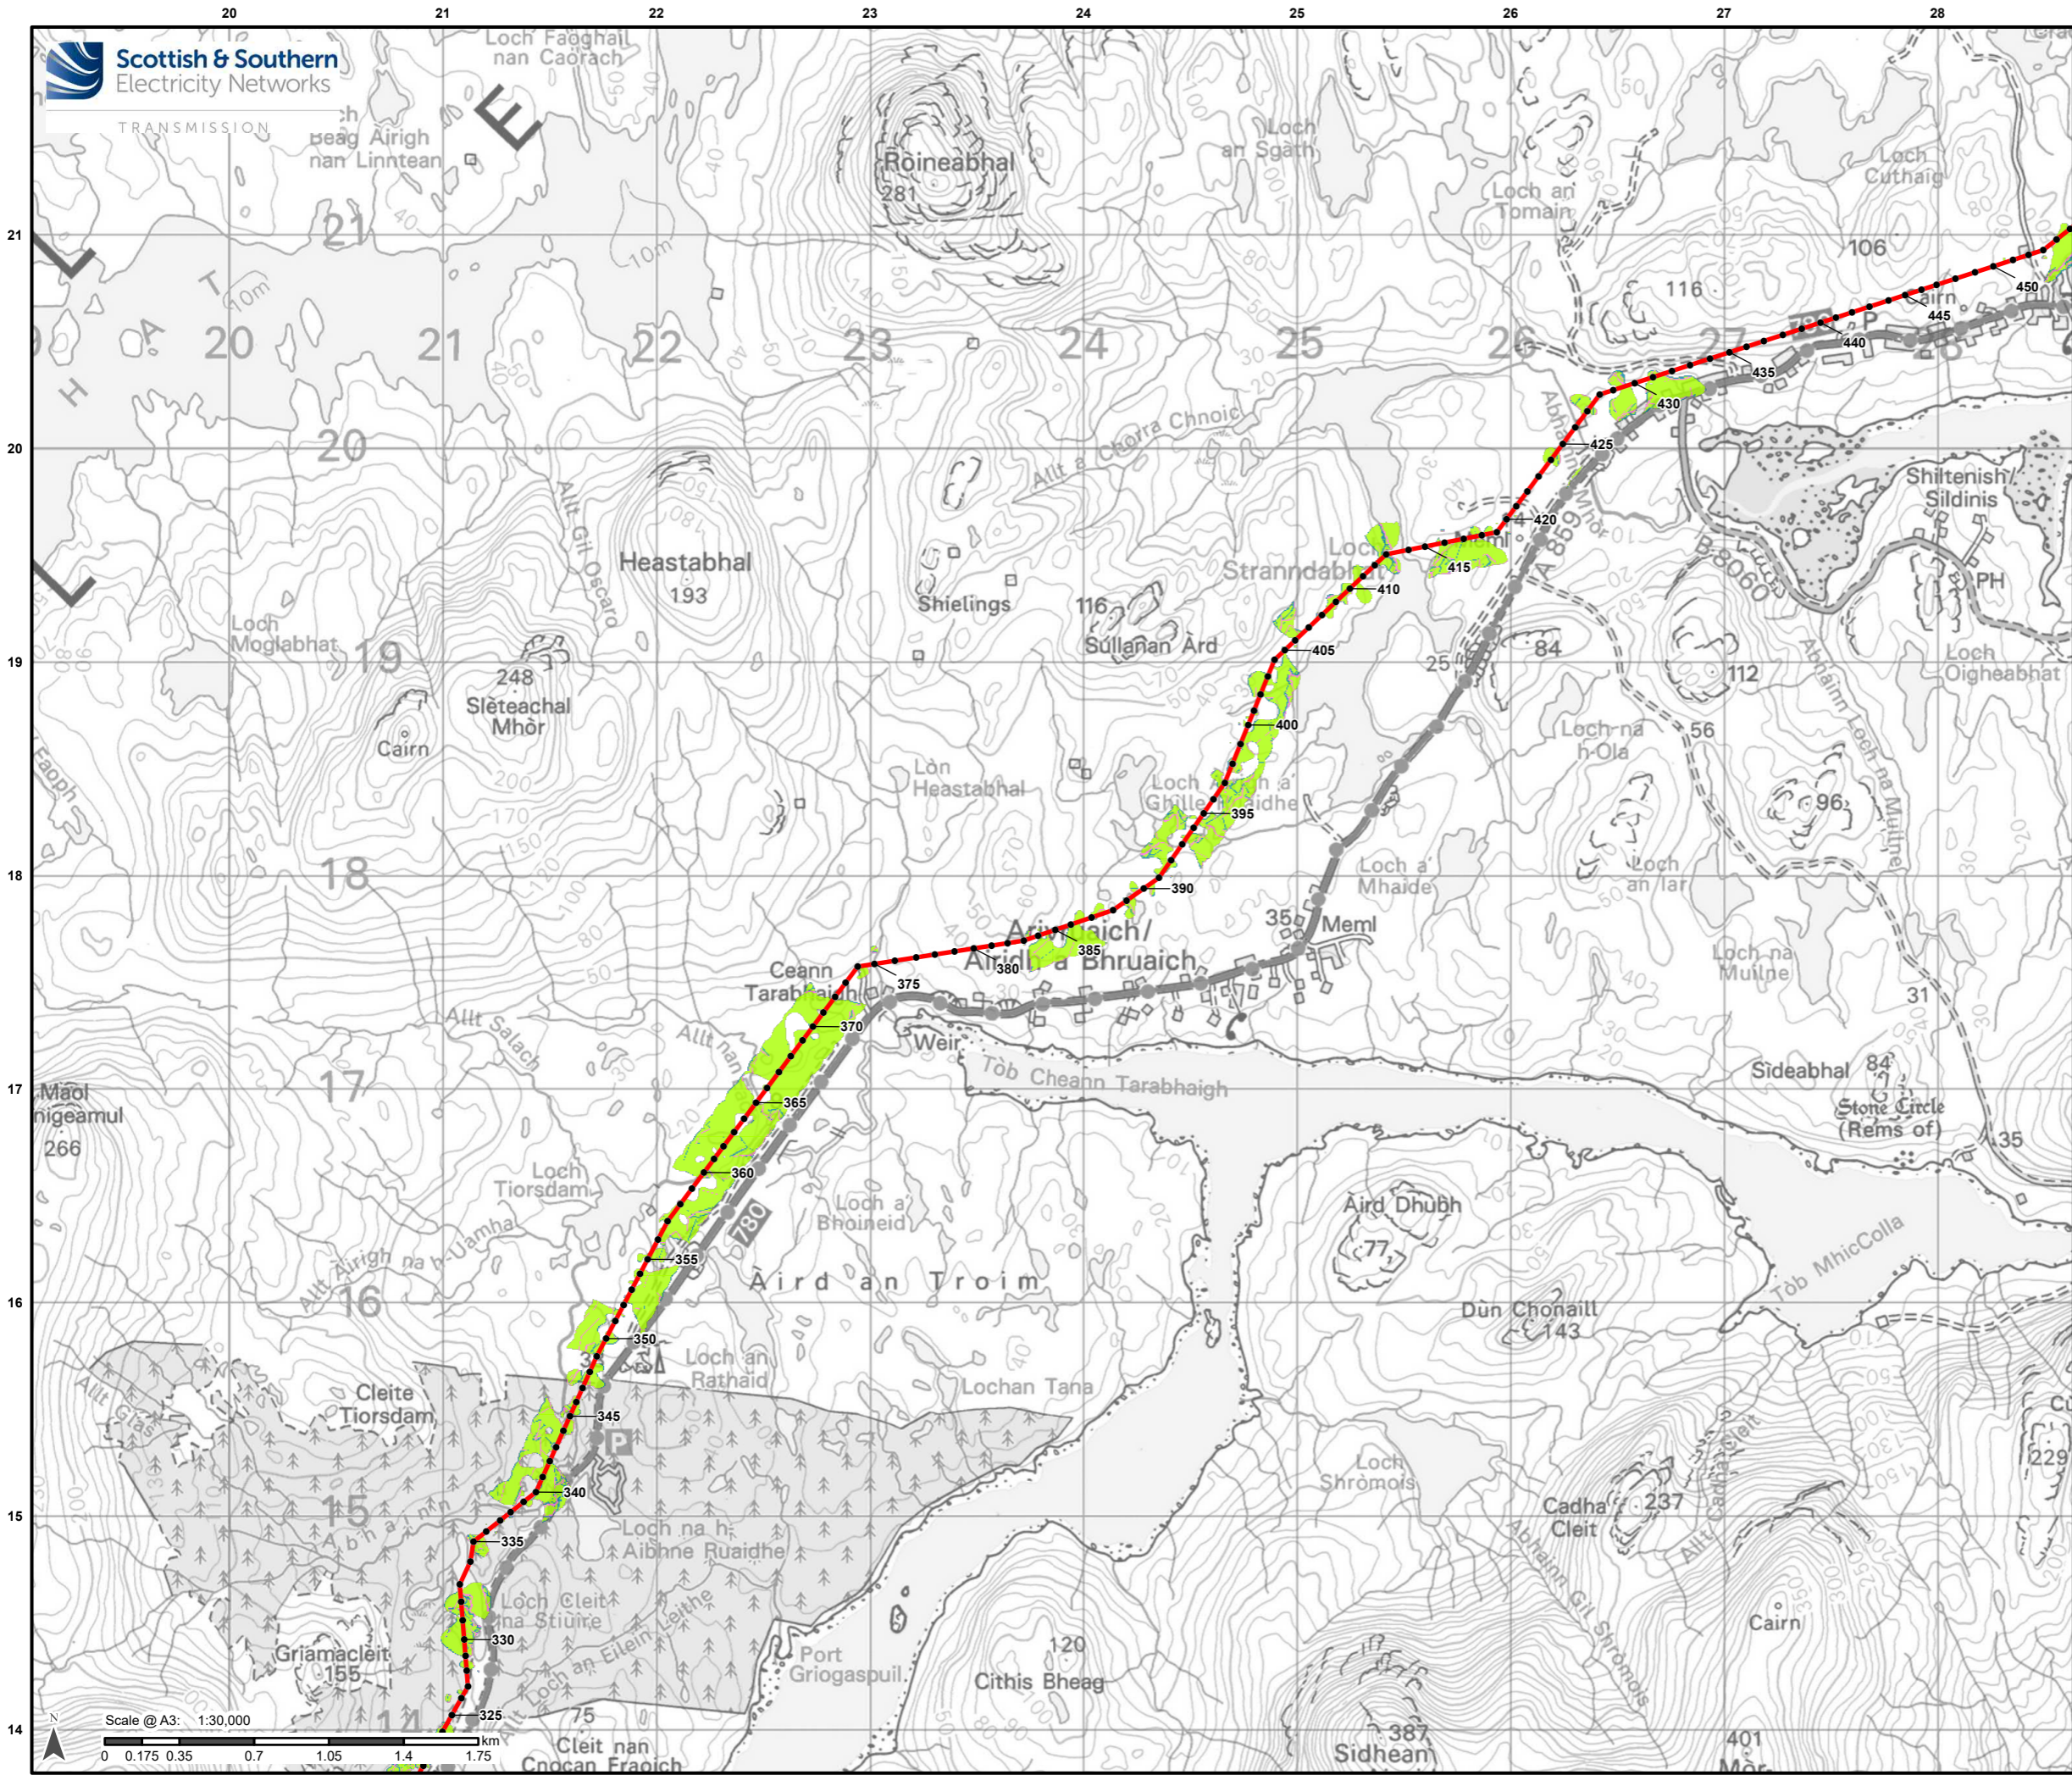


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7g/d: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Convexity Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B



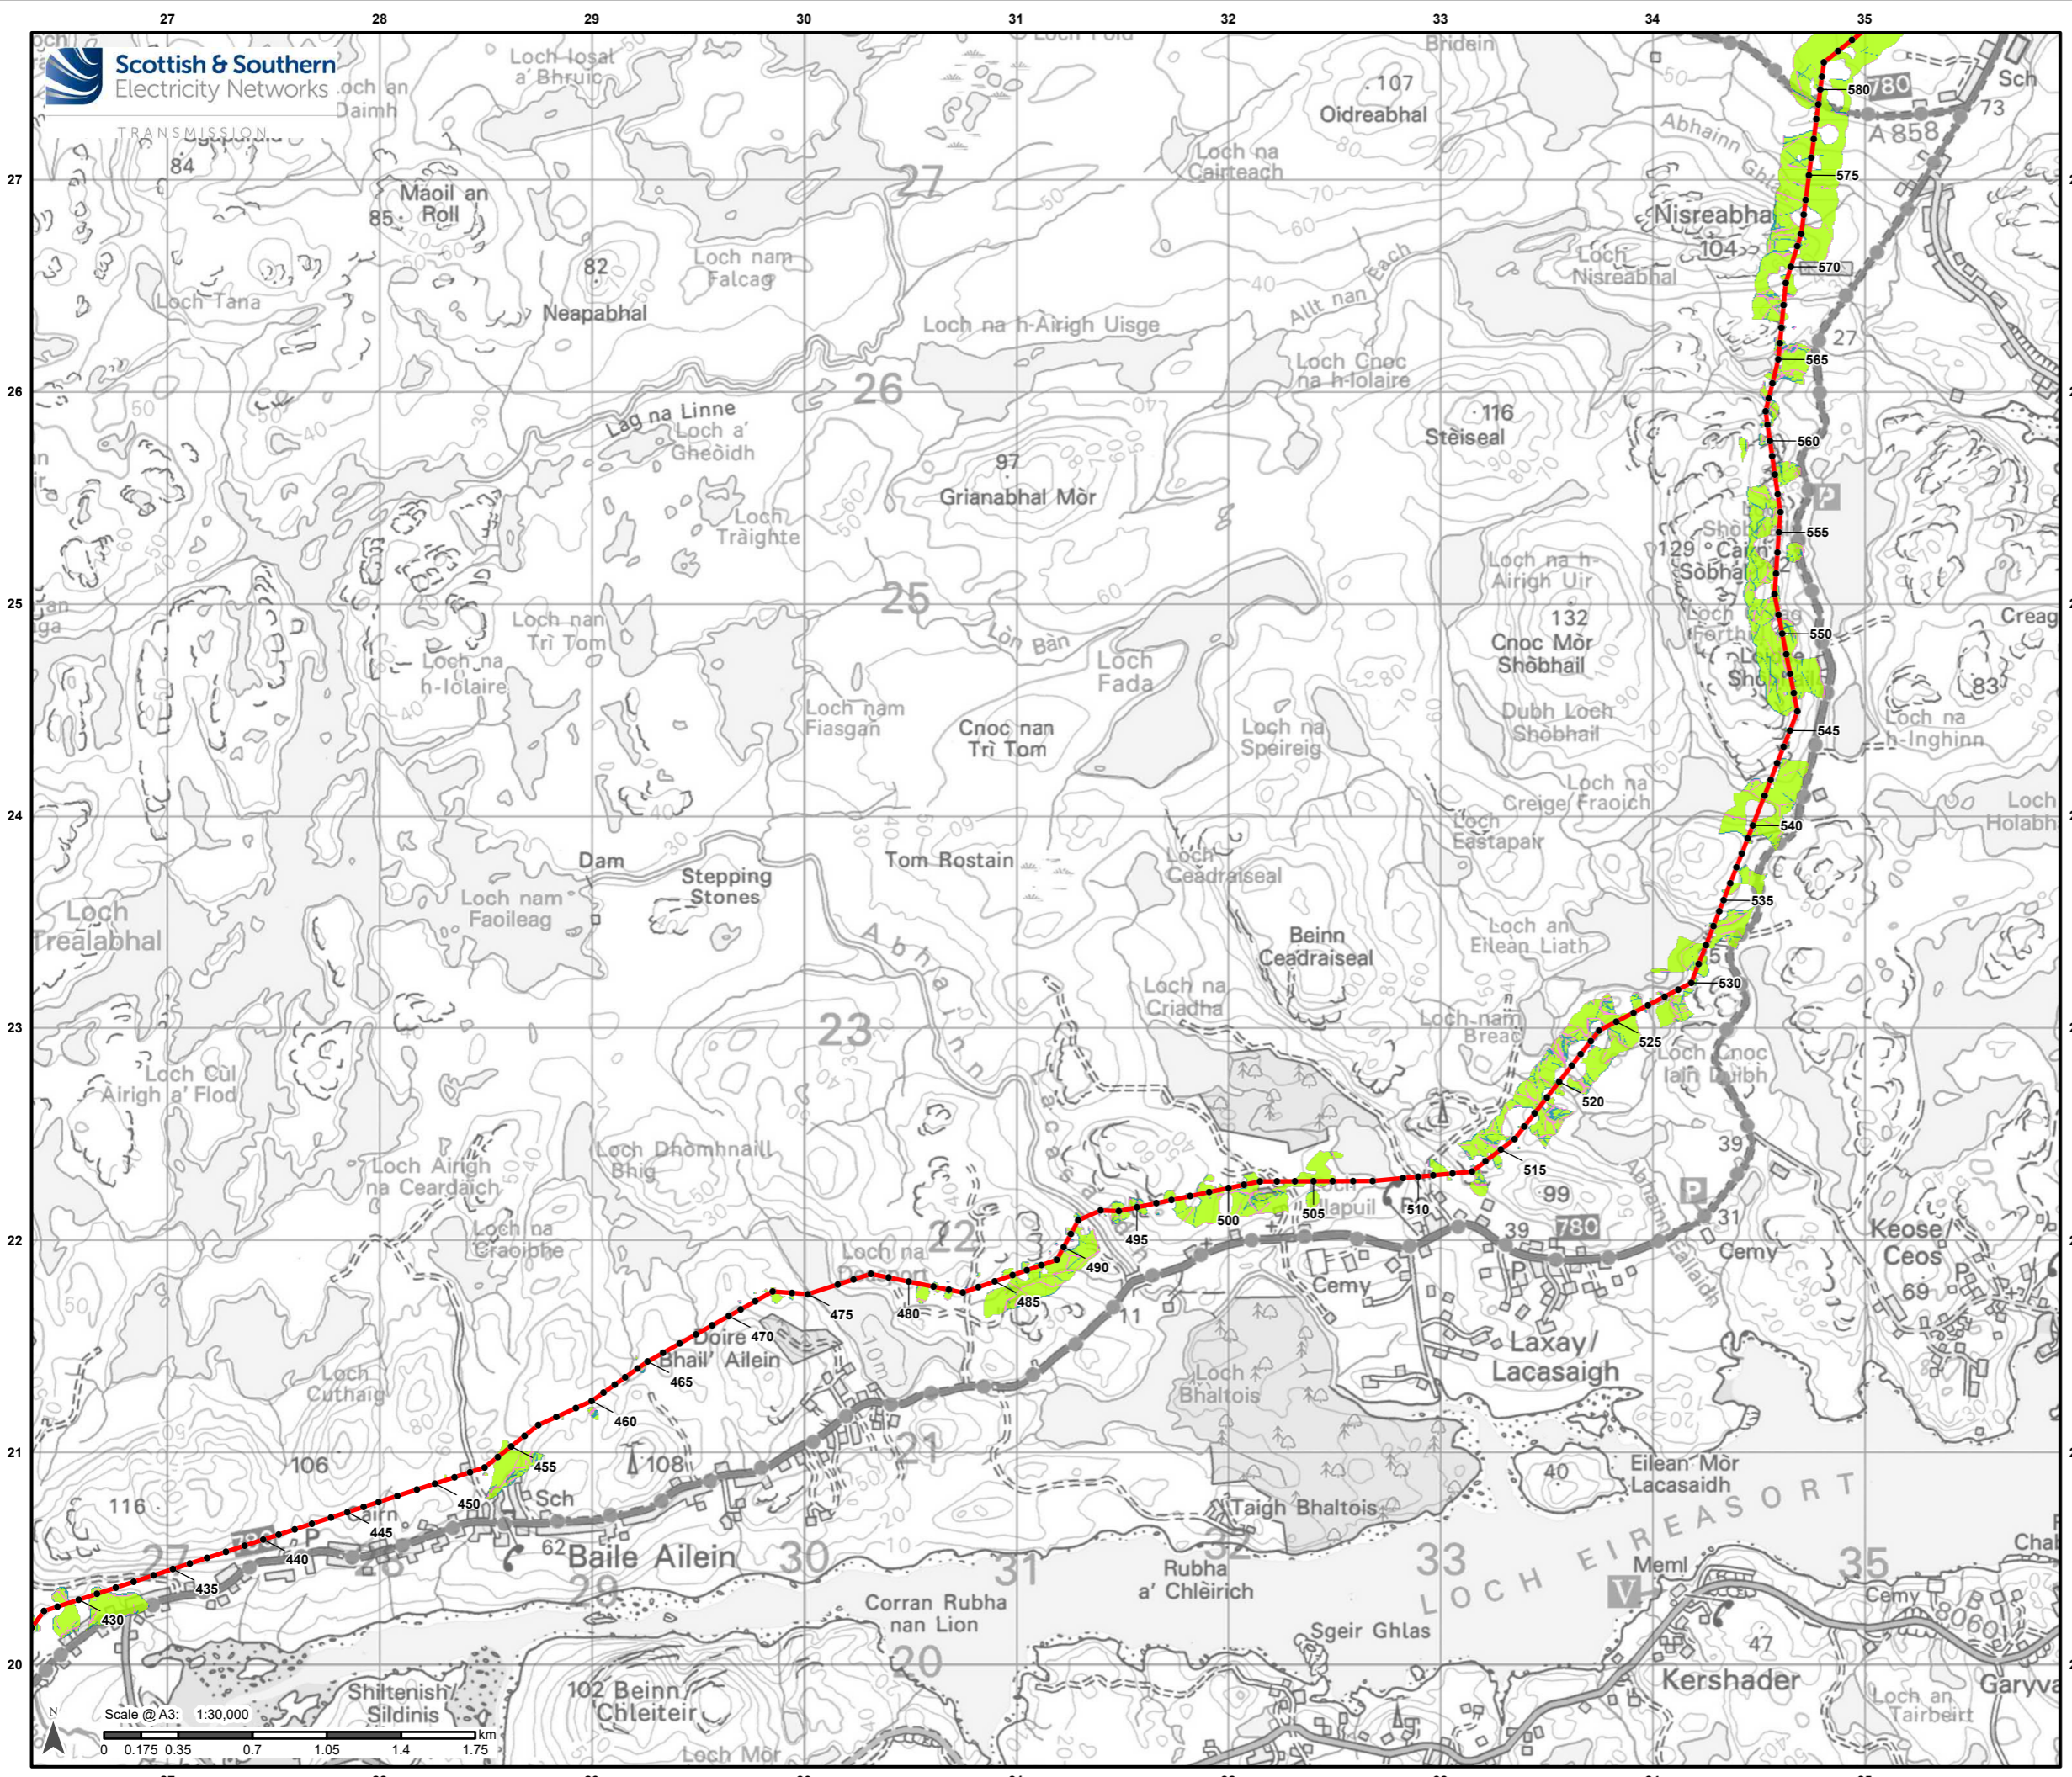


Legend

- Proposed Alignment
- Indicative Pole Location

Profile convexity scores (C)

- Score 0: Rectilinear slope
- Score 2: Concave slope
- Score 3: Convex slope

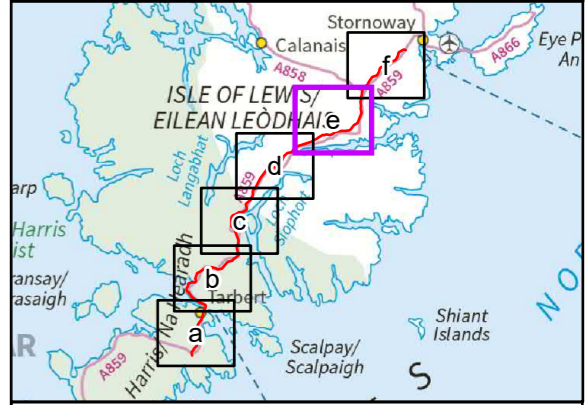


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7g: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Convexity Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B

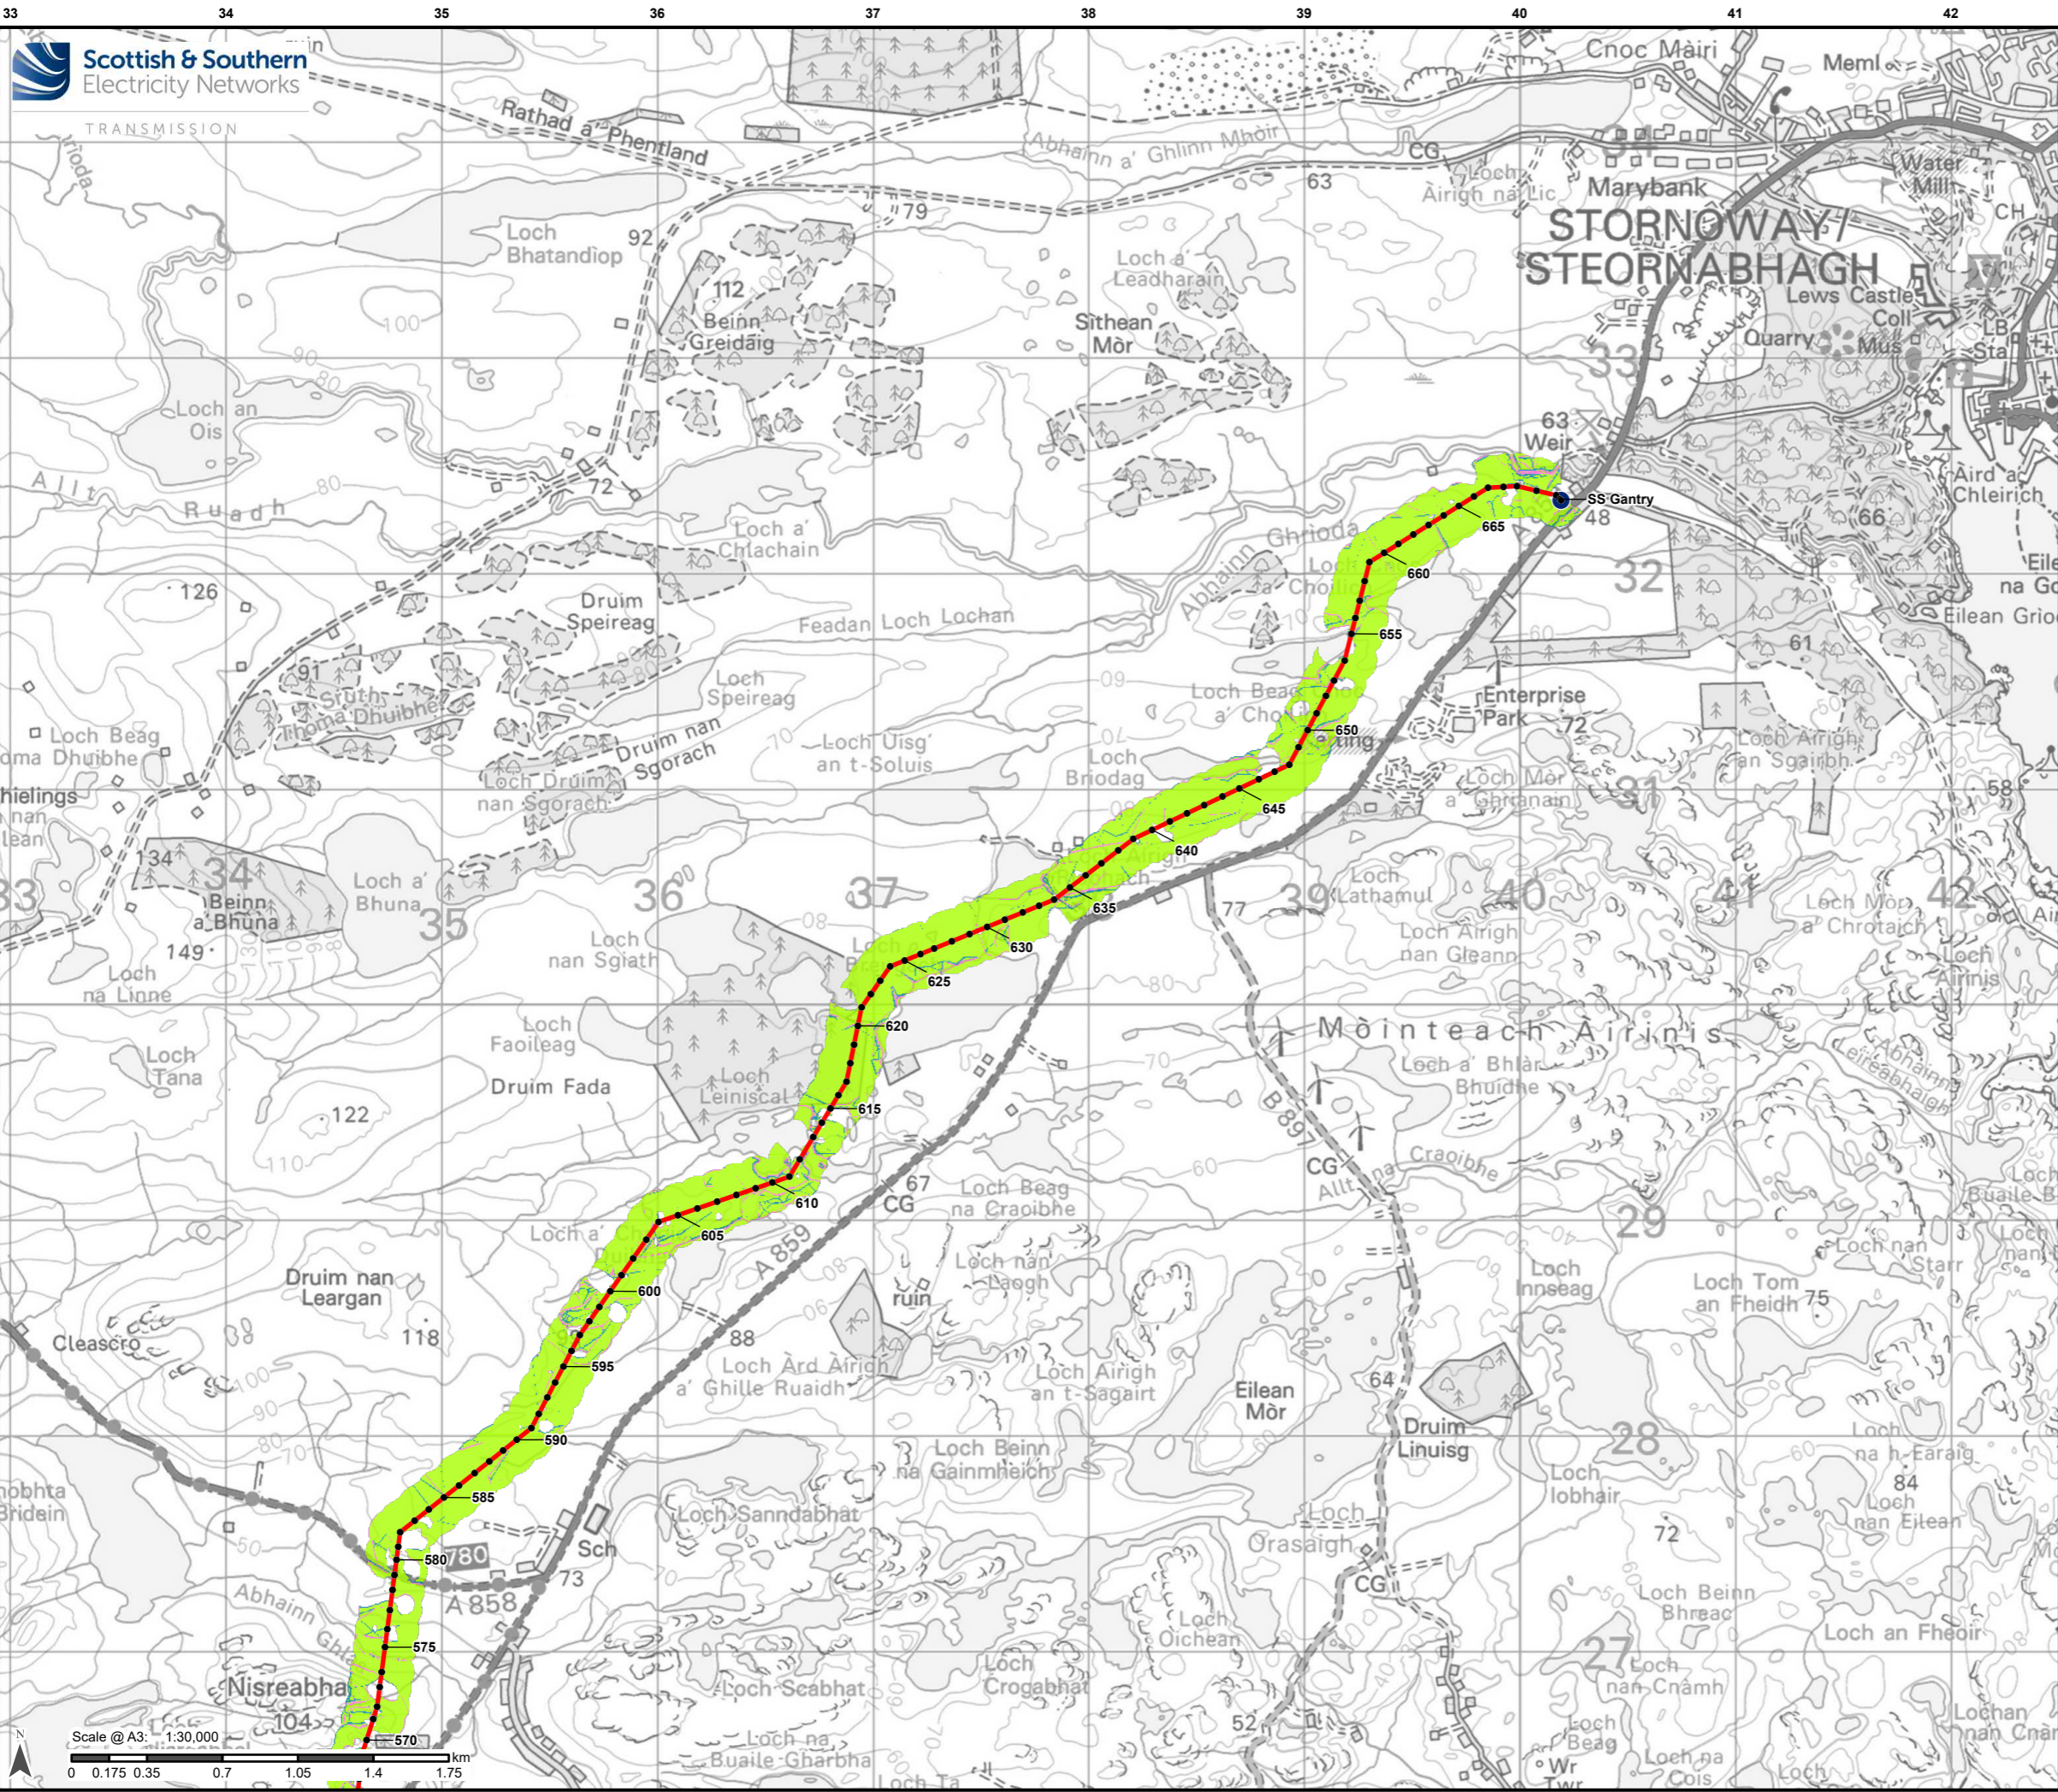


Legend

- Proposed Alignment
- Indicative Pole Location
- Stornoway Substation

Profile convexity scores (C)

- Score 0: Rectilinear slope
- Score 2: Concave slope
- Score 3: Convex slope

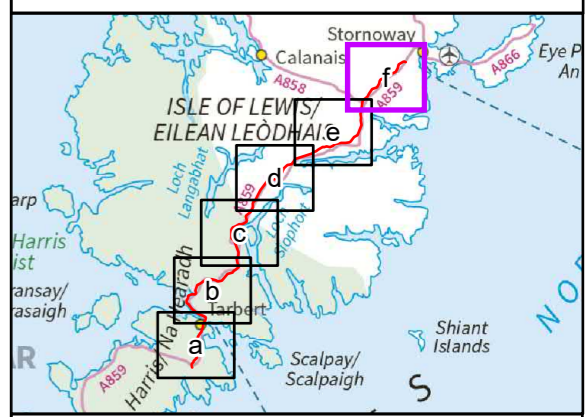

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.7g-f: Peat Landslide Hazard and Risk Assessment: Contributing Factor - Convexity Score

Drawn by: AB Date: 01/09/2022

Drawing: R162_11469_001_Fig10-3-7g_ContribFactConvexity_B