


ANNEX A – FIGURES

Figure 10.3.8a- 10.3.8f

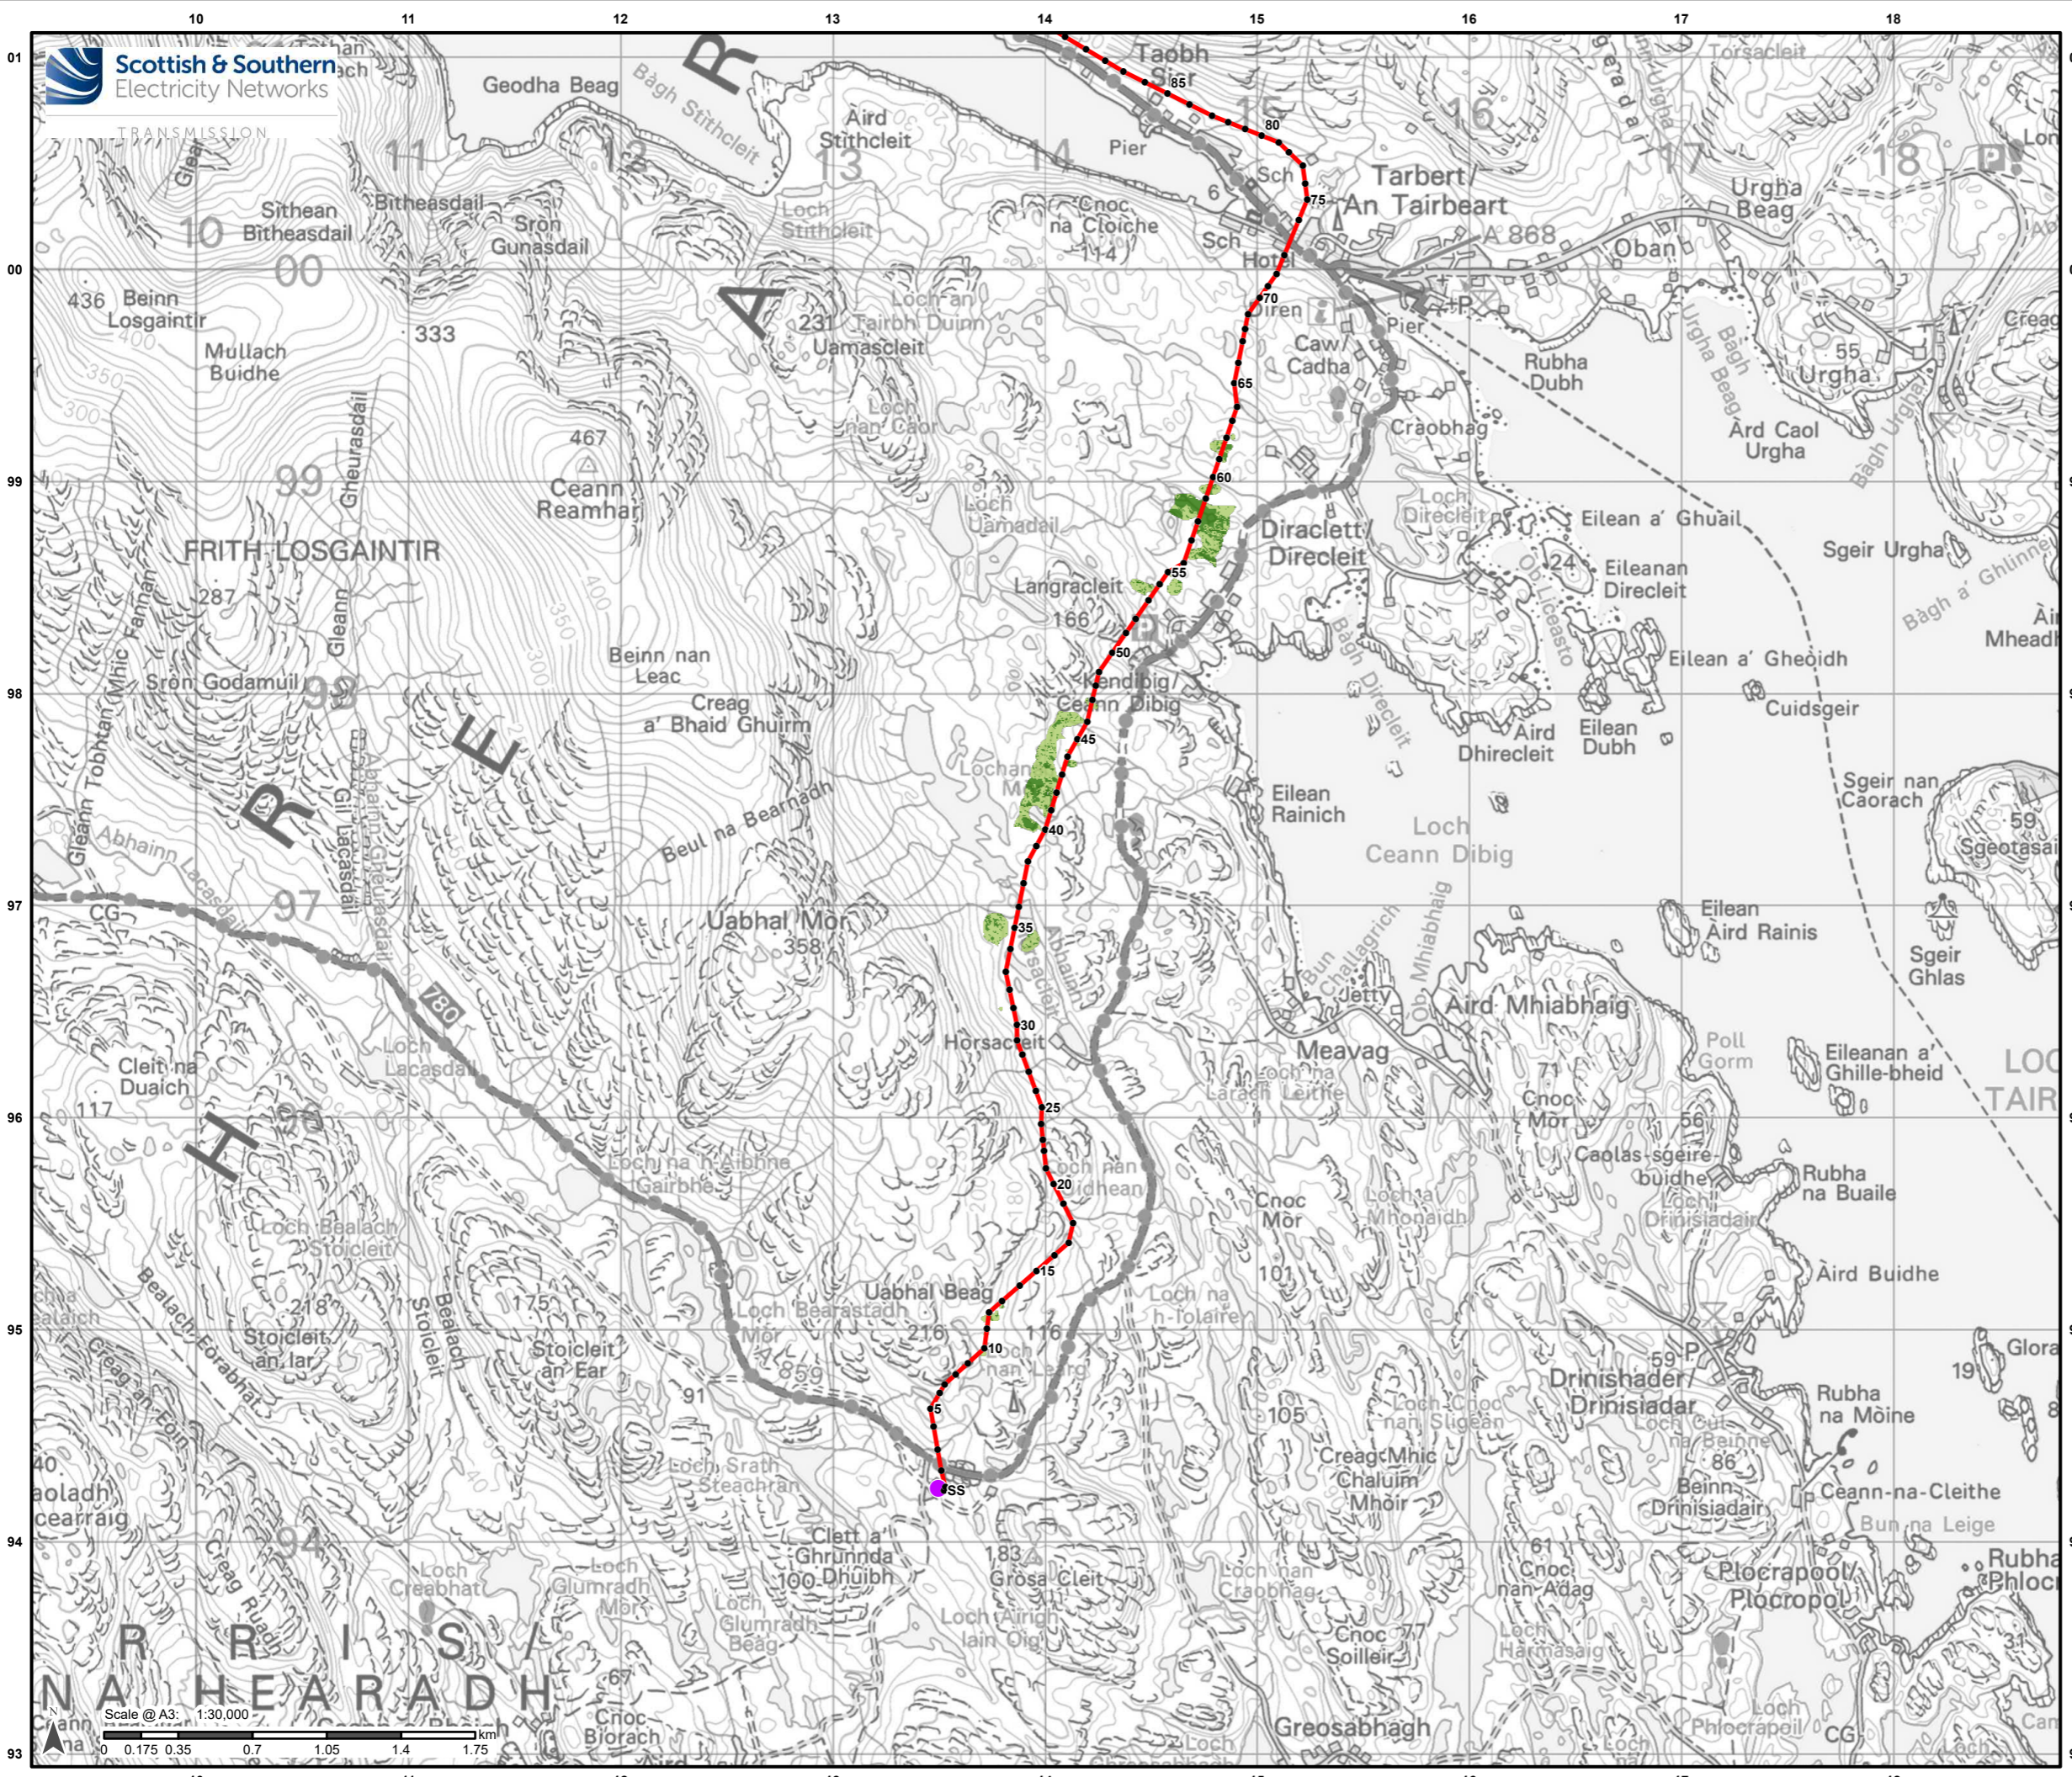


Legend

- Proposed Alignment
- Indicative Pole Location
- Harris 132kV Grid Supply Point

Summed Score / Likelihood Score

- 2 - 6 (Very Low, 1)
- 7 - 11 (Low, 2)
- 12 - 16 (Moderate, 3)

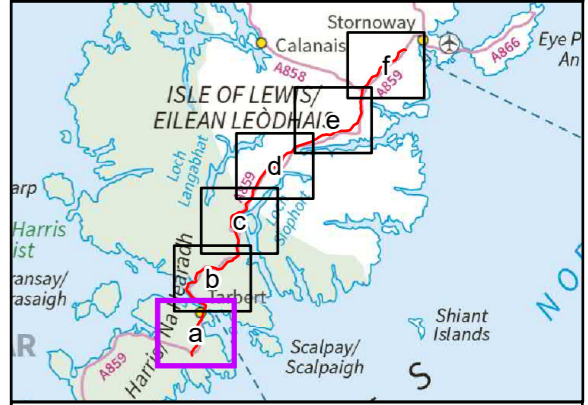


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title:
Figure 10.3.8a:
Peat Landslide Hazard and Risk Assessment:
Peat Slide Likelihood

Drawn by: AB
Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A



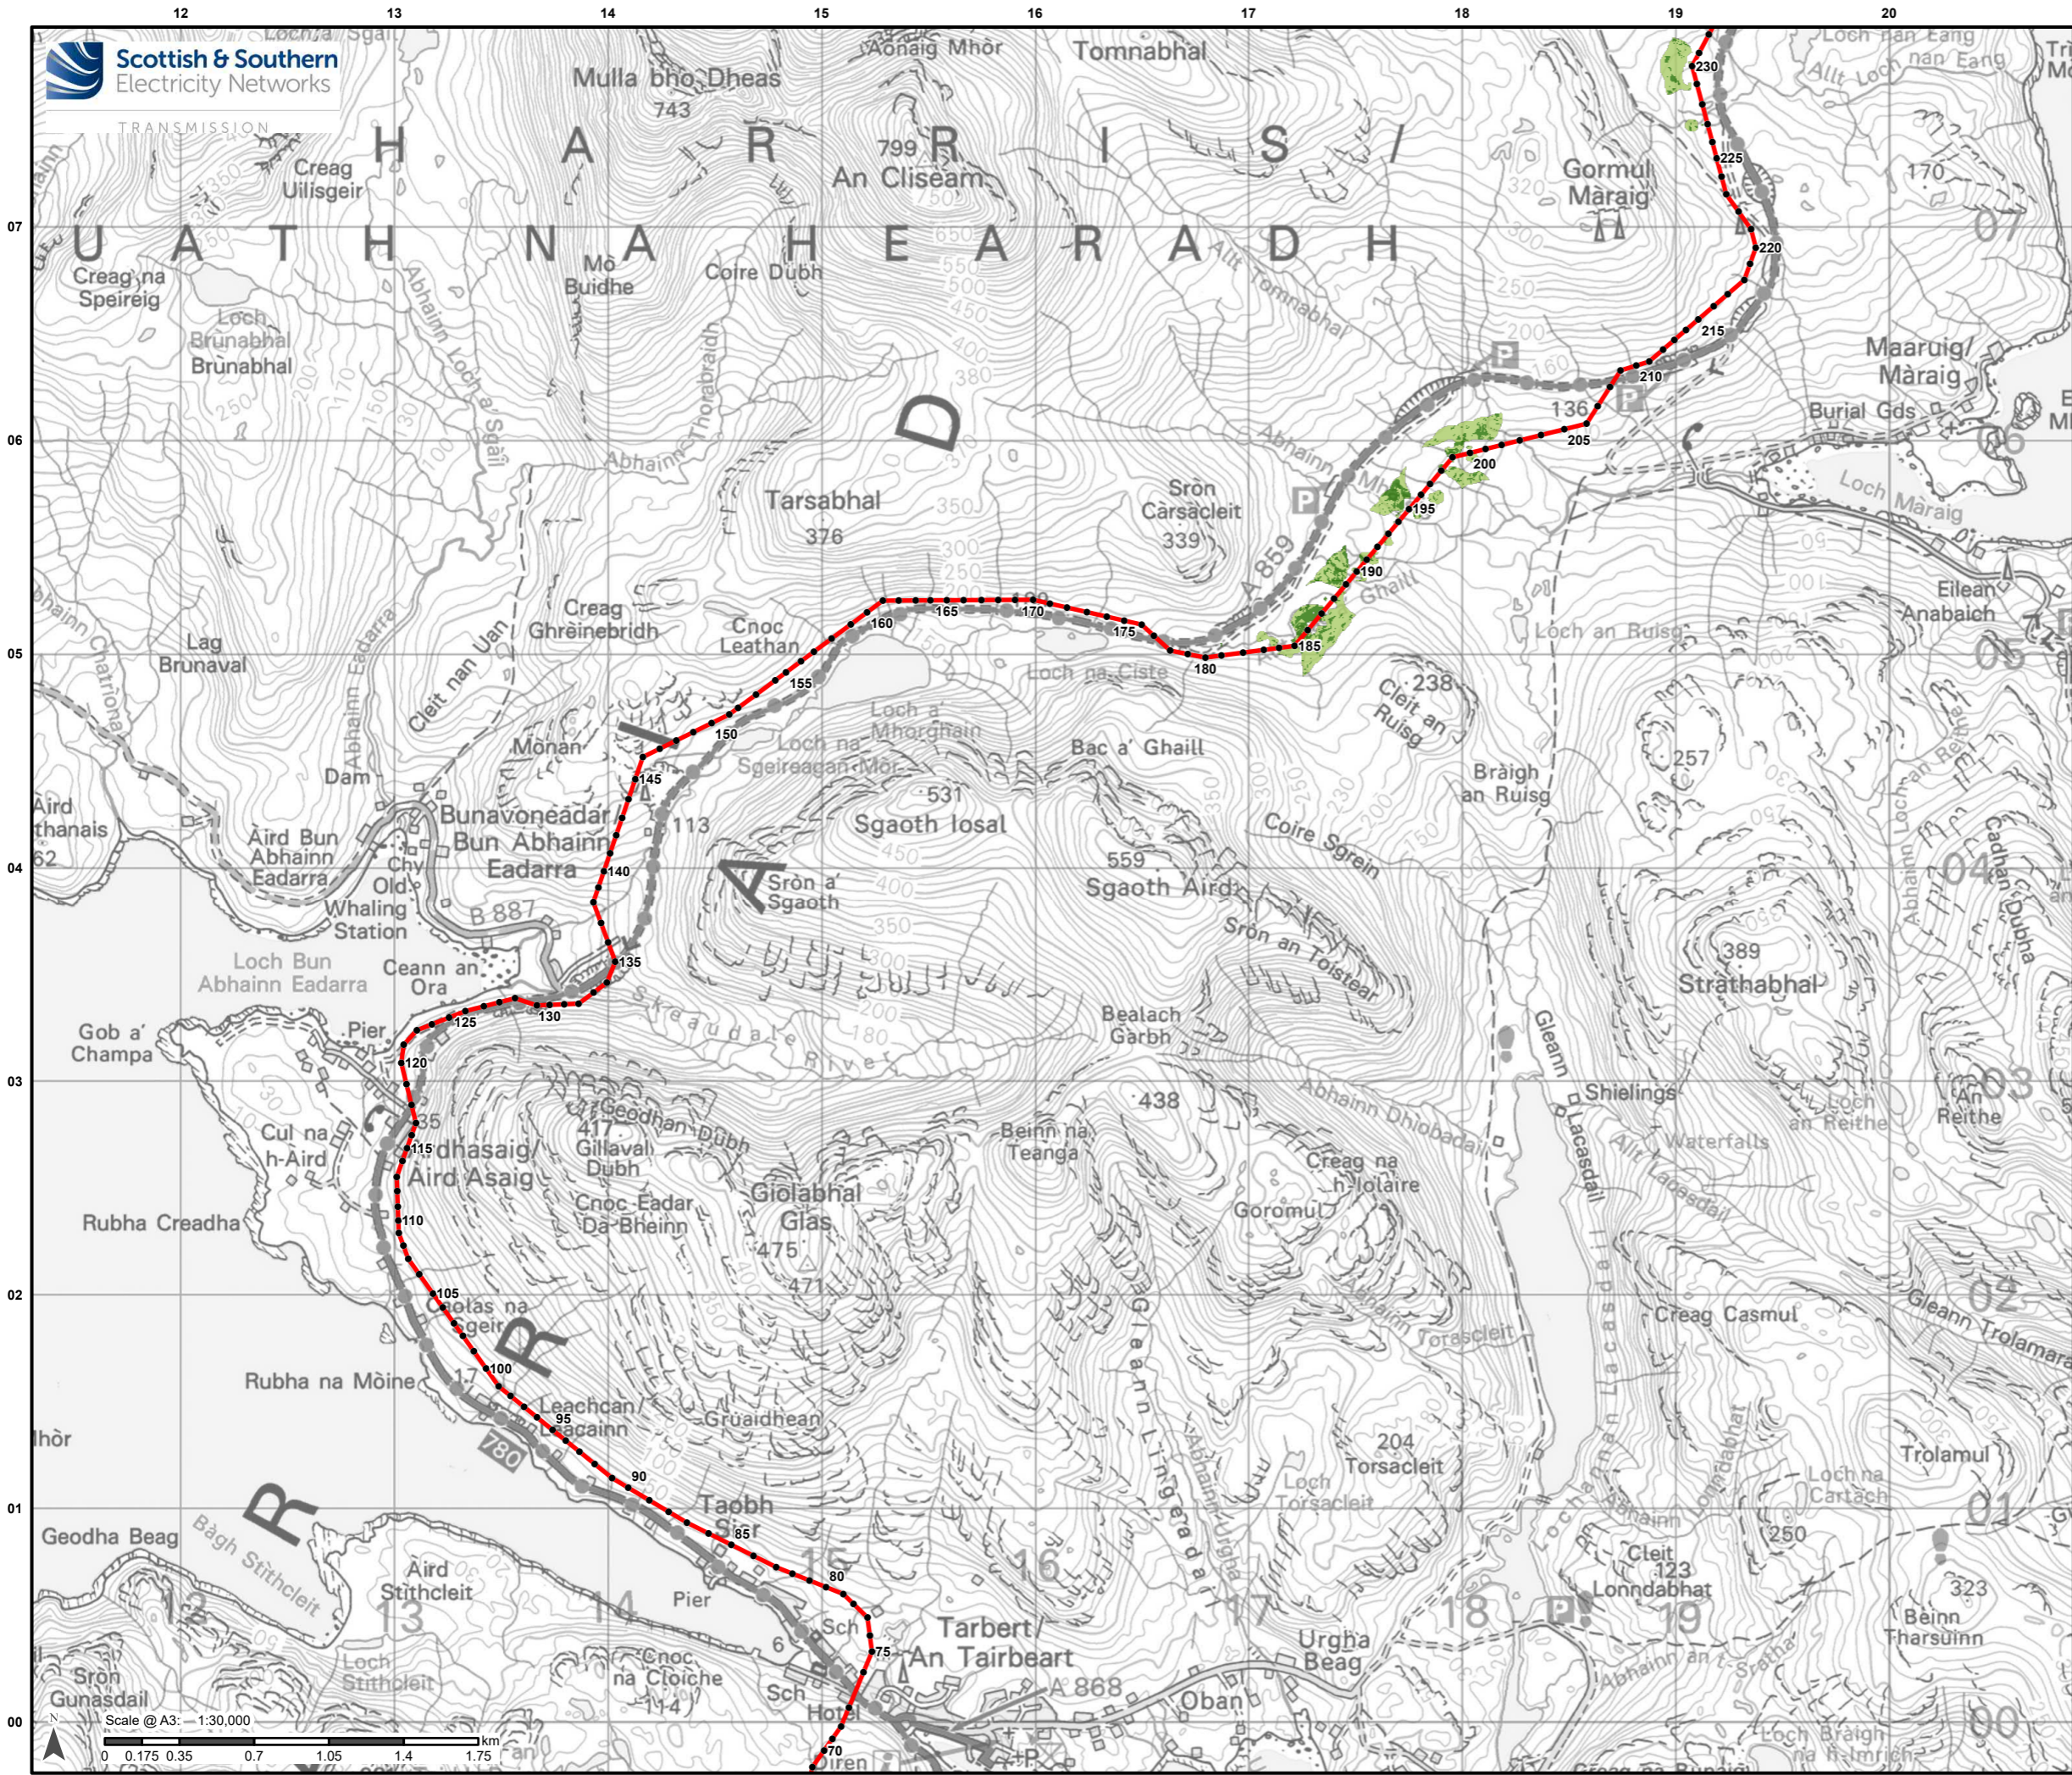


Legend

- Proposed Alignment
- Indicative Pole Location

Summed Score / Likelihood Score

- 2 - 6 (Very Low, 1)
- 7 - 11 (Low, 2)

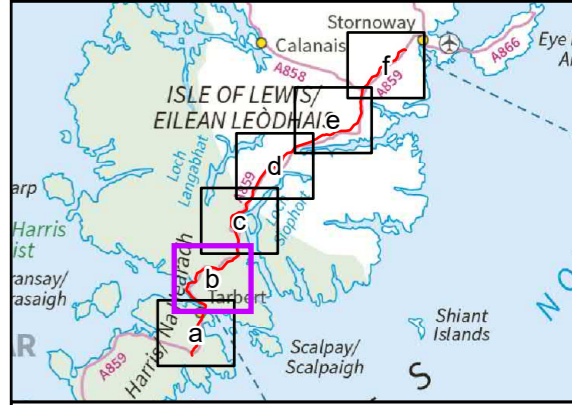


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.8b:
Peat Landslide Hazard and Risk Assessment:
Peat Slide Likelihood



Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A



Legend

- Proposed Alignment
 - Indicative Pole Location
- Summed Score / Likelihood Score**
- 2 - 6 (Very Low, 1)
 - 7 - 11 (Low, 2)
 - 12 - 16 (Moderate, 3)

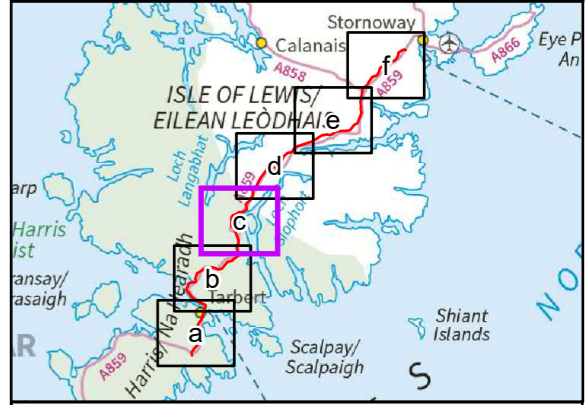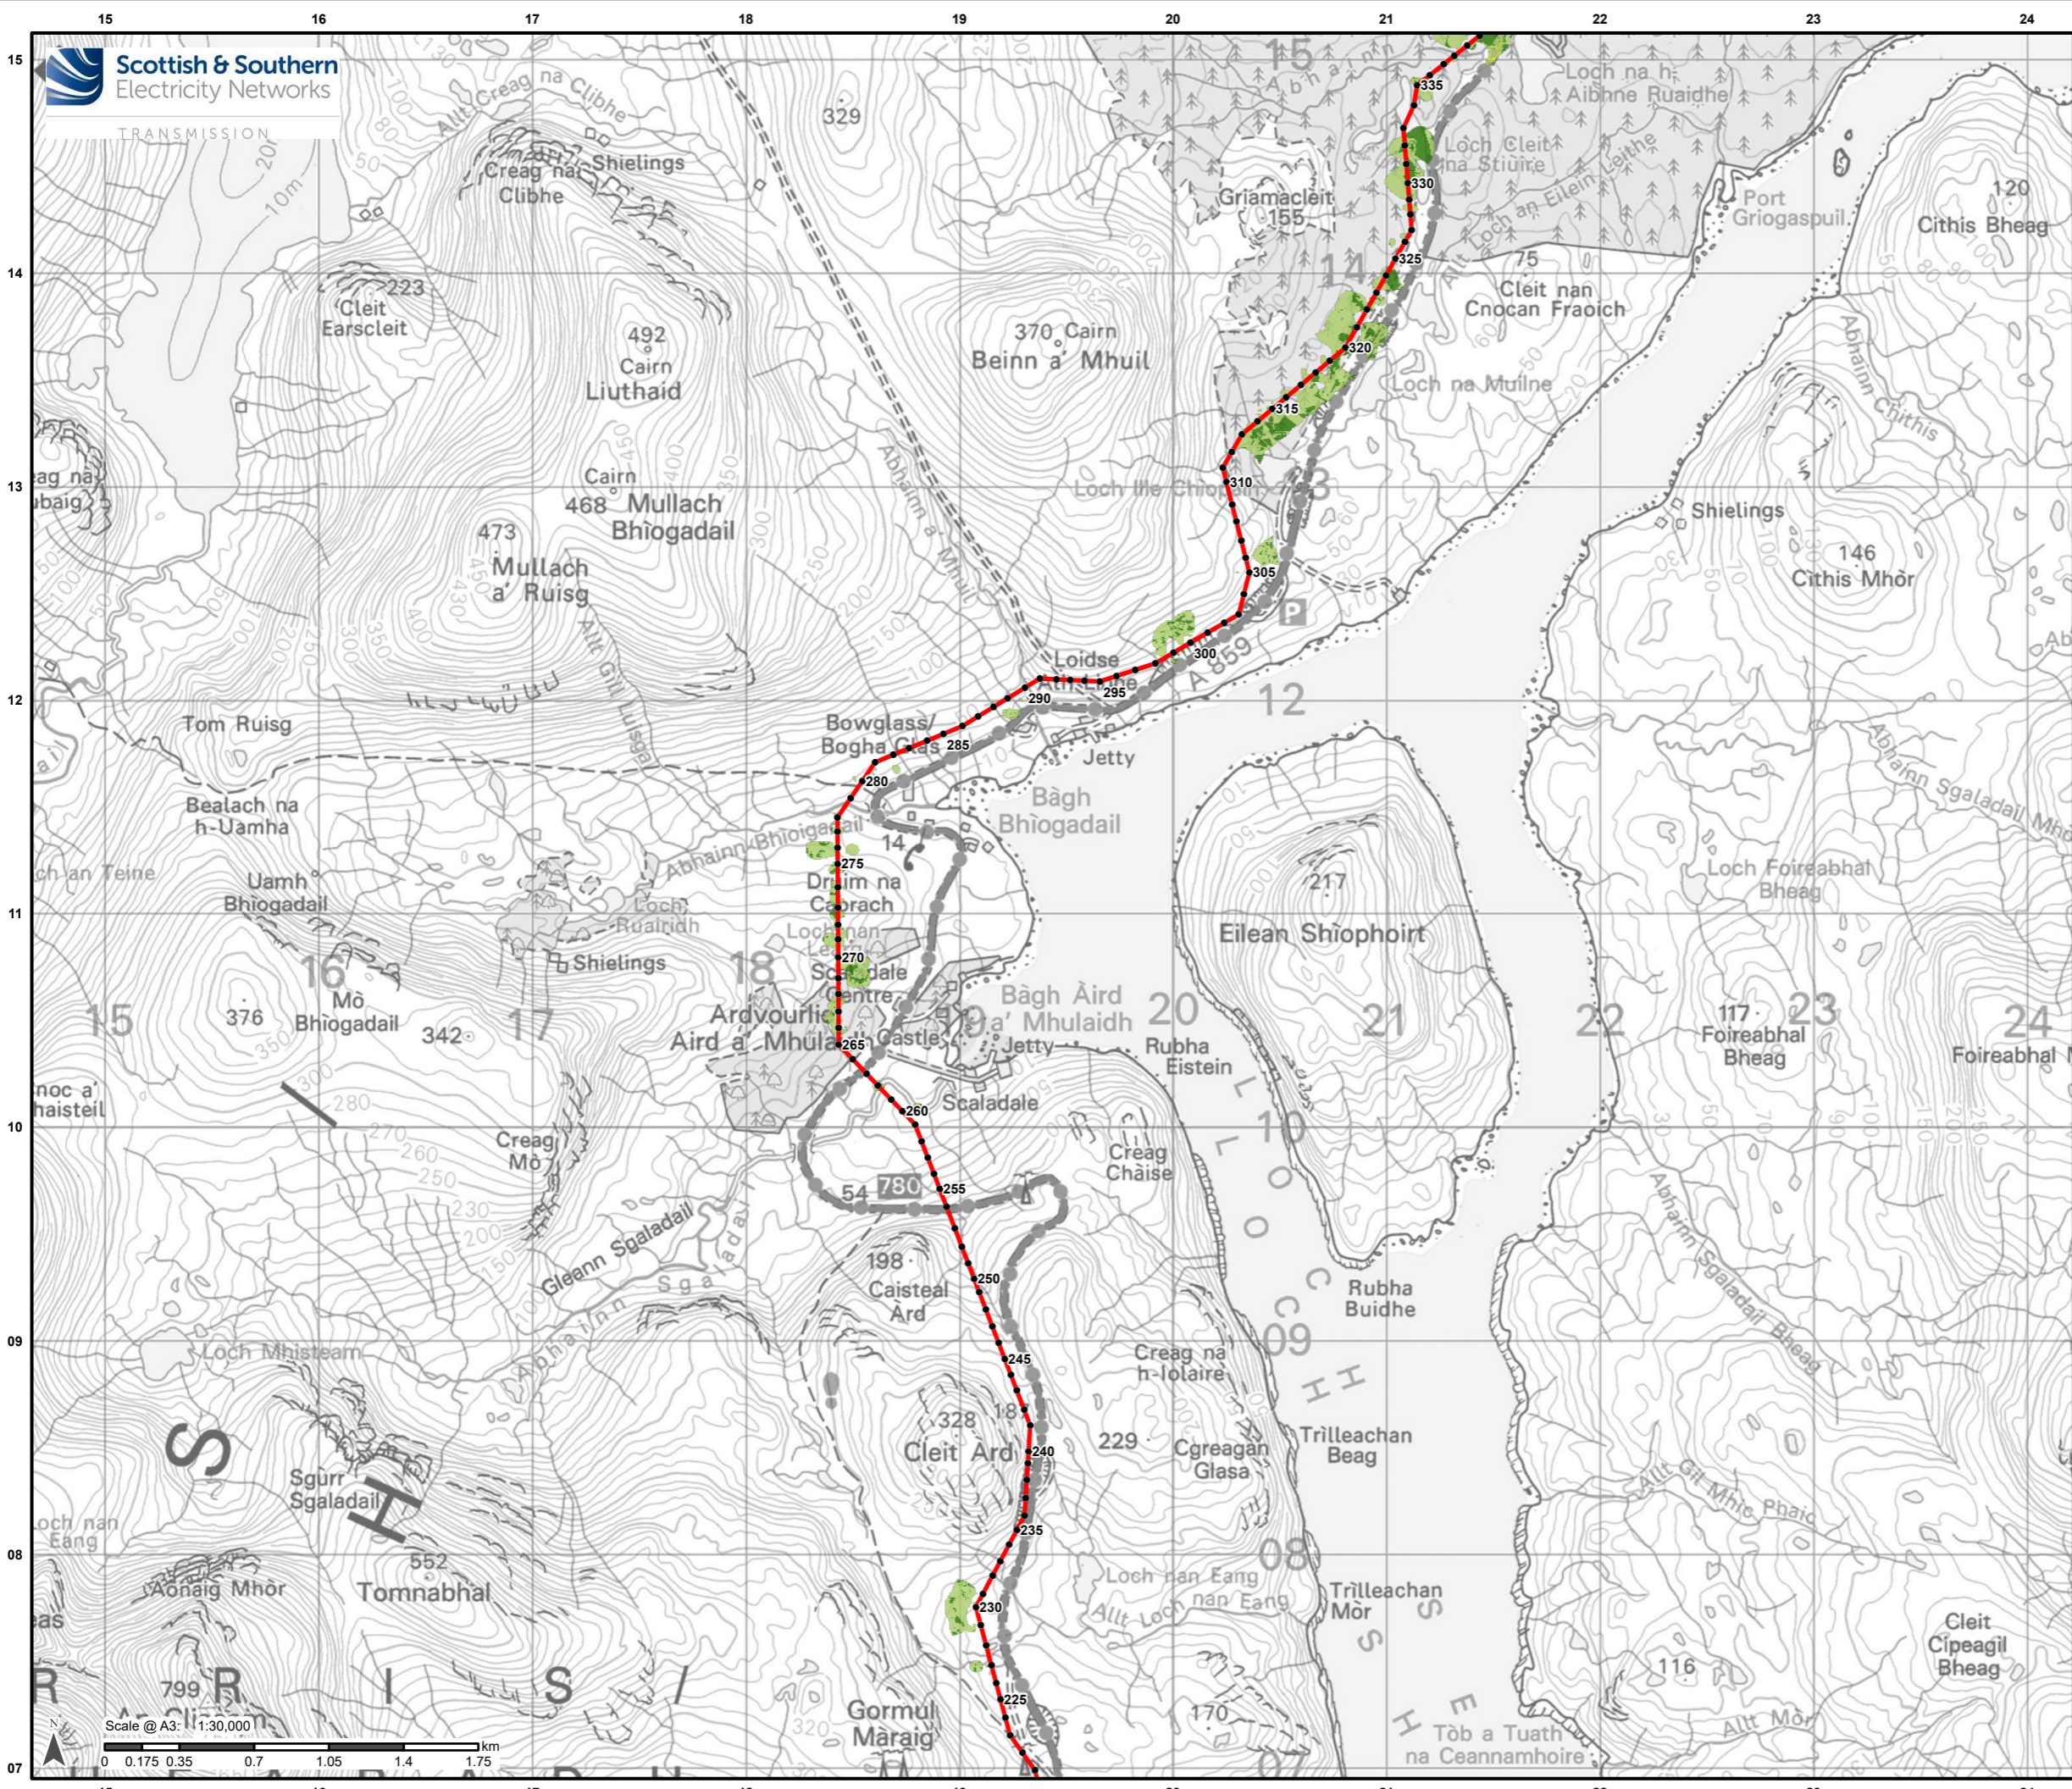


Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.8c: Peat Landslide Hazard and Risk Assessment: Peat Slide Likelihood

Drawn by: AB Date: 31/08/2022


Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A



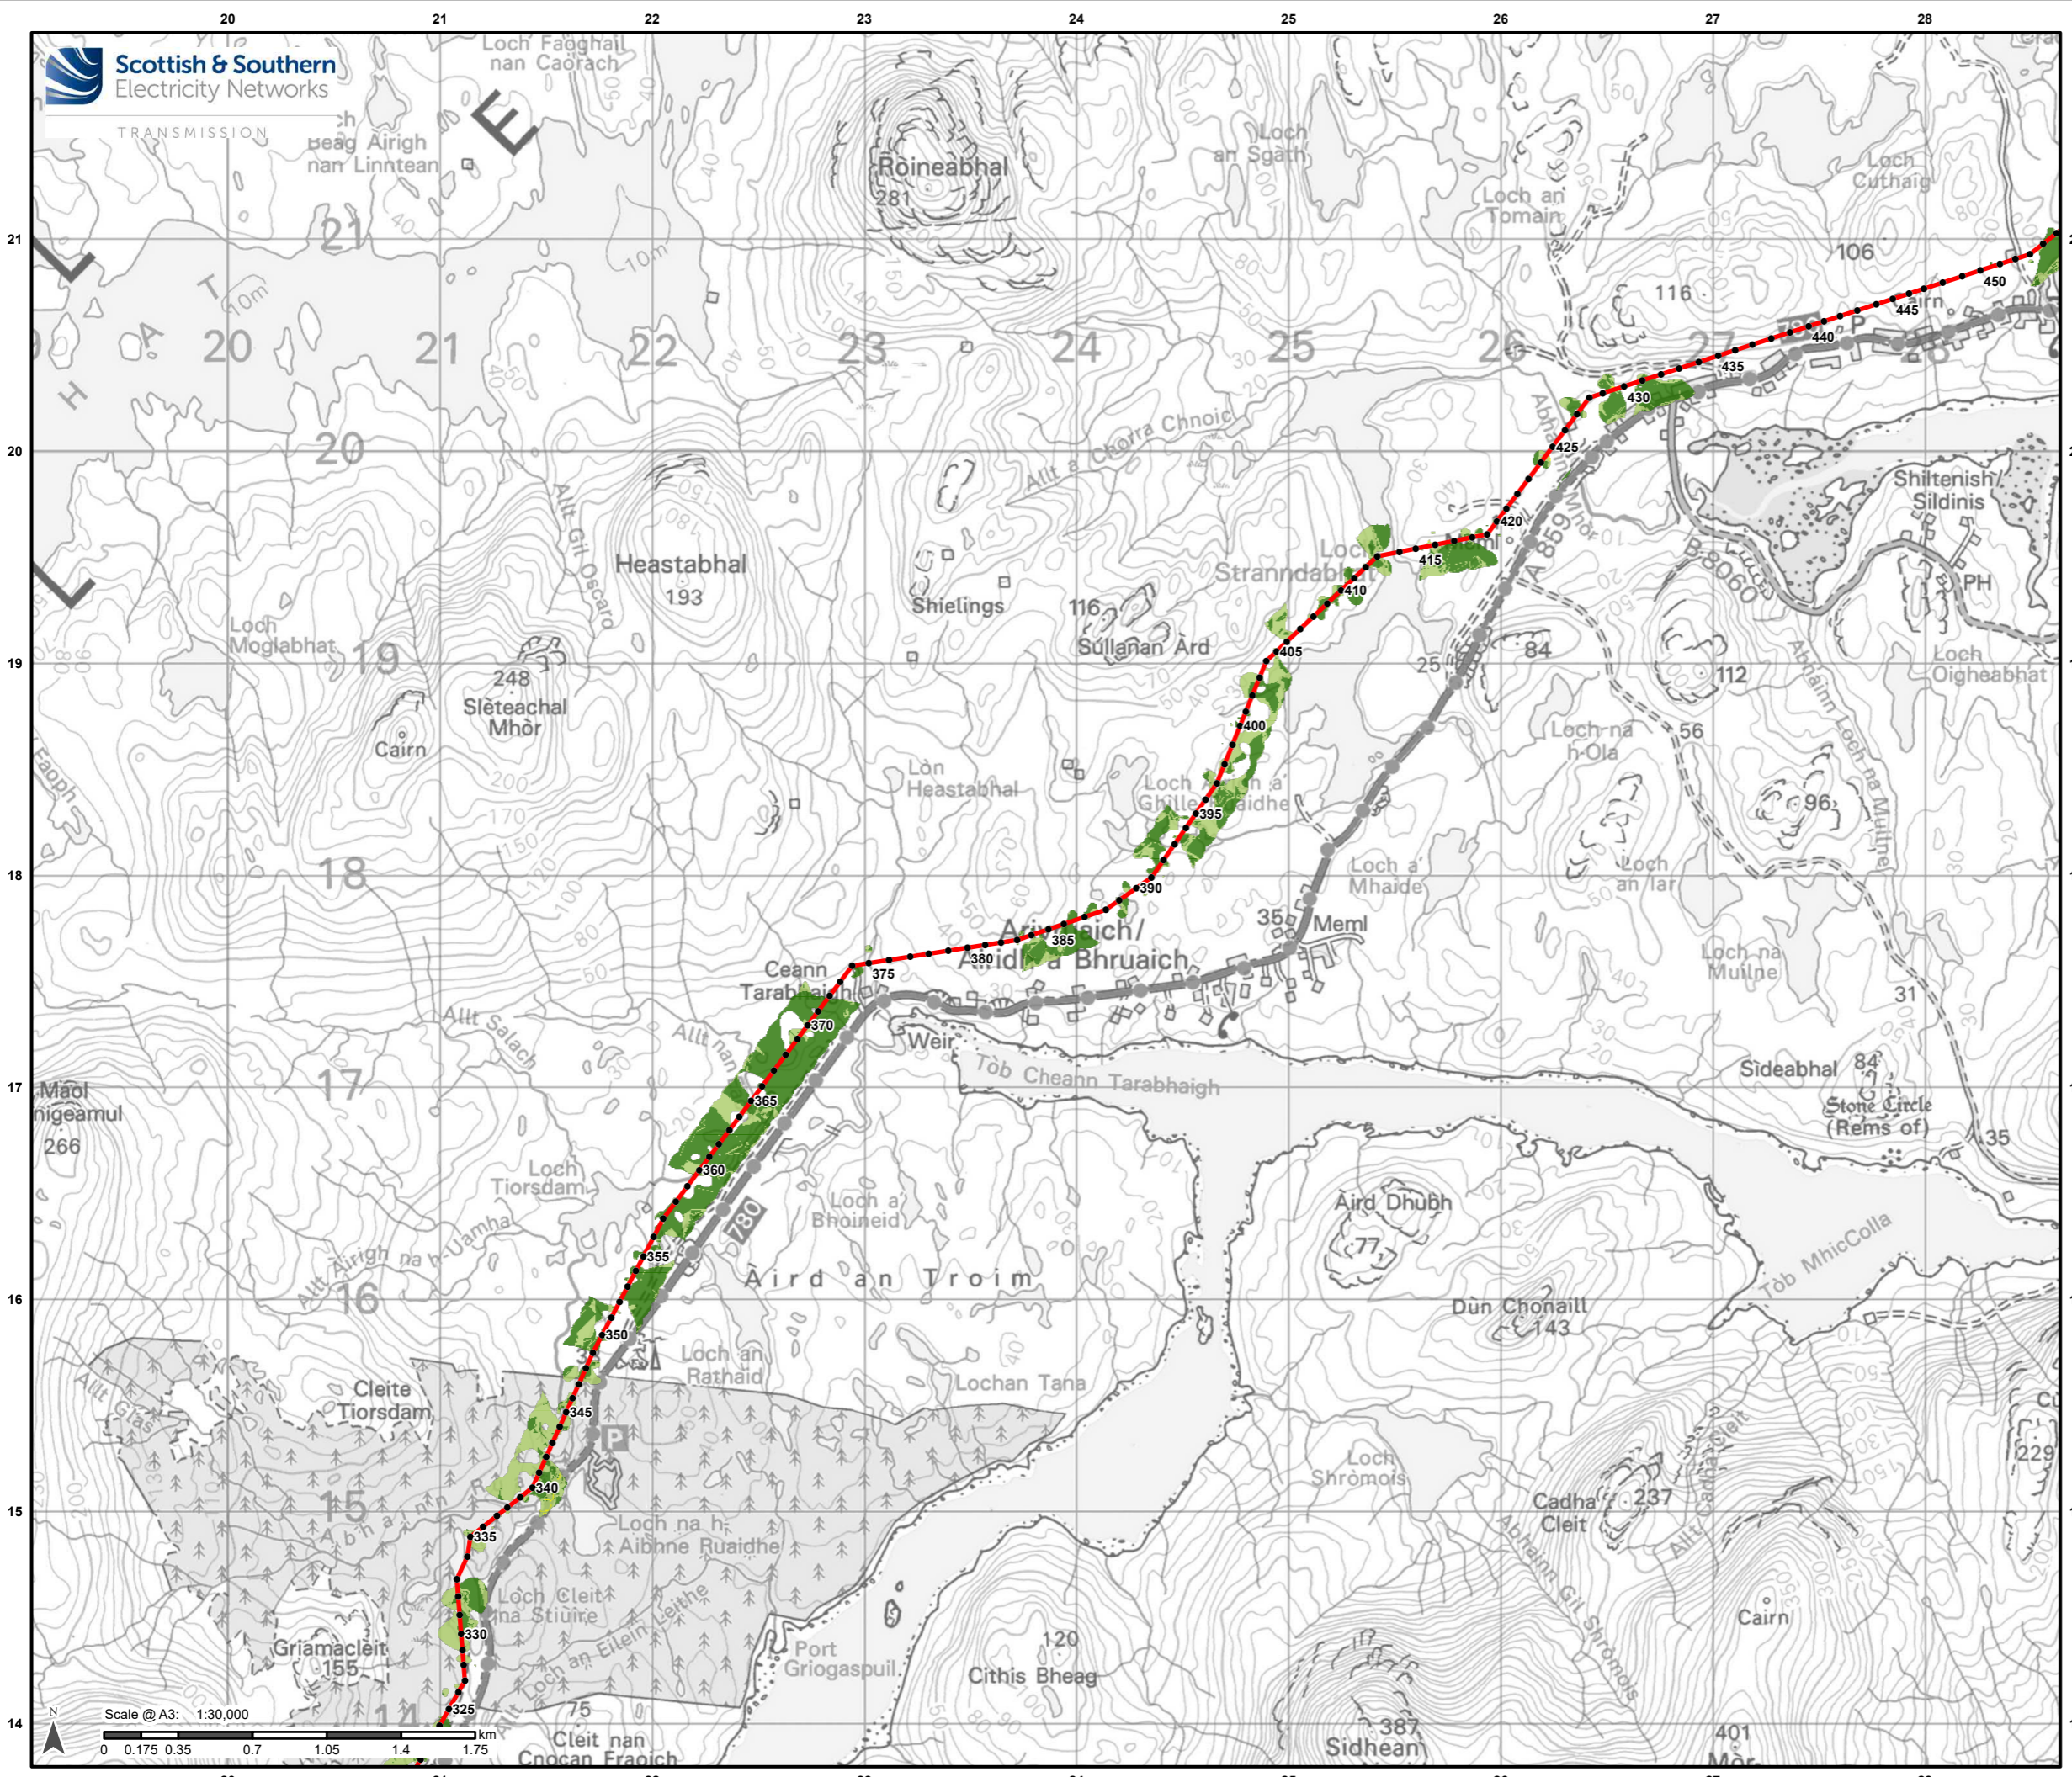

Legend

- Proposed Alignment
 - Indicative Pole Location
- Summed Score / Likelihood Score**
- 2 - 6 (Very Low, 1)
 - 7 - 11 (Low, 2)
 - 12 - 16 (Moderate, 3)

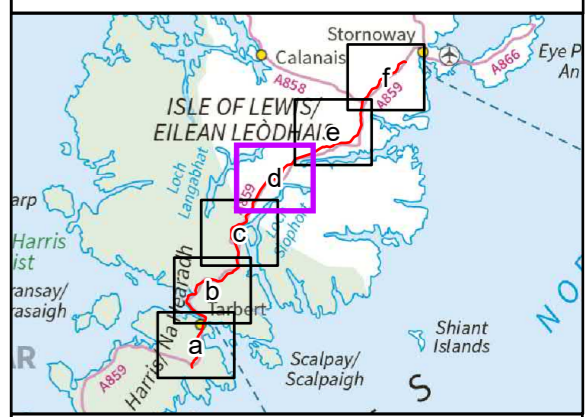


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number 0100022432.


Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title:
Figure 10.3.8d:
Peat Landslide Hazard and Risk Assessment:
Peat Slide Likelihood

Drawn by: AB Date: 31/08/2022


Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A



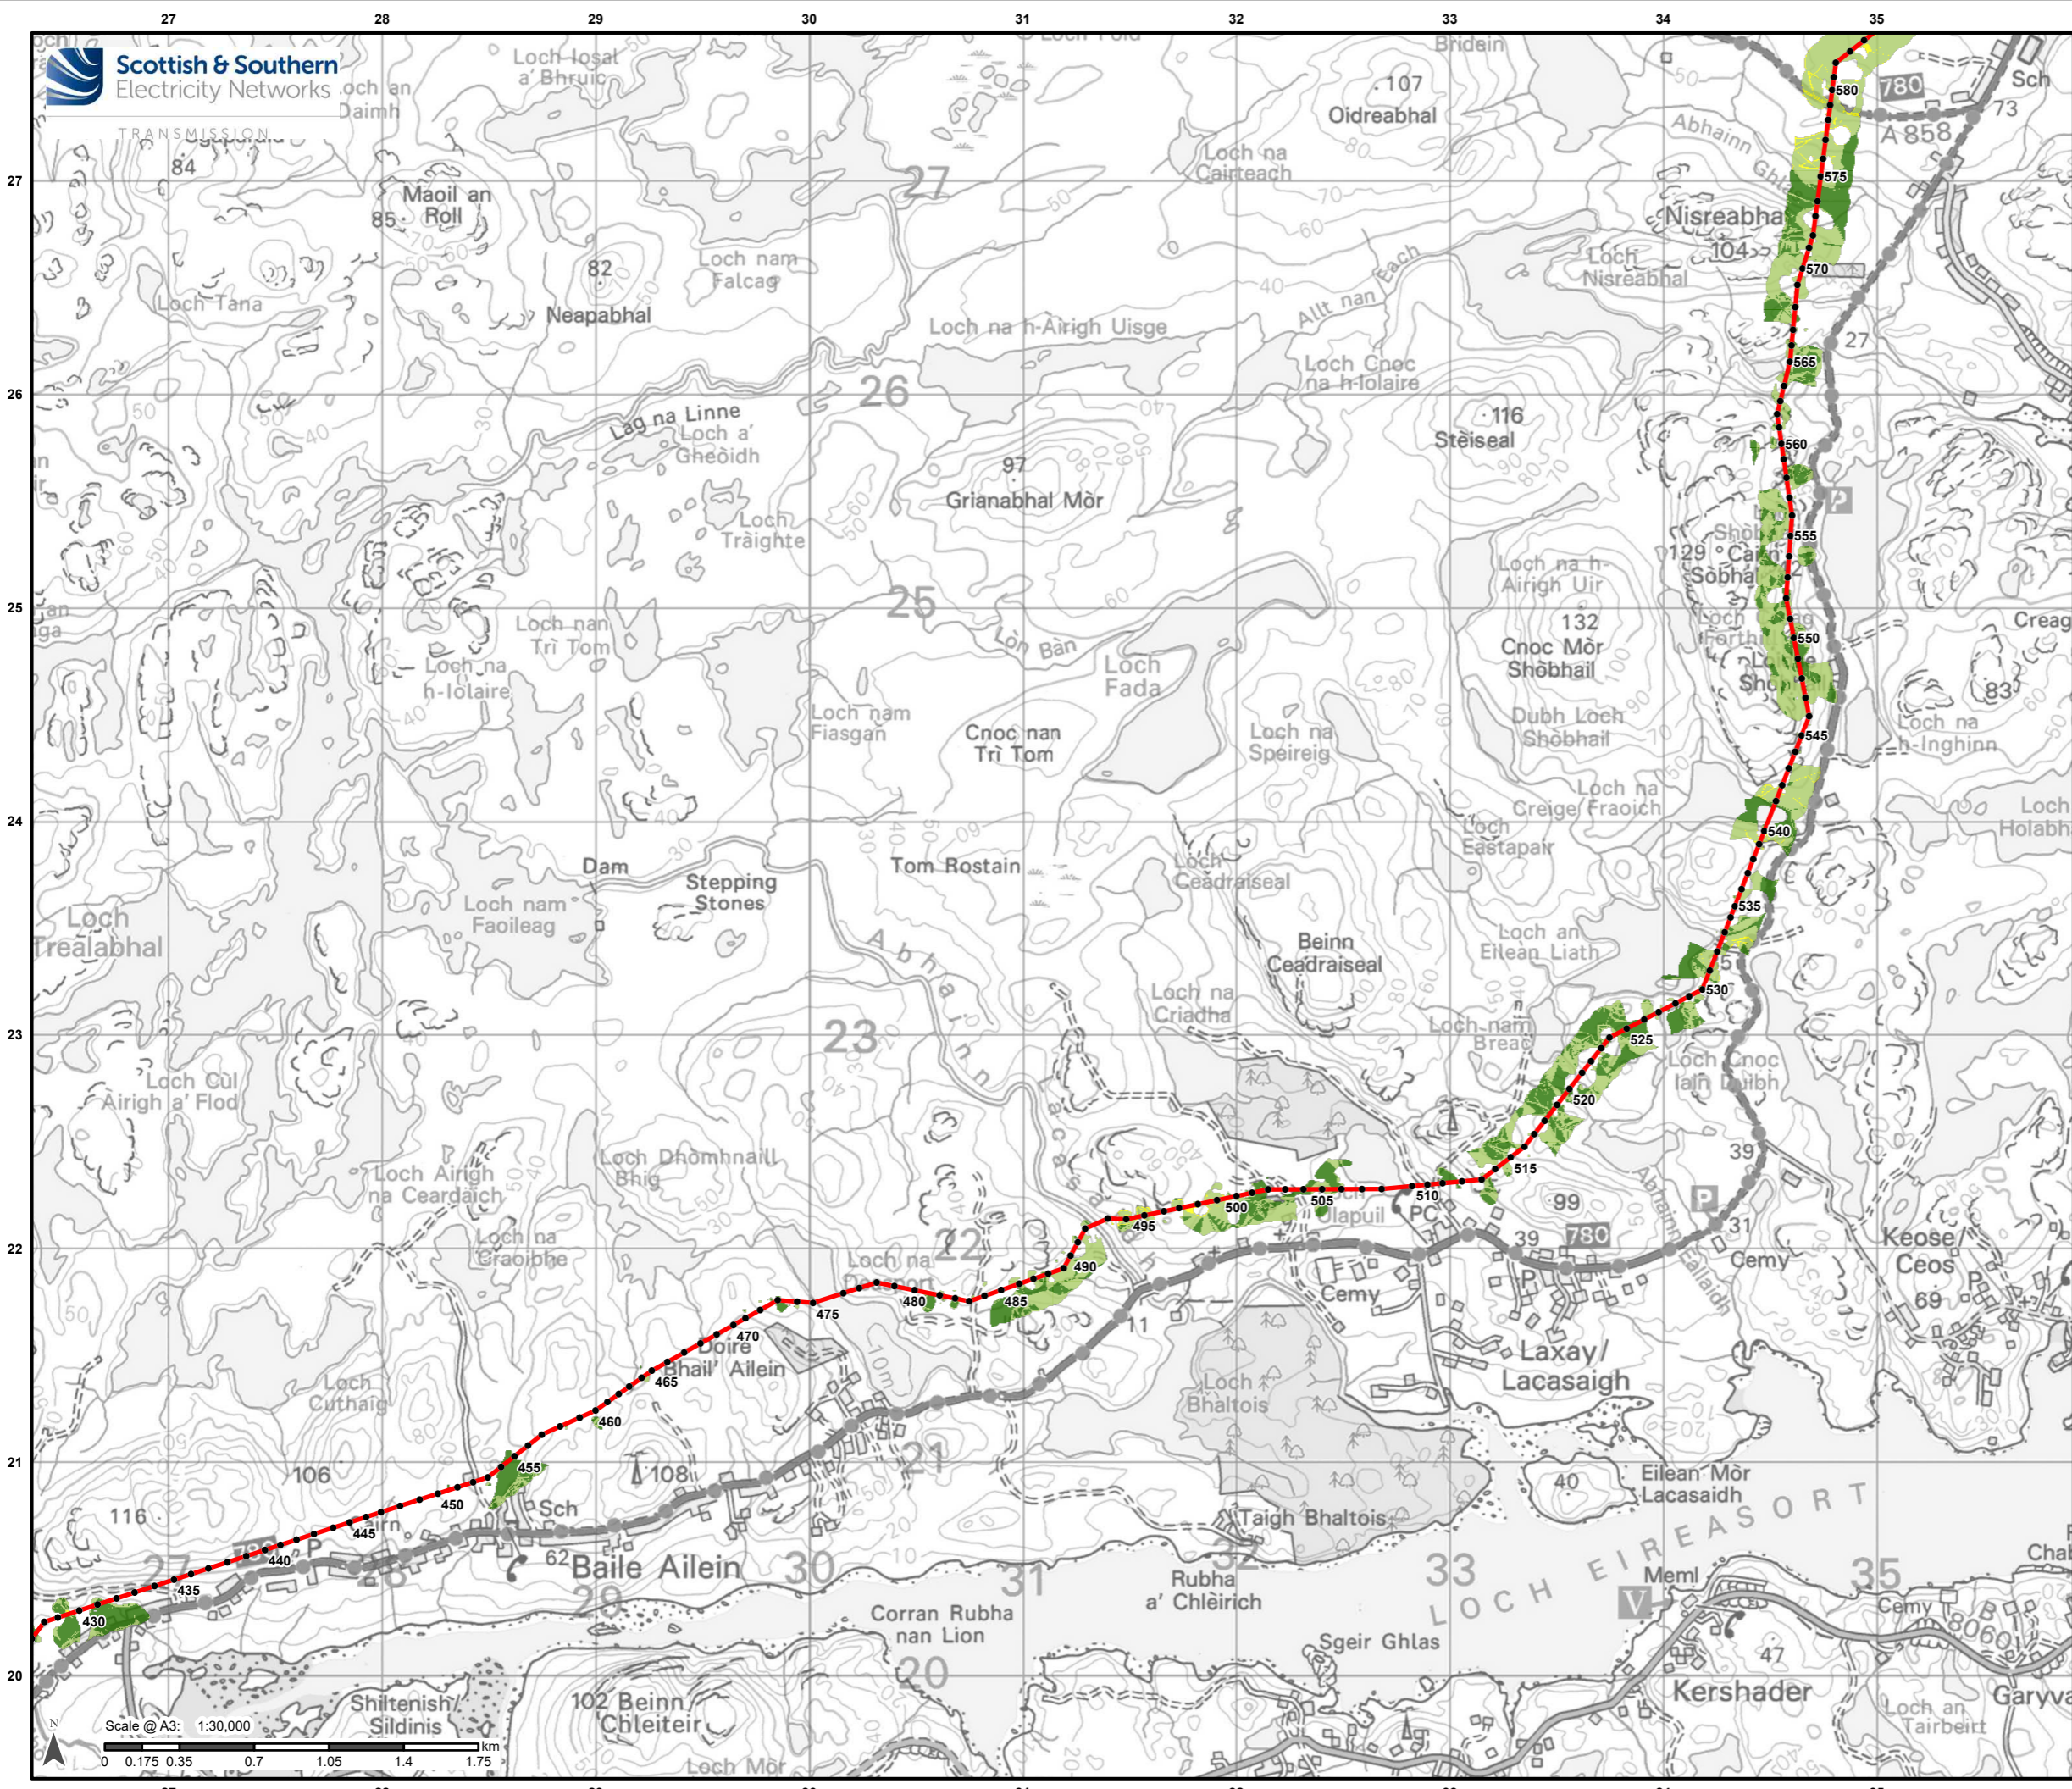

Legend

- Proposed Alignment
 - Indicative Pole Location
- Summed Score / Likelihood Score**
- 2 - 6 (Very Low, 1)
 - 7 - 11 (Low, 2)
 - 12 - 16 (Moderate, 3)

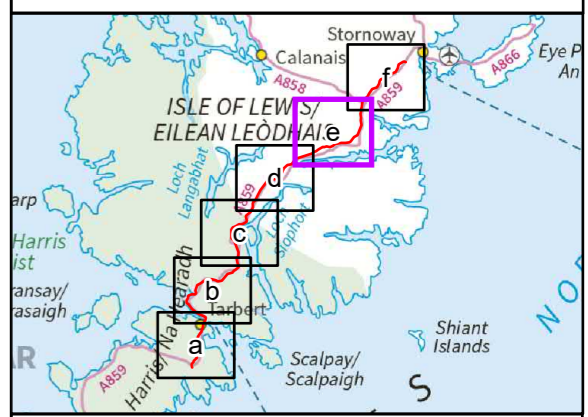

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number 0100022432.


Project No: LT0245

Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.8e:
Peat Landslide Hazard and Risk Assessment:
Peat Slide Likelihood

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A

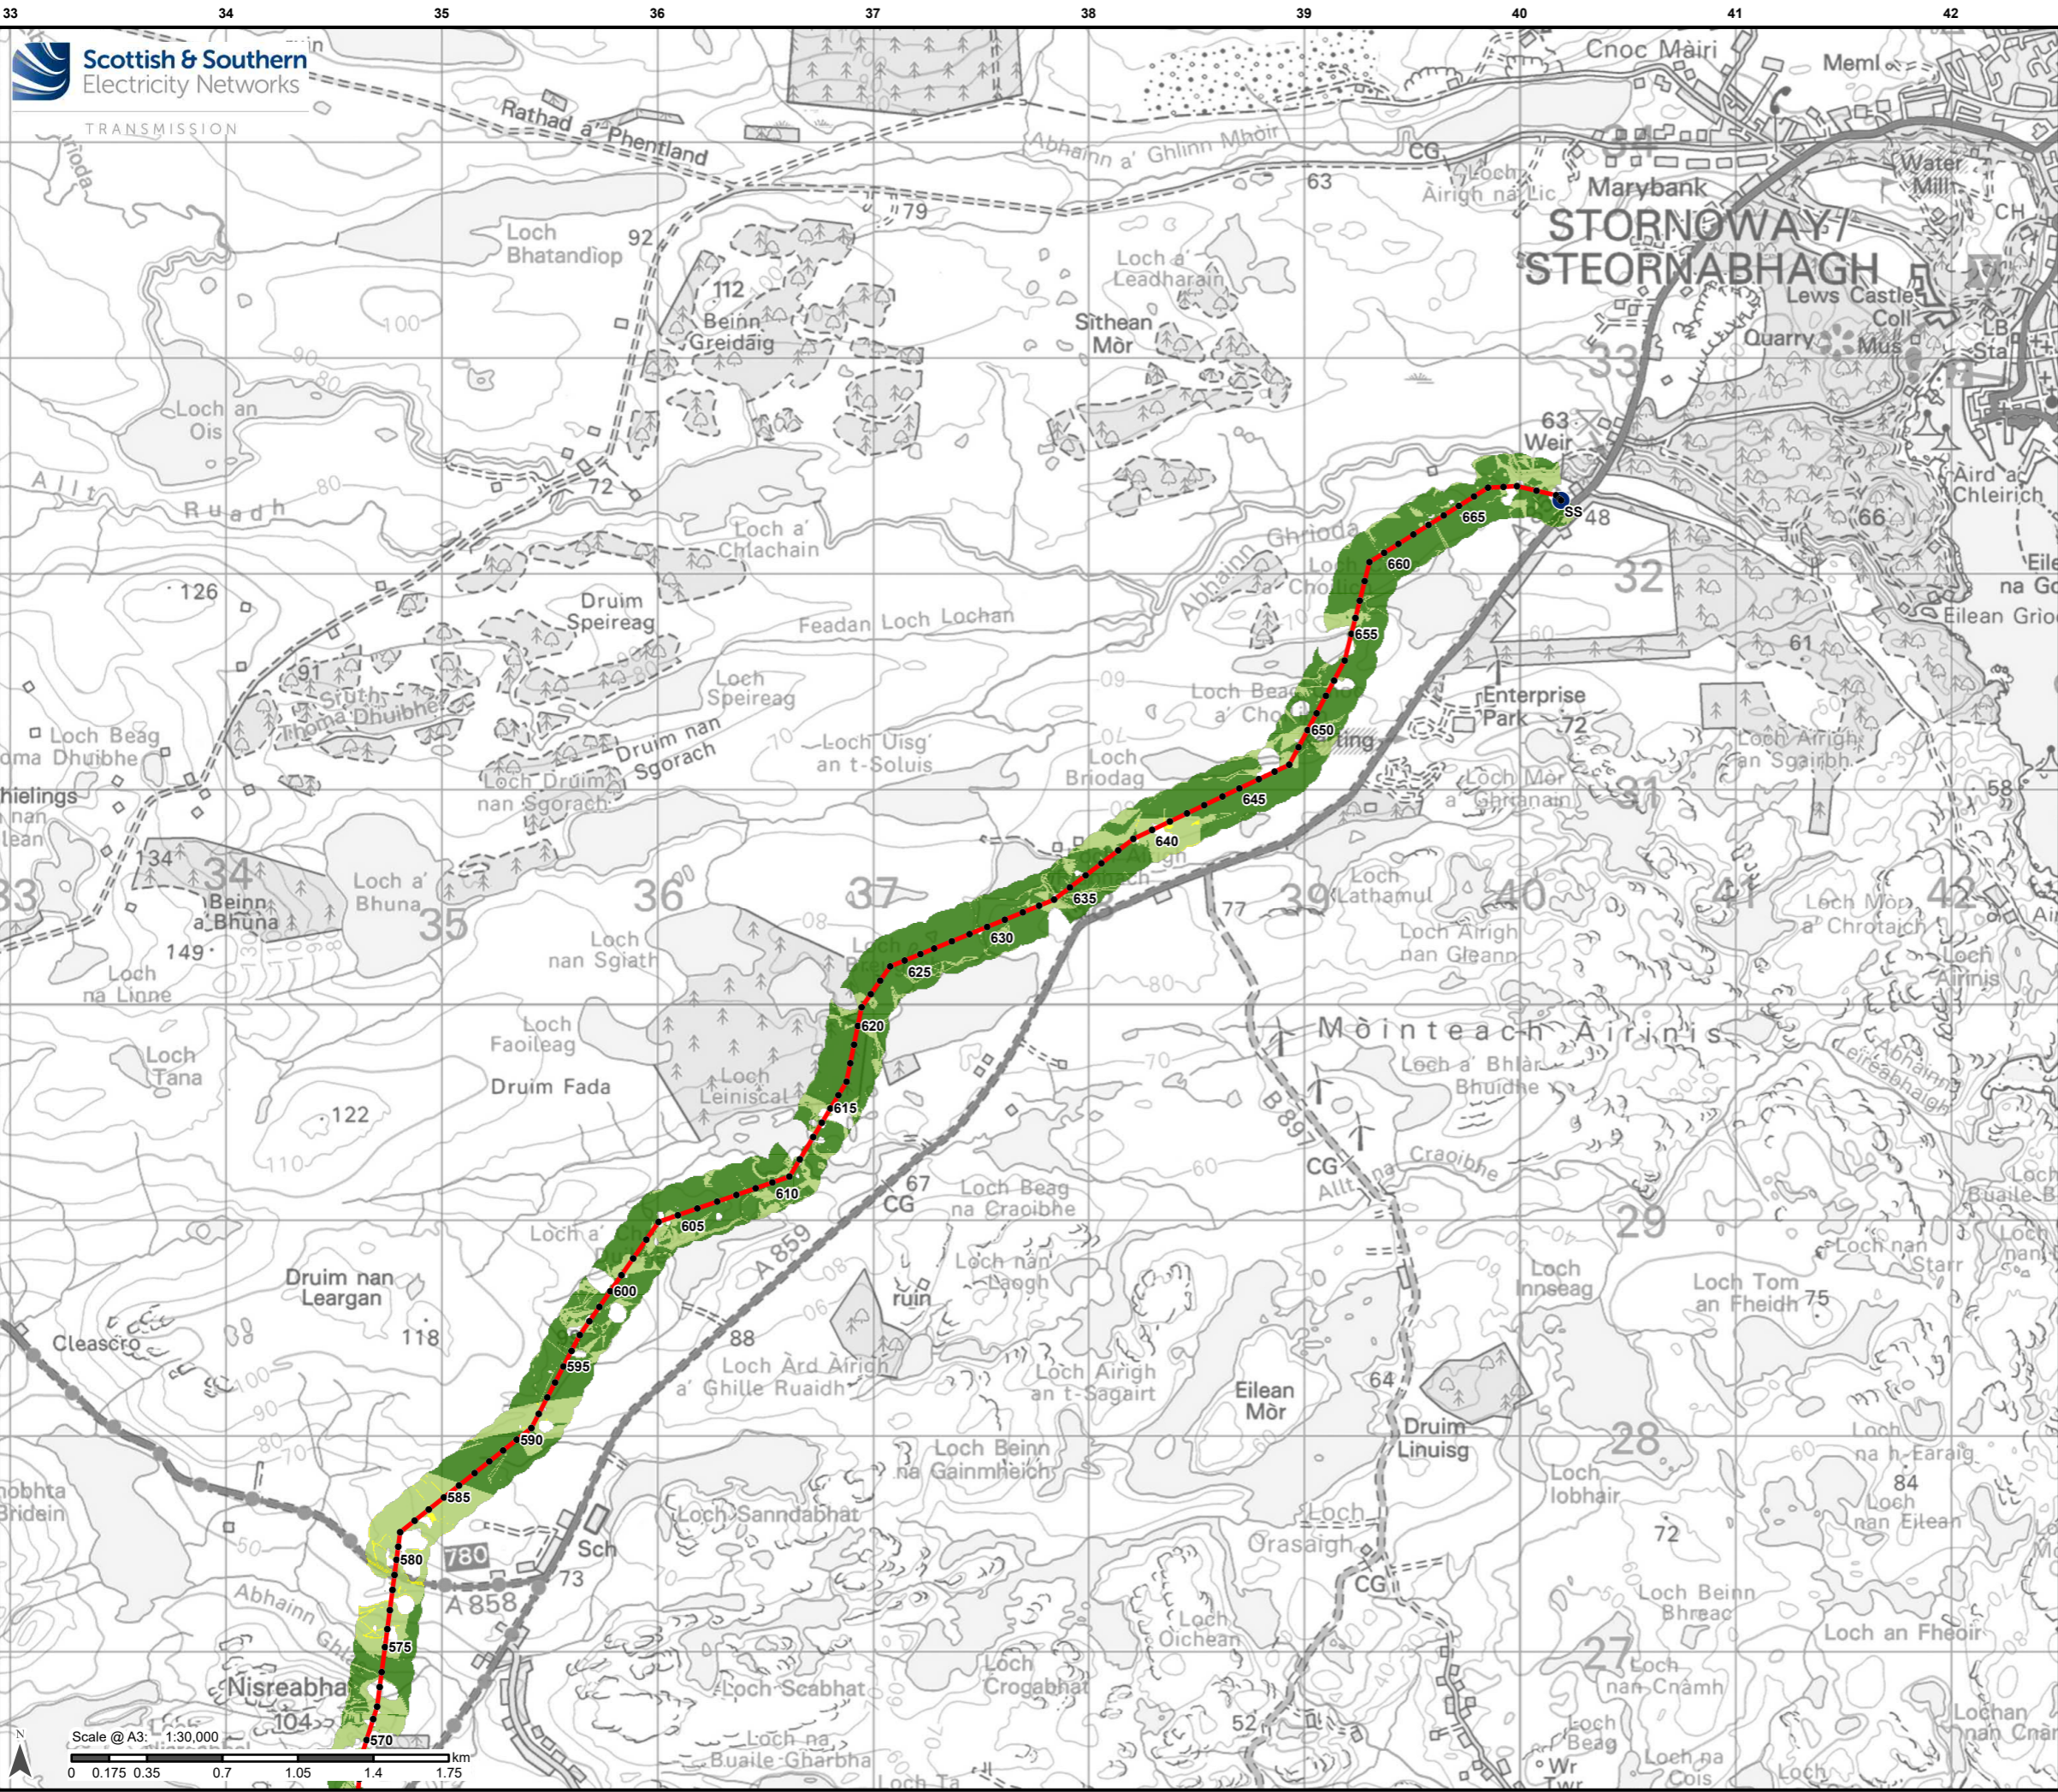


Legend

- Proposed Alignment
- Indicative Pole Location
- Stornoway Substation

Summed Score / Likelihood Score

- 2 - 6 (Very Low, 1)
- 7 - 11 (Low, 2)
- 12 - 16 (Moderate, 3)

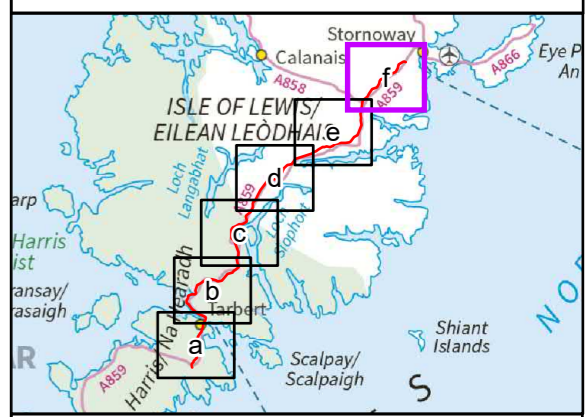

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2022 all rights reserved. Ordnance Survey Licence number 0100022432.

Project No: LT0245
Project: Harris to Stornoway 132 kV OHL Replacement

Title: Figure 10.3.8f:
Peat Landslide Hazard and Risk Assessment:
Peat Slide Likelihood

Drawn by: AB Date: 31/08/2022

Drawing: R162_11469_001_Fig10-3-8_PeatSlideLikelihood_A

