


739 000m.N

736 000m.N

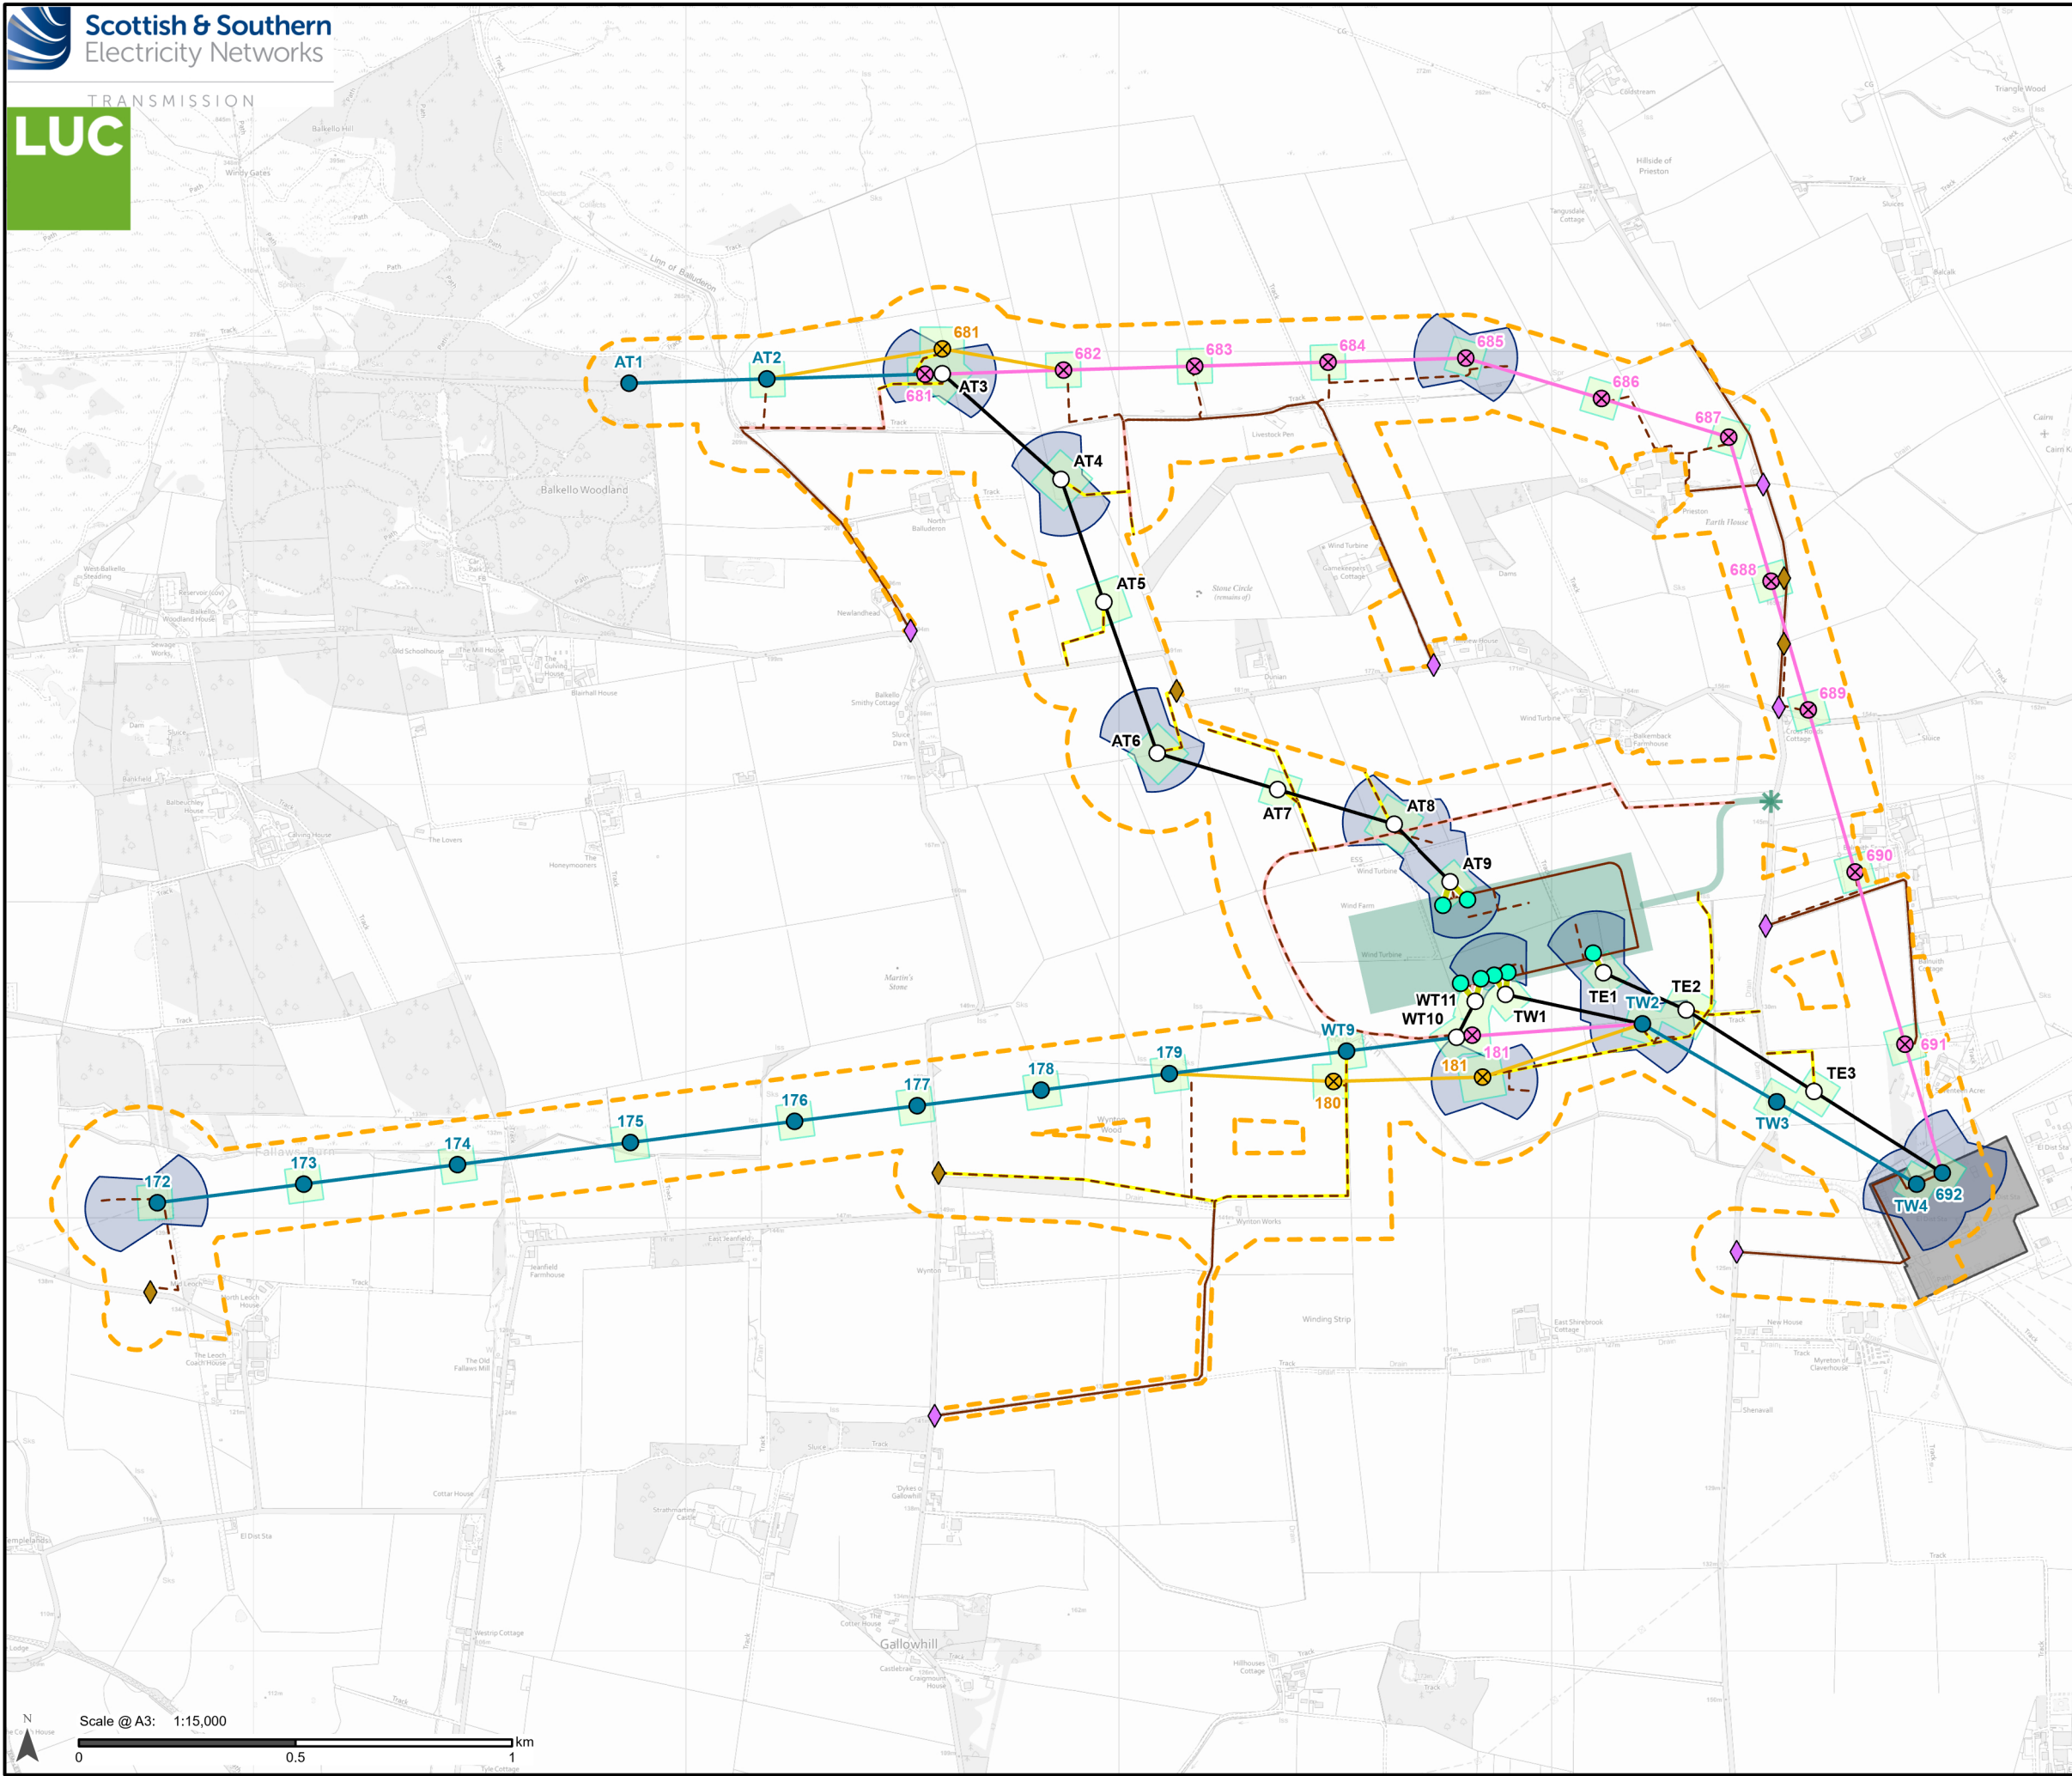

739 000m.N

736 000m.N

Proposed Development

- Proposed Tower
- ⊗ Existing tower to be dismantled
- ⊗ Temporary diversion tower
- Existing tower position to be retained
- Proposed Alignment
- Existing overhead line to be removed
- Temporary diversion of overhead line
- Existing overheadline reconductoring
- Download
- Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary
- Trackway

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Temporary working areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

Intra (Associated) Developments

- Proposed gantry
- Existing access track to be upgraded as part of Proposed Emmock 400 kV substation
- ★ New bellmouth as part of Proposed Emmock 400 kV substation
- Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/ FULN)

Existing Infrastructure

- Existing Tealing Substation

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Emmock and Tealing Overhead Line Tie-ins

Title: Proposed Development for which Section 37 Consent (Electricity Act, 1989) is sought

Drawn by: MS Date: 23/09/2025

Drawing: 3.1

Scale @ A3: 1:15,000

0 0.5 1 km

336 000m.E

340