


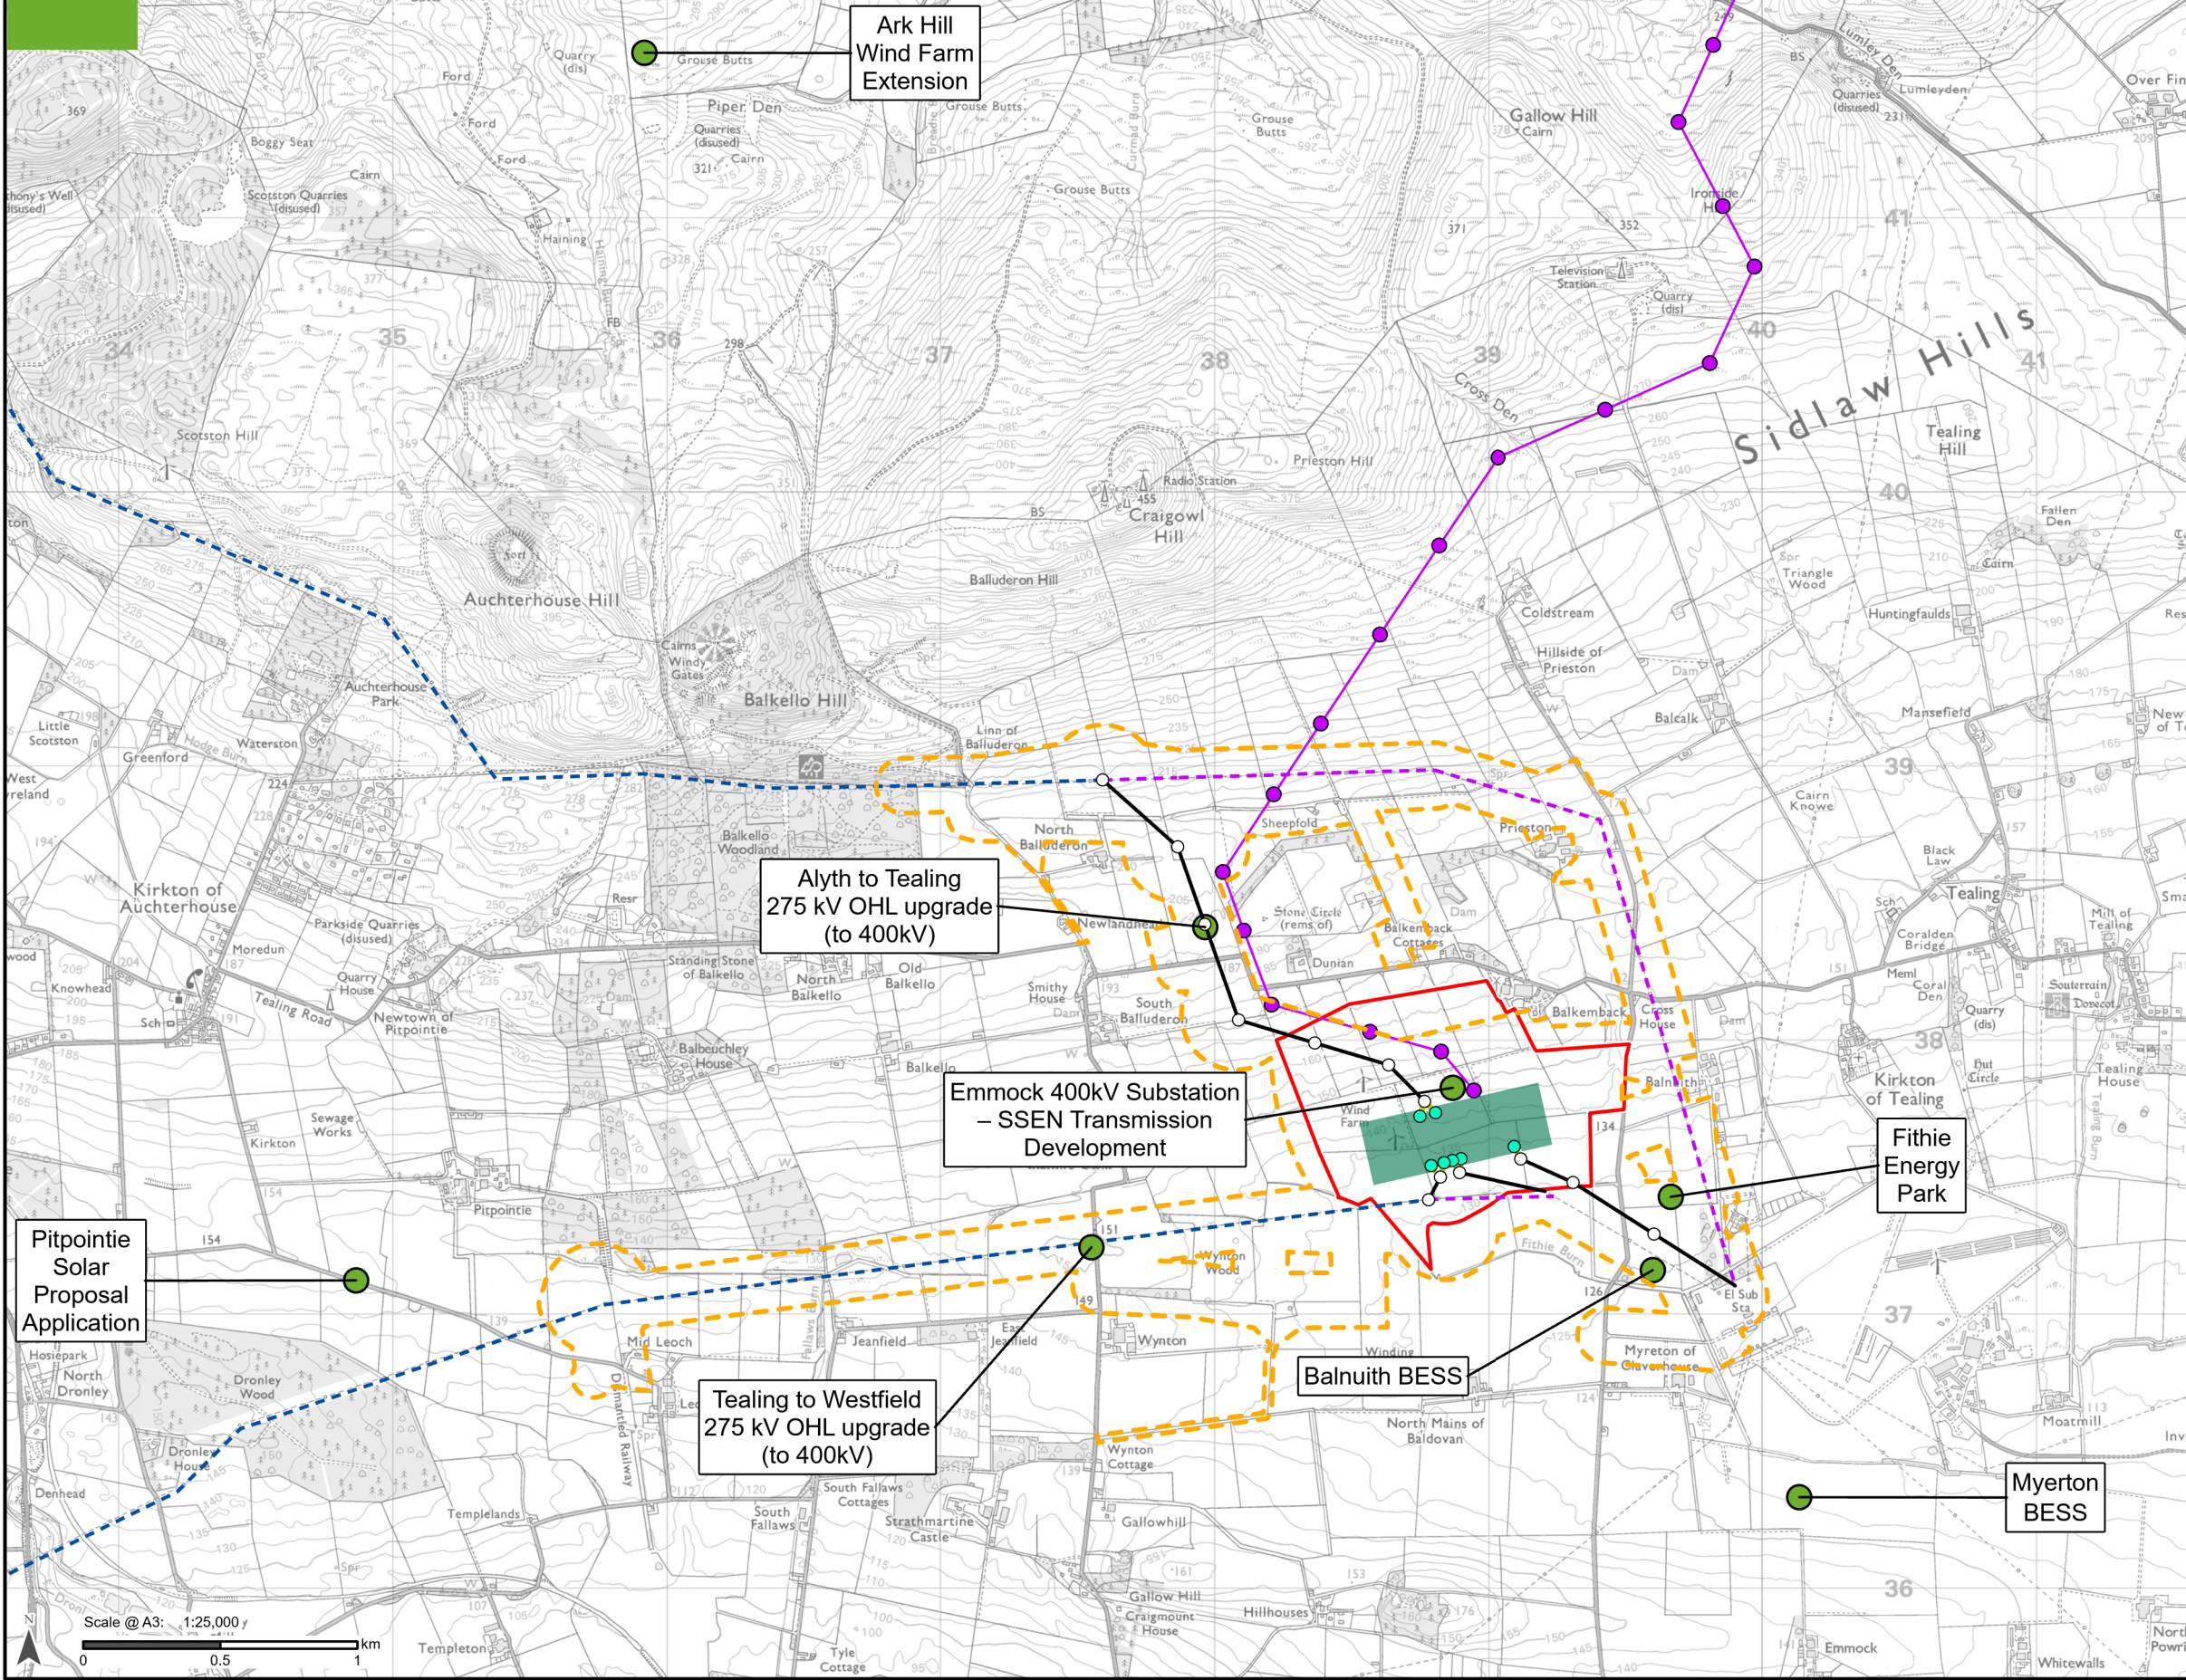

Proposed Development

- Proposed Tower
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Download

Other SSEN project related developments

- Kintore to Tealing OHL tower
- Kintore to Tealing OHL alignment

Intra (Associated) Developments

- Proposed gantry
- Proposed Emmock red line boundary
- Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/FULN)

Inter Developments

- Cumulative development
- Alyth to Tealing and Tealing to Westfield 275 kV OHL Upgrade (to 400 kV)


Emmock and Tealing OHL Tie-ins and Tie-backs ECU00005204

Existing Alyth to Tealing and existing Tealing to Westfield OHL Dismantling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

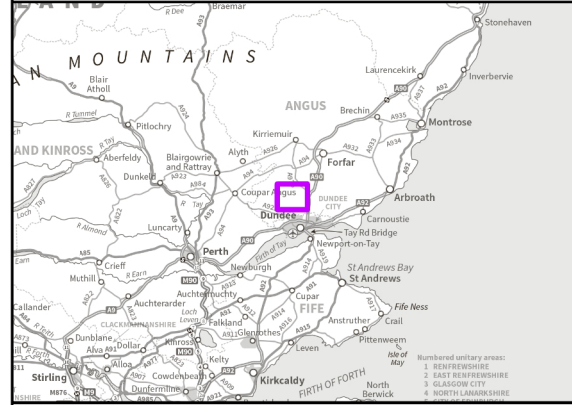

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Emmock and Tealing Overhead Line Tie-ins

Title:

Cumulative Developments

Drawn by: MS

Date: 23/09/2025

Drawing: 5.1