




D	Future bays removed	15'	10'	10000'
C	Attenuation pond removed. Concrete apron added.	15'	10'	20000'
B	Revised platform layout	15'	10'	50000'
A	Platform layout oriented. Planning boundary added.	15'	10'	50000'
DESCRIPTION	DATE	APPROVED	DATE	

PLANNING

C O N S U L T I N G E N G I N E E R S

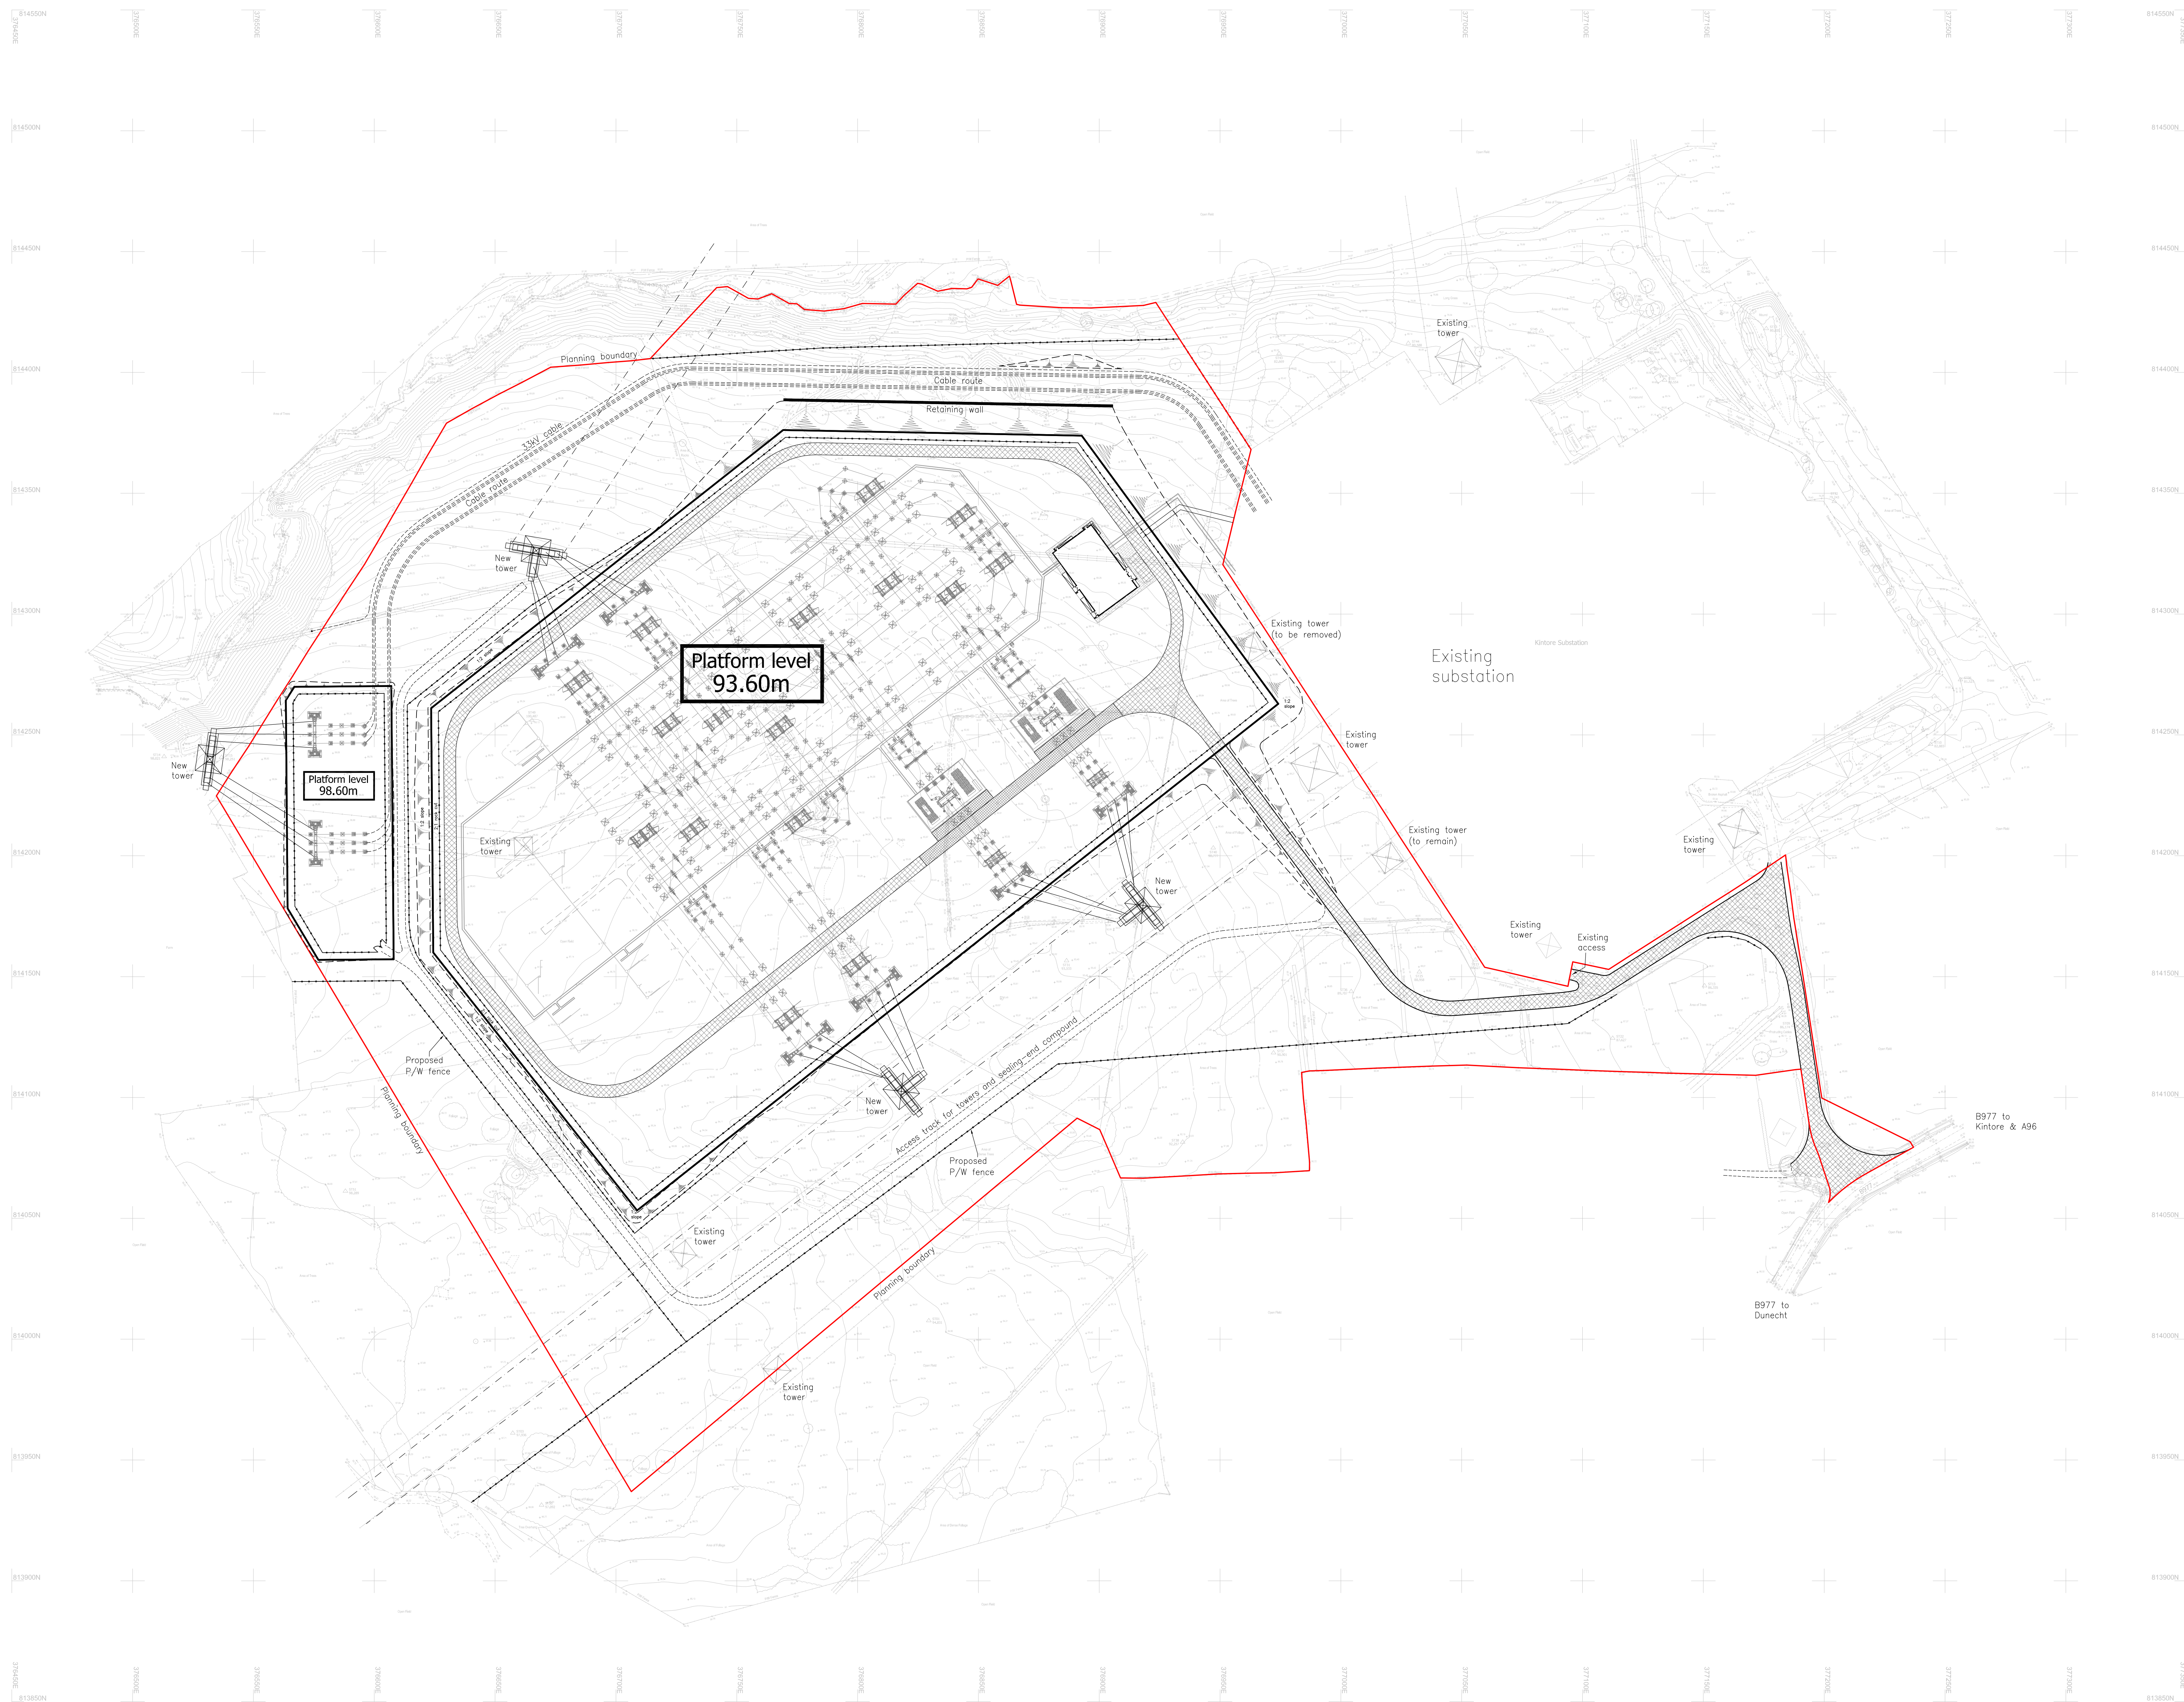

23 Chester Street Edinburgh EH3 7EN
TEL 0131-225-1230 FAX 0131-225-5582



PROJECT
LT000011
400kV EAST COAST REINFORCEMENT
KINTORE SUBSTATION

DRAWING TITLE

PROPOSED PLATFORM LAYOUT

DRAWN	TRACED	CHECKED	APPROVED	DATE
EP		CGY	CGY	June 2011
SCALE	DRG No. 49336064/1006			REV.
1:1000				D