



**Scottish & Southern
Electricity Networks**

TRANSMISSION


Kintore to Tealing 400 kV Overhead Line

Environmental Impact Assessment Report (EIAR)

Additional Information (Part 1)

Volume 2: Technical Chapters and Volume 5: Appendices

February 2026

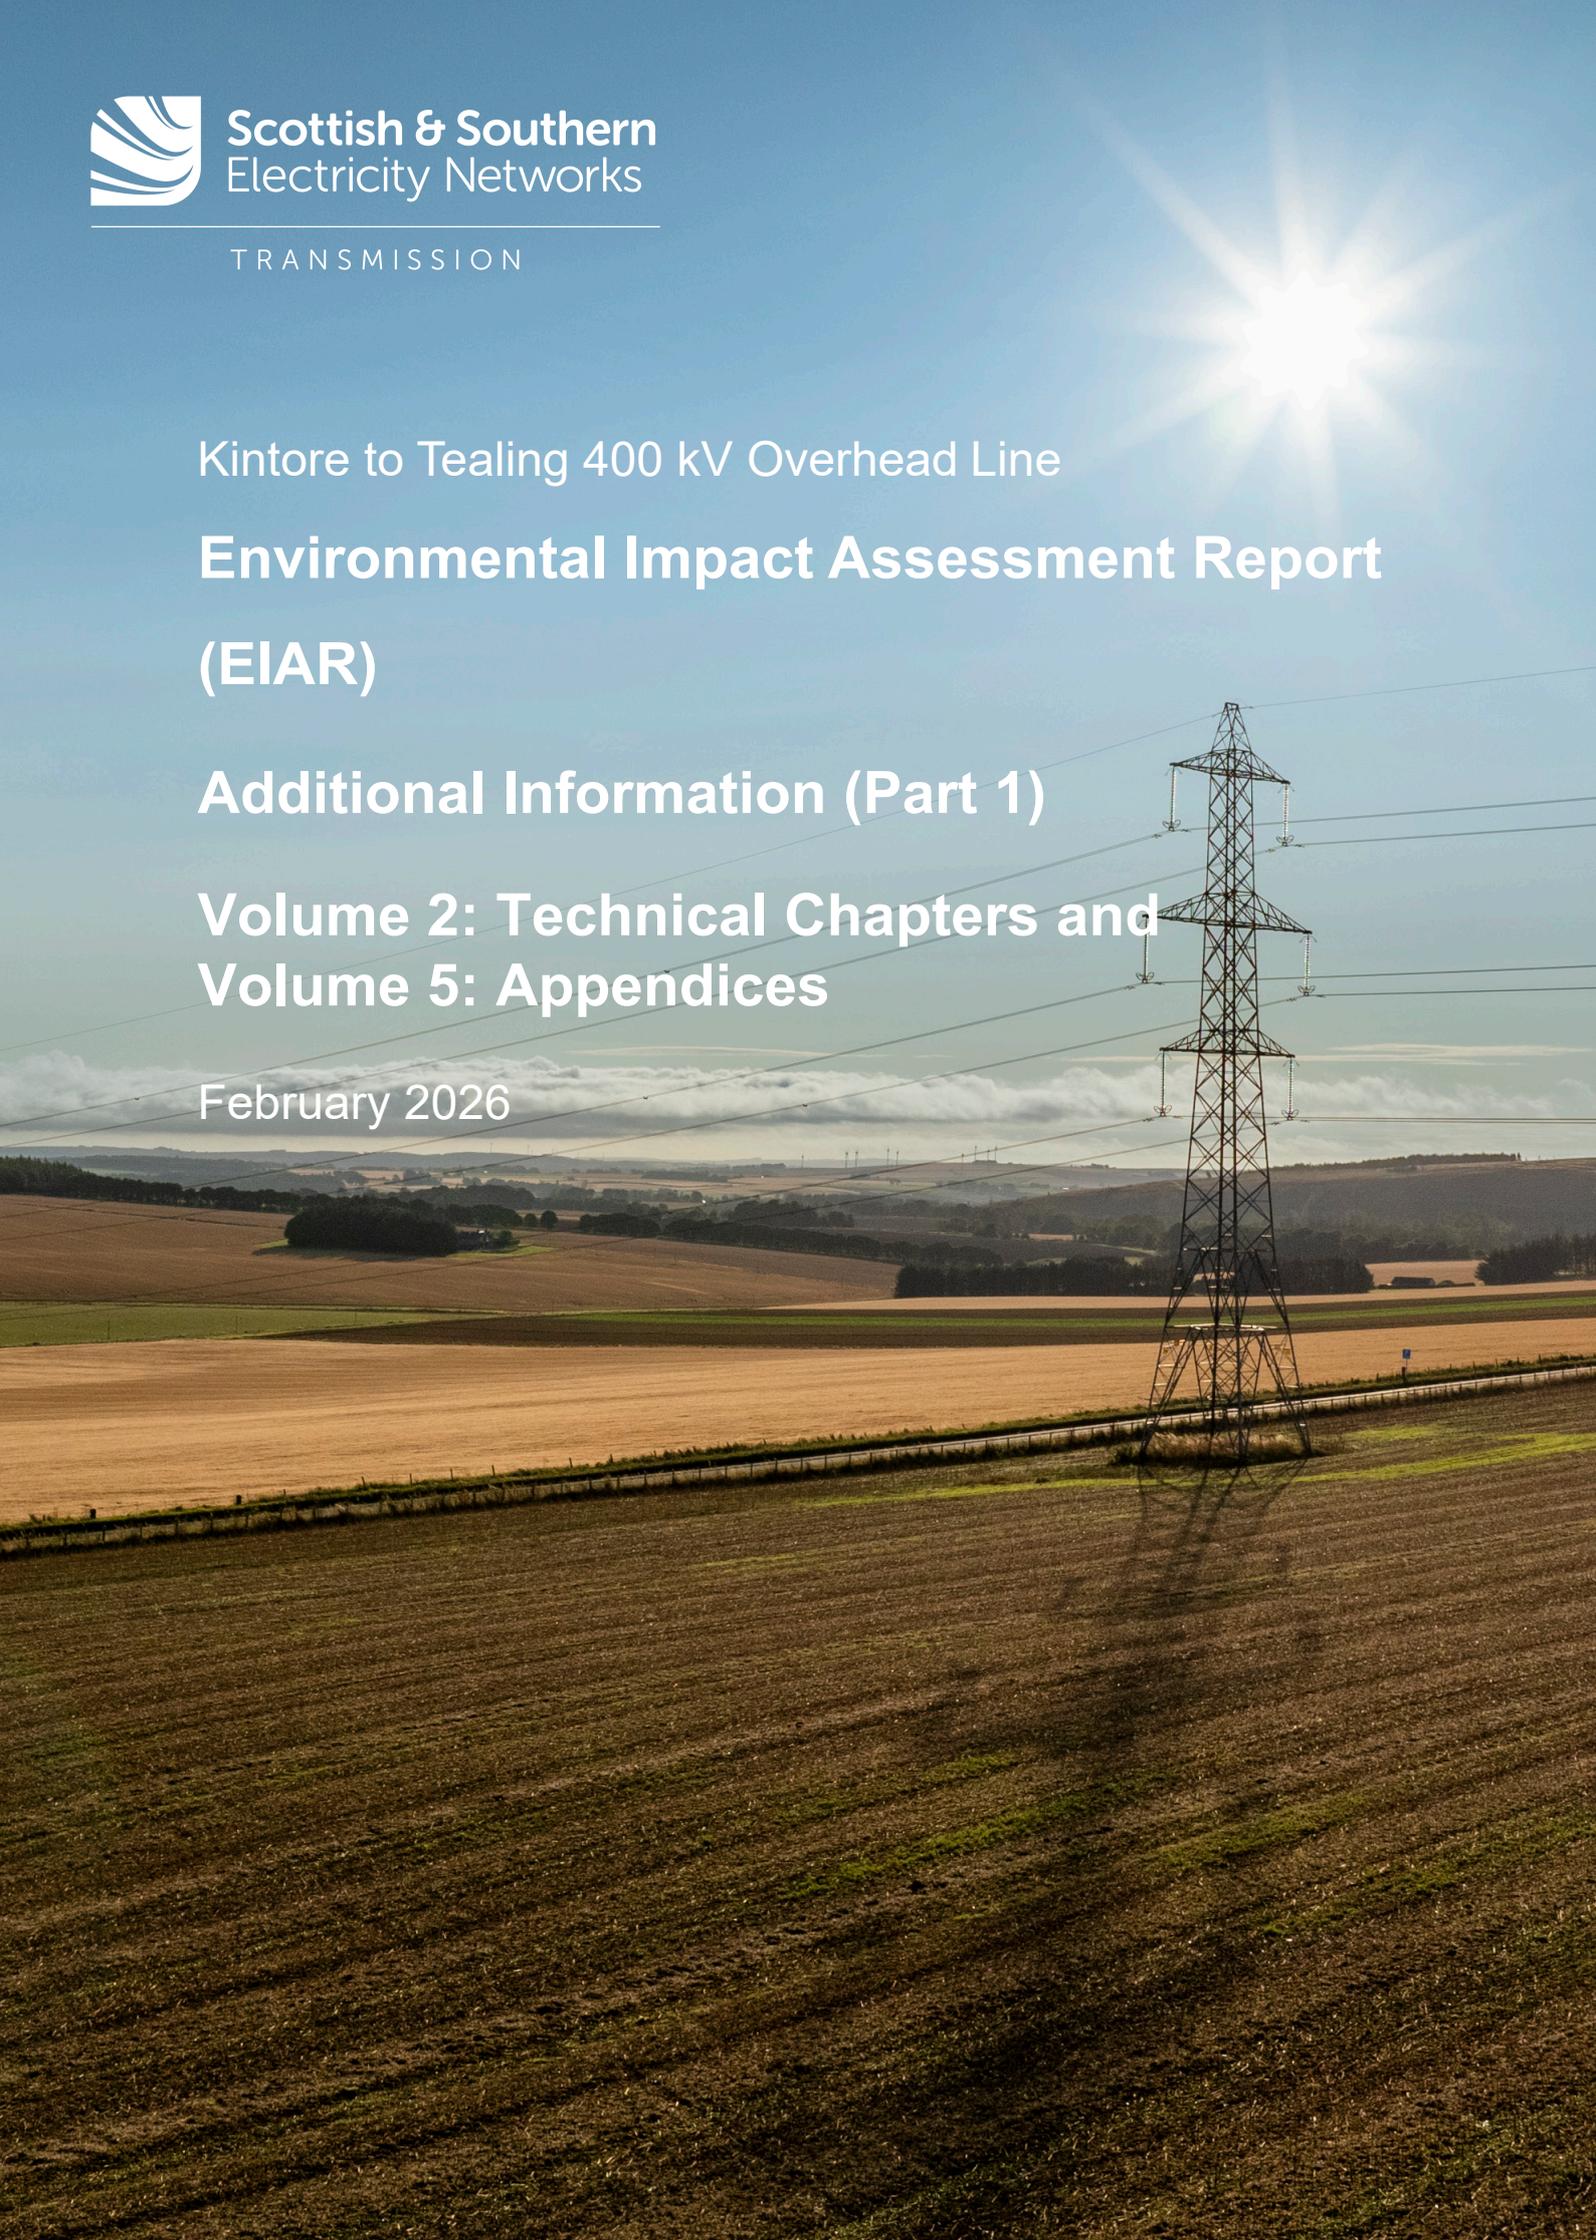

CONTENTS

Volume 2: Technical Chapters

Chapter 11: Ecology

Chapter 13: Hydrology, Hydrogeology, Geology and Soils

Chapter 17: Schedule of Mitigation

Volume 5: Appendices

Appendix 10.6: Inner Study Area Predicted Effects

Appendix 11.2: Habitat and Vegetation Survey Report

Appendix 13.1: Watercourse Crossing and Buffer

Assessment Appendix 13.2: Private Water Supply and Groundwater Abstraction Assessment